


User: G:\user: Paul
 File Path: \\mms\mms\001\projects\287072A\White Rose CCS Interconnection\51 - Deliverables\CAD only\Drawings\287072A-ELE-DRG-017-REV-4-400V Cable Route.dwg
 Date: 12/03/2015 12:30:07
 File Name: \\mms\mms\001\projects\287072A\White Rose CCS Interconnection\51 - Deliverables\CAD only\Drawings\287072A-ELE-DRG-017-REV-4-400V Cable Route.dwg

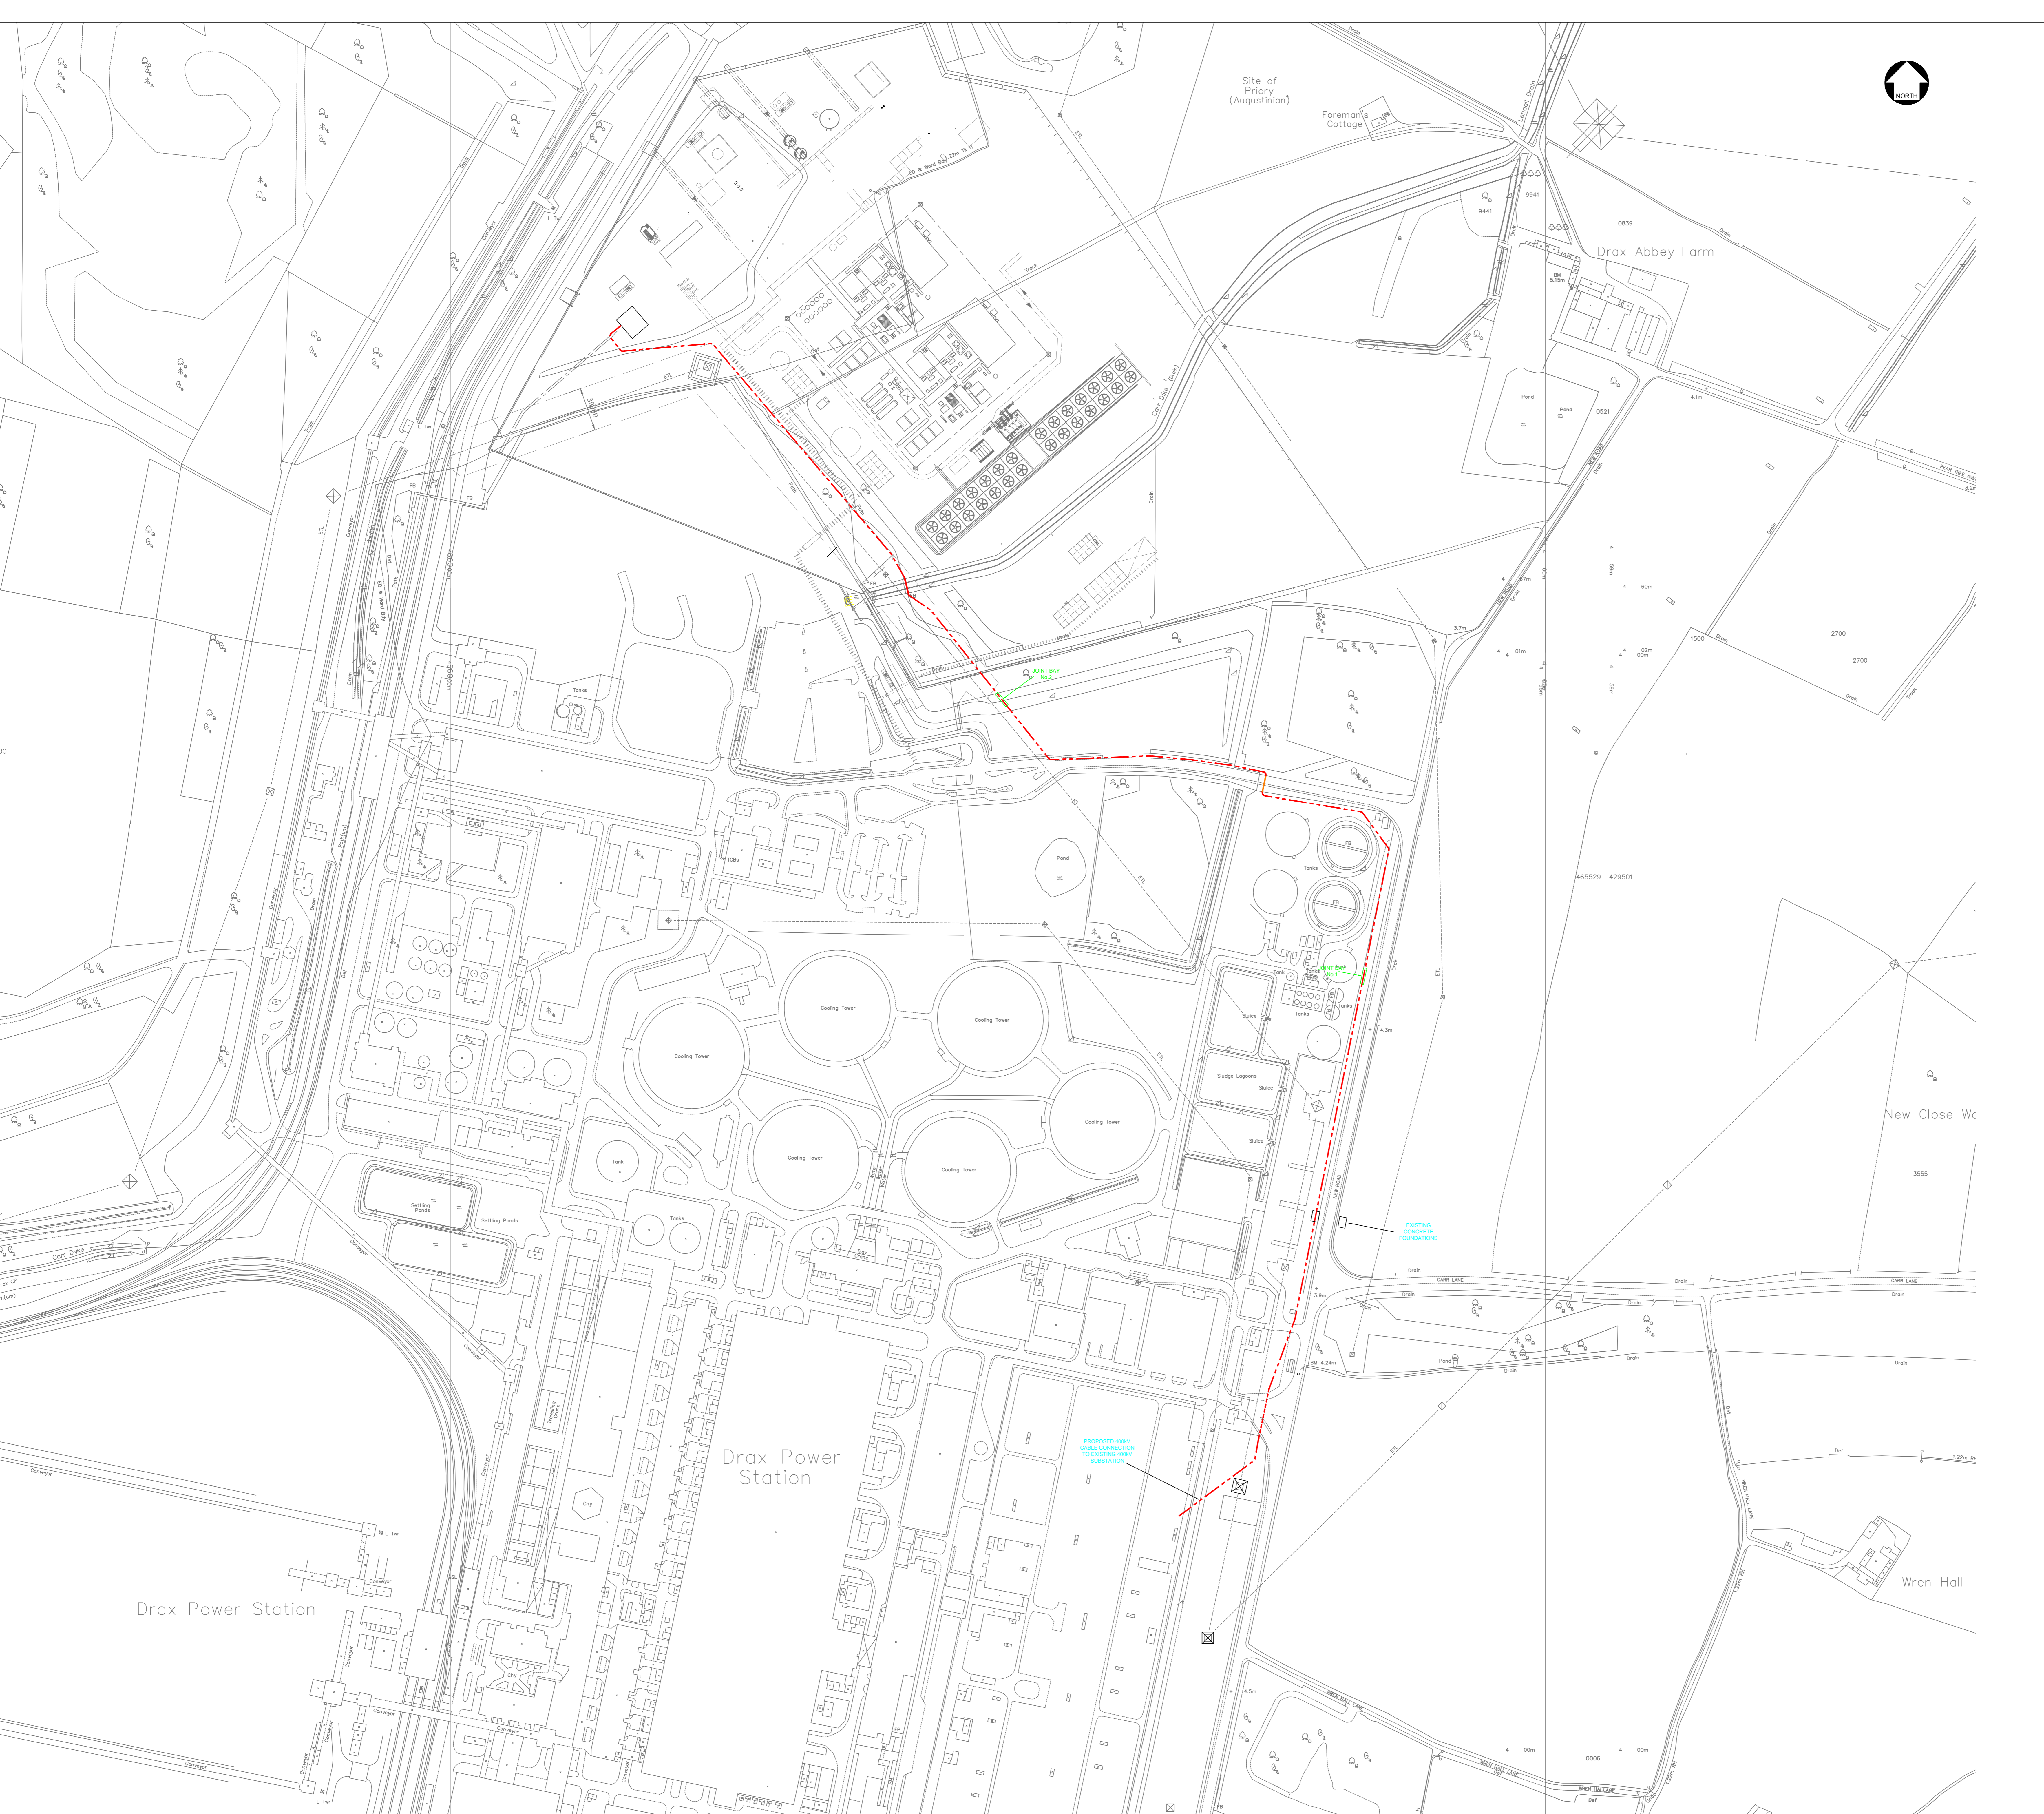

HEALTH AND SAFETY INFORMATION
 IT IS ASSUMED THAT ALL WORKS SHALL BE CARRIED OUT BY COMPETENT PEOPLE. IN ADDITION TO THE HAZARDS NORMALLY ASSOCIATED WITH THE TYPES OF WORK DETAILED ON THIS DRAWING, PLEASE NOTE THE FOLLOWING:

DESIGNER MUST WRITE 'NOTHING SIGNIFICANT' IF APPROPRIATE DO NOT LEAVE BLANK

CONSTRUCTION PHASE
 SIGNIFICANT RESIDUAL RISK— ACTION REQUIRED TO CONTROL THE RESIDUAL RISK THE DESIGNER MUST HAVE AT LEAST ONE SAFE WAY OF CARRYING OUT THIS DESIGN IF RISKS ARE SIGNIFICANT REFER TO SCHEDULE IF APPROPRIATE

O&L & BURIED SERVICES
 O&L & BURIED SERVICES

OPs ACCESS — HORIZONTAL, VERTICAL, PEDESTRIAN, VEHICLE/PLANT

ARE THERE SIGNIFICANT ISSUES REGARDING POINTS REQUIRING ACCESS? IF YES OUTLINE BELOW OR REFER TO APPROPRIATE DOC.

O&L & BURIED SERVICES
 OPs HANDLING / LIFTING STRATEGY

ARE THERE ITEMS OVER 200kg THAT REQUIRE HANDLING? IF SO DETAIL BELOW OR REFER TO APPROPRIATE DOC.

NOTHING SIGNIFICANT
 HEALTH AND SAFETY FILE INCLUSIONS

IDENTIFY HAZARD/SIGNIFICANT RISK ASSOCIATED WITH MAINTENANCE OR REMOVAL OF DRAWING CONTENTS AT A LATER DATE

NOTHING SIGNIFICANT

LEGEND

- ROAD CROSSING
- - - 400kV PROPOSED CABLE ROUTE (1.615km)
- AUGER BORE ACROSS MATERIALS HANDLING ROAD IN LOCATION WHERE NEW CW AND PURGE WATER CROSSING IS LOCATED.
- 400kV CABLE JOINT BAY

Rev	Date	Description	By	Chk	Appr
4	10/03/15	UPDATED AS FINAL ROUTE	MPS	P.G.	R.L.
3	07/11/14	POWER STATION DETAIL ADDED TO DRAWING, EXISTING SERVICES CHANGING NEW CABLE ROUTE DRAWING	MPS	P.G.	R.L.
2	31/10/14	PROJECT AND DRAWING TITLE AMENDED	MPS	P.G.	R.L.
1	26/10/14	NORTH ARROW ADDED	M.P.	P.G.	R.L.

ISSUED

PARSONS BRINCKERHOFF
 Manchester Technology Centre
 Oxford Road
 Manchester M1 7ED
 Tel: 44-(0)161-200-5000
 Fax: 44-(0)161-200-5001

DRAX POWER LIMITED

WHITE ROSE CCS (GENERATING STATION) ORDER

**DRAWING NUMBER 4.8
 PLAN SHOWING
 INDICATIVE ROUTE OF ELECTRICAL CONNECTION FOR 400kV**

Drawn: M. PADLEY	Checked: P. CRUBER
Designed: R. ISSA	Approved: R. ISSA
Date: 10/03/2015	Scale: 1:2000
Project Number: 287072A	Sheet: ELE-DRG-017

287072A ELE-DRG-017 4

© Copyright Parsons Brinckerhoff