




The Abergelli Power Gas Fired Generating Station Order

Illustrative Elevation of Road Structure Over Utilities


PINS Reference Number: EN010069
Author: AECOM

Revision	Date	Description
0	February 2019	Examination Version – Deadline 4



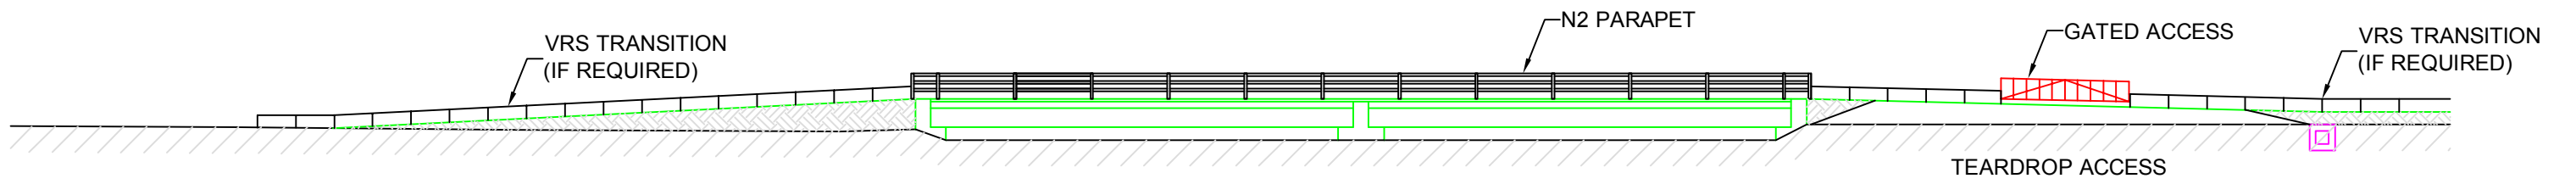

Elevation (Looking East)

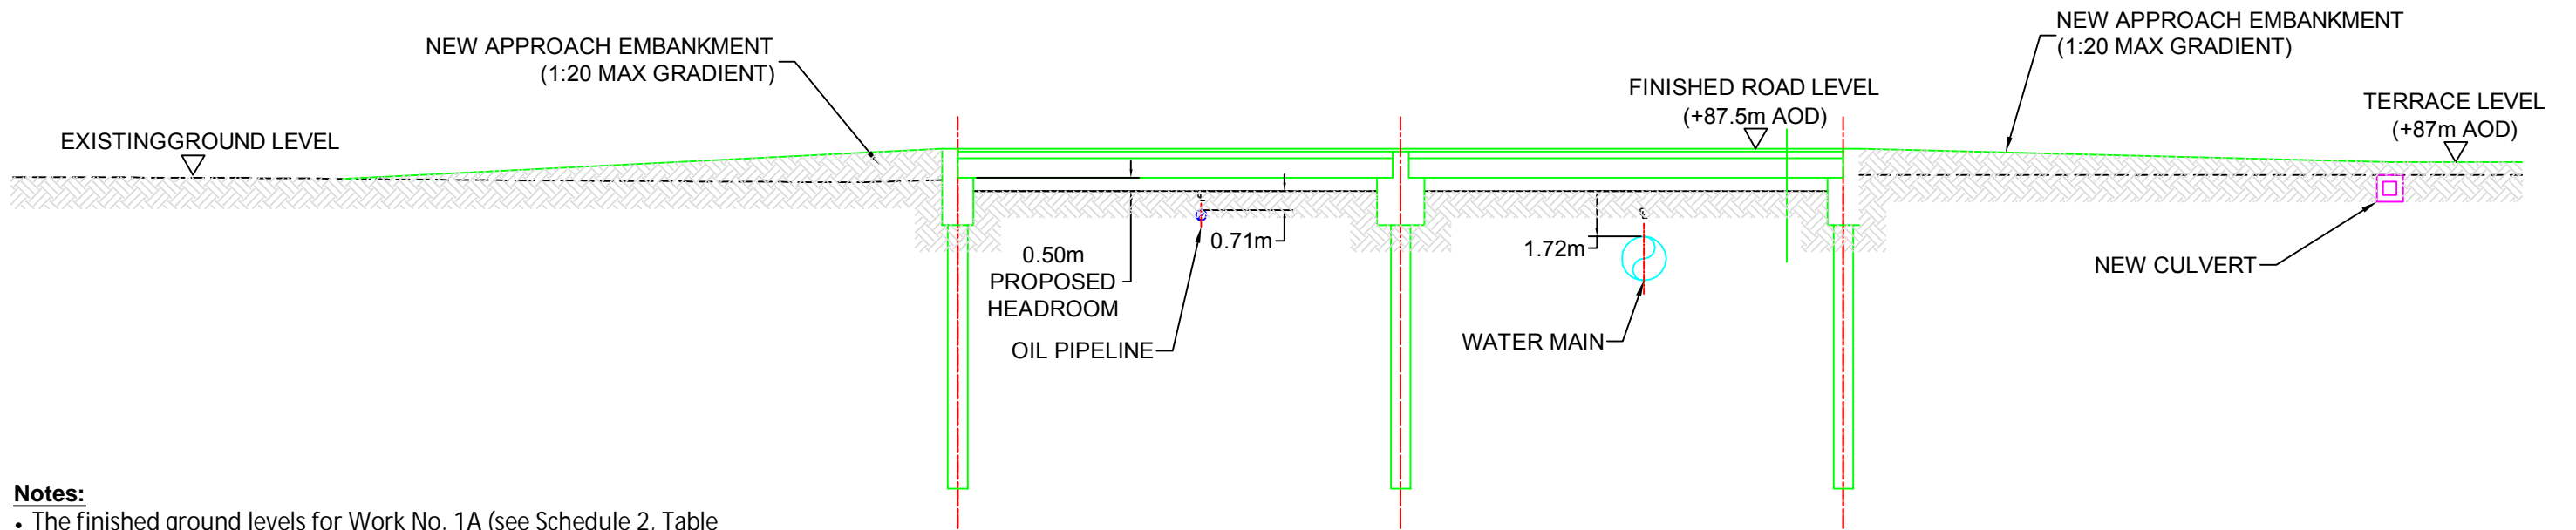

Long Section (Looking East)

Notes:

- The finished ground levels for Work No. 1A (see Schedule 2, Table 2 of the draft Development Consent Order), which contains the Gas Turbine Generator, are a maximum height of 90 m AOD.
- The Access Road, where it meets the boundary of Work No. 1A must be at the same ground level.
- Before the Access Road meets Work No. 1A, it must cross underground utility infrastructure (disused oil pipeline and Welsh Water's water main).
- The existing ground levels above the length of this infrastructure vary with ground levels generally falling in a southerly and south easterly direction.
- The minimum safe clearance level to cross the underground utility infrastructure is 0.7m.

60586176-BR-DRG-006-0
 Bridge Elevation and Long Section

Scale: 1:250 @ A3