

# REPORT

## **Boston Alternative Energy Facility**

Outline Surface and Foul Water Drainage Strategy  
(Tracked)

Client: Alternative Use Boston Projects Ltd

Planning Inspectorate  
Reference: EN010095

Document Reference: 9.4 (2)

Pursuant to: APFP Regulation: 5(2)(q)

Reference: PB6934-ZZ-XX-RP-Z-4028

Status: Final/2.0

Date: 07 April 2022



HASKONINGDHV UK LTD.

Westpoint  
Peterborough Business Park  
Lynch Wood  
Peterborough  
PE2 6FZ  
United Kingdom  
Mobility & Infrastructure  
VAT registration number: 792428892

+44 1733 3344 55 **T**  
info@uk.rhdhv.com **E**  
royalhaskoningdhv.com **W**

Document title: Boston Alternative Energy Facility

Document short title: Outline Drainage Strategy  
Reference: PB6934-ZZ-XX-RP-Z-4028  
Status: 2.0/Final  
Date: 07 April 2022  
Project name: PB6934  
Project number: PB6934  
Author(s): Pedro Vicente

Drafted by: Pedro Vicente, Ian Dennis and Richard  
Woosnam, Paul Salmon

Checked by: Dean Johnson / Paul Salmon

Date: 07/04/22

Approved by: Paul Salmon

Date: 07/04/22

Classification

Project related

*Unless otherwise agreed with the Client, no part of this document may be reproduced or made public or used for any purpose other than that for which the document was produced. HaskoningDHV UK Ltd. accepts no responsibility or liability whatsoever for this document other than towards the Client.*

*Please note: this document contains personal data of employees of HaskoningDHV UK Ltd.. Before publication or any other way of disclosing, consent needs to be obtained or this document needs to be anonymised, unless anonymisation of this document is prohibited by legislation.*

## Table of Contents

<b>1</b>	<b>Introduction</b>	<b>1</b>
1.2	Site Location	1
1.3	Overview of the Development	3
1.4	Site Description	5
<b>2</b>	<b>Existing Drainage and Watercourses</b>	<b>5</b>
<b>3</b>	<b>Previous Development</b>	<b>6</b>
3.1	Flood Risk Assessment	6
3.2	Surface Water Management Plan	7
<b>4</b>	<b>Proposed Drainage Strategy</b>	<b>7</b>
4.1	General Strategy Concept	7
4.2	Drainage Strategy	10
4.3	Proposed Catchment Strategy	11
4.4	Crossing the Roman Bank	12
4.5	Pollution Control	14
4.6	Foul and Industrial Water Disposal	16
<b>5</b>	<b>Conclusions</b>	<b>17</b>

## Table of Tables

Table 4-1	Catchment Areas and Attenuation Volume Required	8
Table 4-2	Proposed Strategy Summary Per Sub-Catchment	11
Table 4-3	Catchment Requirements Details	12

## Table of Figures

Figure 1-1	Proposed Indicative Terrestrial Operational Area	3
Figure 2-1	- Black Sluice IDB Drain Map	6
Figure 4-1	Proposed Drainage Catchment Plan	9
Figure 4-2	Indicative Surface Water Drainage Crossing the Roman Bank	13

## 1 Introduction

1.1.1 Royal HaskoningDHV has been commissioned by Alternative Use Boston Projects Ltd. Boston Alternative Energy Facility to prepare an Outline Surface and Foul Water Drainage Strategy for the proposed Boston Alternative Energy Facility (the Facility) to be located at the Riverside Industrial Estate, Boston. Schedule 2 Part 1 (9) of the draft Development Consent Order (DCO) for the Facility states:

*8.(1) No part of the authorised development may commence until for that part a surface and foul water drainage strategy has been submitted to and approved by the relevant planning authority, following consultation with the Environment Agency, lead local flood authority and relevant internal drainage board on matters related to their function.*

*(2) The plan submitted for approval sub-paragraph (1) must be substantially in accordance with the outline surface and foul water drainage plan.*

*(3) The surface and foul water drainage strategy must be implemented as approved under sub-paragraph (1) and maintained throughout the operation of the authorised development unless otherwise agreed with the relevant planning authority.*

1.1.2 This report aims to provide assurance that a plausible surface water attenuation strategy can feasibly be delivered. The proposals set out in this document set out the strategy in principle. The exact position, location and scale of the drainage elements is to be agreed at detailed design stage.

1.1.3 Outline operational pollution control measures are set out along with information regarding both foul and industrial (trade) discharges originating from the operational Facility and how they will be disposed of.

## 1.2 Site Location

1.2.1 The Development Consent Order (DCO) Application Site for the Boston Alternative Energy Facility (hereafter referenced to as 'the Application Site') is located approximately 2 km to the south east of Boston town centre. The Application Site (NGR TF33950 42241) covers 26.8 hectares (ha) and is neighboured to the west by the Riverside Industrial Estate and to the east by The Haven, a tidal waterway of the River Witham between The Wash and the town of Boston. The A16 public highway is located approximately 1.3 km to the west.

1.2.2 The Application site is split in to two components:

- The Principal Application Area – comprising of an area of 25.3 ha; and



- The Habitat Mitigation Area – comprising of 1.5 ha, located approximately 170 m to the south east of the Principal Application Area, encompassing an area of saltmarsh and small creeks at the margins of The Haven. This area will remain in a semi-natural condition and not be subject to any changes which would affect drainage and this area is therefore not included within this report, with drainage remaining linked to the tidal state of The Haven and not altered in any significant way.
- 1.2.3 The proposed indicative operational area<sup>1</sup> covers 14.85 ha, of which 10.266 ha are impermeable surfaces. Refer to **Figure 1-1** for extents of the site.
- 1.2.4 The Application Site is accessed by road via the Riverside Industrial Estate’s existing road network from Nursery Road. Access to the site from the west to Marsh Lane is gained from Bittern Way.
- 1.2.5 The Boston Biomass UK No.3 Ltd plant (hereafter referenced to as ‘Biomass Power Station’) is located on the eastern boundary of the Application Site. A waste management facility (previously operated by Mick George but having ceased operation at the time of submission) which processed construction and demolition waste is located to the east of Nursery Road and is bounded by the Application Site on all sides (but not included within the proposed Application Site itself).
- 1.2.6 A Household Waste Recycling Centre (HWRC) (built in 2018) is located to the west of the Application Site, south of the junction with Nursery Road/Callen Road. Public access to the HWRC is from Bittern Way.
- 1.2.7 A Waste Transfer Station (WTS) operated by Lincolnshire County Council (LCC) is located to the south of the Application Site, off Slippery Gowt Lane. The WTS receives all of the residual household waste from Boston Borough Council and South Holland District Council areas, and some residual household waste from East Lindsey Council area.

---

<sup>1</sup> Landside area of permanent works proposed under the DCO Application.

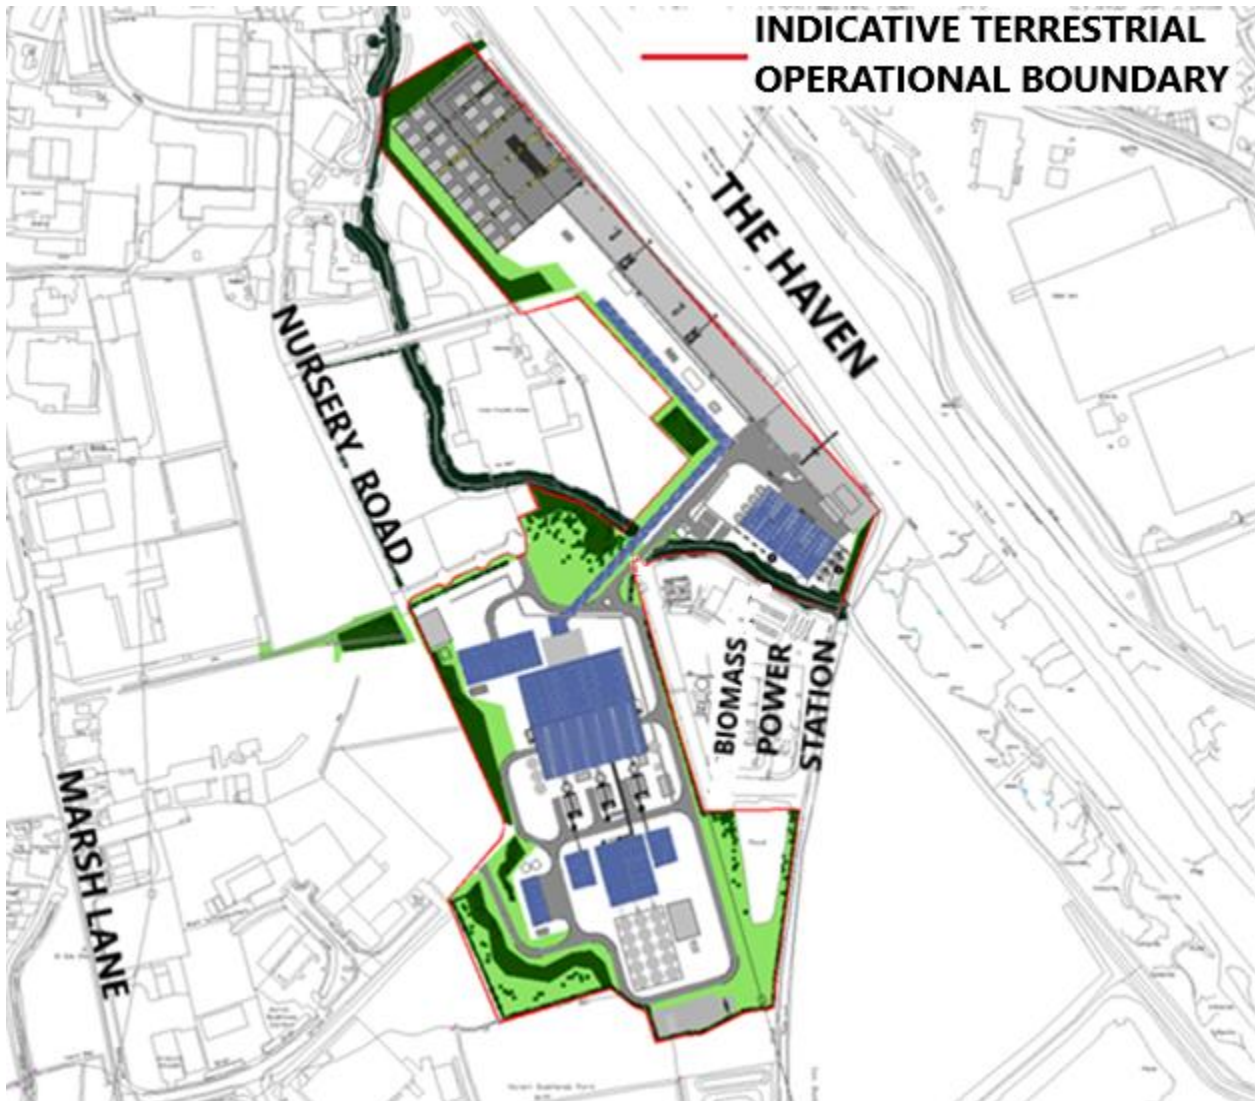


Figure 1-1 Proposed Indicative Terrestrial Operational Area

### 1.3 Overview of the Development

1.3.1 The proposed Facility would deliver approximately 80 megawatts electric (MWe) of renewable energy to the National Grid using Refuse Derived Fuel (RDF) as a feed stock into a thermal treatment facility generating power via steam turbine generators. This technology provides significant environmental benefits compared to landfilling residual waste and contributes to Government sustainable energy targets to achieve a net zero reduction in carbon emissions by 2050.

1.3.2 The Facility would comprise the following main elements:

- a wharf and associated infrastructure (including re-baling facility, workshop, transformer pen and welfare facilities);

- a RDF bale contingency storage area, including sealed drainage, with automated crane system for transferring bales;
- conveyor system running in parallel to the wharf between the RDF storage area and the RDF bale shredding plant. Part of the conveyor system is open and part of which is under cover (including thermal cameras);
- bale shredding plant;
- RDF bunker building;
- thermal treatment plant comprising three nominal 34 MWe combustion lines (circa 120 megawatts thermal (MWth)) and associated ductwork and piping, transformer pens, diesel generators, three stacks, ash silos and ash transfer network; and air pollution control residues (APCr) silo and transfer network;
- turbine plant comprising three steam turbine generators, make-up water facility and associated piping and ductwork;
- air-cooled condenser structure, transformer pen and associated piping and ductwork;
- Lightweight Aggregate (LWA) manufacturing plant comprising four kiln lines, two filter banks with stacks, storage silos for incoming ash, APCr, and binder material (clay and silt), a dedicated berthing point at the wharf, silt storage and drainage facility, clay storage and drainage facility, LWA workshop, interceptor tank, LWA control room, aggregate storage facility and plant for loading aggregate / offloading clay or silt;
- electrical export infrastructure;
- two carbon dioxide (CO<sub>2</sub>) recovery plants and associated infrastructure, including chiller units;
- associated site infrastructure, including site roads, pedestrian routes, car parking, site workshop and storage, security gate, control room with visitor centre and site weighbridge; and
- habitat mitigation works for Redshank and other bird species comprising of improvements to the existing habitat through the creation of small features such as pools/scrapes and introduction of small boulders (Habitat Mitigation Works) within the Habitat Mitigation Area (see para 1.2.2).

1.3.3 The Facility would be designed to operate for an expected period of at least 25 years, after which ongoing operation will be reviewed and if it is not appropriate to continue operation the plant will be decommissioned. The wharf structure would replace a section of the current primary flood defence bank (without impacting on the integrity of the bank) and would form a permanent structure that is not anticipated to be decommissioned.

## 1.4 Site Description

1.4.1 The Application Site comprises both undeveloped and previously developed land enclosed by a network of drainage ditches and forms part of a wider emerging industrial/commercial area.

1.4.2 The eastern site margins of the Application Site are defined in part by a primary flood defence bank along The Haven. Large and small industrial business units are located to the north, west and south of the site. A 132 kilovolt (kV) overhead powerline on pylons traverses the site from north to south and bisects the Application Site.

1.4.3 The part of the Application Site which will accommodate the wharf is approximately 750 m downstream from the existing Port of Boston (measured from the entrance to the impounded basin, the Wet Dock, to the approximate centre of the site).

1.4.4 There are no existing buildings within any part of the Application Site that will require demolition.

## 2 Existing Drainage and Watercourses

2.1.1 The Haven is a tidal main river. It is contained within flood banks (in good condition and currently being upgraded by the Environment Agency as part of their Haven Banks project) which are located within the Application Site along its eastern area at approximately 6.3 m Above Ordnance Datum (AOD).

2.1.2 A water main runs across the Application Site from Bittern Way to the north-eastern corner of the Principal Application Site where it then crosses The Haven. This piece of infrastructure will be avoided by the proposed wharf infrastructure. Where the water main would cross the Application Site it will be diverted, and this is subject to a separate application to Anglian Water on behalf of the landowner. The route of the diversion will be determined in accordance with advice provided by Anglian Water. The diversion will be completed before construction of the Facility.



2.1.3 The Application Site lies within the administrative area of the Black Sluice Internal Drainage Board (IDB), specifically within the Wyberton Marsh catchment. The IDB is responsible for enforcing restrictions to prevent flooding within its district<sup>2</sup>. For the IDB's asset map refer to **Figure 2-1**.

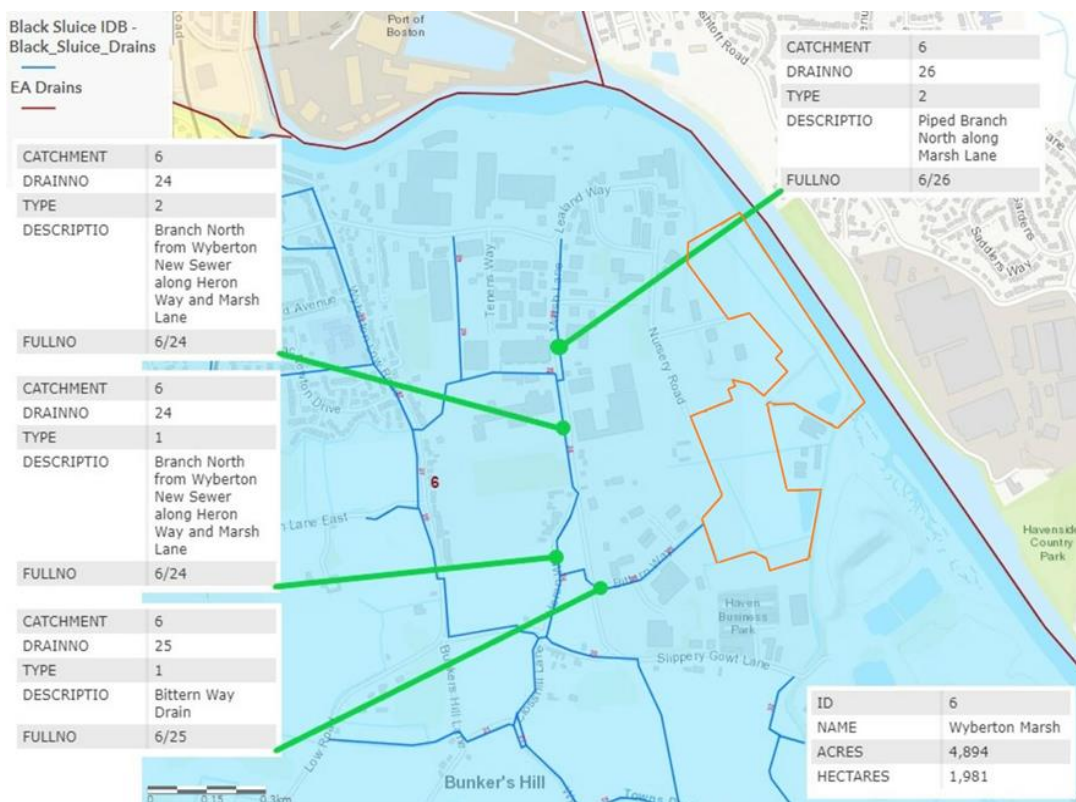


Figure 2-1 - Black Sluice IDB Drain Map

## 3 Previous Development

### 3.1 Flood Risk Assessment

3.1.1 R.M. Associates prepared a PPS25 Flood Risk Assessment (FRA) as part of the, now existing, Biomass Power Station located within the Riverside Industrial Estate.

3.1.2 Whilst the FRA defines the flooding characteristics and prevention measures required for the site, it also notes the agreement secured with the Black Sluice IDB regarding the disposal of surface water for the 25 ha site. The agreement is for 1.4 l/s/ha, which results in a 35 l/s discharge rate for the 25 hectares.

3.1.3 The FRA is dated 4<sup>th</sup> December 2009 and can be found in **Appendix A**.

<sup>2</sup> [Map of District | Black Sluice Internal Drainage Board \(blacksluiceidb.gov.uk\)](http://blacksluiceidb.gov.uk)

## 3.2 Surface Water Management Plan

- 3.2.1 L.D.A. Ltd Consulting Engineers and Transportation Planners prepared a Surface Water Management Plan (SWMP) as part of the continued development of land within Riverside Industrial Estate.
- 3.2.2 The SWMP defines the drainage requirements specific to the Riverside Industrial Estate, which include the Biomass Power Station. It also outlines the basic principles of the water management options available for the long-term future proofing of the Riverside Industrial Estate.
- 3.2.3 It must be noted that the SWMP calculations assumed a 51% catchment rate for the development of the 25 ha site.
- 3.2.4 The SWMP is dated 28<sup>th</sup> February 2013 and can be found in **Appendix A**.


## 4 Proposed Drainage Strategy

### 4.1 General Strategy Concept

- 4.1.1 The drainage strategy proposed within this report considers the water management principles proposed by the SWMP described in section 3.2. This will result in the retention of the existing pond and utilising the same discharge principles, including location. No discharge is proposed into The Haven.
- 4.1.2 The strategy proposes altering the existing drainage ditches impacted by the proposed layout to accommodate the proposals.
- 4.1.3 Furthermore, this drainage strategy considers the surface water discharge rate, of 1.4 l/s/ha, imposed by the Black Sluice IDB as stated in the FRA described in section 3.1.
- 4.1.4 The discharge rate of 35 l/s as calculated by the SWMP for 25 ha of the Riverside Industrial Estate development is used in the calculations included in this report.
- 4.1.5 The existing catchment areas and the catchment introduced by the proposed development are as noted in **Table 4-1**.
- 4.1.6 The proposals increase the ratio of catchment per developed area to 67%. Hence, the updated calculations for the wider development are based on this rate. Refer to **Figure 4-1**.

Table 4-1 Catchment Areas and Attenuation Volume Required

Catchment	Total Area (ha)	Catchment Area (ha)	Attenuation Volume (m <sup>3</sup> )	Comments
Biomass Power Station (Existing)	1.880	0.933	4,633.0	Volume provided by existing pond, which can feasibly be retained.
Boston Alternative Energy (Proposed)	14.850	10.266 (69%)	--	As the proposed site will be part of the wider development, standalone calculations were not produced.
<b>TOTAL</b>	<b>16.73</b>	<b>11.199 (67%)</b>	<b>7,787.0</b>	Refer to calculations in <b>Appendix B</b>
<b>TOTAL (25ha)</b>	<b>25.00</b>	<b>16.750 (67%)</b>	<b>13,082.0</b>	Updated attenuation volume requirements to equal the 67% impermeable surface. Refer to calculations in <b>Appendix B</b>

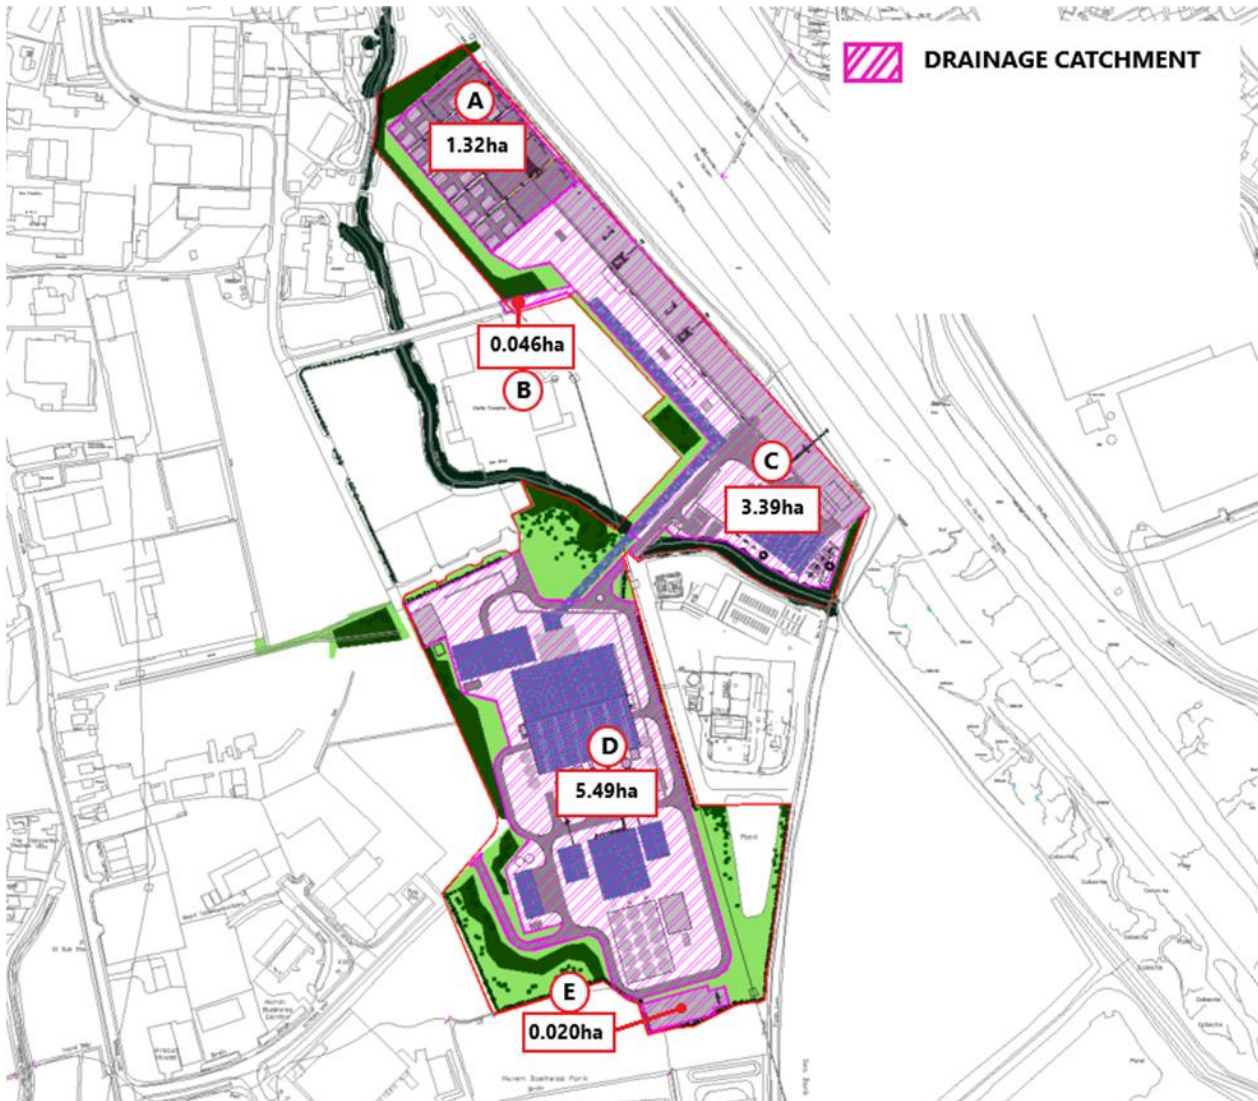

**Figure 4-1 Proposed Drainage Catchment Plan**

- 4.1.7 The calculations summarised in **Table 4-1**, demonstrate that the existing attenuation pond would not suffice to accommodate the additional flows from the proposed development. These volumes are estimations based on the total catchments and do not consider the extent and topography of the site.
- 4.1.8 The scale and general arrangement of the proposed layout will require additional attenuation and conveyance features to manage and connect the north of the site with the existing drainage at the south. The balancing of water volumes between these attenuation features will dictate the total volumes required for the development.



## 4.2 Drainage Strategy

- 4.2.1 A sub-catchment cascading network was developed, as shown on drawing PB6934-RHD-XX-ZZ-DR-D-0501 (see **Appendix D**), to ascertain the scale of the attenuation and conveyance SuDS required across the development to manage the surface water runoff. These calculations consider the proposed development and the existing Biomass Power Station, the total development of the 25.3 ha Principal Application Site is not considered in these. For the cascading calculations summary per sub-catchment refer to **Appendix C**.
- 4.2.2 The calculations were carried out to establish the critical storm for the 1 in 100 Year Return Period plus 40% Climate Change allowance in line with current guidance<sup>3</sup>.
- 4.2.3 The climate change allowance was increased to 40% from the 30% allowed in the previous assessments to account for the current local and national guidance<sup>4</sup>. The upper end has been applied due to risk of flood to the site and neighbouring sites as well as the proposed site use.
- 4.2.4 The proposed drainage strategy for the development considers the construction of a network of ditches and culverts under paved areas to connect them.
- 4.2.5 To collect the runoff from surfaces across the site buried piped networks will be required. These are shown indicatively on drawing PB6934-RHD-XX-ZZ-DR-D-0501, however, its volume has not been considered in the calculations. The calculations for the strategy are based on preliminary calculation using the Source Control tool within MicroDrainage. This is a commonly used method for this early stage of design. The model calculates the runoff within a specific catchment and conveys it through the attenuation structure to estimate its suitability. The multiple catchments are then collated as a cascading system which accounts for the discharge from a catchment into the next. This method does not account for detailed networks of pipes and the volumes within the same.
- 4.2.6 Other SuDS solutions may also be considered to collect runoff across the site, these include but are not limited to, permeable pavements and swales.
- 4.2.7 For the drainage strategy layout refer to drawing PB6934-RHD-XX-ZZ-DR-D-0501 included in **Appendix D**.

<sup>3</sup> As set out at [Flood risk assessments: climate change allowances - GOV.UK \(www.gov.uk\)](https://www.gov.uk)

<sup>4</sup> See [Flood risk assessments: climate change allowances - GOV.UK \(www.gov.uk\)](https://www.gov.uk)  
[Development Roads and Sustainable Drainage Design Approach \(lincolnshire.gov.uk\)](https://www.lincolnshire.gov.uk)

### 4.3 Proposed Catchment Strategy

4.3.1 The concept for the drainage strategy is summarised in **Table 4-2** as shown on drawing PB6934-RHD-XX-ZZ-DR-D-0501, in which the total impermeable area per catchment and the proposed SuDS features proposed are described.

**Table 4-2 Proposed Strategy Summary Per Sub-Catchment**

Catchment Reference	Catchment Area (ha)	Surface Area of SuDS (ha)	Total Impermeable Area (ha)	SuDS Feature	Flow Control	Comments
<b>A+B</b>	1.366	0.139	<b>1.505</b>	Ditch	Orifice Plate	Cascades into Catchment C SuDS
<b>C</b>	3.390	0.238	<b>3.628</b>	Ditch	Orifice Plate	Cascades into Catchment D North SuDS
<b>D (North)</b>	2.745	0.242	<b>2.987</b>	Ditch & Pond	Orifice Plate	Cascades into Catchment D South+E+ Existing
<b>D(South) + E + Biomass Pw St</b>	3.698	1.320	<b>5.018</b>	Ditch & Pond	Hydro Brake	Discharge to IDB Ditch at 35 l/s

4.3.2 The results of the cascading model between the sub-catchments demonstrates that the strategy proposed is feasible. For the cascading calculations summary per sub-catchment refer to **Appendix C**.

Table 4-3 Catchment Requirements Details

Catchment Reference	SuDS Feature	SuDS Description	Flow Rate	Volume Required
A+B	Ditch	199m Long, 1:2 Banks, 1.5m Deep, 1m Wide Base	12 l/s	844 m <sup>3</sup>
C	Ditch	360m Long, 1:2 Banks, 1.5m Deep, 0.6m Wide Base	199.2 l/s	1,092 m <sup>3</sup>
D (North)	Ditch Pond	121m Long, 1:2 Banks, 1.5m Deep, 0.6m Wide Base 646 m <sup>2</sup> Base, 1052 m <sup>2</sup> Surface	216.5 l/s	1,791 m <sup>3</sup>
D(South) + E + Biomass Pw St	Ditch Pond	261m Long, 1:2 Banks, 1.5m Deep, 1m Wide Base As Existing	35 l/s	9,021 m <sup>3</sup>


#### **4.4 Crossing the Roman Bank**

4.4.1 The Roman Bank is a secondary flood defence feature which bisects the Principal Application Site and consists of a raised earth bank c. 2m high, above the adjacent ground level, as shown on the plan: The Roman Bank Within the Order Limits (document reference 4.12, REP9-008). The crest level along the Roman Bank is subject to variation in its relative elevation along its length. There is a Public Right of Way (PRoW) located along its length and further details of this are provided in the Public Rights of Way – Outline Design Guide and Stopping Up Plan (document reference 9.41(1), REP8-007).

4.4.2 The proposals for the Facility include an elevated conveyor and service road which would bisect the Roman Bank at a relative low point, with the provision of a footbridge to ensure continued connectivity of the PRoW along the bank.

4.4.3 Following discussion with the Environment Agency and the Black Sluice Internal Drainage Board it has been determined that where the surface water drainage will cross the Roman Bank it will take the form of an appropriately sized pipe with controls for isolating flows (e.g. penstock or similar). Operating Procedures will be drawn up for the penstock which will be triggered by a Flood Alert<sup>5</sup> for tidal events along The Haven.

4.4.4 An indicative figure for this arrangement is provided in **Figure 4-2**. The final design will be presented as part of the final Drainage and Foul Water Strategy and will be agreed with both parties named above.

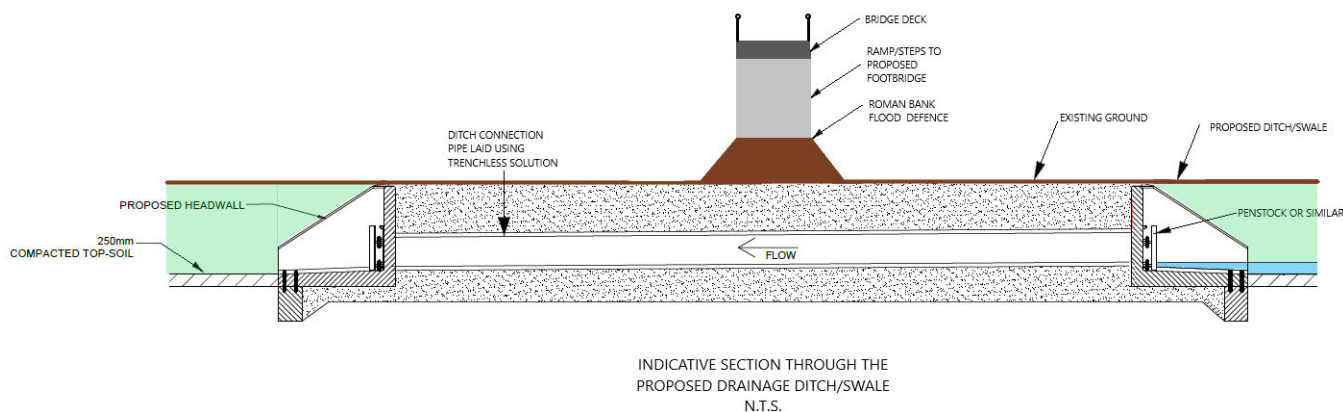

**Figure 4-2 Indicative Surface Water Drainage Crossing the Roman Bank**

4.4.5 In addition to ensuring that the design of the SuDS crossing the Roman Bank is agreed, with the Environment Agency, the Applicant also notes that the following works which may affect the Roman Bank will be discussed and agreed with the Environment Agency in accordance with their Protective Provisions:

- Clearing of vegetation to improve the accessibility of the public footpath along the line of the secondary defence;
- Construction of a footbridge along the line of the secondary flood defence;
- Installation of a conveyor line crossing the secondary flood defence;
- Construction of an access road crossing the secondary flood defence; and
- Construction of a drainage channel beneath the secondary flood defence.

<sup>5</sup> A Flood Alert is issued by the Environment Agency when flooding is possible, between two days and two hours before an event is expected.

#### **4.44.5 Pollution Control**

**4.4.14.5.1** The site drainage system will include a suite of embedded measures designed to manage the risk of pollution from the operational quay, general surface runoff, runoff from parking areas and fire water. These are described in the subsequent sections.

#### **Pollution control measures for the operational wharf**

**4.4.24.5.2** As set out in **Section 1.3**, sealed RDF bales would be unloaded from the vessel into a contingency storage area with a sealed drainage system, or onto a covered conveyor system and into the bale shredding plant. All bales would be inspected in situ on the vessel prior being unloaded, and any damaged bales would not be accepted in to the Facility. This non-acceptance will be managed through contractual conditions with the vessel operators/owners and Operating Procedures to be followed. Further information on management of RDF bales arriving by vessel can be found in ES Chapter 23 Waste (document reference 6.2.23, APP-061). The RDF bale contingency storage area located near the wharf will contain a sealed drainage that will convey flows through via oil interceptors under the wharf deck, with individual recovery pumps to a water system for nodule formation within individual pelletising lines for water re-use. There is therefore very limited potential for material from the RDF bales to enter surface water receptors as they are unloaded from the vessel and transferred onto the conveyor or storage area.

**4.4.34.5.3** However, there remains a small risk that the sealed bales could split as they are being unloaded. In order to manage this risk, the surface of the wharf will be graded to ensure that any potentially contaminated drainage flows away from The Haven and into the sealed drainage system as set out in this report. Additionally, any RDF that escapes from bales that split whilst being removed by crane from the vessel will be captured by underslung sheeting designed to slope either back in to the vessel or to the wharf (depending on tidal state). Any RDF on the wharf will be subject to an operational procedure to immediately clear the area.

#### **Pollution control measures for surface runoff**

**4.4.44.5.4** Surface runoff resulting from the site would be generally produced from runoff from roofs, roads and pavements. The risk of contamination associated with this runoff is therefore expected to be sufficiently low to allow treatment to take place as flows are conveyed through the cascading SuDS, including a network of open drainage ditches (as described in **Section 4.2** and shown in **Appendix D**).

4.4.54.5.5 The drainage ditches will be designed to ensure that flow velocities are sufficiently low and therefore retention time sufficiently high to facilitate the effective removal of fine sediment and contaminants through physical processes such as sedimentation and chemical processes such as adsorption<sup>6</sup>. They will therefore have a low gradient and high surface roughness to ensure that sediment and contaminants are retained (e.g. with vegetation growth for bioretention).

### Pollution control measures for parking areas

4.4.64.5.6 Oil separators compliant with BS EN 858-1:2002 and BS EN 858-2:2003 will be installed to intercept drainage from areas of hardstanding used for car parking, in order to remove hydrocarbons from surface runoff and associated sediment prior to discharge into the site drainage system. Given that the eventual discharge point of the site drainage system is to an IDB drain (cf. **Section 4.3**), Class 1 bypass separators will be installed. These devices, which will contain a silt separation chamber and coalescing devices to separate oil droplets from water, will achieve a discharge concentration of less than 5 mg/l oil and fully treat flows generated by rainfall rates of up to 6.5 mm/hour<sup>7</sup>. Bypass separators provide sufficient levels of protection to car parking areas due to the relatively low risk of major spillages occurring.

4.4.74.5.7 An additional level of protection will be provided in any areas used for fuel or chemical storage (including the fuel oil store located on the lower wharf), in addition to bunded storage tanks with 110% capacity of the stored liquids. These will consist of Class 1 full retention separators, which will achieve a discharge concentration of less than 5 mg/l oil and fully treat flows generated by rainfall rates of up to 65 mm/hour<sup>8</sup>. Full retention separators provide sufficient levels of protection to areas with a greater risk of larger or more frequent spillages occurring.

### Pollution control measures for fire water

4.4.84.5.8 During an emergency situation, fire water will be managed through the use of penstocks<sup>9</sup>, with additional retention made through use of the natural retaining walls of the Roman Bank (at +6.2 m AOD) to the West and the flood defence on the Haven (+7.2 m AOD) (incorporating the new wharf) then ends to the North and South are tied into the original sea defences. Vehicular access from the unnamed road is via an elevated down ramp to the +3.2 m lower wharf. This provides some considerable volume to fill via fire mains and the norm for fighting fires in a waste stack is to extinguish normally within 11 hours.

<sup>6</sup> CIRIA SuDS Manual C753

<sup>7</sup> Environment Agency, SEPA and Environment and Heritage Service (2006) PPG3: Use and design of oil separators in surface water drainage systems. Available online: <http://www.oilstorageregs.co.uk/downloads/PPG3.pdf>



**4.4.94.5.9** This attenuation will be used to isolate the piped networks in the event of a fire and prevent contaminated fire water entering the surface drainage network. The penstocks will be situated at agreed locations on the drainage system and will be automatically operated with manual back up as a second line of safety. These will be overseen by a dedicated operative with delegated responsibility under the Emergency Response Plan for the operational site.

#### **4.54.6 Foul and Industrial Water Disposal**

**4.5.14.6.1** The foul water to be discharged during the operational phase includes black and grey waste water originating from toilets, showers / bathrooms / welfare facilities and the on-site canteen.

**4.5.24.6.2** In the early stages of construction (before connection to the local sewer system) foul water discharges from toilets / showers will be collected and tankered off-site by an authorised contractor for legal disposal (e.g. disposed of at a waste water treatment works under licence). Once the sewer system is available locally there is the option to apply for a temporary connection from the construction village.

**4.5.34.6.3** Two industrial sources of waste water have been identified which will be disposed of to the local sewer system under a Water Industry Act (1991) consent:

- Water used for the amine scrubbers in the CO<sub>2</sub> plants<sup>10</sup>; and
- Water used for food grade CO<sub>2</sub> testing in the on-site laboratory.

<sup>8</sup> Environment Agency, SEPA and Environment and Heritage Service (2006) PPG3: Use and design of oil separators in surface water drainage systems. Available online: <http://www.oilstorageregs.co.uk/downloads/PPG3.pdf>

<sup>9</sup> Environment Agency, SEPA and Environment and Heritage Service (2006) PPG18: Managing fire water and major spillages. Available online: <https://www.netregs.org.uk/media/1674/ppg-18.pdf>

<sup>10</sup> Discharges from the amine scrubbers will only be discharged in the order of twice per year – dependant on operational circumstances.

4.5-4.6.4 No on-site waste water treatment works will be provided either during construction or operation and therefore no discharges of waste (or industrial) effluents will be made to the local surface drainage system, groundwaters or The Haven.

4.5-4.6.5 Discussions have commenced with Anglian Water and rates/volumes and testing of pollutants will all be in line with any requirements of this statutory sewerage undertaker. The new site foul drainage will be designed in accordance with the required British Standards in force at the time.

## 5 Conclusions

- 5.1.1 The proposed indicative operational area covers 14.85 ha, of which 10.266 ha are impermeable surfaces.
- 5.1.2 The Haven is a tidal main river, it is contained within flood banks which are located within the Application Site along its eastern area currently at approximately 6.3 m Above Ordnance Datum.
- 5.1.3 The Application Site lies within the administrative area of the Black Sluice Internal Drainage Board, specifically within the Wyberton Marsh catchment.
- 5.1.4 Previous drainage assessments established a surface water discharge agreement of 1.4 l/s/ha, which results in a 35 l/s discharge rate for the 25 ha development, and which is considered in this Outline Drainage Strategy.
- 5.1.5 The proposals consider the water management principles proposed by the previous drainage assessment.
- 5.1.6 The proposals increase the ratio of catchment per developed area to 67%.
- 5.1.7 The calculations were carried out to establish the critical storm for the 1 in 100 Year Return Period plus 40% Climate Change allowance.



- 5.1.8 This strategy proposes a network of cascading SuDS features that collect and convey surface water to the outfall location. The strategy also proposes that these features connect with the existing SuDS pond which is to be retained.
- 5.1.9 The development requires 12,748 m<sup>3</sup> of attenuation volume to manage the surface water generated by the impermeable surfaces.
- 5.1.10 Outline pollution prevention measures are identified covering the Principal Application site in general and car parks and fire water specifically.
- 5.1.11 The outline principles to collect and dispose of both foul (black and grey) water and industrial (trade) discharges originating on-site is also provided. No discharges to the wider receiving environment will take place from such waste water streams with disposal off-site either via tanker (construction phase only) to a licenced waste water treatment site or discharged under licence to sewer.

## **Appendix**

### **Appendix A – Previous Assessments**

PPS25 Flood Risk Assessment  
Surface Water Management Plan

# PPS25 FLOOD RISK ASSESSMENT

FOR THE ERECTION OF A GASIFICATION PLANT  
RIVERSIDE INDUSTRIAL SITE  
BOSTON

R.M.ASSOCIATES



10 Main Street

Thorpe on the Hill

Lincoln

LN6 9BG

Tel 01522 681728

Mobile 07967 304737

e-mail; [ray-morgan@talktalk.net](mailto:ray-morgan@talktalk.net)

Version 4 December 2009

# **FLOOD RISK ASSESSMENT**

## **FOR THE ERECTION OF A GASIFICATION PLANT**

### **AT RIVERSIDE INDUSTRIAL ESTATE BOSTON**

#### INTRODUCTION

The Government has placed increasing priority on the need to take full account of the risks associated with flooding at all stages of the planning and development process. This seeks to reduce the future damage to property and the risk to life from incidents of flooding. Their expectations relating to flooding are contained in PPS 25 Development and Flood Risk, which identify how the issue of flooding is dealt with in the drafting of planning policy and the consideration of planning applications by avoiding inappropriate development in areas at risk from flooding and to direct development away from areas at highest risk by applying a risk-based approach to development with the sequential test in Table 1 of paragraph 30 PPS25. This should also take into account the vulnerability of proposed uses to flood risk.

The Environment Agency's flood maps show areas that are at risk, from fluvial and tidal flooding. These maps show the limits of the flood plain of the area which could be affected by flood events, over topping or breaching of flood defences. They are based on the approximate extent of floods with a 1% annual probability of exceedance (1 in 100 year flood) for rivers and 0.5% annual probability of exceedance (1 in 200 years flood) for coastal areas under present expectations or the highest known flood. However they do not take into account of the presence of defences or the likelihood that flood return intervals will be reduced by climate change.

This Flood Risk Assessment has been prepared solely in support of the planning application and considers the risk of flooding from fluvial and tidal sources in accordance with PPS 25. It also considers the risks of localised flooding due to inadequate Foul and Surface Water Sewers, Failure of Reservoirs, Water Main pipe bursts, Sewer Blockages, Pump Failures or High Ground Water Table etc.

This document has been prepared solely as a flood risk assessment on behalf of the client. RM Associates accepts no responsibility or liability for any use of this document other than by the client for the purposes for which it was originally commissioned and prepared. If any unauthorised Third Party comes into possession of this report, they rely on it at their own risk and RM Associates owe them no duty of care or skill.

#### APPLICATION SITE

The proposed development lies within the Riverside Industrial Estate Boston, which is the principal industrial area for the town. The area for the proposed site development is allocated within the Local Development Plan ED1 Development on Allocated Employment Sites. The Plan identifies the area as an existing Industry/Commercial Area and future expansion of 44.8Ha. In the interests of The Borough of Boston on going economic prosperity it is important that these areas are allowed to be used for employment purposes. **Map 1**

The nation Grid reference is TF 340421 and the site area amounts to 1.876 hectare, the site lies behind the second tidal defence to the Boston Haven which is a tidal river. The primary defence crest level is 6.50m ODN and the secondary defence crest level is 5.31m ODN

The Site would be classed as Major Development applying the Town & Country Planning (Consultation) (England) Direction 2009 as the site is to be developed is more than 1 hectare

The proposed development site is shown to be within Flood Zone 3a 'high probability' as detailed on the Environment Agency's Flood Zone Maps, and as defined in Table D1 of Planning Policy Statement 25 (PPS25) and within Tidal Category 2 of the Boston Strategic Flood Risk Assessment

Applying the Flood Risk Vulnerability Classification in Table D2 of PPS25, the proposed development is classified as Essential Infrastructure with Table D1 of PPS25 stating that such uses are appropriate in this zone if the Exceptions Test is passed and it should be designed and constructed to remain operational and safe for users in times of flood.

**Table D.2: Flood Risk Vulnerability Classification**

Essential Infrastructure	<ul style="list-style-type: none"> <li>Essential transport infrastructure (including mass evacuation routes) which has to cross the area at risk, and strategic utility infrastructure, including electricity generating power stations and grid and primary substations.</li> </ul>
Highly Vulnerable	<ul style="list-style-type: none"> <li>Police stations, Ambulance stations and Fire stations and Command Centres and telecommunications installations required to be operational during flooding.</li> <li>Emergency dispersal points.</li> <li>Basement dwellings.</li> <li>Caravans, mobile homes and park homes intended for permanent residential use.</li> <li>Installations requiring hazardous substances consent.<sup>19</sup></li> </ul>
More Vulnerable	<ul style="list-style-type: none"> <li>Hospitals.</li> <li>Residential institutions such as residential care homes, children's homes, social services homes, prisons and hostels.</li> <li>Buildings used for: dwelling houses; student halls of residence; drinking establishments; nightclubs; and hotels.</li> <li>Non-residential uses for health services, nurseries and educational establishments.</li> <li>Landfill and sites used for waste management facilities for hazardous waste.<sup>20</sup></li> <li>Sites used for holiday or short-let caravans and camping, <b>subject to a specific warning and evacuation plan.</b></li> </ul>
Less Vulnerable	<ul style="list-style-type: none"> <li>Buildings used for: shops; financial, professional and other services; restaurants and cafes; hot food takeaways; offices; general industry; storage and distribution; non-residential institutions not included in 'more vulnerable'; and assembly and leisure.</li> <li>Land and buildings used for agriculture and forestry.</li> <li>Waste treatment (except landfill and hazardous waste facilities).</li> <li>Minerals working and processing (except for sand and gravel working).</li> <li>Water treatment plants.</li> <li>Sewage treatment plants (if adequate pollution control measures are in place).</li> </ul>

The proposal is to erect a conventional 'gasification' plant capable of producing 12 megawatt of electricity. The proposed development on the disused agricultural land is for the installation of Energy from Waste System. This system employs Gasification as the focal part of the plant for Syngas production. **Plan 1**

The Plant overall size, throughput and expected out put of 12Mw maximum is engineered on the availability to source the wastes locally.

The average ground site level is 2.90mODN, which will be raised by 500mm for the hardcore storage areas the ground floor level for the proposed buildings will be 3.50mODN and all offices and control equipment will be located at First floor level above the 1 in 200 year tide level, the lowest plant base will also be above the predicated tide level of 6.60m ODN. **Plan 2 & 3**

The site area amounts to 1.876 hectare. **Plan 4**

The development consists of the following: - Concrete Hard standings 6640.17 s.m.

Total roof areas 4665.83 s.m.

Permeable Hard standings 4896.57 s.m.

Landscaping 2971.00 sm

Slippery Gowt landfill site is located alongside the eastern boundary and this has raised land levels to above 10mODN.

## DRAINAGE AUTHORITIES

### **Environment Agency**

The Environment Agency has permissive powers for reducing the risk of flooding from designated main rivers and from the sea.

The following potential sources of flooding affecting the development site have been identified as:

- the tidal Haven
- The Wyberton Marsh pumped catchment

The Haven is a tidal river and the flood defences along the southern bank consist of earth embankments with a crest level of 6.50mODN and represents a 1 in 200 year protection with a tide level of 5.93mODN. (Northern Area Tidal Modal Analysis June 2006) and in 75 years time with predicted global warming would be 6.60mODN.

The Environment Agency's flood zone maps, show that the application site as being at risk from flooding from the Boston Haven, adjacent to the site. **Map 2**

These maps show that the area lies within the natural floodplain of the river and would naturally be affected by flooding if the river rose above its banks. However the area is protected by the presence of flood defences.

The flood banks, which are earth embankments, maintained by the Environment Agency and are in a good state of repair.

From the Boston SFRA the Marsh Lane FRZ extends over an area of 30 Hectares.

### **1D Breach Analysis to the Haven Flood Banks**

If a breach or overtopping occurred to the flood banks alongside the Boston Haven would initially fill the low area immediately behind the defences.

From the Northern Area Tidal Modal Analysis Peak tide levels Present Day (2008) at Hobhole Gauge 0.5% (1 in 200) = 5.93mODN

From these tide levels the site would not be affected by overtopping (2009) as the tidal defence crest level is 6.50mODN downstream of Black Sluice.

In considering a breach the following approach is proposed:-

- a) Use "Tide 200" spread sheet with above tide levels to obtain level in Flood Cell (A) 30 km<sup>2</sup>. Avg. ground level 2.50mODN. Note: - Breach for Tidal River 50m Time to close 72 hrs. Defence level 6.50mODN. Ground level at breach 3.30mODN, 1 in 200 year tide level 5.93mODN.
- b) Use this level (a) to give the maximum head at the breach into flood cell. This level will occur for a short period due to tide cycle Max 4 hrs. Assume half of this maximum head to calculate velocity at the site in the EA Hazard/Breach Spreadsheet.
- c) Repeat for Climate Change Rise in sea level 667mm (6.60m ODN)
- d) Taking the precautionary approach the Hazard Rating following a breach which in Flood Risk Assessment (FD 2320) Guidance for New Development Phase 2 R& D Technical Report these are classified as low <0.75, moderate 0.75-1.25, significant 1.25-2.50 and extreme >2.50 based upon an empirical measure of velocity and depth.

$$\mathbf{HR = d \times (v + 0.5) + DF}$$

HR = (flood) hazard rating d = depth of flooding (m)

V = velocity of flood waters (m/sec) DF = debris hazard = 0.5. (1.0 depth above 250mm)

For the degree of Flood Hazard to be classified as low HR has to be <0.75.

The site lies 30m behind the primary defences


Flood Cell	Size	Breach Base Level (into cell)	Average ground level in cell
A	30 km <sup>2</sup>	3.30mODN	2.50mODN

Results tabulated below

	0.5% 2009	0.5% 2084
Tide Level	5.93mODN	6.60mODN
Ground level at breach	3.30mODN	3.30mODN
Avg. Ground level in cell A	2.50mODN	2.50mODN
Level in Cell A From Tide 200	2.81mODN	2.98mODN
Existing Ground level at the site	2.90mODN	2.90mODN
Floor level of building	3.50mODN	3.50mODN
average depth at breach	5.93- 2.64/2 1.65m	6.68- 2.78/2 1.95m
Depth at site	2.81-2.90=0.00m	2.98 – 2.90 = 0.08m
Velocity at 30m from source EA Hazard Spread Sheet	1.13m/sec	1.68m/sec
Hazard Rating	0.50 Low Hazard	0.67 Low Hazard

Year 2084

<b>RESULTS</b>	
<b>Peak Net Volume of Inflows (m3)</b>	14352489.0
<b>Peak Level (m AOD)</b>	2.98

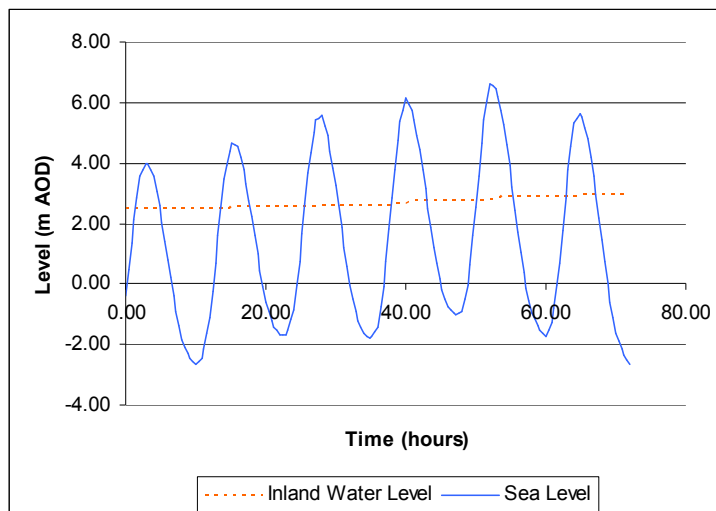



This is the peak depth which occurs over 4 hrs maximum. Use average head to find velocity.

VELOCITY	Site Name	Alternative Energy		Date	Oct-09							
		Boston	Tidal River - Earth Bank									
Defence Type										Head at Breach		
	Ground Level at breach	3.3	mODN	Flood Level	6.6	mODN				1.65	m	
	Breach Width Increments from breach	50	m									
	Debris Factor	Shallow	0.5	Deep	1	(note: shallow <0.26m)						
DISTANCE FROM BREACH												
		0	5	10	15	20	25	30	35	40	45	50
DEPTH AT BREACH	1.35	1.99	1.86	1.77	1.69	1.63	1.57	1.52	1.48	1.44	1.40	1.37
	1.40	2.02	1.90	1.80	1.72	1.66	1.60	1.55	1.51	1.47	1.43	1.40
	1.45	2.06	1.93	1.83	1.75	1.69	1.63	1.58	1.53	1.49	1.46	1.42
	1.50	2.09	1.96	1.86	1.78	1.71	1.66	1.60	1.56	1.52	1.48	1.45
	1.55	2.13	2.00	1.90	1.81	1.74	1.68	1.63	1.58	1.54	1.50	1.47
	1.60	2.16	2.03	1.93	1.84	1.77	1.71	1.66	1.61	1.57	1.53	1.49
	1.65	2.20	2.06	1.96	1.87	1.80	1.74	1.68	1.63	1.59	1.55	1.52
	1.70	2.23	2.09	1.99	1.90	1.83	1.76	1.71	1.66	1.62	1.58	1.54
	1.75	2.26	2.12	2.01	1.93	1.85	1.79	1.73	1.68	1.64	1.60	1.56
	1.80	2.29	2.15	2.04	1.95	1.88	1.81	1.76	1.71	1.66	1.62	1.58

From calculations the HR, at 30m from the breach to the primary defences, at the site of the existing building in year 2009 is 0.50 Low Hazard rating area after climate change year (2084) is 0.67 Low Hazard, for the lifetime of the buildings (75years).

With the primary defences having a crest level of 6.50mODN these defences will not be subject to over topping for the present day. If the defences are not raised or other flood defences provided to protect Boston the site could be flooded from over topping of the defences at a depth of 160mm.

### Boston Borough Strategic Flood Risk Assessment

In order to inform the process of risk assessment and site selection the Borough Council commissioned Consultants to prepare a Strategic Flood Risk Assessment. It was found that a significant proportion of the Borough was at little or no risk when the defences were taken into account. The majority of land in the Borough is at low to medium risk and only a small proportion at high risk

The findings reflect the considerable protection afforded to the area by coastal and tidal flood defences and by the extensive well organised system of fluvial drainage.

The Borough Council has designated fifteen separate Flood Risk Zones within and around the town of Boston. The application site lies within Marsh Lane FRZ 10 and is shown to be in category 2 Low- Medium Risk. **Map 3**

The study has identified that, for the Wyberton Marsh pumped catchment 1 in 100 year flood event, the maximum water level would be 1.45mODN, which is well below bank level.

The primary flood risk to the area is potential tidal flooding from a breach of the right hand bank of Boston Haven between Black Sluice and Slippery Gowt landfill site. The Riverside Industrial Estate is bounded by the Haven and a breach in the primary defence in this area would rapidly result in flooding of the estate. The SFRA stated that the secondary flood defence line of the old sea bank is too close to afford the FRZ more than a limited and temporary alleviation from a breach to the primary defence. A breach further downstream of Slippery Gowt could also cause flooding but with a much lower risk as the overland path would be more than 2km and the secondary flood bank is at a greater distance from the primary embankment and thus forms an effective impediment to tidal flooding.

With the height of the defences being well above the 1 in 200 year tide level it is doubtful that overtopping the defences will occur, the main threat is from a beach occurring at high tide. The risk of over topping will increase during the lifetime of the development unless the defences are raised to cater for global warming

### **Black Sluice Internal Drainage Board**

The site lies within the administrative area of the Black Sluice Internal Drainage Board who has powers under the Land Drainage Act to carry out measures to alleviate flooding in districts with special drainage needs other than Main River. The Internal Drainage Board was consulted regarding flooding history from their system and has stated that they have no record of the site being flooded from their system and are not aware of any flooding from the Haven having affected the site in recent years.

The nearest IDB watercourse to the application site is located to the north of the site and flows in an easterly direction to the Wyberton Marsh Pumping Station. The pumps discharge into the Haven and are designed to cope with all heads.

A scheme for the disposal of surface water has been agreed with the IDB. E-mails 20th November 2009 and 1<sup>st</sup> December 2009. **Appendix A**

### SEQUENTIAL APPROACH

The proposed use for residential development for the site falls within “Essential Infrastructure” uses of land in Table D.3 Flood Risk Vulnerability Classification and Table D1 shows that developments of this nature are appropriate in this zone subject to passing the Exception Test. All development is permitted in Zone 1. Development in Zones 2 and 3 is restricted based on Table D3 of PPS 25 replicated below.

Table D.3<sup>22</sup>: Flood Risk Vulnerability and Flood Zone 'Compatibility'

Flood Risk Vulnerability classification (see Table D2)		Essential Infrastructure	Water compatible	Highly Vulnerable	More Vulnerable	Less Vulnerable
Flood Zone (see Table D.1)	Zone 1	✓	✓	✓	✓	✓
	Zone 2	✓	✓	Exception Test required	✓	✓
	Zone 3a	Exception Test required	✓	x	Exception Test required	✓
	Zone 3b 'Functional Floodplain'	Exception Test required	✓	x	x	x

FLOODING FROM OTHER SOURCES

Flooding is a natural process and can happen at any time from sources other than watercourses and the sea.

- Flooding from land can occur from intense rainfall, often over short duration of time that is unable to soak into the ground or enter the drainage system. With the surrounding built up environment and the land falling to the east to the IDB watercourse there is little risk of flooding and this is likely to be of short duration and cause some local ponding of shallow depth
- The area is not known to suffer from any groundwater problems.
- Flooding from sewers can occur from over loading from heavy rainfall caused by blockages or having inadequate capacity. With the surrounding built up environment and the land falling to the east to the IDB watercourse there is little risk of flooding and this is likely to be of short duration and cause some local ponding of shallow depth
- Non natural or artificial sources of flooding such as reservoirs, lakes or canals where water is stored above natural ground

level could cause flooding if the structure fails or is over topped. There are no other known facilities close by which would affect the site.

CLIMATE CHANGE

Global warming is now recognised that it is likely to affect the frequency and severity of extreme events as both tidal and fluvial flooding.

The annual sea rise due to climate change is given in Annex B, PPS25 and the recommended contingency allowances are stated in Table B1. This for the year 2084 (the life span of industrial buildings) will give a general rise for the Humber Area of 679mm.

$$2006-2025 = 4\text{mm} \quad 19 \times 4 = 76\text{mm}$$

$$2025-2055 = 8.5\text{mm} \quad 30 \times 8.5 = 255\text{mm}$$

$$2055-2084 = 12.\text{mm} \quad 29 \times 12 = 348\text{mm}$$

The effect of global warming on fluvial flood peaks is given in Table B2. It is expected that the overall effect up to 2025 will result in an increase of rainfall of 5%, 2025-2055 10%, 2055-2085 20% with Peak River flows increasing by 10%,

From information from the Environment Agency the existing defences adjacent to the application site are adequate to deal with tidal events upto 2084

### ACCESS AND EGRESS

This is provided along through the existing Marsh Lane Industrial site. Due to the existing land levels it will not be possible

to provide dry access/egress to and from the site however the flood levels along this route would not prevent emergency access/egress during a flood event.

### INFRASTRUCTURE

The buildings will be connected into the foul sewerage system which serves the industrial estate on the northern boundary, surface water from impervious areas will be also discharged into this dyke having first been through a petrol/oil interceptor.

Discussions have been held with the Black Sluice IDB regarding the disposal of surface water not only from this site but from the 25 Hectares owned by the land owner of which 10 Ha has already been developed and arrangements have for surface water has been ad hoc. A scheme has been proposed and submitted to the IDB for necessary improvements to the network to accommodate the additional flow from the 25 hectares. The calculated volume of storage required discharging at the Greenfield rate of 1.4 litres/sec/hectare into the adjacent watercourses, is 9350 cubic metres. The IDB have had this proposal modelled by their Consultants .The IDB have confirmed that the additional storage provided within the system can be accepted without raising levels elsewhere and there is no need for the attenuation weir. **Appendix A**

On site drainage pipes will be laid from the impermeable areas with direct connections into the dyke drainage system and following the Consultants model they have confirmed that the watercourse 1 in 100 year level including climate changes (30%) is 2.44mAOD in the IBD drain and 2.56mAOD in the site drains. With the proposed site level being 3.5mODN, therefore with a freeboard of 1.0m there will be no flooding or surcharging on the site and also there will be no impacts to any third parties from the onsite drainage network, or with the wider IDB watercourse improvements.

As there is a positive drainage system capable of receiving flows the development there is no likely impact on neighbouring property also there will not be above ground flooding which would become a hazard to buildings or site access routes.

## CONCLUSION

- Following the assessment of the Flood Risk from the Haven the category of the site would be in Flood Zone 3, (High Probability) The site is protected to at least 1 in 200 year tidal flood event from the Haven. The Banks are in good condition and the risk of a breach in the banks being minimal. However it is understood that flood defences do not completely remove the chance of flooding and can be overtopped or fail in extreme weather conditions.
- Applying the Flood Risk Vulnerability Classification in Table D2 of PPS25, the proposed development is classified as Essential Infrastructure, with Table D1 of PPS25 stating that such uses are appropriate in this zone if the site passes the Exception Test.
- The Haven is tidal and therefore the flood risk is only at its greatest when under high tide conditions. Metrological forecasts together with known variations of the predicted spring tides will allow sufficient warning time when these events will occur to safely evacuate the site.
- The lowland drainage system is well maintained by the Internal Drainage Board and they have stated that the site has no record of flooding from the Board's system. The Board's pumping station at Wyberton Marsh Pumping Station can operate under all tide levels. Run-off from the site will be controlled to an acceptable rate as per the proposals agreed with the Black Sluice IDB (Appendix A)
- The attenuation proposals to deal with the run-off from this site and the remaining land within the ownership of the land owner has been modelled within the Black Sluice IDB model and will provide a satisfactory solution without causing any above land flooding to the site and to neighbouring lands.
- Any impact of damage to the property can be foreseen and mitigated against by relatively simple design and construction techniques.
  - Floor levels for the development are to be set as high as practicable above ground level taking into account the need for disable access, use of the building and visual amenity issues.
  - The plant is to be raised above the predicted high tide following global warming i.e. 6.65m ODN so as to remain operational at all times.
  - Register the site with the Environment Agency to receive early flood warning information.
  - The Operator of the site shall provide all operatives a flood evacuation plan detailing what to do in the event of a flood.
  - The proposal falls into Essential Infrastructure, the proposed plant and sensitive control areas are to be located above the high tide level, following climate change, i.e.6.60mODN

## APPENDIX

Photo 1	Proposed Development Site and Secondary Flood Banks
Photo 2	Haven Flood Banks
Map 1	Extract from Boston Local Plan Map
Map 2	Extract from Environment Agency Flood Map
Map 3	Extract from Boston SFRA Flood Map
Plan 1	Typical Schematic Plan
Plan 2	Site Location Plan
Plan 3	Site Layout Plan
Plan 4	Site Surface Areas
Plan 5	OS Levels Marsh Lane FRZ

Appendix A Proposed Surface Water Drainage Scheme.

Flood Evacuation Plan



Figure 1 Proposed site and Secondary Flood Defence

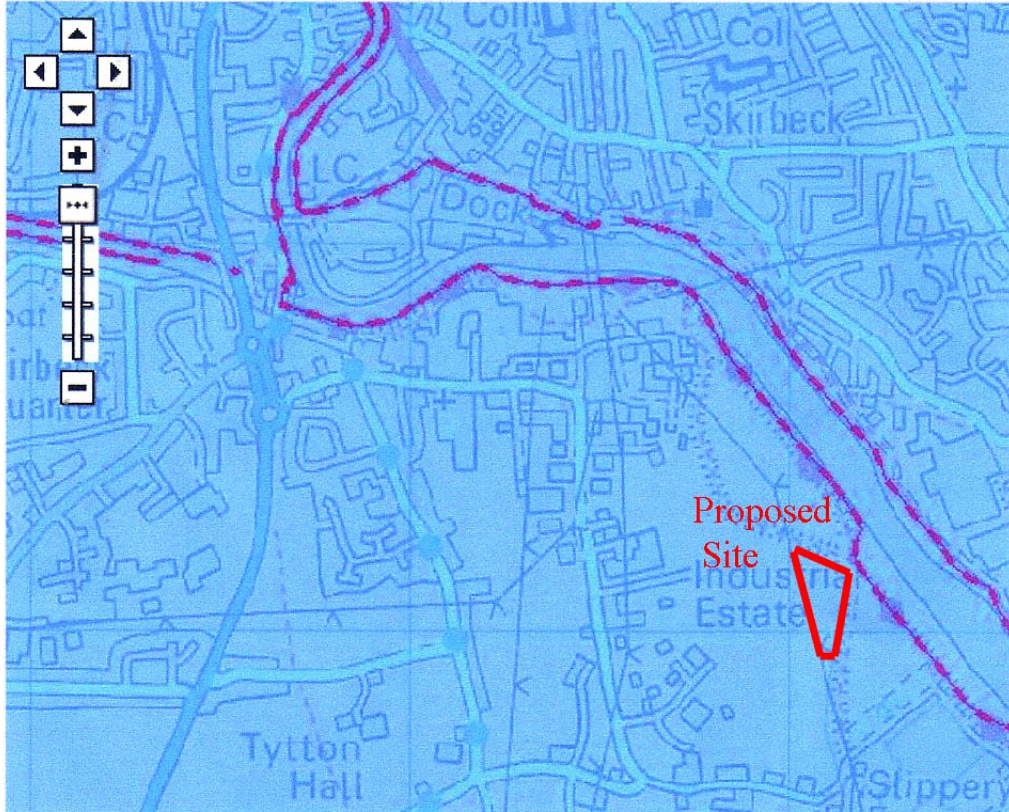


Figure 2 Haven Flood Banks



EXTRACT FROM ENVIRONMENT AGENCY FLOOD MAP


Map of X: 533,526;Y: 342,569 at scale 1:20,000







© Crown copyright. All rights reserved. Environment Agency, 100026380, 2008

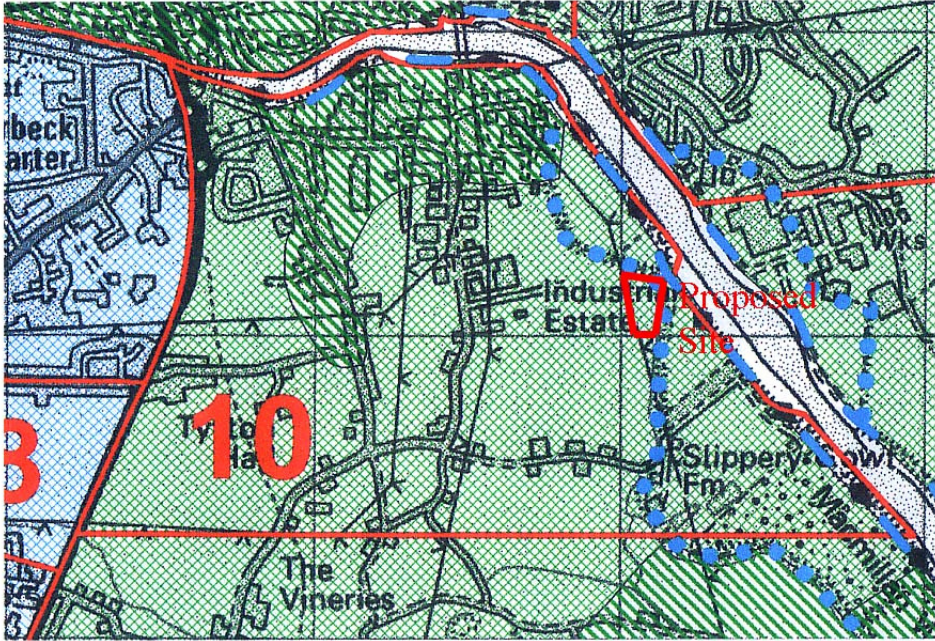


EXTRACT FROM BOSTON SFRA FLOOD MAPS



Tidal Flood Risk


-  Category 1 - Little or No Risk (<0.1%)
-  Category 2 - Low to Medium Risk (0.5% to 0.1%)
-  Category 3 - High Risk (>0.5%)
-  Primary Tidal Defences
-  Secondary Tidal Defences

EXTRACT FROM BOSTON LOCAL PLAN

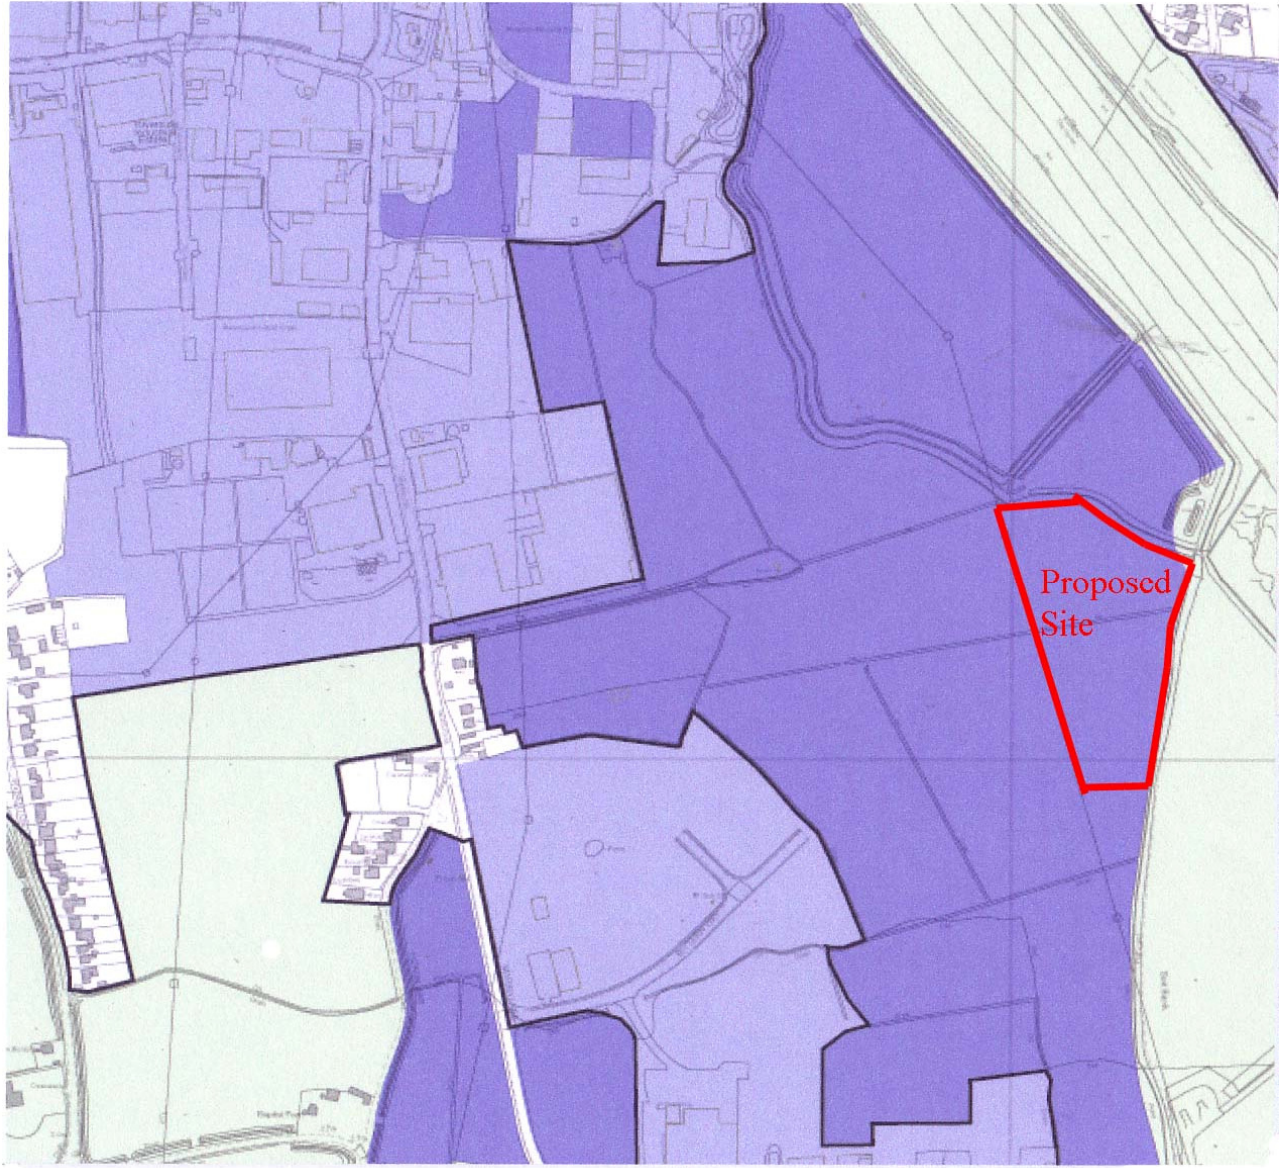


MAP 3



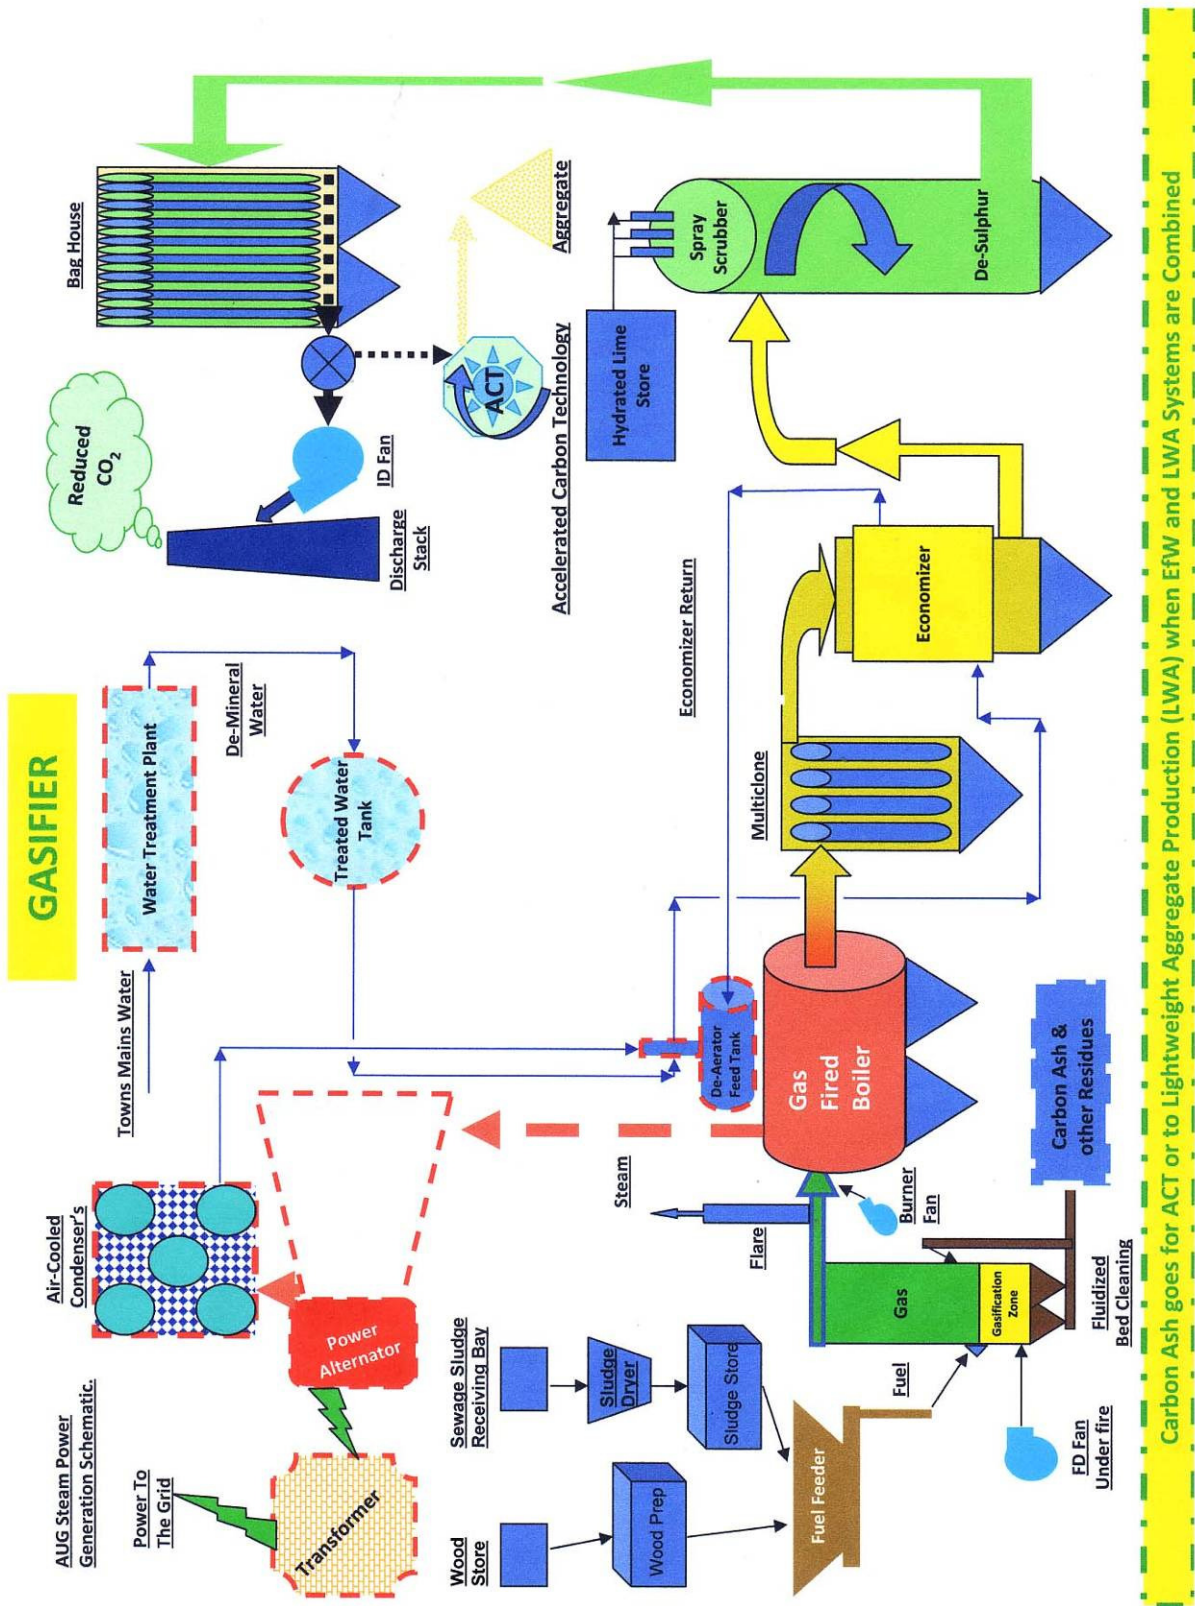

PLAN 1

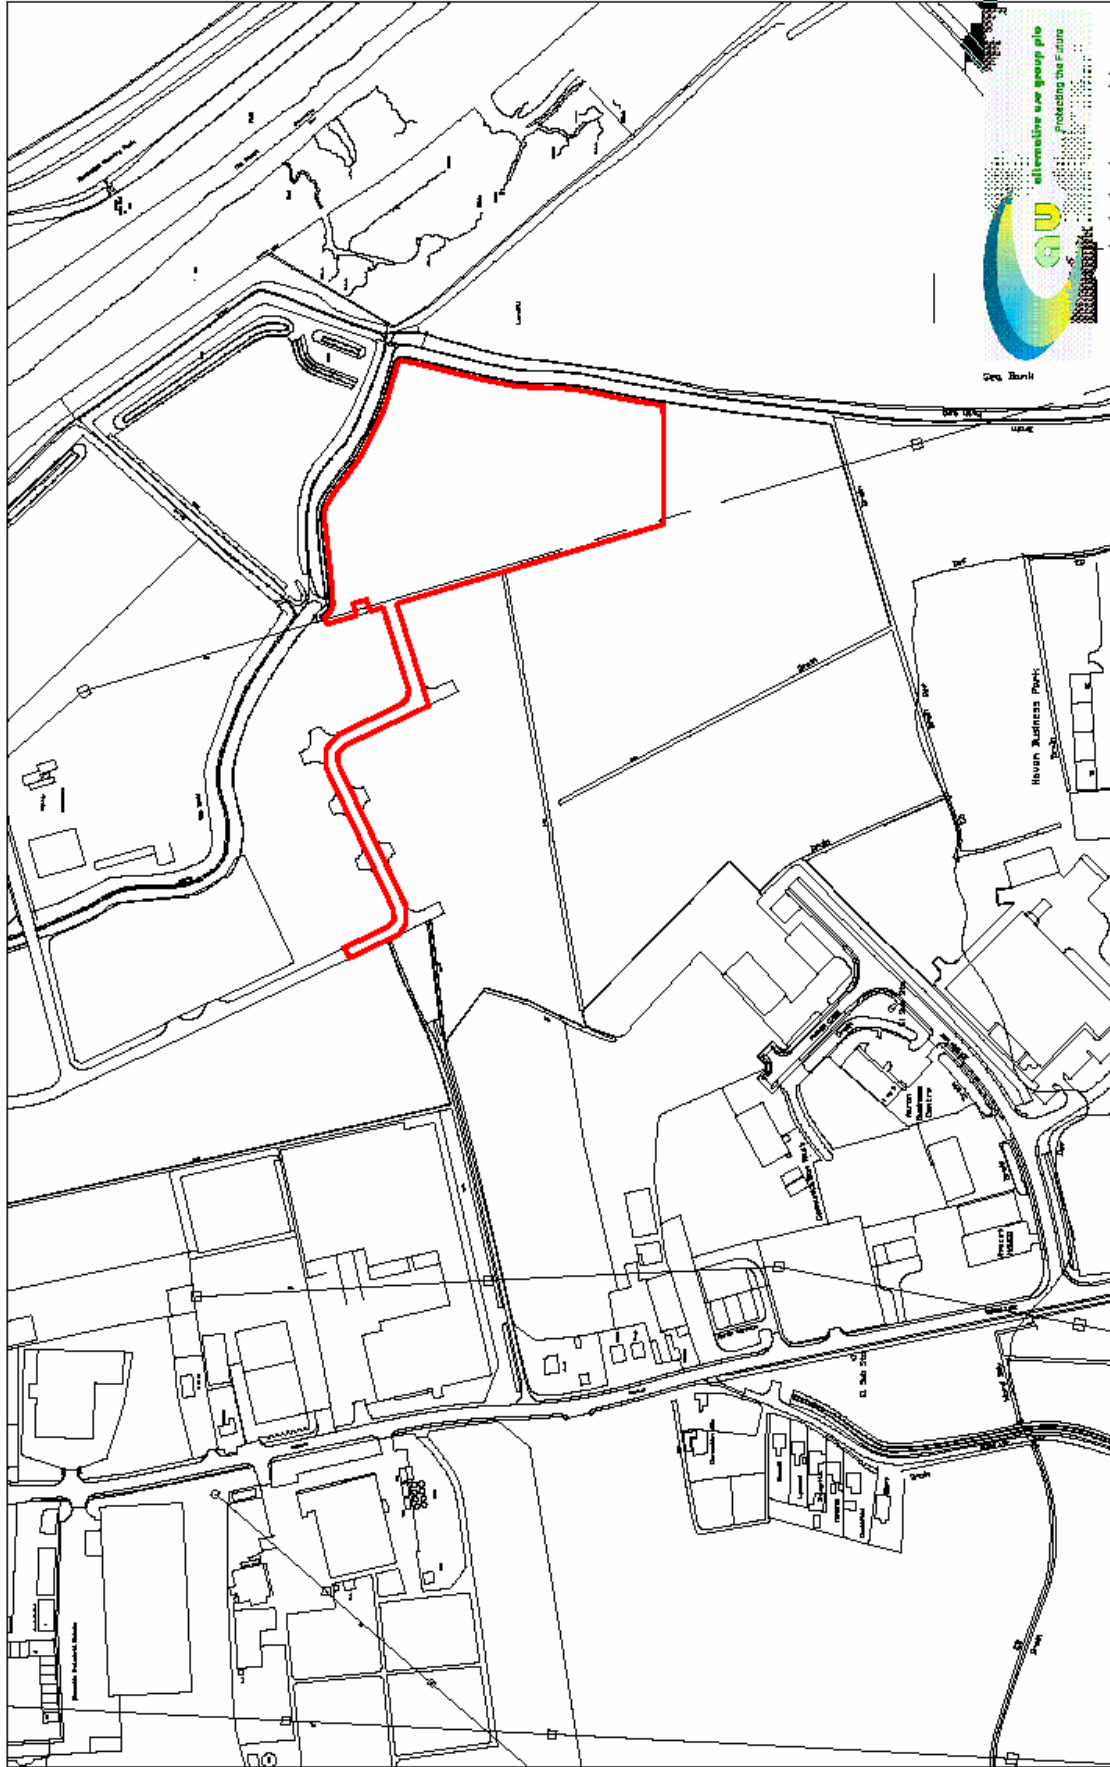

**flarevisual**  
 architecture  
 (01407) 80404 | info@flarevisual.co.uk | www.flarevisual.co.uk

Plan Visual Ltd  
 Little Wymondley Lane,  
 Lough, Lincs LN10 6JH  
 01509 511180

Project Name	Location Plan
Scale	1:2500
Date	October 2009
Sheet	A3
Revision	F20208 - 07 - A

**REVISIONS**

A	Final Issue to Highway Board - 18.10.2008
---	---

**NOTES**

This drawing is the copyright of FLARE VISUAL LTD and remains the property of the client.


All dimensions to be verified on site prior to commencement of work. Any discrepancies must be reported immediately.

All materials specified on this drawing are to be used in accordance with the manufacturer's instructions and current building regulations.

PLAN 2





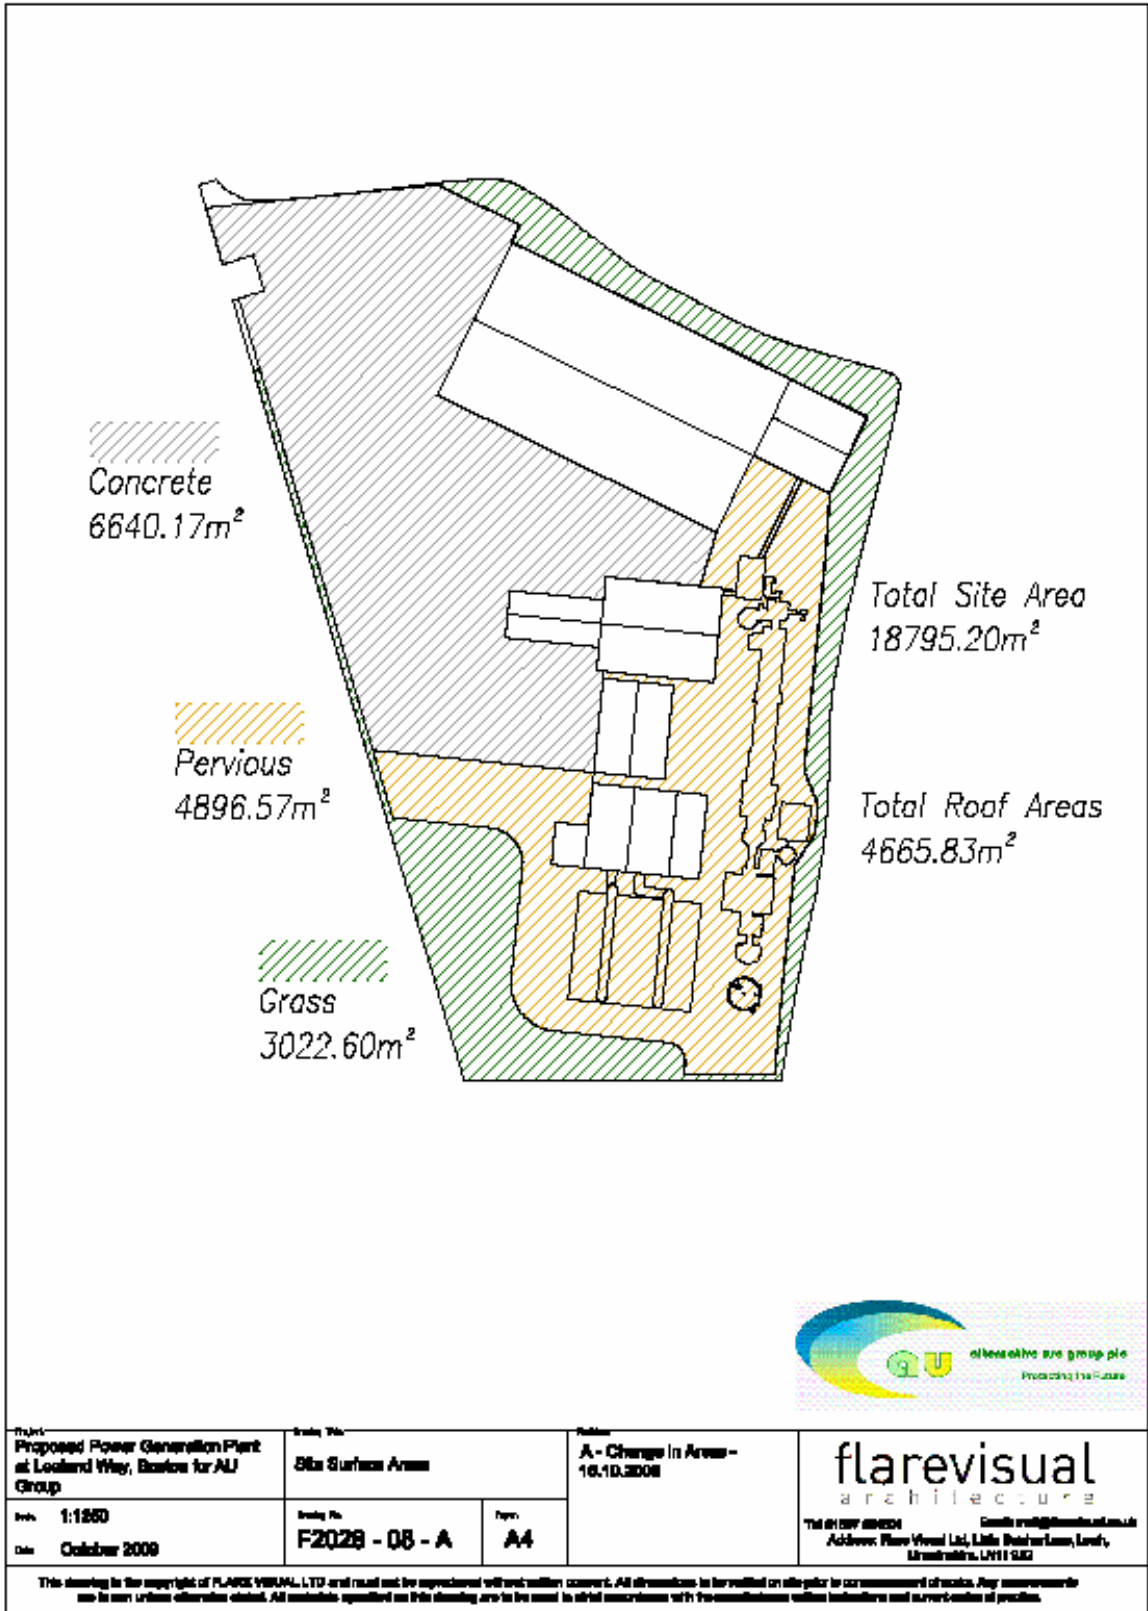





## SEQUENTIAL TEST

Paragraph E5 Annex E PPS 25 states that the SFRA should provide the basis from which to apply the Sequential Test and the Exception Test in the development allocation and development control process.

Boston Borough Council has produced a Flood Risk Matrix to ascertain whether or not the application complies with PPS25 and for the applicant to undertake a self assessment.

From **Sheet 1** of the matrix as the site lies within Flood Risk Category 3 High Risk a FRA is required and that Sequential and Exceptional Tests are also required.

### Sheet 2 Sequential Tests answers to the Questions

1. *Is the site specifically allocated (following sequential testing) for the use proposed in the Interim plan?*

Site shown allocated for Industrial development within the Local Plan

2. *Is the site in a location where the use is allowed (having regard to the SFRA) as a windfall development under the interim plan?*

No

3. *Are there any Interim Plan allocated sites that are available in a lower risk flood category area?*

No

4. *Do the Interim Plan or background documents identify reasonably available alternative allocations in the same flood zone but subject to a lower probability of flooding from all sources (as identified in the SFRA)?*

No

Sequential Test is passed.

Sequential Test is passed

### Sheet 3 Exceptions Test

1 Is it a housing development within a defined town centre

No

1. *Is the site Brownfield?*

No

2. *Would significant community benefit or sustainability benefit arise that could not be realised in an alternative location at lesser flood risk or which would outweigh the flood risk?*

The site is located within an area allocated for employment use up to 27 jobs will be created by this development. This is an "A" test as per D9 in PPS25



The proposal will generate 12Mw maximum of electricity from sources of locally obtained waste.

3. *If the proposal includes a “more vulnerable use” is this excluded from the ground floor or put to a suitable level?* No

The proposal falls into Essential Infrastructure, the proposed plant and sensitive control areas are to be located above the high tide level following global warming i.e.6.60mODN

4 *Is the development a translocation of an existing use/development which in its existing location is at a greater flood risk compared to the proposed site?*

No

6 There are no other allocated employment sites identified in the Local Plan which could accommodate the proposed development

Exceptions Test passed

## Appendix A

### PROPOSED SURFACE WATER DRAINAGE SCHEME RIVERSIDE INDUSTRIAL ESTATE, BOSTON.

An area of land comprising of approximately 25 Ha of land is included in the Borough of Boston Local Plan. Approximately 10 Ha has been developed or has an extant planning approval. **Plan 1** The Surface water disposal which is to local watercourses is very ad hoc with some areas attenuated by various on site means. The Black Sluice Internal Drainage Board has been concerned about the present and future developments for the surface water disposal.

Meetings have been held between the Internal Drainage Board and the Landowner to discuss what arrangements can be made to satisfactorily resolve the drainage problem.

The preliminary design has been prepared in accordance with the guidelines of the Black Sluice Internal Drainage Board and is based on limiting the outflow into the Board's system to 1.4litres/sec, the accepted Greenfield rate of run-off from the site.

The design will also comply with the Environment Agency requirements for surface water disposal to regulate the flow of surface water into the local water courses or drains.

This will be achieved by on-site attenuation within the existing private onsite drainage watercourses and the proposed new watercourse and pond and is designed to deal with surface water run-off up to the critical 1 in 100 year event plus an allowance of 30% for climate change.

The new watercourse will be cut alongside the extension of Bittern Way to the New Power Station Site Road length 250m coloured red. The watercourses shown in Blue on the plan will be widened and the new pond to provide the shortfall in capacity. **Plan 2**

#### Drainage Calculations

Total Area of Site = 25 Ha

Impervious areas – A broad assumption has been agreed that the impervious factor for the calculations is taken to be 51%

The Environment Agency requires the surface water attenuation facilities to be designed to cope with a 1 in100 year event plus an allowance of 30% for climate change, as stated in Table B2 PPS25.

The Black Sluice IDB has stated that the Greenfield rate of run-off for the area has been determined to be 1.4 litres/sec/Ha. This gives an allowable discharge of 35 litres/sec


From **Table 1** the calculated volume of storage required, to discharge at the rate of 35 litres/sec into the adjacent watercourses, is 9350 cubic metres.

It is proposed that this storage capacity is provided by:-

- A new dyke cut from Bitton Way
- The existing boundary watercourse widened on the owners side,
- Provision of new attenuation pond

### Storage Capacity Required

A new dyke is to cut to the same profile as the existing dyke alongside Bittern Way, 7.5m top width, 3.0m bottom, 1.5m deep with 1 to 1.5 side slopes. This gives a volume of storage per metre run of 7.875m<sup>3</sup>

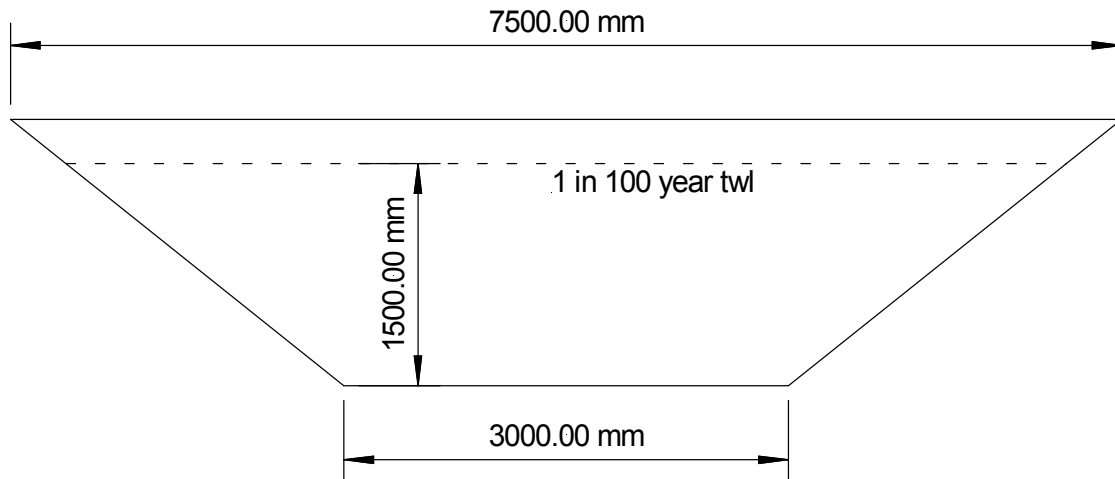


New Cut Watercourse

Total volume of storage within new dyke system = 250m x 7.875 = 1968.75 cub metres.

Length of existing watercourse to be widened = 590 lin. Metres

Total volume of storage within the widened dyke system = 590m x 3.42 = 2017.80 cub metres.

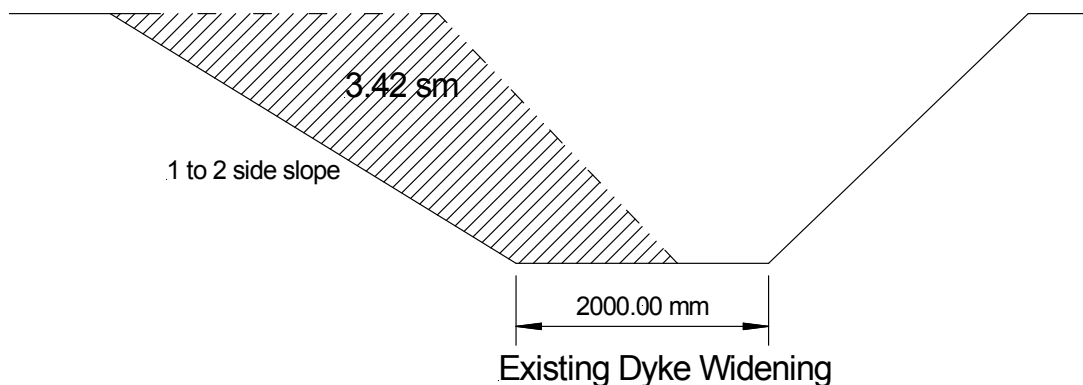

Shortfall in capacity = 9350 – 1968.75 – 2017.80 = 5463.45 m<sup>3</sup>

Pond size 91m x 40m x 1.5m deep


The proposed attenuation volume has been included in the Black Sluice IDB catchment model, and the consultants have confirmed the following.

**Results of modelling of extension of Wyberton Marsh Area:**

**Summary**

If the proposed development takes place as specified the drains in the development site will have enough capacity to store the runoff from the 100-year event and the maximum level will be 1.80mAOD in the IBD drain and 2.39mAOD in the site drains. This will not exceed the crest level of the control structure and any flow leaving the development will be controlled by the dimensions of orifice structure. **Model results have shown that for the 100-year event the outflow into the IDB drain will be approximately 30l/s.**

The drains will also have enough capacity to store the runoff from the 100-year plus climate change (+30%) event and the maximum level will be 2.44mAOD in the IBD drain and 2.56mAOD in the site drains. **In the 100-year climate change event the outflow into the IDB drain will be approximately 35l/s.**

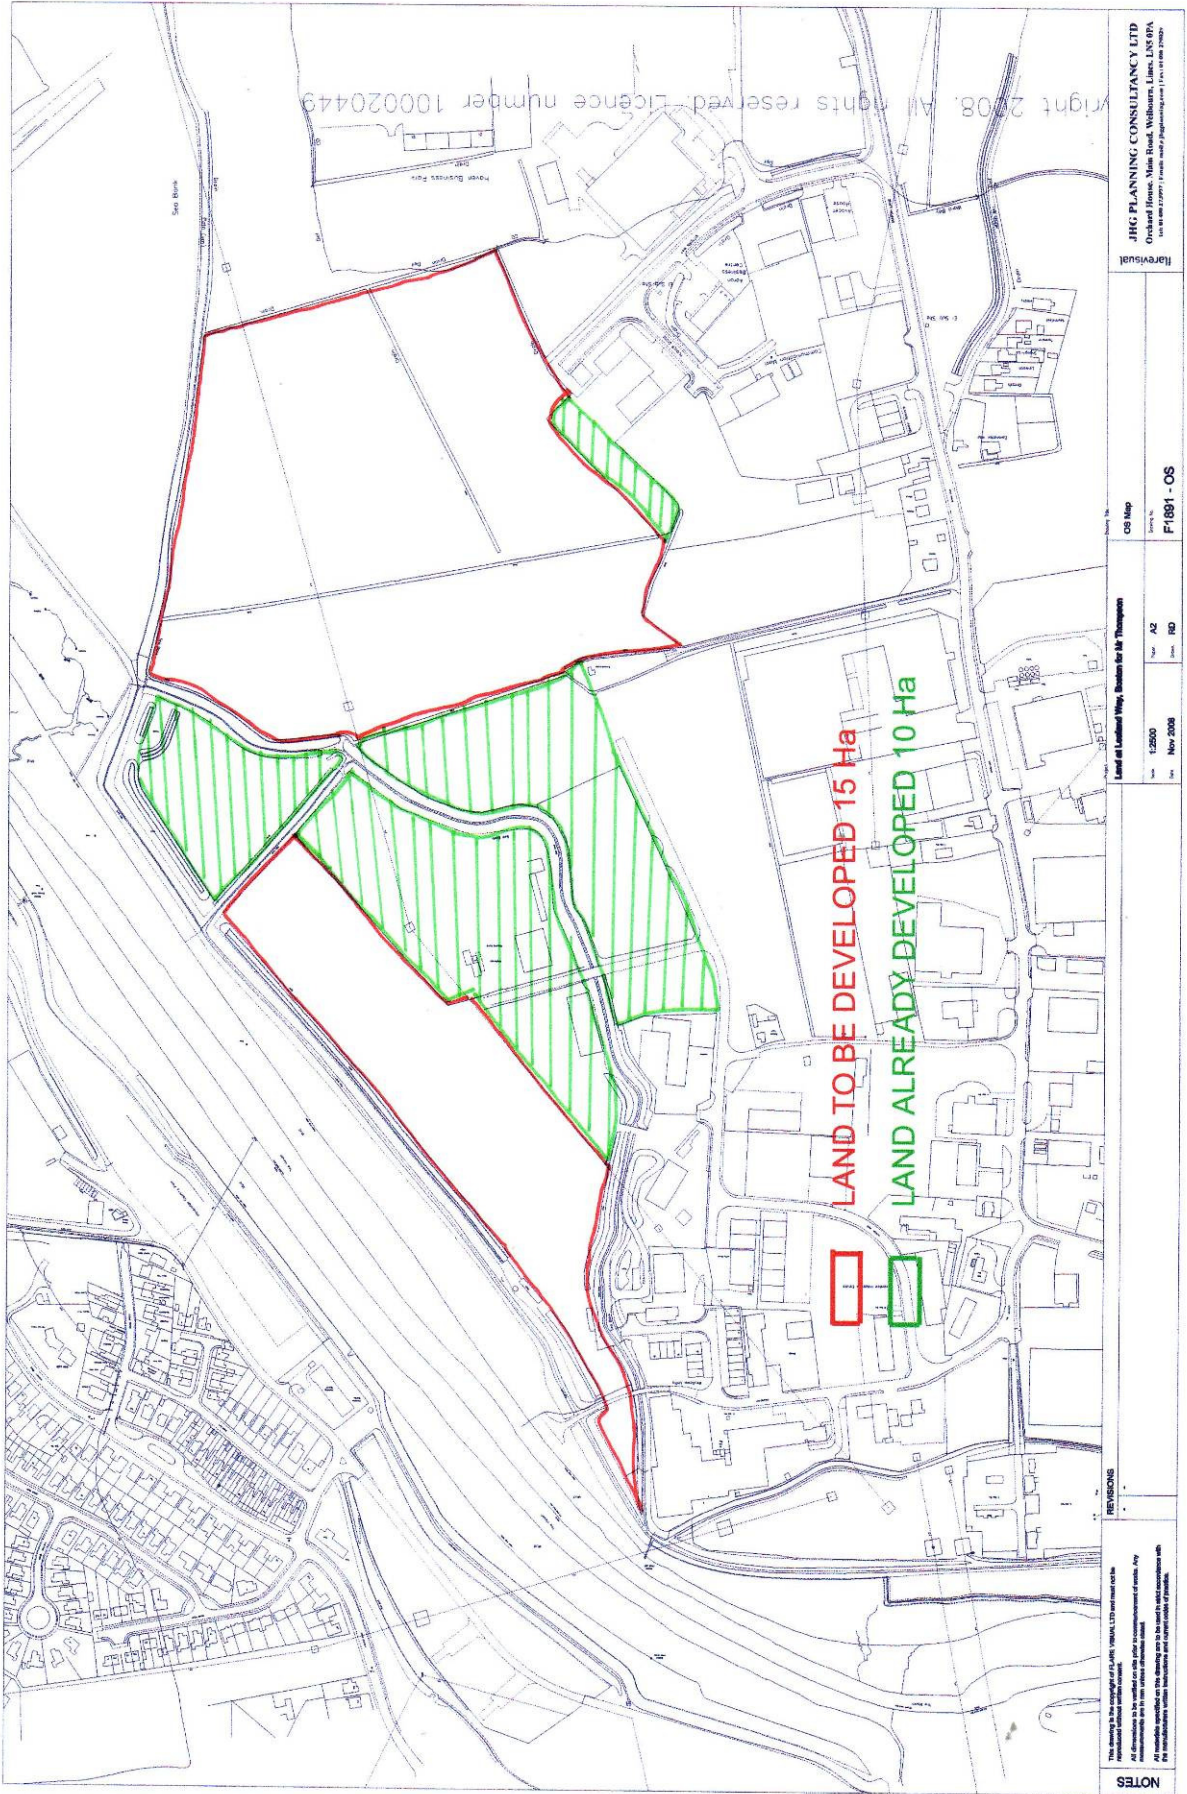

PLAN 1





PROPOSED RIVERSIDE INDUSTRIAL ESTATE BOSTON

Volume of Storage

TABLE 1 Using The Modified Rational Method

Volume of Storage Required for a 1 in 100 Year Storm

Catchment Area 25 Ha (51% impervious) greenfield rate of run-off 1.4 litres/sec/ha

r = 0.40

Duration min	M5-60min 20	Z1	M5-D mm	Z2	M100-D	Intensity mm/hr	Areal Factor	Areal Inten mm/hr	Area ha	Imp Factor	Q1 l/sec	Q2 l/sec	Volume cub m	Q1 + 30% l/sec	Q2 l/sec	Vol + CC cub m
15	20	0.64	12.80	1.98	25.34	101.38	0.94	95.29	25	0.51	3377.68	35.00	3008.41	4390.98	35.00	3920.38
30	20	0.81	16.20	1.97	31.91	63.83	0.95	60.64	25	0.51	2149.26	35.00	3805.68	2794.04	35.00	4966.28
60	20	1	20.00	1.93	38.60	38.60	0.96	37.06	25	0.51	1313.45	35.00	4602.42	1707.48	35.00	6020.95
120	20	1.21	24.20	1.89	45.74	22.87	0.97	22.18	25	0.51	786.27	35.00	5409.17	1022.16	35.00	7107.52
180	20	1.35	27.00	1.87	50.49	16.83	0.97	16.33	25	0.51	578.64	35.00	5871.35	752.24	35.00	7746.15
240	20	1.4	28.00	1.86	52.08	13.02	0.97	12.63	25	0.51	447.65	35.00	5942.15	581.94	35.00	7875.99
300	20	1.55	31.00	1.84	57.04	11.41	0.98	11.18	25	0.51	396.27	35.00	6502.85	515.15	35.00	8642.70
360	20	1.62	32.40	1.83	59.29	9.88	0.98	9.68	25	0.51	343.26	35.00	6658.46	446.24	35.00	8892.80
480	20	1.76	35.20	1.81	63.71	7.96	0.98	7.80	25	0.51	276.64	35.00	6959.18	359.63	35.00	9349.34
600	20	1.75	35.00	1.81	63.35	6.34	0.98	6.21	25	0.51	220.05	35.00	6661.91	286.07	35.00	9038.49

Maximum volume of storage = 93350 cub. metres at a storm duration of 8 hours

TABLE 1

# Email from Black Sluice IDB

Page 1

## Ray Morgan

---

**From:** Ian Watts [redacted]  
**Sent:** 01 December 2009 11:40  
**To:** Ray Morgan  
**Subject:** RE: Proposed Power Station Development at Marsh Lane

Ray

Provided the surface water drainage scheme is carried out to provide the level of attenuation required, then the Board will request that any outstanding details of the scheme be dealt with by the conditioning of any planning consent issued. This will be done in agreement with the local Planning Authority to address the Board's concerns regarding the development site (points 2, 3, 4 and 5 of our original response).

Additionally any Byelaw easement along the length of watercourse to be adopted should be agreed with the Board before any development commences. This is to ensure that the Board are satisfied that future access can be gained effectively along the relevant section and are able to issue the relevant consents, if required.


If you have any queries regarding this matter, then please do not hesitate to contact me.

Best Regards, Ian.

Ian Watts

Technical Engineer

Black Sluice Internal Drainage Board



---

**From:** Ray Morgan [redacted]  
**Sent:** 29 November 2009 16:12  
**To:** Ian Watts  
**Subject:** RE: Proposed Power Station Development at Marsh Lane

Good evening Ian

Thank you for your e-mail regarding the attenuation proposals. Will the Board accept that points 2, 3 & 5 can be covered with planning conditions should planning consent be given? If so I will arrange for the planning consultant to forward for your approval conditions for the Board to request when the application is being considered.

Regards  
Ray

---

01/12/2009




**From:** Stuart Hemmings  
**Sent:** 20 November 2009 15:46  
**To:** [REDACTED]  
**Cc:** Ian Watts  
**Subject:** Proposed Power Station Development at Marsh Lane

I have the following comments to make on the scheme that you have submitted for the surface water drainage of the area owned by Alan Thompson east of Marsh Lane:-

1. The Board accept that the overall scheme in principal will provide a satisfactory level of attenuation for the area concerned.
2. The proposed 450mm diameter pipe does not seem to be adequate to convey the drainage from the area to the north into the proposed open drain alongside Bittern Way
3. I look forward to receiving in due course a detailed plan showing proposed levels of new watercourses and culverts with detailed designs as required for the Board's approval.
4. I shall recommend to the Board that the section along Bittern Way should in future be maintained by the Board. As a Board's drain it will be subject to the Board's Byelaws, of particular note is Byelaw 10, the 9.0 metre rule. I would recommend a 6.0 metre wide strip should be created on the south east side of the new watercourse as a dedicated maintenance strip.
5. The future maintenance responsibility for other new watercourses, culverts and storage lagoons to be created should be established.

Regards

Stuart



01/12/2009

## **FLOOD EVACUATION PLAN GASIFICATION PLANT RIVERSIDE INDUSTRIAL ESTATE BOSTON**

The site is located within an area behind two flood defences at Riverside Industrial Estate Boston and is used as a gasification plant producing electricity the area of the site is approximately 1.8 Hectares.

The area is identified on the Environment Agency's Flood Maps as being at risk from flooding in extreme weather from a breach to the flood defences to the tidal River Haven. The risk has been assessed as being minimal due to the width height and construction of the tidal defence and is classified as being greater than 1 in 200 years.

As visitors or employees to the site you will be using a site, which is classified as being vulnerable in flood conditions and you will be required to register upon arrival and on leaving the site and to familiarise themselves with the plan.

Access to and from the site is along Nursery Road, Marsh Lane to the A16 as shown on the evacuation plan.

In the remote chance of a flooding happening on the site the following plan and action will be implemented.

A flood Marshal *Name*.....has been appointed who will be responsible to notify the occupants that flood warnings have been issued and to implement the evacuation of the site if necessary. A loud hailer will be kept in the office to assist in the evacuation notification.

The Environment Agency Automated Flood warning System will be subscribed to.

They will notify the owners of the site when the risk of flooding can be expected.

Upon receipt of a warning the Environment Agency website will be monitored regularly for new warnings.

The Plan will have three trigger points:

1. **FLOOD WATCH:-**Alert all site users of increased flood threat and ensure they are aware of possible evacuation if the situation deteriorates. All buildings will be visited as well to by the Flood Marshals explain the likelihood of the site flooding and that they should be prepared to move off.

Means; - Flooding of low lying and &  
roads is expected



What to do

- Monitor local news and weather forecasts
- Be aware of water levels near you
- Be prepared to act on your Flood Plan
- Check on safety of pets & livestock
- Charge your mobile phone

2. **FLOOD WARNING:-** Alert all site users of the further increased flood threat and ensure that they are ready to move off site if the next warning is received. Contact all those who are booked on site but not there, explain the situation and request that they do not return to the site unless further instructed by the owner or agent. The state of the Rivers will be checked, also the local weather forecast to ascertain whether the situation will deteriorate or improve. In the case of the situation deteriorating visitors will be asked to leave the site.

Means Flooding of homes and businesses is expected ACT NOW



What to do

- Move cars, pets, food, valuables & important documents to safety
- Get flood protection in place
- Turn off gas, electricity and water if safe to do
- Be prepared to evacuate
- Protect yourself, your family and help others
- Act on the flood plan
- 

3. **SEVERE FLOOD WARNING:-** Evacuate the site to the A16 by turning Right at the public highway at the site entrance, priority given to the vulnerable (elderly or disabled) with assistance if necessary from 4 wheel vehicle. Those away from the site will be contacted to stay away. Each visitor is recorded within the sites booking in procedures; therefore the owners are in a position to be able to make contact and accounted for.

Means:- Act now Severe flooding is expected and extreme danger to life & property



What to do

- Collect things you need for evacuation

- Turn of gas, electricity and water if safe to do
- Stay in a high place with a means of escape
- Avoid electricity sources
- Avoid walking or driving through flood water
- In danger call 999 immediately
- Listen to emergency services
- Act on the flood plan

4. **All Clear:**-Nobody will be allowed back on site until the Environment Agency has issued the all clear notice for the area.

Means:- No further flooding is expected  
Water levels will go down




What to do

- Keep listening to weather reports
- Only return to evacuated buildings when told to do so
- Beware of sharp objects and pollution in flood waters
- Ask for advice before cleaning up

A notice with the evacuation procedure and trigger points will be displayed in all the cabins and all personnel will be requested to make themselves aware of the contents together with the evacuation route plan.

The evacuation plan will be subject to an annual revue.

The **Floodline** telephone number is 0845 988 1188 for up to date flood information.

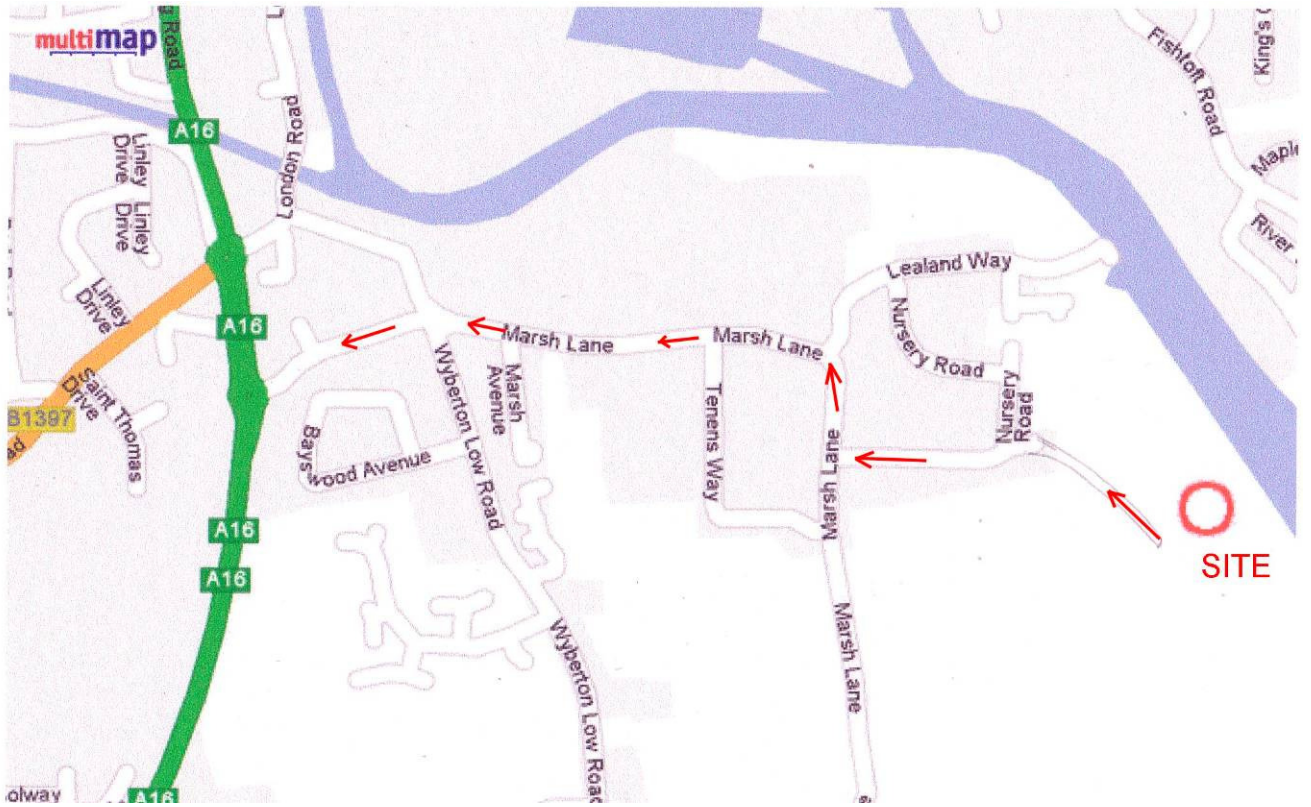

- . L.D.A. Ltd.
- . 2 Central Mews
- . Dinnington
- . Sheffield.
- . S25 2QN.
- . Tel/Fax No: 01909 561075
- . Mob No: 07831 557306
- . Email -mail@longdendesign.co.uk

# RIVERSIDE INDUSTRIAL ESTATE, BOSTON, LINCOLNSHIRE.

## SURFACE WATER MANAGEMENT PLAN.

. . . . .

Prepared for: Alternative Use Group Plc.  
Units 1 - 4 Dounsells,  
Mores Lane,  
Brentwood,  
Essex. CM14 5RZ.

# STORM WATER MANAGEMENT PLAN.

RIVERSIDE INDUSTRIAL ESTATE,  
BOSTON, LINCOLNSHIRE.

## SURFACE WATER MANAGEMENT PLAN.

Report To: Alternative Use Group Plc.  
Units 1 - 4 Dounsells,  
Mores Lane,  
Brentwood,  
Essex. CM14 5RZ.

Report Title: Surface Water Management Plan.  
Riverside Industrial Estate,  
Boston,  
Lincolnshire.

Revision Date: 28<sup>th</sup> February 2013. - Final

Originated By: **M Longden** ..... Date:....28th February 2013

The report and the site assessments carried out by LDA Ltd (LDA) on behalf of the Client are in accordance with the agreed terms of contract and/or written instructions. The reports and assessments produced by LDA have been undertaken with the knowledge and care ordinarily exercised by a Consulting Engineer and proportionate to the services instructed by the Client. The services provided by LDA have taken into account the extents of the scope of works required by the Client, the time scale involved and the resources, including financial and manpower resources, agreed between LDA and the Client.

Other than that expressly contained in the paragraph above, LDA provides no other representation or warranty whether expressed or implied, in relation to the services.

This report is produced exclusively for the purpose of the client. LDA is not aware of any interest or reliance by any third party on the services provided. Unless expressly provided in writing, LDA does not authorise or consent any party other than the Client relying upon the services provided. Any reliance on the service or any part of the services by any party other than the client is made wholly at that party's own and sole risk and LDA disclaims any liability to such parties.

This report is based on site conditions, regulatory or other legal provisions, technology or economic conditions at the time of providing the services to the Client. These conditions can change with time and reliance on the findings of the services cannot be guaranteed due to changing site conditions.

LDA cannot accept any responsibility for the accuracy of third party data used in this report.



## CONTENTS

SECTION 1	-	GENERAL
SECTION 2	-	SURFACE WATER MANGEMENT PLAN (SWMP).
SECTION 3	-	PREPARATION OF SWMP - STAKEHOLDERS.
SECTION 4	-	RISK ASSESSMENT
SECTION 5	-	OPTIONS
SECTION 6	-	IMPLEMENTATION AND REVIEW.

# STORM WATER MANAGEMENT PLAN.

RIVERSIDE INDUSTRIAL ESTATE,  
BOSTON, LINCOLNSHIRE.

---

## 1 GENERAL

- 1.1 The following report considers the further risk of internal flooding and the implications of storm water run-off associated with the continued development of land within Riverside Industrial Estate, Boston Lincoln.
- 1.2 Riverside Industrial Estate extends to 44.8 hectares and is a principal area for industrial development in the town and allocated accordingly in the Local Development Framework Strategy.
- 1.3 Approximately 25 hectares of the industrial estate are owned by Alchemy Farms Ltd and approximately 10 hectares has already been developed or has extant planning approval for industrial land-uses.
- 1.4 As part of the on-going development of the land owned by Alchemy Farms Ltd an application for the construction of a Gasification Power Station comprising gasification plant, turbine house, air cooled condenser, waste timber storage and preparation building, sewage sludge, drying and storage building, combined two storey offices, control room and workshop building, weighbridge and site security building, site security fence, surfaced vehicle manoeuvring and parking area and construction of access at land off Marsh Lane, Riverside Industrial Estate, Boston was granted a conditional planning permission on the 7<sup>th</sup> September 2010 - App Ref: B09/0477 (LCC Ref: B/0477/09).
- 1.5 Included within the Conditions regulating the planning approval were specific measures for “Site Drainage & Pollution Prevention”. In this regard condition 12 states *‘No development shall take place until a scheme for the provision of both on-site and off-site surface water drainage has been submitted to and approved in writing by the Waste Planning Authority, in consultation with the Internal Drainage Board and the Environment Agency. The scheme shall reflect the details and proposals as set out in Appendix A of the Flood Risk Assessment (as defined by Condition 2) and shall also include details of the measures to be taken to enhance the new and enlarged drainage ditches and the water storage systems so as to provide optimal habitat for use by water voles. The approved scheme shall thereafter be implemented and carried out in accordance with the approved details before the construction of the facility hereby permitted commences and shall thereafter be maintained for the duration that the development hereby permitted subsists’*
- 1.6 A Discharge of Conditions Application was submitted to the LPA by JHG Planning Consultants to address all the pre-commencement conditions; in particular to this report those concerning “Site Drainage and Pollution prevention” as described above.

# STORM WATER MANAGEMENT PLAN.

RIVERSIDE INDUSTRIAL ESTATE,  
BOSTON, LINCOLNSHIRE.

---

- 1.7 Included in the supporting information for the discharge of conditions application, with particular reference to site drainage and pollution prevention, were the following documents:
- (i) Dwg N<sup>o</sup>: LDA/836/LDS/01A - STORM WATER STORAGE - SHEET 1 of 2.
  - (ii) Dwg N<sup>o</sup>: LDA/836/LDS/02A - STORM WATER STORAGE - SHEET 2 of 2.
  - (iii) Addendum to Flood Risk Assessment (Ref: LDA/ADDENDUM/14\_06\_2012)
- 1.8 The above documents reflected the principles of the Flood Risk Assessment - Version 4 - December 2009 - Appendix A- which took into consideration the following criteria:
- (i) *Total Site Area = 25 hectares.*
  - (ii) *Impervious Area - 51% of total site area.*
  - (iii) *Maximum discharge rate = 35 litres/sec into IDB system.*
  - (iv) *A volume of 9,350 cubic metres of attenuation was required for a 1 in 100 year plus climate change at 30%.*
  - (v) *Water channel to be developed with a maximum water depth of 1.5 metres.*
  - (vi) *The I.D.B had modelled and agreed that both the volume and depth of water to be attenuated at Riverside Industrial Estate was acceptable and in keeping with the off-site land drainage system locally.*
- 1.9 As a consequence of the application for the discharge of planning conditions, particularly affecting site drainage and pollution, the LPA re-consulted with both the Black Sluice Internal Drainage Board and the Environment Agency.
- 1.10 In January 2013 the Environment Agency informed the L.P.A that they were unable to support the discharge of the drainage conditions for the following reason:
- (i) Although the addendum to the Flood Risk Assessment sets out the right principles for surface water treatment on the site, no detailed calculations or network details have been submitted in support of achieving these principles.
  - (ii) That the minimum level of detail necessary for the E.A to support the discharge of Condition would be a production of information in accordance with the E.A Surface Water Guidance Sheet 3: Discharge of Surface Water Condition.
- 1.11 In compliance with the guidance referred to above, the following sections of this report undertake to provide the production of information, data and hydraulic model results for the land drainage implication of both the Gasification Application Site and the Riverside Industrial Estate. The aim being to establish the basis of a Surface Water Management Plan for Riverside Industrial Estate.
-

## 2 SURFACE WATER MANAGEMENT PLAN.(S.W.M.P.)

- 2.1 The following sections of this report consider the measures necessary to establish a Surface Water Management Plan (SWMP) for Alchemy Farms Ltd, Riverside Industrial Estate, Boston, Lincolnshire.
- 2.2 This SWMP will establish the long-term action plan to manage the impact of surface water on the industrial estate; inform future capital investors, establish drainage maintenance programmes and inform all future stakeholders in land-use planning, emergency planning and the planning of future developments.
- 2.3 The SWMP guidance is structured into four key phases:
- (i) Preparation.
  - (ii) Risk Assessment.
  - (iii) Options.
  - (iv) Implementation and Review.

## 3 PREPARATION OF S.W.M.P. - Stakeholders.

- 3.1 The Riverside Industrial Estate is a low lying area of land that is potentially susceptible to flooding from the following sources:
- (i) The tidal Haven.
  - (ii) The Wyberton Marsh pumped catchment.
  - (iii) Continuing development of Riverside Industrial Estate.
- 3.2 The Haven is a tidal main river and the flood defences along the south bank that protect the industrial estate consist of earth embankments with a crest level of 6.5 m ODN and provide a 1 in 200 year level of protection against a tide level of 5.93 m ODN. The flood defences are maintained by the Environment Agency in this case.
- 3.3 The site lies within the administrative area of the Black Sluice Internal Drainage Board who has power under the Land Drainage Act to carry out measures to alleviate flooding in districts with special drainage needs other than main rivers.
- 3.4 The Riverside Industrial Estate is the principal industrial area within the Borough of Boston Lincs. It is an area that is proposed to extending to 44.8 Hectares within the Local Development Framework and represents an important element of the economic prosperity of the town. Lincolnshire County Council and Boston Borough Council are local government authorities responsible for the future planning, regeneration and permissible land-uses on the industrial estate.
- 3.5 The Riverside Industrial Estate (44.8 Ha) is owned in-part by Alchemy Farms Ltd (25 Ha) and the current application site (1.876 Ha) is for a Gasification Power Station promoted by Alternative Use Group Plc.
- 3.6 All the stakeholders referred to above have been directly involved with the development of the Riverside Industrial Estate and will continue to be involved with all future developments especially in respect to “Site Drainage and Pollution Prevention”.

# STORM WATER MANAGEMENT PLAN.

RIVERSIDE INDUSTRIAL ESTATE,  
BOSTON, LINCOLNSHIRE.

---

## 4 RISK ASSESSMENT.

- 4.1 The assessment of the volume of attenuation storage is based on the 1 in 100 year storm event plus an allowance of 30% for climate change and an allowable discharge rate 35 litres/second.
  
- 4.2 The complete suite of assessments for the above criteria is given in APPENDIX 1 but summarised below are the essential results:
  - (i) Assessments of overall long-term storage  
for 1 in 100 year storm event = 6,996.1sq.m
  - (ii) Critical storm event and duration = 1,440 mins
  - (iii) Critical storm rainfall rate = 3.45 mm/hr
  - (iv) Assessment of overall long-term storage for 1 in 100 year +  
additional 30% for climate change = 9,642 sq.m
  - (v) Assessment of overall long-term storage for 1 in 200 year  
storm event = 10,870.9sq.m
  
- 4.3 The engineers of Black Sluice Internal Drainage Board have advised that the control structure for the improved drainage channel and attenuation pond will be the Wyberton Marsh Pumping Station.
  
- 4.4 In this regard the engineers of Black Sluice I.D.B have undertaken various hydraulic assessments and simulations to incorporate the Riverside Industrial Estate in the overall Wyberton Marsh catchment area.
  
- 4.5 The Board have determined that the volume and the associated depth of water anticipated within the Riverside Industrial Estate area is compatible with the Boards drains in the locality. The Boards drains in the vicinity of the industrial estate also attenuate storm water run-off from Wyberton Marsh catchment area during a severe storm event.

# STORM WATER MANAGEMENT PLAN.

RIVERSIDE INDUSTRIAL ESTATE,  
BOSTON, LINCOLNSHIRE.

---

## 5.0 OPTIONS.

5.1 The options available for the long-term future proofing of Riverside Industrial Estate with regard to sustainable drainage systems (SUDS) to safeguard site drainage and pollution are as follows:

- (i) RIVERSIDE INDUSTRIAL ESTATE - EXTERNAL AREAS
  - Constructed Wetlands.
  - Balancing Ponds - Detention Basin - Retention Ponds.
  - Filter Strips and Swales to estate roads.
  - Additional water channels to extend the I.D.B network.
  
- (ii) INDIVIDUAL DEVELOPMENT SITE - INTERNAL AREAS
  - Water Harvesting.
  - Green Roofs.
  - Landscaping.
  - Soakaways, infiltration trenches, swales and basins.
  - Permeable surfaces and filter drains.

5.2 The options for Riverside Industrial Estate have been considered in detail in Section 4: Risk Assessment but the options applicable to individual development sites need to be managed, planned and executed to accord with the specified criteria.

5.3 In this regard the detailed consideration of the application site provides the following results in respect to “Site Drainage and Pollution”. The following areas are applicable to the proposed power station plant at Lealand Way, Boston for the Alternative Use Group: (Refer the FIG 5.1 below)

- (i) Total impermeable areas = 9,326.68m<sup>2</sup>.
- (ii) Total permeable area = 9,468.52m<sup>2</sup>. ( including landscape)
- (iii) Total site area = **18,795.20m<sup>2</sup>**.

5.4 From the above figures the following percentage changes are:

- (i) % Impermeable areas (including roofs and paving) = 49.63%
- (ii) % Permeable areas (incl landscaping) = 50.37%  
**100.00%**



# STORM WATER MANAGEMENT PLAN.

RIVERSIDE INDUSTRIAL ESTATE,  
BOSTON, LINCOLNSHIRE.

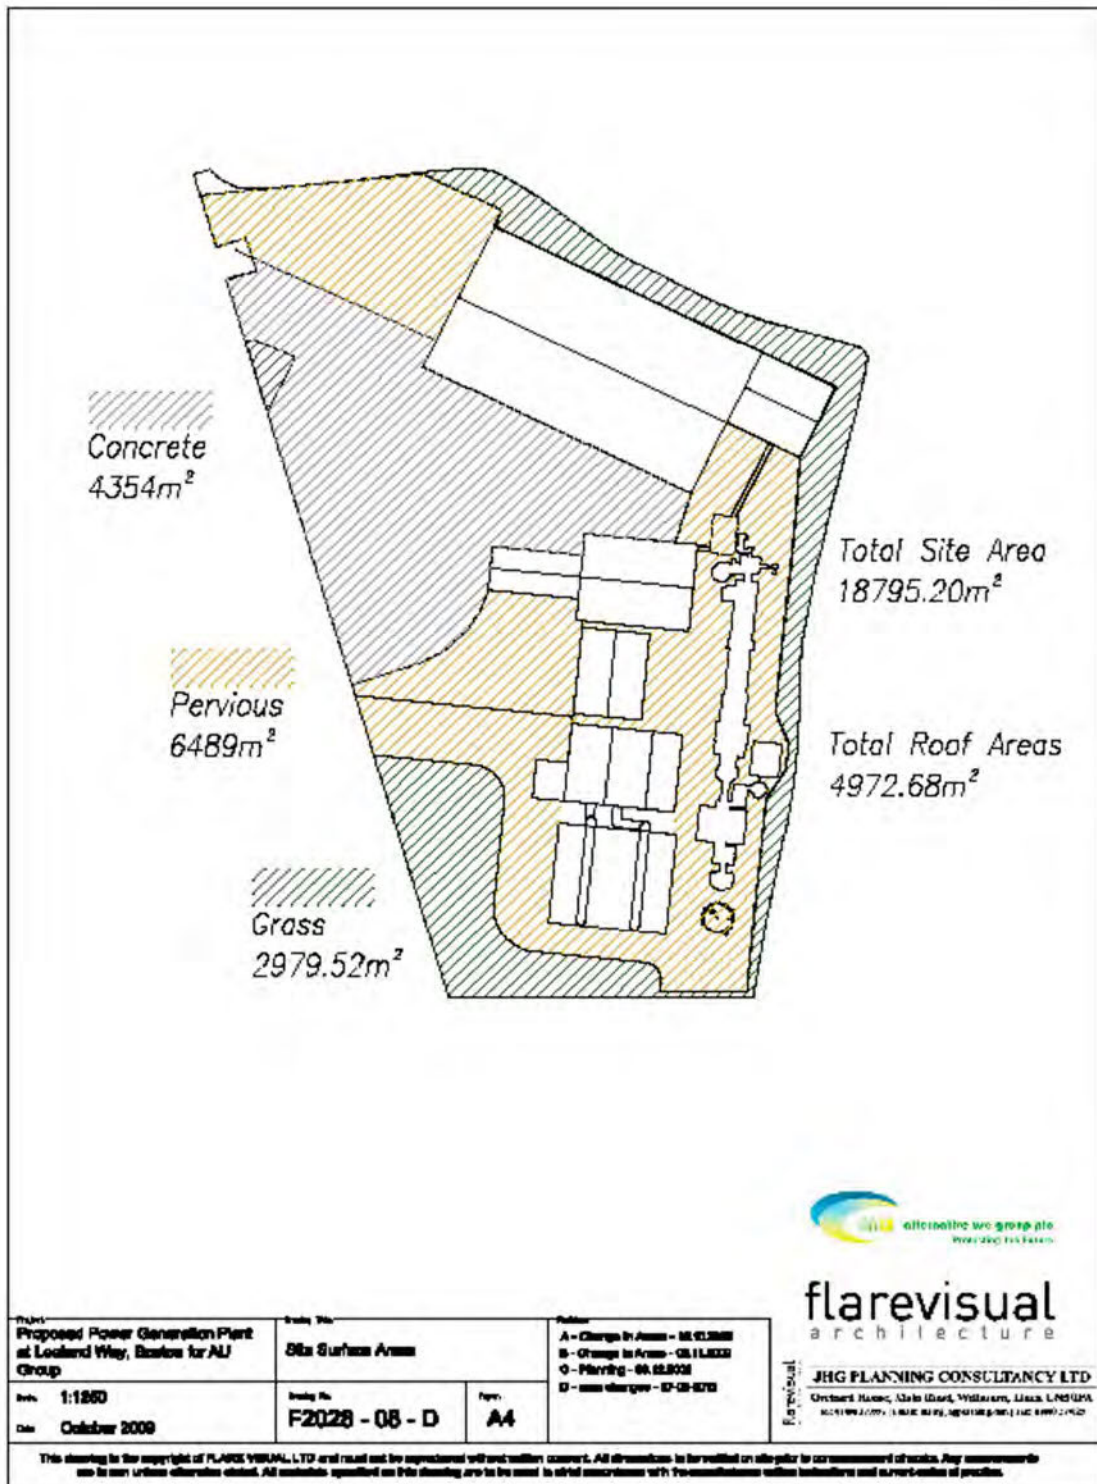


Fig 5.1 - Proposed Application Site Surfacing Details.

# STORM WATER MANAGEMENT PLAN.

RIVERSIDE INDUSTRIAL ESTATE,  
BOSTON, LINCOLNSHIRE.

- 5.5 From the above figures it can be seen that the impermeable conversion rate of 49.63 % for the Gasification Site is in accordance with the original FRA reference Version 4: December 2009 which states - "Appendix A, Drainage Calculations, Impervious areas - A broad assumption has been agreed that the impervious factor for calculations is taken to be 51%.
- 5.6 The development of the Gasification Site incorporates perimeter landscaping and pervious paved areas to reduce the operational impermeable area necessary for the complex to function. Unfortunately the prevailing ground conditions will prohibit infiltration into the underlying sub-strata to any significant effect. (Refer to Fig 5.2 below.)



Plate 1 – General view across the site, looking southeast



Plate 3 – Trench 1 section, looking southwest



Plate 2 – Trench 1 after cleaning, looking northwest



Plate 4 – Trench 2 after cleaning, looking north



Plate 5 – Trench 2 section, looking east

Fig 5.2 - Prevailing Ground Conditions.

# STORM WATER MANAGEMENT PLAN.

RIVERSIDE INDUSTRIAL ESTATE,  
BOSTON, LINCOLNSHIRE.

---

- 5.7 The pervious areas of the application site will therefore incorporate land drainage to relieve any accumulated storm water within the sub-base layers by discharging to nearby open ditches.
- 5.8 The future flood proofing of Riverside Industrial Estate will necessitate the continued monitoring, review and implementation of the SWMP as the impermeable conversion rates for future developments are considered.
- 5.9 In this regard the current assessment of storm water attenuation requirements for Riverside Industrial Estate, with regard to any variation of the impermeable conversion rates have been considered as follows:-
- (i) Impermeable Conversion Rate of **65%** = 12,921 m<sup>3</sup> of storage.
  - (ii) Impermeable Conversion Rate of **75%** = 15,403 m<sup>3</sup> of storage.
  - (iii) Impermeable Conversion Rate of **85%** = 17,996 m<sup>3</sup> of storage.
- (Complete Micro Drainage data results are attached - Appendix 2).

## 6.0 IMPLEMENTATION AND REVIEW

6.1 This section considers the measures necessary for implementing and more importantly delivering the SWMP detailed in the preceding sections.

6.2 The options that have been specified for the Riverside Industrial Estate in general and the individual development sites in particular have to be continually monitored and assessed to ensure that the outcomes and benefits of the SWMP are being complied with and where practicable exceeded wherever possible.

6.3 The implementation and review of the surface water management plan therefore needs to follow the following strategy:

- Retain compliance with the principles and objectives set out in the SWMP study.
- Establish capital and revenue budgets and actions for the construction and maintenance of each element of the SWMP critical actions.
- Maintain contemporary advice and information for all approving authorities and other stake holders in future re-development applications.
- Provide advice, guidance and supplementary data to all approving authorities and other stakeholders on review results and remedial measures necessary to maintain the principle objectives of the SWMP.

6.4 It is recommended that the partnership established between the various stakeholders involved with the re-development of Riverside Industrial Estate continue to work together to agree implementation of the proposed actions which are identified in the preparation of future action plans. In this regard there may be circumstances which might trigger a review and/or an update of the action plan such as:

- Occurrence of a flooding incident.
- Additional data or modelling becoming available which may alter the understanding of risk within the catchment/rivers/industrial estate.
- Outcome of investment decisions by stakeholders/partners affecting the land drainage or flood defences in the catchment/rivers/industrial area.
- Additional development or other changes in the catchment and/or industrial estate which effects surface water flood risk.

# STORM WATER MANAGEMENT PLAN.

RIVERSIDE INDUSTRIAL ESTATE,  
BOSTON, LINCOLNSHIRE.

---

6.5 It is recommended that the impermeable conversion rate for all future developments are monitored and assessed against the base rate of 51% or 12.75 hectares of the Riverside Industrial Estate.

6.6 At the point of exceedance of the impermeable base rate the additional sections of open ditch and the required extension to the attenuation basin will be constructed in accordance with the requirements of the approving authorities so that the discharge rate of 35 litres per second is retained into the Black Sluice Internal Drainage Board maintained system of land drainage ditches.

# STORM WATER MANAGEMENT PLAN.

---

RIVERSIDE INDUSTRIAL ESTATE,  
BOSTON, LINCOLNSHIRE.


## APPENDIX 1.

Baseline Assessments of On-Site Storage.  
1 in 100 years and 1 in 100 years + 30% CC.



# STORM WATER MANAGEMENT PLAN.


RIVERSIDE INDUSTRIAL ESTATE,  
BOSTON, LINCOLNSHIRE.

SCP		Page 1					
Lawrence Buildings 2 Mount Street Manchester M2 5WQ							
Date 25/02/2013 10:58 File 1 in 100year st...	Designed by Gary Ben... Checked by						
Micro Drainage		Source Control 2013.1					
<u>Summary of Results for 100 year Return Period</u>							
Storm Event	Max Level (m)	Max Depth (m)	Max Control (l/s)	Max Overflow (l/s)	Max Outflow (l/s)	Max Volume (m³)	Status
15 min Summer	0.333	0.333	26.9	0.0	26.9	2333.0	O K
30 min Summer	0.437	0.437	26.9	0.0	26.9	3057.4	O K
60 min Summer	0.543	0.543	26.9	0.0	26.9	3803.9	O K
120 min Summer	0.649	0.649	28.1	0.0	28.1	4544.2	O K
180 min Summer	0.707	0.707	29.3	0.0	29.3	4950.1	O K
240 min Summer	0.745	0.745	30.1	0.0	30.1	5211.9	O K
360 min Summer	0.794	0.794	31.1	0.0	31.1	5557.0	O K
480 min Summer	0.826	0.826	31.7	0.0	31.7	5780.0	O K
600 min Summer	0.847	0.847	32.1	0.0	32.1	5928.1	O K
720 min Summer	0.861	0.861	32.4	0.0	32.4	6027.0	O K
960 min Summer	0.876	0.876	32.6	0.0	32.6	6129.8	O K
1440 min Summer	0.876	0.876	32.6	0.0	32.6	6129.7	O K
2160 min Summer	0.863	0.863	32.4	0.0	32.4	6041.8	O K
2880 min Summer	0.846	0.846	32.1	0.0	32.1	5921.6	O K
4320 min Summer	0.803	0.803	31.3	0.0	31.3	5624.4	O K
5760 min Summer	0.757	0.757	30.4	0.0	30.4	5300.9	O K
7200 min Summer	0.712	0.712	29.4	0.0	29.4	4980.9	O K
8640 min Summer	0.668	0.668	28.5	0.0	28.5	4673.3	O K
10080 min Summer	0.626	0.626	27.7	0.0	27.7	4383.7	O K
15 min Winter	0.374	0.374	26.9	0.0	26.9	2615.1	O K
30 min Winter	0.490	0.490	26.9	0.0	26.9	3428.5	O K
60 min Winter	0.609	0.609	27.3	0.0	27.3	4265.9	O K
Storm Event	Rain (mm/hr)	Flooded Volume (m³)	Discharge Volume (m³)	Overflow Volume (m³)	Time-Peak (mins)		
15 min Summer	98.681	0.0	1569.9	0.0	31		
30 min Summer	64.789	0.0	1988.8	0.0	45		
60 min Summer	40.510	0.0	3263.2	0.0	74		
120 min Summer	24.461	0.0	3849.8	0.0	134		
180 min Summer	17.964	0.0	4132.9	0.0	192		
240 min Summer	14.342	0.0	4287.8	0.0	252		
360 min Summer	10.418	0.0	4432.0	0.0	370		
480 min Summer	8.302	0.0	4471.4	0.0	488		
600 min Summer	6.956	0.0	4467.0	0.0	608		
720 min Summer	6.017	0.0	4446.0	0.0	726		
960 min Summer	4.784	0.0	4404.0	0.0	964		
1440 min Summer	3.456	0.0	4301.3	0.0	1346		
2160 min Summer	2.493	0.0	7817.3	0.0	1684		
2880 min Summer	1.975	0.0	7974.1	0.0	2060		
4320 min Summer	1.421	0.0	7492.3	0.0	2896		
5760 min Summer	1.124	0.0	10088.8	0.0	3696		
7200 min Summer	0.936	0.0	10467.7	0.0	4544		
8640 min Summer	0.806	0.0	10756.6	0.0	5360		
10080 min Summer	0.710	0.0	10937.9	0.0	6152		
15 min Winter	98.681	0.0	1754.7	0.0	30		
30 min Winter	64.789	0.0	2116.7	0.0	45		
60 min Winter	40.510	0.0	3620.7	0.0	74		
©1982-2012 Micro Drainage Ltd							

# STORM WATER MANAGEMENT PLAN.

RIVERSIDE INDUSTRIAL ESTATE,


BOSTON, LINCOLNSHIRE.

SCP		Page 2					
Lawrence Buildings 2 Mount Street Manchester M2 5WQ							
Date 25/02/2013 10:58	Designed by Gary Ben...						
File 1 in 100year st...	Checked by						
Micro Drainage		Source Control 2013.1					
<u>Summary of Results for 100 year Return Period</u>							
Storm Event	Max Level (m)	Max Depth (m)	Max Control (l/s)	Max Overflow (l/s)	Max Σ Outflow (l/s)	Max Volume (m³)	Status
120 min Winter	0.728	0.728	29.8	0.0	29.8	5097.8	O K
180 min Winter	0.794	0.794	31.1	0.0	31.1	5556.9	O K
240 min Winter	0.836	0.836	31.9	0.0	31.9	5854.2	O K
360 min Winter	0.893	0.893	33.0	0.0	33.0	6250.5	O K
480 min Winter	0.930	0.930	33.6	0.0	33.6	6510.6	Flood Risk
600 min Winter	0.955	0.955	34.1	0.0	34.1	6687.0	Flood Risk
720 min Winter	0.973	0.973	34.4	0.0	34.4	6808.7	Flood Risk
960 min Winter	0.993	0.993	34.8	0.0	34.8	6947.9	Flood Risk
1440 min Winter	0.999	0.999	34.9	0.0	34.9	6996.1	Flood Risk
2160 min Winter	0.977	0.977	34.5	0.0	34.5	6837.6	Flood Risk
2880 min Winter	0.953	0.953	34.1	0.0	34.1	6674.4	Flood Risk
4320 min Winter	0.892	0.892	32.9	0.0	32.9	6244.5	O K
5760 min Winter	0.825	0.825	31.7	0.0	31.7	5773.0	O K
7200 min Winter	0.759	0.759	30.4	0.0	30.4	5310.0	O K
8640 min Winter	0.696	0.696	29.1	0.0	29.1	4868.9	O K
10080 min Winter	0.636	0.636	27.9	0.0	27.9	4452.9	O K
Storm Event	Rain (mm/hr)	Flooded Volume (m³)	Discharge Volume (m³)	Overflow Volume (m³)	Time-Peak (mins)		
120 min Winter	24.461	0.0	4202.3	0.0	132		
180 min Winter	17.964	0.0	4444.1	0.0	190		
240 min Winter	14.342	0.0	4553.2	0.0	248		
360 min Winter	10.418	0.0	4634.2	0.0	364		
480 min Winter	8.302	0.0	4655.9	0.0	480		
600 min Winter	6.956	0.0	4670.7	0.0	596		
720 min Winter	6.017	0.0	4684.9	0.0	712		
960 min Winter	4.784	0.0	4694.2	0.0	938		
1440 min Winter	3.456	0.0	4616.3	0.0	1378		
2160 min Winter	2.493	0.0	8596.0	0.0	1760		
2880 min Winter	1.975	0.0	8615.9	0.0	2200		
4320 min Winter	1.421	0.0	8004.2	0.0	3120		
5760 min Winter	1.124	0.0	11305.2	0.0	4032		
7200 min Winter	0.936	0.0	11724.0	0.0	4904		
8640 min Winter	0.806	0.0	12032.3	0.0	5720		
10080 min Winter	0.710	0.0	12221.2	0.0	6560		
©1982-2012 Micro Drainage Ltd							



# STORM WATER MANAGEMENT PLAN.

RIVERSIDE INDUSTRIAL ESTATE,  
BOSTON, LINCOLNSHIRE.


SCP		Page 3	
Lawrence Buildings 2 Mount Street Manchester M2 5WQ			
Date 25/02/2013 10:58 File 1 in 100year st...	Designed by Gary Ben... Checked by		
Micro Drainage		Source Control 2013.1	
<u>Rainfall Details</u>			
Rainfall Model	FSR	Winter Storms Yes	
Return Period (years)	100	Cv (Summer) 0.750	
Region	England and Wales	Cv (Winter) 0.840	
M5-60 (mm)	20.000	Shortest Storm (mins) 15	
Ratio R	0.400	Longest Storm (mins) 10080	
Summer Storms	Yes	Climate Change % +0	
<u>Time Area Diagram</u>			
Total Area (ha) 12.750			
Time (mins) From: To: (ha)	Time (mins) From: To: (ha)	Time (mins) From: To: (ha)	Time (mins) From: To: (ha)
0 4 3.180	4 8 3.190	8 12 3.180	12 16 3.200
©1982-2012 Micro Drainage Ltd			

PDF created with pdfFactory Pro trial version [www.pdffactory.com](http://www.pdffactory.com)

On-Site Storage Data For 1 in 100 yrs Storm Return Period.

# STORM WATER MANAGEMENT PLAN.


RIVERSIDE INDUSTRIAL ESTATE,  
BOSTON, LINCOLNSHIRE.

SCP		Page 1					
Lawrence Buildings 2 Mount Street Manchester M2 5WQ							
Date 01/03/2013 11:21	Designed by ian withe...						
File 1 in 100year + 3...	Checked by						
Micro Drainage		Source Control 2013.1					
<u>Summary of Results for 100 year Return Period (+30%)</u>							
Storm Event	Max Level (m)	Max Depth (m)	Max Control (l/s)	Max Overflow (l/s)	Max Outflow (l/s)	Max Volume (m³)	Status
15 min Summer	0.472	0.472	20.9	0.0	20.9	3043.8	OK
30 min Summer	0.619	0.619	22.4	0.0	22.4	3990.0	OK
60 min Summer	0.770	0.770	25.0	0.0	25.0	4968.2	OK
120 min Summer	0.922	0.922	27.4	0.0	27.4	5948.4	OK
180 min Summer	1.007	1.007	28.6	0.0	28.6	6496.1	OK
240 min Summer	1.063	1.063	29.4	0.0	29.4	6856.3	OK
360 min Summer	1.139	1.139	30.4	0.0	30.4	7347.6	OK
480 min Summer	1.191	1.191	31.1	0.0	31.1	7681.2	OK
600 min Summer	1.228	1.228	31.6	0.0	31.6	7917.7	Flood Risk
720 min Summer	1.254	1.254	31.9	0.0	31.9	8090.6	Flood Risk
960 min Summer	1.289	1.289	32.4	0.0	32.4	8312.6	Flood Risk
1440 min Summer	1.314	1.314	32.7	0.0	32.7	8474.0	Flood Risk
2160 min Summer	1.303	1.303	32.5	0.0	32.5	8406.5	Flood Risk
2880 min Summer	1.286	1.286	32.3	0.0	32.3	8295.9	Flood Risk
4320 min Summer	1.243	1.243	31.8	0.0	31.8	8019.1	Flood Risk
5760 min Summer	1.194	1.194	31.1	0.0	31.1	7702.0	OK
7200 min Summer	1.143	1.143	30.5	0.0	30.5	7374.0	OK
8640 min Summer	1.094	1.094	29.8	0.0	29.8	7053.3	OK
10080 min Summer	1.046	1.046	29.1	0.0	29.1	6744.7	OK
15 min Winter	0.529	0.529	20.9	0.0	20.9	3410.8	OK
30 min Winter	0.693	0.693	23.7	0.0	23.7	4471.8	OK
60 min Winter	0.863	0.863	26.5	0.0	26.5	5569.2	OK
120 min Winter	1.034	1.034	29.0	0.0	29.0	6671.3	OK
Storm Event	Rain (mm/hr)	Flooded Volume (m³)	Discharge Volume (m³)	Overflow Volume (m³)	Time-Peak (mins)		
15 min Summer	128.285	0.0	1702.3	0.0	31		
30 min Summer	84.226	0.0	1747.1	0.0	46		
60 min Summer	52.662	0.0	3629.3	0.0	76		
120 min Summer	31.800	0.0	3850.3	0.0	134		
180 min Summer	23.353	0.0	4010.9	0.0	194		
240 min Summer	18.644	0.0	4129.0	0.0	254		
360 min Summer	13.543	0.0	4286.9	0.0	372		
480 min Summer	10.792	0.0	4384.5	0.0	490		
600 min Summer	9.043	0.0	4443.8	0.0	610		
720 min Summer	7.823	0.0	4477.9	0.0	728		
960 min Summer	6.219	0.0	4495.9	0.0	966		
1440 min Summer	4.493	0.0	4412.0	0.0	1442		
2160 min Summer	3.241	0.0	8335.0	0.0	1924		
2880 min Summer	2.568	0.0	8279.3	0.0	2280		
4320 min Summer	1.847	0.0	7844.7	0.0	3036		
5760 min Summer	1.461	0.0	13015.6	0.0	3872		
7200 min Summer	1.217	0.0	13369.0	0.0	4688		
8640 min Summer	1.048	0.0	13370.8	0.0	5536		
10080 min Summer	0.923	0.0	12825.1	0.0	6352		
15 min Winter	128.285	0.0	1726.2	0.0	31		
30 min Winter	84.226	0.0	1820.0	0.0	45		
60 min Winter	52.662	0.0	3775.1	0.0	74		
120 min Winter	31.800	0.0	4076.1	0.0	132		
©1982-2012 Micro Drainage Ltd							

# STORM WATER MANAGEMENT PLAN.


RIVERSIDE INDUSTRIAL ESTATE,

BOSTON, LINCOLNSHIRE.

SCP		Page 2					
Lawrence Buildings 2 Mount Street Manchester M2 5WQ							
Date 01/03/2013 11:21	Designed by ian withe...						
File 1 in 100year + 3...	Checked by						
Micro Drainage		Source Control 2013.1					
<u>Summary of Results for 100 year Return Period (+30%)</u>							
Storm Event	Max Level (m)	Max Depth (m)	Max Control (l/s)	Max Overflow (l/s)	Max Outflow (l/s)	Max Volume (m³)	Status
180 min Winter	1.130	1.130	30.3	0.0	30.3	7290.1	OK
240 min Winter	1.194	1.194	31.1	0.0	31.1	7699.2	OK
360 min Winter	1.281	1.281	32.3	0.0	32.3	8261.0	Flood Risk
480 min Winter	1.341	1.341	33.0	0.0	33.0	8646.7	Flood Risk
600 min Winter	1.384	1.384	33.5	0.0	33.5	8923.7	Flood Risk
720 min Winter	1.415	1.415	33.9	0.0	33.9	9129.7	Flood Risk
960 min Winter	1.458	1.458	34.4	0.0	34.4	9404.1	Flood Risk
1440 min Winter	1.495	1.495	34.8	0.0	34.8	9641.9	Flood Risk
2160 min Winter	1.493	1.493	34.8	0.0	34.8	9629.3	Flood Risk
2880 min Winter	1.463	1.463	34.5	0.0	34.5	9436.5	Flood Risk
4320 min Winter	1.408	1.408	33.8	0.0	33.8	9081.0	Flood Risk
5760 min Winter	1.339	1.339	33.0	0.0	33.0	8639.6	Flood Risk
7200 min Winter	1.267	1.267	32.1	0.0	32.1	8175.2	Flood Risk
8640 min Winter	1.197	1.197	31.2	0.0	31.2	7717.7	OK
10080 min Winter	1.128	1.128	30.3	0.0	30.3	7277.2	OK
Storm Event	Rain (mm/hr)	Flooded Volume (m³)	Discharge Volume (m³)	Overflow Volume (m³)	Time-Peak (mins)		
180 min Winter	23.353	0.0	4283.8	0.0	190		
240 min Winter	18.644	0.0	4417.6	0.0	248		
360 min Winter	13.543	0.0	4587.7	0.0	366		
480 min Winter	10.792	0.0	4690.4	0.0	482		
600 min Winter	9.043	0.0	4752.1	0.0	598		
720 min Winter	7.823	0.0	4786.9	0.0	716		
960 min Winter	6.219	0.0	4803.6	0.0	946		
1440 min Winter	4.493	0.0	4710.5	0.0	1400		
2160 min Winter	3.241	0.0	8977.0	0.0	2052		
2880 min Winter	2.568	0.0	8912.5	0.0	2392		
4320 min Winter	1.847	0.0	8431.8	0.0	3252		
5760 min Winter	1.461	0.0	14501.9	0.0	4168		
7200 min Winter	1.217	0.0	14764.1	0.0	5056		
8640 min Winter	1.048	0.0	14477.6	0.0	5968		
10080 min Winter	0.923	0.0	13887.7	0.0	6856		
©1982-2012 Micro Drainage Ltd							

# STORM WATER MANAGEMENT PLAN.


RIVERSIDE INDUSTRIAL ESTATE,  
BOSTON, LINCOLNSHIRE.

SCP		Page 3					
Lawrence Buildings 2 Mount Street Manchester M2 5WQ							
Date 01/03/2013 11:21	Designed by ian withe...						
File 1 in 100year + 3...	Checked by						
Micro Drainage		Source Control 2013.1					
<u>Rainfall Details</u>							
Rainfall Model	FSR	Winter Storms Yes					
Return Period (years)	100	Cv (Summer) 0.750					
Region	England and Wales	Cv (Winter) 0.840					
MS-60 (mm)	20.000	Shortest Storm (mins) 15					
Ratio R	0.400	Longest Storm (mins) 10080					
Summer Storms	Yes	Climate Change % +30					
<u>Time Area Diagram</u>							
Total Area (ha) 12.750							
Time (mins)	Area (ha)	Time (mins)	Area (ha)	Time (mins)	Area (ha)	Time (mins)	Area (ha)
From: 0	To: 4	From: 4	To: 8	From: 8	To: 12	From: 12	To: 16
	3.180		3.190		3.180		3.200
©1982-2012 Micro Drainage Ltd							




# STORM WATER MANAGEMENT PLAN.

RIVERSIDE INDUSTRIAL ESTATE,  
BOSTON, LINCOLNSHIRE.

SCP		Page 4					
Lawrence Buildings 2 Mount Street Manchester M2 5WQ							
Date 01/03/2013 11:21	Designed by ian withe...						
File 1 in 100year + 3...	Checked by						
Micro Drainage		Source Control 2013.1					
<u>Model Details</u>							
Storage is Online Cover Level (m) 1.500							
<u>Tank or Pond Structure</u>							
Invert Level (m) 0.000							
Depth (m)	Area (m <sup>2</sup> )	Depth (m) Area (m <sup>2</sup> )	Depth (m) Area (m <sup>2</sup> )	Depth (m) Area (m <sup>2</sup> )			
0.000	6450.0	1.400	6450.0	2.800	0.0	4.200	0.0
0.200	6450.0	1.600	6450.0	3.000	0.0	4.400	0.0
0.400	6450.0	1.800	0.0	3.200	0.0	4.600	0.0
0.600	6450.0	2.000	0.0	3.400	0.0	4.800	0.0
0.800	6450.0	2.200	0.0	3.600	0.0	5.000	0.0
1.000	6450.0	2.400	0.0	3.800	0.0		
1.200	6450.0	2.600	0.0	4.000	0.0		
<u>Hydro-Brake® Outflow Control</u>							
Design Head (m) 1.500 Hydro-Brake® Type Mdl Invert Level (m) 0.000							
Design Flow (l/s) 35.0 Diameter (mm) 160							
Depth (m)	Flow (l/s)	Depth (m) Flow (l/s)	Depth (m) Flow (l/s)	Depth (m) Flow (l/s)			
0.100	6.3	1.200	31.2	3.000	49.4	7.000	75.4
0.200	16.8	1.400	33.7	3.500	53.3	7.500	78.0
0.300	20.9	1.600	36.0	4.000	57.0	8.000	80.6
0.400	19.5	1.800	38.2	4.500	60.5	8.500	83.1
0.500	20.3	2.000	40.3	5.000	63.7	9.000	85.5
0.600	22.1	2.200	42.3	5.500	66.8	9.500	87.8
0.800	25.5	2.400	44.2	6.000	69.8		
1.000	28.5	2.600	46.0	6.500	72.7		
<u>Complex Overflow Control</u>							
<u>Depth/Flow Relationship</u>							
Invert Level (m) 0.000							
©1982-2012 Micro Drainage Ltd							

# STORM WATER MANAGEMENT PLAN.

RIVERSIDE INDUSTRIAL ESTATE,  
BOSTON, LINCOLNSHIRE.

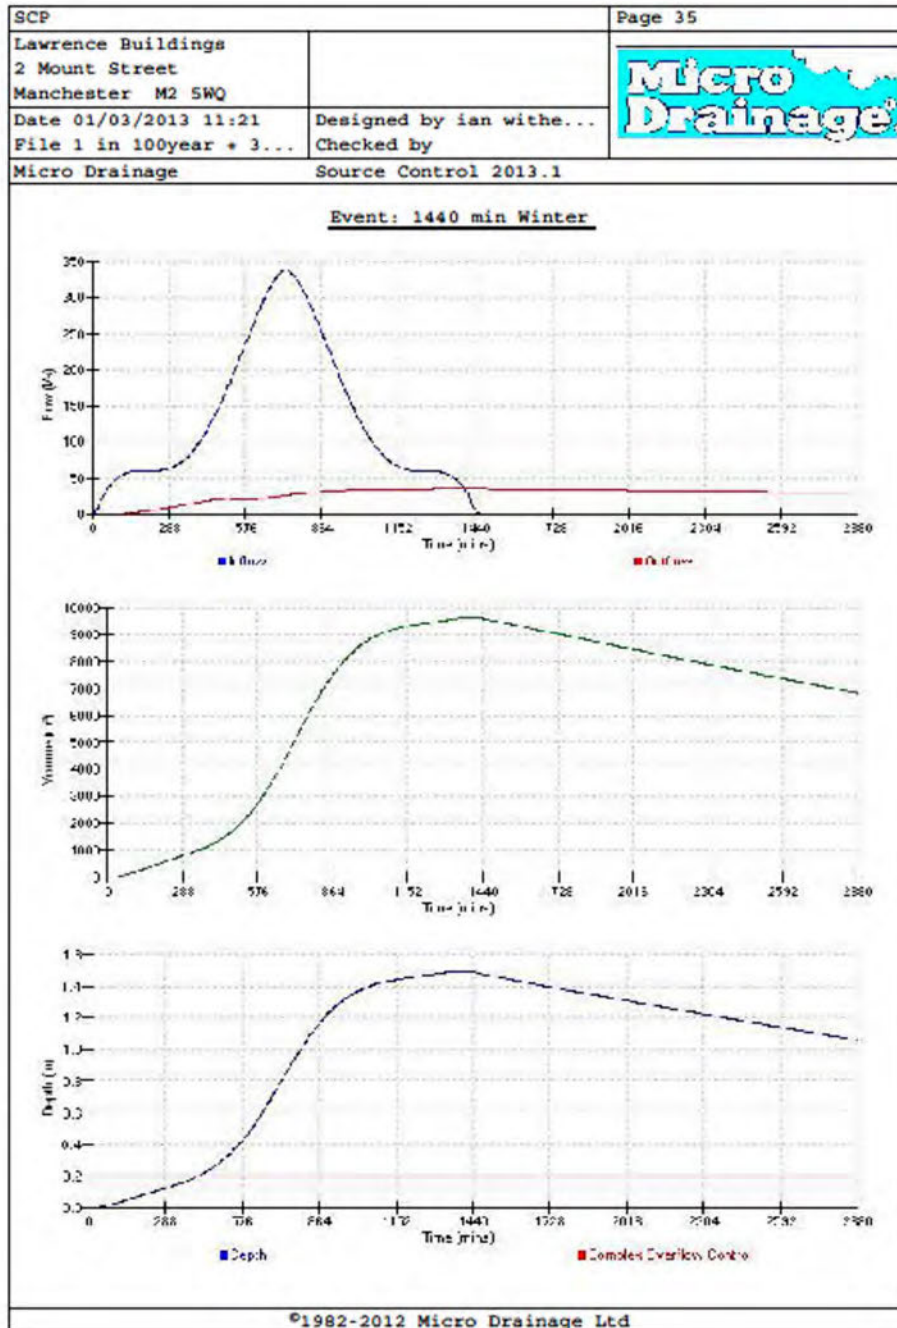

On-Site Storage Data For 1 in 100 yrs + 30% CC.


## APPENDIX 2.

Future Assessments of On-Site Storage.

For 1 in 100 year + 30% CC with  
Impermeable Site Areas of 65%, 75% and 85%.

# STORM WATER MANAGEMENT PLAN.

RIVERSIDE INDUSTRIAL ESTATE,  
BOSTON, LINCOLNSHIRE.


SCP		Page 1					
Lawrence Buildings 2 Mount Street Manchester M2 5WQ							
Date 28/02/2013 16:26	Designed by Ian Withe...						
File 1 in 100year + 3...	Checked by						
Micro Drainage		Source Control 2013.1					
<u>Summary of Results for 100 year Return Period (+30%)</u>							
Storm Event	Max Level (m)	Max Depth (m)	Max Control (l/s)	Max Overflow (l/s)	Max Outflow (l/s)	Max Volume (m³)	Status
15 min Summer	0.450	0.450	31.8	0.0	31.8	3877.3	O K
30 min Summer	0.590	0.590	31.8	0.0	31.8	5085.8	O K
60 min Summer	0.736	0.736	31.8	0.0	31.8	6342.0	O K
120 min Summer	0.883	0.883	31.8	0.0	31.8	7610.4	O K
180 min Summer	0.966	0.966	31.7	0.0	31.7	8328.1	O K
240 min Summer	1.022	1.022	31.8	0.0	31.8	8806.6	O K
360 min Summer	1.099	1.099	31.8	0.0	31.8	9471.1	O K
480 min Summer	1.153	1.153	31.8	0.0	31.8	9935.7	O K
600 min Summer	1.192	1.192	31.8	0.0	31.8	10276.1	O K
720 min Summer	1.222	1.222	31.8	0.0	31.8	10535.8	Flood Risk
960 min Summer	1.264	1.264	32.0	0.0	32.0	10896.5	Flood Risk
1440 min Summer	1.306	1.306	32.5	0.0	32.5	11254.0	Flood Risk
2160 min Summer	1.315	1.315	32.6	0.0	32.6	11339.4	Flood Risk
2880 min Summer	1.299	1.299	32.4	0.0	32.4	11200.5	Flood Risk
4320 min Summer	1.262	1.262	32.0	0.0	32.0	10880.5	Flood Risk
5760 min Summer	1.220	1.220	31.8	0.0	31.8	10520.7	Flood Risk
7200 min Summer	1.176	1.176	31.8	0.0	31.8	10138.3	O K
8640 min Summer	1.131	1.131	31.8	0.0	31.8	9745.4	O K
10080 min Summer	1.085	1.085	31.8	0.0	31.8	9357.0	O K
15 min Winter	0.504	0.504	31.8	0.0	31.8	4345.5	O K
30 min Winter	0.662	0.662	31.8	0.0	31.8	5702.2	O K
60 min Winter	0.825	0.825	31.8	0.0	31.8	7110.3	O K
120 min Winter	0.990	0.990	31.7	0.0	31.7	8532.9	O K
Storm Event	Rain (mm/hr)	Flooded Volume (m³)	Discharge Volume (m³)	Overflow Volume (m³)	Time-Peak (mins)		
15 min Summer	128.285	0.0	2240.8	0.0	31		
30 min Summer	84.226	0.0	2560.0	0.0	46		
60 min Summer	52.662	0.0	4671.3	0.0	76		
120 min Summer	31.800	0.0	4770.9	0.0	134		
180 min Summer	23.353	0.0	4629.7	0.0	194		
240 min Summer	18.644	0.0	4567.5	0.0	254		
360 min Summer	13.543	0.0	4552.4	0.0	372		
480 min Summer	10.792	0.0	4573.9	0.0	492		
600 min Summer	9.043	0.0	4594.4	0.0	610		
720 min Summer	7.823	0.0	4606.3	0.0	730		
960 min Summer	6.219	0.0	4602.7	0.0	968		
1440 min Summer	4.493	0.0	4509.9	0.0	1446		
2160 min Summer	3.241	0.0	9015.8	0.0	2160		
2880 min Summer	2.568	0.0	8821.6	0.0	2576		
4320 min Summer	1.847	0.0	8300.5	0.0	3296		
5760 min Summer	1.461	0.0	16018.3	0.0	4088		
7200 min Summer	1.217	0.0	16195.6	0.0	4904		
8640 min Summer	1.048	0.0	15689.7	0.0	5712		
10080 min Summer	0.923	0.0	14654.5	0.0	6560		
15 min Winter	128.285	0.0	2442.4	0.0	31		
30 min Winter	84.226	0.0	2484.9	0.0	45		
60 min Winter	52.662	0.0	4636.3	0.0	74		
120 min Winter	31.800	0.0	4662.3	0.0	132		
©1982-2012 Micro Drainage Ltd							



# STORM WATER MANAGEMENT PLAN.


RIVERSIDE INDUSTRIAL ESTATE,

BOSTON, LINCOLNSHIRE.

SCP		Page 2					
Lawrence Buildings 2 Mount Street Manchester M2 5WQ							
Date 28/02/2013 16:26	Designed by ian withe...						
File 1 in 100year + 3...	Checked by						
Micro Drainage		Source Control 2013.1					
<u>Summary of Results for 100 year Return Period (+30%)</u>							
Storm Event	Max Level (m)	Max Depth (m)	Max Control (l/s)	Max Overflow (l/s)	Max E Outflow (l/s)	Max Volume (m³)	Status
180 min Winter	1.084	1.084	31.8	0.0	31.8	9340.1	O K
240 min Winter	1.146	1.146	31.8	0.0	31.8	9880.3	O K
360 min Winter	1.234	1.234	31.8	0.0	31.8	10634.0	Flood Risk
480 min Winter	1.295	1.295	32.4	0.0	32.4	11164.5	Flood Risk
600 min Winter	1.341	1.341	32.9	0.0	32.9	11556.7	Flood Risk
720 min Winter	1.376	1.376	33.4	0.0	33.4	11858.5	Flood Risk
960 min Winter	1.425	1.425	33.9	0.0	33.9	12285.8	Flood Risk
1440 min Winter	1.478	1.478	34.6	0.0	34.6	12737.4	Flood Risk
2160 min Winter	1.499	1.499	34.8	0.0	34.8	12920.7	Flood Risk
2880 min Winter	1.487	1.487	34.7	0.0	34.7	12822.0	Flood Risk
4320 min Winter	1.433	1.433	34.0	0.0	34.0	12354.8	Flood Risk
5760 min Winter	1.379	1.379	33.4	0.0	33.4	11887.8	Flood Risk
7200 min Winter	1.318	1.318	32.6	0.0	32.6	11360.6	Flood Risk
8640 min Winter	1.254	1.254	31.9	0.0	31.9	10809.0	Flood Risk
10080 min Winter	1.189	1.189	31.8	0.0	31.8	10252.5	O K
Storm Event	Rain (mm/hr)	Flooded Volume (m³)	Discharge Volume (m³)	Overflow Volume (m³)	Time-Peak (mins)		
180 min Winter	23.353	0.0	4629.3	0.0	192		
240 min Winter	18.644	0.0	4662.7	0.0	250		
360 min Winter	13.543	0.0	4749.0	0.0	366		
480 min Winter	10.792	0.0	4818.2	0.0	484		
600 min Winter	9.043	0.0	4863.9	0.0	602		
720 min Winter	7.823	0.0	4890.6	0.0	718		
960 min Winter	6.219	0.0	4901.4	0.0	952		
1440 min Winter	4.493	0.0	4813.6	0.0	1412		
2160 min Winter	3.241	0.0	9540.7	0.0	2084		
2880 min Winter	2.568	0.0	9413.5	0.0	2740		
4320 min Winter	1.847	0.0	8906.9	0.0	3460		
5760 min Winter	1.461	0.0	17619.8	0.0	4376		
7200 min Winter	1.217	0.0	17346.6	0.0	5272		
8640 min Winter	1.048	0.0	16443.0	0.0	6224		
10080 min Winter	0.923	0.0	15622.4	0.0	7072		
©1982-2012 Micro Drainage Ltd							

# STORM WATER MANAGEMENT PLAN.


RIVERSIDE INDUSTRIAL ESTATE,  
BOSTON, LINCOLNSHIRE.

SCP		Page 1	
Lawrence Buildings 2 Mount Street Manchester M2 5WQ			
Date 28/02/2013 16:34 File 1 in 100year + 3...	Designed by ian withe... Checked by		
Micro Drainage		Source Control 2013.1	
<u>Rainfall Details</u>			
Rainfall Model	FSR	Winter Storms Yes	
Return Period (years)	100	Cv (Summer) 0.750	
Region	England and Wales	Cv (Winter) 0.840	
M5-60 (mm)	20.000	Shortest Storm (mins) 15	
Ratio R	0.400	Longest Storm (mins) 10080	
Summer Storms	Yes	Climate Change % +30	
<u>Time Area Diagram</u>			
Total Area (ha) 16.250			
Time (mins) From: To: (ha)	Time (mins) From: To: (ha)	Time (mins) From: To: (ha)	Time (mins) From: To: (ha)
0 4 4.062	4 8 4.062	8 12 4.062	12 16 4.064
©1982-2012 Micro Drainage Ltd			

On-Site Storage Data For 1 in 100 yrs + 30% CC at 65% Imp Area.

# STORM WATER MANAGEMENT PLAN.


RIVERSIDE INDUSTRIAL ESTATE,  
BOSTON, LINCOLNSHIRE.

SCP		Page 1					
Lawrence Buildings 2 Mount Street Manchester M2 5WQ							
Date 28/02/2013 16:28	Designed by Ian Withe...						
File 1 in 100year + 3...	Checked by						
Micro Drainage		Source Control 2013.1					
<u>Summary of Results for 100 year Return Period (+30%)</u>							
Storm Event	Max Level (m)	Max Depth (m)	Max Control (l/s)	Max Overflow (l/s)	Max Outflow (l/s)	Max Volume (m³)	Status
15 min Summer	0.436	0.436	31.8	0.0	31.8	4478.9	O K
30 min Summer	0.572	0.572	31.8	0.0	31.8	5875.3	O K
60 min Summer	0.713	0.713	31.8	0.0	31.8	7329.7	O K
120 min Summer	0.856	0.856	31.8	0.0	31.8	8803.8	O K
180 min Summer	0.938	0.938	31.8	0.0	31.8	9643.9	O K
240 min Summer	0.993	0.993	31.8	0.0	31.8	10208.5	O K
360 min Summer	1.070	1.070	31.8	0.0	31.8	11000.4	O K
480 min Summer	1.125	1.125	31.8	0.0	31.8	11562.2	O K
600 min Summer	1.166	1.166	31.8	0.0	31.8	11981.4	O K
720 min Summer	1.197	1.197	31.8	0.0	31.8	12307.1	O K
960 min Summer	1.243	1.243	31.8	0.0	31.8	12776.2	Flood Risk
1440 min Summer	1.293	1.293	32.3	0.0	32.3	13293.6	Flood Risk
2160 min Summer	1.318	1.318	32.6	0.0	32.6	13544.0	Flood Risk
2880 min Summer	1.311	1.311	32.6	0.0	32.6	13481.6	Flood Risk
4320 min Summer	1.281	1.281	32.2	0.0	32.2	13166.8	Flood Risk
5760 min Summer	1.247	1.247	31.8	0.0	31.8	12817.6	Flood Risk
7200 min Summer	1.211	1.211	31.8	0.0	31.8	12445.2	Flood Risk
8640 min Summer	1.173	1.173	31.8	0.0	31.8	12056.2	O K
10080 min Summer	1.134	1.134	31.8	0.0	31.8	11659.0	O K
15 min Winter	0.488	0.488	31.8	0.0	31.8	5019.1	O K
30 min Winter	0.641	0.641	31.8	0.0	31.8	6586.5	O K
60 min Winter	0.799	0.799	31.8	0.0	31.8	8216.4	O K
120 min Winter	0.960	0.960	31.8	0.0	31.8	9669.8	O K
Storm Event	Rain (mm/hr)	Flooded Volume (m³)	Discharge Volume (m³)	Overflow Volume (m³)	Time-Peak (mins)		
15 min Summer	128.285	0.0	2326.7	0.0	31		
30 min Summer	84.226	0.0	2588.3	0.0	46		
60 min Summer	52.662	0.0	4865.8	0.0	76		
120 min Summer	31.800	0.0	4705.5	0.0	134		
180 min Summer	23.353	0.0	4561.3	0.0	194		
240 min Summer	18.644	0.0	4525.4	0.0	254		
360 min Summer	13.543	0.0	4538.6	0.0	374		
480 min Summer	10.792	0.0	4570.7	0.0	492		
600 min Summer	9.043	0.0	4594.9	0.0	612		
720 min Summer	7.823	0.0	4607.7	0.0	730		
960 min Summer	6.219	0.0	4602.7	0.0	970		
1440 min Summer	4.493	0.0	4504.6	0.0	1446		
2160 min Summer	3.241	0.0	9080.9	0.0	2164		
2880 min Summer	2.568	0.0	8921.8	0.0	2860		
4320 min Summer	1.847	0.0	8396.7	0.0	3504		
5760 min Summer	1.461	0.0	17352.8	0.0	4264		
7200 min Summer	1.217	0.0	16684.9	0.0	5048		
8640 min Summer	1.048	0.0	15748.2	0.0	5880		
10080 min Summer	0.923	0.0	14941.6	0.0	6672		
15 min Winter	128.285	0.0	2516.5	0.0	31		
30 min Winter	84.226	0.0	2484.7	0.0	45		
60 min Winter	52.662	0.0	4858.3	0.0	74		
120 min Winter	31.800	0.0	4597.6	0.0	134		
©1982-2012 Micro Drainage Ltd							




# STORM WATER MANAGEMENT PLAN.

RIVERSIDE INDUSTRIAL ESTATE,  
BOSTON, LINCOLNSHIRE.

SCP		Page 2					
Lawrence Buildings 2 Mount Street Manchester M2 5WQ							
Date 28/02/2013 16:28	Designed by ian withe...						
File 1 in 100year + 3...	Checked by						
Micro Drainage		Source Control 2013.1					
<u>Summary of Results for 100 year Return Period (+30%)</u>							
Storm Event	Max Level (m)	Max Depth (m)	Max Control (l/s)	Max Overflow (l/s)	Max E Outflow (l/s)	Max Volume (m <sup>3</sup> )	Status
180 min Winter	1.052	1.052	31.8	0.0	31.8	10813.9	O K
240 min Winter	1.114	1.114	31.8	0.0	31.8	11449.9	O K
360 min Winter	1.201	1.201	31.8	0.0	31.8	12345.9	Flood Risk
480 min Winter	1.263	1.263	32.0	0.0	32.0	12984.6	Flood Risk
600 min Winter	1.310	1.310	32.5	0.0	32.5	13464.6	Flood Risk
720 min Winter	1.346	1.346	33.0	0.0	33.0	13840.0	Flood Risk
960 min Winter	1.400	1.400	33.6	0.0	33.6	14387.9	Flood Risk
1440 min Winter	1.461	1.461	34.4	0.0	34.4	15016.0	Flood Risk
2160 min Winter	1.496	1.496	34.8	0.0	34.8	15379.4	Flood Risk
<b>2880 min Winter</b>	<b>1.498</b>	<b>1.498</b>	<b>34.8</b>	<b>0.0</b>	<b>34.8</b>	<b>15403.0</b>	<b>Flood Risk</b>
4320 min Winter	1.459	1.459	34.3	0.0	34.3	14996.7	Flood Risk
5760 min Winter	1.414	1.414	33.8	0.0	33.8	14537.1	Flood Risk
7200 min Winter	1.366	1.366	33.2	0.0	33.2	14042.2	Flood Risk
8640 min Winter	1.314	1.314	32.6	0.0	32.6	13504.7	Flood Risk
10080 min Winter	1.260	1.260	31.9	0.0	31.9	12949.6	Flood Risk
Storm Event	Rain (mm/hr)	Flooded Volume (m <sup>3</sup> )	Discharge Volume (m <sup>3</sup> )	Overflow Volume (m <sup>3</sup> )	Time-Peak (mins)		
180 min Winter	23.353	0.0	4603.6	0.0	192		
240 min Winter	18.644	0.0	4653.8	0.0	250		
360 min Winter	13.543	0.0	4751.5	0.0	368		
480 min Winter	10.792	0.0	4822.9	0.0	484		
600 min Winter	9.043	0.0	4868.1	0.0	602		
720 min Winter	7.823	0.0	4893.2	0.0	720		
960 min Winter	6.219	0.0	4900.4	0.0	954		
1440 min Winter	4.493	0.0	4806.0	0.0	1418		
2160 min Winter	3.241	0.0	9662.4	0.0	2100		
<b>2880 min Winter</b>	<b>2.568</b>	<b>0.0</b>	<b>9531.9</b>	<b>0.0</b>	<b>2768</b>		
4320 min Winter	1.847	0.0	8999.4	0.0	3980		
5760 min Winter	1.461	0.0	18204.5	0.0	4496		
7200 min Winter	1.217	0.0	17421.9	0.0	5408		
8640 min Winter	1.048	0.0	16763.5	0.0	6320		
10080 min Winter	0.923	0.0	16090.2	0.0	7264		
©1982-2012 Micro Drainage Ltd							

# STORM WATER MANAGEMENT PLAN.


RIVERSIDE INDUSTRIAL ESTATE,  
BOSTON, LINCOLNSHIRE.

SCP		Page 1					
Lawrence Buildings 2 Mount Street Manchester M2 5WQ							
Date 28/02/2013 16:35 File 1 in 100year + 3...	Designed by ian withe... Checked by						
Micro Drainage		Source Control 2013.1					
<u>Rainfall Details</u>							
Rainfall Model	FSR	Winter Storms Yes					
Return Period (years)	100	Cv (Summer) 0.750					
Region	England and Wales	Cv (Winter) 0.840					
M5-60 (mm)	20.000	Shortest Storm (mins) 15					
Ratio R	0.400	Longest Storm (mins) 10080					
Summer Storms	Yes	Climate Change % +30					
<u>Time Area Diagram</u>							
Total Area (ha) 18.750							
Time (mins) From: To:	Area (ha)	Time (mins) From: To:	Area (ha)	Time (mins) From: To:	Area (ha)	Time (mins) From: To:	Area (ha)
0 4	4.687	4 8	4.687	8 12	4.687	12 16	4.689
©1982-2012 Micro Drainage Ltd							

On-Site Storage Data For 1 in 100 yrs + 30% CC at 75% Imp Area.

# STORM WATER MANAGEMENT PLAN.


RIVERSIDE INDUSTRIAL ESTATE,  
BOSTON, LINCOLNSHIRE.

SCP		Page 1					
Lawrence Buildings 2 Mount Street Manchester M2 5WQ							
Date 28/02/2013 16:31	Designed by Ian Withe...						
File 1 in 100year + 3...	Checked by						
Micro Drainage		Source Control 2013.1					
<u>Summary of Results for 100 year Return Period (+30%)</u>							
Storm Event	Max Level (m)	Max Depth (m)	Max Control (l/s)	Max Overflow (l/s)	Max Outflow (l/s)	Max Volume (m³)	Status
15 min Summer	0.423	0.423	31.8	0.0	31.8	5080.7	O K
30 min Summer	0.555	0.555	31.8	0.0	31.8	6664.9	O K
60 min Summer	0.693	0.693	31.8	0.0	31.8	8317.3	O K
120 min Summer	0.833	0.833	31.7	0.0	31.7	9997.2	O K
180 min Summer	0.913	0.913	31.8	0.0	31.8	10959.4	O K
240 min Summer	0.967	0.967	31.8	0.0	31.8	11609.8	O K
360 min Summer	1.044	1.044	31.8	0.0	31.8	12529.2	O K
480 min Summer	1.099	1.099	31.8	0.0	31.8	13187.9	O K
600 min Summer	1.140	1.140	31.8	0.0	31.8	13685.8	O K
720 min Summer	1.173	1.173	31.8	0.0	31.8	14077.8	O K
960 min Summer	1.221	1.221	31.8	0.0	31.8	14655.4	Flood Risk
1440 min Summer	1.278	1.278	32.2	0.0	32.2	15333.4	Flood Risk
2160 min Summer	1.313	1.313	32.6	0.0	32.6	15751.7	Flood Risk
2880 min Summer	1.317	1.317	32.6	0.0	32.6	15808.7	Flood Risk
4320 min Summer	1.293	1.293	32.3	0.0	32.3	15518.4	Flood Risk
5760 min Summer	1.265	1.265	32.0	0.0	32.0	15180.6	Flood Risk
7200 min Summer	1.235	1.235	31.8	0.0	31.8	14816.1	Flood Risk
8640 min Summer	1.203	1.203	31.8	0.0	31.8	14434.1	Flood Risk
10080 min Summer	1.170	1.170	31.8	0.0	31.8	14041.2	O K
15 min Winter	0.474	0.474	31.8	0.0	31.8	5692.8	O K
30 min Winter	0.623	0.623	31.8	0.0	31.8	7470.8	O K
60 min Winter	0.777	0.777	31.8	0.0	31.8	9322.4	O K
120 min Winter	0.934	0.934	31.8	0.0	31.8	11206.8	O K
Storm Event	Rain (mm/hr)	Flooded Volume (m³)	Discharge Volume (m³)	Overflow Volume (m³)	Time-Peak (mins)		
15 min Summer	128.285	0.0	2383.4	0.0	31		
30 min Summer	84.226	0.0	2606.2	0.0	46		
60 min Summer	52.662	0.0	4960.6	0.0	76		
120 min Summer	31.800	0.0	4648.4	0.0	136		
180 min Summer	23.353	0.0	4522.2	0.0	194		
240 min Summer	18.644	0.0	4501.4	0.0	254		
360 min Summer	13.543	0.0	4527.1	0.0	374		
480 min Summer	10.792	0.0	4562.7	0.0	492		
600 min Summer	9.043	0.0	4587.4	0.0	612		
720 min Summer	7.823	0.0	4599.6	0.0	732		
960 min Summer	6.219	0.0	4592.4	0.0	970		
1440 min Summer	4.493	0.0	4489.7	0.0	1448		
2160 min Summer	3.241	0.0	9140.5	0.0	2164		
2880 min Summer	2.568	0.0	8986.0	0.0	2880		
4320 min Summer	1.847	0.0	8448.6	0.0	3724		
5760 min Summer	1.461	0.0	17486.8	0.0	4448		
7200 min Summer	1.217	0.0	16669.1	0.0	5200		
8640 min Summer	1.048	0.0	15971.6	0.0	6048		
10080 min Summer	0.923	0.0	15265.6	0.0	6864		
15 min Winter	128.285	0.0	2563.5	0.0	31		
30 min Winter	84.226	0.0	2488.6	0.0	45		
60 min Winter	52.662	0.0	4829.5	0.0	74		
120 min Winter	31.800	0.0	4561.2	0.0	134		
©1982-2012 Micro Drainage Ltd							



# STORM WATER MANAGEMENT PLAN.


RIVERSIDE INDUSTRIAL ESTATE,  
BOSTON, LINCOLNSHIRE.

SCP		Page 2					
Lawrence Buildings 2 Mount Street Manchester M2 5WQ							
Date 28/02/2013 16:31	Designed by ian withe...						
File 1 in 100year + 3...	Checked by						
Micro Drainage		Source Control 2013.1					
<u>Summary of Results for 100 year Return Period (+30%)</u>							
Storm Event	Max Level (m)	Max Depth (m)	Max Control (l/s)	Max Overflow (l/s)	Max Outflow (l/s)	Max Volume (m³)	Status
180 min Winter	1.024	1.024	31.8	0.0	31.8	12287.3	O K
240 min Winter	1.085	1.085	31.8	0.0	31.8	13018.9	O K
360 min Winter	1.171	1.171	31.8	0.0	31.8	14057.1	O K
480 min Winter	1.234	1.234	31.8	0.0	31.8	14804.3	Flood Risk
600 min Winter	1.281	1.281	32.2	0.0	32.2	15371.6	Flood Risk
720 min Winter	1.318	1.318	32.7	0.0	32.7	15820.9	Flood Risk
960 min Winter	1.374	1.374	33.3	0.0	33.3	16489.3	Flood Risk
1440 min Winter	1.441	1.441	34.1	0.0	34.1	17295.5	Flood Risk
2160 min Winter	1.487	1.487	34.7	0.0	34.7	17842.9	Flood Risk
<b>2880 min Winter</b>	<b>1.500</b>	<b>1.500</b>	<b>34.8</b>	<b>0.0</b>	<b>34.8</b>	<b>17995.8</b>	<b>Flood Risk</b>
4320 min Winter	1.479	1.479	34.6	0.0	34.6	17749.1	Flood Risk
5760 min Winter	1.437	1.437	34.1	0.0	34.1	17240.8	Flood Risk
7200 min Winter	1.399	1.399	33.6	0.0	33.6	16783.1	Flood Risk
8640 min Winter	1.356	1.356	33.1	0.0	33.1	16270.4	Flood Risk
10080 min Winter	1.311	1.311	32.6	0.0	32.6	15726.8	Flood Risk
Storm Event	Rain (mm/hr)	Flooded Volume (m³)	Discharge Volume (m³)	Overflow Volume (m³)	Time-Peak (mins)		
180 min Winter	23.353	0.0	4587.5	0.0	192		
240 min Winter	18.644	0.0	4644.7	0.0	250		
360 min Winter	13.543	0.0	4745.9	0.0	368		
480 min Winter	10.792	0.0	4816.8	0.0	486		
600 min Winter	9.043	0.0	4860.5	0.0	604		
720 min Winter	7.823	0.0	4884.0	0.0	720		
960 min Winter	6.219	0.0	4888.0	0.0	956		
1440 min Winter	4.493	0.0	4788.8	0.0	1422		
2160 min Winter	3.241	0.0	9740.3	0.0	2108		
<b>2880 min Winter</b>	<b>2.568</b>	<b>0.0</b>	<b>9599.8</b>	<b>0.0</b>	<b>2780</b>		
4320 min Winter	1.847	0.0	9046.4	0.0	4068		
5760 min Winter	1.461	0.0	18214.0	0.0	4664		
7200 min Winter	1.217	0.0	17693.0	0.0	5552		
8640 min Winter	1.048	0.0	17127.9	0.0	6488		
10080 min Winter	0.923	0.0	16459.0	0.0	7368		
©1982-2012 Micro Drainage Ltd							



# STORM WATER MANAGEMENT PLAN.

RIVERSIDE INDUSTRIAL ESTATE,  
BOSTON, LINCOLNSHIRE.


SCP		Page 1	
Lawrence Buildings 2 Mount Street Manchester M2 5WQ			
Date 28/02/2013 16:32 File 1 in 100year + 3...	Designed by ian withe... Checked by		
Micro Drainage		Source Control 2013.1	
<u>Rainfall Details</u>			
Rainfall Model	PSR	Winter Storms Yes	
Return Period (years)	100	Cv (Summer) 0.750	
Region	England and Wales	Cv (Winter) 0.840	
MS-60 (mm)	20.000	Shortest Storm (mins) 15	
Ratio R	0.400	Longest Storm (mins) 10080	
Summer Storms	Yes	Climate Change % +30	
<u>Time Area Diagram</u>			
Total Area (ha) 21.250			
Time (mins) From: To: (ha)	Time (mins) From: To: (ha)	Time (mins) From: To: (ha)	Time (mins) From: To: (ha)
0 4 5.312	4 8 5.312	8 12 5.312	12 16 5.314
©1982-2012 Micro Drainage Ltd			

On-Site Storage Data For 1 in 100 yrs + 30% CC at 85% Imp Area.

# POWER STATION SITE.

OVERHEAD CONDUCTORS.


PROPOSED DETENTION BASIN.

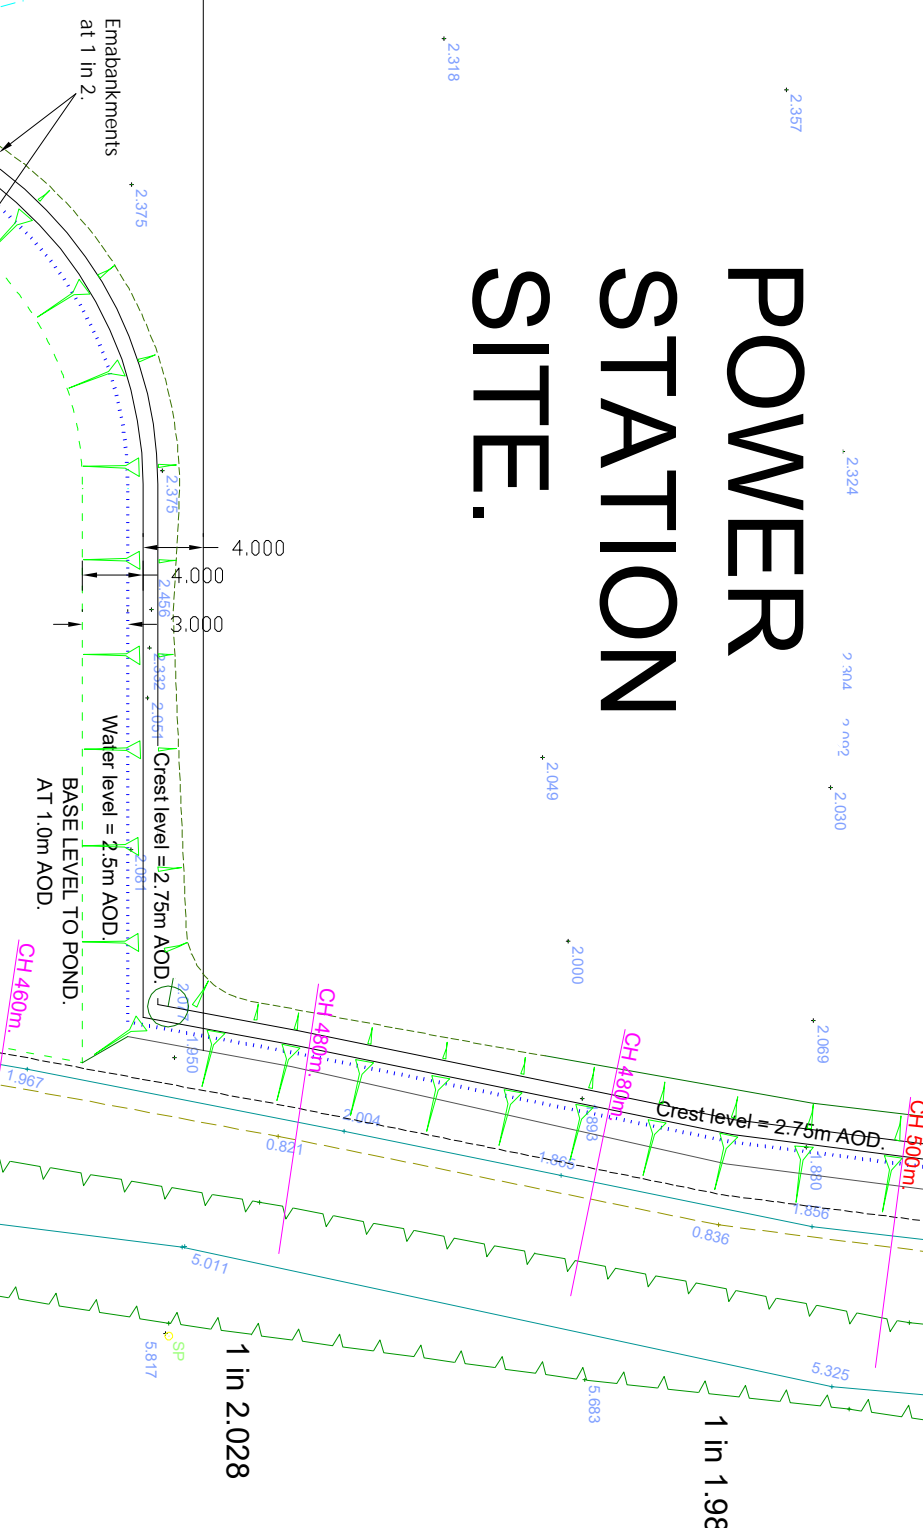



TYPICAL DITCH SECTION - CH. 40 m

TYPICAL DITCH SECTION - CH. 320 m

TYPICAL POND SECTION - CH. 420 m

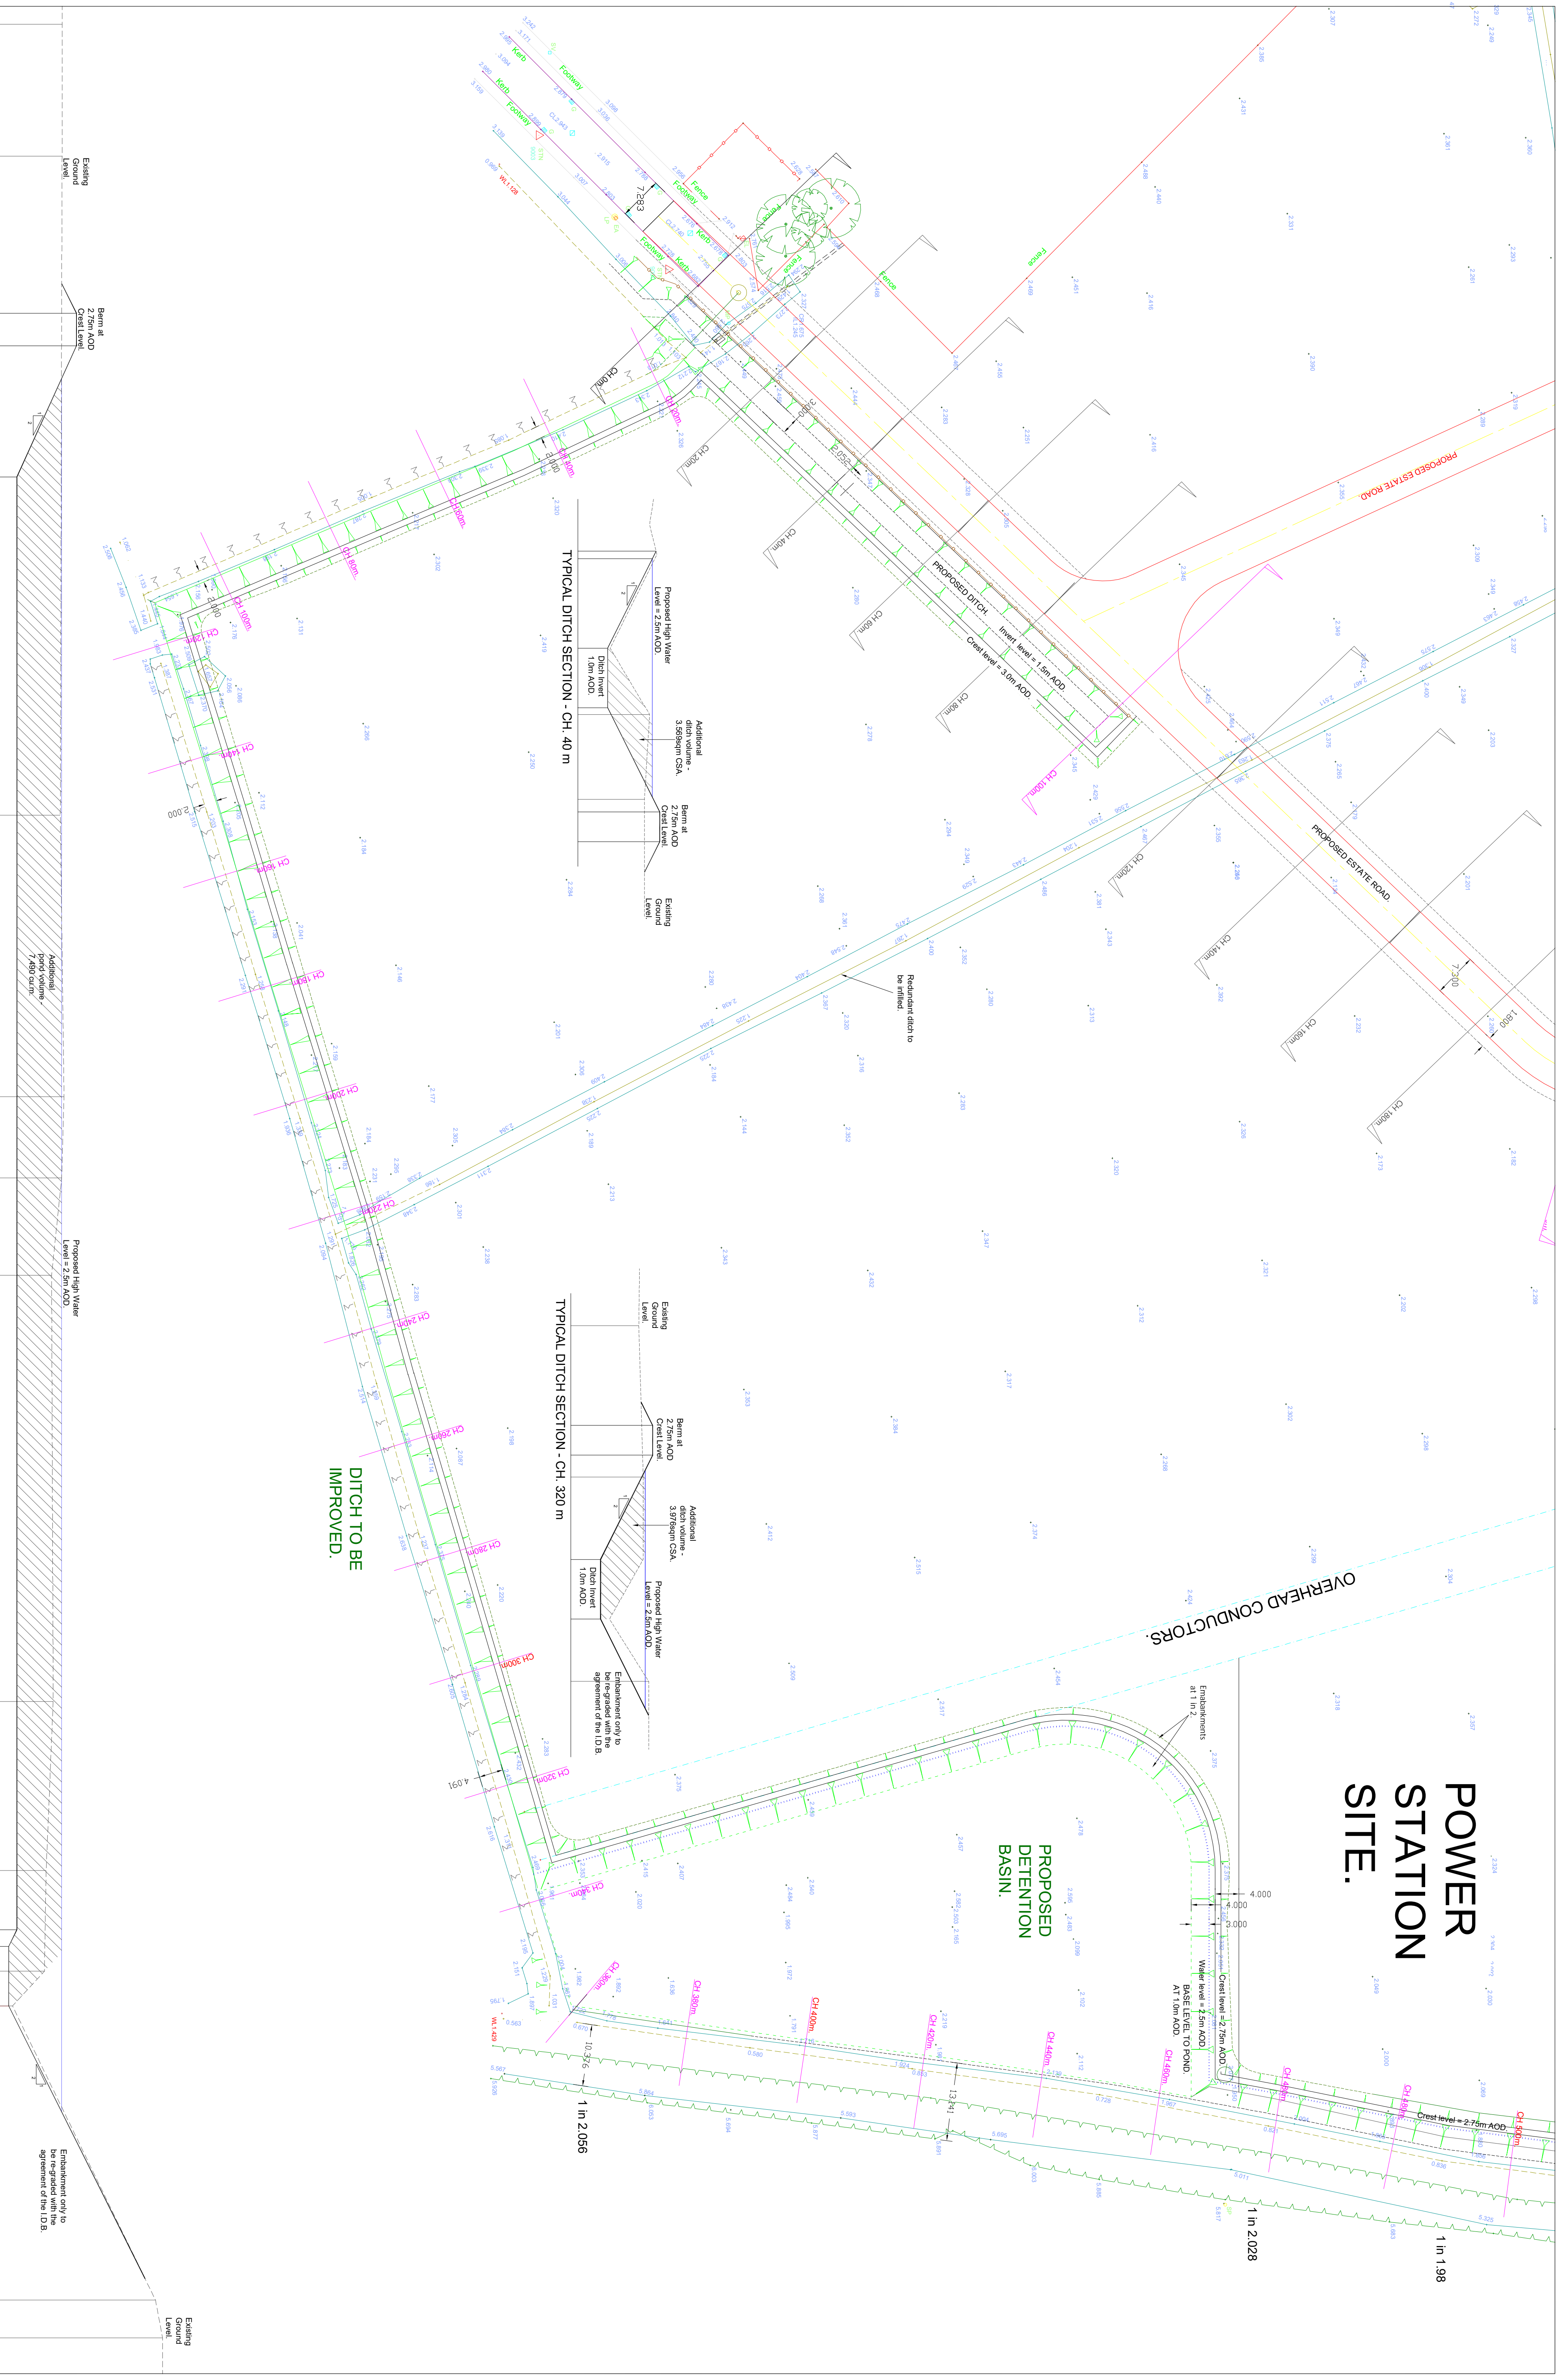

DITCH TO BE IMPROVED.

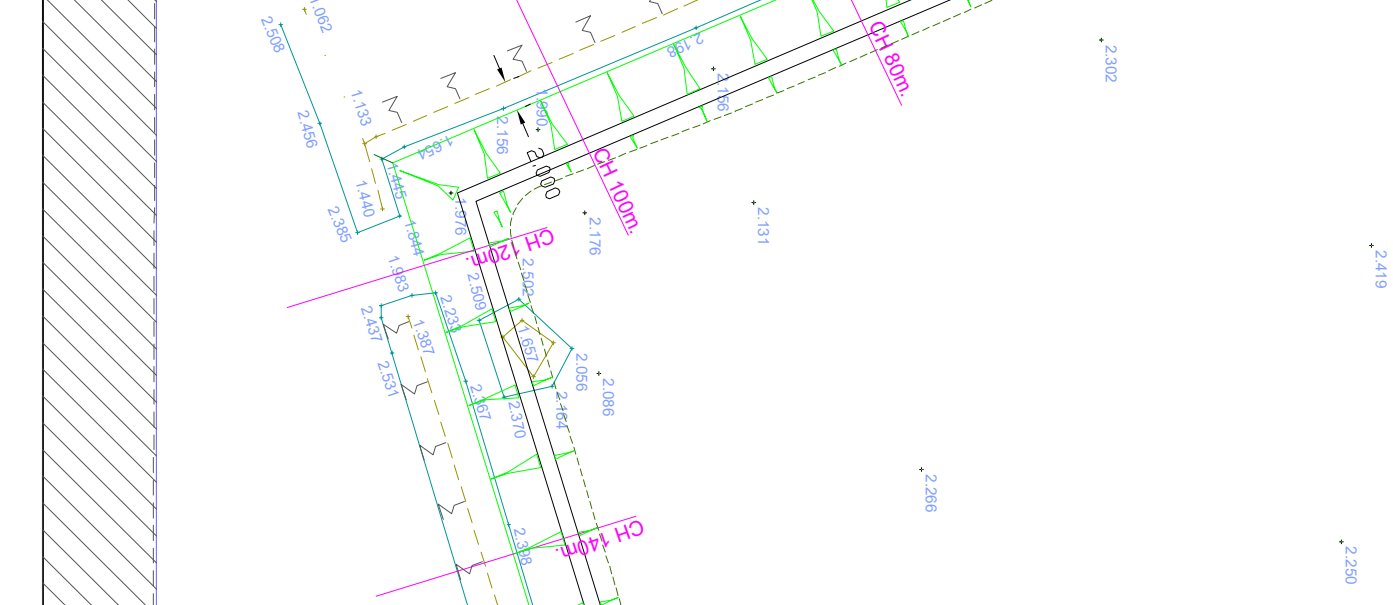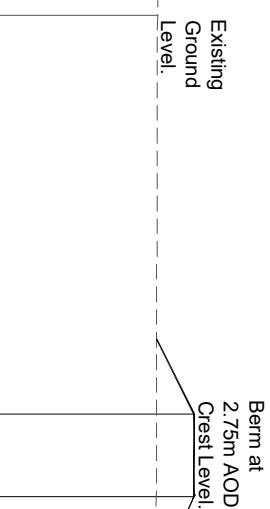






## **Appendix**

### **Appendix B – Total Catchment Based Calculations**

PB6934-RHD-SW-ZZ-MD-D-0500\_Proposed+Biomass  
No.3  
PB6934-RHD-SW-ZZ-MD-D-0501\_Full Development

Manchester One Portland Street Manchester M1 3LF	PB6934 Boston Alternative Energy Proposed + Biomass No.3	
Date 12/08/2021 File PB6934-RHD-SW-ZZ-MD-D-0...	Designed by P.Vicente Checked by	

Innovyze Source Control 2020.1

Summary of Results for 100 year Return Period (+40%)

Storm Event	Max Level (m)	Max Depth (m)	Max Control (l/s)	Max Overflow (l/s)	Max Σ Outflow (l/s)	Max Volume (m³)	Status
15 min Summer	1.749	0.749	35.0	0.0	35.0	2618.3	O K
30 min Summer	1.902	0.902	35.0	0.0	35.0	3437.4	O K
60 min Summer	2.042	1.042	35.0	0.0	35.0	4285.7	O K
120 min Summer	2.167	1.167	35.0	0.0	35.0	5132.1	O K
180 min Summer	2.231	1.231	35.0	0.0	35.0	5600.4	O K
240 min Summer	2.272	1.272	35.0	0.0	35.0	5905.2	Flood Risk
360 min Summer	2.318	1.318	35.0	0.0	35.0	6265.5	Flood Risk
480 min Summer	2.346	1.346	35.0	0.0	35.0	6489.4	Flood Risk
600 min Summer	2.363	1.363	35.0	0.0	35.0	6631.7	Flood Risk
720 min Summer	2.374	1.374	35.0	0.0	35.0	6718.8	Flood Risk
960 min Summer	2.382	1.382	35.0	0.0	35.0	6787.5	Flood Risk
1440 min Summer	2.371	1.371	35.0	0.0	35.0	6690.9	Flood Risk
2160 min Summer	2.334	1.334	35.0	0.0	35.0	6394.4	Flood Risk
2880 min Summer	2.299	1.299	35.0	0.0	35.0	6113.1	Flood Risk
4320 min Summer	2.231	1.231	35.0	0.0	35.0	5598.2	O K
5760 min Summer	2.165	1.165	35.0	0.0	35.0	5115.6	O K
7200 min Summer	2.097	1.097	35.0	0.0	35.0	4650.4	O K
8640 min Summer	2.022	1.022	35.0	0.0	35.0	4164.0	O K
10080 min Summer	1.941	0.941	35.0	0.0	35.0	3666.6	O K
15 min Winter	1.811	0.811	35.0	0.0	35.0	2937.7	O K
30 min Winter	1.973	0.973	35.0	0.0	35.0	3857.8	O K

Storm Event	Rain (mm/hr)	Flooded Volume (m³)	Discharge Volume (m³)	Overflow Volume (m³)	Time-Peak (mins)
15 min Summer	126.830	0.0	2461.7	0.0	30
30 min Summer	83.383	0.0	2912.5	0.0	45
60 min Summer	52.299	0.0	4294.8	0.0	74
120 min Summer	31.753	0.0	5132.5	0.0	134
180 min Summer	23.426	0.0	5489.1	0.0	194
240 min Summer	18.779	0.0	5524.6	0.0	252
360 min Summer	13.642	0.0	5459.6	0.0	370
480 min Summer	10.873	0.0	5404.8	0.0	490
600 min Summer	9.115	0.0	5360.8	0.0	608
720 min Summer	7.889	0.0	5323.1	0.0	726
960 min Summer	6.276	0.0	5258.2	0.0	964
1440 min Summer	4.539	0.0	5154.3	0.0	1440
2160 min Summer	3.278	0.0	9776.7	0.0	1784
2880 min Summer	2.600	0.0	10169.1	0.0	2160
4320 min Summer	1.872	0.0	9463.9	0.0	2952
5760 min Summer	1.482	0.0	11927.2	0.0	3800
7200 min Summer	1.235	0.0	12425.6	0.0	4616
8640 min Summer	1.064	0.0	12841.7	0.0	5448
10080 min Summer	0.938	0.0	13185.0	0.0	6160
15 min Winter	126.830	0.0	2702.6	0.0	30
30 min Winter	83.383	0.0	2888.5	0.0	45

Manchester One Portland Street Manchester M1 3LF	PB6934 Boston Alternative Energy Proposed + Biomass No.3
Date 12/08/2021 File PB6934-RHD-SW-ZZ-MD-D-0...	Designed by P.Vicente Checked by




Innovyze Source Control 2020.1

Summary of Results for 100 year Return Period (+40%)

Storm Event	Max Level (m)	Max Depth (m)	Max Control (l/s)	Max Overflow (l/s)	Max Σ Outflow (l/s)	Max Volume (m³)	Status
60 min Winter	2.121	1.121	35.0	0.0	35.0	4812.4	O K
120 min Winter	2.254	1.254	35.0	0.0	35.0	5769.3	Flood Risk
180 min Winter	2.323	1.323	35.0	0.0	35.0	6305.5	Flood Risk
240 min Winter	2.367	1.367	35.0	0.0	35.0	6658.3	Flood Risk
360 min Winter	2.418	1.418	35.0	0.0	35.0	7085.4	Flood Risk
480 min Winter	2.450	1.450	35.0	0.0	35.0	7359.5	Flood Risk
600 min Winter	2.471	1.471	35.0	0.0	35.0	7542.3	Flood Risk
720 min Winter	2.484	1.484	35.0	0.0	35.0	7663.2	Flood Risk
<b>960 min Winter</b>	<b>2.498</b>	<b>1.498</b>	<b>35.0</b>	<b>0.0</b>	<b>35.0</b>	<b>7786.4</b>	<b>Flood Risk</b>
1440 min Winter	2.496	1.496	35.0	0.0	35.0	7770.2	Flood Risk
2160 min Winter	2.461	1.461	35.0	0.0	35.0	7455.0	Flood Risk
2880 min Winter	2.418	1.418	35.0	0.0	35.0	7087.1	Flood Risk
4320 min Winter	2.334	1.334	35.0	0.0	35.0	6392.1	Flood Risk
5760 min Winter	2.244	1.244	35.0	0.0	35.0	5692.6	O K
7200 min Winter	2.148	1.148	35.0	0.0	35.0	5000.9	O K
8640 min Winter	2.041	1.041	35.0	0.0	35.0	4285.0	O K
10080 min Winter	1.912	0.912	35.0	0.0	35.0	3495.0	O K

Storm Event	Rain (mm/hr)	Flooded Volume (m³)	Discharge Volume (m³)	Overflow Volume (m³)	Time-Peak (mins)
60 min Winter	52.299	0.0	4781.3	0.0	74
120 min Winter	31.753	0.0	5527.1	0.0	132
180 min Winter	23.426	0.0	5533.7	0.0	190
240 min Winter	18.779	0.0	5494.4	0.0	248
360 min Winter	13.642	0.0	5444.9	0.0	364
480 min Winter	10.873	0.0	5415.1	0.0	482
600 min Winter	9.115	0.0	5395.7	0.0	598
720 min Winter	7.889	0.0	5383.2	0.0	714
<b>960 min Winter</b>	<b>6.276</b>	<b>0.0</b>	<b>5375.0</b>	<b>0.0</b>	<b>944</b>
1440 min Winter	4.539	0.0	5356.1	0.0	1392
2160 min Winter	3.278	0.0	10728.6	0.0	2016
2880 min Winter	2.600	0.0	10538.0	0.0	2280
4320 min Winter	1.872	0.0	9789.2	0.0	3204
5760 min Winter	1.482	0.0	13358.3	0.0	4104
7200 min Winter	1.235	0.0	13915.6	0.0	4984
8640 min Winter	1.064	0.0	14380.9	0.0	5888
10080 min Winter	0.938	0.0	14775.8	0.0	6568



Manchester One Portland Street Manchester M1 3LF	PB6934 Boston Alternative Energy Proposed + Biomass No.3	
Date 12/08/2021 File PB6934-RHD-SW-ZZ-MD-D-0...	Designed by P.Vicente Checked by	

Innovyze Source Control 2020.1


Rainfall Details

Rainfall Model	FSR	Winter Storms	Yes
Return Period (years)	100	Cv (Summer)	0.750
Region	England and Wales	Cv (Winter)	0.840
M5-60 (mm)	18.500	Shortest Storm (mins)	15
Ratio R	0.400	Longest Storm (mins)	10080
Summer Storms	Yes	Climate Change %	+40

Time Area Diagram

Total Area (ha) 11.199

Time (mins)	Area	Time (mins)	Area	Time (mins)	Area	Time (mins)	Area
From: To:	(ha)	From: To:	(ha)	From: To:	(ha)	From: To:	(ha)
0	4 2.800	4	8 2.800	8	12 2.800	12	16 2.799

Royal HaskoningDHV		Page 4
Manchester One Portland Street Manchester M1 3LF	PB6934 Boston Alternative Energy Proposed + Biomass No.3	
Date 12/08/2021 File PB6934-RHD-SW-ZZ-MD-D-0...	Designed by P.Vicente Checked by	

Innovyze Source Control 2020.1

Model Details

Storage is Online Cover Level (m) 2.550

Tank or Pond Structure

Invert Level (m) 1.000

Depth (m)	Area (m <sup>2</sup> )	Depth (m)	Area (m <sup>2</sup> )
0.000	2180.0	1.500	9000.0

Hydro-Brake® Optimum Outflow Control

Unit Reference MD-SHE-0247-3500-1500-3500  
 Design Head (m) 1.500  
 Design Flow (l/s) 35.0  
 Flush-Flo™ Calculated  
 Objective Minimise upstream storage  
 Application Surface  
 Sump Available Yes  
 Diameter (mm) 247  
 Invert Level (m) 1.000  
 Minimum Outlet Pipe Diameter (mm) 300  
 Suggested Manhole Diameter (mm) 1800


Control Points	Head (m)	Flow (l/s)
Design Point (Calculated)	1.500	35.0
Flush-Flo™	0.472	35.0
Kick-Flo®	1.032	29.3
Mean Flow over Head Range	-	29.9

The hydrological calculations have been based on the Head/Discharge relationship for the Hydro-Brake® Optimum as specified. Should another type of control device other than a Hydro-Brake Optimum® be utilised then these storage routing calculations will be invalidated

Depth (m)	Flow (l/s)	Depth (m)	Flow (l/s)	Depth (m)	Flow (l/s)	Depth (m)	Flow (l/s)
0.100	8.0	1.200	31.4	3.000	48.9	7.000	73.7
0.200	25.2	1.400	33.9	3.500	52.6	7.500	76.2
0.300	33.8	1.600	36.1	4.000	56.2	8.000	78.6
0.400	34.8	1.800	38.2	4.500	59.4	8.500	81.0
0.500	35.0	2.000	40.2	5.000	62.6	9.000	83.3
0.600	34.7	2.200	42.1	5.500	65.5	9.500	85.5
0.800	33.5	2.400	43.9	6.000	68.4		
1.000	30.3	2.600	45.6	6.500	71.1		

Weir Overflow Control

Discharge Coef 0.544 Width (m) 8.000 Invert Level (m) 2.500

Royal HaskoningDHV		Page 1
Manchester One Portland Street Manchester M1 3LF	PB6934 Boston Alternative Energy Full Development (67%) Imp.	
Date 12/08/2021 File PB6934-RHD-SW-ZZ-MD-D-0...	Designed by P.Vicente Checked by	

Innovyze Source Control 2020.1

Summary of Results for 100 year Return Period (+40%)

Storm Event	Max Level (m)	Max Depth (m)	Max Control (l/s)	Max Overflow (l/s)	Max Outflow (l/s)	Max Volume (m³)	Status
15 min Summer	1.567	0.567	35.0	0.0	35.0	3941.8	O K
30 min Summer	1.717	0.717	35.0	0.0	35.0	5175.9	O K
60 min Summer	1.863	0.863	35.0	0.0	35.0	6466.6	O K
120 min Summer	2.004	1.004	35.0	0.0	35.0	7791.0	O K
180 min Summer	2.083	1.083	35.0	0.0	35.0	8557.0	O K
240 min Summer	2.134	1.134	35.0	0.0	35.0	9075.4	O K
360 min Summer	2.198	1.198	35.0	0.0	35.0	9737.2	O K
480 min Summer	2.241	1.241	35.0	0.0	35.0	10193.0	O K
600 min Summer	2.272	1.272	35.0	0.0	35.0	10525.3	Flood Risk
720 min Summer	2.295	1.295	35.0	0.0	35.0	10774.0	Flood Risk
960 min Summer	2.326	1.326	35.0	0.0	35.0	11107.4	Flood Risk
1440 min Summer	2.352	1.352	35.0	0.0	35.0	11400.6	Flood Risk
2160 min Summer	2.350	1.350	35.0	0.0	35.0	11381.9	Flood Risk
2880 min Summer	2.328	1.328	35.0	0.0	35.0	11129.0	Flood Risk
4320 min Summer	2.280	1.280	35.0	0.0	35.0	10604.3	Flood Risk
5760 min Summer	2.231	1.231	35.0	0.0	35.0	10084.6	O K
7200 min Summer	2.183	1.183	35.0	0.0	35.0	9576.4	O K
8640 min Summer	2.134	1.134	35.0	0.0	35.0	9077.1	O K
10080 min Summer	2.085	1.085	35.0	0.0	35.0	8580.7	O K
15 min Winter	1.626	0.626	35.0	0.0	35.0	4418.8	O K
30 min Winter	1.789	0.789	35.0	0.0	35.0	5804.2	O K


Storm Event	Rain (mm/hr)	Flooded Volume (m³)	Discharge Volume (m³)	Overflow Volume (m³)	Time-Peak (mins)
15 min Summer	126.830	0.0	2838.5	0.0	31
30 min Summer	83.383	0.0	2965.1	0.0	45
60 min Summer	52.299	0.0	5608.1	0.0	76
120 min Summer	31.753	0.0	5731.5	0.0	134
180 min Summer	23.426	0.0	5558.0	0.0	194
240 min Summer	18.779	0.0	5442.7	0.0	254
360 min Summer	13.642	0.0	5304.9	0.0	372
480 min Summer	10.873	0.0	5217.7	0.0	492
600 min Summer	9.115	0.0	5156.8	0.0	610
720 min Summer	7.889	0.0	5112.5	0.0	730
960 min Summer	6.276	0.0	5058.0	0.0	968
1440 min Summer	4.539	0.0	5008.5	0.0	1446
2160 min Summer	3.278	0.0	10341.9	0.0	2160
2880 min Summer	2.600	0.0	10010.4	0.0	2632
4320 min Summer	1.872	0.0	9363.4	0.0	3336
5760 min Summer	1.482	0.0	17536.8	0.0	4104
7200 min Summer	1.235	0.0	18086.8	0.0	4912
8640 min Summer	1.064	0.0	18197.4	0.0	5792
10080 min Summer	0.938	0.0	17497.4	0.0	6568
15 min Winter	126.830	0.0	2955.5	0.0	31
30 min Winter	83.383	0.0	2949.4	0.0	45

Innovyze Source Control 2020.1

Summary of Results for 100 year Return Period (+40%)

Storm Event	Max Level (m)	Max Depth (m)	Max Control (l/s)	Max Overflow (l/s)	Max Outflow (l/s)	Max Volume (m³)	Status
60 min Winter	1.948	0.948	35.0	0.0	35.0	7255.0	O K
120 min Winter	2.102	1.102	35.0	0.0	35.0	8747.8	O K
180 min Winter	2.186	1.186	35.0	0.0	35.0	9609.9	O K
240 min Winter	2.242	1.242	35.0	0.0	35.0	10197.3	O K
360 min Winter	2.312	1.312	35.0	0.0	35.0	10954.6	Flood Risk
480 min Winter	2.360	1.360	35.0	0.0	35.0	11482.7	Flood Risk
600 min Winter	2.394	1.394	35.0	0.0	35.0	11873.0	Flood Risk
720 min Winter	2.420	1.420	35.0	0.0	35.0	12169.5	Flood Risk
960 min Winter	2.456	1.456	35.0	0.0	35.0	12580.2	Flood Risk
1440 min Winter	2.491	1.491	35.0	0.0	35.0	12984.6	Flood Risk
2160 min Winter	2.499	1.499	35.0	0.0	35.0	13081.7	Flood Risk
2880 min Winter	2.483	1.483	35.0	0.0	35.0	12889.7	Flood Risk
4320 min Winter	2.423	1.423	35.0	0.0	35.0	12194.8	Flood Risk
5760 min Winter	2.365	1.365	35.0	0.0	35.0	11541.4	Flood Risk
7200 min Winter	2.302	1.302	35.0	0.0	35.0	10850.0	Flood Risk
8640 min Winter	2.237	1.237	35.0	0.0	35.0	10146.1	O K
10080 min Winter	2.169	1.169	35.0	0.0	35.0	9439.6	O K

Storm Event	Rain (mm/hr)	Flooded Volume (m³)	Discharge Volume (m³)	Overflow Volume (m³)	Time-Peak (mins)
60 min Winter	52.299	0.0	5815.3	0.0	74
120 min Winter	31.753	0.0	5570.6	0.0	132
180 min Winter	23.426	0.0	5424.2	0.0	192
240 min Winter	18.779	0.0	5346.4	0.0	250
360 min Winter	13.642	0.0	5269.7	0.0	366
480 min Winter	10.873	0.0	5240.2	0.0	484
600 min Winter	9.115	0.0	5239.0	0.0	602
720 min Winter	7.889	0.0	5257.9	0.0	718
960 min Winter	6.276	0.0	5287.5	0.0	952
1440 min Winter	4.539	0.0	5248.4	0.0	1414
2160 min Winter	3.278	0.0	10504.1	0.0	2092
2880 min Winter	2.600	0.0	10284.0	0.0	2744
4320 min Winter	1.872	0.0	9886.7	0.0	3508
5760 min Winter	1.482	0.0	19478.0	0.0	4392
7200 min Winter	1.235	0.0	19741.9	0.0	5336
8640 min Winter	1.064	0.0	18998.5	0.0	6232
10080 min Winter	0.938	0.0	18053.9	0.0	7168

Manchester One Portland Street Manchester M1 3LF	PB6934 Boston Alternative Energy Full Development (67%) Imp.	
Date 12/08/2021 File PB6934-RHD-SW-ZZ-MD-D-0...	Designed by P.Vicente Checked by	

Innovyze Source Control 2020.1


Rainfall Details

Rainfall Model	FSR	Winter Storms	Yes
Return Period (years)	100	Cv (Summer)	0.750
Region	England and Wales	Cv (Winter)	0.840
M5-60 (mm)	18.500	Shortest Storm (mins)	15
Ratio R	0.400	Longest Storm (mins)	10080
Summer Storms	Yes	Climate Change %	+40

Time Area Diagram

Total Area (ha) 16.750

Time (mins)	Area	Time (mins)	Area	Time (mins)	Area	Time (mins)	Area
From: To:	(ha)	From: To:	(ha)	From: To:	(ha)	From: To:	(ha)
0	4 4.188	4	8 4.188	8	12 4.188	12	16 4.186

Royal HaskoningDHV		Page 4
Manchester One Portland Street Manchester M1 3LF	PB6934 Boston Alternative Energy Full Development (67%) Imp.	
Date 12/08/2021 File PB6934-RHD-SW-ZZ-MD-D-0...	Designed by P.Vicente Checked by	

Innovyze Source Control 2020.1

Model Details

Storage is Online Cover Level (m) 2.550

Tank or Pond Structure

Invert Level (m) 1.000

Depth (m)	Area (m <sup>2</sup> )	Depth (m)	Area (m <sup>2</sup> )
0.000	6000.0	1.500	11780.0

Hydro-Brake® Optimum Outflow Control

Unit Reference	MD-SHE-0247-3500-1500-3500
Design Head (m)	1.500
Design Flow (l/s)	35.0
Flush-Flo™	Calculated
Objective	Minimise upstream storage
Application	Surface
Sump Available	Yes
Diameter (mm)	247
Invert Level (m)	1.000
Minimum Outlet Pipe Diameter (mm)	300
Suggested Manhole Diameter (mm)	1800

Control Points	Head (m)	Flow (l/s)
Design Point (Calculated)	1.500	35.0
Flush-Flo™	0.472	35.0
Kick-Flo®	1.032	29.3
Mean Flow over Head Range	-	29.9

The hydrological calculations have been based on the Head/Discharge relationship for the Hydro-Brake® Optimum as specified. Should another type of control device other than a Hydro-Brake Optimum® be utilised then these storage routing calculations will be invalidated

Depth (m)	Flow (l/s)	Depth (m)	Flow (l/s)	Depth (m)	Flow (l/s)	Depth (m)	Flow (l/s)
0.100	8.0	1.200	31.4	3.000	48.9	7.000	73.7
0.200	25.2	1.400	33.9	3.500	52.6	7.500	76.2
0.300	33.8	1.600	36.1	4.000	56.2	8.000	78.6
0.400	34.8	1.800	38.2	4.500	59.4	8.500	81.0
0.500	35.0	2.000	40.2	5.000	62.6	9.000	83.3
0.600	34.7	2.200	42.1	5.500	65.5	9.500	85.5
0.800	33.5	2.400	43.9	6.000	68.4		
1.000	30.3	2.600	45.6	6.500	71.1		

Weir Overflow Control

Discharge Coef 0.544 Width (m) 8.000 Invert Level (m) 2.500




## Appendix

### Appendix C – Sub-Catchment Cascading Calculations

PB6934-RHD-SW-ZZ-MD-D-0550\_Catchment AB  
PB6934-RHD-SW-ZZ-MD-D-0551\_Catchment C  
PB6934-RHD-SW-ZZ-MD-D-0552\_Catchment D.North  
PB6934-RHD-SW-ZZ-MD-D-0553\_Catchment  
D.South+E+EX




Royal HaskoningDHV		Page 2
Manchester One Portland Street Manchester M1 3LF	PB6934 Boston Alternative Energy SW Strategy - Catch A+B	
Date 12/08/2021 File PB6934-RHD-SW-ZZ-MD-D-0...	Designed by P.Vicente Checked by	

Innovyze Source Control 2020.1

Cascade Summary of Results for PB6934-RHD-SW-ZZ-MD-D-0550\_Catchment AB.SRCX

Storm Event	Max Level (m)	Max Depth (m)	Max Infiltration (l/s)	Max Control (l/s)	Max Overflow (l/s)	Max Outflow (l/s)	Max Volume (m³)	Status
8640 min Summer	2.494	0.744	0.0	8.6	0.0	8.6	232.2	O K
10080 min Summer	2.427	0.677	0.0	8.2	0.0	8.2	191.2	O K
15 min Winter	2.715	0.965	0.0	9.9	0.0	9.9	391.3	O K
30 min Winter	2.853	1.103	0.0	10.6	0.0	10.6	510.1	O K
60 min Winter	2.975	1.225	0.0	11.2	0.0	11.2	628.8	O K
120 min Winter	3.079	1.329	0.0	11.6	0.0	11.6	738.8	Flood Risk
180 min Winter	3.127	1.377	0.0	11.8	0.0	11.8	792.3	Flood Risk
240 min Winter	3.152	1.402	0.0	12.0	0.0	12.0	821.1	Flood Risk
360 min Winter	3.170	1.420	0.0	12.0	0.0	12.0	842.1	Flood Risk
480 min Winter	3.172	1.422	0.0	12.0	0.0	12.0	844.0	Flood Risk
600 min Winter	3.165	1.415	0.0	12.0	0.0	12.0	835.5	Flood Risk
720 min Winter	3.152	1.402	0.0	12.0	0.0	12.0	821.0	Flood Risk
960 min Winter	3.130	1.380	0.0	11.9	0.0	11.9	794.9	Flood Risk
1440 min Winter	3.076	1.326	0.0	11.6	0.0	11.6	734.7	Flood Risk
2160 min Winter	2.987	1.237	0.0	11.2	0.0	11.2	640.9	O K
2880 min Winter	2.902	1.152	0.0	10.8	0.0	10.8	556.3	O K
4320 min Winter	2.747	0.997	0.0	10.0	0.0	10.0	417.1	O K
5760 min Winter	2.610	0.860	0.0	9.3	0.0	9.3	310.9	O K
7200 min Winter	2.493	0.743	0.0	8.6	0.0	8.6	231.0	O K
8640 min Winter	2.392	0.642	0.0	8.0	0.0	8.0	171.6	O K
10080 min Winter	2.307	0.557	0.0	7.4	0.0	7.4	127.4	O K

Storm Event	Rain (mm/hr)	Flooded Volume (m³)	Discharge Volume (m³)	Overflow Volume (m³)	Time-Peak (mins)
8640 min Summer	1.064	0.0	1729.8	0.0	4760
10080 min Summer	0.938	0.0	1778.8	0.0	5456
15 min Winter	126.830	0.0	400.8	0.0	22
30 min Winter	83.383	0.0	527.1	0.0	37
60 min Winter	52.299	0.0	661.2	0.0	66
120 min Winter	31.753	0.0	802.8	0.0	124
180 min Winter	23.426	0.0	888.4	0.0	180
240 min Winter	18.779	0.0	949.6	0.0	238
360 min Winter	13.642	0.0	1034.8	0.0	352
480 min Winter	10.873	0.0	1099.6	0.0	462
600 min Winter	9.115	0.0	1152.4	0.0	568
720 min Winter	7.889	0.0	1196.8	0.0	662
960 min Winter	6.276	0.0	1269.4	0.0	746
1440 min Winter	4.539	0.0	1377.3	0.0	1054
2160 min Winter	3.278	0.0	1491.9	0.0	1496
2880 min Winter	2.600	0.0	1577.5	0.0	1932
4320 min Winter	1.872	0.0	1704.1	0.0	2728
5760 min Winter	1.482	0.0	1798.3	0.0	3464
7200 min Winter	1.235	0.0	1873.9	0.0	4184
8640 min Winter	1.064	0.0	1937.4	0.0	4928
10080 min Winter	0.938	0.0	1992.2	0.0	5552

Royal HaskoningDHV		Page 3
Manchester One Portland Street Manchester M1 3LF	PB6934 Boston Alternative Energy SW Strategy - Catch A+B	
Date 12/08/2021 File PB6934-RHD-SW-ZZ-MD-D-0...	Designed by P.Vicente Checked by	

Innovyze Source Control 2020.1


Cascade Rainfall Details for PB6934-RHD-SW-ZZ-MD-D-0550\_Catchment AB.SRCX

Rainfall Model	FSR	Winter Storms	Yes
Return Period (years)	100	Cv (Summer)	0.750
Region	England and Wales	Cv (Winter)	0.840
M5-60 (mm)	18.500	Shortest Storm (mins)	15
Ratio R	0.400	Longest Storm (mins)	10080
Summer Storms	Yes	Climate Change %	+40

Time Area Diagram

Total Area (ha) 1.505

<b>Time (mins)</b>	<b>Area</b>	<b>Time (mins)</b>	<b>Area</b>
<b>From: To:</b>	<b>(ha)</b>	<b>From: To:</b>	<b>(ha)</b>
0	4 0.753	4	8 0.752

Royal HaskoningDHV		Page 4
Manchester One Portland Street Manchester M1 3LF	PB6934 Boston Alternative Energy SW Strategy - Catch A+B	
Date 12/08/2021 File PB6934-RHD-SW-ZZ-MD-D-0...	Designed by P.Vicente Checked by	

Innovyze Source Control 2020.1

Cascade Model Details for PB6934-RHD-SW-ZZ-MD-D-0550\_Catchment AB.SRCX

Storage is Online Cover Level (m) 3.300

Swale Structure

Infiltration Coefficient Base (m/hr)	0.00000	Length (m)	199.0
Infiltration Coefficient Side (m/hr)	0.00000	Side Slope (1:X)	2.0
Safety Factor	2.0	Slope (1:X)	500.0
Porosity	1.00	Cap Volume Depth (m)	1.500
Invert Level (m)	1.750	Cap Infiltration Depth (m)	0.000
Base Width (m)	1.0		


Orifice Outflow Control

Diameter (m) 0.070 Discharge Coefficient 0.600 Invert Level (m) 1.750

Weir Overflow Control

Discharge Coef 0.544 Width (m) 7.000 Invert Level (m) 3.250



Royal HaskoningDHV		Page 1
Manchester One Portland Street Manchester M1 3LF	PB6934 Boston Alternative Energy SW Strategy - Catch C	
Date 12/08/2021 File PB6934-RHD-SW-ZZ-MD-D-0...	Designed by P.Vicente Checked by	

Innovyze Source Control 2020.1

Cascade Summary of Results for PB6934-RHD-SW-ZZ-MD-D-0551\_Catchment C.SRCX

**Upstream Structures** **Outflow To**

PB6934-RHD-SW-ZZ-MD-D-0550\_Catchment AB.SRCX PB6934-RHD-SW-ZZ-MD-D-0552\_Catchment D.North.SRCX PB6934-RHD-SW-ZZ-MD-D-0551\_Catchment C.SRCX

Half Drain Time : 53 minutes.

Storm Event	Max Level (m)	Max Depth (m)	Max Infiltration (l/s)	Max Control (l/s)	Max Overflow (l/s)	Max Outflow (l/s)	Max Volume (m³)	Status
15 min Summer	2.433	1.183	0.0	178.9	0.0	178.9	697.2	O K
30 min Summer	2.547	1.297	0.0	188.4	0.0	188.4	865.5	Flood Risk
60 min Summer	2.596	1.346	0.0	192.4	0.0	192.4	943.6	Flood Risk
120 min Summer	2.583	1.333	0.0	191.4	0.0	191.4	923.2	Flood Risk
180 min Summer	2.545	1.295	0.0	188.2	0.0	188.2	862.2	Flood Risk
240 min Summer	2.502	1.252	0.0	184.7	0.0	184.7	796.1	Flood Risk
360 min Summer	2.413	1.163	0.0	177.1	0.0	177.1	668.6	O K
480 min Summer	2.331	1.081	0.0	169.9	0.0	169.9	561.7	O K
600 min Summer	2.257	1.007	0.0	163.0	0.0	163.0	472.6	O K
720 min Summer	2.190	0.940	0.0	156.5	0.0	156.5	398.6	O K
960 min Summer	2.074	0.824	0.0	144.6	0.0	144.6	286.1	O K
1440 min Summer	1.900	0.650	0.0	124.7	0.0	124.7	154.9	O K
2160 min Summer	1.734	0.484	0.0	102.2	0.0	102.2	73.0	O K
2880 min Summer	1.648	0.398	0.0	86.1	0.0	86.1	44.8	O K
4320 min Summer	1.576	0.326	0.0	64.5	0.0	64.5	27.6	O K
5760 min Summer	1.537	0.287	0.0	52.7	0.0	52.7	20.2	O K
7200 min Summer	1.511	0.261	0.0	45.1	0.0	45.1	16.1	O K


Storm Event	Rain (mm/hr)	Flooded Volume (m³)	Discharge Volume (m³)	Overflow Volume (m³)	Time-Peak (mins)
15 min Summer	126.830	0.0	1220.7	0.0	22
30 min Summer	83.383	0.0	1605.0	0.0	34
60 min Summer	52.299	0.0	2013.4	0.0	54
120 min Summer	31.753	0.0	2444.8	0.0	88
180 min Summer	23.426	0.0	2705.5	0.0	122
240 min Summer	18.779	0.0	2891.8	0.0	156
360 min Summer	13.642	0.0	3151.1	0.0	222
480 min Summer	10.873	0.0	3348.6	0.0	286
600 min Summer	9.115	0.0	3509.2	0.0	348
720 min Summer	7.889	0.0	3644.4	0.0	408
960 min Summer	6.276	0.0	3865.6	0.0	526
1440 min Summer	4.539	0.0	4194.2	0.0	758
2160 min Summer	3.278	0.0	4543.3	0.0	1108
2880 min Summer	2.600	0.0	4803.7	0.0	1468
4320 min Summer	1.872	0.0	5189.3	0.0	2200
5760 min Summer	1.482	0.0	5476.2	0.0	2936
7200 min Summer	1.235	0.0	5706.5	0.0	3672

Innovyze Source Control 2020.1

Cascade Summary of Results for PB6934-RHD-SW-ZZ-MD-D-0551\_Catchment C.SRCX

Storm Event	Max Level (m)	Max Depth (m)	Max Infiltration (l/s)	Max Control (l/s)	Max Overflow (l/s)	Max Outflow (l/s)	Max Volume (m³)	Status
8640 min Summer	1.492	0.242	0.0	39.7	0.0	39.7	13.5	O K
10080 min Summer	1.477	0.227	0.0	35.6	0.0	35.6	11.6	O K
15 min Winter	2.500	1.250	0.0	184.5	0.0	184.5	793.2	O K
30 min Winter	2.624	1.374	0.0	194.6	0.0	194.6	990.4	Flood Risk
<b>60 min Winter</b>	<b>2.683</b>	<b>1.433</b>	<b>0.0</b>	<b>199.2</b>	<b>0.0</b>	<b>199.2</b>	<b>1092.1</b>	<b>Flood Risk</b>
120 min Winter	2.663	1.413	0.0	197.7	0.0	197.7	1056.1	Flood Risk
180 min Winter	2.608	1.358	0.0	193.3	0.0	193.3	963.1	Flood Risk
240 min Winter	2.544	1.294	0.0	188.2	0.0	188.2	861.6	Flood Risk
360 min Winter	2.416	1.166	0.0	177.4	0.0	177.4	673.2	O K
480 min Winter	2.300	1.050	0.0	167.0	0.0	167.0	522.9	O K
600 min Winter	2.196	0.946	0.0	157.1	0.0	157.1	405.0	O K
720 min Winter	2.104	0.854	0.0	147.8	0.0	147.8	313.4	O K
960 min Winter	1.953	0.703	0.0	131.1	0.0	131.1	189.6	O K
1440 min Winter	1.751	0.501	0.0	104.7	0.0	104.7	79.4	O K
2160 min Winter	1.627	0.377	0.0	79.9	0.0	79.9	39.3	O K
2880 min Winter	1.579	0.329	0.0	65.3	0.0	65.3	28.1	O K
4320 min Winter	1.525	0.275	0.0	49.2	0.0	49.2	18.2	O K
5760 min Winter	1.494	0.244	0.0	40.4	0.0	40.4	13.8	O K
7200 min Winter	1.472	0.222	0.0	34.6	0.0	34.6	11.0	O K
8640 min Winter	1.452	0.202	0.0	30.4	0.0	30.4	8.9	O K
10080 min Winter	1.437	0.187	0.0	27.2	0.0	27.2	7.4	O K

Storm Event	Rain (mm/hr)	Flooded Volume (m³)	Discharge Volume (m³)	Overflow Volume (m³)	Time-Peak (mins)
8640 min Summer	1.064	0.0	5899.8	0.0	4384
10080 min Summer	0.938	0.0	6066.8	0.0	5136
15 min Winter	126.830	0.0	1367.1	0.0	23
30 min Winter	83.383	0.0	1797.6	0.0	34
<b>60 min Winter</b>	<b>52.299</b>	<b>0.0</b>	<b>2255.0</b>	<b>0.0</b>	<b>58</b>
120 min Winter	31.753	0.0	2738.2	0.0	94
180 min Winter	23.426	0.0	3030.2	0.0	132
240 min Winter	18.779	0.0	3238.8	0.0	168
360 min Winter	13.642	0.0	3529.2	0.0	236
480 min Winter	10.873	0.0	3750.5	0.0	300
600 min Winter	9.115	0.0	3930.3	0.0	362
720 min Winter	7.889	0.0	4081.8	0.0	422
960 min Winter	6.276	0.0	4329.5	0.0	536
1440 min Winter	4.539	0.0	4697.5	0.0	760
2160 min Winter	3.278	0.0	5088.5	0.0	1104
2880 min Winter	2.600	0.0	5380.2	0.0	1468
4320 min Winter	1.872	0.0	5812.0	0.0	2204
5760 min Winter	1.482	0.0	6133.4	0.0	2936
7200 min Winter	1.235	0.0	6391.3	0.0	3672
8640 min Winter	1.064	0.0	6607.8	0.0	4408
10080 min Winter	0.938	0.0	6794.8	0.0	5096

Royal HaskoningDHV		Page 3
Manchester One Portland Street Manchester M1 3LF	PB6934 Boston Alternative Energy SW Strategy - Catch C	
Date 12/08/2021 File PB6934-RHD-SW-ZZ-MD-D-0...	Designed by P.Vicente Checked by	

Innovyze Source Control 2020.1


Cascade Rainfall Details for PB6934-RHD-SW-ZZ-MD-D-0551\_Catchment C.SRCX

Rainfall Model	FSR	Winter Storms	Yes
Return Period (years)	100	Cv (Summer)	0.750
Region	England and Wales	Cv (Winter)	0.840
M5-60 (mm)	18.500	Shortest Storm (mins)	15
Ratio R	0.400	Longest Storm (mins)	10080
Summer Storms	Yes	Climate Change %	+40

Time Area Diagram

Total Area (ha) 3.628

Time (mins)	Area (ha)	Time (mins)	Area (ha)	Time (mins)	Area (ha)
From:	To:	From:	To:	From:	To:
0	4	4	8	8	12
	1.209		1.209		1.210

Royal HaskoningDHV		Page 4
Manchester One Portland Street Manchester M1 3LF	PB6934 Boston Alternative Energy SW Strategy - Catch C	
Date 12/08/2021 File PB6934-RHD-SW-ZZ-MD-D-0...	Designed by P.Vicente Checked by	

Innovyze Source Control 2020.1

Cascade Model Details for PB6934-RHD-SW-ZZ-MD-D-0551\_Catchment C.SRCX

Storage is Online Cover Level (m) 2.800

Swale Structure


Infiltration Coefficient Base (m/hr)	0.00000	Length (m)	360.0
Infiltration Coefficient Side (m/hr)	0.00000	Side Slope (1:X)	2.0
Safety Factor	2.0	Slope (1:X)	500.0
Porosity	1.00	Cap Volume Depth (m)	1.500
Invert Level (m)	1.250	Cap Infiltration Depth (m)	0.000
Base Width (m)	0.6		

Orifice Outflow Control

Diameter (m) 0.290 Discharge Coefficient 0.600 Invert Level (m) 1.250

Weir Overflow Control

Discharge Coef 0.544 Width (m) 6.600 Invert Level (m) 2.750

Royal HaskoningDHV		Page 1
Manchester One Portland Street Manchester M1 3LF	PB6934 Boston Alternative Energy SW Strategy - Catch D.North	
Date 12/08/2021 File PB6934-RHD-SW-ZZ-MD-D-0...	Designed by P.Vicente Checked by	

Innovyze Source Control 2020.1

Cascade Summary of Results for PB6934-RHD-SW-ZZ-MD-D-0552\_Catchment  
D.North.SRCX

**Upstream  
Structures**


**Outflow To**

PB6934-RHD-SW-ZZ-MD-D-0551\_Catchment C.SRCX PB6934-RHD-SW-ZZ-MD-D-0553\_Catchment D.South+Existing.SRCX  
PB6934-RHD-SW-ZZ-MD-D-0550\_Catchment AB.SRCX

Storm Event	Max Level (m)	Max Depth (m)	Max Control (l/s)	Max Overflow (l/s)	Max Outflow (l/s)	Max Volume (m³)	Status
15 min Summer	1.866	0.816	153.3	0.0	153.3	793.2	O K
30 min Summer	2.040	0.990	172.2	0.0	172.2	1021.3	O K
60 min Summer	2.215	1.165	189.2	0.0	189.2	1274.7	O K
120 min Summer	2.365	1.315	202.8	0.0	202.8	1512.0	Flood Risk
180 min Summer	2.410	1.360	206.6	0.0	206.6	1586.2	Flood Risk
240 min Summer	2.408	1.358	206.5	0.0	206.5	1583.3	Flood Risk
360 min Summer	2.381	1.331	204.1	0.0	204.1	1537.7	Flood Risk
480 min Summer	2.348	1.298	201.3	0.0	201.3	1484.5	Flood Risk
600 min Summer	2.312	1.262	198.1	0.0	198.1	1425.8	Flood Risk
720 min Summer	2.273	1.223	194.6	0.0	194.6	1363.7	O K
960 min Summer	2.189	1.139	186.8	0.0	186.8	1235.6	O K
1440 min Summer	2.023	0.973	170.4	0.0	170.4	997.9	O K
2160 min Summer	1.820	0.770	148.0	0.0	148.0	736.5	O K
2880 min Summer	1.675	0.625	129.4	0.0	129.4	567.4	O K
4320 min Summer	1.509	0.459	104.5	0.0	104.5	392.6	O K
5760 min Summer	1.441	0.391	87.3	0.0	87.3	326.5	O K
7200 min Summer	1.401	0.351	74.5	0.0	74.5	288.5	O K

Storm Event	Rain (mm/hr)	Flooded Volume (m³)	Discharge Volume (m³)	Overflow Volume (m³)	Time-Peak (mins)
15 min Summer	126.830	0.0	1918.8	0.0	59
30 min Summer	83.383	0.0	2522.9	0.0	64
60 min Summer	52.299	0.0	3179.9	0.0	70
120 min Summer	31.753	0.0	3861.7	0.0	126
180 min Summer	23.426	0.0	4273.6	0.0	182
240 min Summer	18.779	0.0	4567.9	0.0	222
360 min Summer	13.642	0.0	4977.4	0.0	276
480 min Summer	10.873	0.0	5289.1	0.0	338
600 min Summer	9.115	0.0	5542.3	0.0	400
720 min Summer	7.889	0.0	5755.4	0.0	464
960 min Summer	6.276	0.0	6103.5	0.0	588
1440 min Summer	4.539	0.0	6616.6	0.0	826
2160 min Summer	3.278	0.0	7184.7	0.0	1172
2880 min Summer	2.600	0.0	7596.0	0.0	1520
4320 min Summer	1.872	0.0	8202.9	0.0	2216
5760 min Summer	1.482	0.0	8662.6	0.0	2936
7200 min Summer	1.235	0.0	9026.4	0.0	3672




Royal HaskoningDHV		Page 2
Manchester One Portland Street Manchester M1 3LF	PB6934 Boston Alternative Energy SW Strategy - Catch D.North	
Date 12/08/2021 File PB6934-RHD-SW-ZZ-MD-D-0...	Designed by P.Vicente Checked by	

Innovyze Source Control 2020.1

Cascade Summary of Results for PB6934-RHD-SW-ZZ-MD-D-0552\_Catchment  
D.North.SRCX

Storm Event	Max Level (m)	Max Depth (m)	Max Control (l/s)	Max Overflow (l/s)	Max Σ Outflow (l/s)	Max Volume (m³)	Status
8640 min Summer	1.372	0.322	65.2	0.0	65.2	261.5	O K
10080 min Summer	1.350	0.300	58.3	0.0	58.3	241.4	O K
15 min Winter	1.931	0.881	160.6	0.0	160.6	875.1	O K
30 min Winter	2.116	1.066	179.8	0.0	179.8	1128.5	O K
60 min Winter	2.302	1.252	197.2	0.0	197.2	1409.6	Flood Risk
120 min Winter	2.466	1.416	211.4	0.0	211.4	1681.5	Flood Risk
180 min Winter	2.522	1.472	216.0	0.0	216.0	1780.7	Flood Risk
240 min Winter	2.528	1.478	216.5	0.0	216.5	1791.3	Flood Risk
360 min Winter	2.489	1.439	213.3	0.0	213.3	1721.7	Flood Risk
480 min Winter	2.439	1.389	209.1	0.0	209.1	1636.1	Flood Risk
600 min Winter	2.378	1.328	203.9	0.0	203.9	1532.8	Flood Risk
720 min Winter	2.310	1.260	197.9	0.0	197.9	1422.4	Flood Risk
960 min Winter	2.169	1.119	184.9	0.0	184.9	1206.1	O K
1440 min Winter	1.919	0.869	159.3	0.0	159.3	859.8	O K
2160 min Winter	1.669	0.619	128.6	0.0	128.6	560.9	O K
2880 min Winter	1.529	0.479	107.7	0.0	107.7	412.2	O K
4320 min Winter	1.423	0.373	81.6	0.0	81.6	309.4	O K
5760 min Winter	1.375	0.325	66.2	0.0	66.2	264.1	O K
7200 min Winter	1.343	0.293	56.1	0.0	56.1	235.5	O K
8640 min Winter	1.319	0.269	49.0	0.0	49.0	214.8	O K

Storm Event	Rain (mm/hr)	Flooded Volume (m³)	Discharge Volume (m³)	Overflow Volume (m³)	Time-Peak (mins)
8640 min Summer	1.064	0.0	9330.7	0.0	4408
10080 min Summer	0.938	0.0	9591.2	0.0	5136
15 min Winter	126.830	0.0	2149.3	0.0	60
30 min Winter	83.383	0.0	2824.4	0.0	64
60 min Winter	52.299	0.0	3561.8	0.0	68
120 min Winter	31.753	0.0	4325.3	0.0	124
180 min Winter	23.426	0.0	4786.6	0.0	180
240 min Winter	18.779	0.0	5116.1	0.0	232
360 min Winter	13.642	0.0	5574.6	0.0	288
480 min Winter	10.873	0.0	5923.5	0.0	356
600 min Winter	9.115	0.0	6206.8	0.0	422
720 min Winter	7.889	0.0	6445.3	0.0	488
960 min Winter	6.276	0.0	6834.4	0.0	610
1440 min Winter	4.539	0.0	7403.0	0.0	842
2160 min Winter	3.278	0.0	8046.9	0.0	1188
2880 min Winter	2.600	0.0	8507.5	0.0	1528
4320 min Winter	1.872	0.0	9187.9	0.0	2216
5760 min Winter	1.482	0.0	9702.1	0.0	2944
7200 min Winter	1.235	0.0	10109.7	0.0	3672
8640 min Winter	1.064	0.0	10450.8	0.0	4408


Manchester One Portland Street Manchester M1 3LF	PB6934 Boston Alternative Energy SW Strategy - Catch D.North	
Date 12/08/2021 File PB6934-RHD-SW-ZZ-MD-D-0...	Designed by P.Vicente Checked by	

Innovyze	Source Control 2020.1
----------	-----------------------

Cascade Summary of Results for PB6934-RHD-SW-ZZ-MD-D-0552\_Catchment  
D.North.SRCX

Storm Event	Max Level (m)	Max Depth (m)	Max Control (l/s)	Max Overflow (l/s)	Max E Outflow (l/s)	Max Volume (m <sup>3</sup> )	Status
10080 min Winter	1.302	0.252	43.7	0.0	43.7	199.3	O K

Storm Event	Rain (mm/hr)	Flooded Volume (m <sup>3</sup> )	Discharge Volume (m <sup>3</sup> )	Overflow Volume (m <sup>3</sup> )	Time-Peak (mins)
10080 min Winter	0.938	0.0	10743.4	0.0	5144

Manchester One Portland Street Manchester M1 3LF	PB6934 Boston Alternative Energy SW Strategy - Catch D.North	
Date 12/08/2021	Designed by P.Vicente	
File PB6934-RHD-SW-ZZ-MD-D-0...	Checked by	

Innovyze	Source Control 2020.1
----------	-----------------------


Cascade Rainfall Details for PB6934-RHD-SW-ZZ-MD-D-0552\_Catchment  
D.North.SRCX

Rainfall Model	FSR	Winter Storms	Yes
Return Period (years)	100	Cv (Summer)	0.750
Region	England and Wales	Cv (Winter)	0.840
M5-60 (mm)	18.500	Shortest Storm (mins)	15
Ratio R	0.400	Longest Storm (mins)	10080
Summer Storms	Yes	Climate Change %	+40

Time Area Diagram

Total Area (ha) 2.987

Time (mins)	Area	Time (mins)	Area
From:	To: (ha)	From:	To: (ha)
0	4 1.494	4	8 1.493

Manchester One Portland Street Manchester M1 3LF	PB6934 Boston Alternative Energy SW Strategy - Catch D.North	
Date 12/08/2021	Designed by P.Vicente	
File PB6934-RHD-SW-ZZ-MD-D-0...	Checked by	

Innovyze	Source Control 2020.1
----------	-----------------------

Cascade Model Details for PB6934-RHD-SW-ZZ-MD-D-0552\_Catchment D.North.SRCX

Storage is Online Cover Level (m) 2.600

Tank or Pond Structure

Invert Level (m) 1.050


Depth (m)	Area (m <sup>2</sup> )	Depth (m)	Area (m <sup>2</sup> )
0.000	719.0	1.550	1848.0

Orifice Outflow Control

Diameter (m) 0.300 Discharge Coefficient 0.600 Invert Level (m) 1.050

Weir Overflow Control

Discharge Coef 0.544 Width (m) 6.600 Invert Level (m) 2.550

Royal HaskoningDHV		Page 1
Manchester One Portland Street Manchester M1 3LF	PB6934 Boston Alternative Energy SW Strategy - Catch D.S+E+Ex	
Date 12/08/2021 File PB6934-RHD-SW-ZZ-MD-D-0...	Designed by P.Vicente Checked by	

Innovyze Source Control 2020.1

Cascade Summary of Results for PB6934-RHD-SW-ZZ-MD-D-0553\_Catchment D.South +Existing.SRCX

Upstream Structures	Outflow To	Overflow To
PB6934-RHD-SW-ZZ-MD-D-0552_Catchment D.North.SRCX	(None)	(None)
PB6934-RHD-SW-ZZ-MD-D-0551_Catchment C.SRCX		
PB6934-RHD-SW-ZZ-MD-D-0550_Catchment AB.SRCX		

Storm Event	Max Level (m)	Max Depth (m)	Max Control (l/s)	Max Overflow (l/s)	Max Outflow (l/s)	Max Volume (m³)	Status
15 min Summer	1.546	0.496	35.0	0.0	35.0	2270.8	O K
30 min Summer	1.677	0.627	35.0	0.0	35.0	3084.9	O K
60 min Summer	1.803	0.753	35.0	0.0	35.0	3966.4	O K
120 min Summer	1.925	0.875	35.0	0.0	35.0	4907.8	O K
180 min Summer	1.993	0.943	35.0	0.0	35.0	5477.1	O K
240 min Summer	2.039	0.989	35.0	0.0	35.0	5881.1	O K
360 min Summer	2.099	1.049	35.0	0.0	35.0	6429.0	O K
480 min Summer	2.140	1.090	35.0	0.0	35.0	6817.0	O K
600 min Summer	2.170	1.120	35.0	0.0	35.0	7111.1	O K
720 min Summer	2.193	1.143	35.0	0.0	35.0	7336.6	O K
960 min Summer	2.221	1.171	35.0	0.0	35.0	7617.9	O K
1440 min Summer	2.243	1.193	35.0	0.0	35.0	7846.9	O K
2160 min Summer	2.240	1.190	35.0	0.0	35.0	7817.7	O K
2880 min Summer	2.217	1.167	35.0	0.0	35.0	7578.7	O K
4320 min Summer	2.167	1.117	35.0	0.0	35.0	7080.8	O K
5760 min Summer	2.118	1.068	35.0	0.0	35.0	6606.1	O K
7200 min Summer	2.064	1.014	35.0	0.0	35.0	6108.2	O K

Storm Event	Rain (mm/hr)	Flooded Volume (m³)	Discharge Volume (m³)	Overflow Volume (m³)	Time-Peak (mins)
15 min Summer	126.830	0.0	2639.7	0.0	226
30 min Summer	83.383	0.0	2962.2	0.0	277
60 min Summer	52.299	0.0	4879.5	0.0	332
120 min Summer	31.753	0.0	5647.6	0.0	398
180 min Summer	23.426	0.0	5693.8	0.0	448
240 min Summer	18.779	0.0	5586.8	0.0	492
360 min Summer	13.642	0.0	5375.7	0.0	568
480 min Summer	10.873	0.0	5239.6	0.0	638
600 min Summer	9.115	0.0	5145.6	0.0	712
720 min Summer	7.889	0.0	5073.4	0.0	792
960 min Summer	6.276	0.0	4965.4	0.0	996
1440 min Summer	4.539	0.0	4824.1	0.0	1452
2160 min Summer	3.278	0.0	10346.2	0.0	2164
2880 min Summer	2.600	0.0	9985.0	0.0	2720
4320 min Summer	1.872	0.0	9181.2	0.0	3412
5760 min Summer	1.482	0.0	13950.7	0.0	4160
7200 min Summer	1.235	0.0	14523.7	0.0	4920

Innovyze Source Control 2020.1

Cascade Summary of Results for PB6934-RHD-SW-ZZ-MD-D-0553\_Catchment D.South  
+Existing.SRCX

Storm Event	Max Level (m)	Max Depth (m)	Max Control (l/s)	Max Overflow (l/s)	Max Σ Outflow (l/s)	Max Volume (m³)	Status
8640 min Summer	2.008	0.958	35.0	0.0	35.0	5609.6	O K
10080 min Summer	1.953	0.903	35.0	0.0	35.0	5143.7	O K
15 min Winter	1.598	0.548	35.0	0.0	35.0	2577.9	O K
30 min Winter	1.738	0.688	35.0	0.0	35.0	3496.8	O K
60 min Winter	1.872	0.822	35.0	0.0	35.0	4489.2	O K
120 min Winter	2.001	0.951	35.0	0.0	35.0	5551.8	O K
180 min Winter	2.074	1.024	35.0	0.0	35.0	6199.9	O K
240 min Winter	2.123	1.073	35.0	0.0	35.0	6652.7	O K
360 min Winter	2.184	1.134	35.0	0.0	35.0	7254.2	O K
480 min Winter	2.228	1.178	35.0	0.0	35.0	7689.8	O K
600 min Winter	2.260	1.210	35.0	0.0	35.0	8026.2	O K
720 min Winter	2.285	1.235	35.0	0.0	35.0	8291.0	O K
960 min Winter	2.318	1.268	35.0	0.0	35.0	8649.7	Flood Risk
1440 min Winter	2.347	1.297	35.0	0.0	35.0	8965.2	Flood Risk
2160 min Winter	2.352	1.302	35.0	0.0	35.0	9020.8	Flood Risk
2880 min Winter	2.335	1.285	35.0	0.0	35.0	8833.9	Flood Risk
4320 min Winter	2.275	1.225	35.0	0.0	35.0	8183.5	O K
5760 min Winter	2.215	1.165	35.0	0.0	35.0	7565.4	O K
7200 min Winter	2.149	1.099	35.0	0.0	35.0	6904.0	O K
8640 min Winter	2.070	1.020	35.0	0.0	35.0	6162.1	O K

Storm Event	Rain (mm/hr)	Flooded Volume (m³)	Discharge Volume (m³)	Overflow Volume (m³)	Time-Peak (mins)
8640 min Summer	1.064	0.0	14993.0	0.0	5656
10080 min Summer	0.938	0.0	15368.4	0.0	6408
15 min Winter	126.830	0.0	2848.5	0.0	243
30 min Winter	83.383	0.0	2962.5	0.0	298
60 min Winter	52.299	0.0	5374.9	0.0	358
120 min Winter	31.753	0.0	5723.6	0.0	428
180 min Winter	23.426	0.0	5540.5	0.0	482
240 min Winter	18.779	0.0	5389.6	0.0	522
360 min Winter	13.642	0.0	5237.5	0.0	592
480 min Winter	10.873	0.0	5156.1	0.0	660
600 min Winter	9.115	0.0	5105.5	0.0	730
720 min Winter	7.889	0.0	5073.0	0.0	806
960 min Winter	6.276	0.0	5040.2	0.0	988
1440 min Winter	4.539	0.0	5004.2	0.0	1438
2160 min Winter	3.278	0.0	10387.3	0.0	2124
2880 min Winter	2.600	0.0	10085.8	0.0	2772
4320 min Winter	1.872	0.0	9474.1	0.0	3584
5760 min Winter	1.482	0.0	15617.0	0.0	4432
7200 min Winter	1.235	0.0	16247.9	0.0	5328
8640 min Winter	1.064	0.0	16759.8	0.0	6184



Manchester One Portland Street Manchester M1 3LF	PB6934 Boston Alternative Energy SW Strategy - Catch D.S+E+Ex
Date 12/08/2021 File PB6934-RHD-SW-ZZ-MD-D-0...	Designed by P.Vicente Checked by




Innovyze Source Control 2020.1

Cascade Summary of Results for PB6934-RHD-SW-ZZ-MD-D-0553\_Catchment D.South  
+Existing.SRCX

Storm Event	Max Level (m)	Max Depth (m)	Max Control (l/s)	Max Overflow (l/s)	Max E Outflow (l/s)	Max Volume (m <sup>3</sup> )	Status
10080 min Winter	1.981	0.931	35.0	0.0	35.0	5376.5	O K

Storm Event	Rain (mm/hr)	Flooded Volume (m <sup>3</sup> )	Discharge Volume (m <sup>3</sup> )	Overflow Volume (m <sup>3</sup> )	Time-Peak (mins)
10080 min Winter	0.938	0.0	17163.9	0.0	6920

Manchester One Portland Street Manchester M1 3LF	PB6934 Boston Alternative Energy SW Strategy - Catch D.S+E+Ex	
Date 12/08/2021 File PB6934-RHD-SW-ZZ-MD-D-0...	Designed by P.Vicente Checked by	

Innovyze	Source Control 2020.1
----------	-----------------------


Cascade Rainfall Details for PB6934-RHD-SW-ZZ-MD-D-0553\_Catchment D.South  
+Existing.SRCX

Rainfall Model	FSR	Winter Storms	Yes
Return Period (years)	100	Cv (Summer)	0.750
Region	England and Wales	Cv (Winter)	0.840
M5-60 (mm)	18.500	Shortest Storm (mins)	15
Ratio R	0.400	Longest Storm (mins)	10080
Summer Storms	Yes	Climate Change %	+40

Time Area Diagram

Total Area (ha) 5.018

Time (mins)	Area	Time (mins)	Area	Time (mins)	Area
From: To:	(ha)	From: To:	(ha)	From: To:	(ha)
0	4 1.673	4	8 1.673	8	12 1.672

Royal HaskoningDHV		Page 5
Manchester One Portland Street Manchester M1 3LF	PB6934 Boston Alternative Energy SW Strategy - Catch D.S+E+Ex	
Date 12/08/2021 File PB6934-RHD-SW-ZZ-MD-D-0...	Designed by P.Vicente Checked by	

Innovyze Source Control 2020.1

Cascade Model Details for PB6934-RHD-SW-ZZ-MD-D-0553\_Catchment D.South  
+Existing.SRCX

Storage is Online Cover Level (m) 2.600

Tank or Pond Structure

Invert Level (m) 1.050

Depth (m)	Area (m <sup>2</sup> )	Depth (m)	Area (m <sup>2</sup> )
0.000	3408.0	1.550	13204.0


Hydro-Brake® Optimum Outflow Control

Unit Reference	MD-SHE-0247-3500-1500-3500
Design Head (m)	1.500
Design Flow (l/s)	35.0
Flush-Flo™	Calculated
Objective	Minimise upstream storage
Application	Surface
Sump Available	Yes
Diameter (mm)	247
Invert Level (m)	1.050
Minimum Outlet Pipe Diameter (mm)	300
Suggested Manhole Diameter (mm)	1800

Control Points	Head (m)	Flow (l/s)
Design Point (Calculated)	1.500	35.0
Flush-Flo™	0.472	35.0
Kick-Flo®	1.032	29.3
Mean Flow over Head Range	-	29.9

The hydrological calculations have been based on the Head/Discharge relationship for the Hydro-Brake® Optimum as specified. Should another type of control device other than a Hydro-Brake Optimum® be utilised then these storage routing calculations will be invalidated

Depth (m)	Flow (l/s)	Depth (m)	Flow (l/s)	Depth (m)	Flow (l/s)	Depth (m)	Flow (l/s)
0.100	8.0	1.200	31.4	3.000	48.9	7.000	73.7
0.200	25.2	1.400	33.9	3.500	52.6	7.500	76.2
0.300	33.8	1.600	36.1	4.000	56.2	8.000	78.6
0.400	34.8	1.800	38.2	4.500	59.4	8.500	81.0
0.500	35.0	2.000	40.2	5.000	62.6	9.000	83.3
0.600	34.7	2.200	42.1	5.500	65.5	9.500	85.5
0.800	33.5	2.400	43.9	6.000	68.4		
1.000	30.3	2.600	45.6	6.500	71.1		



Royal HaskoningDHV		Page 6
Manchester One Portland Street Manchester M1 3LF	PB6934 Boston Alternative Energy SW Strategy - Catch D.S+E+Ex	
Date 12/08/2021	Designed by P.Vicente	
File PB6934-RHD-SW-ZZ-MD-D-0...	Checked by	
Innovyze	Source Control 2020.1	
<p><u>Weir Overflow Control</u></p> <p>Discharge Coef 0.544 Width (m) 5.000 Invert Level (m) 2.550</p>		
©1982-2020 Innovyze		

## **Appendix**






### **Appendix D – Drainage Strategy Layout**

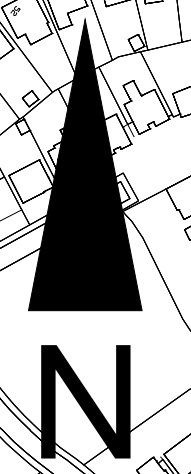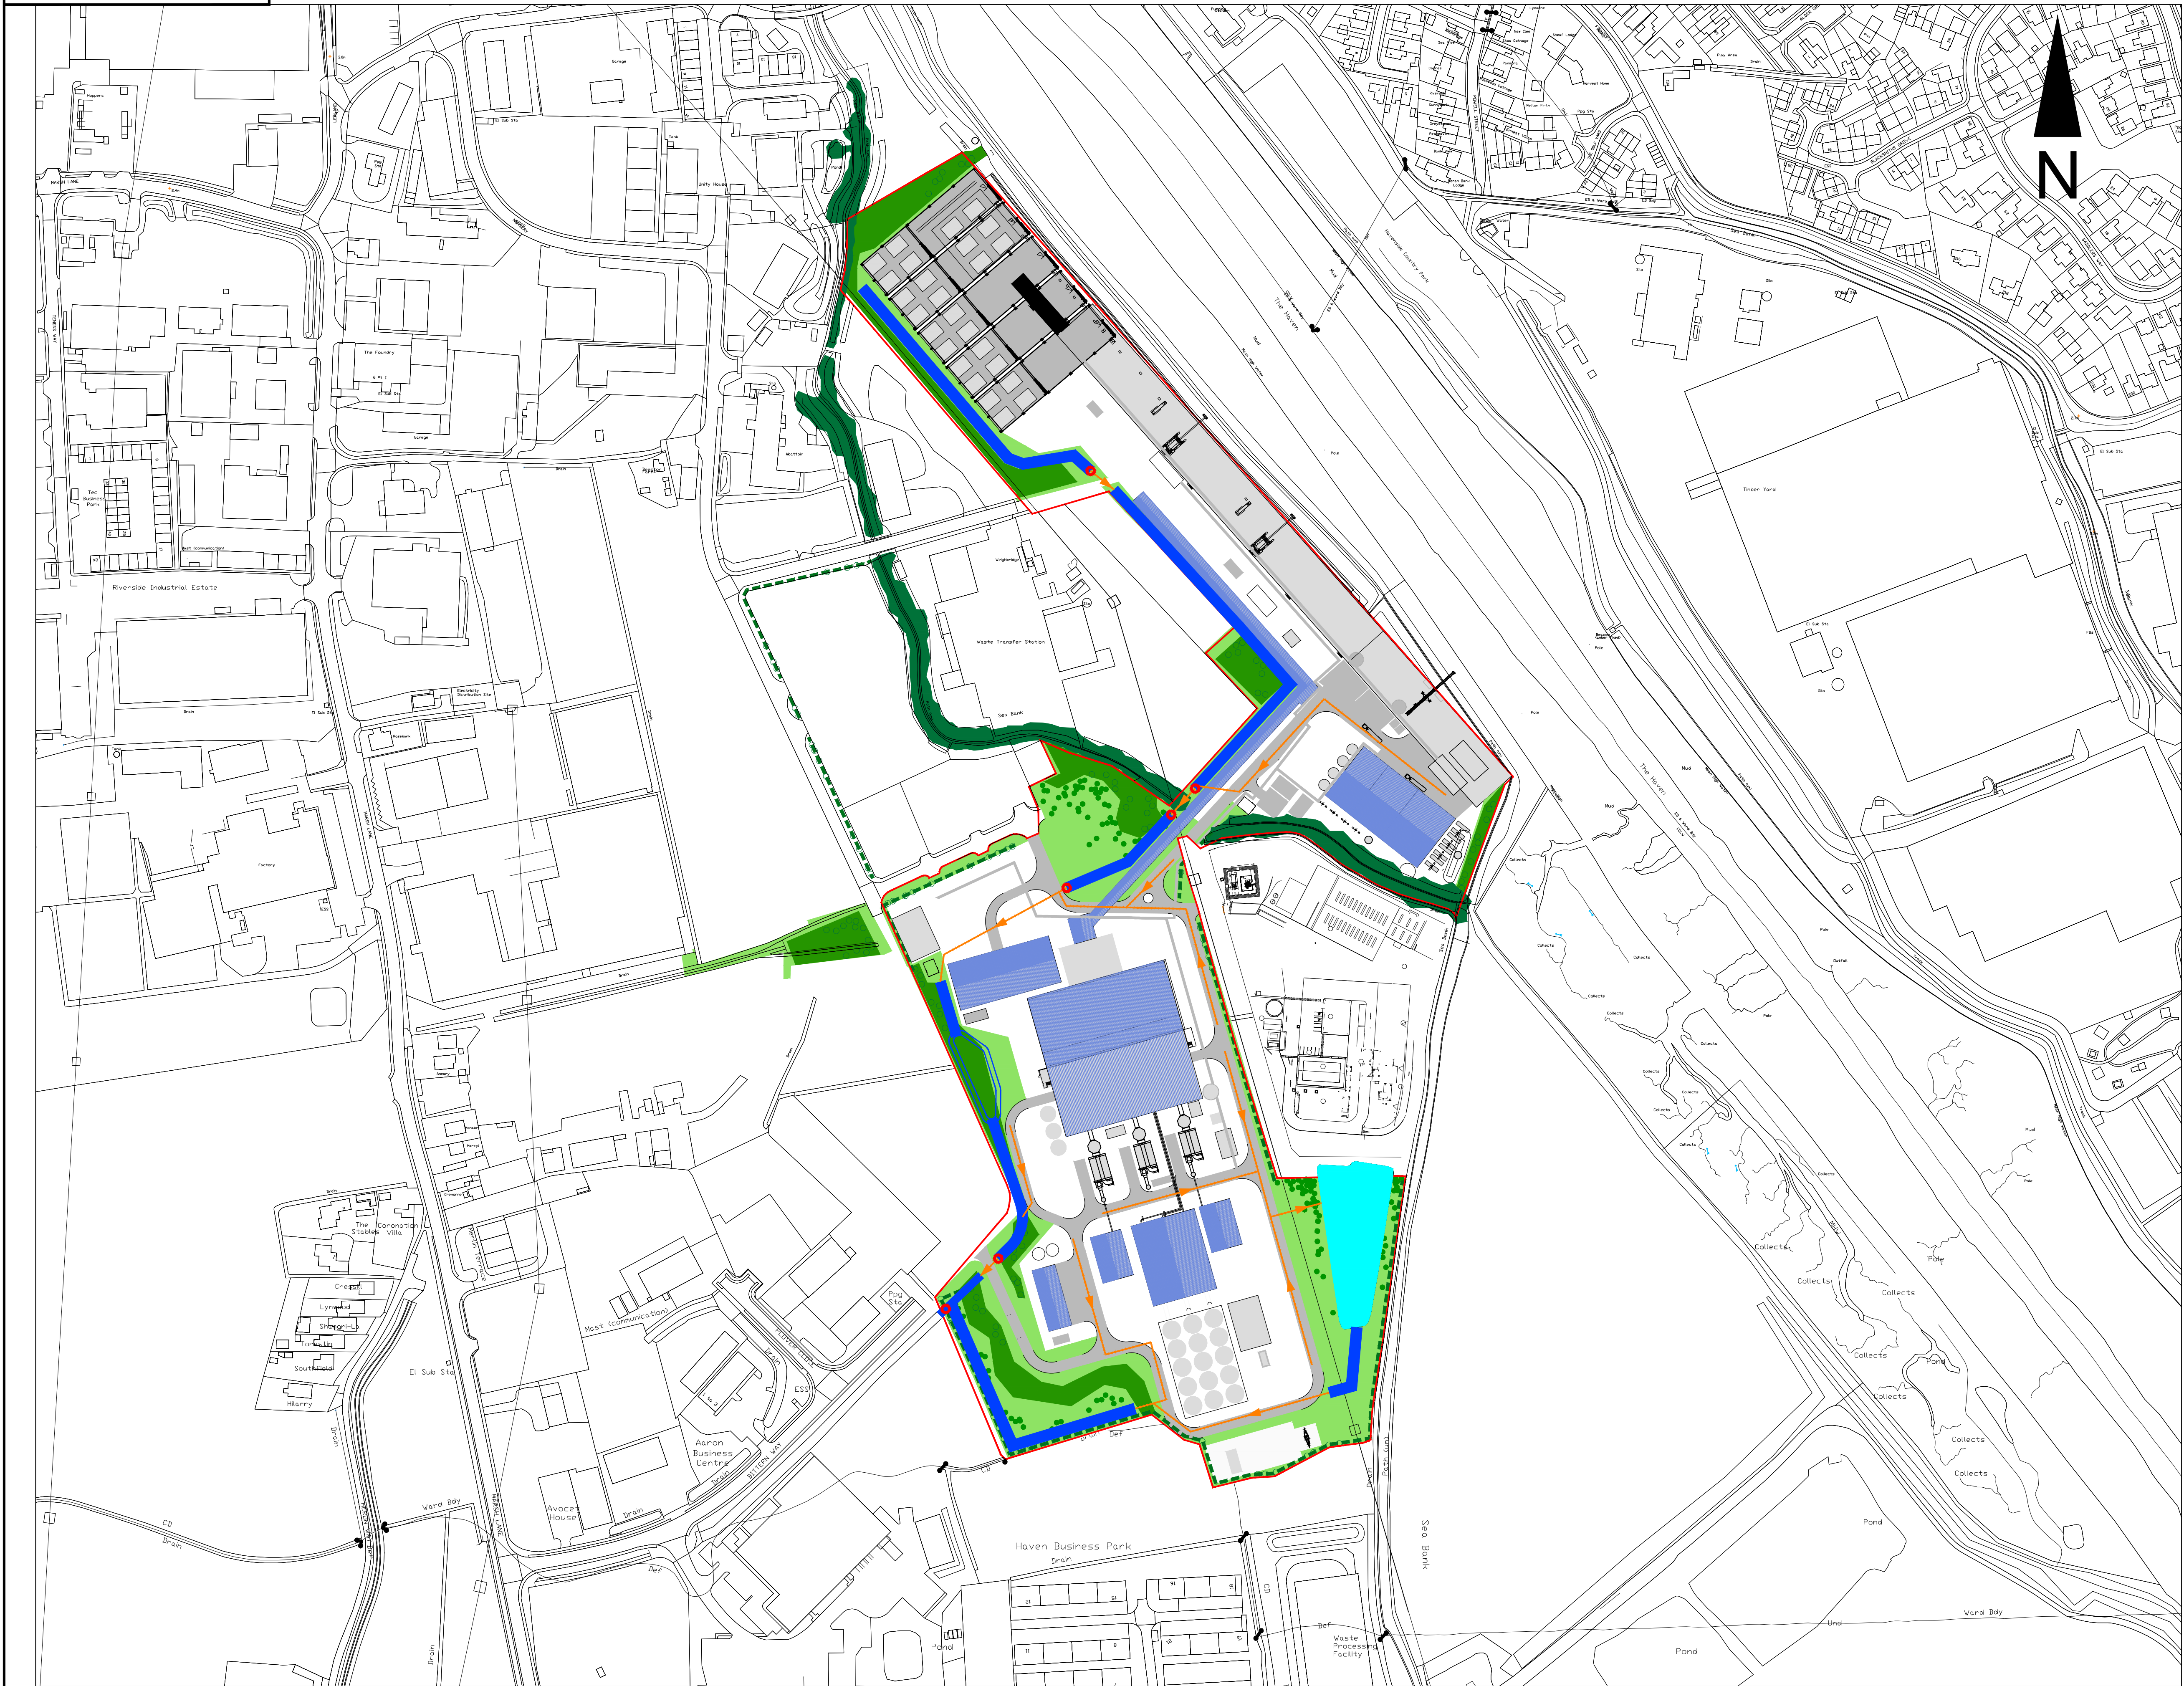PB6934-RHD-XX-ZZ-DR-D-0501





NOTES

- KEY:**
-  CULVERT / PIPE
  -  CONVEYANCE DITCH
  -  ATTENUATION POND
  -  FLOW CONTROL
  -  EXISTING POND

REV	DATE	DESCRIPTION	BY	CHK	APP

REVISIONS

CLIENT

ALTERNATIVE USE  
BOSTON PROJECTS LTD

PROJECT  
BOSTON  
ALTERNATIVE ENERGY FACILITY  
ENVIRONMENTAL STATEMENT

TITLE  
PROPOSED DRAINAGE  
STRATEGY LAYOUT



Rightwell House,  
Bretton  
Peterborough, PE3 8DW  
Tel +44(0)1733 334455  
Email info.peterborough@rhdhv.com  
Website www.royalhaskoning.com

DRAWN	PPV	CHECKED	DJ	APPROVED	PS
DATE	13/08/2021	SCALE	AT A1	1:2000	REF.
DRAWING No.	PB6934-RHD-XX-ZZ-DR-D-0501	SUITABILITY	S2	REVISION	P02