


THIS DRAWING IS TO BE USED ONLY FOR THE PURPOSE OF ISSUE THAT IT WAS ISSUED FOR AND IS SUBJECT TO AMENDMENT

- LEGEND**
- Order Limits
 - Consented Gas Engine Plant (Indicative Boundary)
 - OCGT Power Station Site
 - Noise Sensitive Receptor (NSR)

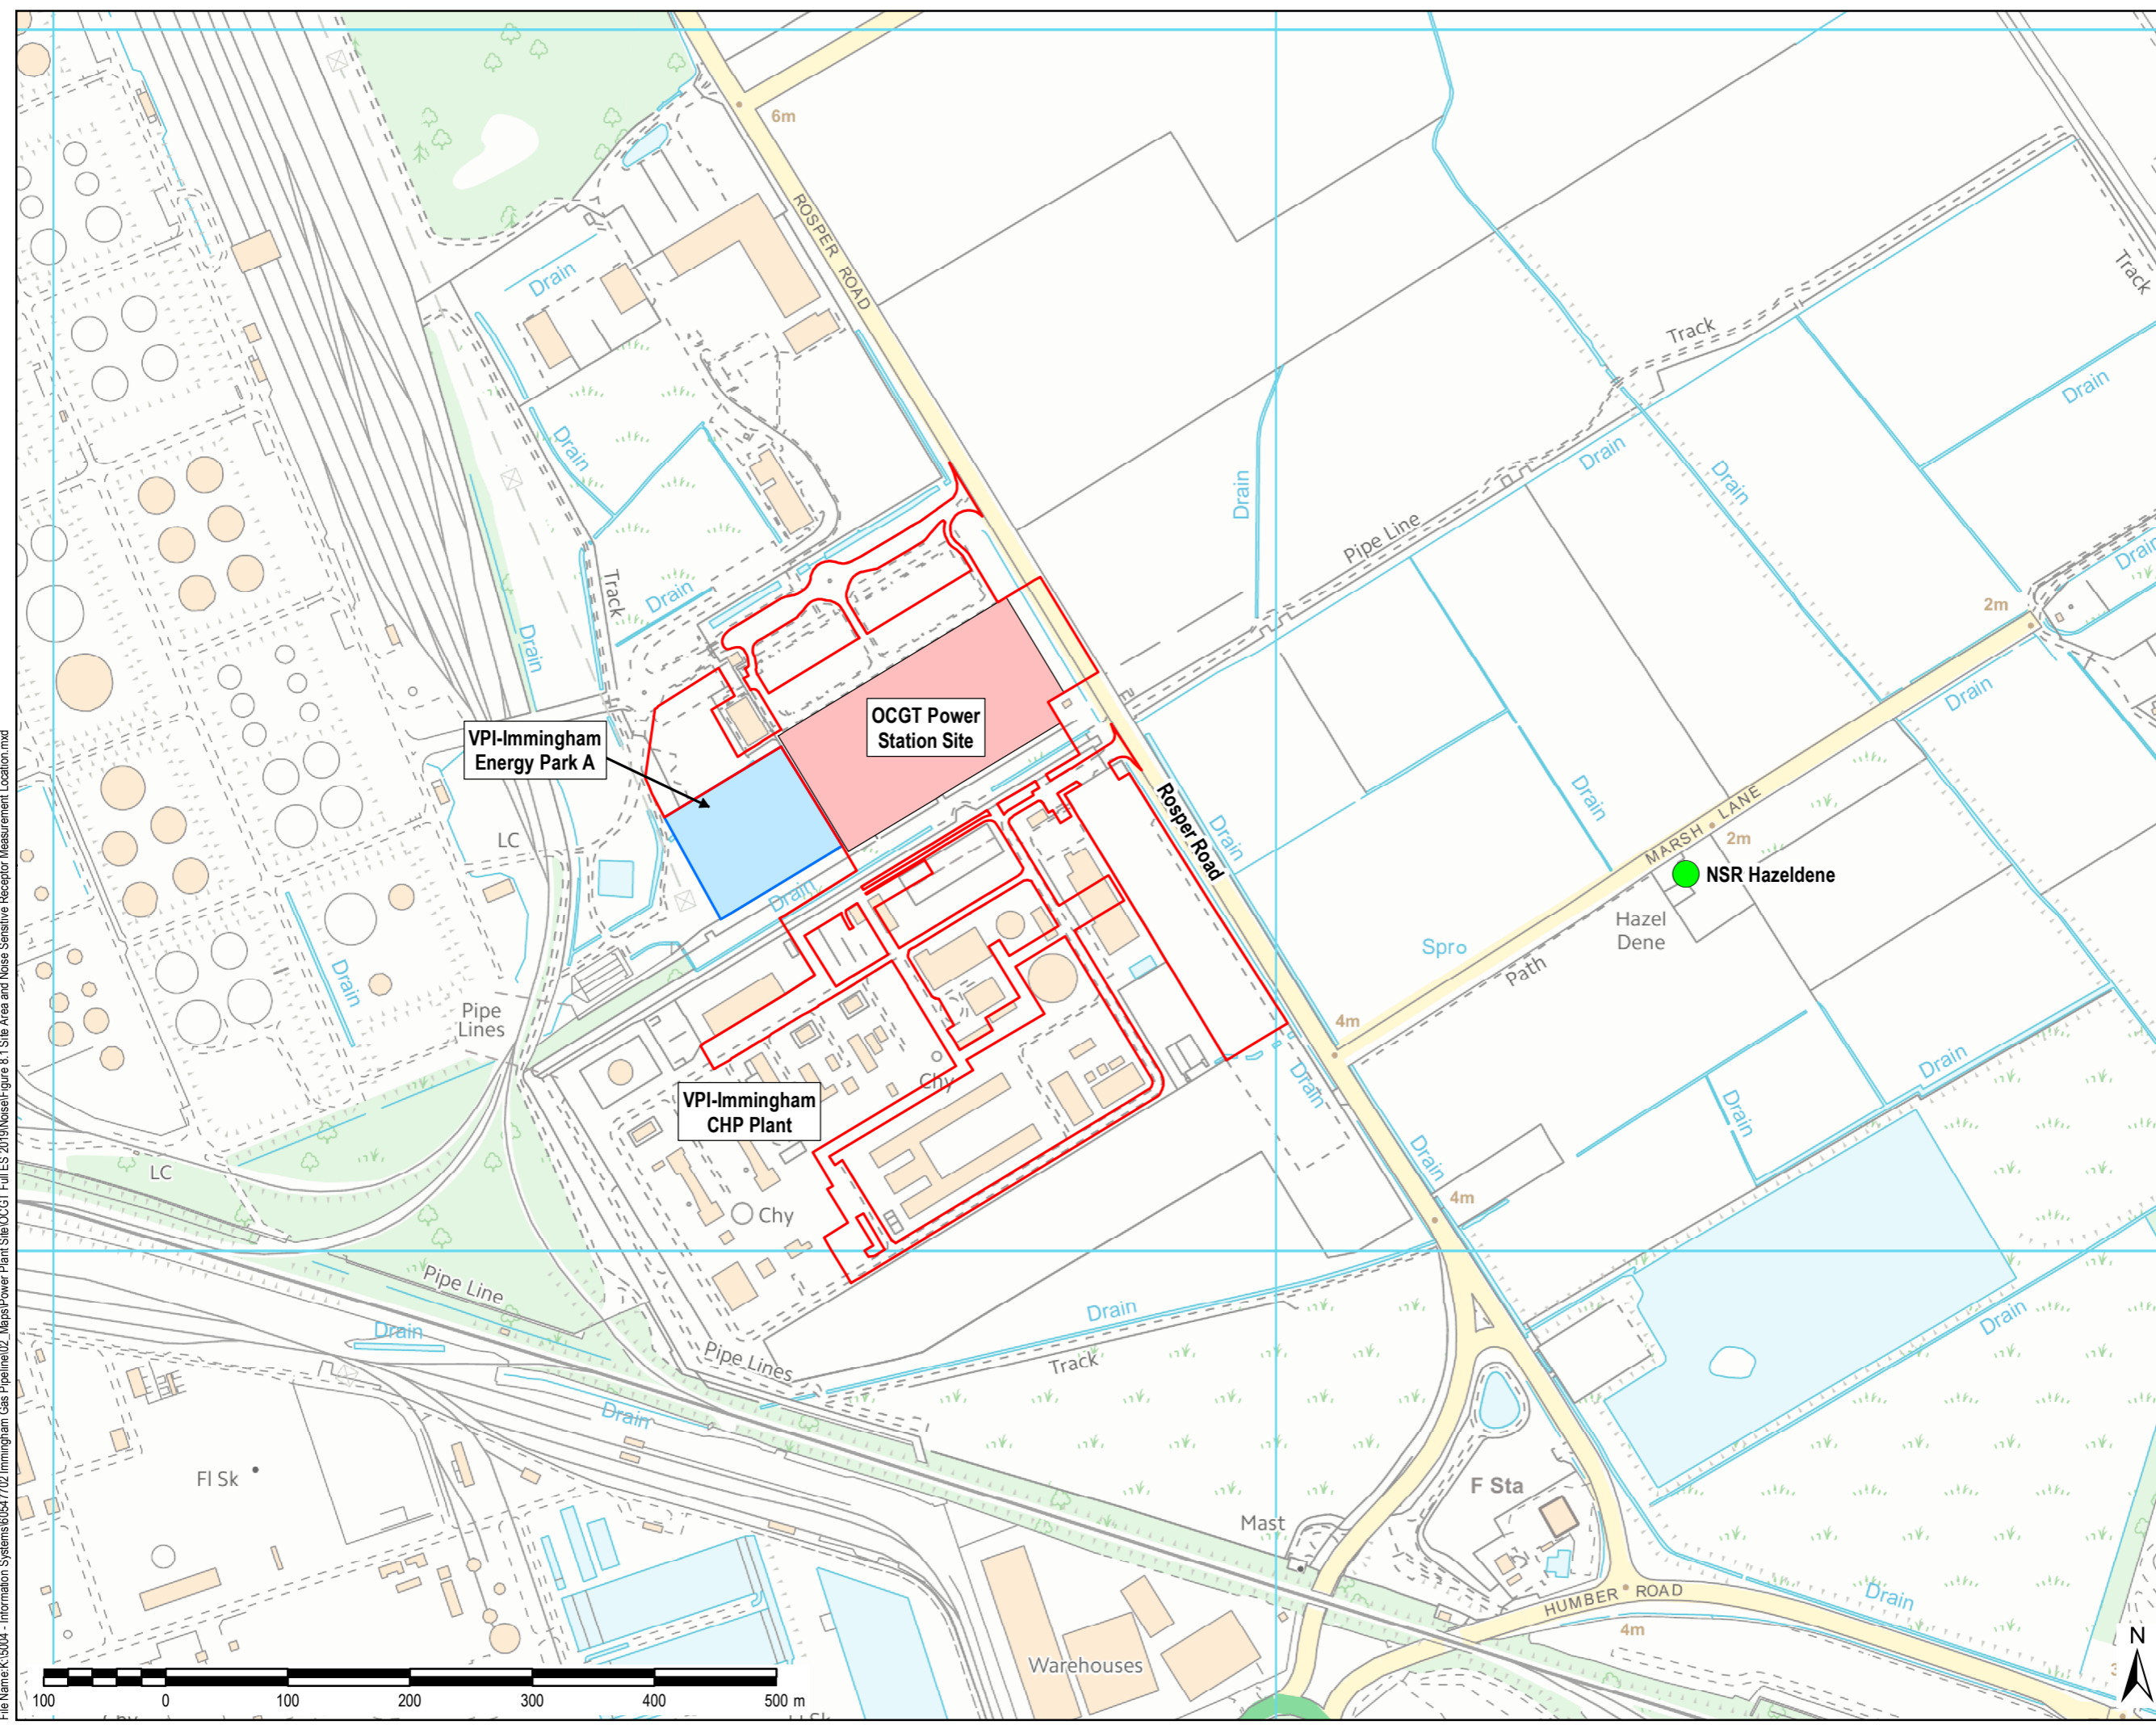

Copyright
 Reproduced from Ordnance Survey digital map data
 © Crown copyright 2019. All rights reserved.
 Licence number 0100031673.

Purpose of Issue
ENVIRONMENTAL STATEMENT

Client
VPI IMMINGHAM B LTD

Project Title
THE VPI IMMINGHAM OCGT PROJECT

Drawing Title
BASELINE NOISE MONITORING LOCATIONS AND SENSITIVE RECEPTORS FIGURE 8.1

| | | | |
|--|---------------|-----------------------|--------------------|
| Drawn JW | Checked SG | Approved MS | Date 05/04/2019 |
| AECOM Internal Project No. 60547702 | | Scale @ A3 1:5,000 | |

THIS DOCUMENT HAS BEEN PREPARED PURSUANT TO AND SUBJECT TO THE TERMS OF AECOM'S APPOINTMENT BY ITS CLIENT. AECOM ACCEPTS NO LIABILITY FOR ANY USE OF THIS DOCUMENT OTHER THAN BY ITS ORIGINAL CLIENT OR FOLLOWING AECOM'S EXPRESS AGREEMENT TO SUCH USE, AND ONLY FOR THE PURPOSES FOR WHICH IT WAS PREPARED AND PROVIDED.

AECOM
 Midpoint
 Alençon Link, Basingstoke
 Hampshire, RG21 7PP
 Telephone (01256) 310200
 Fax (01256) 310201
 www.aecom.com

DCO Document Ref
6.3.12

File Name: K15004 - Information Systems\60547702\Immingham Gas Pipeline\02_Maps\Power Plant Site\OCGT Full ES 2019\Noise\Figure 8.1 Site Area and Noise Sensitive Receptor Measurement Location.mxd

