



# SUNNICA ENERGY FARM

EN010106

Volume 6

8.83 Drainage Technical Note

APFP Regulation 5(2)(e)

Planning Act 2008

Infrastructure Planning (Applications: Prescribed Forms and  
Procedure) Regulations 2009



24 March 2023  
Version number: 01

Planning Act 2008

**The Infrastructure Planning  
(Applications: Prescribed Forms and  
Procedure) Regulations 2009**

## **Sunnica Energy Farm**

### **8.83 Drainage Technical Note**

<b>Regulation Reference:</b>	Regulation 5(2)(e)
<b>Planning Inspectorate Scheme Reference</b>	EN010106
<b>Application Document Reference</b>	EN010106/APP/8.83
<b>Author</b>	Sunnica Energy Farm Project Team

<b>Version</b>	<b>Date</b>	<b>Status of Version</b>
Rev 00	13 January 2023	Submitted at Deadline 5
Rev 01	24 March 2023	Submitted at Deadline 10

# Table of contents

<b>Chapter</b>	<b>Pages</b>
<b>1 Introduction</b>	<b>2</b>
1.1 Scheme Description and Background	2
1.2 Design Assumptions	4
<b>2 Supporting Information</b>	<b>6</b>
2.1 Flood Risk	6
2.2 Existing Drainage	7
2.3 Geology and Hydrogeology	7
<b>3 Proposed Drainage Arrangements</b>	<b>8</b>
3.1 Surface Water Drainage Strategy	8
3.2 Contributing Areas	8
3.3 Greenfield Runoff Rates	10
3.4 Proposed Discharge Rates	10
3.5 Proposed Attenuation	11
3.6 Water Quality	16
3.7 Exceedance Flows	17
3.8 Amenity and Ecological Value of SuDS Features	18
3.9 Impact on Sites of Special Scientific Interest (SSSI) Sites	18
3.10 Fire Water Runoff	18
3.11 Adoption and Maintenance	19
<b>Appendix A Topographic Surveys</b>	<b>20</b>
<b>Appendix B Order limits</b>	<b>21</b>
<b>Appendix C Proposed Attenuation</b>	<b>22</b>
<b>Appendix D Greenfield Runoff Rates</b>	<b>24</b>
<b>Appendix E Maintenance Schedules</b>	<b>25</b>
Infiltration Basins	25
Swales	26
<b>Appendix F Drainage General Arrangements</b>	<b>28</b>
 <b>List of Tables</b>	
Table 1 Flood Risk Summary.....	6
Table 2 Contributing Areas .....	10
Table 3 Greenfield Discharge Rates.....	10
Table 4 Proposed Storage Features .....	13
Table 5 Proposed Storage Features.....	15
Table 6 <i>Assessment against CIRIA C753 The SuDS Manual Sample Index Approach</i> ....	17
 <b>List of Figures</b>	
Figure 1 The Scheme .....	4
Figure 2: Proposed Access Track Detail.....	9
Figure 3: Cam and Ely Ouse Catchment Peak Rainfall allowances (extracted from online catchment mapping, 6 September 2022) .....	12
Figure 4 MicroDrainage Quick Storage Estimate for 1 in 30 yr plus 35% climate change .	13
Figure 5: MicroDrainage 1 in 100 yr plus 40% climate change results.....	15

# 1 Introduction


## 1.1 Scheme Description and Background

- 1.1.1 Sunnica Energy Farm (hereafter referred to as the Scheme) is located within the counties of Cambridgeshire and Suffolk and falling within the administrative areas of East Cambridgeshire District Council (ECDC) and West Suffolk Council (WSC). The location and Scheme components are described in more detail in **Chapters 2 [APP-034]** and **Chapter 3 [REP2-022]** of the Environmental Statement, respectively.
- 1.1.2 The Order limits covers an area of approximately 1,059 hectares (previously 1,113ha), comprising arable fields interspersed with tree shelter belts (linear), small woodland and copses, agricultural fields, and farm access tracks and farm buildings.
- 1.1.3 The previous revision of the Scheme included “Sunnica West Site B” comprising of a maximum developable area of 23.00 ha. This has now been removed due to ongoing consultation.
- 1.1.4 This Drainage Technical Note reflects changes as result of the removal of the developable area in Sunnica West B, in relation to the proposed drainage strategy and the required total surface water attenuation volume across the Scheme
- 1.1.5 As a result of the removal of “Sunnica West Site B”, drainage drawing WPP-ACM-XX-DR-C-ZZ-001 is no longer in use.
- 1.1.6 The proposed Scheme comprises two main sites: Sunnica West Site and Sunnica East Site. The sites are now split into Sunnica East Sites A and B and Sunnica West Site A, all of which are to be connected by Grid Connection Routes A and B to Burwell substation.
- 1.1.7 The maximum developable areas are now as follows:
- a. Sunnica East Site A – 115.0 ha
  - b. Sunnica East Site B – 227.0 ha
  - c. Sunnica West Site A – 256.0 ha
- 1.1.8 Totalling 598.00 ha, the remaining areas (461 ha) will be set aside for environmental and archaeological mitigation and cable routes.
- 1.1.9 The Sites (Sunnica East Site A, Sunnica East Site B, and Sunnica West Site A) will comprise the principal infrastructure as follows:
- a. Solar PV panels;
  - b. PV module mounting structures;
  - c. Inverters;
  - d. Transformers;
  - e. Switchgears;



- f. Cabling (including high and low voltage cabling);
  - g. One or more Battery Energy Storage Systems (BESS) (expected to be formed of lithium ion batteries storing electrical energy) on Sunnica East Site A, Sunnica East Site B and Sunnica West Site A;
  - h. An onsite substation comprising a substation and control building (Sunnica East Site A, Sunnica East Site B and Sunnica West Site A);
  - i. Office/warehouse (Sunnica East Site A and Sunnica East Site B only);
  - j. Fencing and security measures;
  - k. Drainage;
  - l. Internal access roads and car parking;
  - m. Landscaping including habitat creation areas; and
  - n. Construction laydown areas
- 1.1.10 This Drainage Technical Note sets out the outline drainage strategy for the Scheme, with regards to handling surface water generated within the PV panel areas, substation and BESS areas, and supersedes the Drainage Strategy provided in Annex D of the FRA Addendum **[REP4-041]**.
- 1.1.11 The revision takes into account revised rainfall data using FEH, and updates to planning practice guidance (PPG) and climate change allowances, released post DCO submission. Changes to the Drainage Strategy as a result of the Change Application **[EN010106/APP/8.74]** are confined to Chapter 3 (Sections 3.1 to 3.5) of this Note.
- 1.1.12 No drainage is proposed for the cable routes; the cables will be buried, and the routes will be restored to greenfield conditions.
- 1.1.13 This report should be read in conjunction with the FRA **[AS-007 to AS-010]**, FRA Addendum **[REP4-040]** and the FRA Clarification Document in light of Proposed Scheme Changes **[EN010106/APP/8.74]**.

1.1.14 Figure 1 below shows the Order limits.

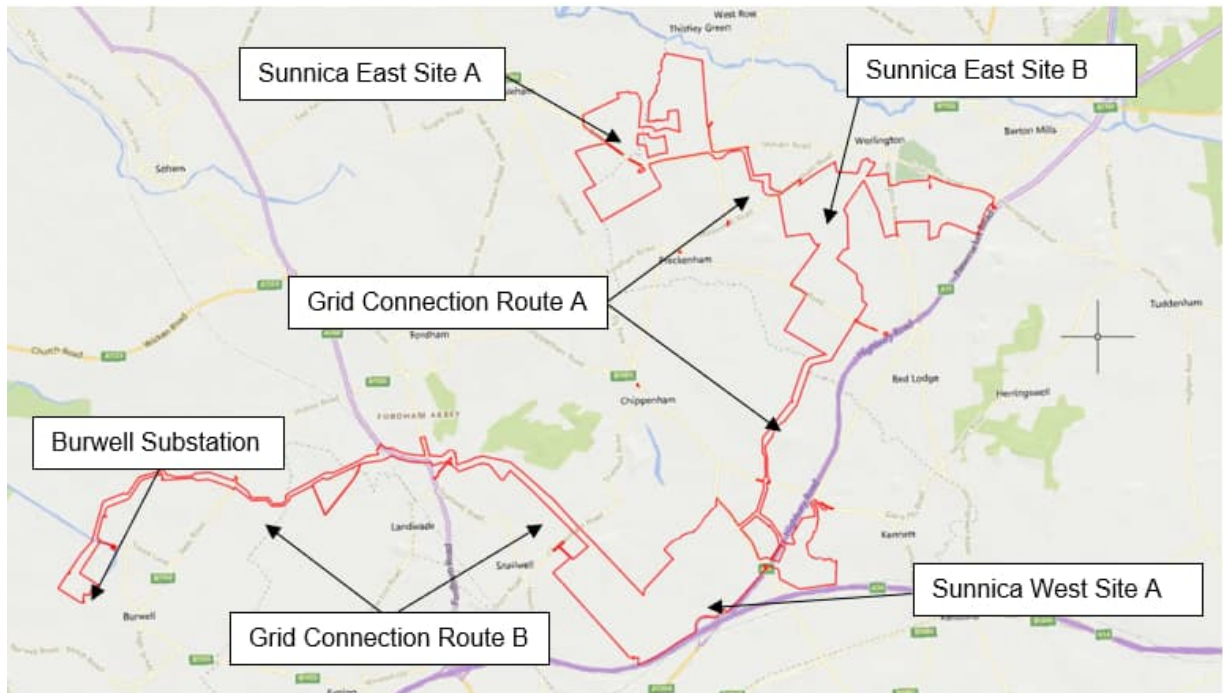

**Figure 1 The Proposed Scheme**

## 1.2 Design Assumptions

1.2.1 The following design assumptions have been used to produce this assessment, as set out in the previous Drainage strategy report, as Annex F to FRA [AS-010] and as Annex D to the FRA Addendum Report [REP4-041].

- a. Existing levels for the areas listed in 1.1.8 have been taken from drone topographical survey conducted by Above Surveying Ltd on behalf of Sunnica Ltd.
- b. Due to the size of the Order limits and the developable areas, a ground investigation is cost prohibitive at this stage. Instead, information on the Site's ground conditions have been determined through a desktop study: British Geological Survey (BGS) show the majority of the south of the site lies within the Holywell Nodular Chalk Formation and Woburn Sands Formation, whilst the majority of the north of the site (Sunnica East sites A and B) lies in the Zig Zag Chalk Formation. Where the BGS had information on Superficial Deposits, they indicate areas of sand and gravel.
- c. An infiltration rate of  $1 \times 10^{-5}$  m/s has been assumed. This is based on a conservative infiltration rate estimation for soil suitable for infiltration, referenced from CIRIA SuDS Manual (C753).
- d. The drainage system has been designed to accommodate the 1 in 100-year storm, plus a 40% allowance for an increase in peak rainfall intensity due to climate change.
- e. A Volumetric Runoff Coefficient ( $C_v$ ) of 1 has been used in this design. The percentage impermeable area (PIMP) value was assumed to be 10% equivalent for the solar fields and 100% for compound areas and 100% for the BESS areas.

- f. All swale features will avoid all archaeological sites and will maintain a minimum 10m buffer to watercourses and sensitive sites.
- g. No permanent water features are proposed. Surface water runoff will largely collect at existing low spots and infiltrate to ground, as existing. Bird strike risk from nearby aviation sites precludes any permanent water feature as part of the SuDS strategy
- h. FEH catchment data has been applied to the calculations.
- i. In accordance with BRE 365, a minimum of 1m should be provided between the base on any infiltration system and the groundwater table to allow for fluctuations in the groundwater level and to protect groundwater quality. As groundwater levels are not fully known at this stage, proposed infiltration attenuation features have been kept shallow (maximum depth of 600mm) to lower the possibility of encountering groundwater. Assumptions are also referred from Chapter 9 for anticipated ground conditions.

## 2 Supporting Information

### 2.1 Flood Risk

- 2.1.1 The potential flood risk to the Scheme, is summarised in Table 1 below. For further detail on the site's potential flood risk, refer to the Flood Risk Assessment (**Appendix 9C** of the Environmental Statement [**AS-007 to AS-010**] and the Flood Risk Assessment Addendum [**EN010106/APP/8.67**]).

**Table 1: Flood Risk Summary**

Flood Risk Source	Pre-Scheme Risk	Post Scheme Risk	Comments
Fluvial	Low (Residual)	Low	The majority of the Order limits are within Flood Zone 1, but certain areas lie in Flood Zone 2, 3a, 3b. No permanent above ground development will occur in Flood Zone 3b. Residual risk of PV panels within Flood Zone 3a has been taken into account with PV panels raised by up to 100mm above the ground level.
Tidal	Very Low	Very Low	Not in a tidal area
Pluvial (Surface Water)	Low	Low	Surface water risk varies throughout the Order limits indicating patches of the Order limits which are susceptible to surface water flooding. However, flooding is localised and generally shallow (low risk).
Groundwater	Medium	Medium	Groundwater risk also varies, with all Sites between <25% and >75%, therefore further ground investigation, groundwater monitoring and infiltration testing is proposed to confirm groundwater levels. Furthermore, both the Sunnica East Site B and Sunnica West Sites A and B Sites are shown to be within a Source Protection Zone III, with small areas of Source Protection Zone II. Therefore, infiltration techniques must ensure mitigation measures are put in effect to protect groundwater interaction in these areas.
Sewers	Low	Low	Sewer flood risk remains low
Artificial Sources	Low (residual)	Low (residual)	Statutory Reservoirs (large raised reservoirs with volumes above ground of 25,000m <sup>3</sup> or over) are regularly inspected and maintained as set out in the Reservoirs Act 1975. On that basis they are deemed to pose a low (residual) risk.  Other artificial sources such as canals and waterways are considered to be regularly maintained and therefore only deemed to pose a low (residual) risk to the Scheme

## **2.2 Existing Drainage**

2.2.1 The area within the Order limits is largely greenfield. It consists of individual trees, hedgerow, tree belts (linear) small woodland block, agricultural fields (arable) and farm access tracks. There is currently no formal piped drainage system within the Order limits. It is assumed that for low intensity rainfall events, rainfall would infiltrate to ground where it lands. For rainfall events where rainfall intensity exceeds the local rate of infiltration, it is assumed that any runoff generated within the Order limits would naturally flow overland to low spots within the Order limits where it would collect and infiltrate as the event subsides. Where parts of the Order limits interact with watercourses, excess runoff will naturally drain from the catchment into the watercourse.

## **2.3 Geology and Hydrogeology**

2.3.1 The bedrock and superficial geology for the area has been identified from mapping produced by the British Geological Survey. These maps indicate Superficial Deposits are absent for portions of the site. However, there are areas of sand and gravel from Glacial River Terrace Deposits throughout portions of the Order limits.

2.3.2 The Bedrock covering the majority of the south of the site is Holywell Nodular Chalk Formation and New Pit Chalk Formation, whilst the majority of the north of site is the Zig Zag Chalk Formation. Both bedrock geologies are chalk member formations.

2.3.3 The EA's Online Interactive Maps for Groundwater shows the site is situated partly within a Groundwater Source Protection Zone 3 (Total Catchment Zone). An SPZ typically means there is an underlying aquifer supplying a borehole for potable use.

## 3 Proposed Drainage Arrangements


### 3.1 Surface Water Drainage Strategy

- 3.1.1 As previously mentioned, the Scheme is largely a greenfield site. It is considered that rainfall will mostly permeate into the ground where it falls and that any runoff generated within arable fields collects in local low spots where it infiltrates to ground or enter a watercourse as appropriate where the site drainage interacts with one. The proposed surface water drainage strategy for the Scheme areas noted in section 1.1.8 of this report aims to mimic the natural drainage conditions of the site as much as possible.
- 3.1.2 The proposed solar PV panels will be held above ground individually on narrow diameter piled legs (<100mm diameter). This prevents sealing the ground with an impermeable surface beneath solar panels allowing rainfall/runoff to infiltrate to ground throughout the Sites. As a result, it is considered that the site's impermeable area will remain consistent to its pre-development state.
- 3.1.3 To prevent ponding occurring around the solar panels or overland flow routes directing runoff off site, a series of swales and infiltration basins will be constructed within the solar PV panel fields in identified low spots throughout the Sites to collect and store runoff, allowing it to infiltrate to ground. The locations of the proposed swales and detention basins can be seen in outline drainage drawings WPP-ACM-XX-DR-C-ZZ-001 to WPP-ACM-XX-DR-C-ZZ-008, in Appendix F. Detailed drainage designs and SuDS feature locations will be determined post consent at detailed design stage.
- 3.1.4 Throughout the Sites, there are several areas demarcated as archaeology or heritage areas that will not contain solar PV panels or associated infrastructure. No drainage infrastructure is proposed for these areas. Swales or infiltration basins will be positioned to prevent any runoff from the solar panel fields flowing into these areas. Drawings WPP-ACM-XX-DR-C-ZZ-001 to WPP-ACM-XX-DR-C-ZZ-008 annotate the outline locations of these features, to be confirmed at detailed design, post consent. Within Sunnica East Sites A and B and Sunnica West Site A, there will also be compound areas and BESS and on-site substations that have an impermeable surface. The outline design of swales and detention basins have been sized to demonstrate there is sufficient capacity available to accommodate the increased runoff from these areas.

### 3.2 Contributing Areas

- 3.2.1 The total area contributing to the proposed drainage system is presented in Table 2 below. In calculating this area, the following assumptions were made:
- Heritage, Archaeological Mitigation, Ecology Enhancement and Proposed Woodland areas were deemed to contribute 0% of their total area to runoff.
  - Access tracks will be permeable, as set out in Section 3.5.61 of Scheme Description [REP2-022] and as noted in NPS EN-2 paragraph 2.50.7. Access tracks will be constructed within each of the Sites. These will be compacted stone tracks up to 3.5m wide with 1:2 gradient slopes on either side. As a result these will not contribute a net increase in peak surface water runoff. Figure 2 below, taken from the Scheme Description, indicated the access track detail:



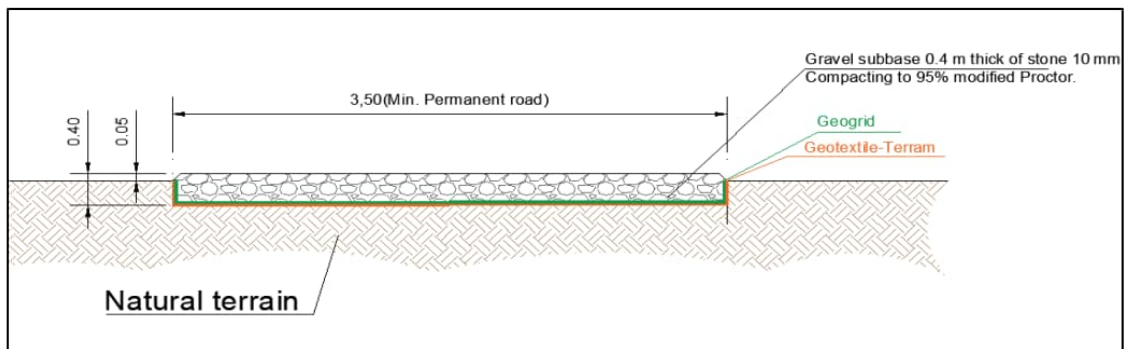

**Figure 2: Proposed Access Track Detail**

- c. Compound areas would contribute 100% runoff with BESS and Substation areas were deemed to contribute 100% of their total area to runoff.
- d. As the solar panel fields are greenfield areas, the contributing area for calculations was pro-rata'd to represent an effective impermeable area in order to calculate runoff volumes using the MicroDrainage software, as it only allows impermeable areas to be included in the calculation. It is generally accepted that 10% of the greenfield area would be a fair representation of the equivalent impermeable area to input into MicroDrainage or other modelling software, to enable a model to analyse greenfield runoff (modelling software does not inherently facilitate greenfield areas as a positive drainage catchment; drainage software defaults to impermeable contributing areas only (i.e. 100% impermeable). As previously mentioned, the solar PV panels will be held above ground on four-legged stands. This will allow most rainfall to infiltrate to ground within the solar PV fields.
- e. Cable routes were not deemed to contribute any runoff to the drainage system. The proposed cable will be buried, and the greenfield conditions will be restored.

**Table 2: Contributing Areas**

Sites	Area (ha)	Pre-Development PIMP* (%)	Post-Development PIMP* (%)	Post Development Greenfield Contributing Area (ha) as Effective Impermeable area	Post-Development Impermeable Areas (ha) (BESS / Compound Areas)	Effective combined Post-Development Contributing Area (ha) to proposed drainage system **
<b>Sunnica East Sites A and B</b>	542	0%	7%	27.7	9.1	36.8
<b>Sunnica West Site A</b>	373	0%	14%	28.2	25.1	53.3
<b>Cable Routes</b>	144	0%	0%	0	0	0
<b>TOTAL</b>	<b>1,059</b>				<b>TOTAL</b>	<b>90.1</b>

\*- Percentage Impermeable (PIMP)

\*\*- Includes Solar Panel Sites and

### 3.3 Greenfield Runoff Rates

3.3.1 The equivalent greenfield runoff rates for the site have been calculated for the site using HR Wallingford's UKSuDS Greenfield Runoff Rate Estimation tool based on the proposed contributing impermeable area. These rates are shown in Table 3.

**Table 3: Greenfield Discharge Rates**

Return Period (years)	Discharge Rate (l/s) (1,059 ha)
1	83.61
Qbar	96.10
30	235.45
100	342.12

### 3.4 Proposed Discharge Rates

3.4.1 As mentioned earlier, it is not intended to discharge surface water runoff off-site. Instead any surface water runoff generated within the Sites will be disposed of via infiltration to mimic existing conditions. As a full ground investigation for the entire site would be cost prohibitive at this stage, the site's infiltration potential has been assessed based on the desktop study.

3.4.2 As previously discussed, the vast majority of Sites lies in areas of sand and gravel atop chalk; ground material typically associated with good infiltration rates. As a conservative approach, the Sites infiltration rate has been modelled with an infiltration rate of  $1 \times 10^{-5}$ m/s. The percentage of impermeable area for compound areas, BESS and on-site substations has not yet been confirmed; detailed layouts will be re-assessed post planning to ensure the SuDS strategy

and required attenuation is provided. Taking a conservative approach, at present it is assumed 100% impermeable area for site compounds and sub-stations, and 100% impermeable for BESS areas, to account for fire water capture and runoff. Increases to existing contributing area are to be balanced by infiltration techniques, with exceedance flows captured by surrounding swales.

### 3.5 Proposed Attenuation

- 3.5.1 Attenuation will be required onsite to temporarily store any surface water runoff generated within the site boundary before it is infiltrated to ground. Attenuation will be provided in the form of swales and infiltration basins. These features will be strategically located based on existing overland flow routes to capture runoff. The swales/infiltration basins will be 600 mm deep with minimum 1 in 3 side slopes. Check dams will be placed strategically within swales to optimise their storage potential on steeper slopes. Where the attenuation lies within the solar field, the legs of the solar panel will be extended so that the solar panel lies above any potential flooding. The outline strategy presents locations for attenuation, which will be refined during detail design, post consent.
- 3.5.2 The Scheme will provide minimal alterations to the existing topography and ground conditions on-site. It was therefore assumed a portion of runoff generated would infiltrate to ground before it reached a proposed storage feature or would become trapped in a local low spot. As such, it was decided that the upper estimate for the storage volume required would result in redundant storage. The required storage volume was therefore based on the average of the upper and lower estimate. The total storage to be provide onsite is presented in Table 4 below. For a detail breakdown of the storage to provide for each catchment, refer to Appendix C.
- 3.5.3 Revised Planning Practice Guidance on the changes to climate change allowances to peak rainfall was published in May 2022, post DCO submission, for application of climate change allowances for the 1 in 30 year event, as well as the climate change allowance for the 1 in 100 year event.
- 3.5.4 The revised guidance has mimicked the changes to the fluvial flood risk approach to climate change allowances, which are now based on river catchment areas, as discussed in the submitted FRA [**AS-007 to AS-010**].
- 3.5.5 The drainage strategy has been revised to take into account relevant latest guidance.
- 3.5.6 The sole river catchment that the Scheme falls within is the Cam and Ely Ouse catchment. Figure 3 below notes the climate change allowances for the Cam and Ely Ouse:

## Cam and Ely Ouse Management ⊗ Catchment peak rainfall allowances

### 3.3% annual exceedance rainfall event

Epoch	Central allowance	Upper end allowance
2050s	20%	35%
2070s	20%	35%

### 1% annual exceedance rainfall event



Epoch	Central allowance	Upper end allowance
2050s	20%	40%
2070s	25%	40%

\*Use '2050s' for development with a lifetime up 2060 and use the 2070s epoch for development with a lifetime between 2061 and 2125.

**Figure 3: Cam and Ely Ouse Catchment Peak Rainfall allowances (extracted from online catchment mapping, 03 January 2023)**

#### 1 in 30 year Runoff Assessment

- 3.5.7 Assessing the 1 in 30 year return period event plus 35% climate change scenario, the calculation was run with FEH data, instead of FSR previously used, in response to statutory consultee comments.
- 3.5.8 The 'Quick Storage Estimate' tool provides an upper and lower estimate for the storage volume required, as shown in Figure 4, using FEH data (obtained September 2022).

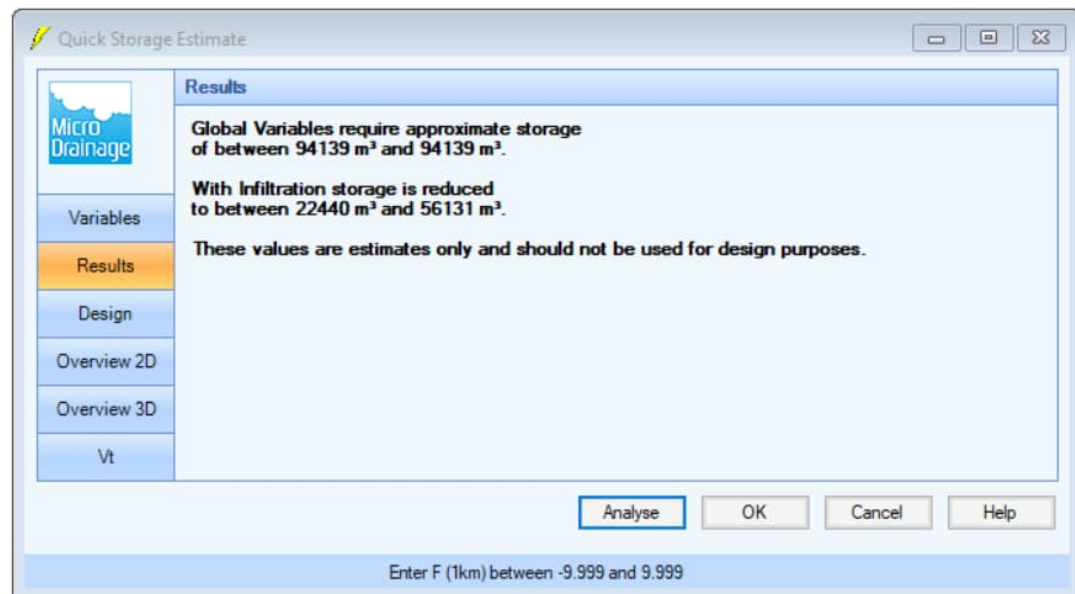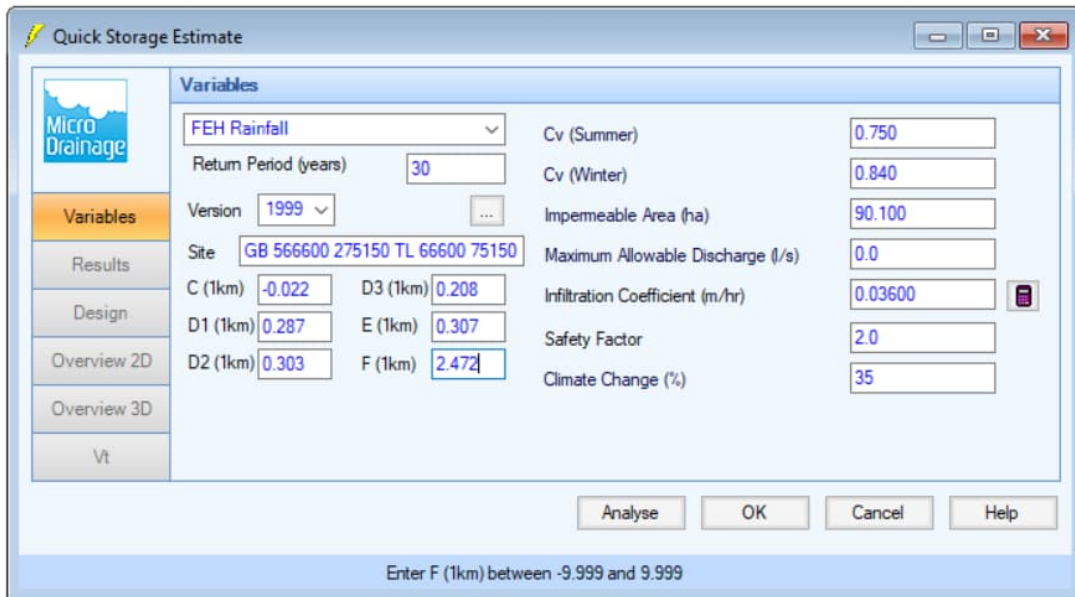

**Figure 4: MicroDrainage Quick Storage Estimate for 1 in 30 yr plus 35% climate change**

3.5.9 Table 4 below summarises the 1 in 30 year attenuation volumes, compared to the available attenuation within the Scheme, based on infiltration, as per the original principals of the strategy.

**Table 4: Proposed Storage Features**



Total storage required (m <sup>3</sup> ) 1 in 30 year + 35% Climate Change	Total storage provided (m <sup>3</sup> )
22,440 to 56,131 (39,286 average)	55,470

3.5.10 The results indicate there is sufficient storage within the system, to provide an additional 16,184 m<sup>3</sup> capacity in the event of a 1 in 30 year event including an allowance for climate change. This is considered to provide a robust level of capacity.

### **1 in 100 year Runoff Assessment, including 40% Climate Change**

- 3.5.11 For the 1 in 100 year return period event, the Upper End climate change allowance of 40% has not changed, based on the 2070s epoch for the development lifetime as a worst case approach.
- 3.5.12 The calculation was run with FEH data, instead of FSR previously used, in response to statutory consultee comments.
- 3.5.13 FEH data can often provide higher runoff values than FSR, for larger catchment analysis and longer duration storm events. This can be due in part to more recent rainfall data and data from more rainfall gauges than older FSR data. In this case, the higher runoff rates lead to higher attenuation requirements.
- 3.5.14 Subsequently, the drainage strategy has been reviewed in terms of swales and detention basins, to review and potentially increase attenuation for the FEH analysis for the developable areas referenced in section 1.1.8 of this report, and to take into account the removal of Sunnica West Site B in these calculations. Refer to Figure 5 and Table 5 below for results, Annex A for revised table of swale and basin volumes, and Annex B for the revised Drainage Strategy Plans that reflect increases swales and basins as required; the Order limits are not space limited; therefore, additional volumes can be provided at detailed design if required.



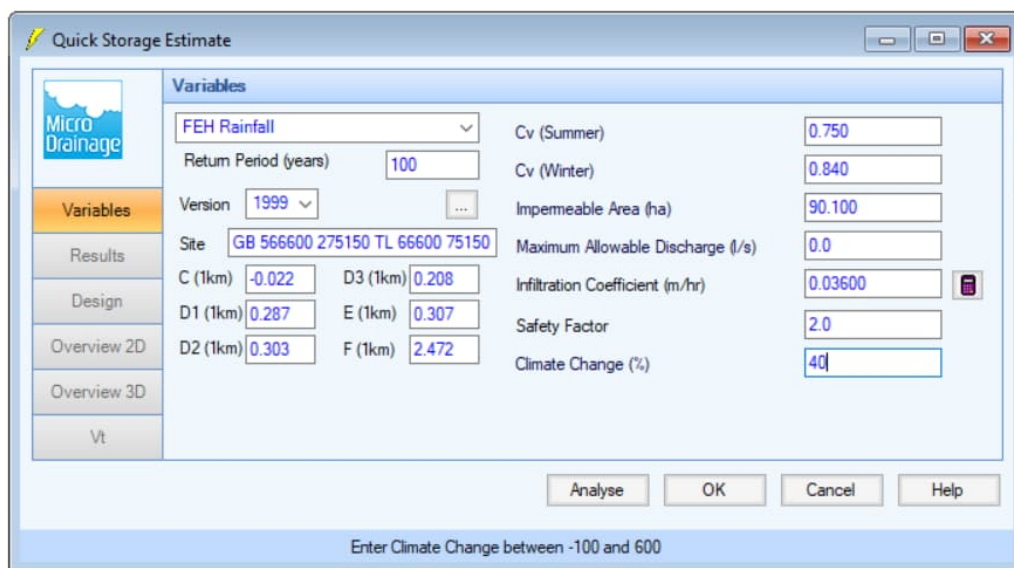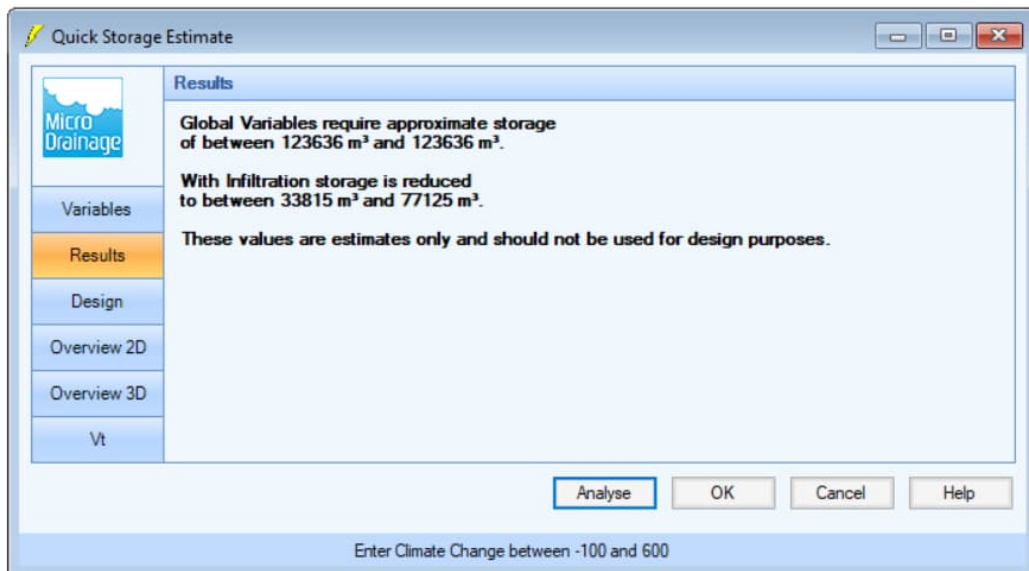

**Figure 5: MicroDrainage 1 in 100 yr plus 40% climate change results**

**Table 5: Proposed Storage Features**

Total storage required (m <sup>3</sup> ) 1 in 100 year + 40% Climate Change	Total storage provided (m <sup>3</sup> )
33,815 to 77,125 (55,470 average)	55,470

- 3.5.15 The results using FEH indicate the proposed total storage volume provides sufficient attenuation for the worst case event, including allowance for climate change.
- 3.5.16 As a result of the revised drainage assessment, the Scheme does not increase flood risk elsewhere.
- 3.5.17 In conclusion, it is considered that for both the 1 in 30 year event and the 1 in 100 year event, both including climate change, the drainage strategy complies with the revised Scheme layout.

### **Four Pillars of Sustainable Drainage Systems (SuDS)**

- 3.5.18 The latest planning practice guidance places an emphasis on SuDS, with clear evidence to be provided to justify that the use of SuDS would be inappropriate.
- 3.5.19 The definition of SuDS in the guidance now means the 4-pillars need to be considered. The 4 pillars of SuDS are:
- a. Water Quality
  - b. Water Quantity
  - c. Amenity
  - d. Biodiversity
- 3.5.20 Below ground storage is not proposed as part of the drainage strategy of the Scheme. Above ground swales and attenuation basins that mimic the natural, existing, runoff regime are proposed.
- 3.5.21 Swales provide natural water quality improvement by trapping and treating pollutants as they travel in the swale.
- 3.5.22 Amenity value applies to use of features for public amenity; as the PV panel areas will be on private land not open to the public.
- 3.5.23 The drainage strategy has shown that it provides sufficient quantity of attenuation to ensure flood risk is not increase on site or elsewhere, with additional capacity for exceedance events provided within the swales.

## **3.6 Water Quality**

- 3.6.1 CIRIA C753 The SuDS Manual states that “SuDS provide an opportunity to capture and treat runoff by intercepting, filtering, and degrading pollutants, and by reducing the volume of potentially contaminated water...while at the same time conveying, storing and infiltrating surface water to protect flood risk, river morphology and water resources, and delivering amenity and biodiversity value for the development”. In order to assess the risk to receiving watercourses an assessment has been undertaken of the proposed surface water drainage system in accordance with the SuDS manual. This is a simplistic method that can be used to assess the level of treatment a drainage system could potentially provide to captured surface water runoff.
- 3.6.2 This method is known as the Simple Index Approach; it states the following:
- Total SuDS Mitigation Index  $\geq$  Pollution hazard index
- 3.6.3 The SuDS manual only provides a limited number of land uses. The land uses in Table 6 below were chosen as the most suitable components of the Scheme. The pollution hazard indices for solar PV panels were based on residential roofs as the outside casing of the panel is constructed from glass and is unlikely to create a significant pollution risk (no oil / fluid is present in the panels etc).

- 3.6.4 Surface water runoff from the solar PV panel fields, compound areas, BESS and substation areas will drain runoff overland to either swales or infiltration basins. From here, runoff will infiltrate to ground. Table 6 below lists the pollutant hazard indices and mitigation indices used as part of the Simple Index Approach (SIA) and demonstrates the proposed SuDS are sufficient to treat the Scheme runoff.
- 3.6.5 The impermeable areas chosen within the simple index method below consist of the solar PV panels and the low traffic roads and non-residential car parking with infrequent movements. The areas containing BESS and transformers are contained within the 'low traffic roads' as they are self-contained containers or bunded areas. Under normal operation, runoff from these areas is considered to be low risk as it will be treated as roof / road runoff.
- 3.6.6 Firefighting water, and its potential containments, is not included here as any fire water applied to BESS areas would be contained within a separate lagoon structure and removed from site via controlled methods (e.g. tanker) if the water is polluted, i.e. it will not drain into the surface water drainage network without prior testing to confirm it is clean water (*please see section below on Fire Water Runoff*).

**Table 6 Assessment against CIRIA C753 The SuDS Manual Sample Index Approach**

Land use	Pollution Hazard Indices			
	Pollution Hazard Level	Total Suspended Solids (TSS)	Metals	Hydrocarbons
Solar PV panels*	Very Low	0.2	0.2	0.05
Low Traffic roads and non-residential car parking with infrequent change (i.e. <300 traffic movements/day)**	Low	0.5	0.4	0.4
<i>Total Pollution index</i>		0.7	0.6	0.45
<i>*The pollution hazard indices for solar panels has been based on residential roofs.</i>				
<i>**Compound areas and substation areas</i>				
Type of SuDS Component	Mitigation indices			
	TSS	Metals	Hydrocarbons	
Swales	0.5	0.6	0.6	
Infiltration Basin	0.5	0.5	0.6	
Total Mitigation Index	1.0	1.1	1.2	

- 3.6.7 From the above assessment the results are calculated, a pass is where the total mitigation index is greater than the pollution hazard index. According to the SIA, with the provision of swales and infiltration basins, there is adequate treatment being provided for the key pollutants considered by the SIA of the SuDS manual (i.e. TSS, metals and hydrocarbons).

### 3.7 Exceedance Flows

- 3.7.1 The proposed surface water drainage network has been designed to accommodate runoff from all storms up to and including the 100 year +40% return

period. For an extreme storm event, any exceedance flows that cannot be retained by the proposed attenuation flow overland, following the existing topography, where ultimately, they will be contained within the SuDS features. The swale capacity can theoretically contain the 1 in 100 year runoff event, including climate change with little to no infiltration.

### **3.8 Amenity and Ecological Value of SuDS Features**

- 3.8.1 Due to the nature of the Scheme, personnel involved in the Scheme will have minimal interaction with the proposed drainage features. Consequently, the potential amenity benefit provided by the drainage is not considered relevant to the design. The design of the drainage, however, will be discreet so that it does not hinder the aesthetic value of the Sites.
- 3.8.2 Incorporating swales and infiltration basins within the Sites should maintain some ecological value within the fields that may be lost from the introduction of solar panels.

### **3.9 Impact on Sites of Special Scientific Interest (SSSI) Sites**

- 3.9.1 Drainage is primarily designed to intercept increased impermeable area runoff from the Sites. Solar panel field runoff has been treated as greenfield runoff. Surface water is to be collected and treated in Swales to improve water quality and largely infiltrate to ground as per existing regime. Excess flows will enter the watercourses, although regular inflows may be less from these solar panel areas, i.e. there is an overall presumption of reduced flood risk downstream through the proposals.

#### **Snailwell Fen SSSI**

- 3.9.2 Sunnica West Site A drains away from the SSSI, naturally following the topography (Chippenham Road is a watershed line effectively).
- 3.9.3 There will be no increase in runoff volumes, and no reduction in water quality. It is considered the drainage catchment for the Site does not affect the primary River Snail catchment and spring upstream which would feed the majority of water for the Snailwell SSSI. Runoff from firewater from the battery storage area will be captured so it cannot discharge off site or to ground and will be tested/removed by tanker off site if contamination is found to be present.

#### **Chippenham Fen and Snailwell Poor's Fen**

- 3.9.4 As mentioned above, the proposed drainage network is largely contained within the Sites, as there are natural low-lying areas. The Sites are also downstream of the Chippenham SSSI, so impact to SSSI is considered negligible from all elements of drainage. There will be no reduction in water quality entering watercourses or groundwater through the current drainage proposals.

### **3.10 Fire Water Runoff**

- 3.10.1 The BESS areas require fire water tanks to suppress a fire, should one break out in the BESS containers.
- 3.10.2 A fire strategy has been prepared as part of the development proposals. Fire water tanks are to be located at each BESS site, capable of retaining 242.5m<sup>3</sup>

water per site. The tanks are to be filled with standard water, with no chemical additives.


- 3.10.3 Should a fire break out in a container, the strategy proposes to contain fire within the individual container by using automated fire suppression. This water will be contained in a sump within the battery container and transported off-site. Fire water will be used to soak nearby containers to prevent heat transfer and damage to other containers, see Outline Battery Fire Safety Management Plan **[REP2-032]**.
- 3.10.4 Fire water runoff may, however, contain particles from a fire. In the unlikely event of fire water being discharged, the runoff must be contained and tested/treated before being allowed to discharge to the proposed SuDS (watercourse / infiltration).
- 3.10.5 It is proposed to contain the fire water runoff within a bunded lagoon structure where it can be held and tested before either being released into the SuDS system or taken off site by a tanker for treatment elsewhere. The lagoon will then be cleaned of all contaminants.
- 3.10.6 The lagoon will be controlled by a penstock valve that can be automatically closed during a fire, i.e. under normal circumstances rainfall will be allowed to drain through the lagoon into the SuDS system.
- 3.10.7 The lagoons will be 0.6m deep and 410m<sup>2</sup> in area. This is to allow attenuation of the 242.5m<sup>3</sup> fire water runoff plus an additional 10% capacity.

### **3.11 Adoption and Maintenance**

- 3.11.1 The proposed drainage strategy will be maintained by the Applicant or a private company employed by the Applicant. All proposed drainage features should be maintained according to standard practice. Refer to Appendix E for maintenance schedules of proposed SuDS features.

# Appendix A Topographic Surveys



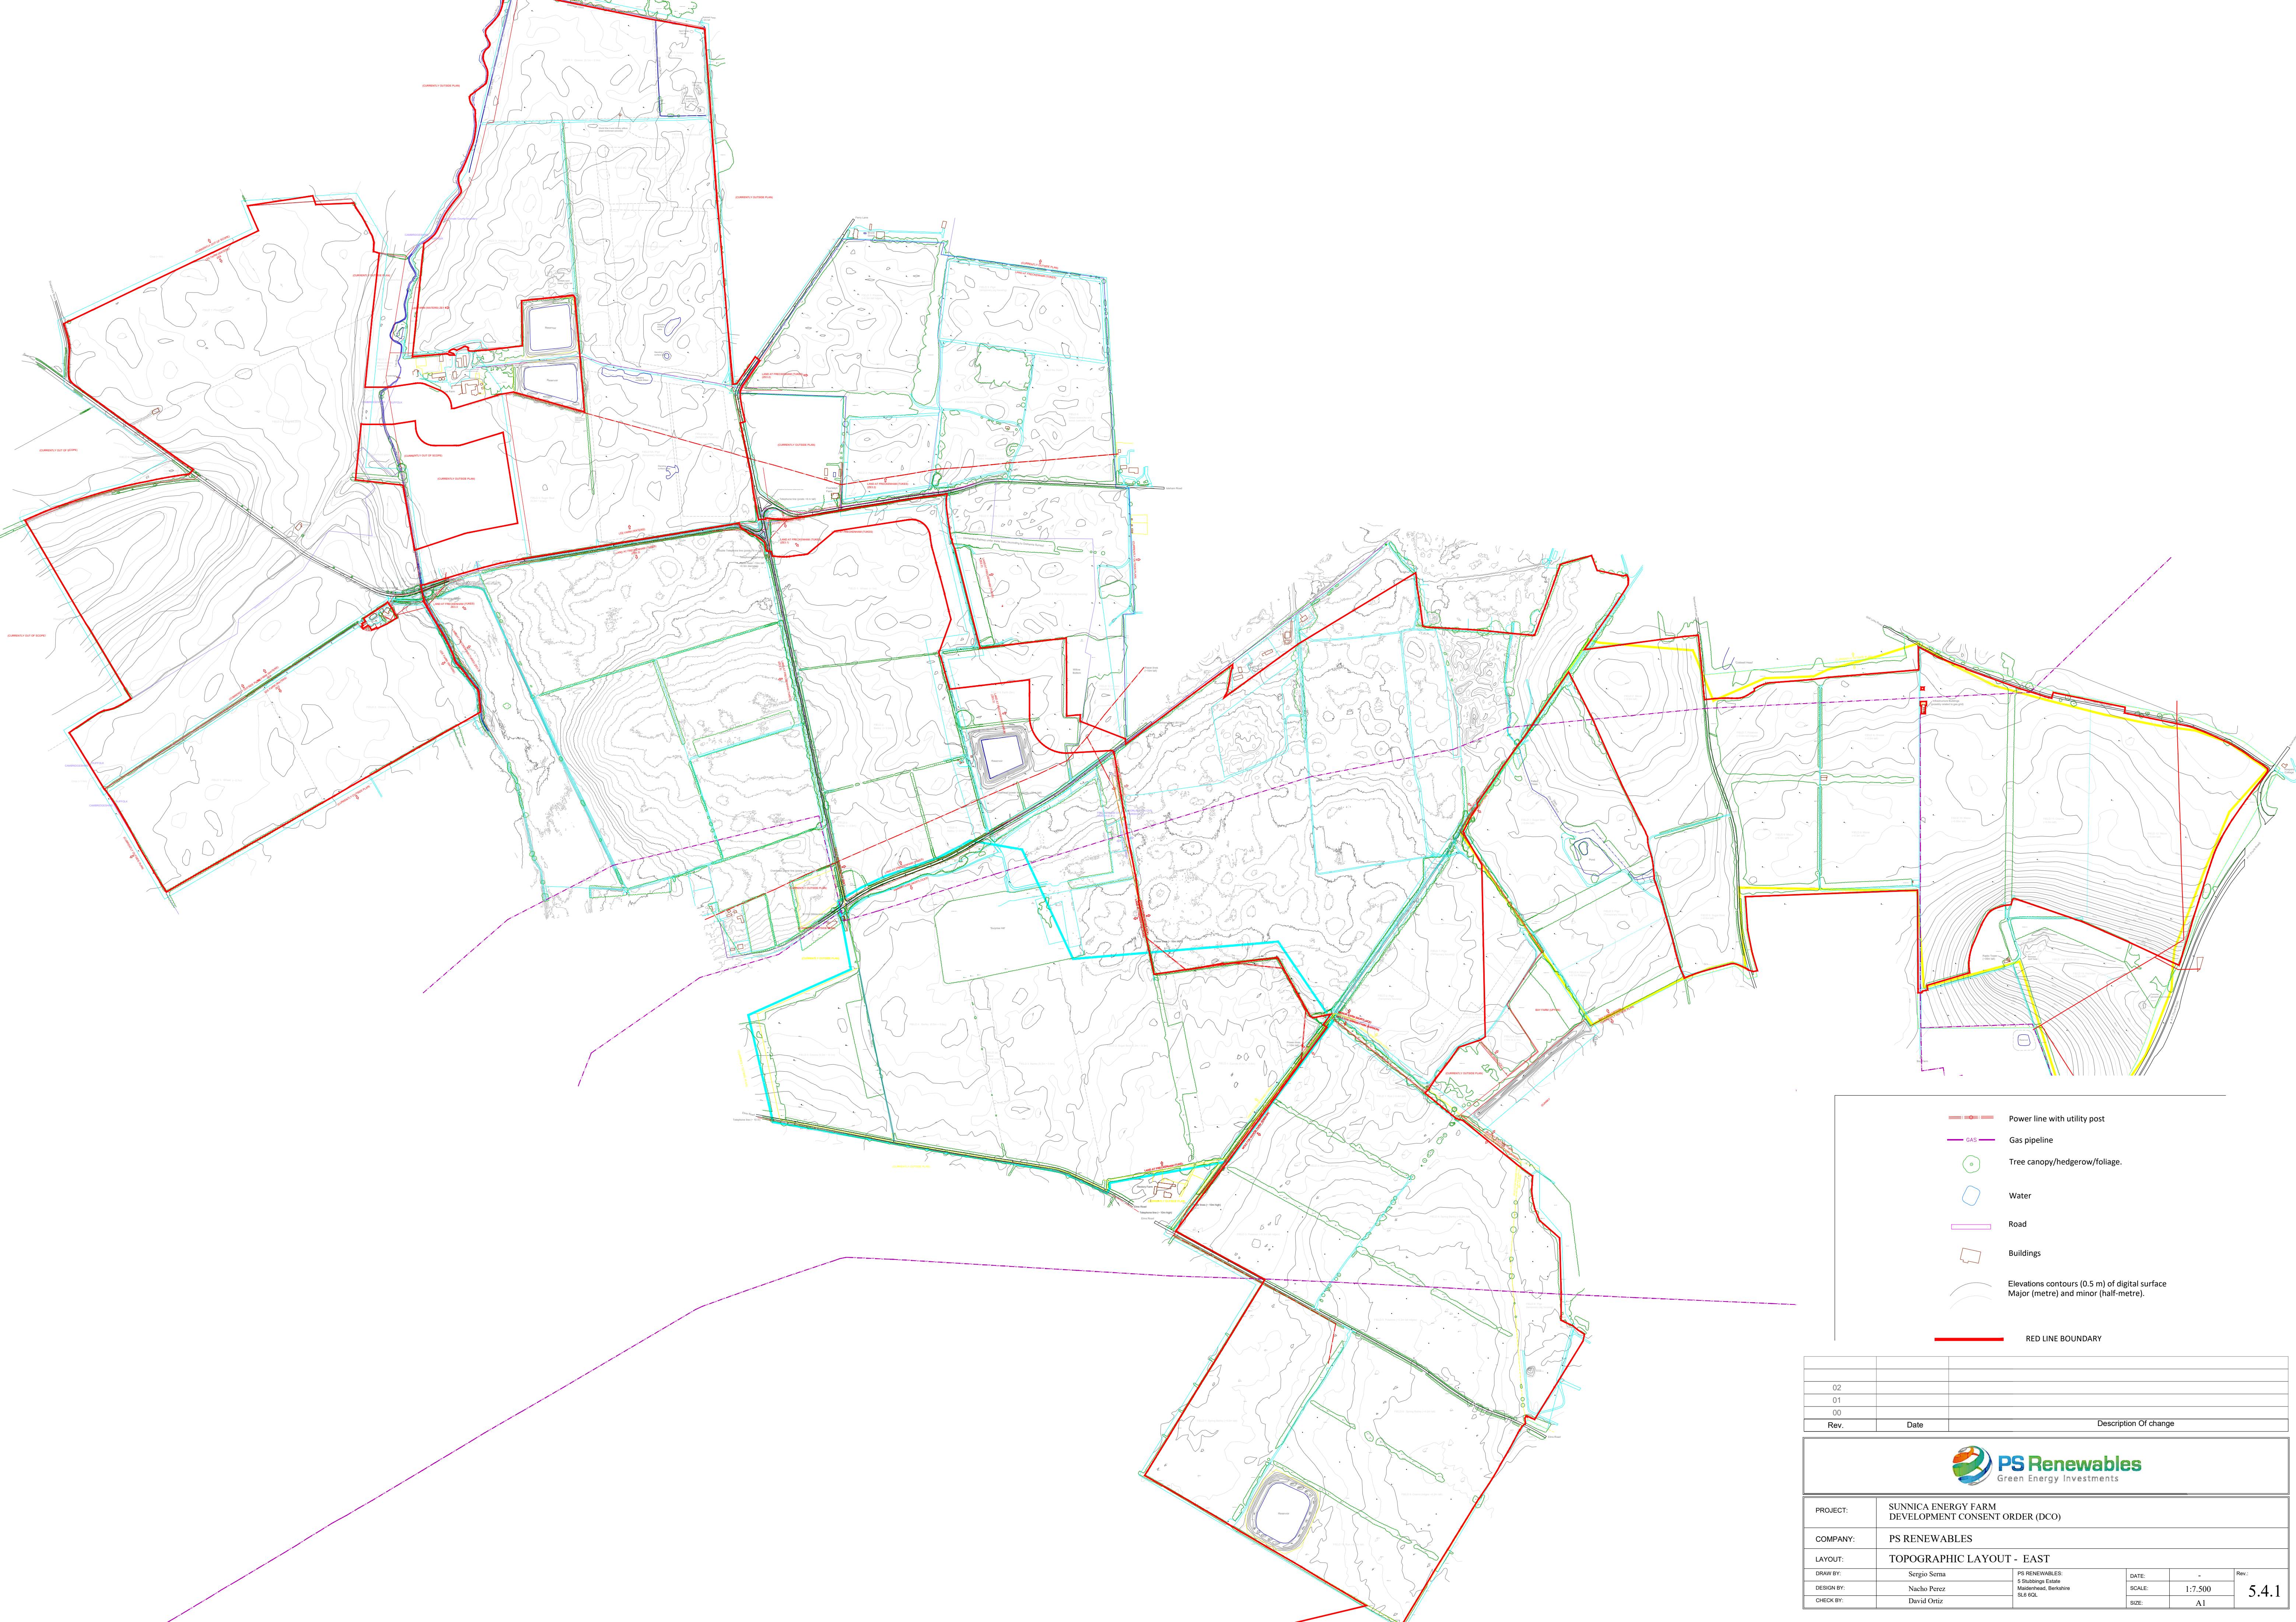


- Power line with utility post
- Gas pipeline
- Tree canopy/hedgerow/foliage.
- Water
- Road
- Buildings
- Elevations contours (0.5 m) of digital surface  
Major (metre) and minor (half-metre).
- RED LINE BOUNDARY









Rev.	Date	Description Of change
02		
01		
00		

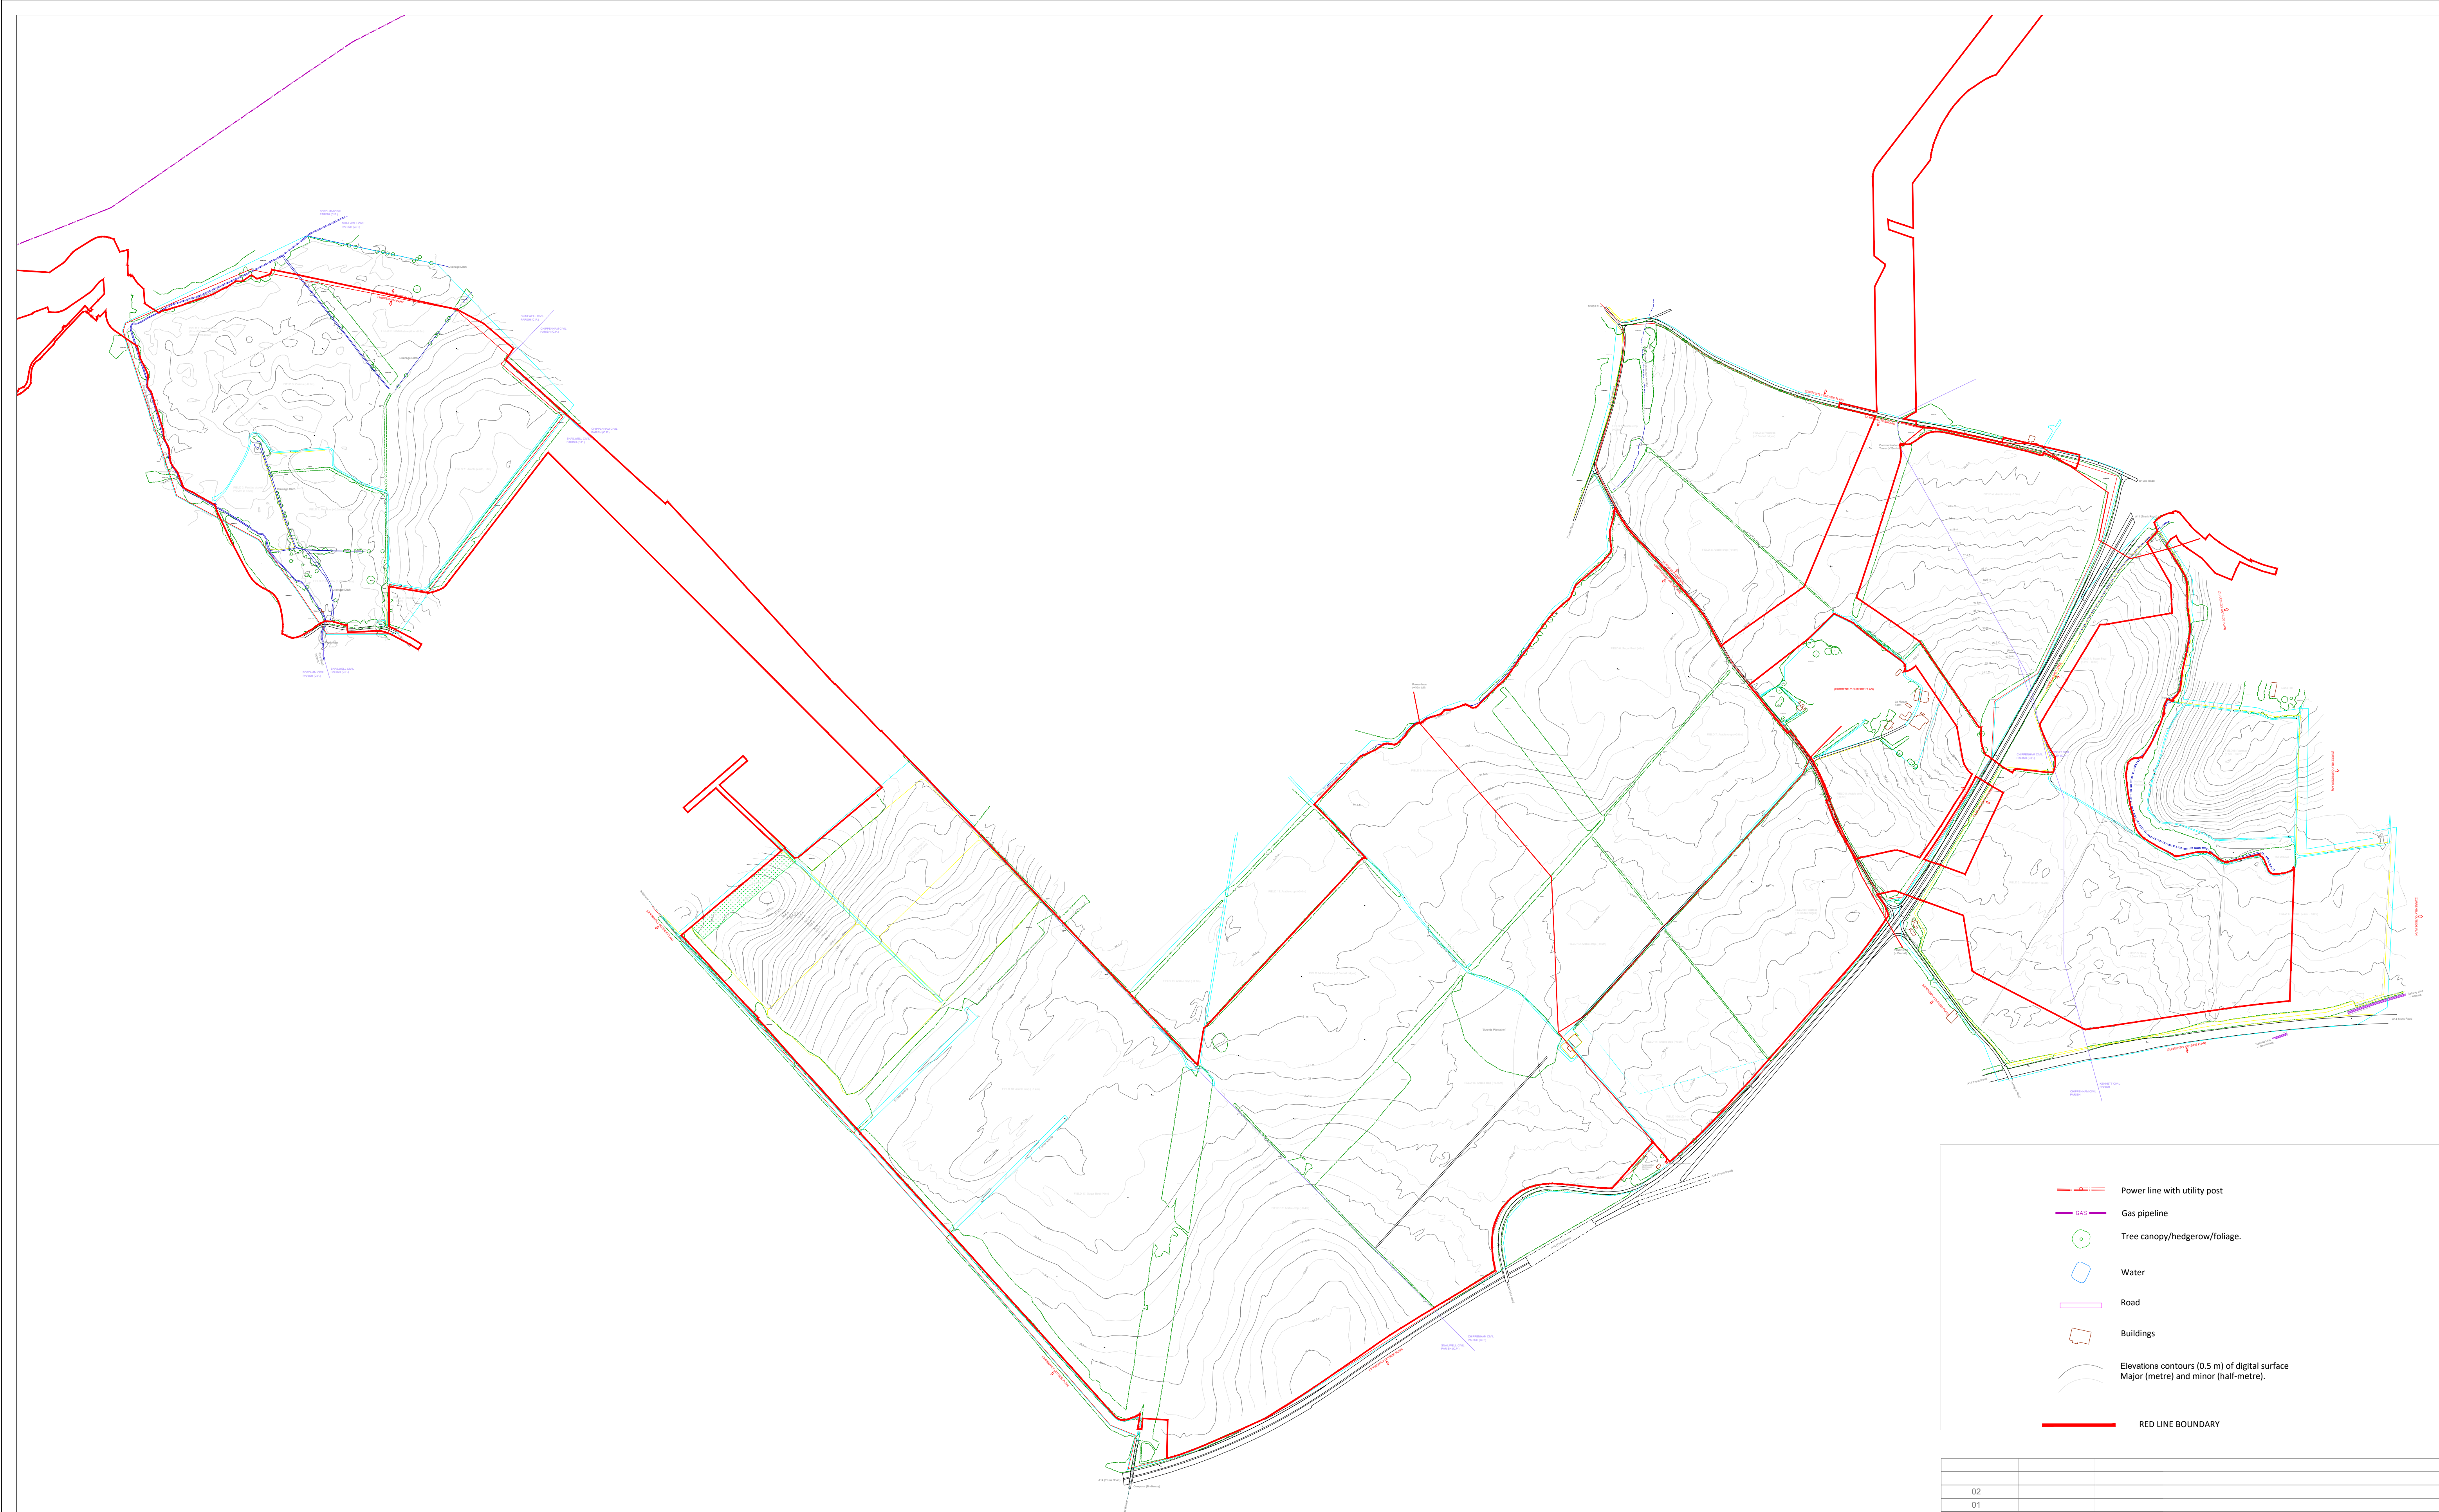

PROJECT:	SUNNICA ENERGY FARM DEVELOPMENT CONSENT ORDER (DCO)			
COMPANY:	PS RENEWABLES			
LAYOUT:	TOPOGRAPHIC LAYOUT - EAST			
DRAWN BY:	Sergio Serna	PS RENEWABLES 5 Suizaonga Estate Machilsway, Berkhov BLK 60L	DATE:	-
DESIGN BY:	Nacho Perez		SCALE:	1:7,500
CHECK BY:	David Ortiz		SIZE:	A1
				5.4.1





-  Power line with utility post
-  Gas pipeline
-  Tree canopy/hedgerow/foliage.
-  Water
-  Road
-  Buildings
-  Elevations contours (0.5 m) of digital surface  
Major (metre) and minor (half-metre).
-  RED LINE BOUNDARY


02		
01		
00		
Rev.	Date	Description Of change



PROJECT:	SUNNICA ENERGY FARM DEVELOPMENT CONSENT ORDER (DCO)				
COMPANY:	PS RENEWABLES				
LAYOUT:	TOPOGRAPHIC LAYOUT - WEST				
DRAWN BY:	Sergio Serna	PS RENEWABLES	DATE:	-	Rev:
DESIGN BY:	Nacho Perez	5 Suizaonga Estate	SCALE:	1:7,500	5.4.2
CHECK BY:	David Ortiz	Mapalmeac, Benavente BUE 604.	SIZE:	A1	

# Appendix B Order limits



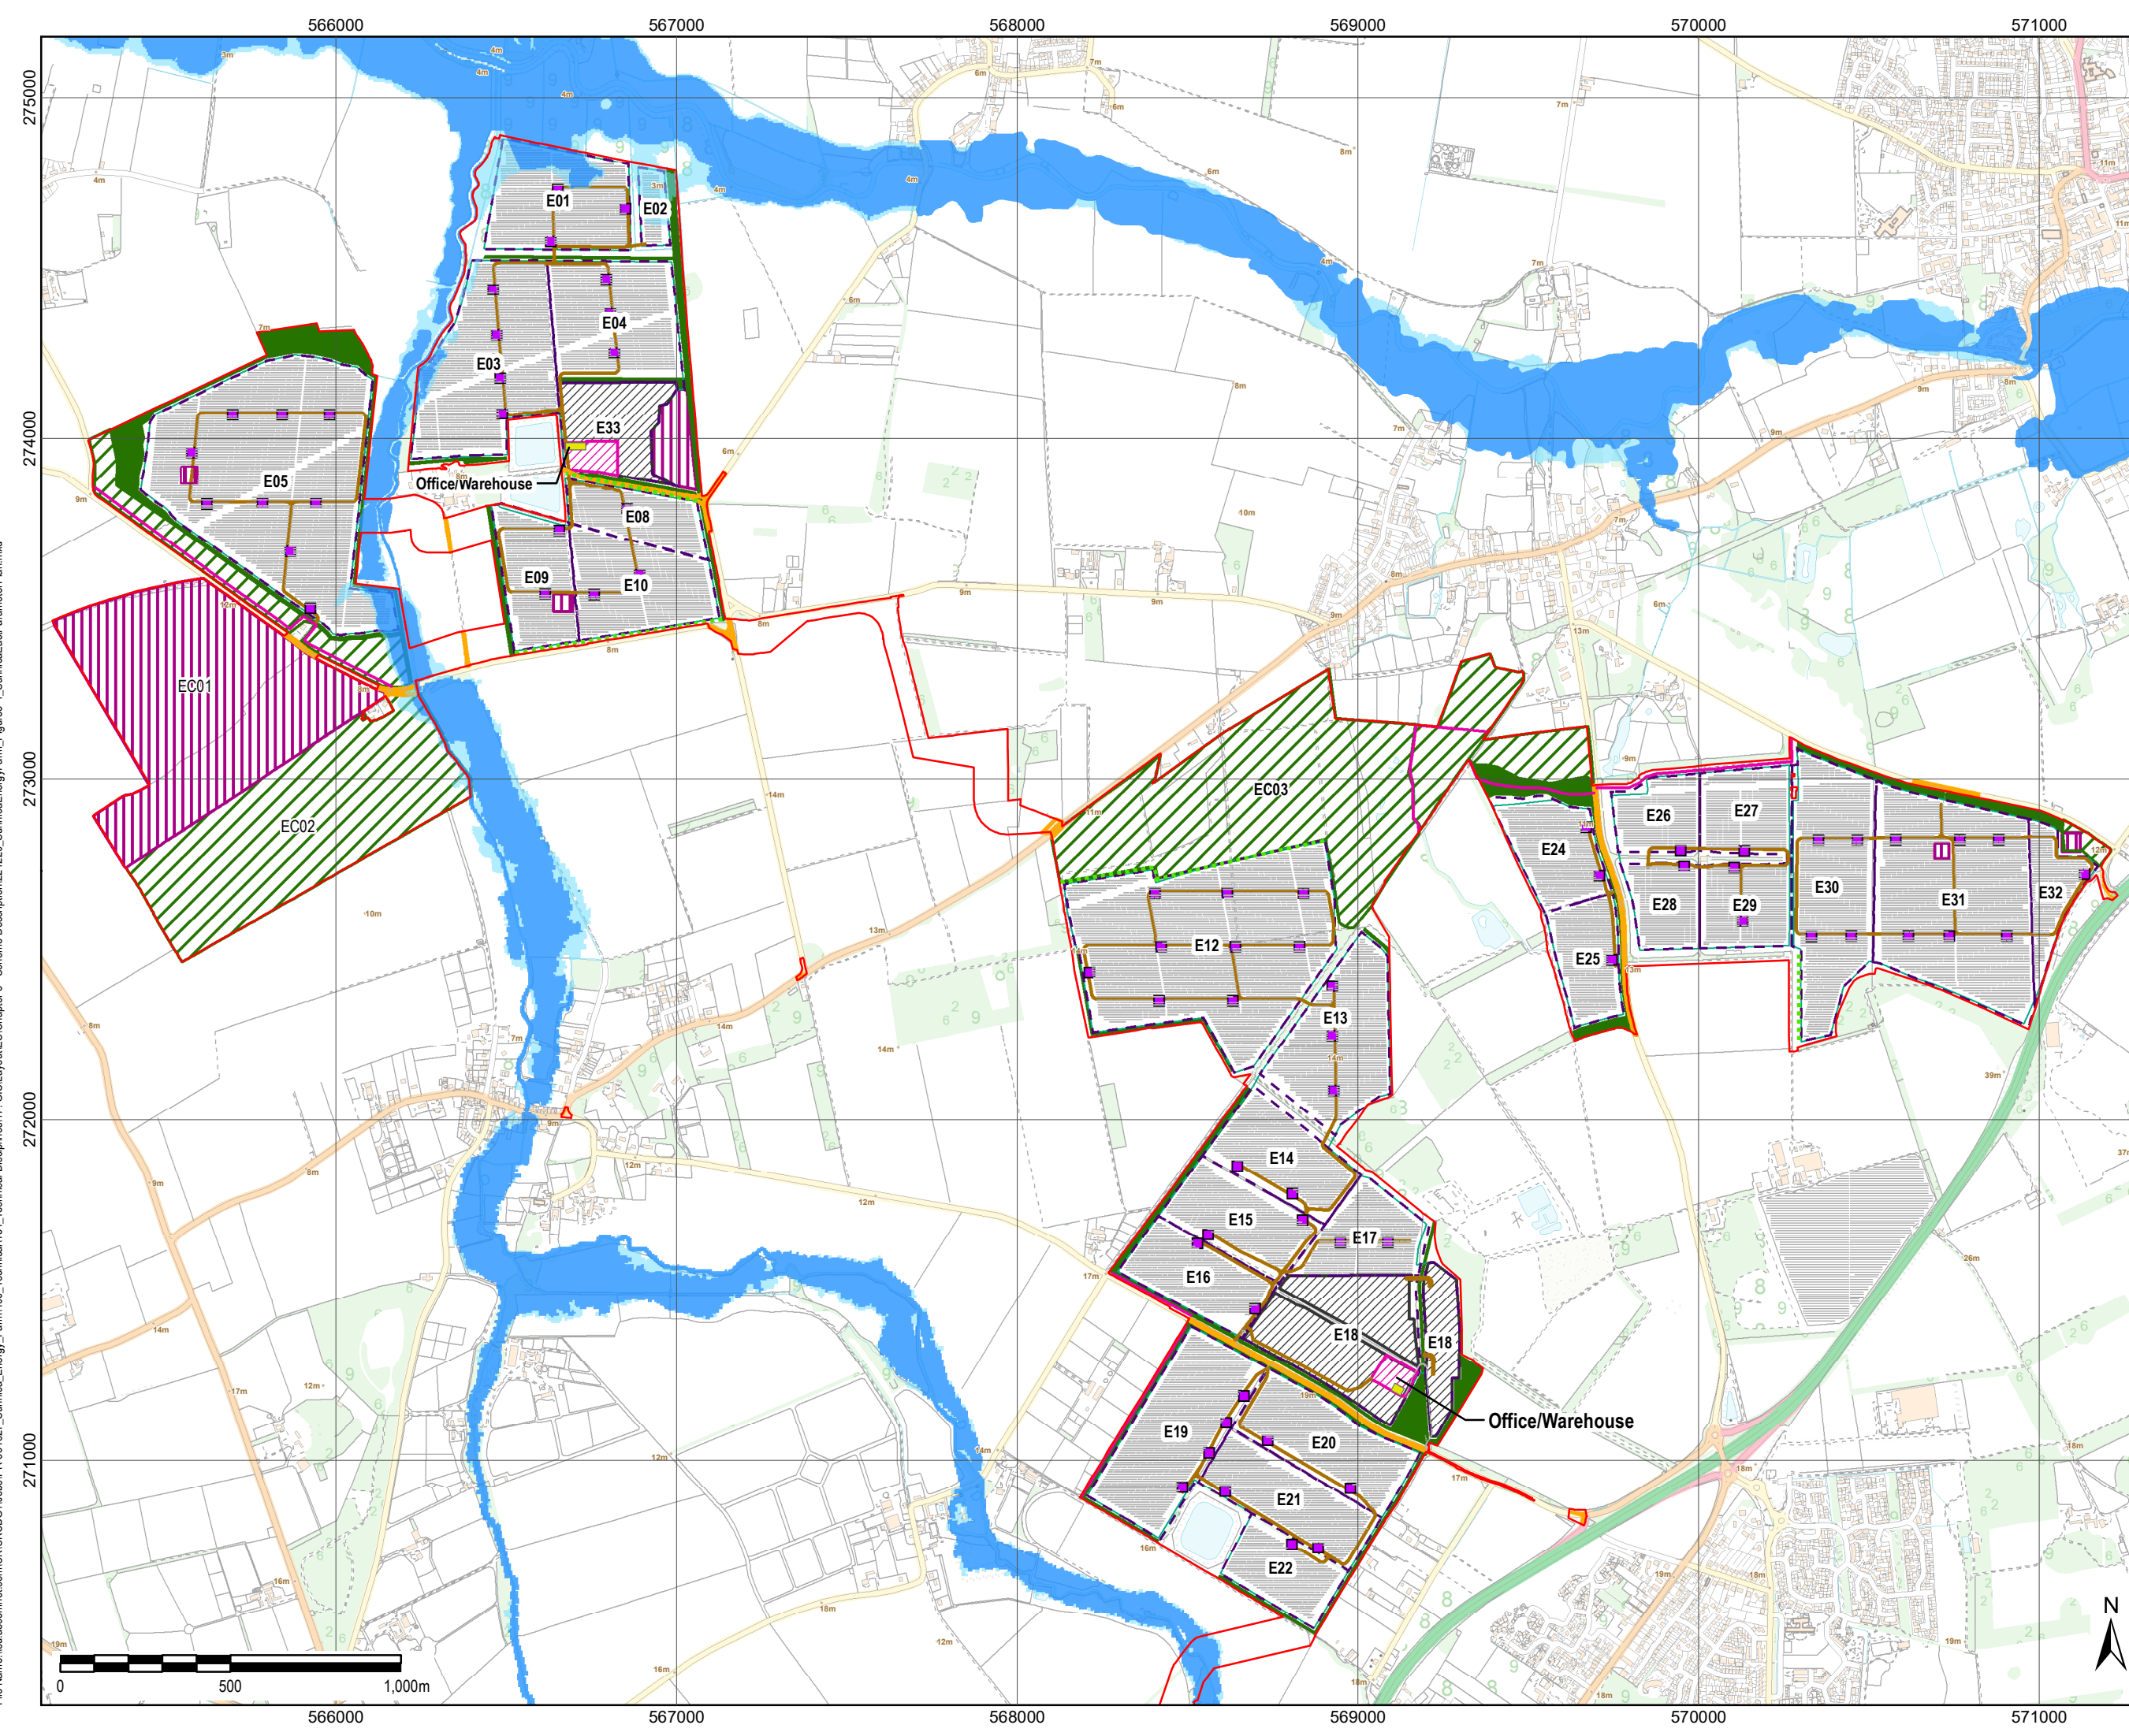

THIS DRAWING IS TO BE USED ONLY FOR THE PURPOSE OF ISSUE THAT IT WAS ISSUED FOR AND IS SUBJECT TO AMENDMENT

**LEGEND**

- The Order Limits
- BESS and Substation
- Public Highway within Scheme
- Illustrative Locations of Solar Stations
- Developable Area
- Boundary Fence
- Compound Area (Permanent)
- Potential Provision of Permissive Route
- Proposed Road
- Flood Zone 2
- Flood Zone 3


**Green Infrastructure**

- Native Grassland Planting
- Native Grassland Planting within Archaeological Mitigation Areas
- Proposed Woodland (new planting or infilling of existing vegetation)
- Proposed Hedgerow (new planting or infilling of existing vegetation)

Note: Developable fields previously referred to as E06, E07, E11 and E23 are no longer being developed with solar infrastructure and now form part of the mitigation strategy; however, the field numbering for the remaining developable fields has been retained for consistency.

Document Reference: EN010106/APP6.3  
 APPF Regulation: 5(2)(a)

Copyright:  
 Contains OS data © Crown copyright and database right 2021. Contains public sector information licensed under the Open Government Licence v3.0  
 © Environment Agency copyright and/or database right 2022. All rights reserved. Some features of this map are based on digital spatial data from the Centre for Ecology & Hydrology, © NERC (CEH), © Crown copyright and database rights 2022 Ordnance Survey 100024198.

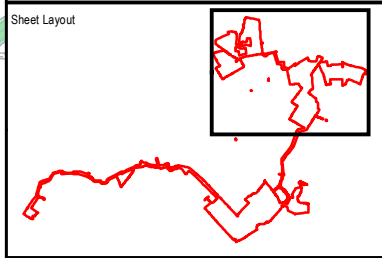

Purpose of Issue  
**FOR DCO SUBMISSION**

Client  
**SUNNICA LTD**



Drawing Title  
**FIGURE 3-1  
 SUNNICA EAST  
 PARAMETER PLAN**

Drawn HW	Checked LL	Approved NC	Date 13/01/2023
AECOM Internal Project No. 60589004		Scale @ A3 1:17,500	


THIS DOCUMENT HAS BEEN PREPARED PURSUANT TO AND SUBJECT TO THE TERMS OF AECOM'S APPOINTMENT BY ITS CLIENT. AECOM ACCEPTS NO LIABILITY FOR ANY USE OF THIS DOCUMENT OTHER THAN BY ITS ORIGINAL CLIENT OR FOLLOWING AECOM'S EXPRESS AGREEMENT TO SUCH USE AND ONLY FOR THE PURPOSES FOR WHICH IT WAS PREPARED AND PROVIDED.

AECOM  
 Unit 1 Wellbrook Court,  
 Gilton,  
 Cambridge, CB3 0NA  
 United Kingdom  
 Telephone (01223) 488000  
 www.aecom.com

Drawing Number <b>60589004_ES_SD_001</b>	Rev <b>0</b>
---	-----------------

File Name: \\eu.aecom.net\UK\UKCBG1\Jobs\PR-334327\_Sunnica\_Energy\_Farm\400\_Technical\434\_Technical Disciplines\17\_GIS\Layout\ES\Chapter 3 - Scheme Description\22 1220\_SunnicaEastParameterPlan.mxd



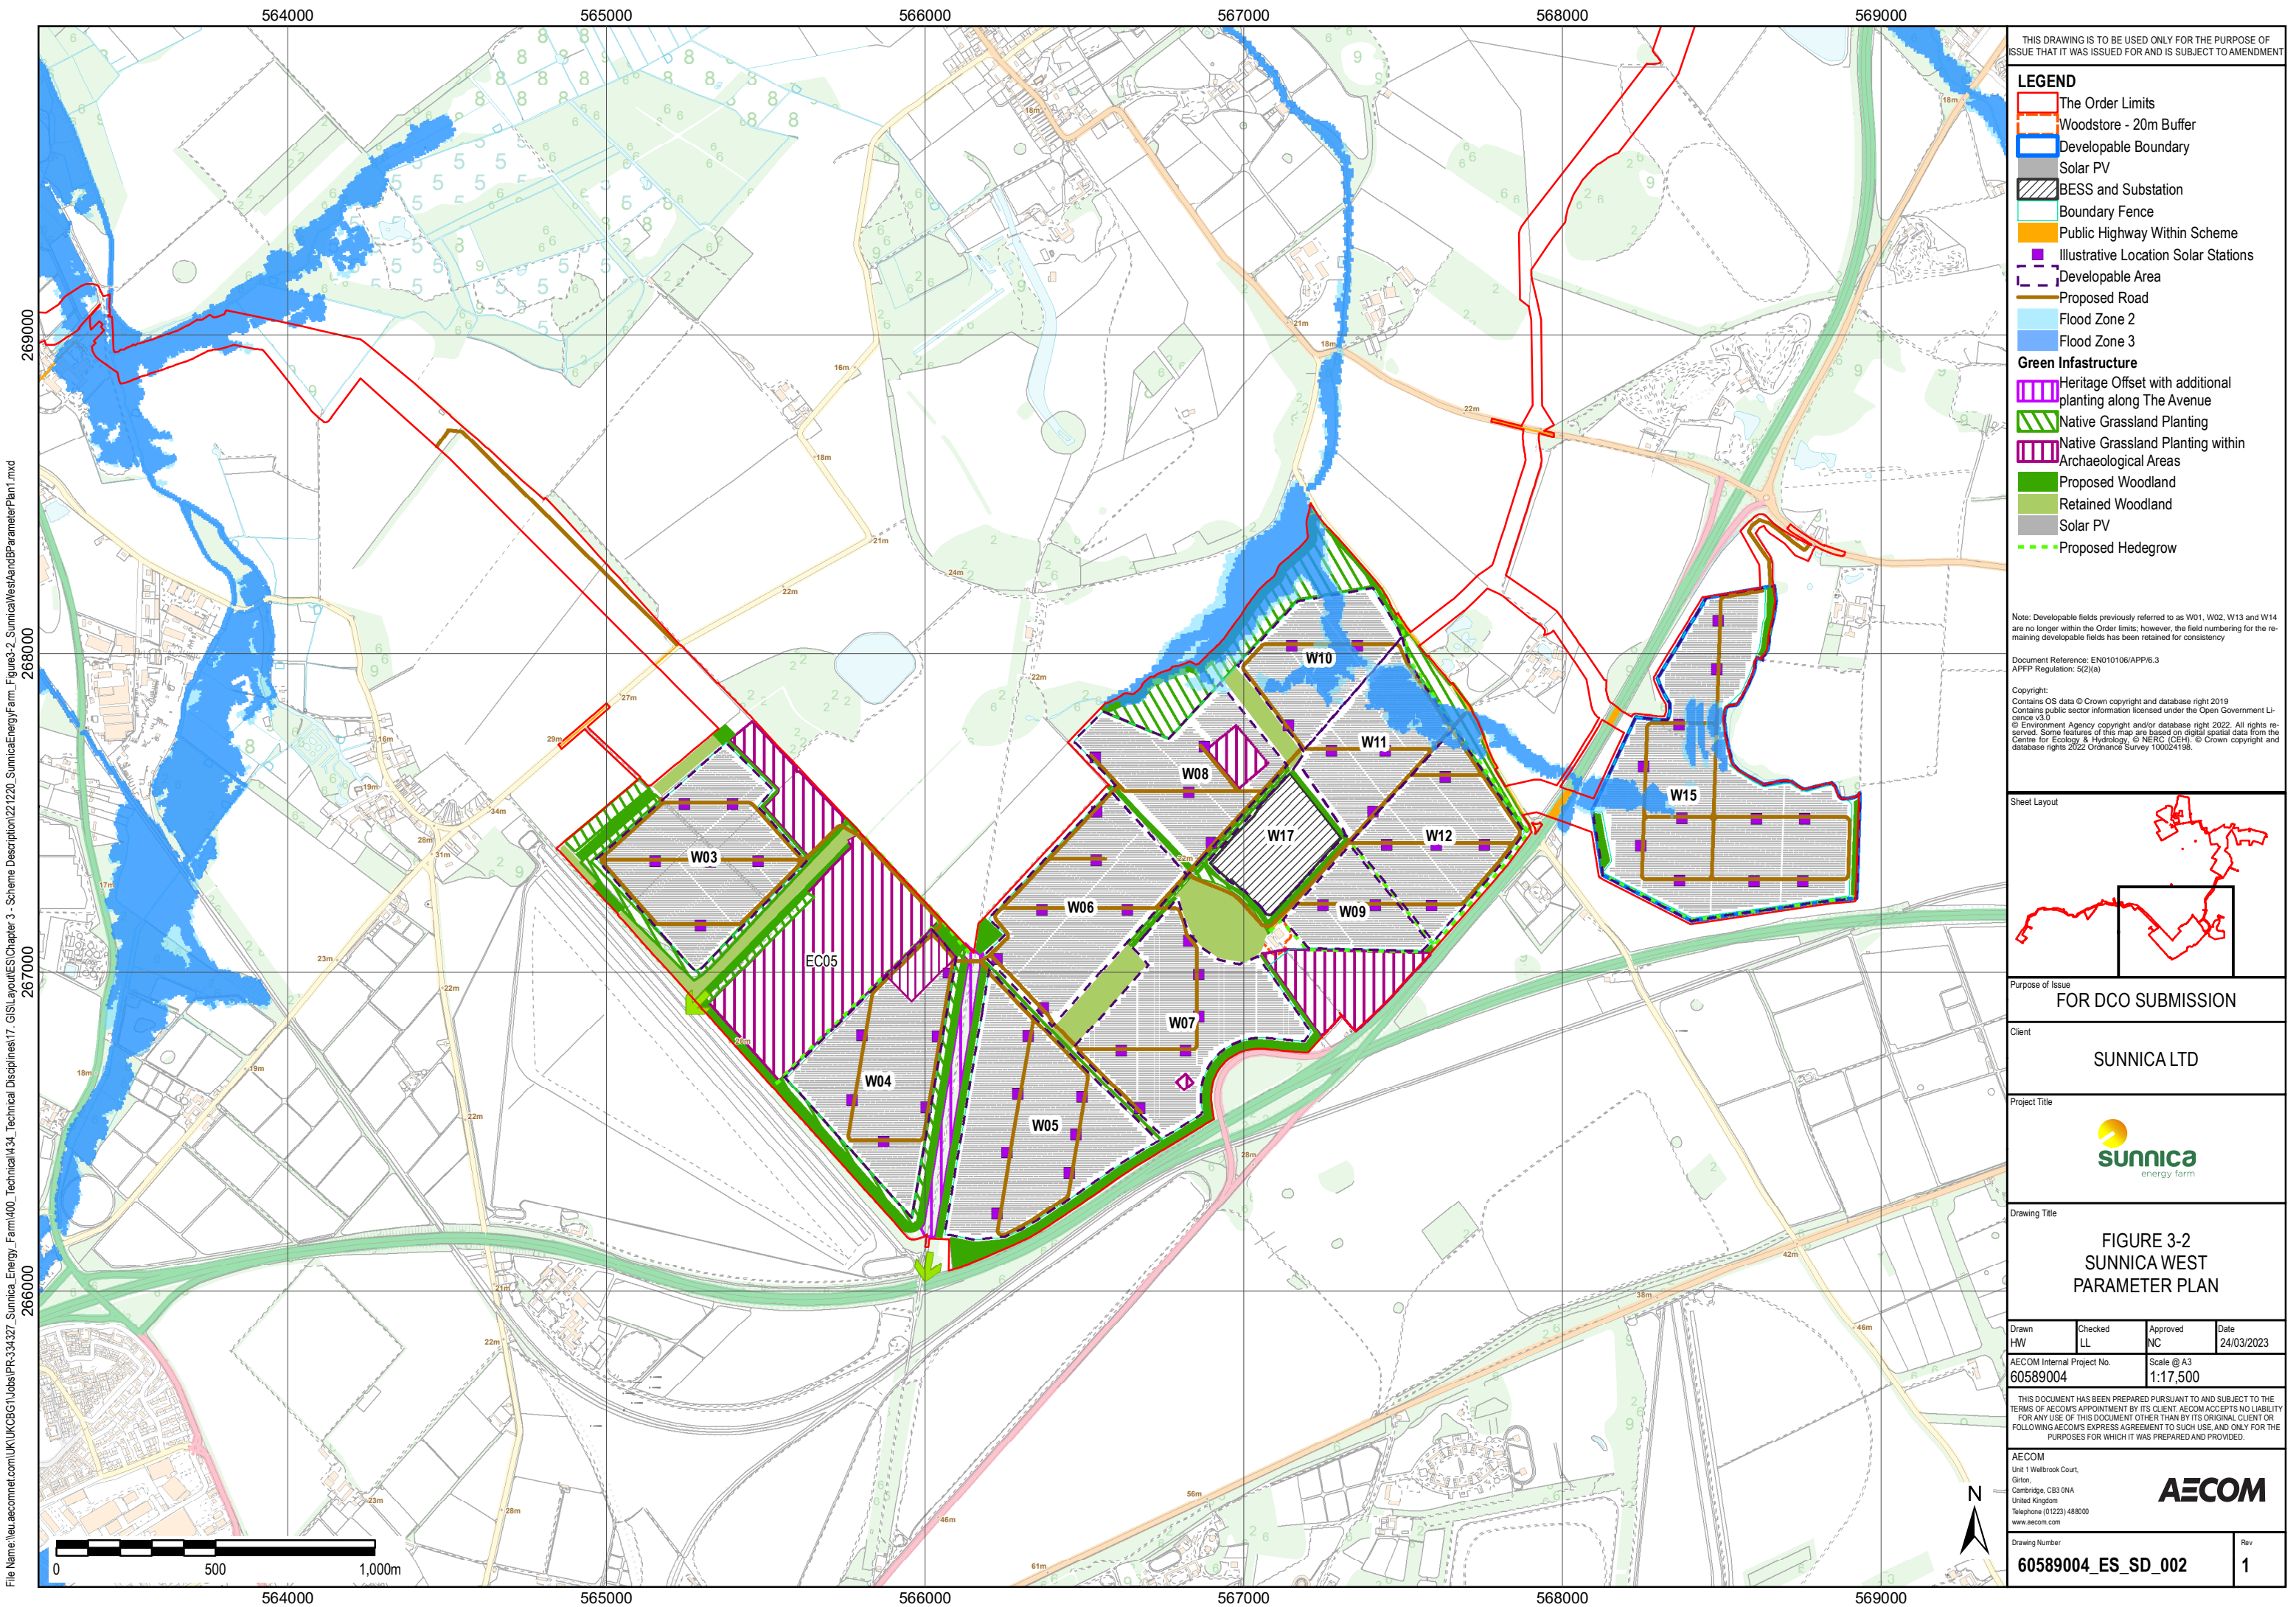

THIS DRAWING IS TO BE USED ONLY FOR THE PURPOSE OF ISSUE THAT IT WAS ISSUED FOR AND IS SUBJECT TO AMENDMENT

**LEGEND**

- The Order Limits
- Woodstore - 20m Buffer
- Developable Boundary
- Solar PV
- BESS and Substation
- Boundary Fence
- Public Highway Within Scheme
- Illustrative Location Solar Stations
- Developable Area
- Proposed Road
- Flood Zone 2
- Flood Zone 3


**Green Infrastructure**

- Heritage Offset with additional planting along The Avenue
- Native Grassland Planting
- Native Grassland Planting within Archaeological Areas
- Proposed Woodland
- Retained Woodland
- Solar PV
- Proposed Hedegrow

Note: Developable fields previously referred to as W01, W02, W13 and W14 are no longer within the Order limits; however, the field numbering for the remaining developable fields has been retained for consistency

Document Reference: EN010106/APP/6.3  
APFP Regulation: 5(2)(a)

Copyright:  
Contains OS data © Crown copyright and database right 2019  
Contains public sector information licensed under the Open Government Licence v3.0  
© Environment Agency copyright and/or database right 2022. All rights reserved. Some features of this map are based on digital spatial data from the Centre for Ecology & Hydrology, © NERC (CEH), © Crown copyright and database rights 2022 Ordnance Survey 100024198.

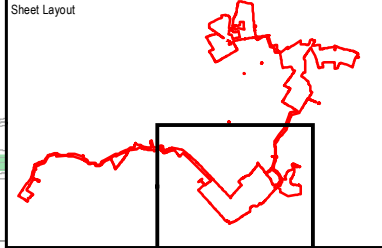

Purpose of Issue  
**FOR DCO SUBMISSION**

Client  
**SUNNICA LTD**



Drawing Title  
**FIGURE 3-2  
SUNNICA WEST  
PARAMETER PLAN**

Drawn HW	Checked LL	Approved NC	Date 24/03/2023
AECOM Internal Project No. 60589004		Scale @ A3 1:17,500	

THIS DOCUMENT HAS BEEN PREPARED PURSUANT TO AND SUBJECT TO THE TERMS OF AECOM'S APPOINTMENT BY ITS CLIENT. AECOM ACCEPTS NO LIABILITY FOR ANY USE OF THIS DOCUMENT OTHER THAN BY ITS ORIGINAL CLIENT OR FOLLOWING AECOM'S EXPRESS AGREEMENT TO SUCH USE AND ONLY FOR THE PURPOSES FOR WHICH IT WAS PREPARED AND PROVIDED.

AECOM  
Unit 1 Wellbrook Court,  
Gilton,  
Cambridge, CB3 0NA  
United Kingdom  
Telephone (01223) 488000  
www.aecom.com

**AECOM**

Drawing Number <b>60589004_ES_SD_002</b>	Rev <b>1</b>
---	-----------------

File Name: \\au.aecom.net\UK\UKCBG1\Jobs\PR-334327\_Sunnica\_Energy\_Farm\_400\_Technical\434\_Technical Disciplines\17\_GIS\Layout\ES\Chapter 3 - Scheme Description\21220\_SunnicaWest\AandBParameterPlan1.mxd

# Appendix C Proposed Attenuation

Catchment No.	Area (ha.)	PIMP	Impermeable Area (ha.)	Storage Required (m <sup>3</sup> )	Total Volume Available (m <sup>3</sup> )	Ref S.C <sub>n</sub> .1	Ref S.C <sub>n</sub> .2	Ref S.C <sub>n</sub> .3	Ref S.C <sub>n</sub> .4	Ref S.C <sub>n</sub> .5	Ref P.C <sub>n</sub> .1	Ref P.C <sub>n</sub> .2	Ref P.C <sub>n</sub> .3	Ref P.C <sub>n</sub> .4
1						NO LONGER USED								
2						NO LONGER USED								
3						NO LONGER USED								
4						NO LONGER USED								
5	32.1	10%	3.2	1826	679	447	231	0	0	0	0	0	0	0
6	23.3	10%	2.3	1506	638	638	0	0	0	0	0	0	0	0
7	25.3	10%	2.5	1438	720	720	0	0	0	0	0	0	0	0
8	7.1	10%	0.7	402	525	525	0	0	0	0	0	0	0	0
9	4.3	10%	0.4	245	304	153	151	0	0	0	0	0	0	0
10	20.2	10%	2.0	1327	548	386	162	0	0	0	0	0	0	0
11	23.3	10%	2.3	1328	609	609	0	0	0	0	0	0	0	0
12	19.1	10%	1.9	1111	2432	253	329	480	0	0	1370	0	0	0
13	9.1	100%	9.1	7287	872	228	397	248	0	0	0	0	0	0
14	8.3	10%	0.8	729	729	446	284	0	0	0	0	0	0	0
15	18.2	10%	1.8	1114	765	342	423	0	0	0	0	0	0	0
16	14.7	10%	1.5	862	1297	244	153	0	0	0	900	0	0	0
17	13.9	10%	1.4	790	1198	190	117	76	315	0	200	300	0	0
18	22.5	10%	2.3	1282	1888	488	0	0	0	0	700	700	0	0
19	25.5	10%	2.6	1451	1466	0	366	302	270	528	0	0	0	0
20						NO LONGER USED								
21						NO LONGER USED								
22						NO LONGER USED								
23	6.4	10%	0.6	679	443	283	160	0	0	0	0	0	0	0





# Appendix D Greenfield Runoff Rates

Print

Close Report



# Greenfield runoff rate estimation for sites

www.uksuds.com | Greenfield runoff tool

Calculated by:

Site name:

Site location:

### Site Details

Latitude:

Longitude:

Reference:

Date:

This is an estimation of the greenfield runoff rates that are used to meet normal best practice criteria in line with Environment Agency guidance "Rainfall runoff management for developments", SC030219 (2013), the SuDS Manual C753 (Ciria, 2015) and the non-statutory standards for SuDS (Defra, 2015). This information on greenfield runoff rates may be the basis for setting consents for the drainage of surface water runoff from sites.

Runoff estimation approach

### Site characteristics

Total site area (ha):

### Methodology

$Q_{BAR}$  estimation method:

SPR estimation method:

### Soil characteristics

	Default	Edited
SOIL type:	<input type="text" value="1"/>	<input type="text" value="1"/>
HOST class:	<input type="text" value="N/A"/>	<input type="text" value="N/A"/>
SPR/SPRHOST:	<input type="text" value="0.1"/>	<input type="text" value="0.1"/>

### Hydrological characteristics

	Default	Edited
SAAR (mm):	<input type="text" value="551"/>	<input type="text" value="551"/>
Hydrological region:	<input type="text" value="5"/>	<input type="text" value="5"/>
Growth curve factor 1 year:	<input type="text" value="0.87"/>	<input type="text" value="0.87"/>
Growth curve factor 30 years:	<input type="text" value="2.45"/>	<input type="text" value="2.45"/>
Growth curve factor 100 years:	<input type="text" value="3.56"/>	<input type="text" value="3.56"/>
Growth curve factor 200 years:	<input type="text" value="4.21"/>	<input type="text" value="4.21"/>

### Notes

#### (1) Is $Q_{BAR} < 2.0$ l/s/ha?

When  $Q_{BAR}$  is  $< 2.0$  l/s/ha then limiting discharge rates are set at 2.0 l/s/ha.

#### (2) Are flow rates $< 5.0$ l/s?

Where flow rates are less than 5.0 l/s consent for discharge is usually set at 5.0 l/s if blockage from vegetation and other materials is possible. Lower consent flow rates may be set where the blockage risk is addressed by using appropriate drainage elements.

#### (3) Is $SPR/SPRHOST \leq 0.3$ ?

Where groundwater levels are low enough the use of soakaways to avoid discharge offsite would normally be preferred for disposal of surface water runoff.

Greenfield runoff rates	Default	Edited
$Q_{BAR}$ (l/s):	<input type="text" value="96.1"/>	<input type="text" value="96.1"/>
1 in 1 year (l/s):	<input type="text" value="83.61"/>	<input type="text" value="83.61"/>
1 in 30 years (l/s):	<input type="text" value="235.45"/>	<input type="text" value="235.45"/>
1 in 100 year (l/s):	<input type="text" value="342.12"/>	<input type="text" value="342.12"/>
1 in 200 years (l/s):	<input type="text" value="404.59"/>	<input type="text" value="404.59"/>

This report was produced using the greenfield runoff tool developed by HR Wallingford and available at [www.uksuds.com](http://www.uksuds.com). The use of this tool is subject to the UK SuDS terms and conditions and licence agreement, which can both be found at [www.uksuds.com/terms-and-conditions.htm](http://www.uksuds.com/terms-and-conditions.htm). The outputs from this tool are estimates of greenfield runoff rates. The use of these results is the responsibility of the users of this tool. No liability will be accepted by HR Wallingford, the Environment Agency, CEH, Hydrosolutions or any other organisation for the use of this data in the design or operational characteristics of any drainage scheme.

# Appendix E Maintenance Schedules

## Infiltration Basins

Infiltration basins are vegetated open surface basins designs to store water and allow it to infiltrate into the ground. Vegetation provides amenity benefit and filtration of pollutants and is therefore as important to its function as the basin itself. A schedule setting out the maintenance operations, actions and frequency is included below. Please also refer to the manufacturer’s operation and maintenance manual for any inlet structures or valves if available.

**CIRIA C753 TABLE 13.2 Operation and maintenance requirements for infiltration basins**

Maintenance schedule	Required action	Typical frequency
Regular maintenance	Remove litter, debris and trash	Monthly
	Cut grass – for landscaped areas and access routes	Monthly (during growing season) or as required
	Cut grass – meadow grass in and around basin	Half yearly: spring (before nesting season) and autumn
	Manage other vegetation and remove nuisance plants	Monthly at start, then as required
Occasional maintenance	Reseed areas of poor vegetation growth	Annually, or as required
	Prune and trim trees and remove cuttings	As required
	Remove sediment from pre-treatment system when 50% full	As required
Remedial actions	Repair erosion or other damage by reseedling or re-turfing	As required
	Realign the rip-rap	As required
	Repair or rehabilitate inlets, outlets and overflows	As required
	Rehabilitate infiltration surface using scarifying and spiking techniques if performance deteriorates	As required
	Relevel uneven surfaces and reinstate design levels	As required
Monitoring	Inspect inlets, outlets and overflows for blockages, and clear if required	Monthly
	Inspect banksides, structures, pipework etc for	Monthly

evidence of physical damage

---

Inspect inlets and pre-treatment systems for silt Half yearly

accumulation; establish appropriate silt removal

frequencies

---

Inspect infiltration surfaces for compaction and Monthly

ponding

## Swales

Swales are man-made linear depressions designed to convey water along a specified route. Upkeep of swales and their inlets and outlets is key to their function.

A schedule setting out the maintenance operations, actions and frequency is included below. Please also refer to the manufacturers operation and maintenance manual for any inlet structures if available.

### CIRIA C753 TABLE 17.1 Operation and maintenance requirements for swales

Maintenance schedule	Required action	Typical frequency
Regular maintenance	Remove litter and debris	Monthly, or as required
	Cut grass – to retain grass height within specified design range	Monthly (during growing season), or as required
	Manage other vegetation and remove nuisance plants	Monthly at start, then as required
	Inspect inlets, outlets and overflows for blockages, and clear if required	Monthly
	Inspect infiltration surfaces for ponding, compaction, silt accumulation, record areas where water is ponding	Monthly, or when required
	Inspect vegetation coverage	Monthly for 6 months, quarterly for 2 years, then half yearly
	Inspect inlets and facility surface for silt accumulation, establish appropriate silt removal frequencies	Half yearly
Occasional maintenance	Reseed areas of poor vegetation growth, alter plant types to better suit conditions, if required	As required or if bare soil is exposed over 10% or more of the swale treatment area
Remedial actions	Repair erosion or other damage by re-turfing or reseedling	As required
	Relevel uneven surfaces and reinstate design levels	As required

Scarify and spike topsoil layer to improve infiltration performance, break up silt deposits and prevent compaction of the soil surface	As required
Remove build-up of sediment on upstream gravel trench, flow spreader or at top of filter strip	As required
Remove and dispose of oils or petrol residues using safe standard practices	As required


# Appendix F Drainage General Arrangements



**NOTES**

- DO NOT SCALE FROM THIS DRAWING
- ALL DIMENSIONS WHERE SHOWN ARE IN MM.
- SITE LEVELS BASED ON DRONE FLOWN TOPOGRAPHICAL SURVEY BY ABOVE SURVEYS LTD.
- SITE BACKGROUND TAKEN FROM OS BASE MAP DATASET AND SHOULD NOT BE USED FOR DETAILED DESIGN PURPOSES
- SITE LAYOUT BASED ON DESIGN SET: SOL\_SchemeBoundary\_ParameterPlans\_200715 ITERATION 4 FOR BOTH EAST AND WEST SITES BY PS RENEWABLES, PLANS UN-DATED.
- DRAINAGE SWALES PROPOSED WITH INFILTRATION SUBJECT TO FURTHER ON SITE GROUND INVESTIGATIONS. NO PIPED DRAINAGE PROPOSED OTHER THAN OUTLETS TO WATERCOURSES WHERE REQUIRED.
- HIGH LEVEL DRAINAGE ASSESSMENT IS BASED ON TOPOGRAPHICAL CATCHMENT RUNOFF CONTOUR MODEL AND NOT CURRENTLY BASED ON DETAILED RAINFALL RATES AND VOLUMES. THIS WILL BE PREPARED AT PLANNING STAGE AND SWALES ADJUSTED TO SUIT IF REQUIRED.
- NO DRAINAGE ASSESSMENT HAS BEEN CARRIED OUT FOR THE PLANNED MITIGATION AREAS, WHERE NO PV PANEL / COMPOUND AREA DEVELOPMENT IS TAKING PLACE. IT IS ASSUMED THESE AREAS WILL DRAIN AS EXISTING.
- STORAGE AREAS AND COMPOUNDS HAVE NOT BEEN INCLUDED IN DRAINAGE STRATEGY AS DETAILS ON IMPERMEABLE AREAS ARE NOT KNOWN. THEREFORE ARE ASSUMED TO DRAIN INTO PROPOSED SWALES AND STORAGE BASINS.
- THE DESIGN OF PV PANEL LAYOUTS, BY OTHERS, IS ASSUMED TO HAVE CONSIDERED ACCESS AND MAINTENANCE REQUIREMENTS. ACCESS AROUND FIELDS IS ASSUMED TO BE PROVIDED AS A NATURAL BUFFER BETWEEN FENCES AND PANELS AND WILL FACILITATE ACCESS TO MAINTAIN SWALES AND BASINS.

**KEY PLAN - WEST SIDE**

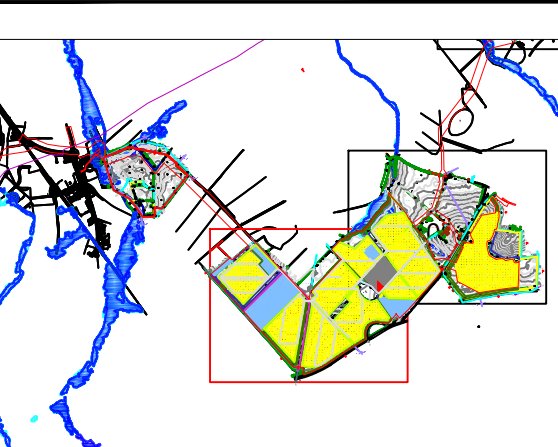

**KEY**

- LAYOUT
- RED LINE BOUNDARY
- SOLAR FIELD AREA
- ARCHAEOLOGICAL MITIGATION AREA
- COMPOUND AREA (PERMANENT)
- ECOLOGICAL ENHANCEMENT
- ECOLOGICAL ENHANCEMENT WETLAND
- RETAINED WOODLAND
- BATTERY STORAGE / COMPOUND
- SWALE (0.6m DEEP)
- INFILTRATION BASIN (0.6m DEEP)
- FIRE WATER STORAGE LAGOON WITH PENSTOCK
- FRESHWATER DRAINAGE ROUTE
- FLOOD ZONE 3
- FLOOD ZONE 2

**ISSUE/REVISION**

NO	DATE	DESCRIPTION
P6	06.01.23	BOUNDARY UPDATE
P5	22.11.22	BOUNDARY / FEH UPDATE
P4	19.10.21	BOUNDARY UPDATE
P3	09.07.21	BOUNDARY DESIGN UPDATE
P2	03.08.20	BOUNDARY UPDATE
P1	04.10.19	PRELIMINARY

**ISSUE PURPOSE / SUITABILITY**

ISSUE	DATE	DESCRIPTION
IR		

**PROJECT NUMBER**


60589004

**SHEET TITLE**

SUNNICA ENERGY FARM  
DRAINAGE STRATEGY  
GENERAL ARRANGEMENT  
WEST SITE (SHEET 2 OF 3)


**SHEET NUMBER**

WPP-ACM-XX-DR-C-ZZ-002

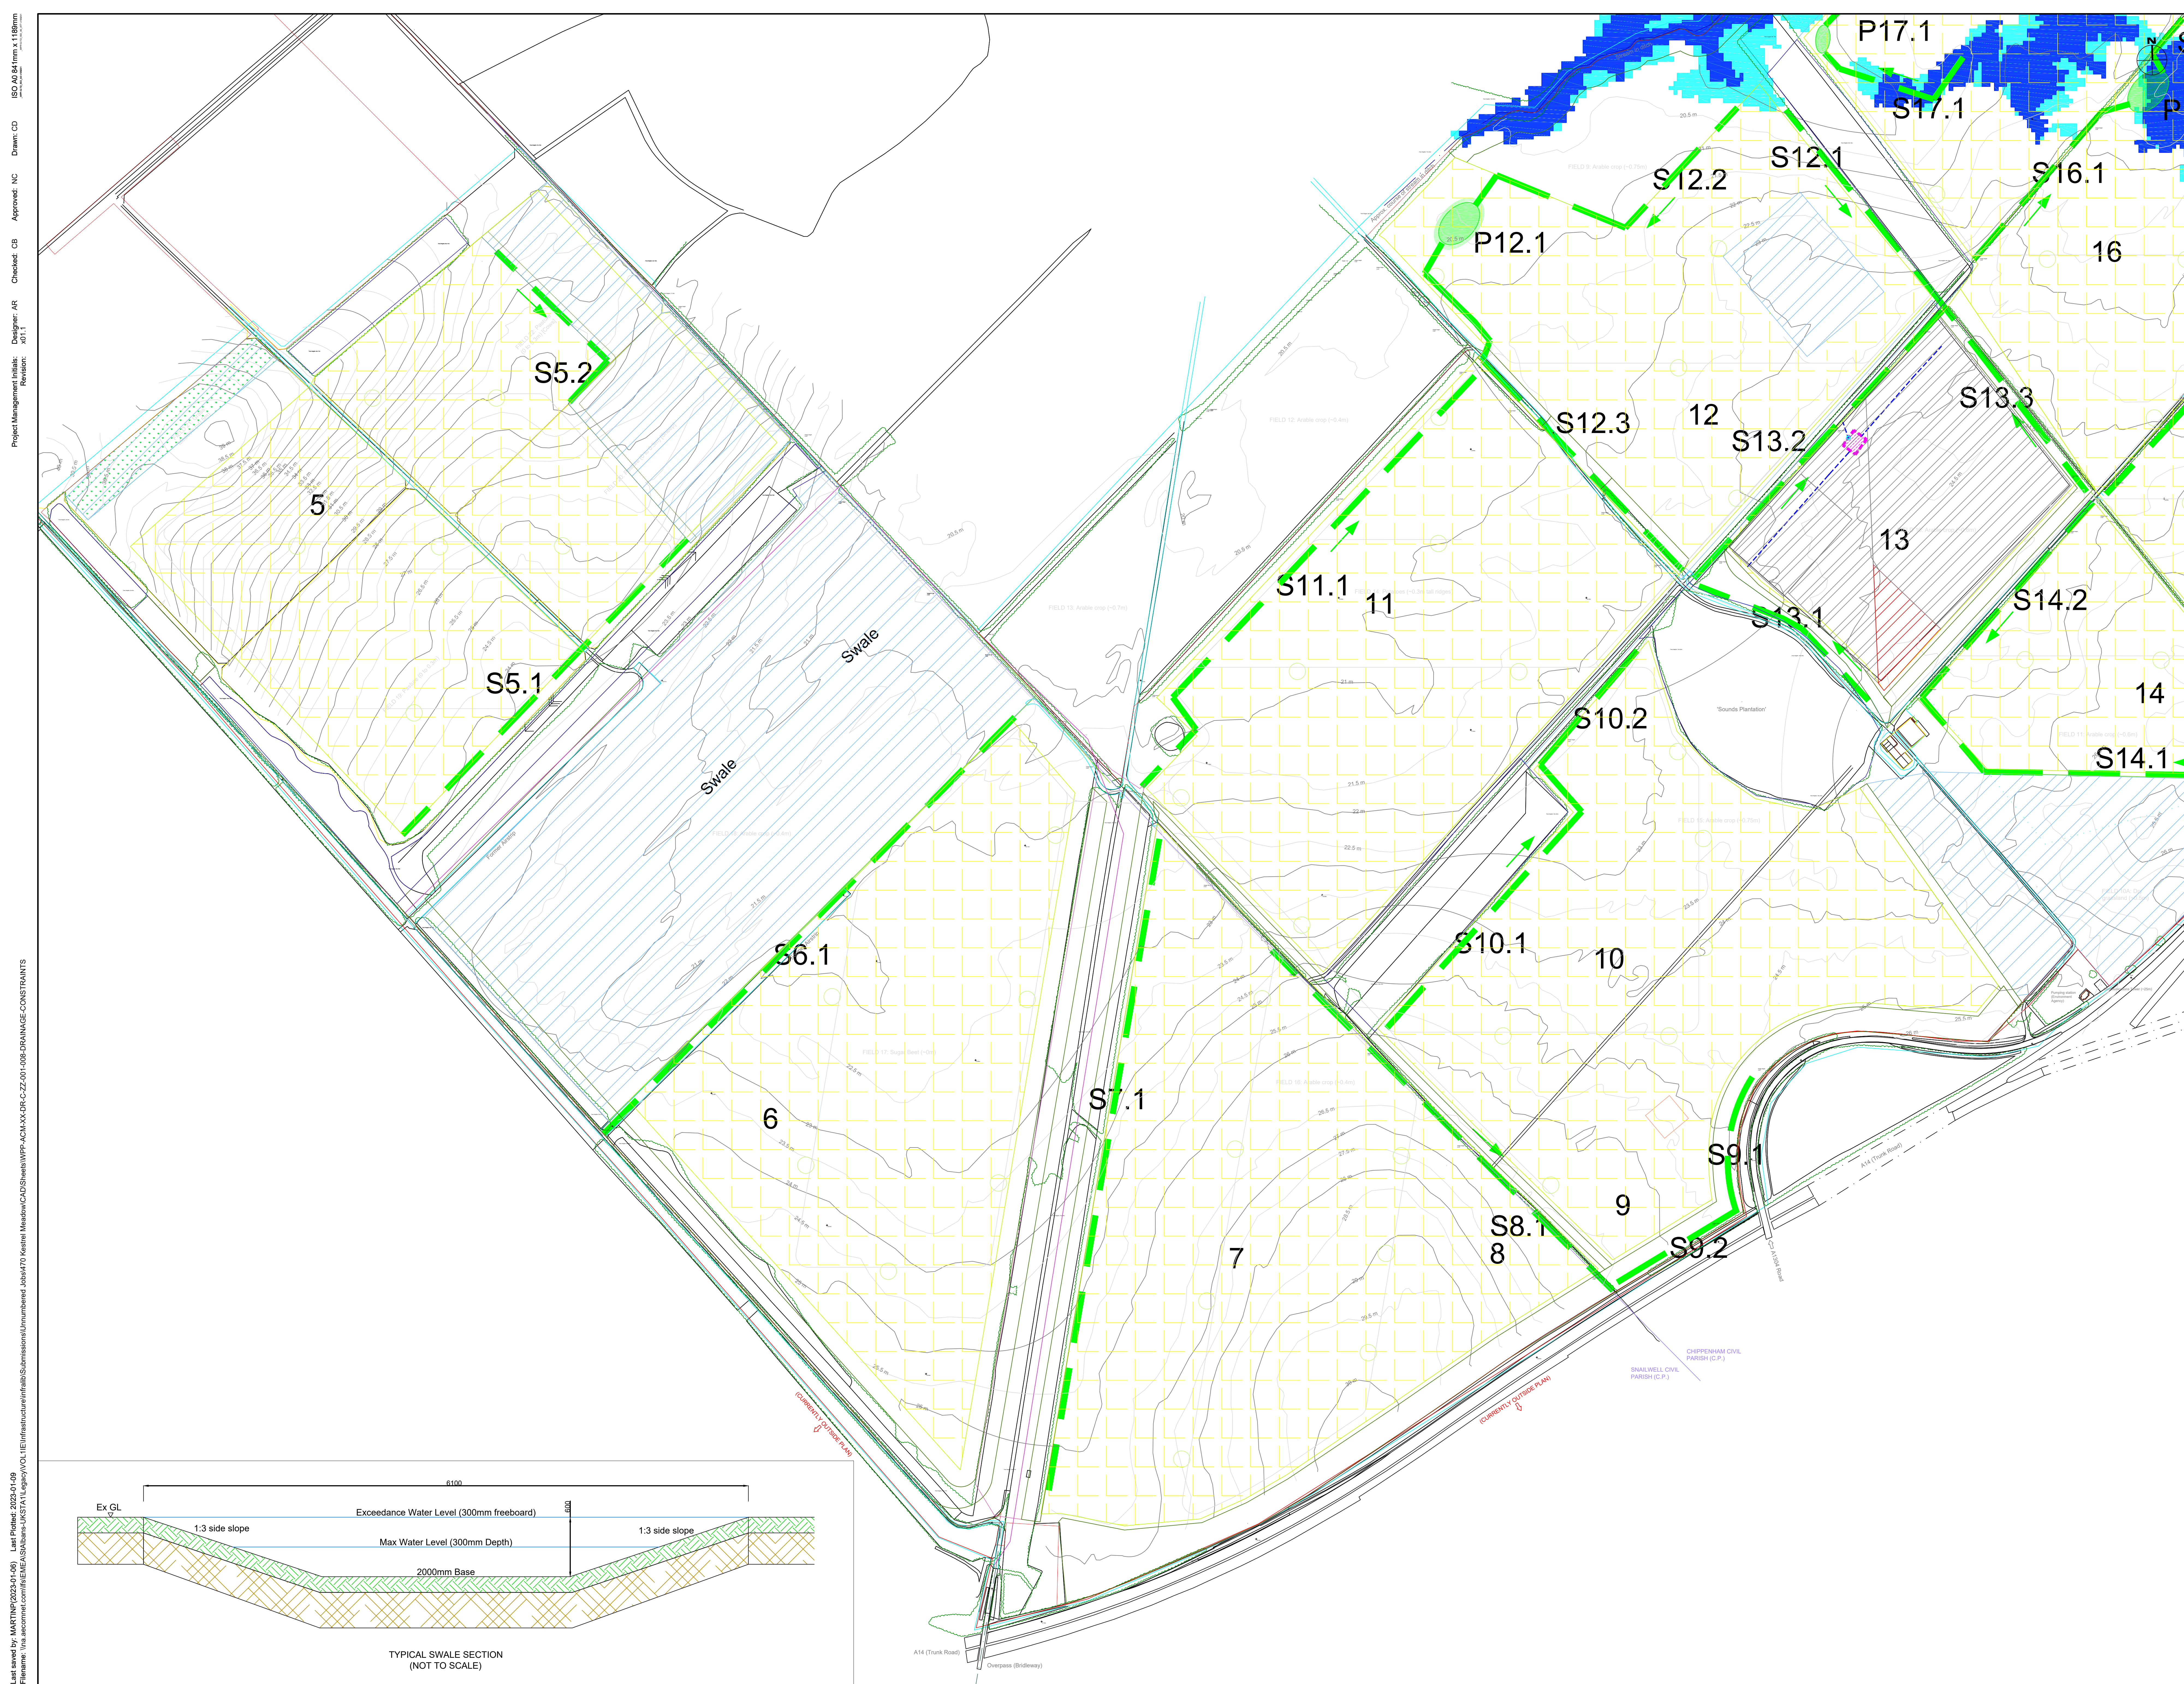

ISO A0 841mm x 1189mm  
 Drawn: CD  
 Approved: NC  
 Checked: CB  
 Designer: AR  
 Project Management Initials: X01.1  
 Revision:



Last saved by: MARTINP(2023-01-06)  
 Last Picked: 2023-01-06  
 Filename: I:\a\acomet.com\file\EM\SUNNICA\Infrastructure\Initials\Sunnicawest\Unnumbered\Job470\Kestrel\Measow\CAD\Sheets\WPP-ACM-XX-DR-C-ZZ-002-008-DRAINAGE-CONSTRAINTS

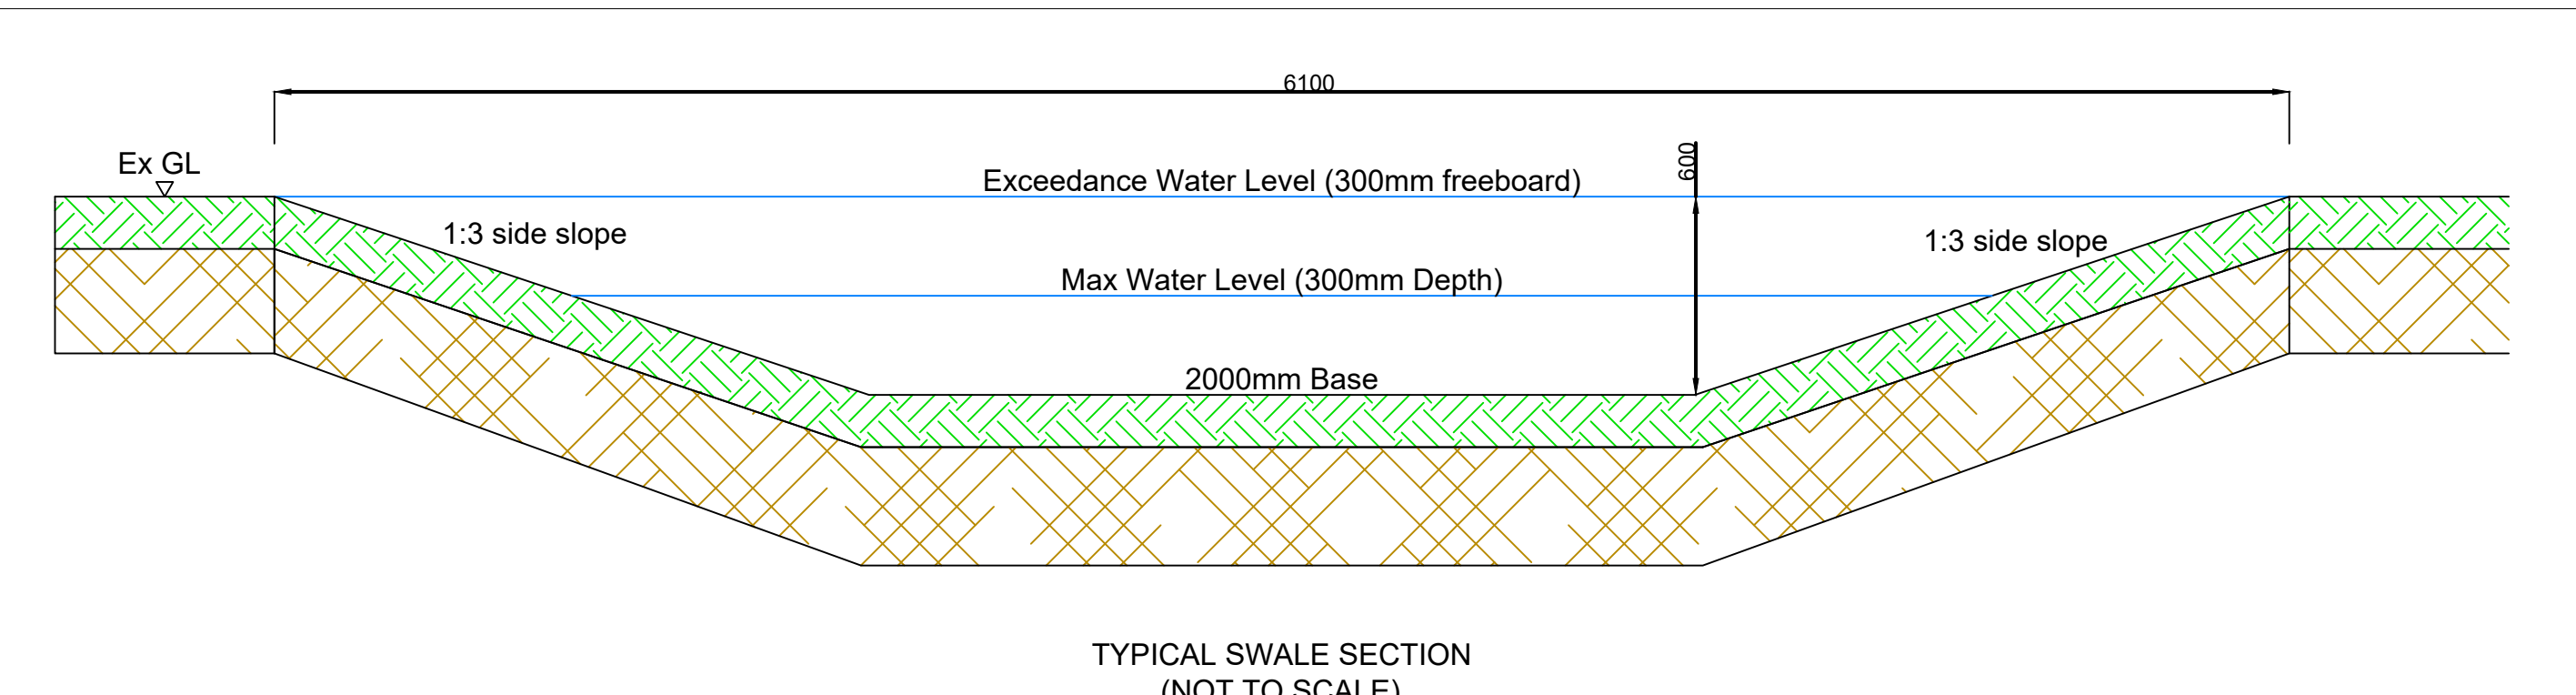

This drawing has been prepared for the use of AECOM's client. It may not be used, modified, reproduced or relied upon by third parties, except as agreed by AECOM or as required by law. AECOM accepts no responsibility, and denies any liability, whatsoever, to any party that uses or relies on this drawing, without AECOM's express written consent. All measurements must be obtained from the stated dimension.




ISO A0 841mm x 1189mm  
 Drawn: CD  
 Approved: NC  
 Checked: CS  
 Designer: AR  
 Project Management Initials: Revision:  
 Last saved by: MARTINP (2023-01-26)  
 File name: I:\a\acomm\com\IE\MS\Sunnica\AKSTA\Legacy\VOL1\IE\Infrastructure\Initials\Sunnica\Unnumbered\Job470\Kestrel\Measow\CAD\Sheets\WPP-ACM-XX-DR-C-ZZ-001-008-DRAINAGE-CONSTRAINTS

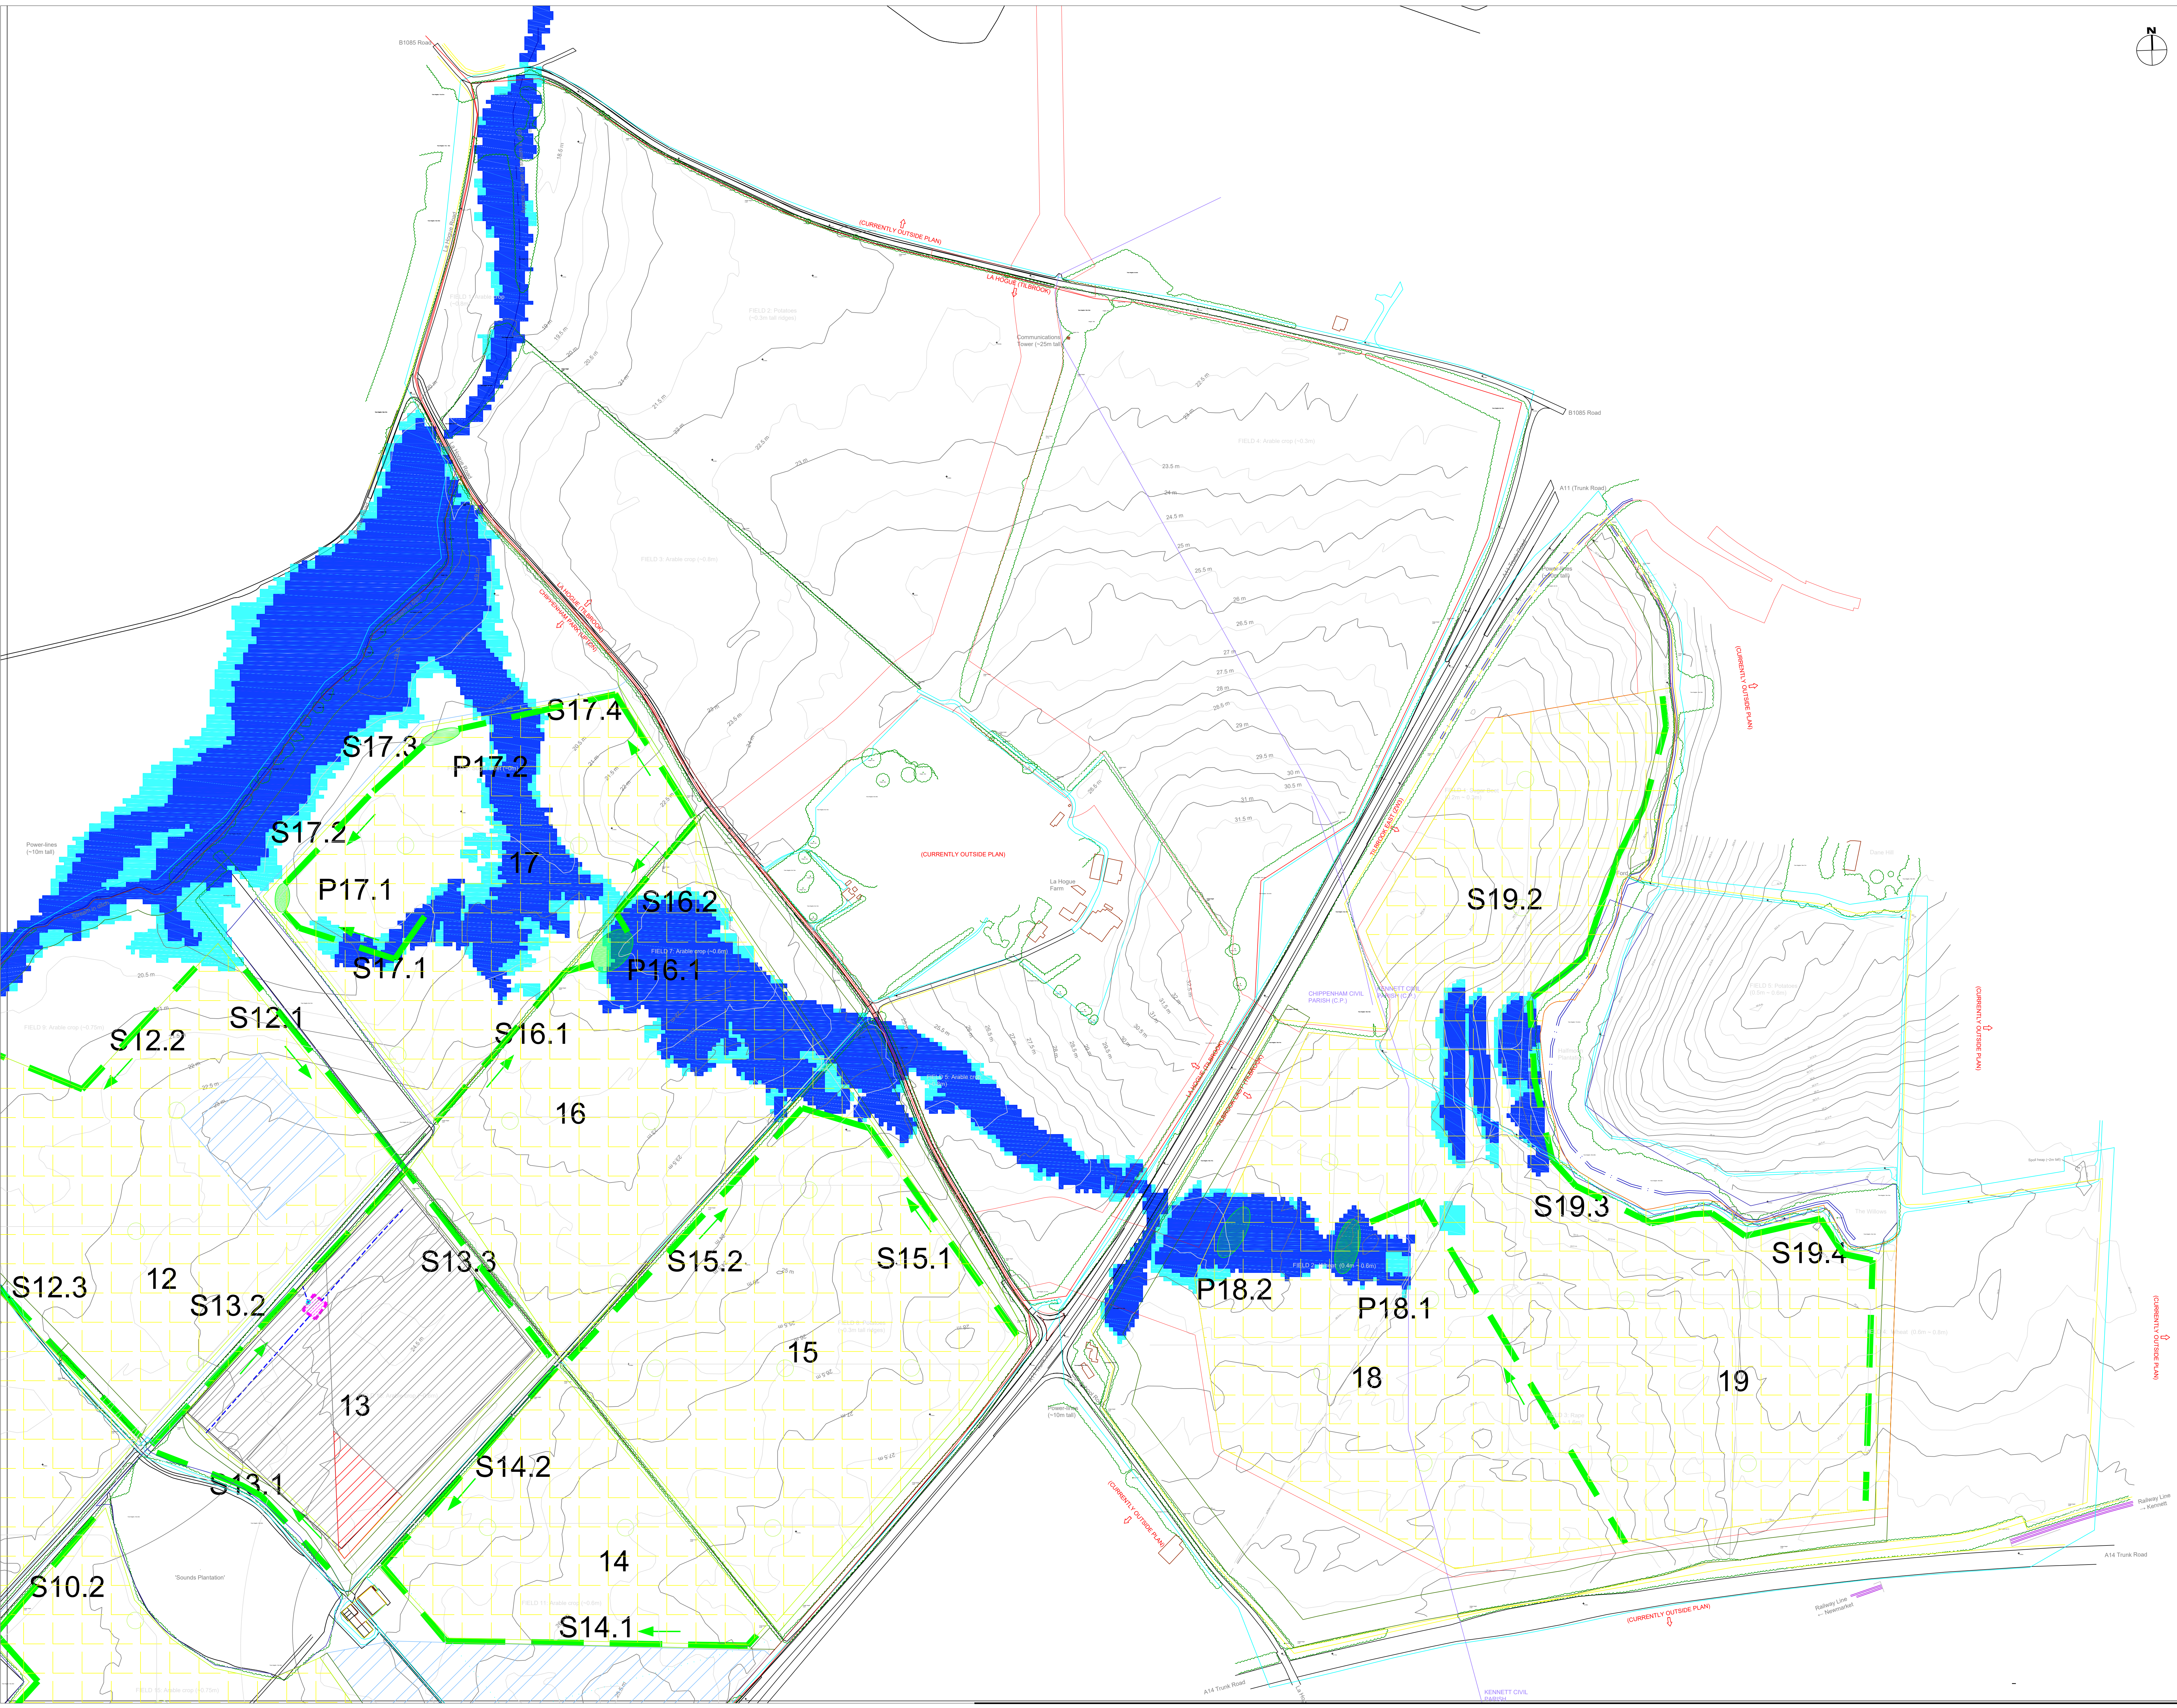

- NOTES**
- DO NOT SCALE FROM THIS DRAWING
  - ALL DIMENSIONS WHERE SHOWN ARE IN MM.
  - SITE LEVELS BASED ON DRONE FLOWN TOPOGRAPHICAL SURVEY BY ABOVE SURVEYS LTD.
  - SITE BACKGROUND TAKEN FROM OS BASE MAP DATASET AND SHOULD NOT BE USED FOR DETAILED DESIGN PURPOSES
  - SITE LAYOUT BASED ON DESIGN SEF\_SOL\_SchemeBoundary\_ParametersPlans\_200715 ITERATION 4 FOR BOTH EAST AND WEST SITES, BY PS RENEWABLES, PLANS UN-DATED.
  - DRAINAGE SWALES PROPOSED WITH INFILTRATION SUBJECT TO FURTHER ON SITE GROUND INVESTIGATIONS. NO PIPED DRAINAGE PROPOSED OTHER THAN OUTLETS TO WATERCOURSES WHERE REQUIRED.
  - HIGH LEVEL DRAINAGE ASSESSMENT IS BASED ON TOPOGRAPHICAL CATCHMENT RUNOFF CONTOUR MODEL, AND NOT CURRENTLY BASED ON DETAILED RUNOFF RATES AND VOLUMES. THIS WILL BE PREPARED AT PLANNING STAGE AND SWALES ADJUSTED TO SUIT IF REQUIRED.
  - NO DRAINAGE ASSESSMENT HAS BEEN CARRIED OUT FOR THE PLANNED MITIGATION AREAS, WHERE NO PV PANEL / COMPOUND AREA DEVELOPMENT IS TAKING PLACE. IT IS ASSUMED THESE AREAS WILL DRAIN AS EXISTING.
  - STORAGE AREAS AND COMPOUNDS HAVE NOT BEEN INCLUDED IN DRAINAGE STRATEGY AS DETAILS ON IMPERMEABLE AREAS ARE NOT KNOWN. THEREFORE ARE ASSUMED TO DRAIN INTO PROPOSED SWALES AND STORAGE BASINS.
  - THE DESIGN OF PV PANEL LAYOUTS, BY OTHERS, IS ASSUMED TO HAVE CONSIDERED ACCESS AND MAINTENANCE REQUIREMENTS. ACCESS AROUND FIELDS IS ASSUMED TO BE PROVIDED AS A NATURAL BUFFER BETWEEN FENCES AND PANELS AND WILL FACILITATE ACCESS TO MAINTAIN SWALES AND BASINS.

**KEY PLAN - WEST SIDE**

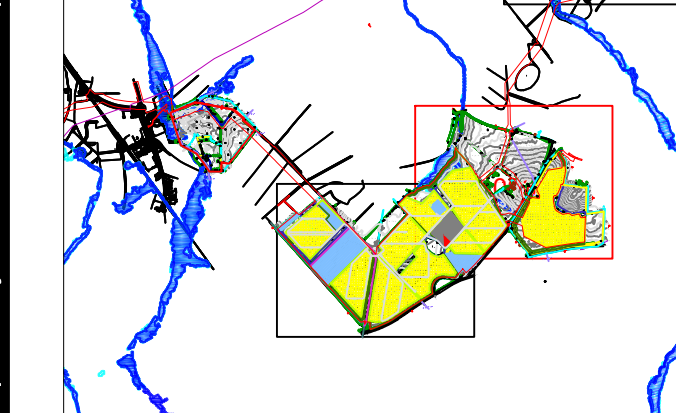

**KEY**

[Red dashed line]	RED LINE BOUNDARY
[Yellow hatched]	SOLAR FIELD AREA
[Blue hatched]	ARCHAEOLOGICAL MITIGATION AREA
[Red hatched]	COMPOUND AREA (PERMANENT)
[Green hatched]	ECOLOGY ENHANCEMENT
[Blue hatched]	ECOLOGY ENHANCEMENT WETLAND
[Blue hatched]	RETAINED WOODLAND
[Blue hatched]	BATTERY STORAGE / COMPOUND
[Green dashed line]	SWALE (0.6m DEEP)
[Green dashed line]	INFILTRATION BASIN (0.6m DEEP)
[Green dashed line]	FIRE WATER STORAGE LAGOON WITH PENSTOCK
[Red dashed line]	FIREWATER DRAINAGE ROUTE
[Blue dashed line]	FLOOD ZONE 3
[Blue dashed line]	FLOOD ZONE 2

**ISSUE/REVISION**

IR	DATE	DESCRIPTION
P6	06.01.23	BOUNDARY UPDATE
P5	22.11.22	BOUNDARY / FEH UPDATE
P4	19.10.21	BOUNDARY UPDATE
P3	09.07.21	BOUNDARY / DESIGN UPDATE
P2	03.08.20	BOUNDARY UPDATE
P1	04.10.19	PRELIMINARY


**ISSUE PURPOSE / SUITABILITY**

This drawing has been prepared for the use of AECOM's client. It may not be used, modified, reproduced or relied upon by third parties, except as agreed by AECOM or as required by law. AECOM accepts no responsibility, and denies any liability, whatsoever, to any party that uses or relies on this drawing, without AECOM's express written consent. All measurements must be obtained from the stated dimensions.



- NOTES**
- DO NOT SCALE FROM THIS DRAWING
  - ALL DIMENSIONS WHERE SHOWN ARE IN MM
  - SITE LEVELS BASED ON DRONE FLOWN TOPOGRAPHICAL SURVEY BY ABOVE SURVEYS LTD.
  - SITE BACKGROUND TAKEN FROM OS BASE MAP DATASET AND SHOULD NOT BE USED FOR DETAILED DESIGN PURPOSES
  - SITE LAYOUT BASED ON DESIGN SET: SOL\_SchemaBoundary\_ParametersPlans\_200715 ITERATION 4 FOR BOTH EAST AND WEST SITES BY PS RENEWABLES, PLANS UN-DATED.
  - DRAINAGE SWALES PROPOSED WITH INFILTRATION SUBJECT TO FURTHER ON SITE GROUND INVESTIGATIONS. NO PIPED DRAINAGE PROPOSED OTHER THAN OUTLETS TO WATERCOURSES WHERE REQUIRED.
  - HIGH LEVEL DRAINAGE ASSESSMENT IS BASED ON TOPOGRAPHICAL CATCHMENT RUNOFF CONTOUR MODEL, AND NOT CURRENTLY BASED ON DETAILED RUNOFF RATES AND VOLUMES; THIS WILL BE PREPARED AT PLANNING STAGE AND SWALES ADJUSTED TO SUIT IF REQUIRED.
  - NO DRAINAGE ASSESSMENT HAS BEEN CARRIED OUT FOR THE PLANNED MITIGATION AREAS, WHERE NO PV PANEL / COMPOUND AREA DEVELOPMENT IS TAKING PLACE. IT IS ASSUMED THESE AREAS WILL DRAIN AS EXISTING.
  - STORAGE AREAS AND COMPOUNDS HAVE NOT BEEN INCLUDED IN DRAINAGE STRATEGY AS DETAILS ON IMPERMEABLE AREAS ARE NOT KNOWN, THEREFORE ARE ASSUMED TO DRAIN INTO PROPOSED SWALES AND STORAGE BASINS.
  - THE DESIGN OF PV PANEL LAYOUTS, BY OTHERS, IS ASSUMED TO HAVE CONSIDERED ACCESS AND MAINTENANCE REQUIREMENTS AROUND FIELDS. ACCESS IS ASSUMED TO BE PROVIDED AS A NATURAL BUFFER BETWEEN FENCES AND PANELS AND WILL FACILITATE ACCESS TO MAINTAIN SWALES AND BASINS.

**KEY PLAN - EAST SIDE**

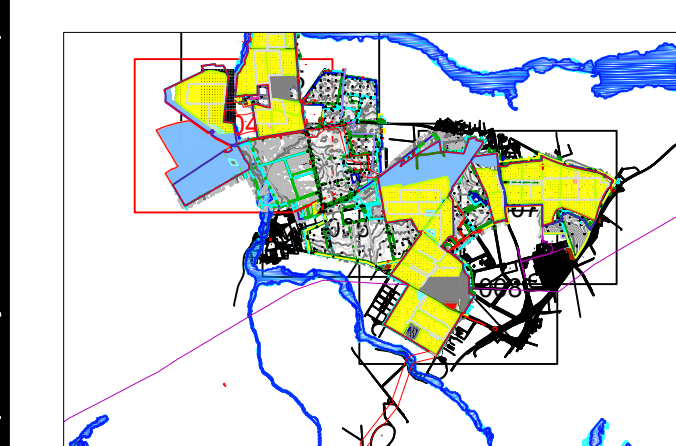

- KEY**
- LAYOUT
  - RED LINE BOUNDARY
  - SOLAR FIELD AREA
  - ARCHAEOLOGICAL MITIGATION AREA
  - COMPOUND AREA (PERMANENT)
  - ECOLOGY ENHANCEMENT
  - ECOLOGY ENHANCEMENT WETLAND
  - RETAINED WOODLAND
  - BATTERY STORAGE / COMPOUND
  - SWALE (0.6m DEEP)
  - INFILTRATION BASIN (0.6m DEEP)
  - FIRE WATER STORAGE LAGOON WITH PENSTOCK
  - FIREWATER DRAINAGE ROUTE
  - FLOOD ZONE 3
  - FLOOD ZONE 2

**ISSUE/REVISION**


IR	DATE	DESCRIPTION
P6	06.01.23	BOUNDARY UPDATE
P5	22.11.22	BOUNDARY / FEH UPDATE
P4	19.10.21	BOUNDARY UPDATE
P3	09.07.21	BOUNDARY / DESIGN UPDATE
P2	03.08.20	BOUNDARY UPDATE
P1	04.10.19	PRELIMINARY

**ISSUE PURPOSE / SUITABILITY**

**PROJECT NUMBER**  
 60589004

**SHEET TITLE**  
 SUNNICA ENERGY FARM  
 DRAINAGE STRATEGY  
 GENERAL ARRANGEMENT  
 EAST SIDE (SHEET 1 OF 5)

**SHEET NUMBER**  
 WPP-ACM-XX-DR-C-ZZ-004

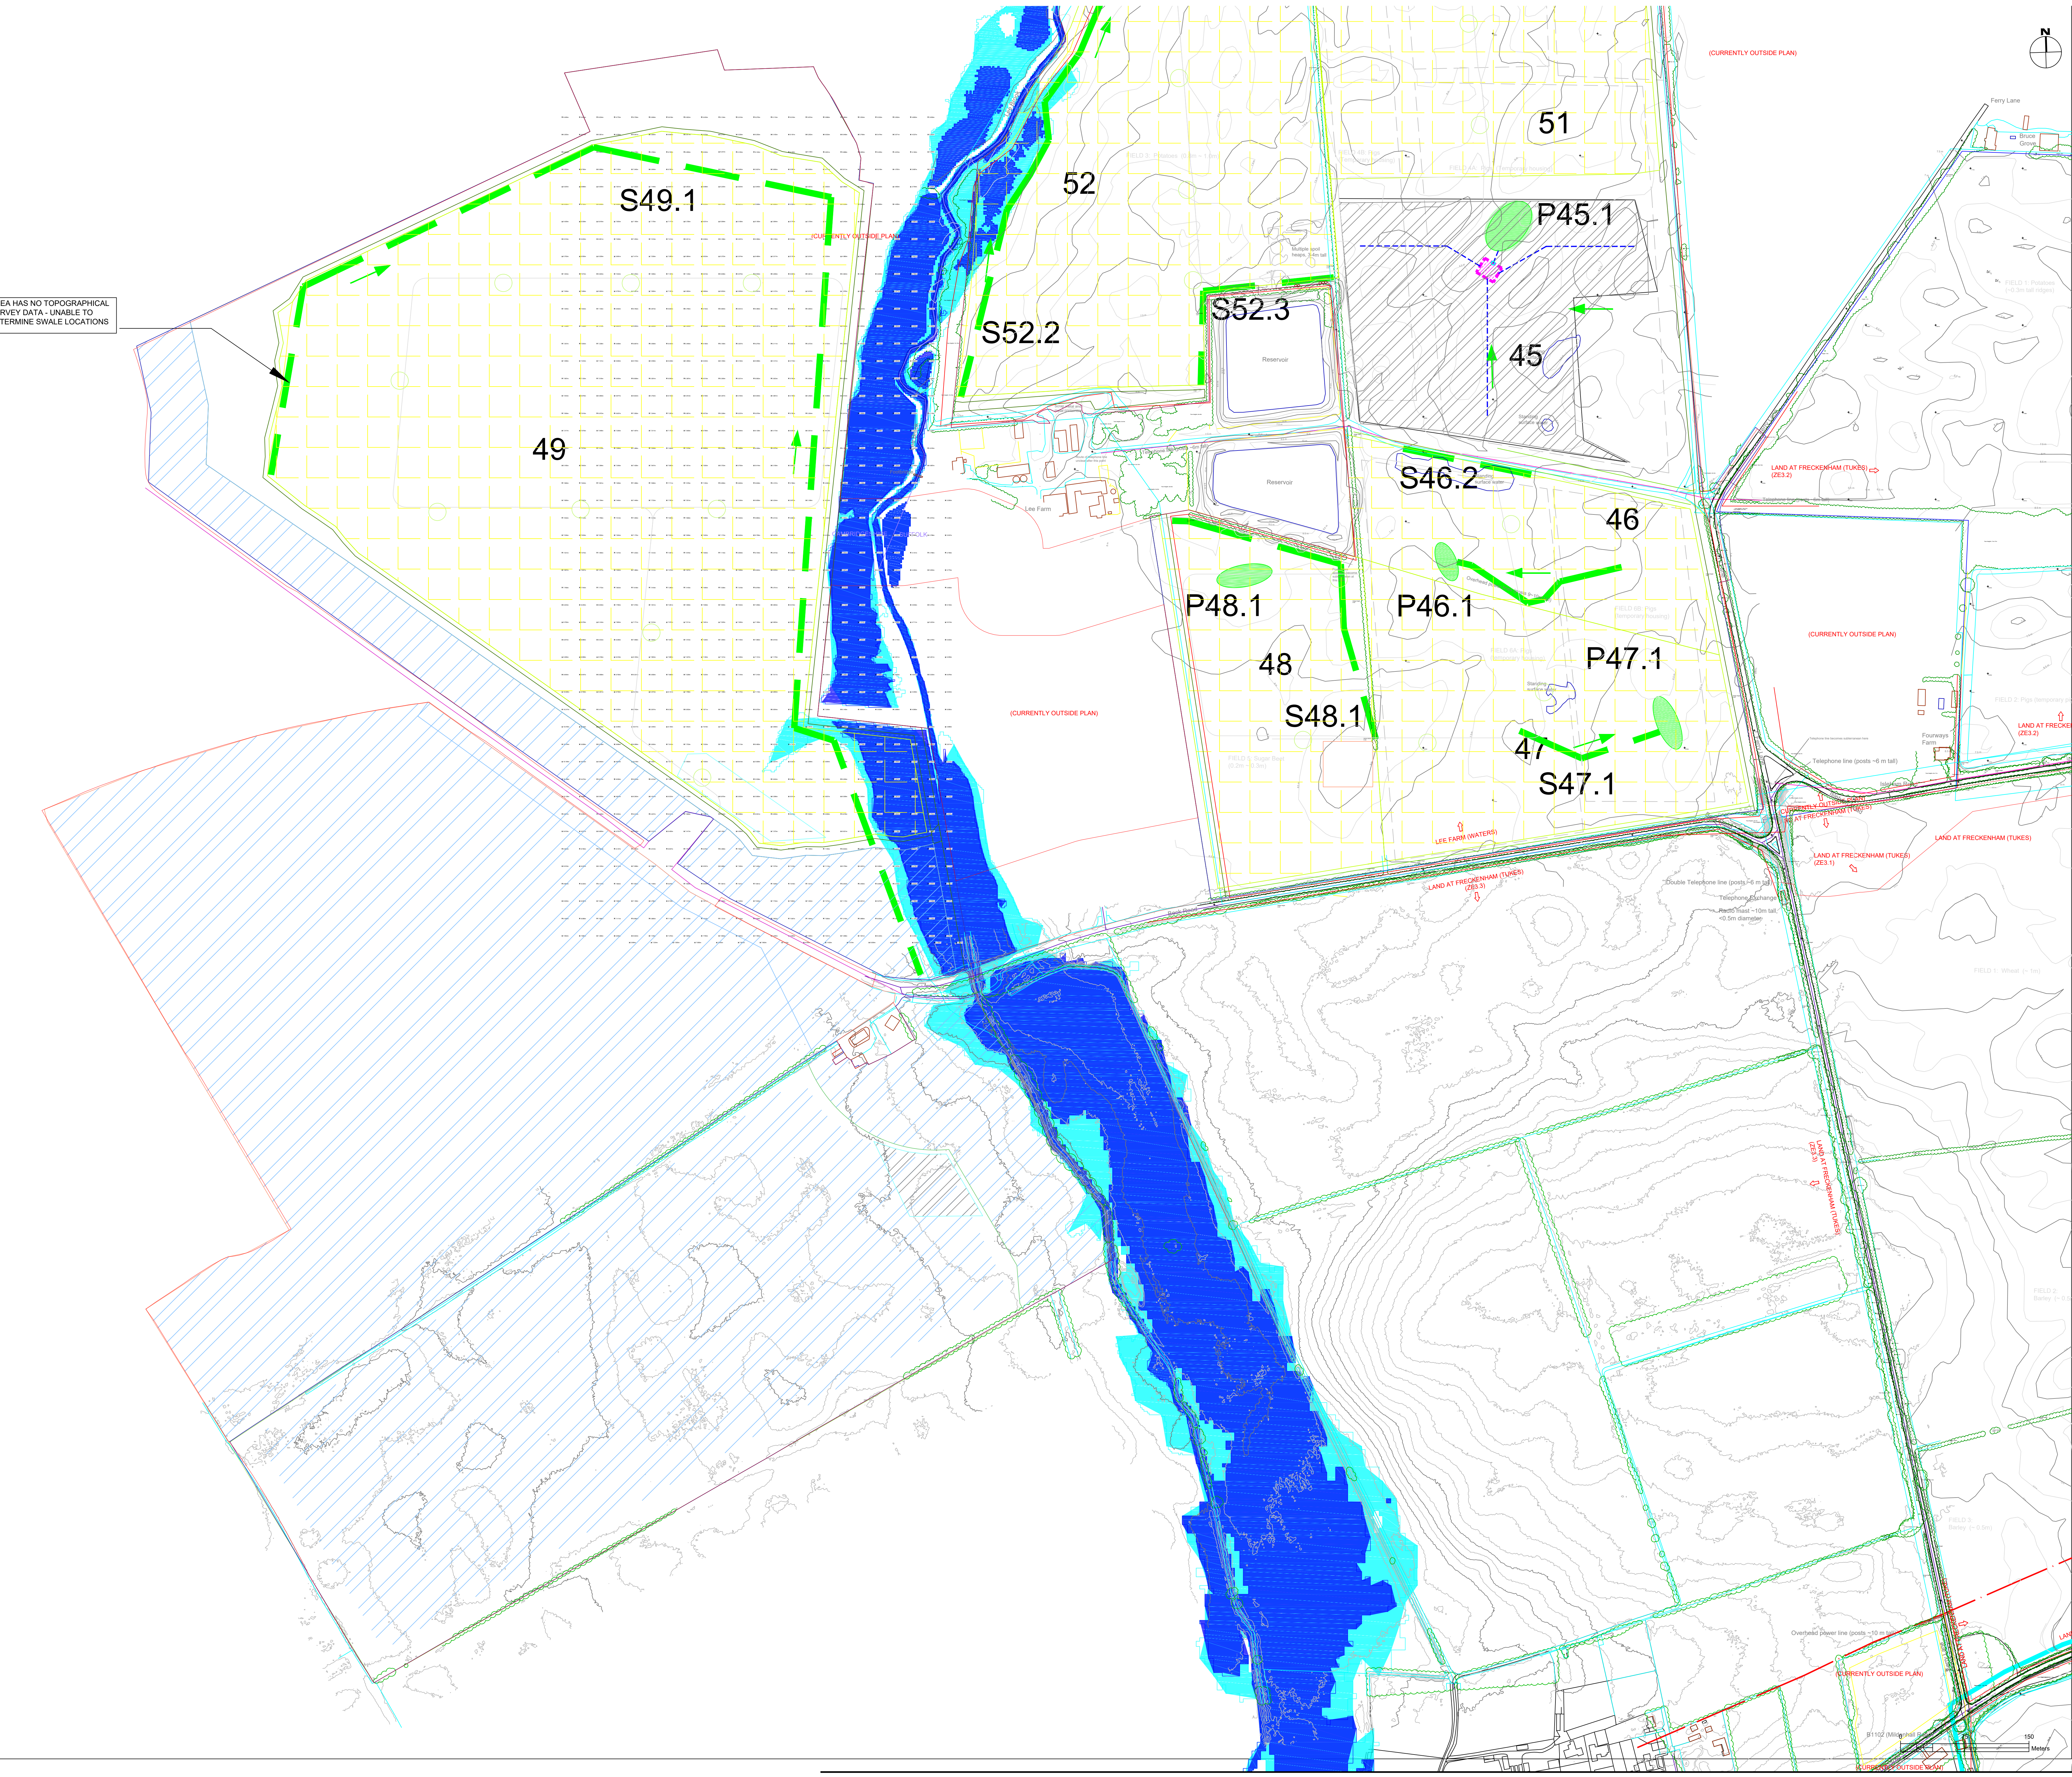


AREA HAS NO TOPOGRAPHICAL SURVEY DATA - UNABLE TO DETERMINE SWALE LOCATIONS

This drawing has been prepared for the use of AECOM's client. It may not be used, modified, reproduced or relied upon by third parties, except as agreed by AECOM or as required by law. AECOM accepts no responsibility, and denies any liability, whatsoever to any party that uses or relies on this document. All measurements must be obtained from the stated dimensions.




ISO A0 841mm x 1189mm  
 Drawn: CD  
 Approved: NC  
 Checked: CS  
 Designer: AR  
 Project Management Initials: Revision:  
 Last saved by: MARTINP(2023-01-08)  
 Last Pinned: 2023-01-08  
 Filename: I:\a\acomet\com\file\ME\SUNNICAS\AL1\STAT1\Legacy\VOL1\Infrastructure\Initials\Sunnicas\Unnumbered\Job470\Kestrel Meadow\CAD\Sheets\WPP-ACM-XX-DR-C-ZZ-09-108-DRAINAGE-CONSTRAINTS

- NOTES**
- DO NOT SCALE FROM THIS DRAWING
  - ALL DIMENSIONS WHERE SHOWN ARE IN MM.
  - SITE LEVELS BASED ON DRONE FLOWN TOPOGRAPHICAL SURVEY BY ABOVE SURVEYS LTD.
  - SITE BACKGROUND TAKEN FROM OS BASE MAP DATASET AND SHOULD NOT BE USED FOR DETAILED DESIGN PURPOSES
  - SITE LAYOUT BASED ON DESIGN SEF\_S04\_SchemeBoundary\_ParameterPlans\_200715 ITERATION 4 FOR BOTH EAST AND WEST SITES BY PS RENEWABLES, PLANS UN-DATED.
  - DRAINAGE SWALES PROPOSED WITH INFILTRATION SUBJECT TO FURTHER ON SITE GROUND INVESTIGATIONS. NO PIPED DRAINAGE PROPOSED OTHER THAN OUTLETS TO WATERCOURSES WHERE REQUIRED.
  - HIGH LEVEL DRAINAGE ASSESSMENT IS BASED ON TOPOGRAPHICAL CATCHMENT RUNOFF CONTOUR MODEL, AND NOT CURRENTLY BASED ON DETAILED RUNOFF RATES AND VOLUMES. THIS WILL BE PREPARED AT PLANNING STAGE AND SWALES ADJUSTED TO SUIT IF REQUIRED.
  - NO DRAINAGE ASSESSMENT HAS BEEN CARRIED OUT FOR THE PLANNED MITIGATION AREAS, WHERE NO PV PANEL / COMPOUND AREA DEVELOPMENT IS TAKING PLACE. IT IS ASSUMED THESE AREAS WILL DRAIN AS EXISTING.
  - STORAGE AREAS AND COMPOUNDS HAVE NOT BEEN INCLUDED IN DRAINAGE STRATEGY AS DETAILS ON IMPERMEABLE AREAS ARE NOT KNOWN. THEREFORE ARE ASSUMED TO DRAIN INTO PROPOSED SWALES AND STORAGE BASINS.
  - THE DESIGN OF PV PANEL LAYOUTS, BY OTHERS IS ASSUMED TO HAVE CONSIDERED ACCESS AND MAINTENANCE REQUIREMENTS. ACCESS AROUND FIELDS IS ASSUMED TO BE PROVIDED AS A NATURAL BUFFER BETWEEN FENCES AND PANELS AND WILL FACILITATE ACCESS TO MAINTAIN SWALES AND BASINS.

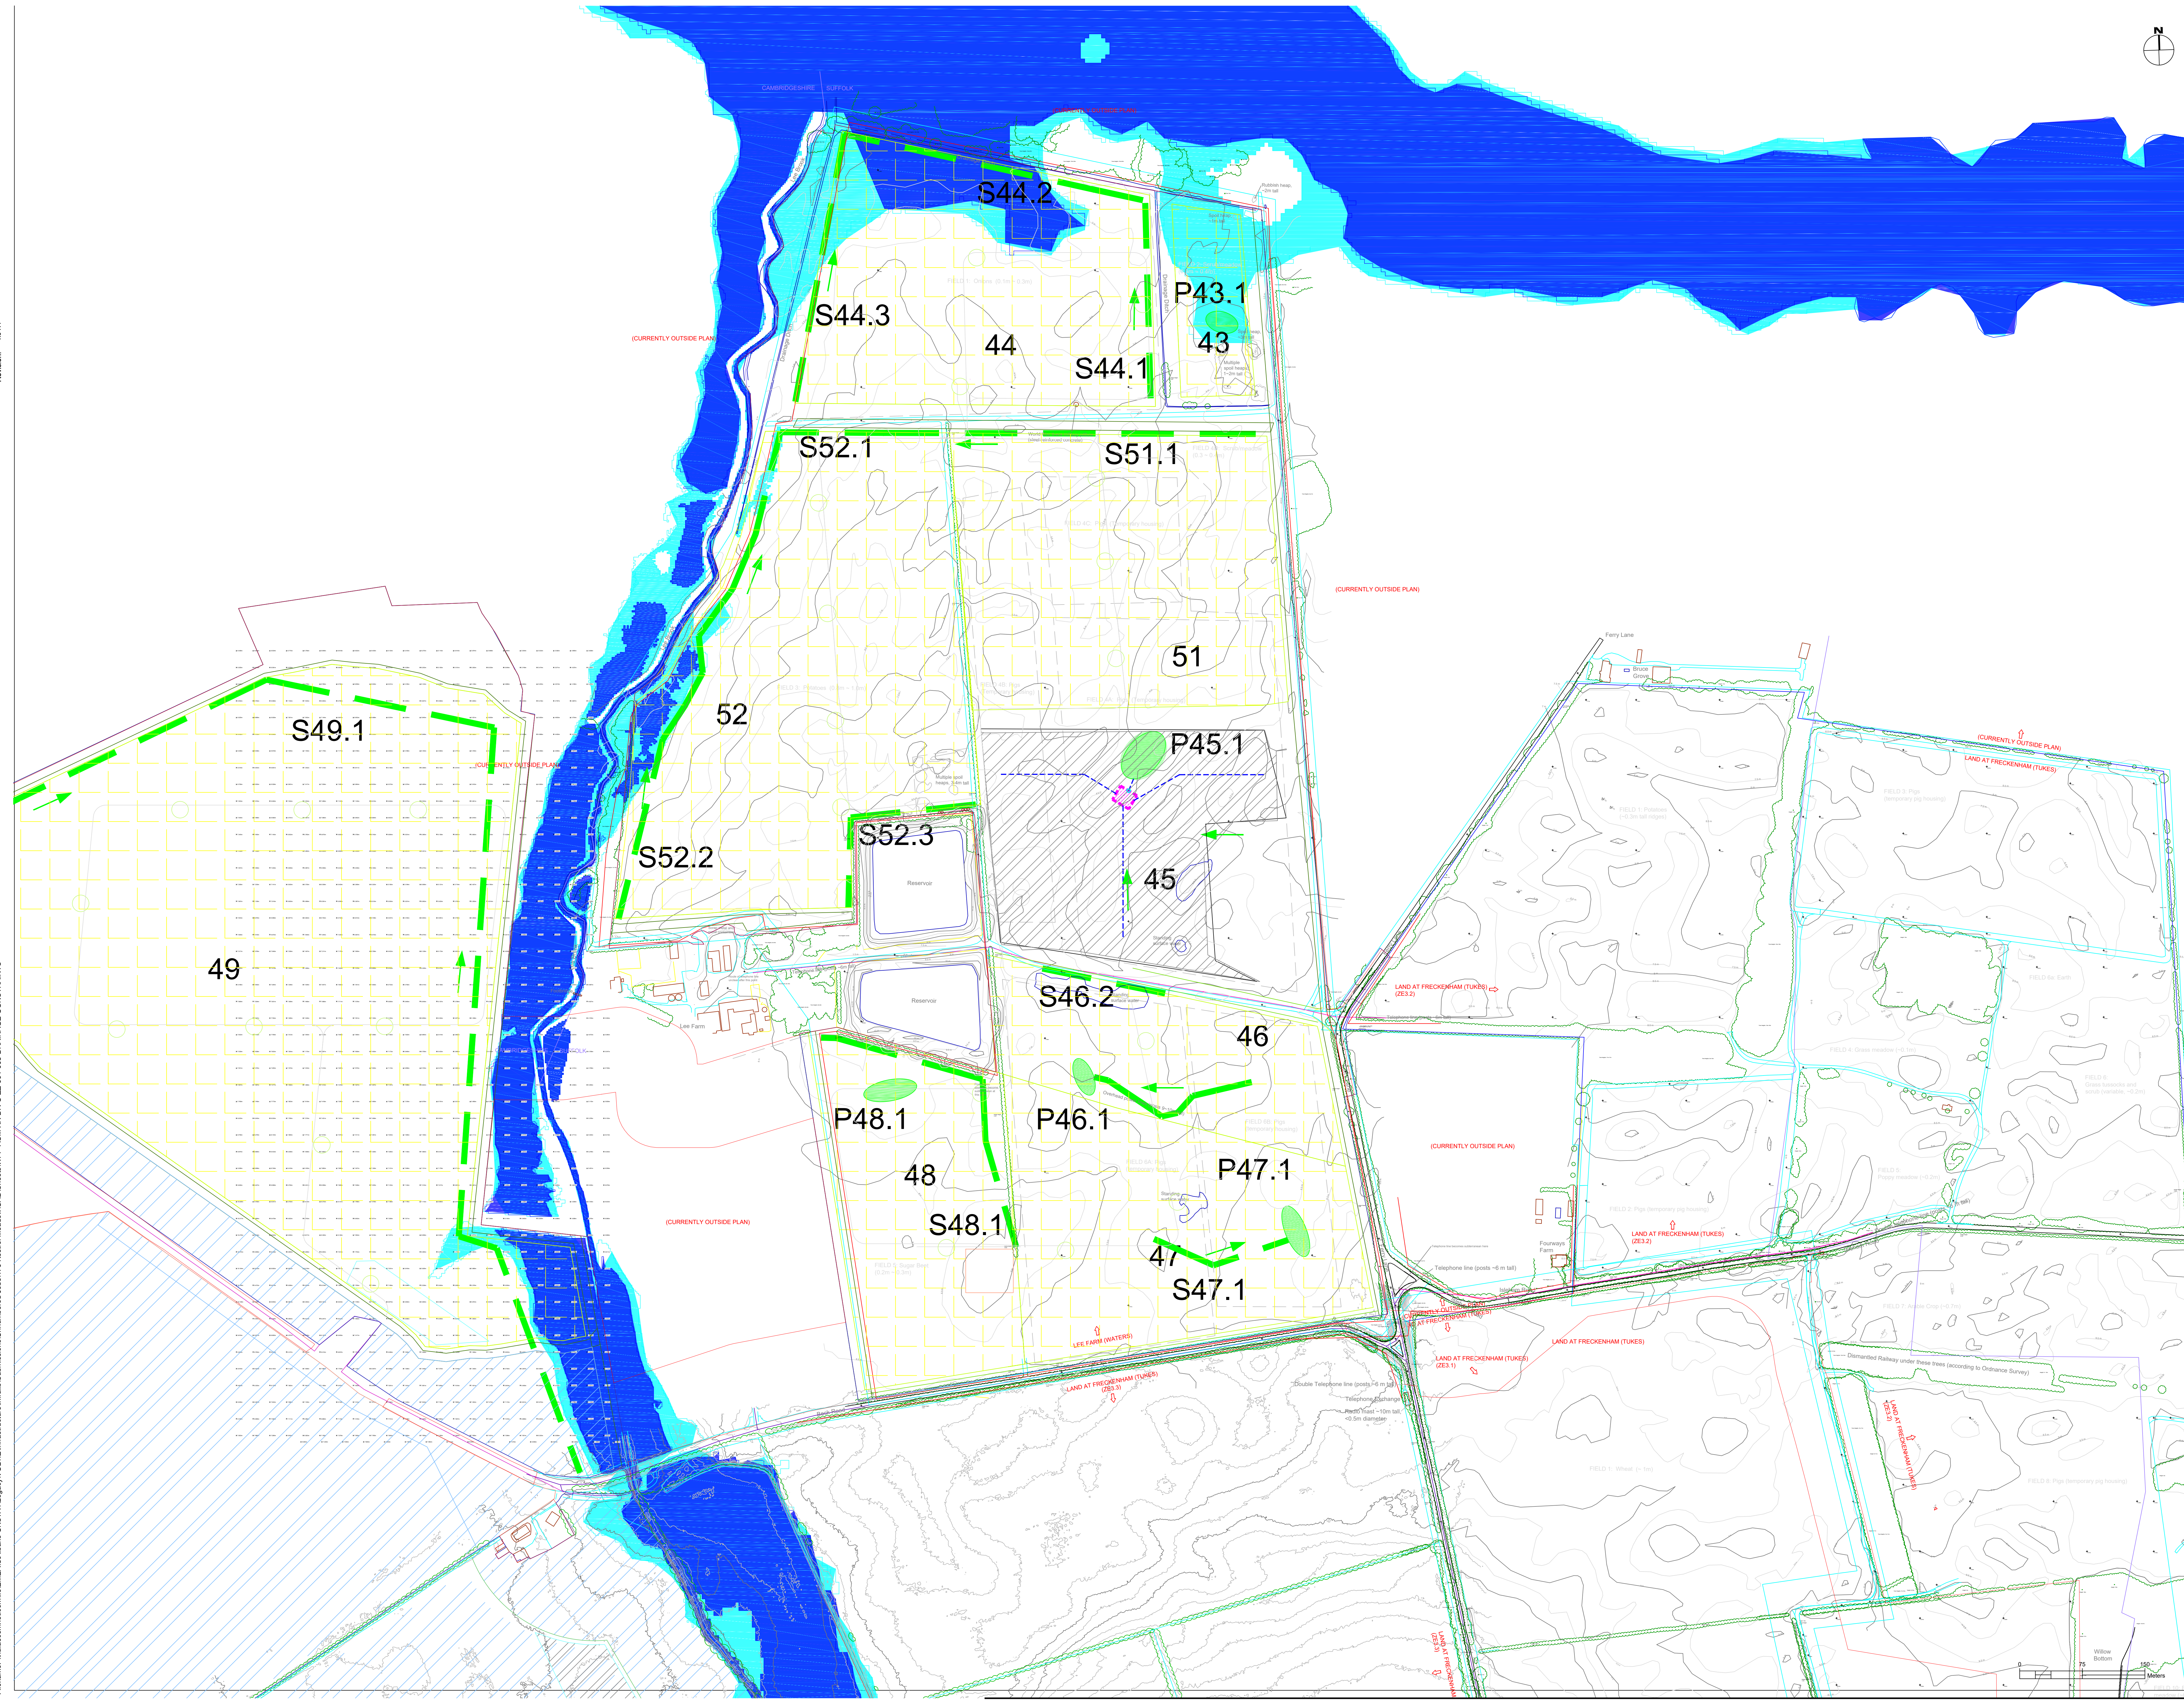

**KEY PLAN - EAST SIDE**

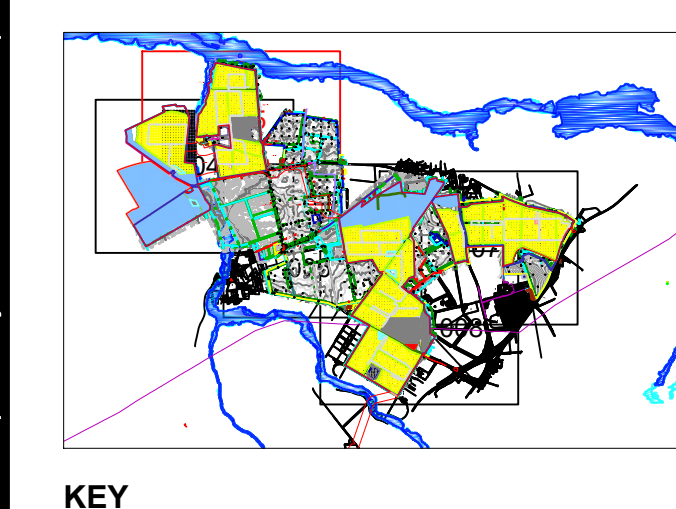

**KEY**

LAYOUT	DESCRIPTION
[Red line]	RED LINE BOUNDARY
[Yellow grid]	SOLAR FIELD AREA
[Red hatched]	ARCHAEOLOGICAL MITIGATION AREA
[Blue hatched]	COMPOUND AREA (PERMANENT)
[Green hatched]	ECOLOGY ENHANCEMENT
[Light blue hatched]	ECOLOGY ENHANCEMENT WETLAND
[Dark blue hatched]	RETAINED WOODLAND
[Purple hatched]	BATTERY STORAGE / COMPOUND
[Green dashed]	SWALE (0.6m DEEP)
[Green dashed]	SWALE (0.3m DEEP)
[Green dashed]	INFILTRATION BASIN
[Green dashed]	FIRE WATER STORAGE LAGOON WITH PENSTOCK
[Red dashed]	FIREWATER DRAINAGE ROUTE
[Blue dashed]	FLOOD ZONE 3
[Light blue dashed]	FLOOD ZONE 2


**ISSUE/REVISION**

NO	DATE	DESCRIPTION
P6	06.01.23	BOUNDARY UPDATE
P5	22.11.22	BOUNDARY / FENH UPDATE
P4	19.10.21	BOUNDARY UPDATE
P3	09.07.21	BOUNDARY / DESIGN UPDATE
P2	03.08.20	BOUNDARY UPDATE
P1	04.10.19	PRELIMINARY
IR	DATE	DESCRIPTION

**ISSUE PURPOSE / SUITABILITY**




ISO A0 841mm x 1189mm  
 Drawn: CD  
 Approved: NC  
 Checked: CS  
 Designer: AR  
 Project Management Initials: Revision:  
 Last saved by: MARTINP (2023-01-06)  
 Last Pinned: 2023-01-06  
 Filename: I:\a\acomet.com\GIS\ESTIA\Legacy\VOL1\Infrastructure\Initials\Sumissions\Unnumbered\Job470\Kestrel\MeadowCAD\Sheets\WPP-ACM-XX-DR-C-ZZ-001-008-DRAINAGE-CONSTRAINTS

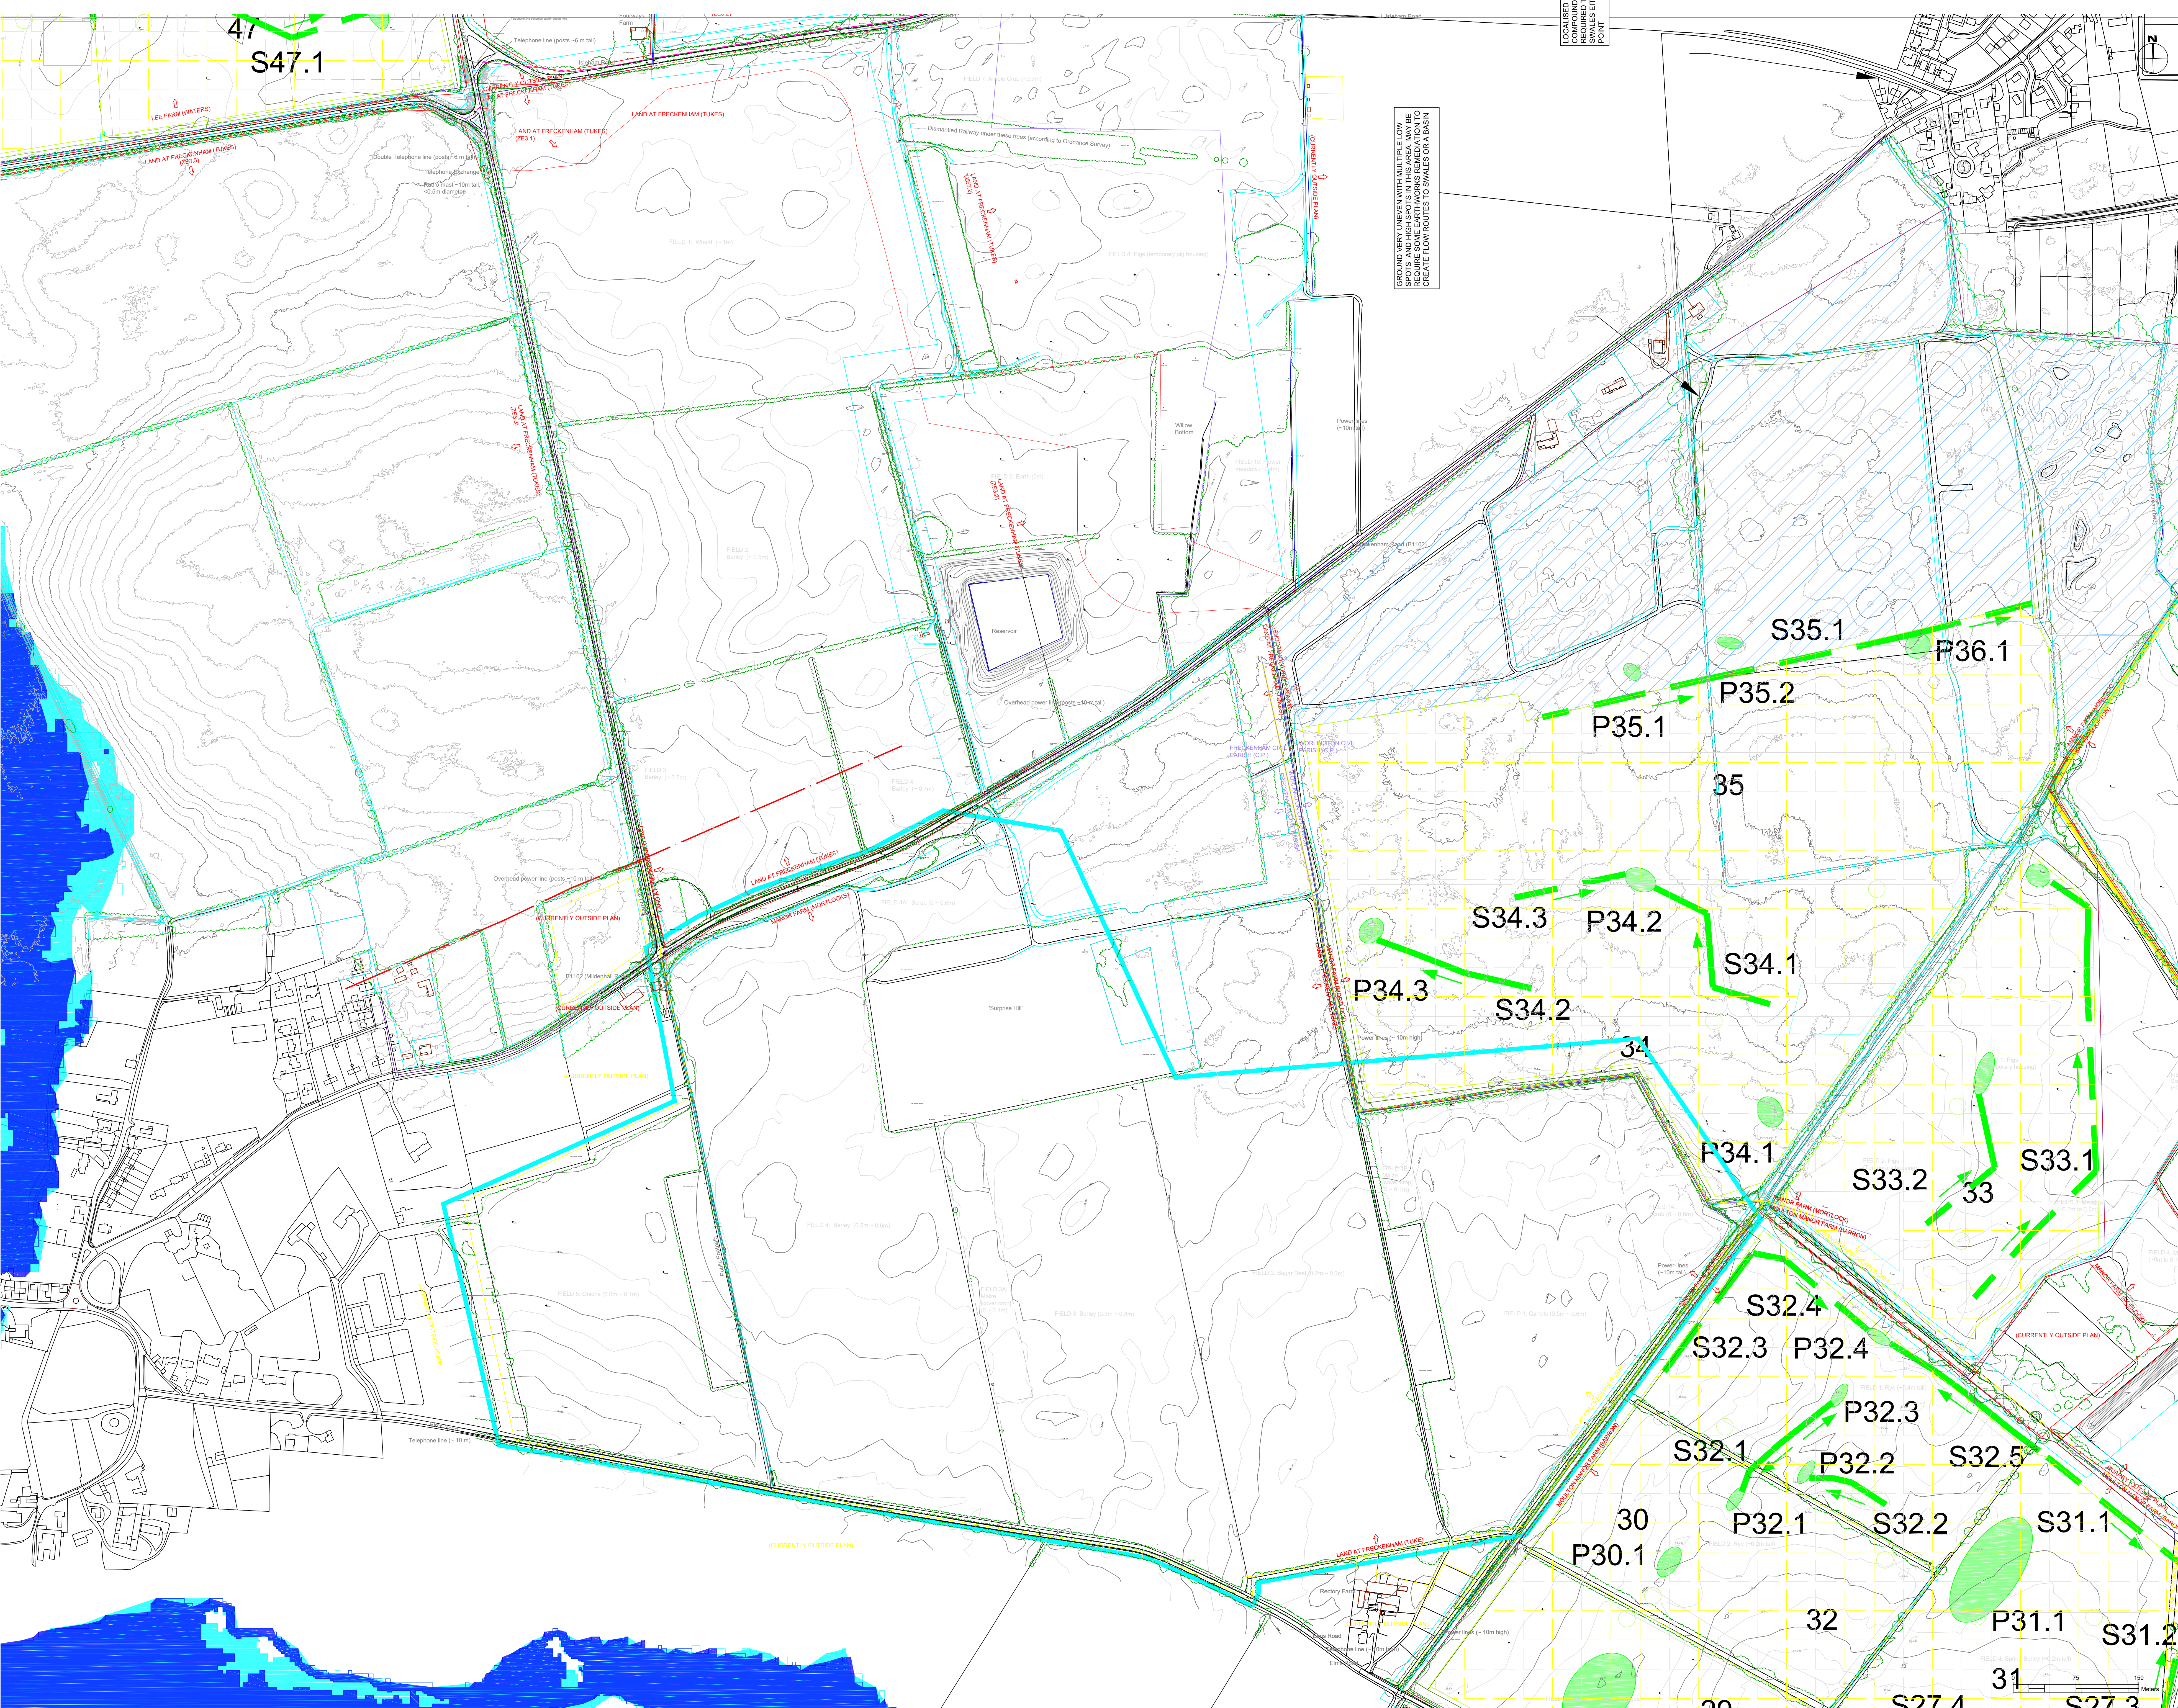

LOCALISED DRAINAGE CONSTRAINTS  
 COMPUND ARE SWALES EITHER POINT

LOCALISED DRAINAGE CONSTRAINTS  
 COMPUND ARE SWALES EITHER POINT

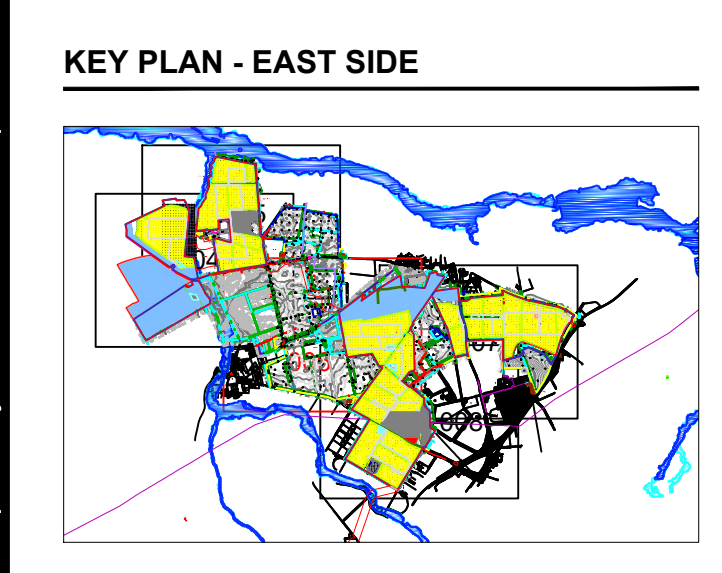

KEY


LAYOUT	RED LINE BOUNDARY
SOLAR FIELD AREA	ARCHAEOLOGICAL MITIGATION AREA
COMPUND AREA (PERMANENT)	ECOLOGY ENHANCEMENT
ECOLOGY ENHANCEMENT	ECOLOGY ENHANCEMENT WETLAND
RETAINED HOODLAND	BATTERY STORAGE / COMPOUND
SWALE (0.6m DEEP)	INFILTRATION BASIN (0.6m DEEP)
FIRE WATER STORAGE LAGOON WITH PENSTOCK	FRESHWATER DRAINAGE ROUTE
FLOOD ZONE 3	FLOOD ZONE 2

ISSUE/REVISION


IR	DATE	DESCRIPTION
P6	06.01.23	BOUNDARY UPDATE
P5	22.11.22	BOUNDARY / FEH UPDATE
P4	19.10.21	BOUNDARY UPDATE
P3	09.07.21	BOUNDARY / DESIGN UPDATE
P2	03.08.20	BOUNDARY UPDATE
P1	04.10.19	PRELIMINARY



ISO A0 841mm x 1189mm  
 Drawn: CD  
 Approved: NC  
 Checked: CS  
 Designer: AR  
 Project Management Initials: Revision:  
 Last saved by: MARTINP(2023-01-06)  
 Last Pinned: 2023-01-09  
 Filename: I:\aecom\clients\EME\SUNNICA\Infrastructure\WPP-ACM-XX-DR-CZ-001-008-DRAINAGE-CONSTRAINTS

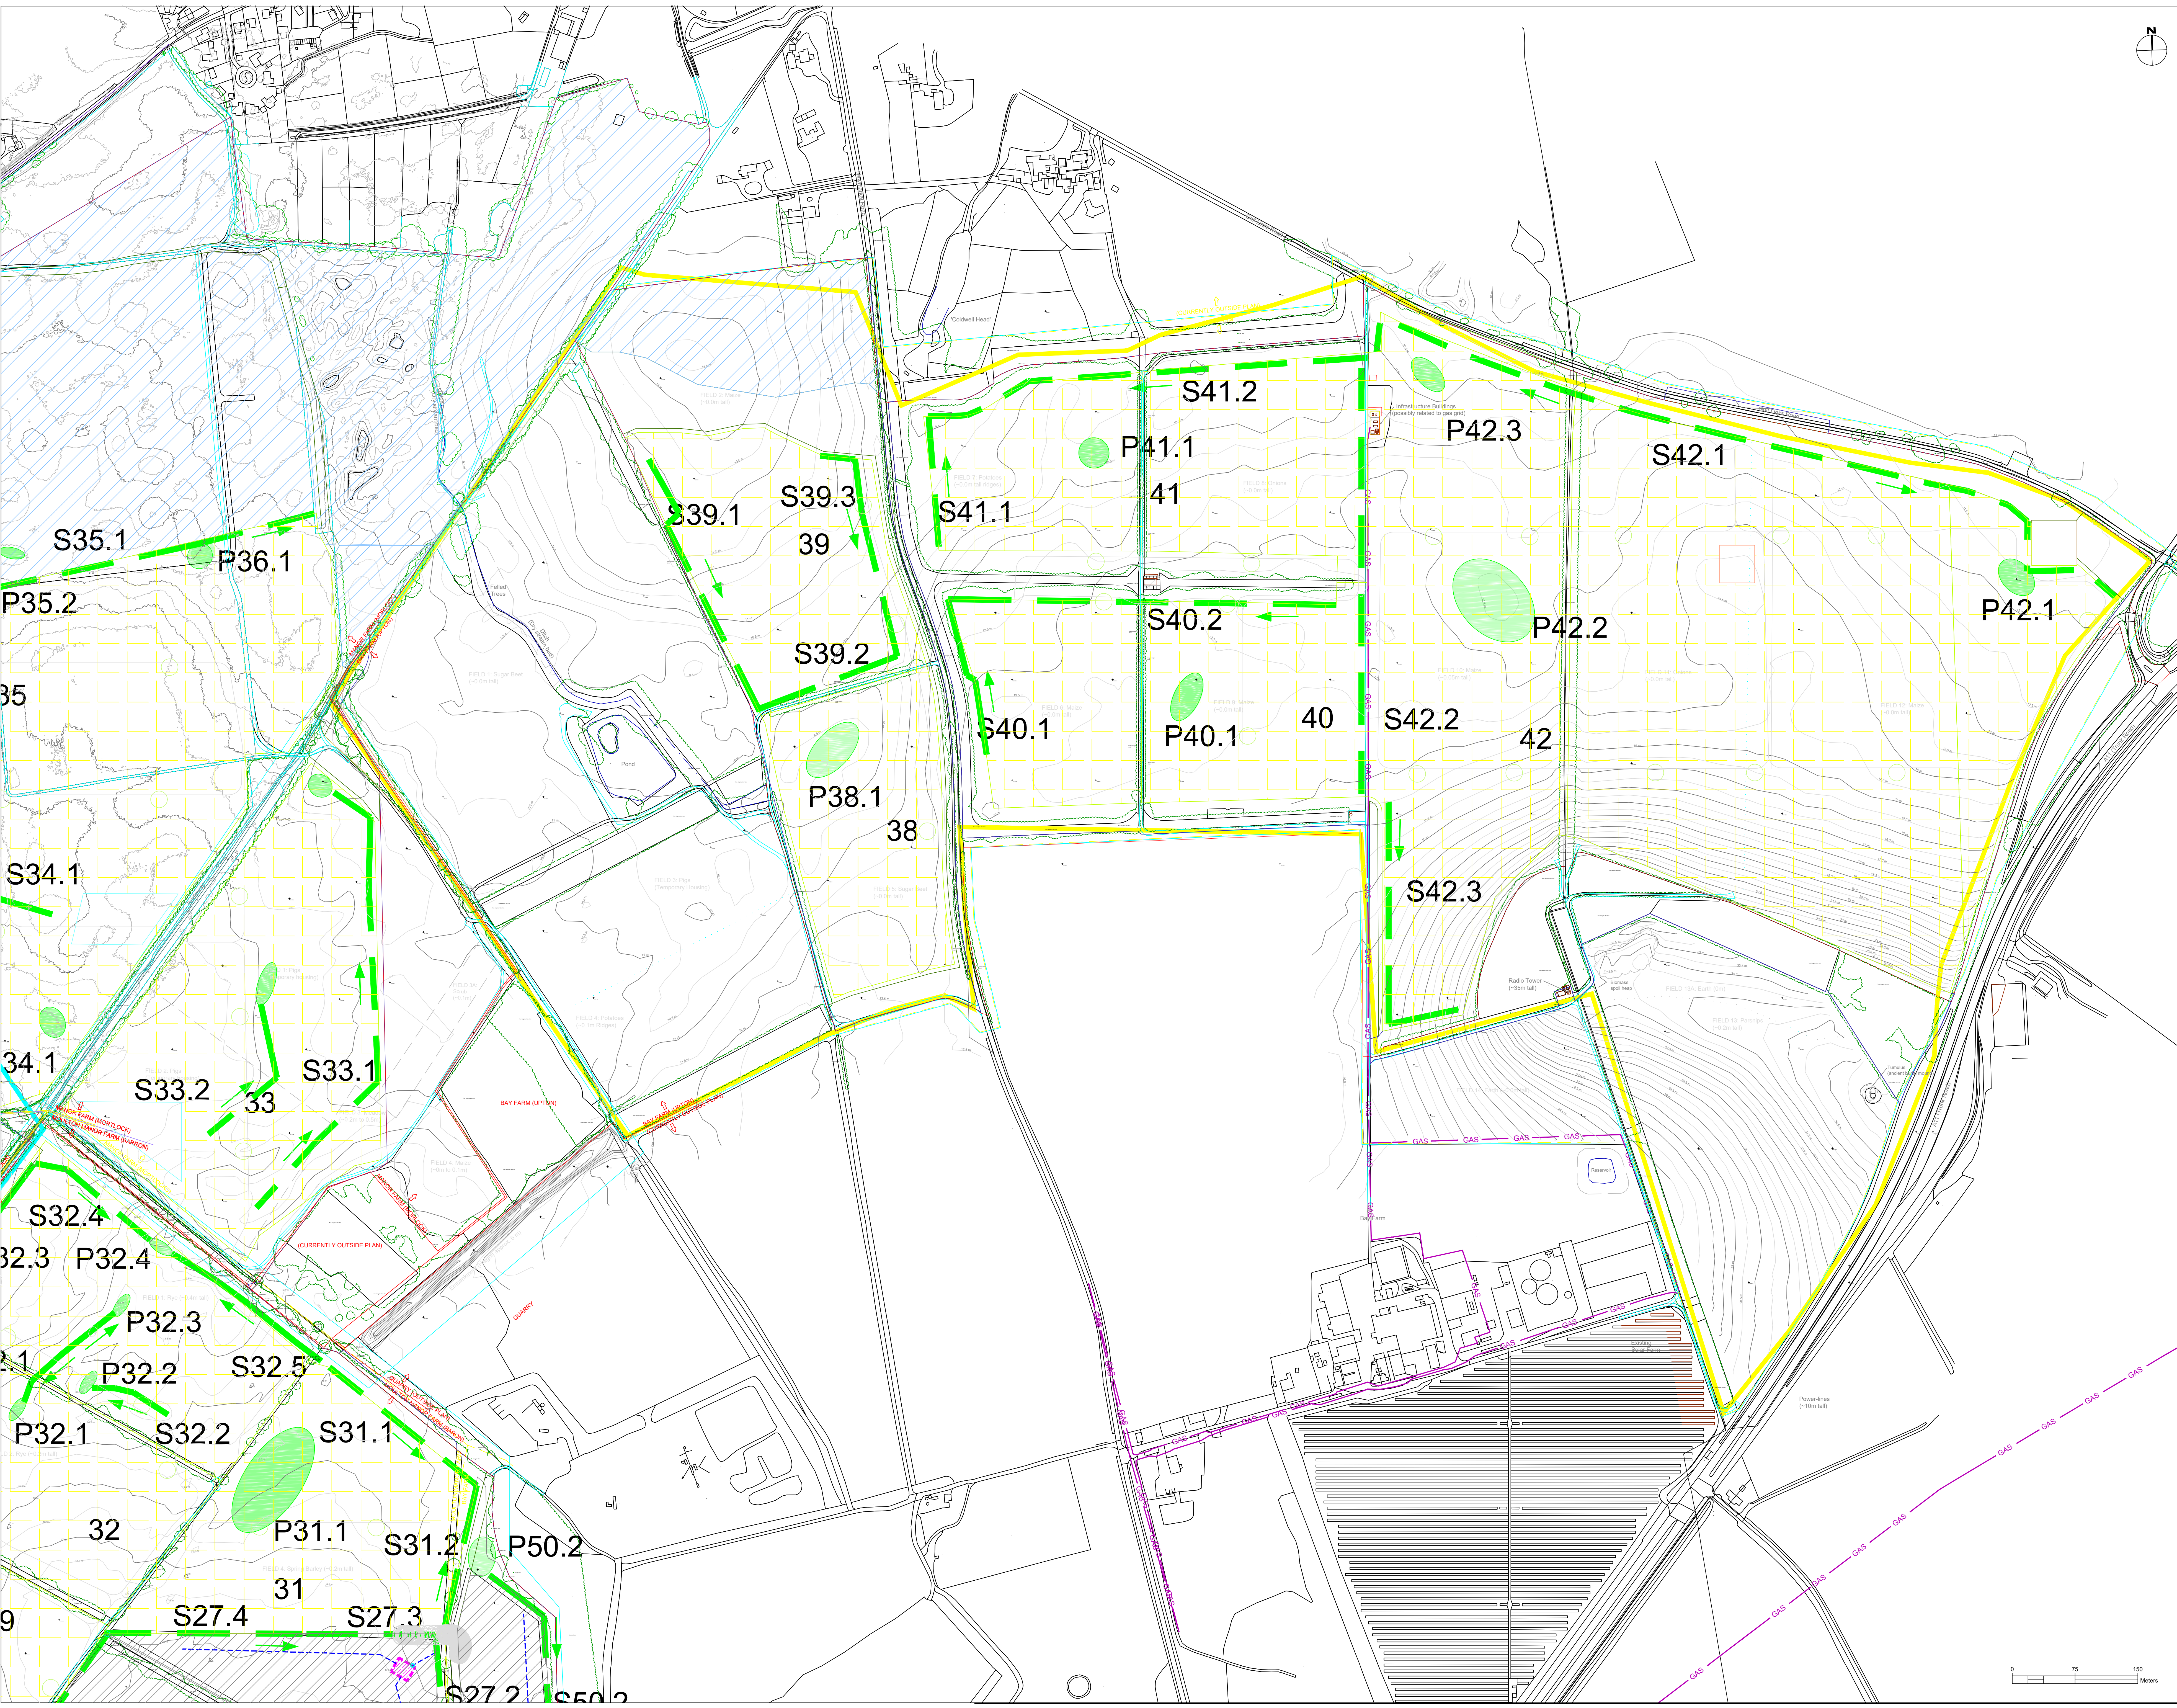

- NOTES**
- DO NOT SCALE FROM THIS DRAWING
  - ALL DIMENSIONS WHERE SHOWN ARE IN MM.
  - SITE LEVELS BASED ON DRONE FLOWN TOPOGRAPHICAL SURVEY BY ABOVE SURVEYS LTD.
  - SITE BACKGROUND TAKEN FROM OS BASE MAP DATASET AND SHOULD NOT BE USED FOR DETAILED DESIGN PURPOSES
  - SITE LAYOUT BASED ON DESIGN SEF\_SOL\_SchemeBoundary\_ParameterPlans\_200715 ITERATION 4 FOR BOTH EAST AND WEST SITES BY PS RENEWABLES, PLANS UN-DATED.
  - DRAINAGE SWALES PROPOSED WITH INFILTRATION SUBJECT TO FURTHER ON SITE GROUND INVESTIGATIONS. NO PIPED DRAINAGE PROPOSED OTHER THAN OUTLETS TO WATERCOURSES WHERE REQUIRED.
  - HIGH LEVEL DRAINAGE ASSESSMENT IS BASED ON TOPOGRAPHICAL CATCHMENT RUNOFF CONTOUR MODEL AND NOT CURRENTLY BASED ON DETAILED RUNOFF RATES AND VOLUMES. THIS WILL BE PREPARED AT PLANNING STAGE AND SWALES ADJUSTED TO SUIT IF REQUIRED.
  - NO DRAINAGE ASSESSMENT HAS BEEN CARRIED OUT FOR THE PLANNED MITIGATION AREAS, WHERE NO PV PANEL / COMPOUND AREA DEVELOPMENT IS TAKING PLACE. IT IS ASSUMED THESE AREAS WILL DRAIN AS EXISTING.
  - STORAGE AREAS AND COMPOUNDS HAVE NOT BEEN INCLUDED IN DRAINAGE STRATEGY AS DETAILS ON IMPERMEABLE AREAS ARE NOT KNOWN. THEREFORE ARE ASSUMED TO DRAIN INTO PROPOSED SWALES AND STORAGE BASINS.
  - THE DESIGN OF PV PANEL LAYOUTS, BY OTHERS, IS ASSUMED TO HAVE CONSIDERED ACCESS AND MAINTENANCE REQUIREMENTS. ACCESS AROUND FIELDS IS ASSUMED TO BE PROVIDED AS A NATURAL BUFFER BETWEEN FENCES AND PANELS AND WILL FACILITATE ACCESS TO MAINTAIN SWALES AND BASINS.

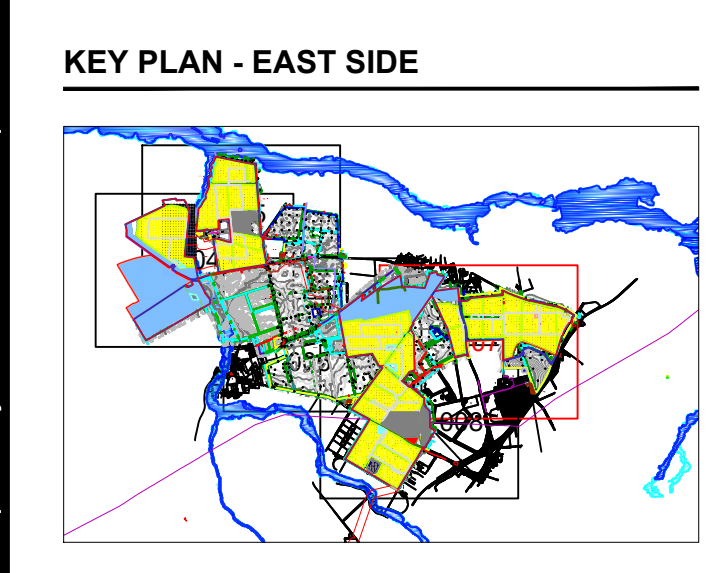


**KEY PLAN**

	RED LINE BOUNDARY
	SOLAR FIELD AREA
	ARCHAEOLOGICAL MITIGATION AREA
	COMPOUND AREA (PERMANENT)
	ECOLOGY ENHANCEMENT
	ECOLOGY ENHANCEMENT WETLAND
	RETAINED WOODLAND
	BATTERY STORAGE / COMPOUND
	SWALE (0.6m DEEP)
	INFILTRATION BASIN (0.6m DEEP)
	FIRE WATER STORAGE LAGOON WITH PENSTOCK
	FIREWATER DRAINAGE ROUTE
	FLOOD ZONE 3
	FLOOD ZONE 2

**ISSUE/REVISION**


IR	DATE	DESCRIPTION
P6	06.01.23	BOUNDARY UPDATE
P5	22.11.22	BOUNDARY / FEH UPDATE
P4	19.10.21	BOUNDARY / DESIGN UPDATE
P3	09.07.21	BOUNDARY / DESIGN UPDATE
P2	03.08.20	BOUNDARY UPDATE
P1	04.10.19	PRELIMINARY

This drawing has been prepared for the use of AECOM's client. It may not be used, modified, reproduced or relied upon by third parties, except as agreed by AECOM or as required by law. AECOM accepts no responsibility, and denies any liability, whatsoever, to any party that uses or relies on this drawing without AECOM's express written consent. All measurements must be obtained from the stated dimensions.


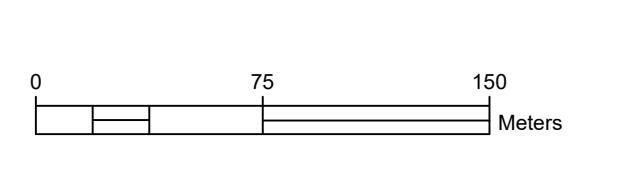




Last saved by: MARTINP(2023-01-18) Last Picked: 2023-01-09  
 Filename: I:\aecomnet\com\file\EME\SUNNICA\UK\STAT1\Legacy\VOL1\Infrastructure\in\trial\SUNNICA\XX-DR-C-ZZ-008-DRAINAGE-CONSTRAINTS  
 Project Management Initials: Revision: Designer: AR Checked: CB Approved: NC Drawn: CD  
 ISO A0 841mm x 1189mm

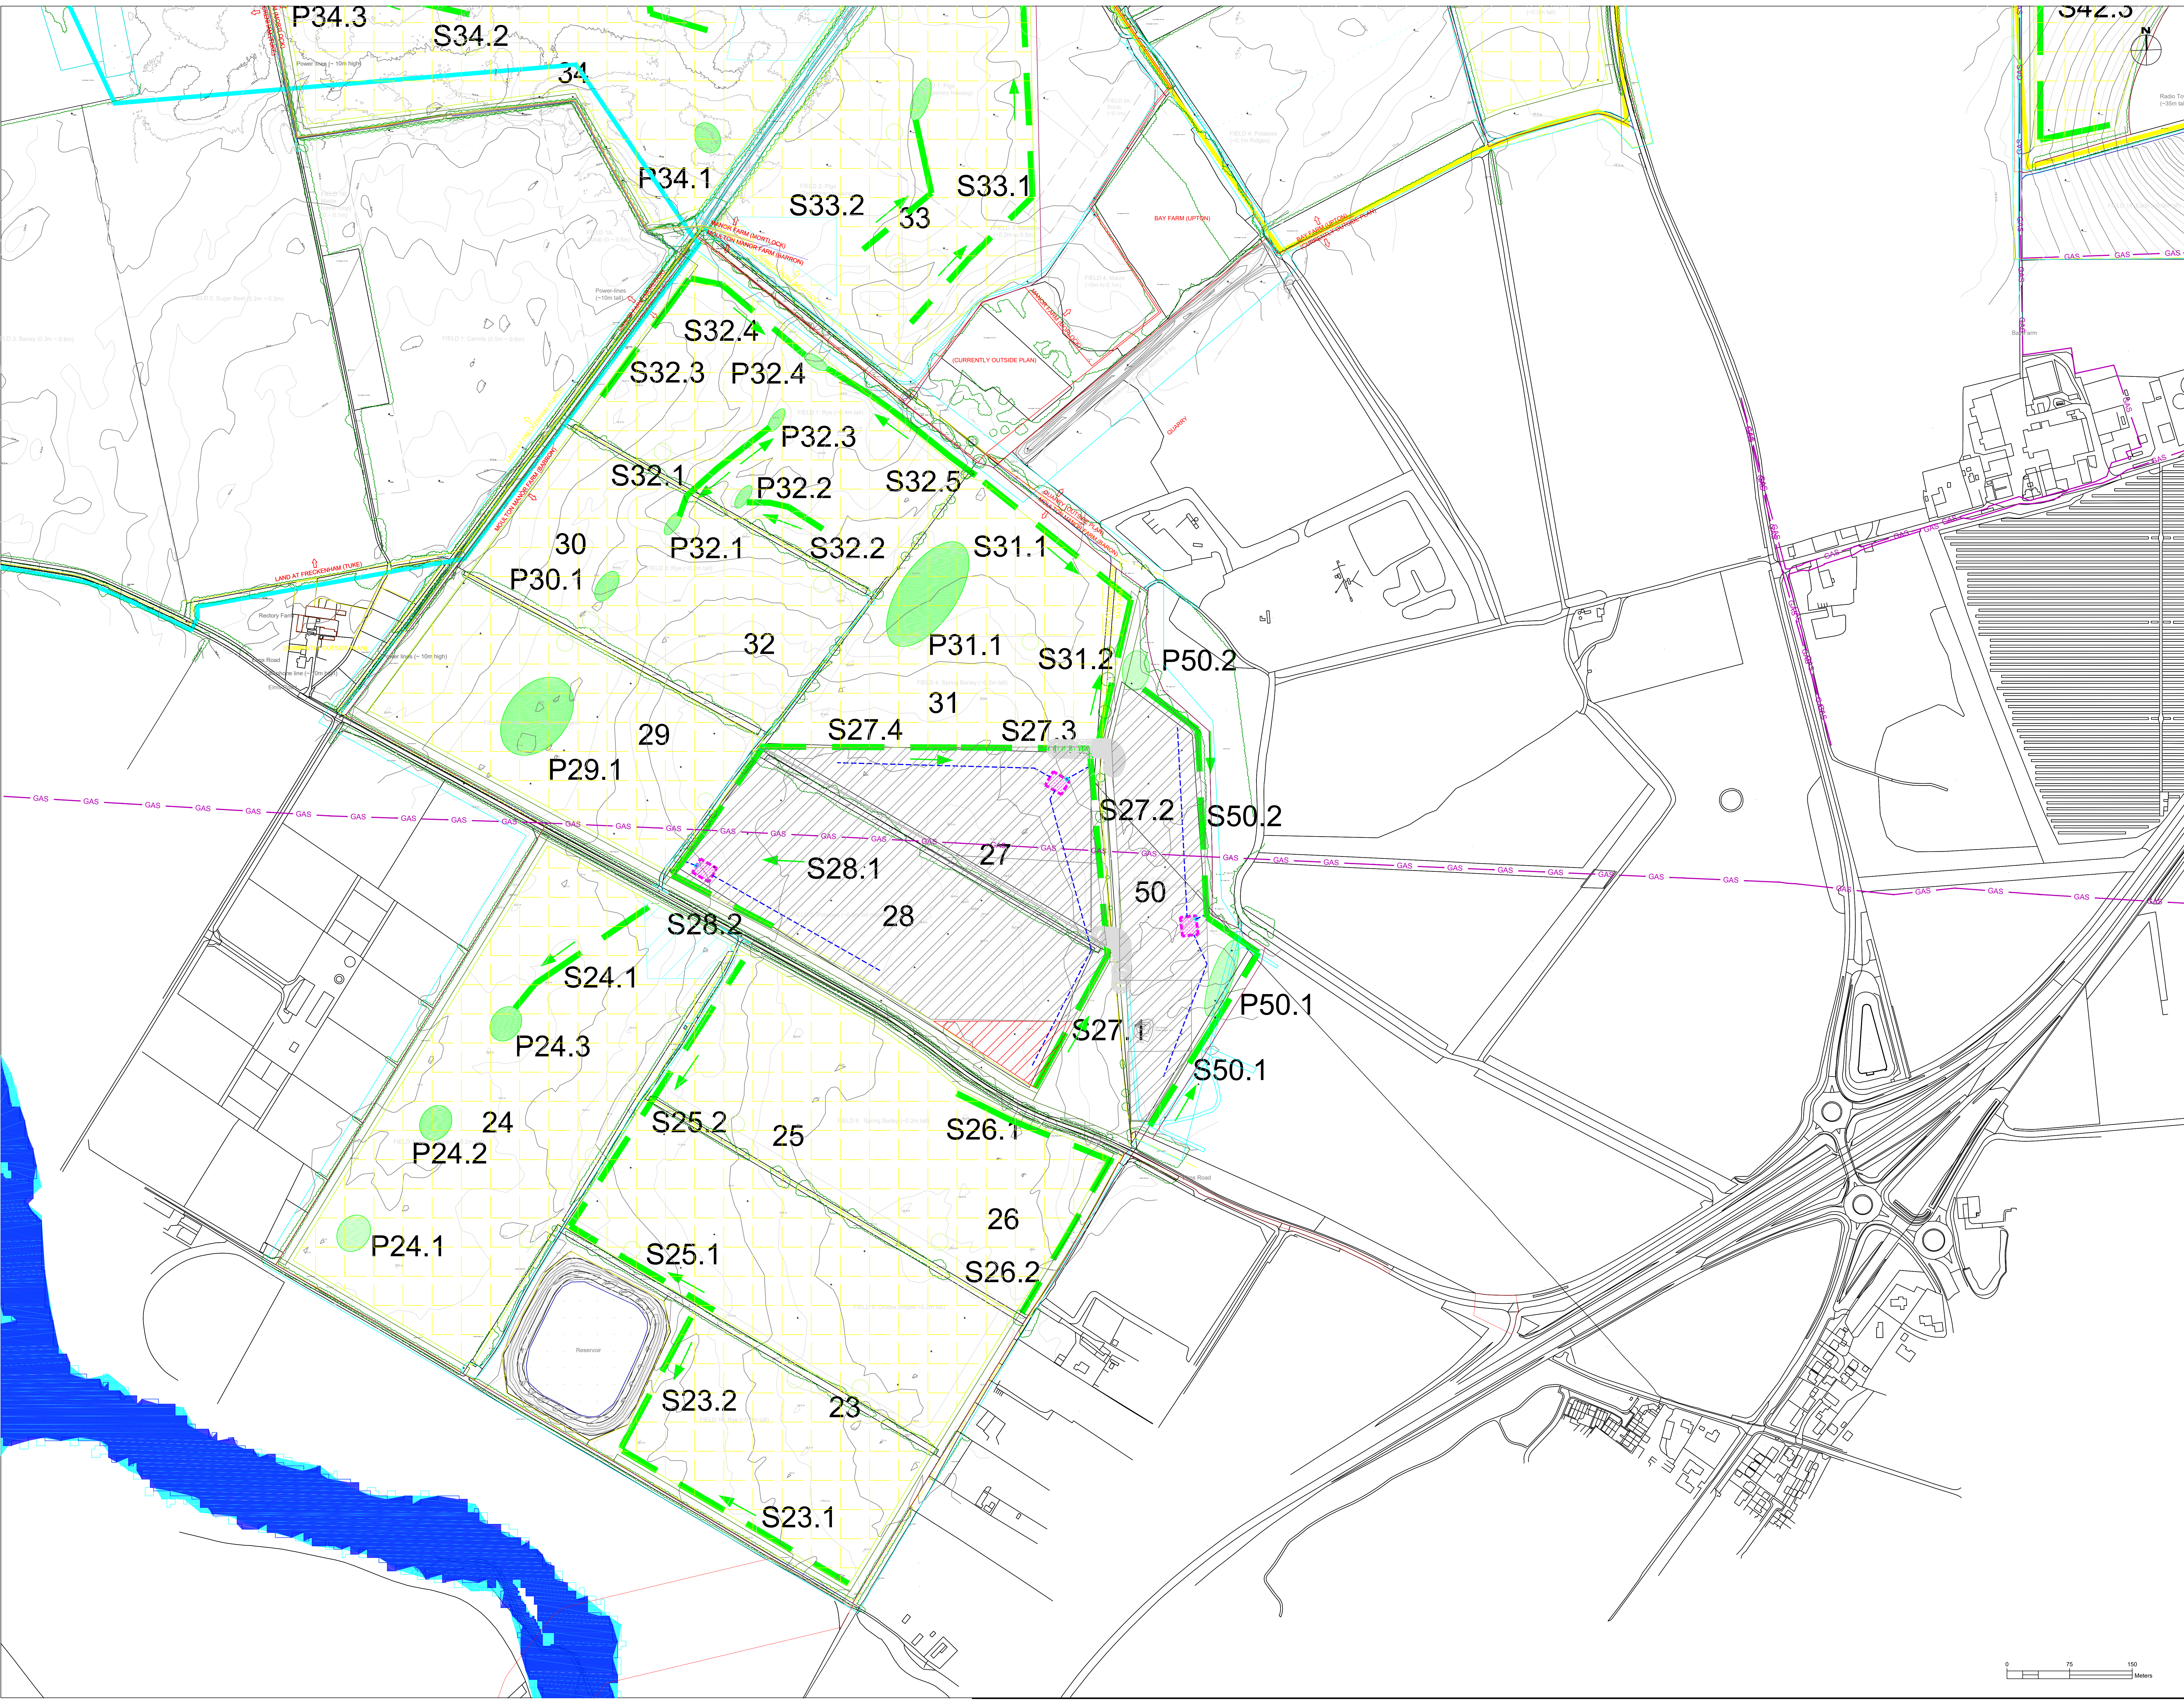


- NOTES**
- DO NOT SCALE FROM THIS DRAWING
  - ALL DIMENSIONS WHERE SHOWN ARE IN MM.
  - SITE LEVELS BASED ON DRONE FLOWN TOPOGRAPHICAL SURVEY BY ABOVE SURVEYS LTD.
  - SITE BACKGROUND TAKEN FROM OS BASE MAP DATASET AND SHOULD NOT BE USED FOR DETAILED DESIGN PURPOSES
  - SITE LAYOUT BASED ON DESIGN SEF\_SOL\_SchemeBoundary\_ParametersPlans\_200715 ITERATION 4 FOR BOTH EAST AND WEST SITES BY PS RENEWABLES. PLANS UN-DATED.
  - DRAINAGE SWALES PROPOSED WITH INFILTRATION SUBJECT TO FURTHER ON SITE GROUND INVESTIGATIONS. NO PIPED DRAINAGE PROPOSED OTHER THAN OUTLETS TO WATERCOURSES WHERE REQUIRED.
  - HIGH LEVEL DRAINAGE ASSESSMENT IS BASED ON TOPOGRAPHICAL CATCHMENT RUNOFF CONTOUR MODEL. AND NOT CURRENTLY BASED ON DETAILED RUNOFF RATES AND VOLUMES; THIS WILL BE PREPARED AT PLANNING STAGE AND SWALES ADJUSTED TO SUIT IF REQUIRED.
  - NO DRAINAGE ASSESSMENT HAS BEEN CARRIED OUT FOR THE PLANNED MITIGATION AREAS, WHERE NO PV PANEL / COMPOUND AREA DEVELOPMENT IS TAKING PLACE. IT IS ASSUMED THESE AREAS WILL DRAIN AS EXISTING.
  - STORAGE AREAS AND COMPOUNDS HAVE NOT BEEN INCLUDED IN DRAINAGE STRATEGY AS DETAILS ON IMPERMEABLE AREAS ARE NOT KNOWN, THEREFORE ARE ASSUMED TO DRAIN INTO PROPOSED SWALES AND STORAGE BASINS.
  - THE DESIGN OF PV PANEL LAYOUTS, BY OTHERS IS ASSUMED TO HAVE CONSIDERED ACCESS AND MAINTENANCE REQUIREMENTS. ACCESS AROUND FIELDS IS ASSUMED TO BE PROVIDED AS A NATURAL BUFFER BETWEEN FENCES AND PANELS AND WILL FACILITATE ACCESS TO MAINTAIN SWALES AND BASINS.

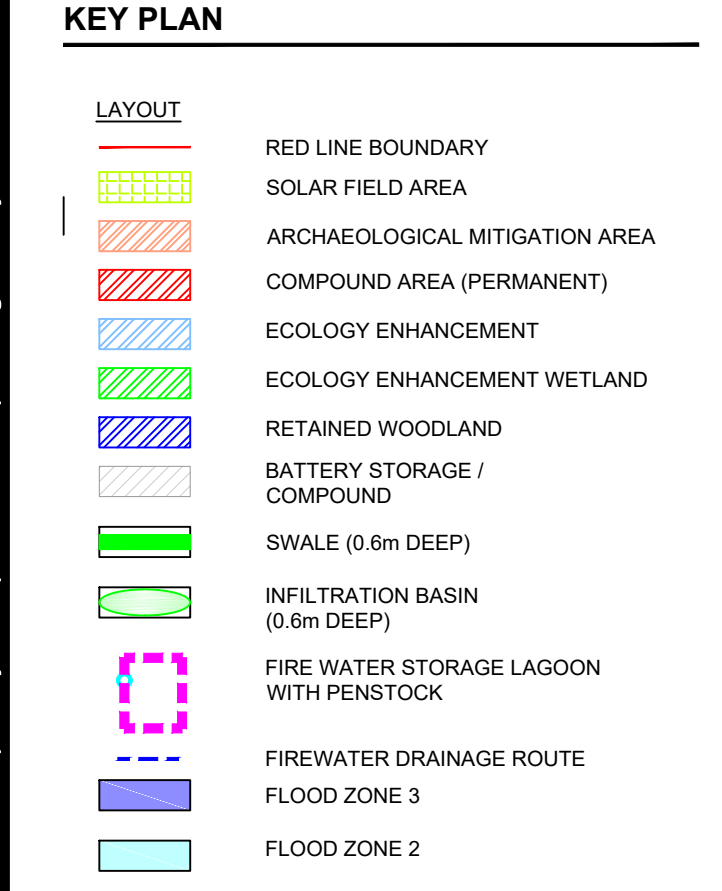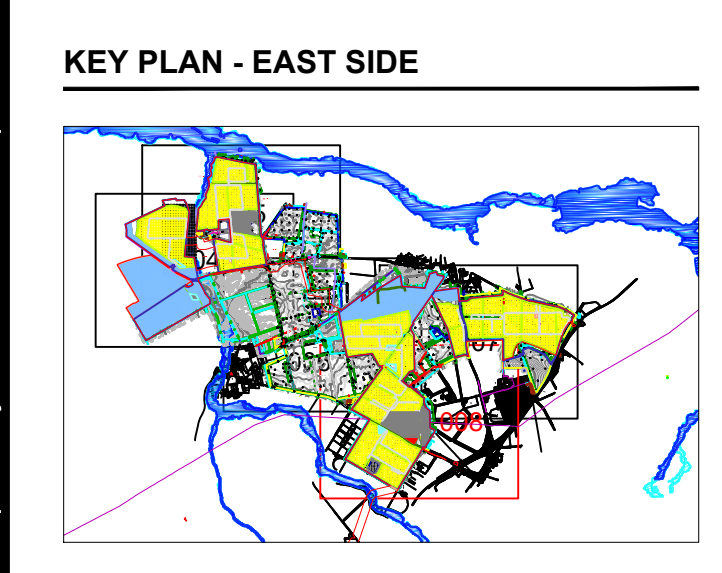

**ISSUE/REVISION**

ISSUE	DATE	DESCRIPTION
P6	06.01.23	BOUNDARY UPDATE
P5	22.11.22	BOUNDARY / FEH UPDATE
P4	19.10.21	BOUNDARY UPDATE
P3	09.07.21	BOUNDARY / DESIGN UPDATE
P2	03.08.20	BOUNDARY UPDATE
P1	04.10.19	PRELIMINARY
IR	DATE	DESCRIPTION

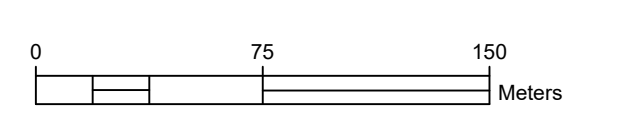

This drawing has been prepared for the use of AECOM's client. It may not be used, modified, reproduced or relied upon by third parties, except as agreed by AECOM or as required by law. AECOM accepts no responsibility, and denies any liability, whatsoever to any party that relies on this document. All measurements must be obtained from the stated dimensions.