


Revision: C Drawn: EL Checked: KR Approved: AB Date: 2022-12-12
Filename: Y:\Projects\4077_Longfield Solar\01_Working\01_D1_Drawing\4077_LGF_LPF_00010.dwg



CONSULTANT
Arcus Consultancy Services
10 Swinigate Court East
3 Swinigate
York, YO1 8AJ
T: +44 1904 715 470
www.arcusconsulting.co.uk

- LEGEND**
- Order Limits
 - Potential Developable Area (PDA)
 - Deer Fencing
 - Palisade Fencing
 - Acoustic Fencing
 - Longfield Substation
 - Office, Warehouse and Plant Storage Area
 - BESS Phase 1
 - BESS Phase 2
 - BESS Rendezvous Area
 - Temporary Construction Compound
 - Primary Access Track
 - Secondary Access Track
 - Existing Private Access Track
 - Existing Public Highway
 - Site Entrance
 - Overhead Electricity Line (11kV)
 - Overhead Electricity Line (11kV) Diversion
 - Overhead Electricity Line (132kV)
 - Overhead Electricity Line (400 kV)
 - 400kV Cable Route
 - 5m Contour
 - Area of Wetland
 - Individual Tree
 - Hedgerow
 - Area of Woodland
 - Bridleway
 - Public Footpath
 - Proposed Cycle Track
 - Security Kiosk
 - Site Access Layby
 - BESS Internal Tracks
 - Gate
 - CCTV
 - BESS Water Tank
 - Attenuation Pond
 - Drainage Pipe Network
 - Bull's Lodge Extension Area

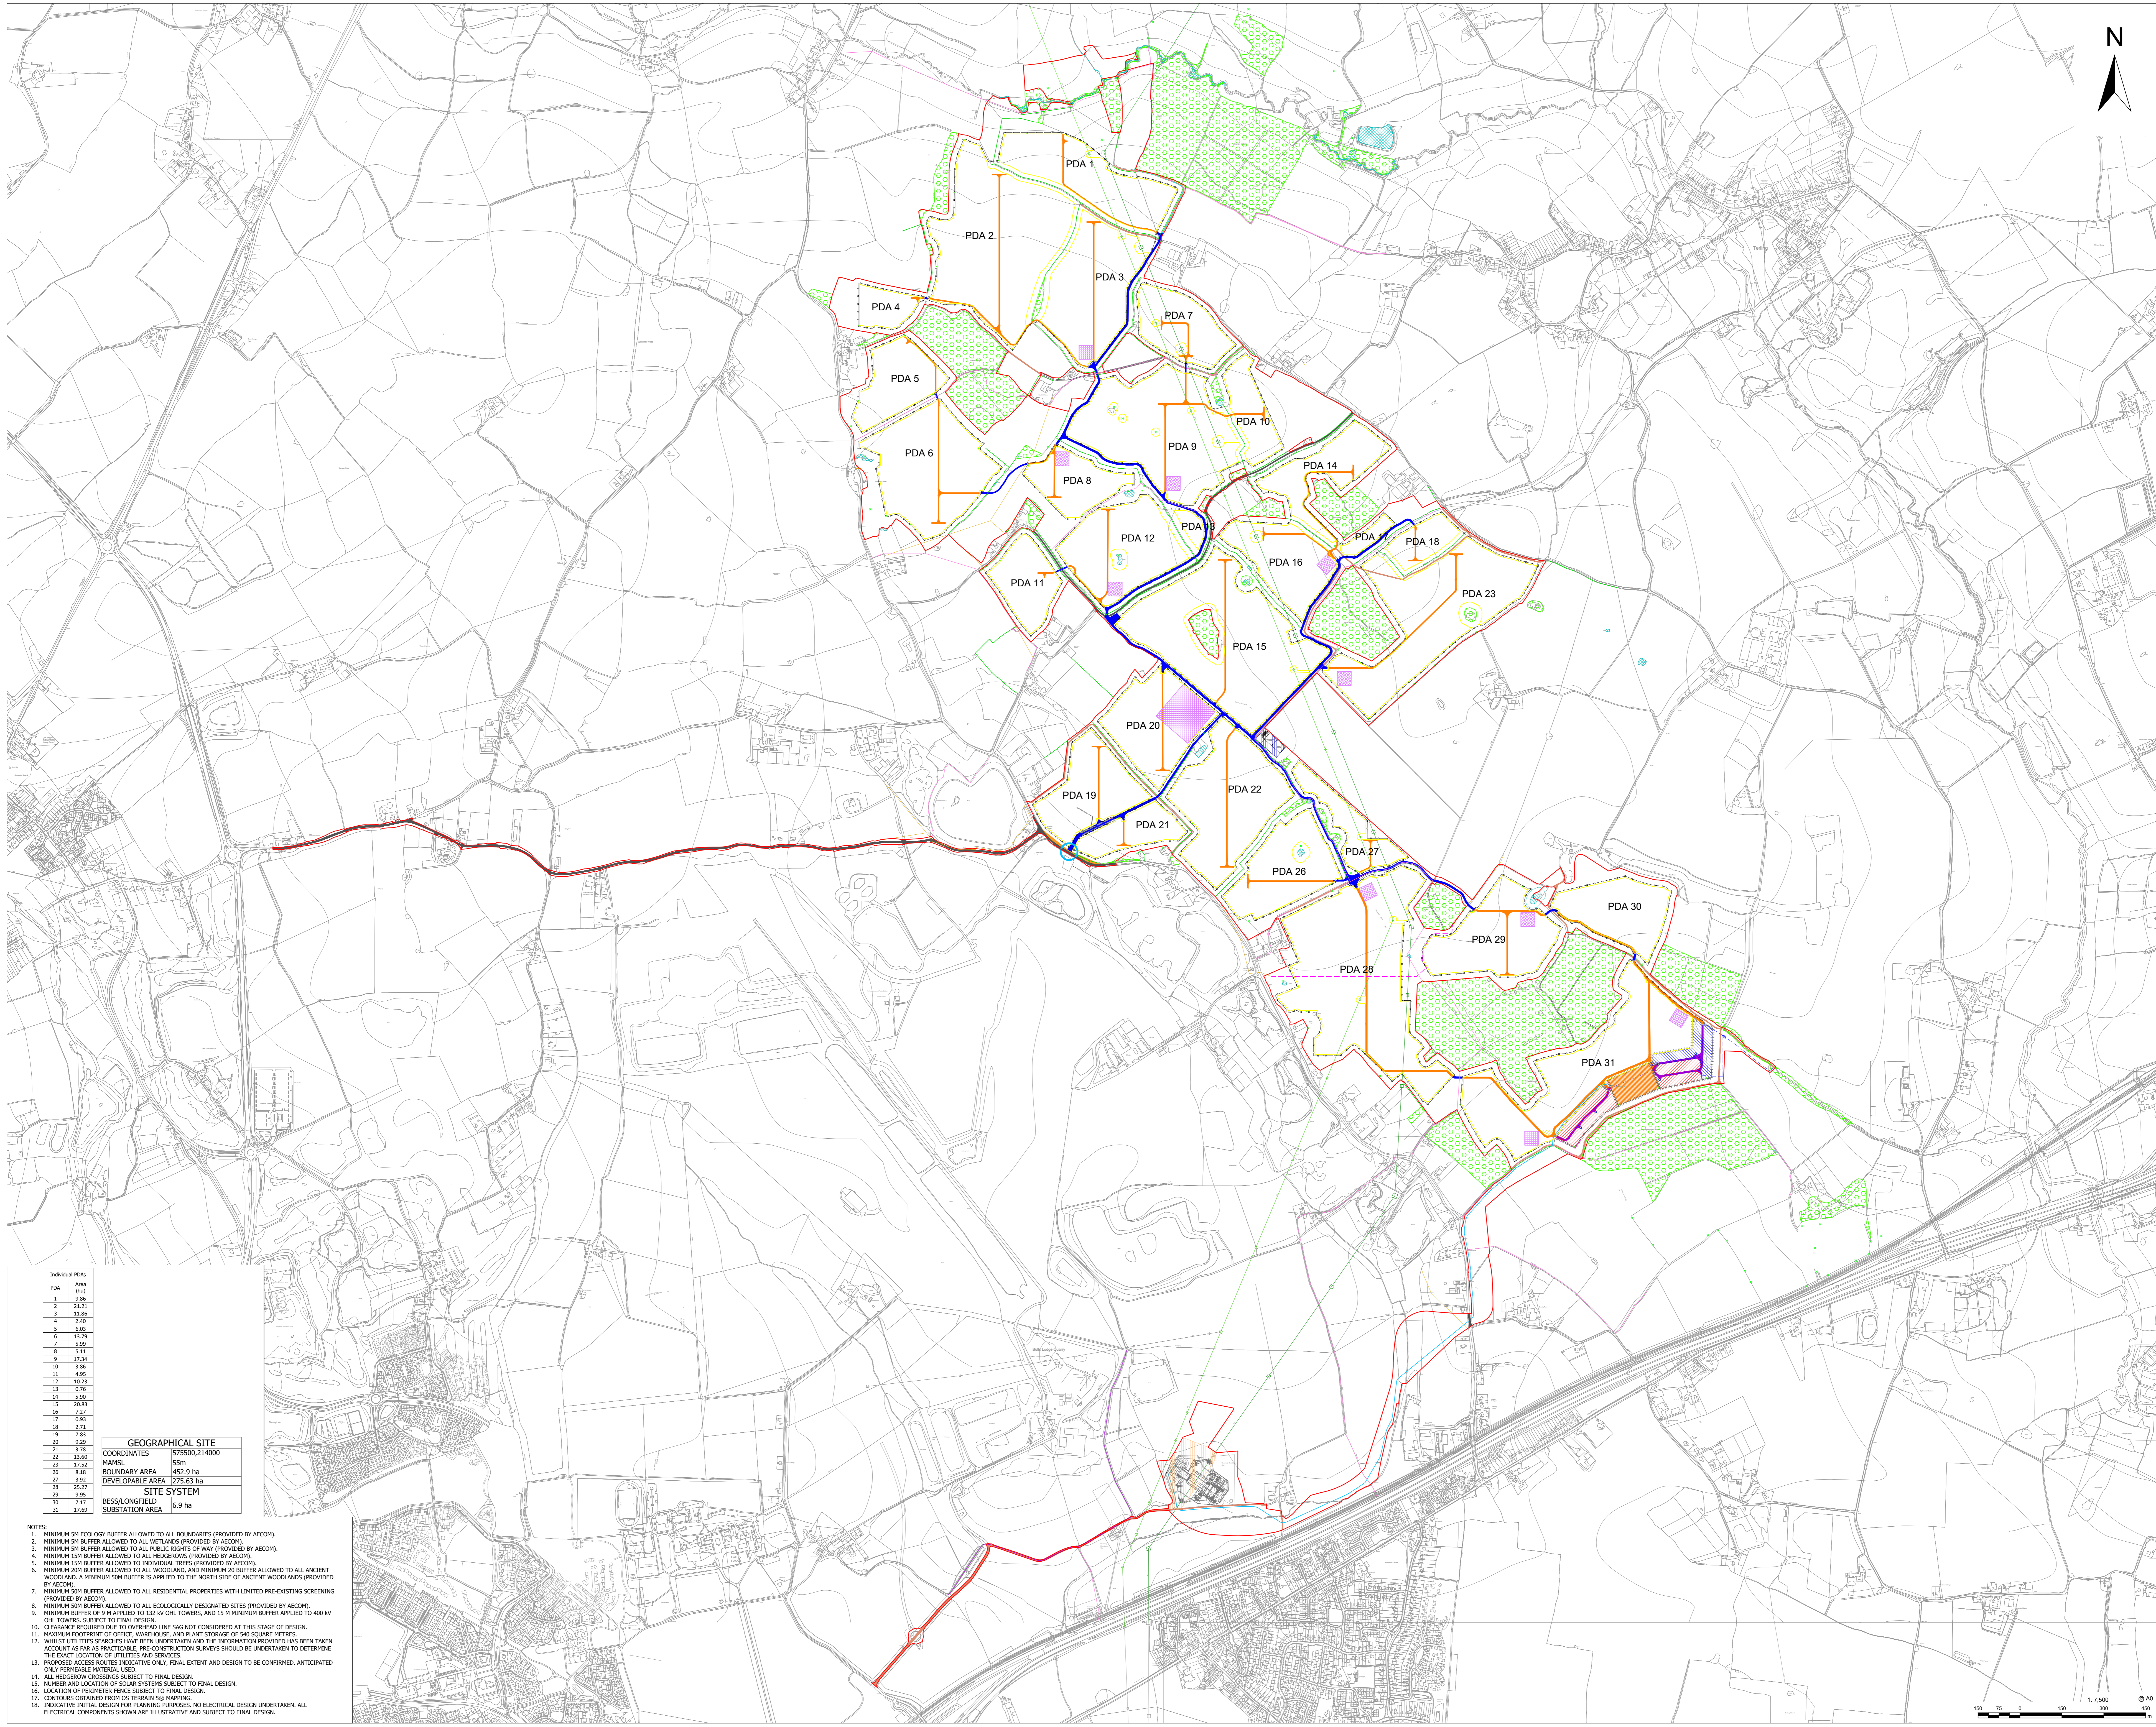

Individual PDAs	
PDA	Area (ha)
1	9.86
2	21.21
3	11.66
4	2.40
5	6.01
6	13.79
7	5.99
8	5.11
9	17.34
10	3.46
11	4.95
12	16.13
13	0.76
14	5.20
15	20.83
16	1.77
17	0.93
18	2.71
19	7.83
20	9.29
21	1.78
22	13.60
23	17.52
24	8.14
25	1.90
26	25.07
27	9.95
28	7.17
29	17.69

GEOGRAPHICAL SITE	
COORDINATES	575500,214000
BOUNDARY AREA	452.9 ha
DEVELOPABLE AREA	275.63 ha
SITE SYSTEM	
BESS/LONGFIELD	16.9 ha
SUBSTATION AREA	6.9 ha

- NOTES:**
- MINIMUM 5M ECOLOGY BUFFER ALLOWED TO ALL BOUNDARIES (PROVIDED BY AECOM).
 - MINIMUM 5M BUFFER ALLOWED TO ALL WETLANDS (PROVIDED BY AECOM).
 - MINIMUM 5M BUFFER ALLOWED TO ALL PUBLIC RIGHTS OF WAY (PROVIDED BY AECOM).
 - MINIMUM 15M BUFFER ALLOWED TO ALL HEDGEROWS (PROVIDED BY AECOM).
 - MINIMUM 15M BUFFER ALLOWED TO INDIVIDUAL TREES (PROVIDED BY AECOM).
 - MINIMUM 50M BUFFER ALLOWED TO ALL WOODLANDS AND MINIMUM 50M BUFFER ALLOWED TO ALL ANCIENT WOODLANDS. A MINIMUM 50M BUFFER IS APPLIED TO THE NORTH SIDE OF ANCIENT WOODLANDS (PROVIDED BY AECOM).
 - MINIMUM 50M BUFFER ALLOWED TO ALL RESIDENTIAL PROPERTIES WITH LIMITED PRE-EXISTING SCREENING (PROVIDED BY AECOM).
 - MINIMUM 50M BUFFER ALLOWED TO ALL ECOLOGICALLY DESIGNATED SITES (PROVIDED BY AECOM).
 - MINIMUM BUFFER OF 9M APPLIED TO 132 kV OHL TOWERS, AND 15 M MINIMUM BUFFER APPLIED TO 400 kV OHL TOWERS SUBJECT TO FINAL DESIGN.
 - CLEARANCE REQUIRED DUE TO OVERHEAD LINE SAG NOT CONSIDERED AT THIS STAGE OF DESIGN.
 - MAXIMUM FOOTPRINT OF OFFICE, WAREHOUSE, AND PLANT STORAGE OF 500 SQUARE METRES.
 - WHILE UTILITY SEARCHES HAVE BEEN UNDERTAKEN AND THE INFORMATION PROVIDED HAS BEEN TAKEN ACCOUNT AS FAR AS PRACTICABLE, PRE-CONSTRUCTION SURVEYS SHOULD BE UNDERTAKEN TO DETERMINE THE EXACT LOCATION OF UTILITIES AND SERVICES.
 - PROPOSED ACCESS ROUTES INDICATIVE ONLY. FINAL EXTENT AND DESIGN TO BE CONFIRMED. ANTICIPATED ONLY PERMISSIBLE MATERIAL USES.
 - ALL HEDGEROW CROSSINGS SUBJECT TO FINAL DESIGN.
 - NUMBER AND LOCATION OF SOLAR SYSTEMS SUBJECT TO FINAL DESIGN.
 - LOCATION OF PROHIBITED FENCE SUBJECT TO FINAL DESIGN.
 - CONTOURS OBTAINED FROM DS TERRAIN 5M MAPPING.
 - INDICATIVE INITIAL DESIGN FOR PLANNING PURPOSES. NO ELECTRICAL DESIGN UNDERTAKEN. ALL ELECTRICAL COMPONENTS SHOWN ARE ILLUSTRATIVE AND SUBJECT TO FINAL DESIGN.



NOTES
This drawing is to be read in conjunction with all other relevant documentation.

All dimensions, changes, levels, and coordinates are in metres unless defined otherwise.

This drawing is to be read in conjunction with the project health & safety file for any identified potential risks.

The drawing is the copyright of Arcus and cannot be reproduced in any form without the express consent of the company. Written and scaled dimensions to be checked on site, and any discrepancies should be reported to Arcus prior to work commencing on site.

Reproduced from Ordnance Survey digital map data © Crown copyright 2022. All rights reserved. License number 100048606.

Scale above 1:2,500 used as appropriate for figure requirements.

ISSUE PURPOSE
Environmental Statement
APFP Regulation: 5(2)(a)

PINS REFERENCE NUMBER
EN010118

FIGURE TITLE
Construction Layout

FIGURE NUMBER
Figure 2-27

