



OAKLANDS FARM SOLAR PARK

Applicant: Oaklands Farm Solar Ltd

Indicative Cable Trench Plan

October 2024




Document Ref: EN010122/D5/13.7

Version: Deadline 5



EN010122 - D5 - 13.7 - Indicative Cable
Trench Plan

- Order Limits / Site Boundary
- Indicative Low and Medium Voltage Cable Trench
- Indicative Earthing Cable Trench
- 132kV Underground Cable to Drakelow

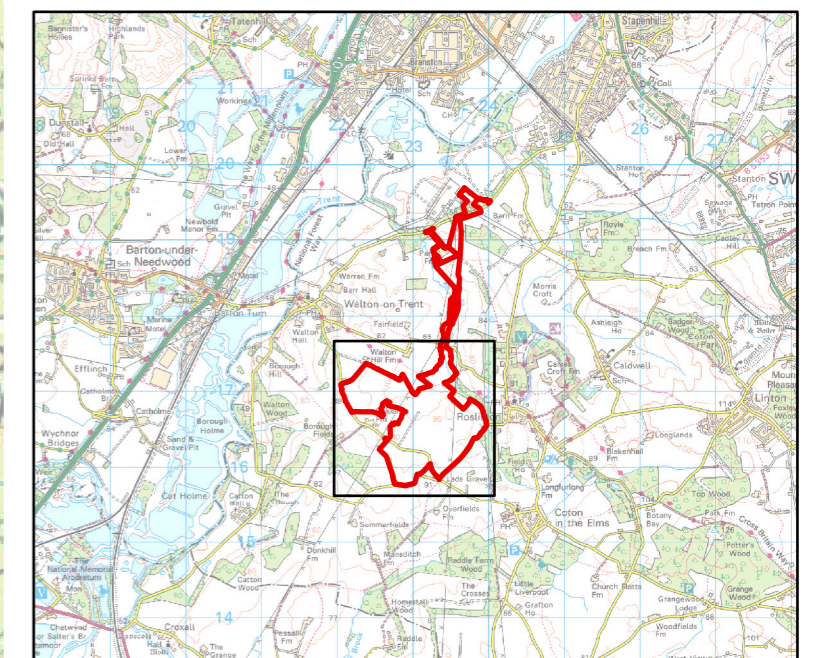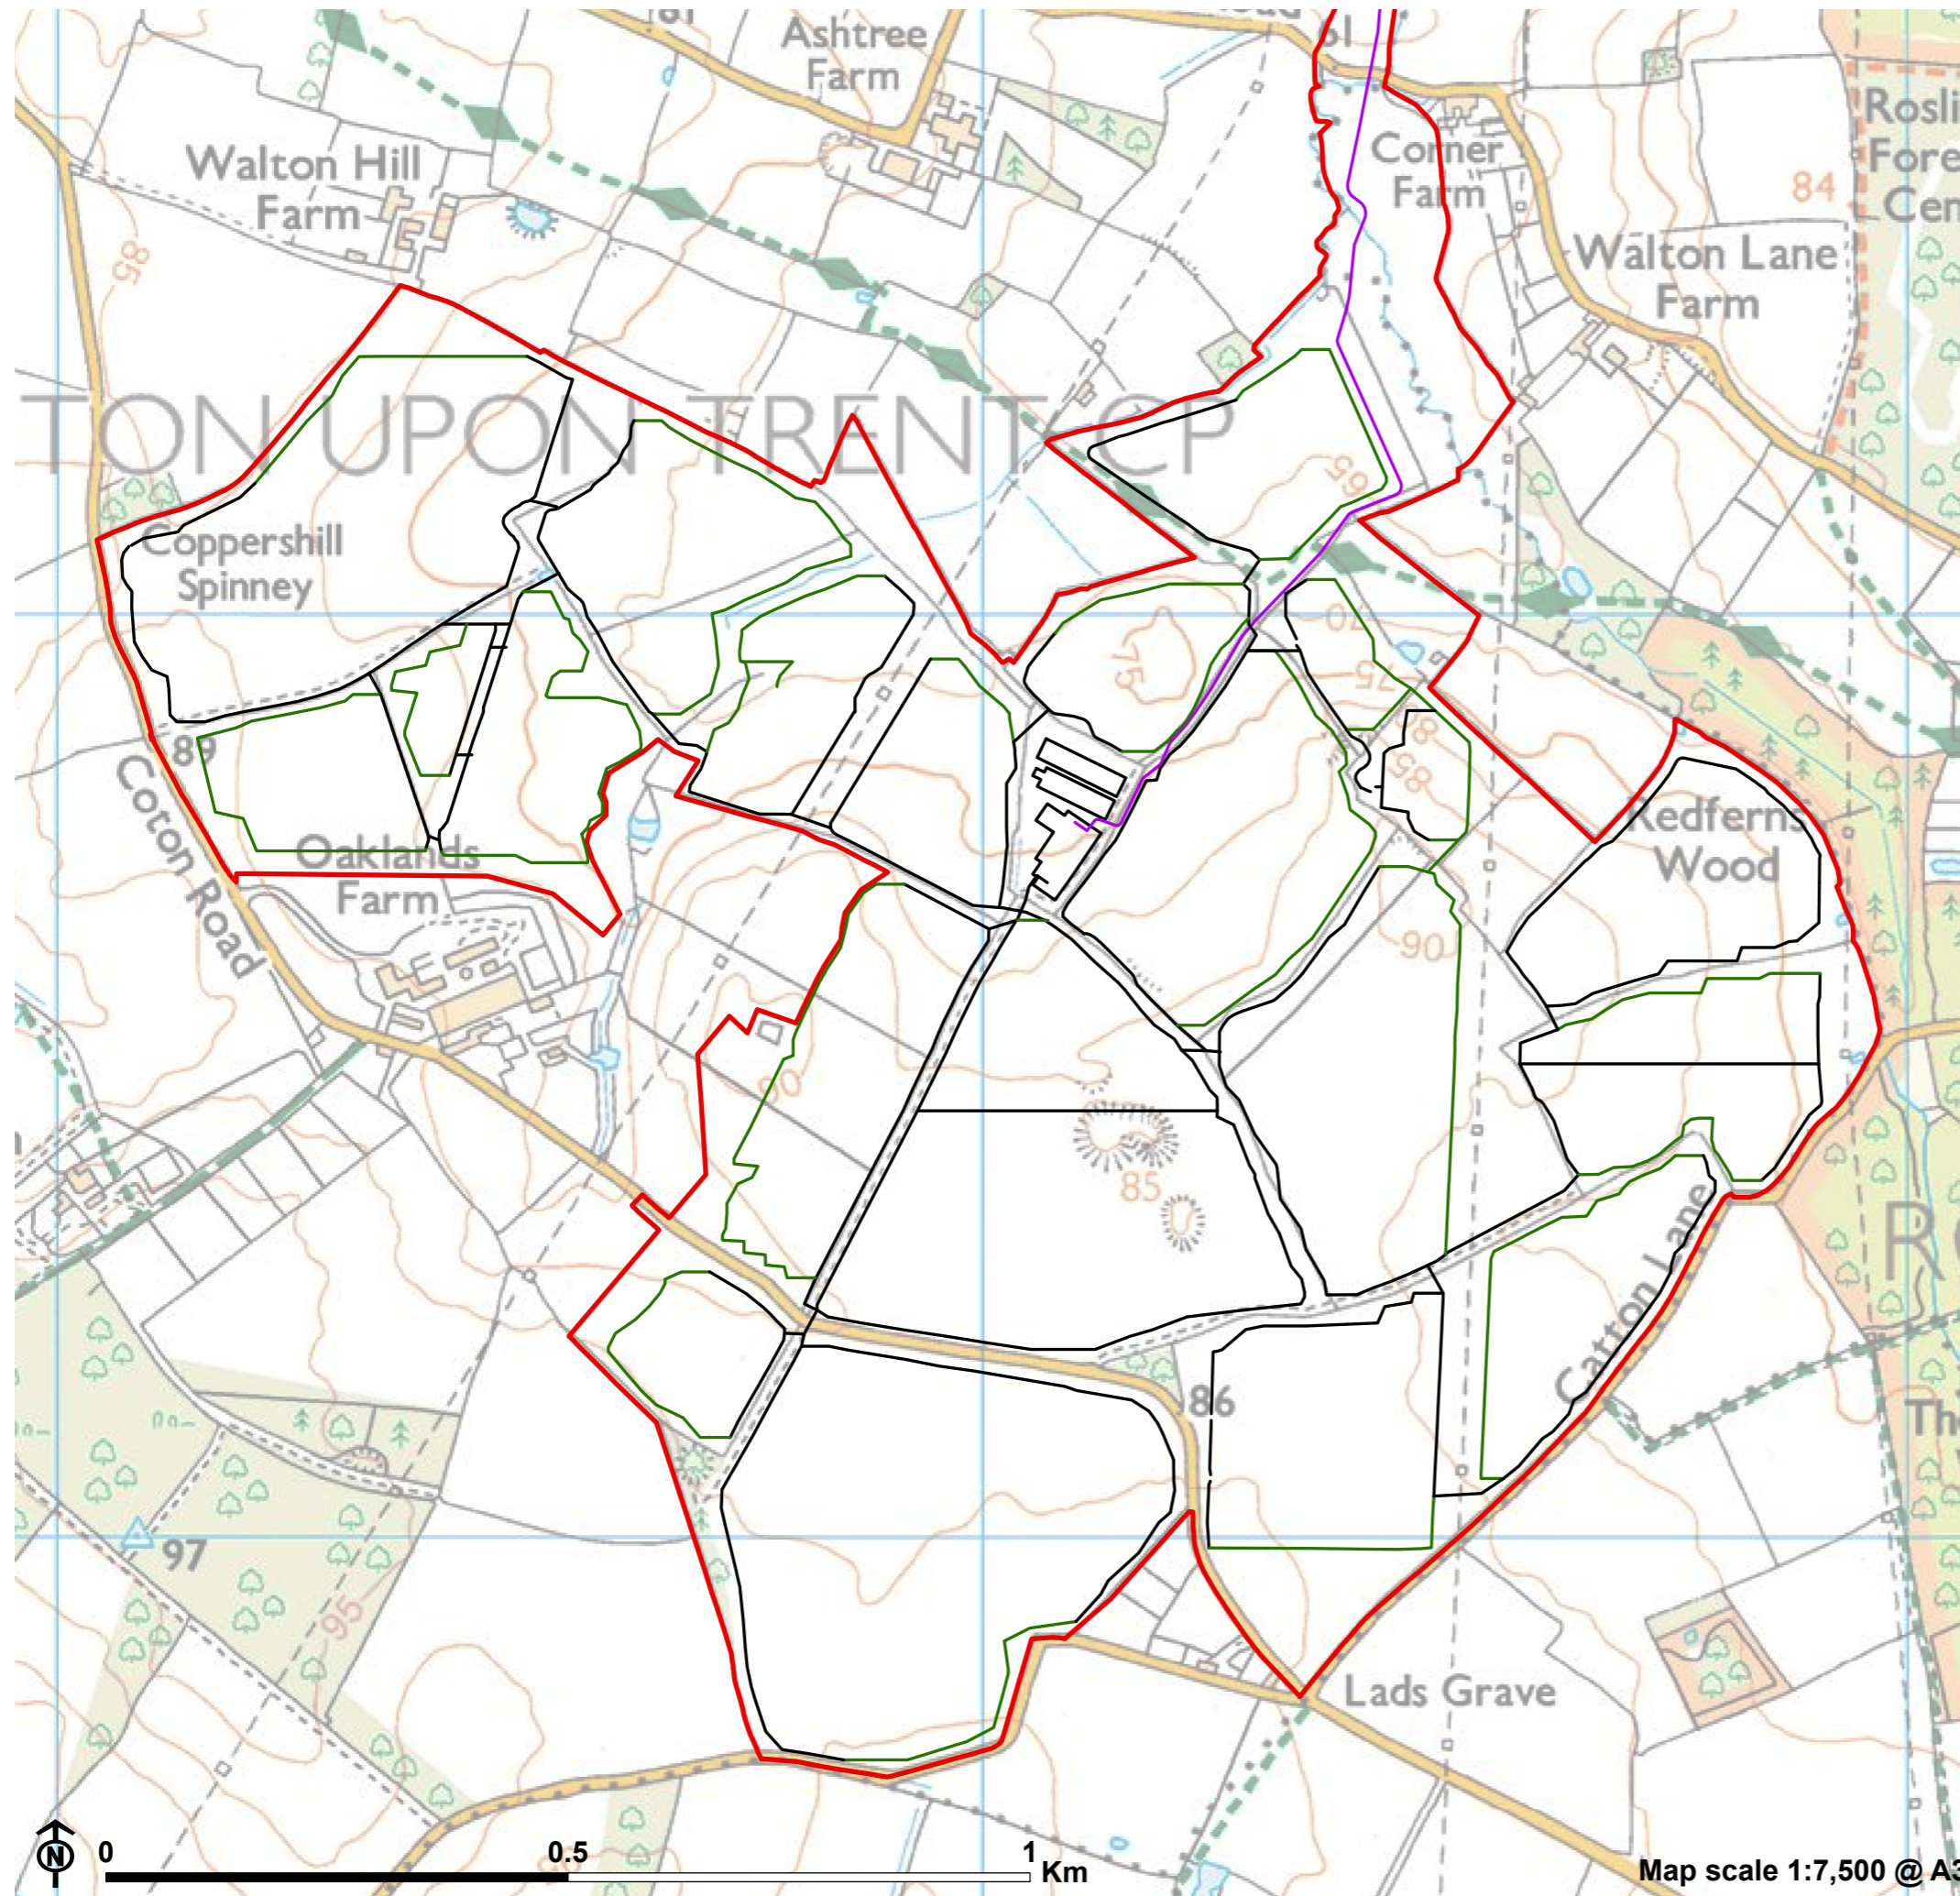

Map scale 1:7,500 @ A3

PINS reference: EN010122

