

Heckington Fen Solar Park

EN010123

Figure 3.5 Indicative Cable Route

Applicant: Ecotricity (Heck Fen Solar) Limited


Document Reference: 6.2.3

Pursuant to: APFP Regulation 5(2)(a)

Document Revision: 2

August 2023



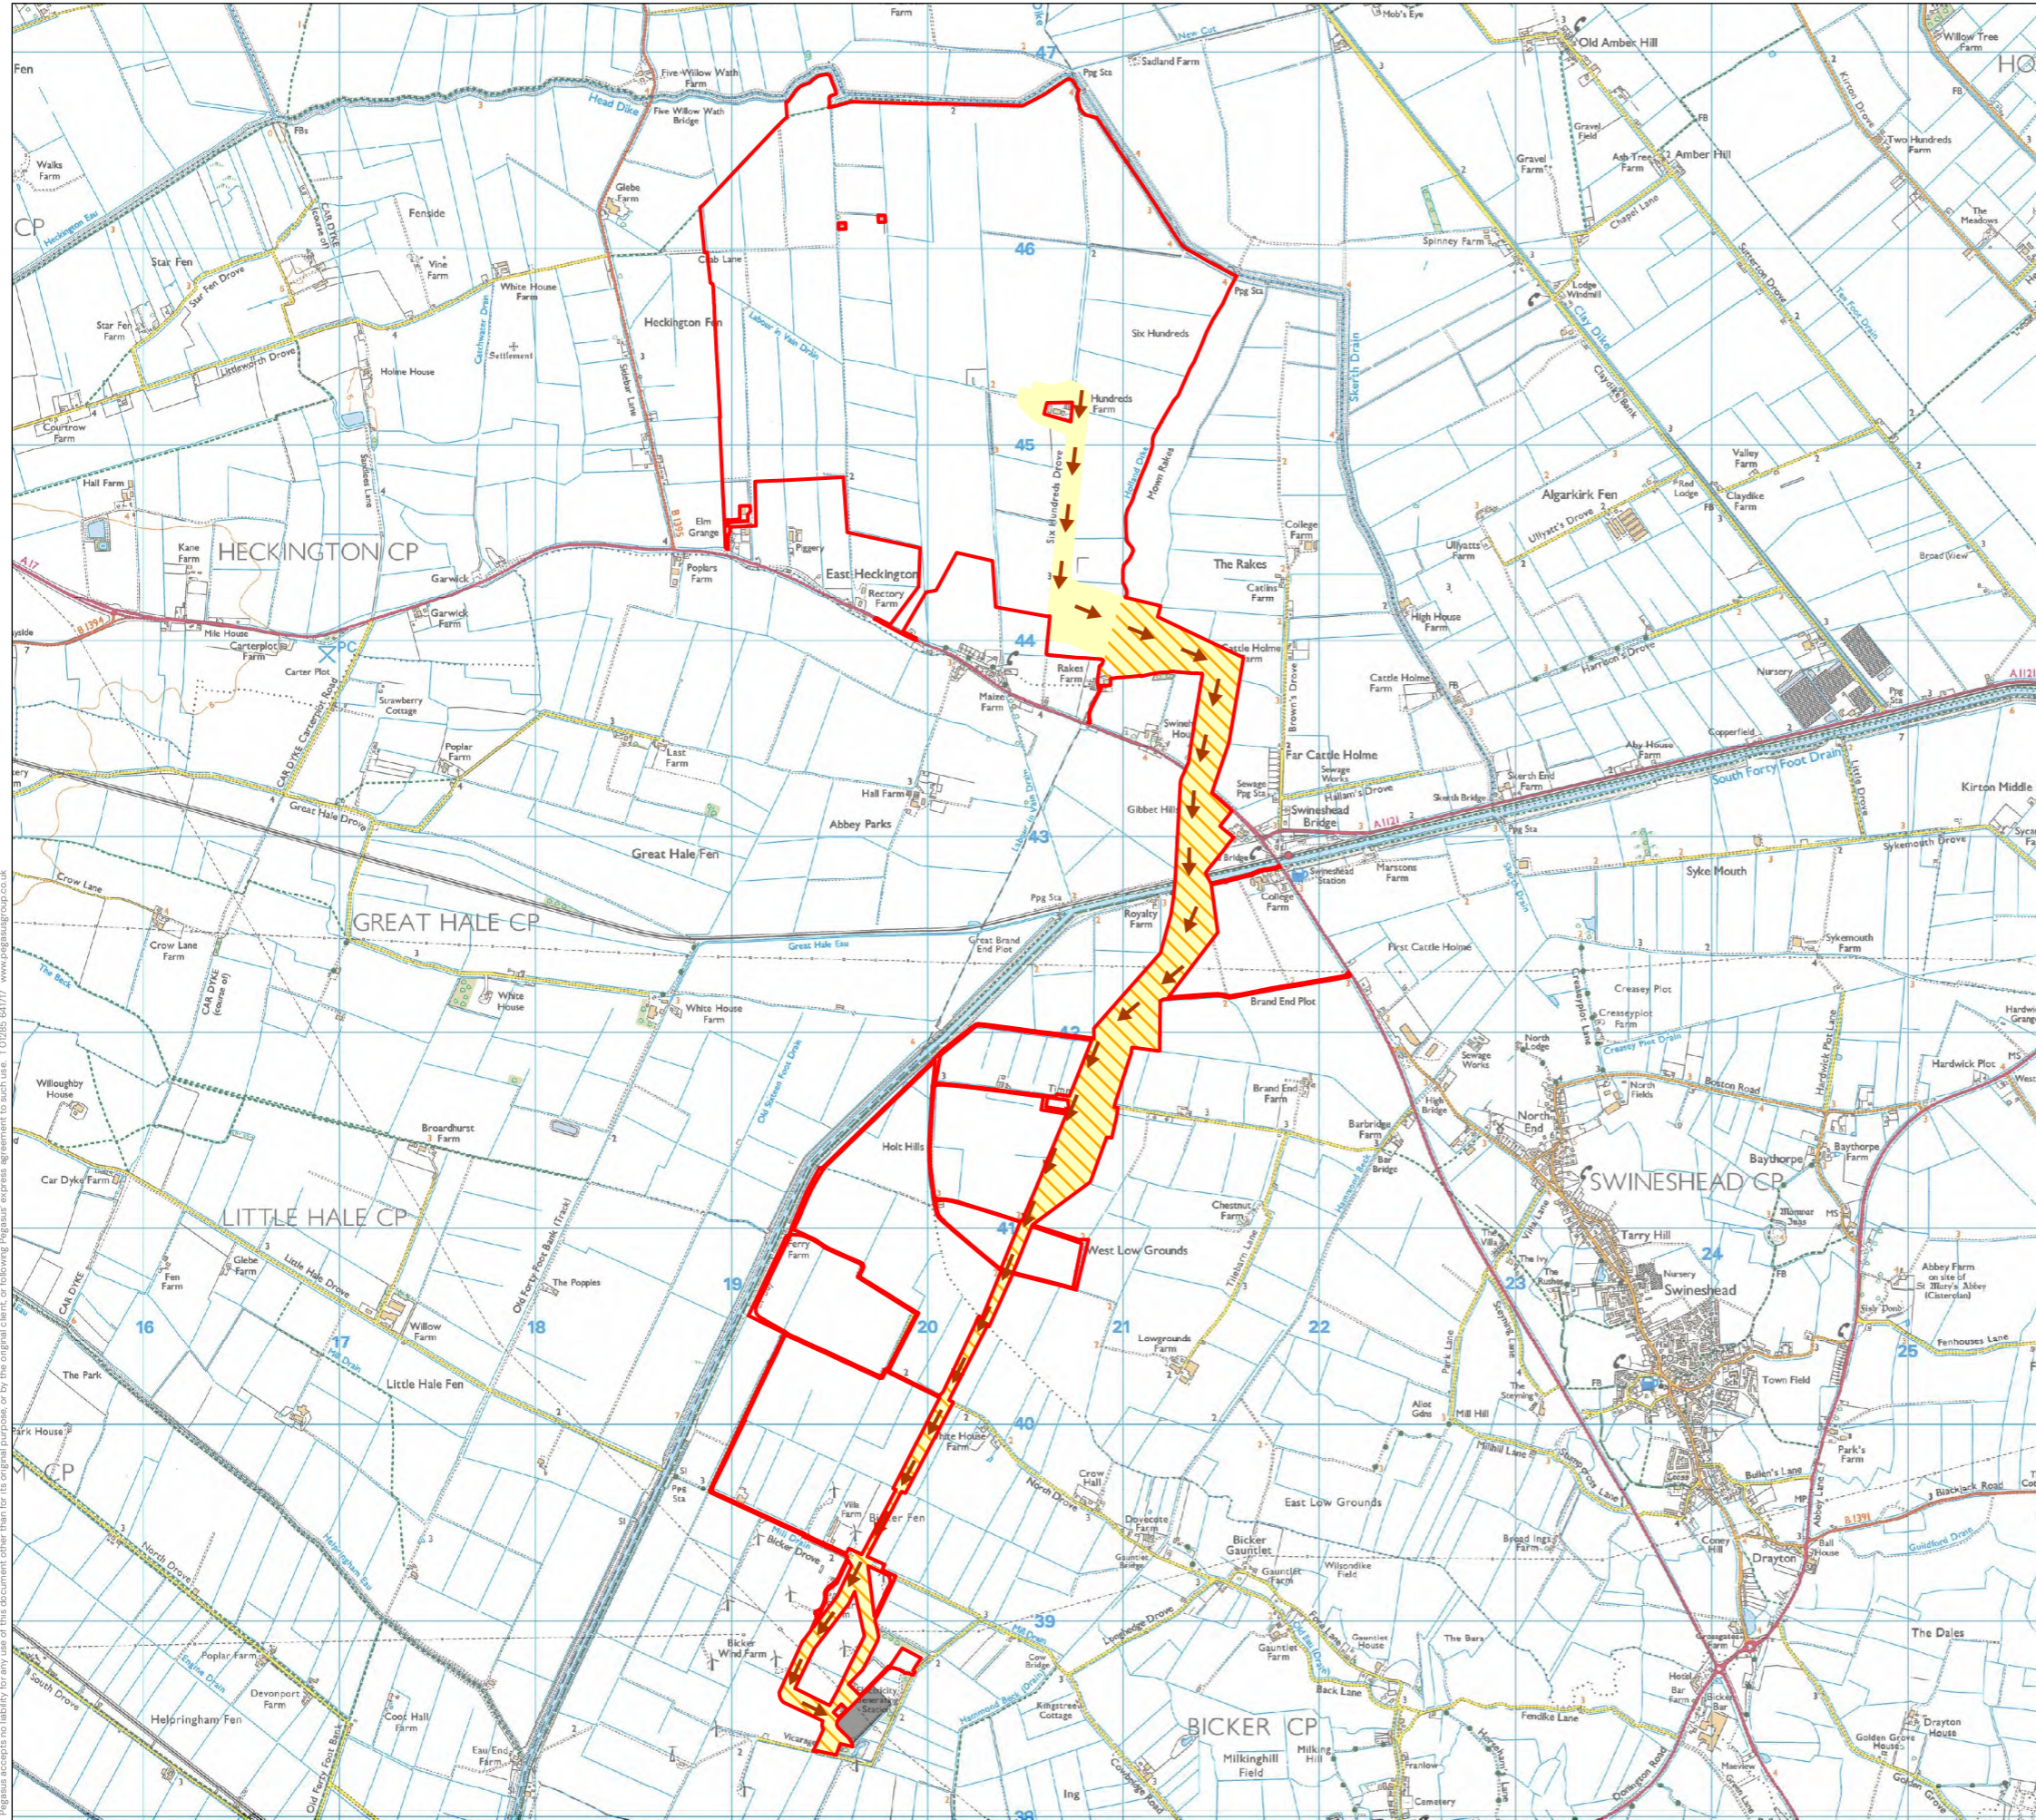

KEY

- Order Limits
- Bicker Fen Substation
- Indicative Cable Route
- Indicative Cable Route Corridor
- Off-Site Cable Route Corridor and Associated Ancillary Infrastructure (including temporary construction compounds and street access)

NOTES:

Areas with no indicative cable route are included for access purposes

An indicative preliminary route is shown for purposes of assessment. The final route alignment will follow in the detailed design

REVISIONS:

Change in submission

DCO Document Reference: 6.2.3

APFP Regulation: 5(2)(a)

FIGURE 3.5 INDICATIVE CABLE ROUTE

| DATE | SCALE | SHEET | REVISION |
|------------|-------------|-------|----------|
| 11/07/2023 | 1:35,000@A3 | - | C |

DRAWING NUMBER P20-2370_40

↑

0
1.5 km



Copyright Pegasus Planning Group Ltd. © Crown copyright and database rights 2023. Ordnance Survey 0100030373. Empasite Licence number 0100030373. Promap Licence number 000000449. Pegasus accepts no liability for any use of this document other than for the original purpose, or by the original client, or following express agreement to such use. T 01262 84777. www.pegasusplanning.co.uk