

Heckington Fen Solar Park

EN010123

Figure 3.8 Extent of plantation clearance at Bicker Fen National Grid Substation

Applicant: Ecotricity (Heck Fen Solar) Limited


Document Reference: Pre-ExA.ChangeApp.ESFIG3.8.V1

Pursuant to: APFP Regulation 5(2)(a)

Document Revision: 1

August 2023



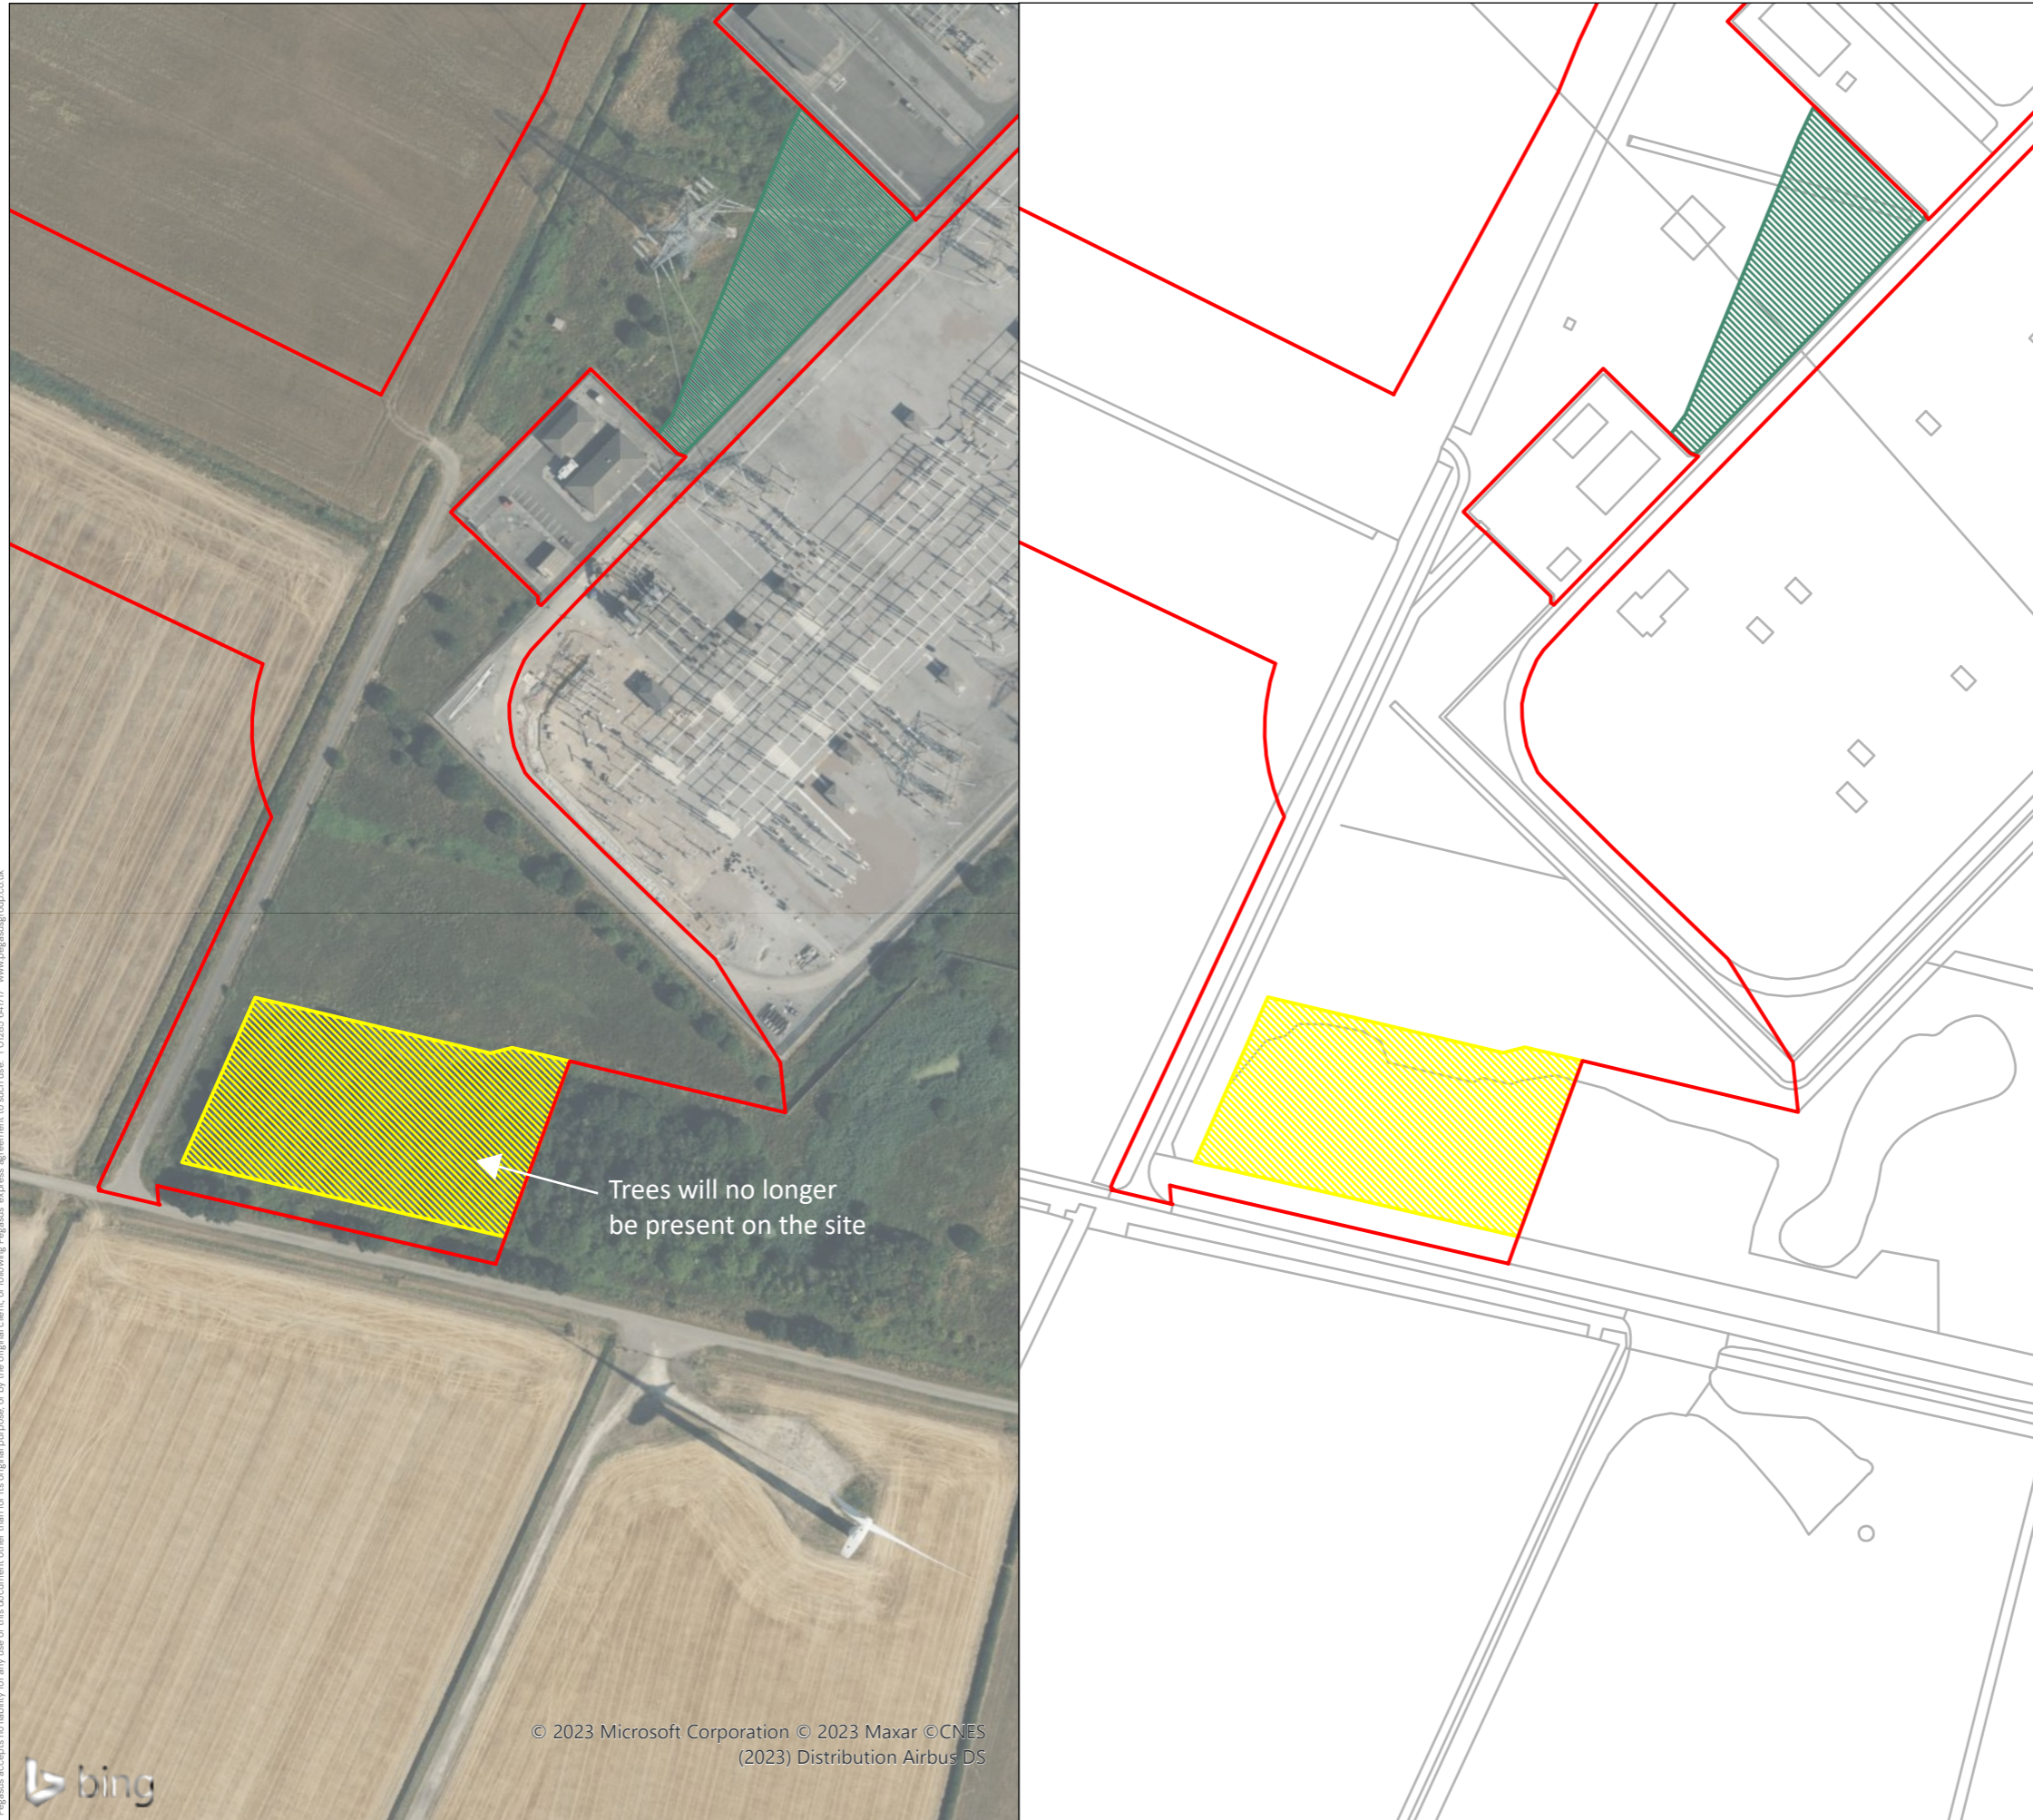

KEY

- Order Limits
- Plantation Clearance – south of substation (Total area 0.53ha of which 0.4ha is plantation woodland and 0.13ha is rough grassland/scrub)
- Rough Grassland/Scrubland Clearance – west of substation (0.3ha)

Trees will no longer be present on the site

DCO Document Reference: 6.2.3
 APFP Regulation: 5(2)(a)

FIGURE 3.8 – Extent of Plantation clearance in Additional Works areas at Bicker Fen National Grid Substation

DATE	SCALE	SHEET	REVISION
14/08/2023	1:2,000@A3	-	-

DRAWING NUMBER
 P20-2370_96

