

Heckington Fen Solar Park

EN010123

Figure 3.9 Change of Notification Areas at Bicker Fen National Grid Substation

Applicant: Ecotricity (Heck Fen Solar) Limited

Document Reference: Pre-ExA.ChangeApp.ESFIG3.9.V1

Pursuant to: APFP Regulation 5(2)(a)


Document Revision: 1

August 2023



Legend

- Proposed Order Limits
- AW1
- AW2
- Submitted DCO Order Limits

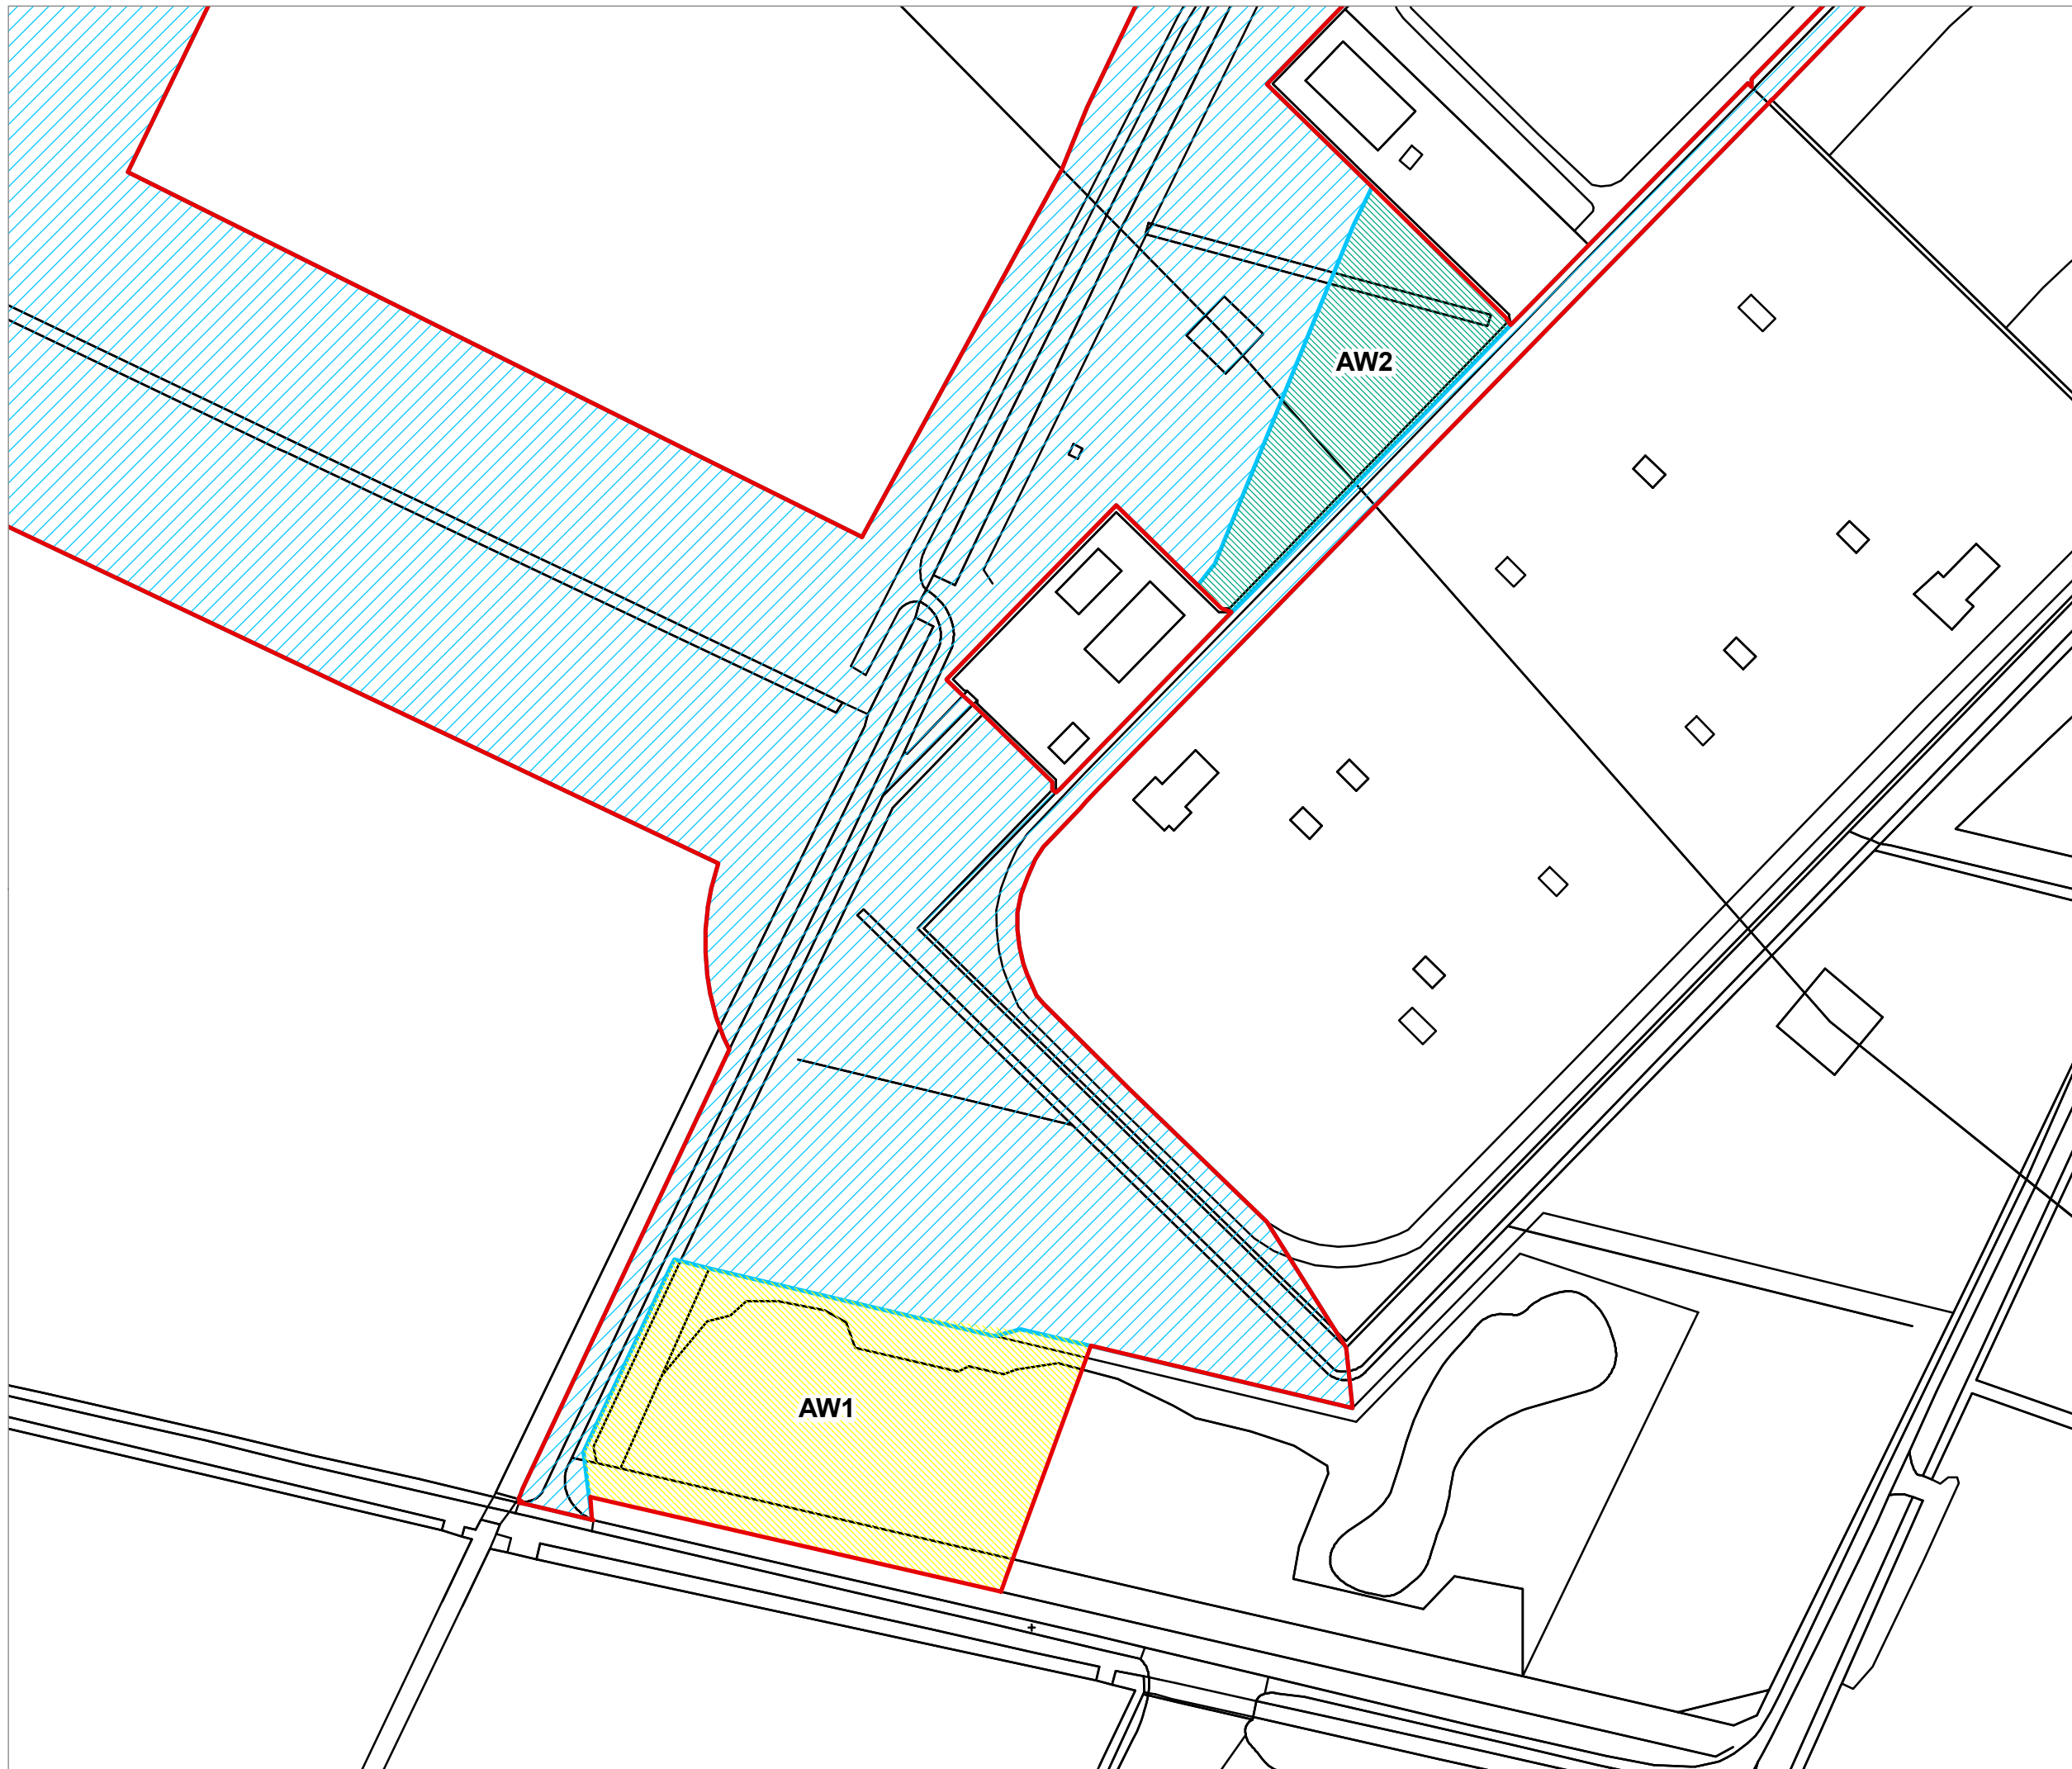


AW1 refers to the maximum extent of land required for bus coupler in AIS design solution

AW2 refers to a new cable sealing end

DCO Document Reference – 6.2.3

Figure 3.9

Title: Change of Notification Areas at Bicker Fen (August 2023)



Drawn by: **MW** Checked by: Approved by:

Ref: 6945_T0112_03 Date: June 2023

Heckington Fen Solar Park