

# Heckington Fen Solar Park

EN010123

## Figure 4.22 – Substation Control Building

Applicant: Ecotricity (Heck Fen Solar) Limited

Document Reference: 6.2.4





Pursuant to: APFP Regulation 5(2)(a)

Deadline 2: 7th November 2023

Document Revision: 2

November 2023



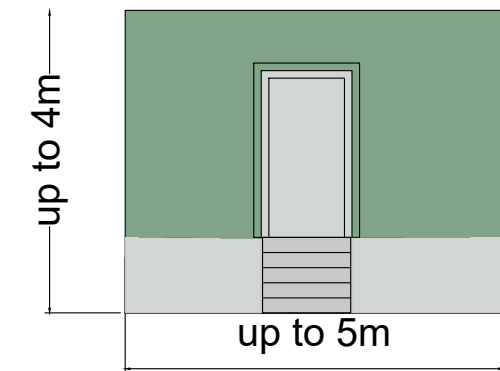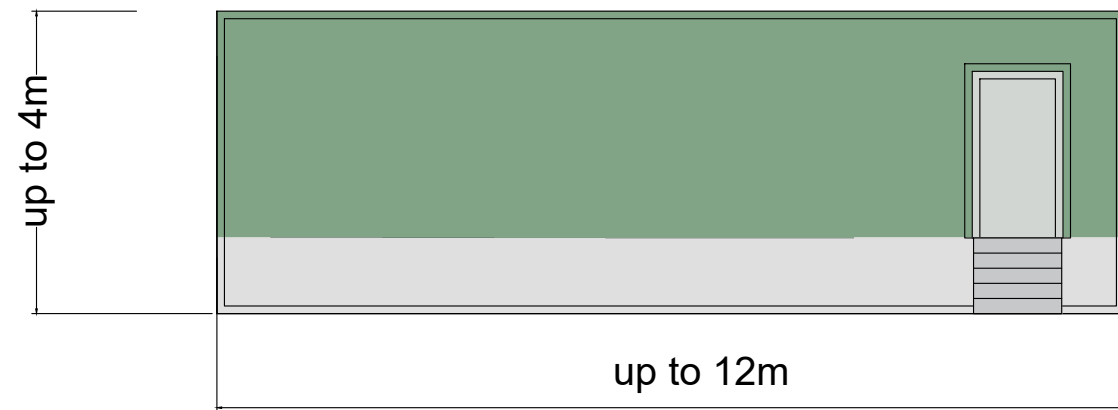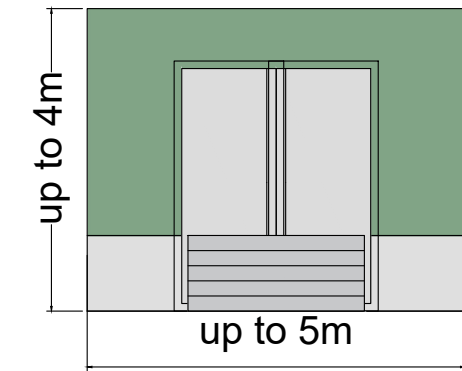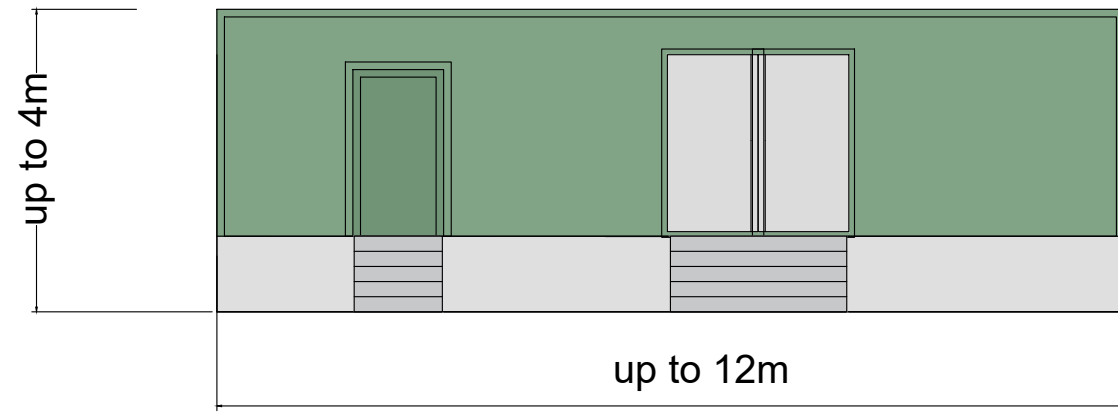

The finished floor level of the control room at the energy park site will be at or above 2.25m AOD.

NOTES: Plan is indicative and subject to detailed design.  
The infrastructure within the plan represents a worst-case scenario in terms of scale and design and has been accordingly assessed within the ES documentation

DCO Document Reference: 6.2.4  
APFP Regulation: (5)(2)(o)

**Figure 4.22**  
**Substation Control Building Elevation**

Scale: 1: 100 @ A3

Drawn by: Checked by: Approved by:

Ref: 6945\_T0095\_03 Date: October 2023