



Company:		Ou	ter Dowsing Offshore	Asset:		Whole Asset					
Project:		WI	nole Wind Farm	Sub Project/Package:		Whole Asset					
Document Title or Description:		2.2	2.2 Offshore Works Plans								
Internal Document Number:		PP	PP1-ODOW-DEV-CS-PLN-0012_03		3 rd Party Doc No (If applicable):		N/A				
Rev No.	Date		Status / Reason for Issue	Author	Checked by	Re ^s	viewed	Approved by			
1.0	March 2024		DCO Application	Dalcour Maclaren	Shepherd & Wedderburn	Ou Do	ter wsing	Outer Dowsing			
2.0	July 2024		Response to Section 51 Advice	Dalcour Maclaren	Shepherd & Wedderburn		ter wsing	Outer Dowsing			
3.0	September 2024		Procedural Deadline 19 September	Dalcour Maclaren	Shepherd & Wedderburn		ter wsing	Outer Dowsing			

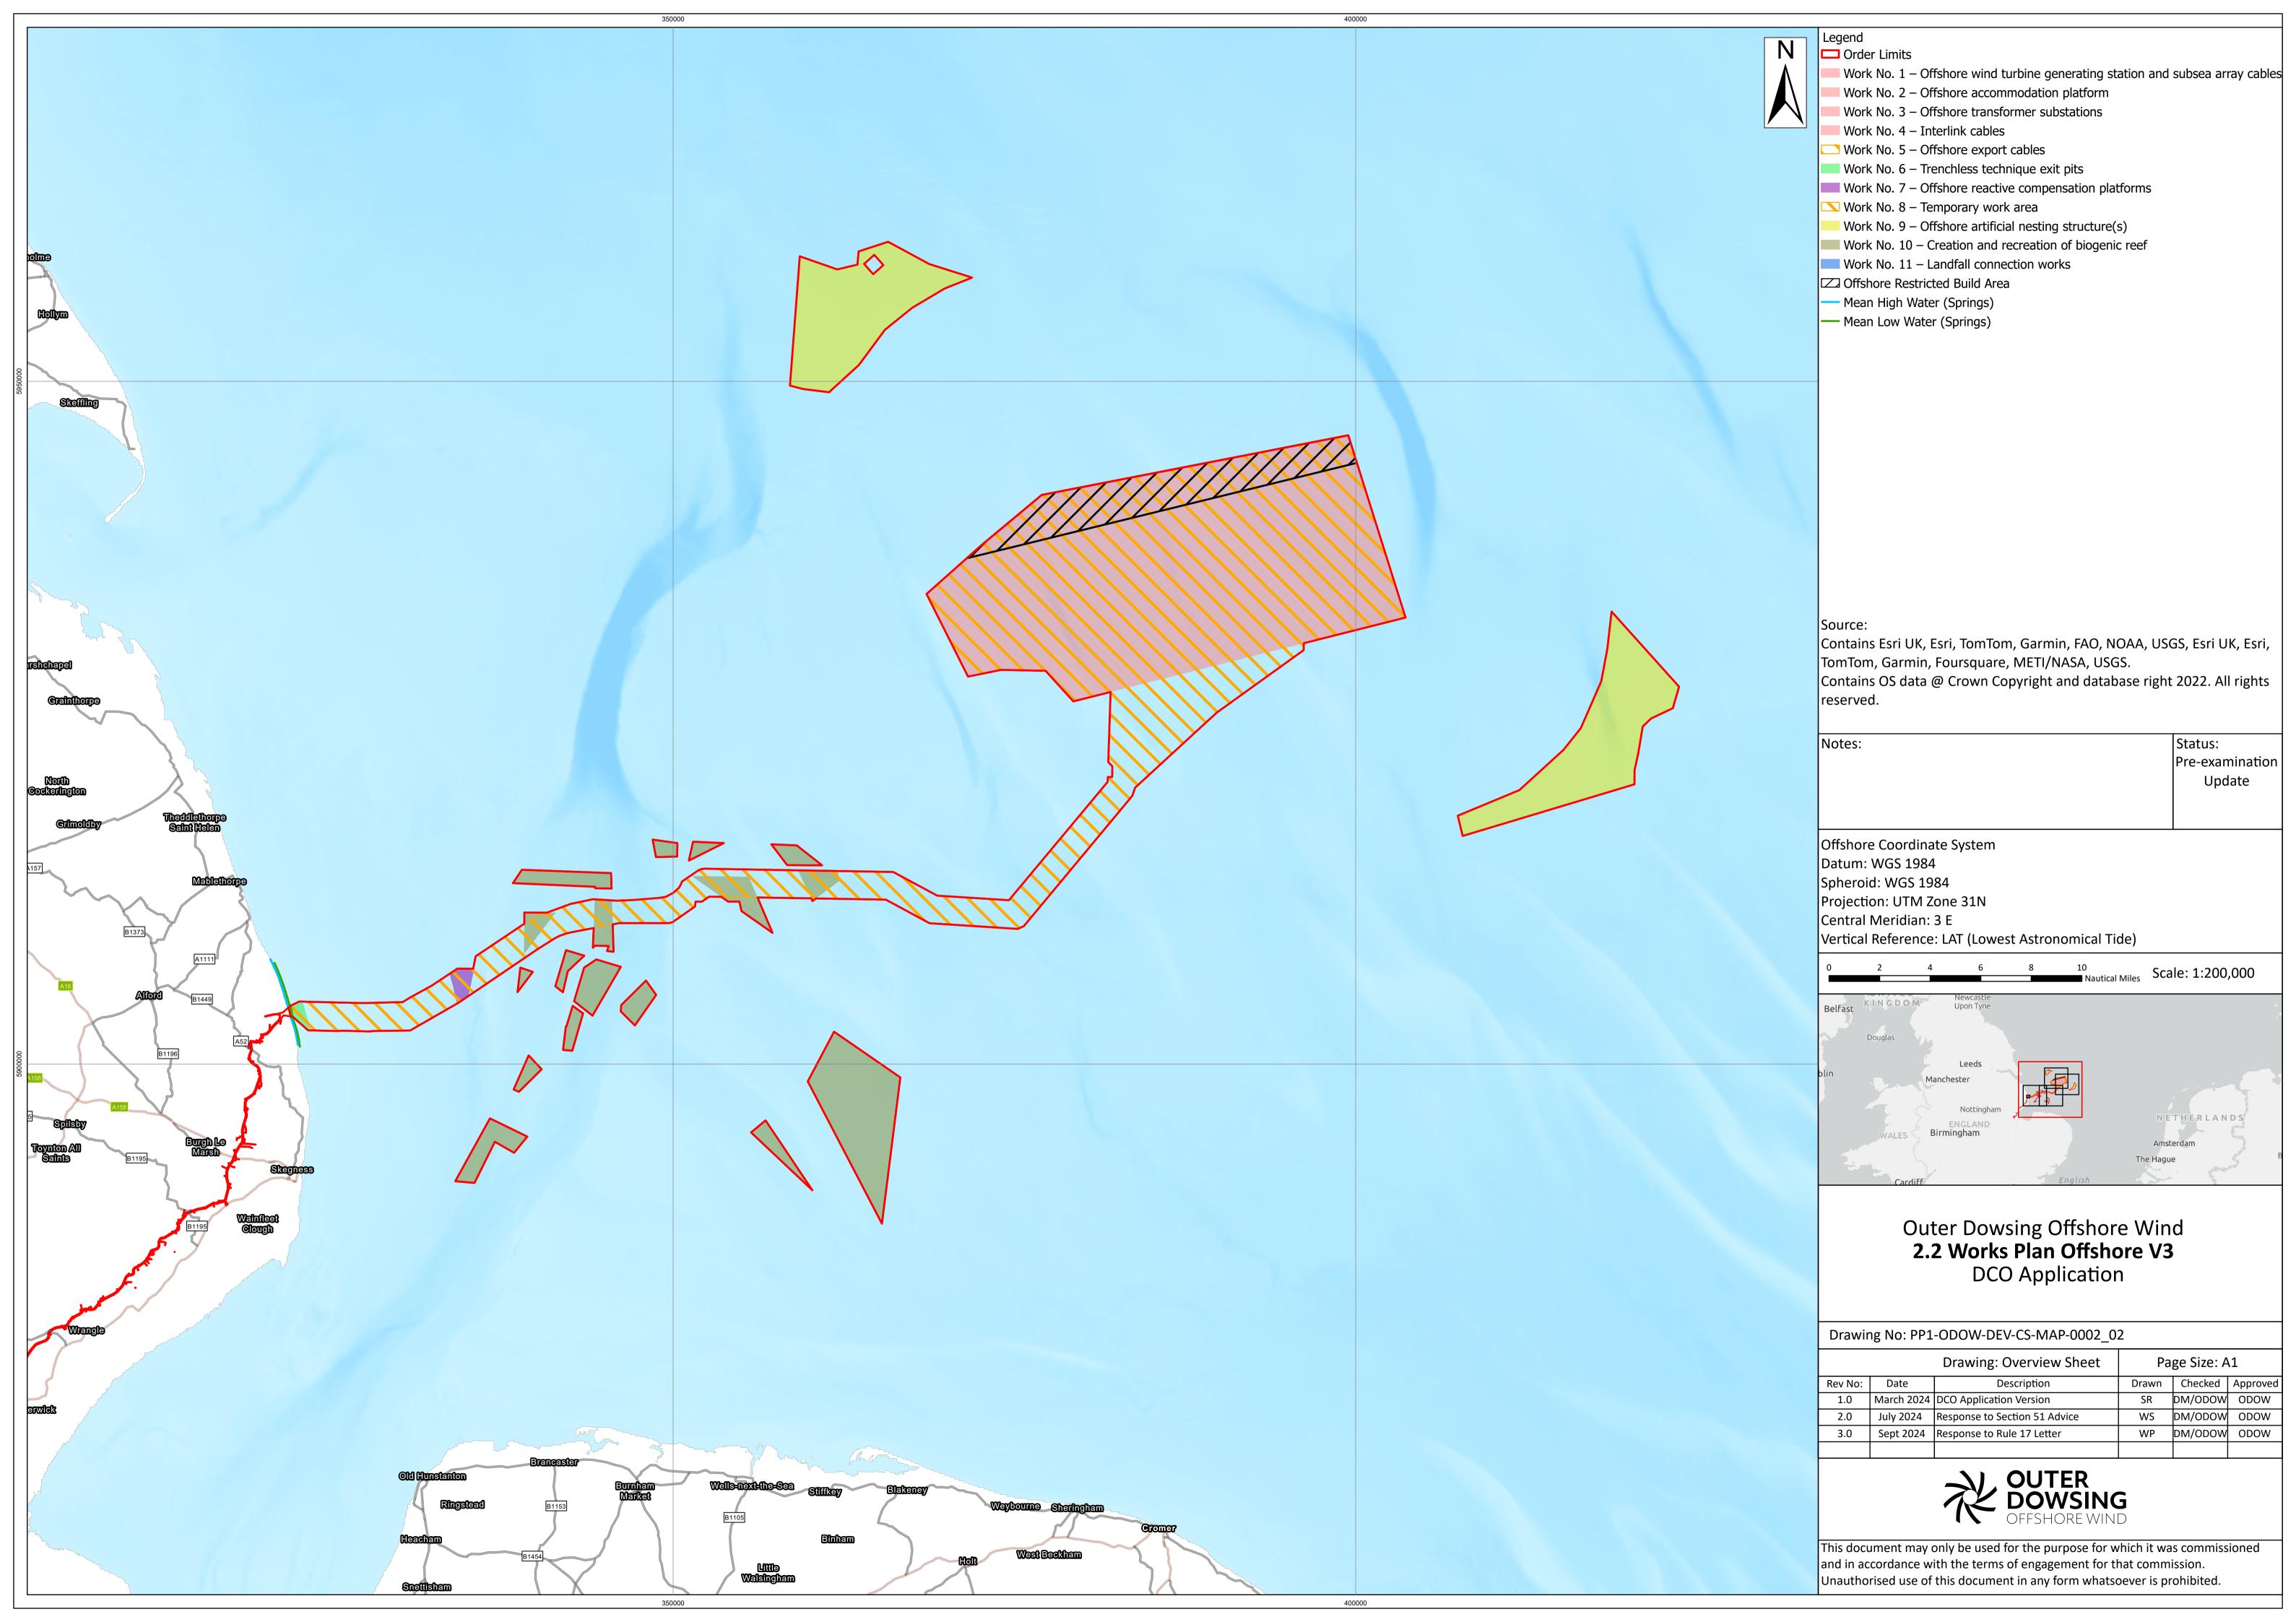

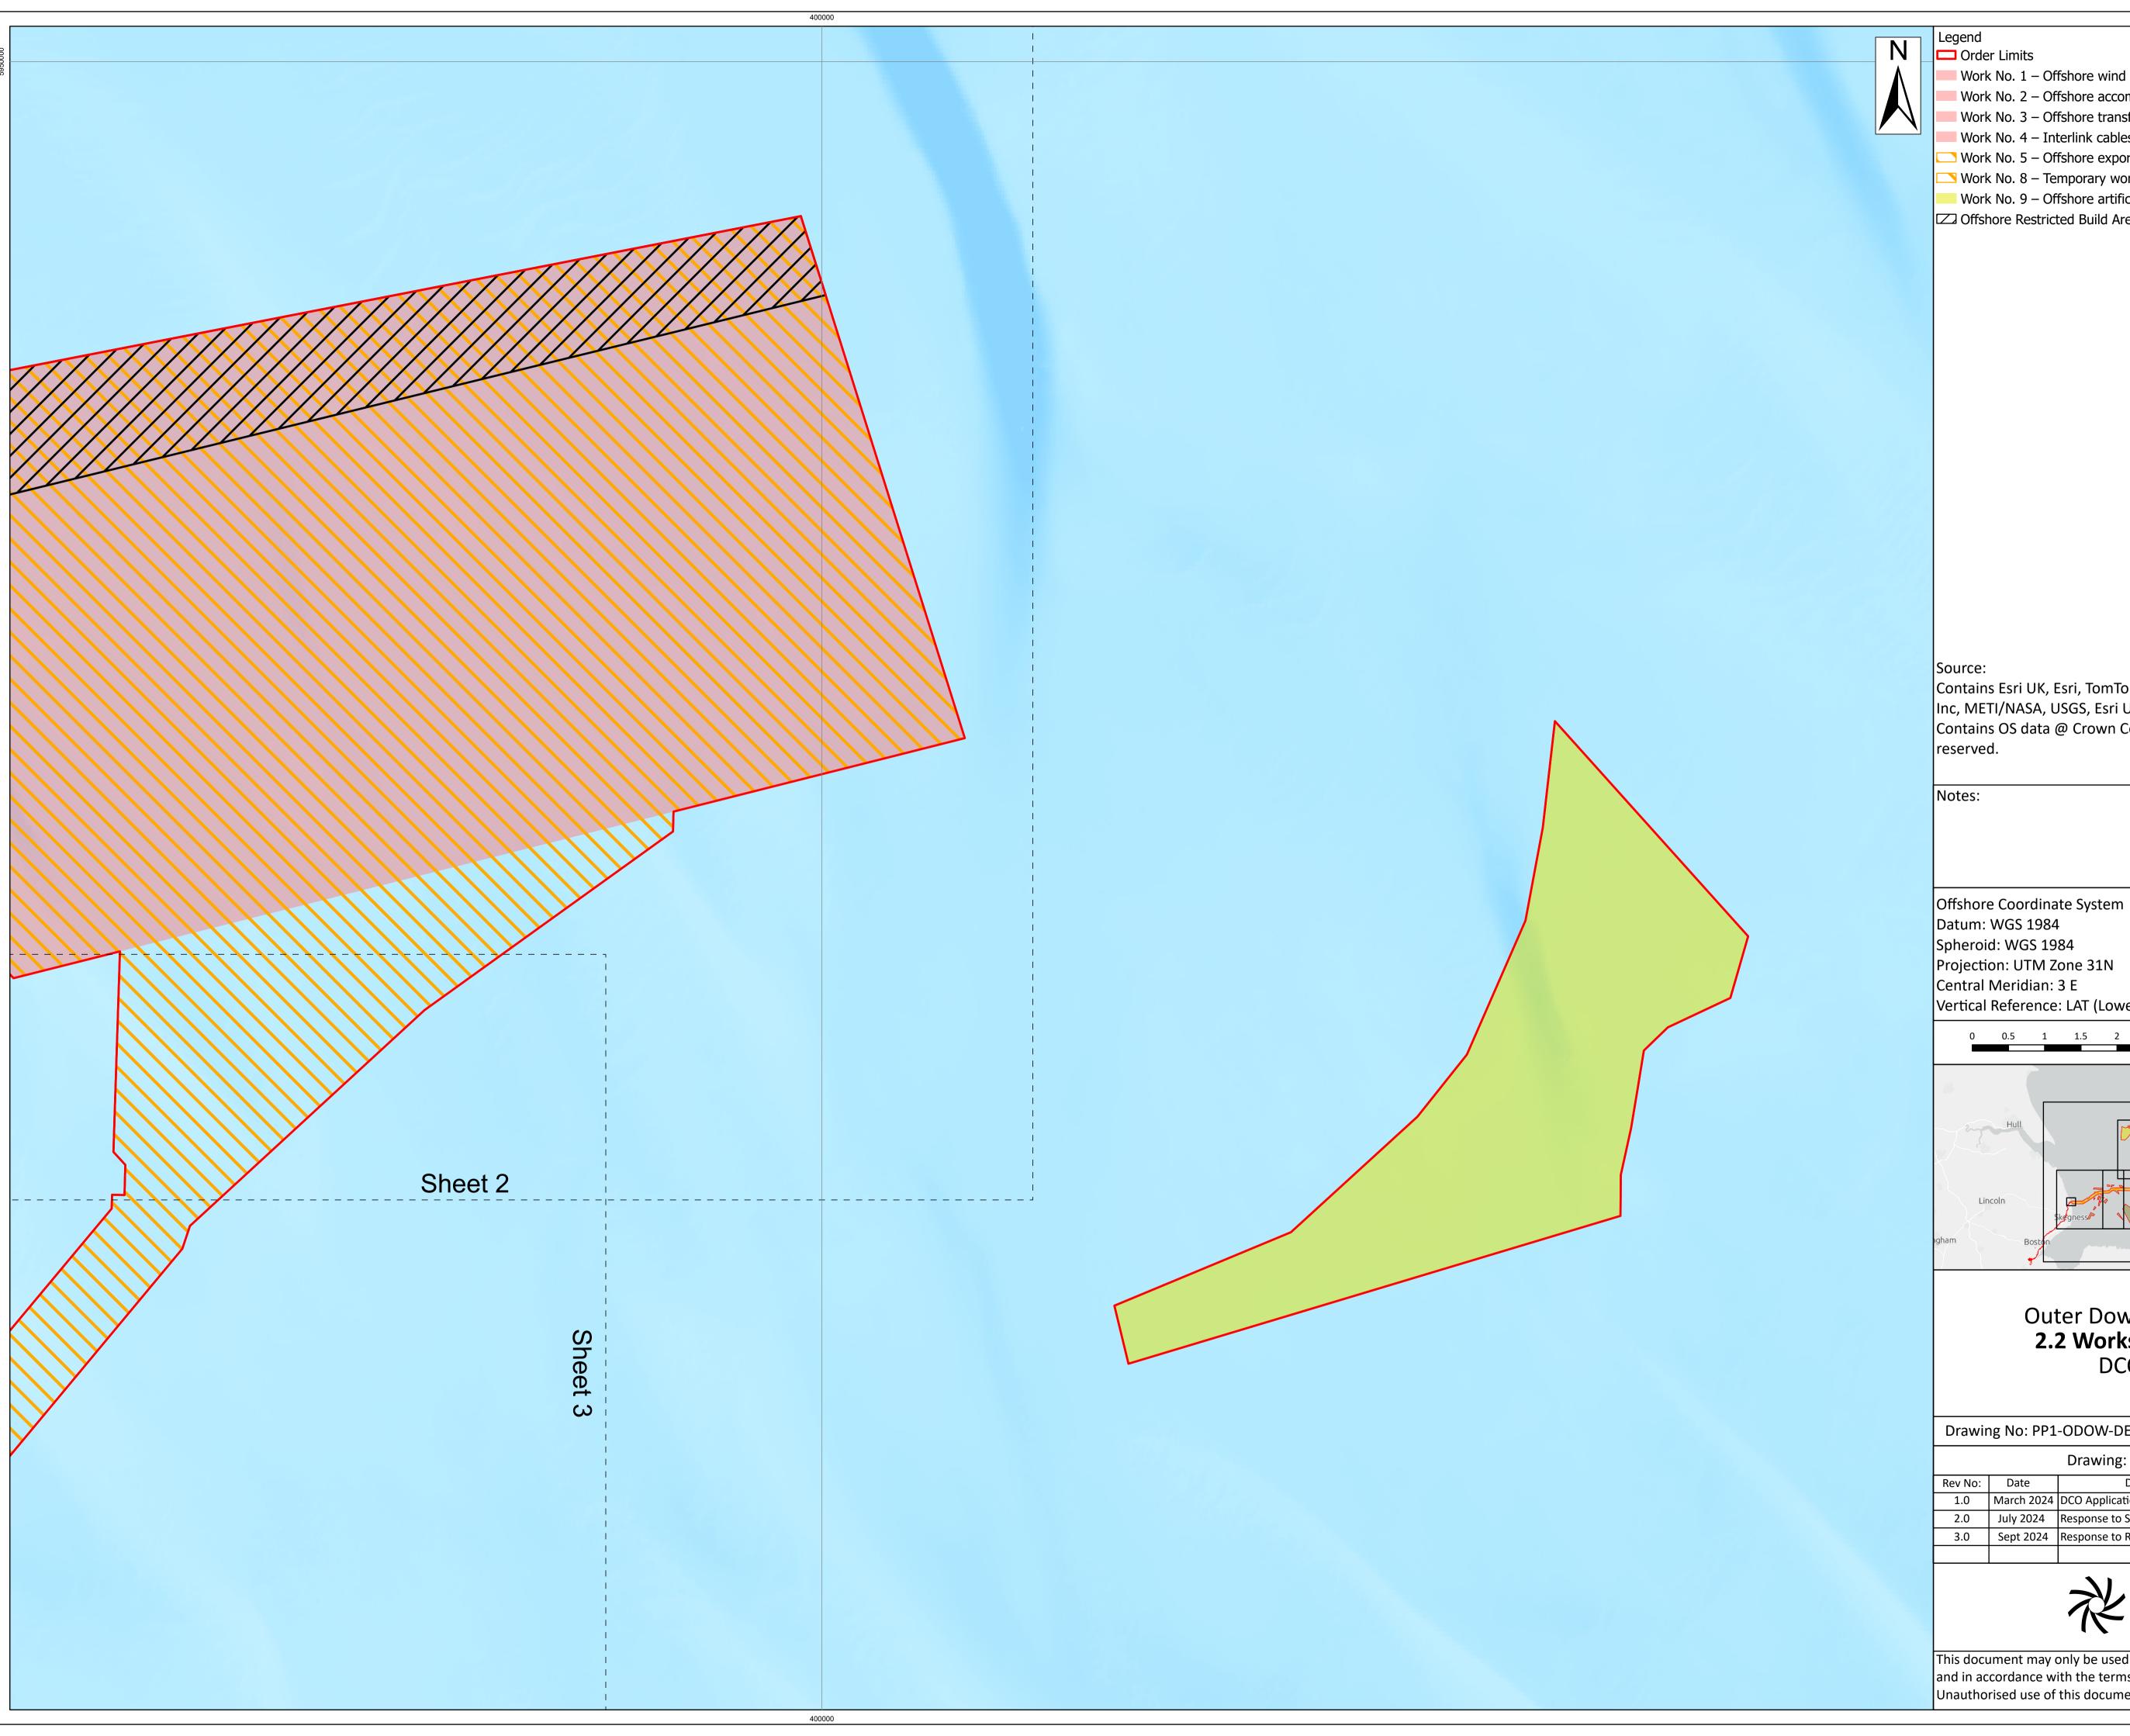

- Work No. 1 Offshore wind turbine generating station and subsea array cables
- Work No. 2 Offshore accommodation platform
- Work No. 3 Offshore transformer substations
- Work No. 4 Interlink cables
- → Work No. 5 Offshore export cables
- Nork No. 8 − Temporary work area
- Work No. 9 Offshore artificial nesting structure(s)
- ☑ Offshore Restricted Build Area


Contains Esri UK, Esri, TomTom, Garmin, Foursquare, GeoTechnologies, Inc, METI/NASA, USGS, Esri UK, Esri, TomTom, Garmin, FAO, NOAA, USGS. Contains OS data @ Crown Copyright and database right 2022. All rights

> Status: Pre-examination Update

Scale: 1:75,000

Spheroid: WGS 1984 Projection: UTM Zone 31N

Vertical Reference: LAT (Lowest Astronomical Tide)

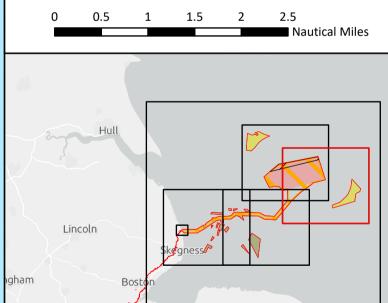

Outer Dowsing Offshore Wind **2.2 Works Plan Offshore V3** DCO Application

Drawing No: PP1-ODOW-DEV-CS-MAP-0002_02

		Page Size: A1			
Rev No:	Date	Description	Drawn	Checked	Approved
1.0	March 2024	DCO Application Version	SR	DM/ODOW	ODOW
2.0	July 2024	Response to Section 51 Advice	WS	DM/ODOW	ODOW
3.0	Sept 2024	Response to Rule 17 Letter	WP	DM/ODOW	ODOW



This document may only be used for the purpose for which it was commissioned and in accordance with the terms of engagement for that commission. Unauthorised use of this document in any form whatsoever is prohibited.

