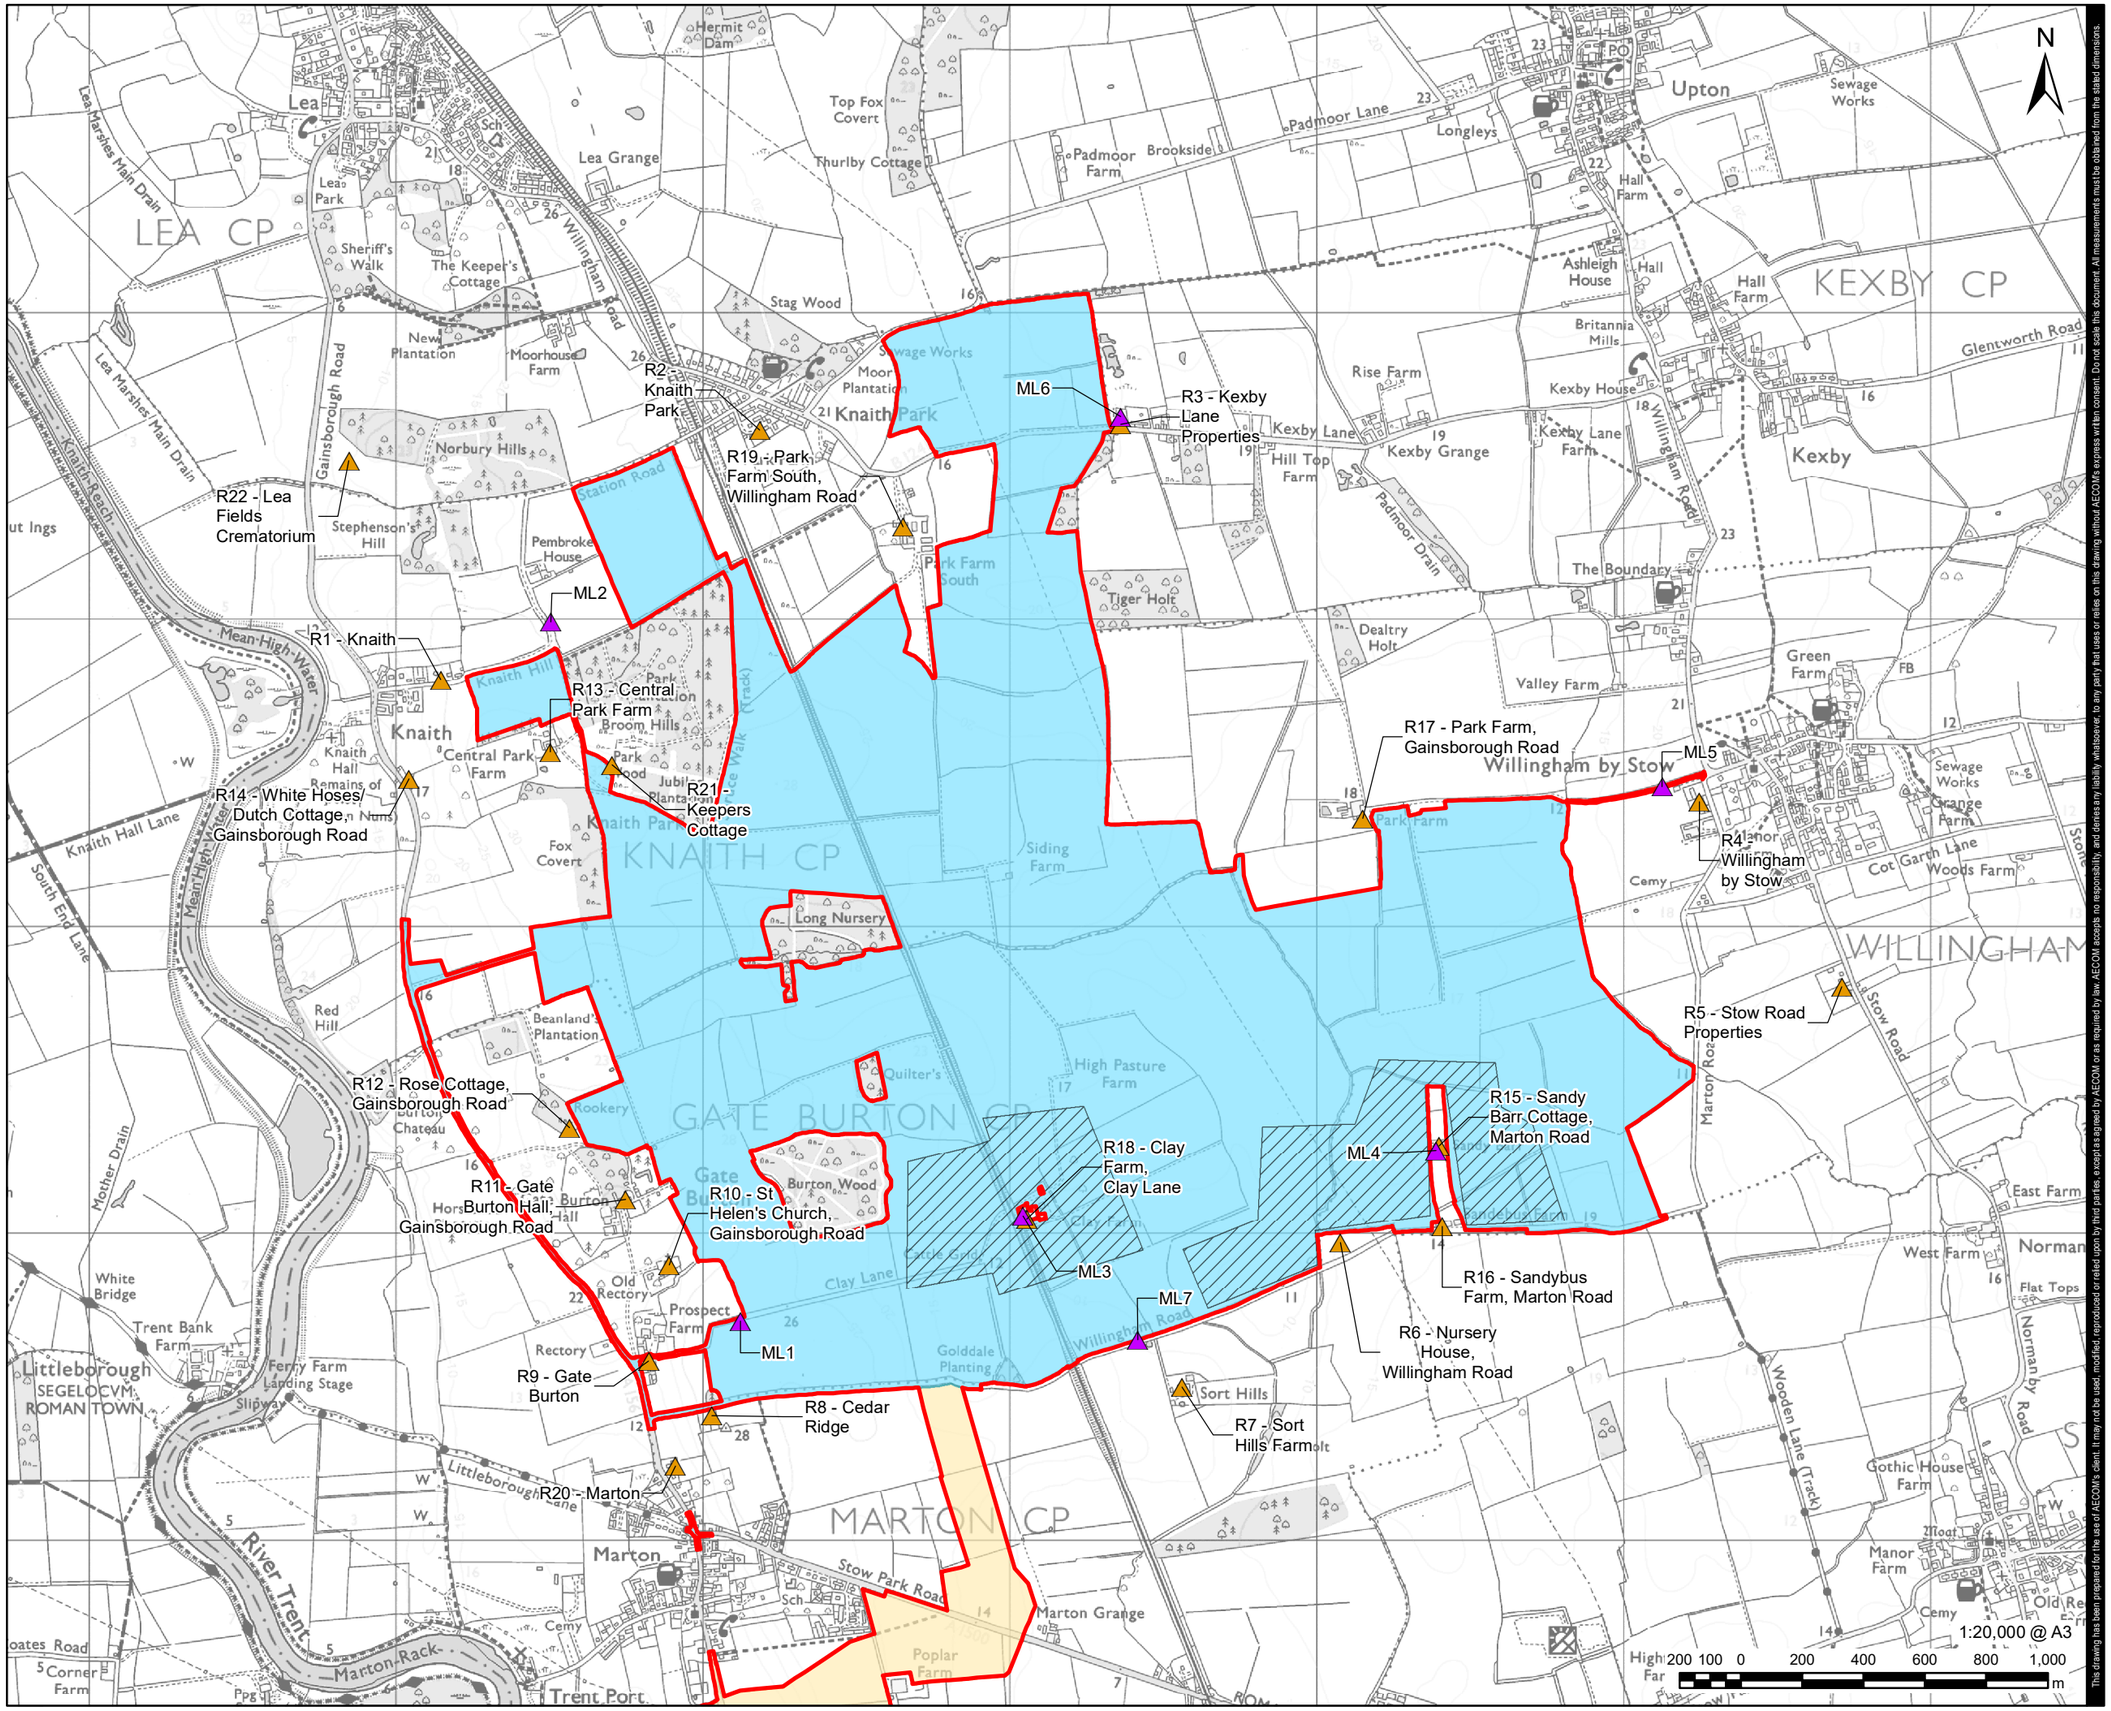

Filename: \\na.aecomnet.com\fs\EMEA\Croydon-UKCRD1\Legacy\UKCRD1\FP001\UKCRD1FP001-V1\E\projects\general\GIS\Projects\Gate Burton Energy Park\02_Maps\Environmental Statement\Chapter 11 - Noise\NOI_ES_Figure11_1_ReceptorandNoiseMonitoringLocations.mxd
Revision: 01 Drawn: VC Checked: ER Approved: WB Date: 2022-12-09

AECOM

PROJECT

Gate Burton Energy Park

CLIENT

Gate Burton ENERGY PARK

CONSULTANT

AECOM Limited
Sunley House
4 Bedford Park
Surrey, CR0 2AP, UK
www.aecom.com

LEGEND

- Order Limits
- Solar and Energy Storage
- Grid Connection
- Noise Monitoring
- Receptor Locations
- PCU Exclusion Zones for Noise

NOTES

© Crown copyright and database rights 2022. Ordnance Survey 0100031673.

ISSUE PURPOSE

Environmental Statement

PROJECT NUMBER

60664324

FIGURE TITLE

Receptor Locations and Noise Monitoring Positions

FIGURE NUMBER

Figure 11-1

This drawing has been prepared for the use of AECOM's client. It may not be used, modified, reproduced or relied upon by third parties, except as agreed by AECOM or as required by law. AECOM accepts no responsibility, and denies any liability whatsoever, to any party that uses or relies on this drawing without AECOM's express written consent. Do not scale this document. All measurements must be obtained from the stated dimensions.