

**AECOM**

PROJECT  
**Gate Burton Energy Park**


CLIENT  
**Gate Burton**  
ENERGY PARK  
CONSULTANT

AECOM Limited  
Sunley House  
4 Bedford Park  
Surrey, CR0 2AP, UK  
www.aecom.com

**LEGEND**

- ORDER LIMITS
- PHOTOVOLTAIC (PV) SOLAR PANEL
- NO TEMPORARY ACCESS
- TEMPORARY CONSTRUCTION COMPOUND
- PROPOSED LOCATION OF BATTERY ENERGY STORAGE SYSTEM (BESS)
- OVERHEAD POWERLINE AND PYLON
- PERIMETER FENCE TO SOLAR PANELS
- PROPOSED POWER CONVERSION UNIT (PCU)
- PROPOSED ACCESS TRACK
- J2.1 - INTACT HEDGE - SPECIES-POOR
- J2.2 - DEFUNCT HEDGE - SPECIES-POOR
- J2.3 - HEDGE WITH TREES - SPECIES-POOR
- A2.1 - SCRUB - DENSE/CONTINUOUS
- A2.2 - SCRUB - SCATTERED
- POTENTIAL AREAS OF VEGETATION REMOVAL**
- HEDGEROW REMOVAL
- PERIMETER FENCE REMOVAL
- WOODLAND REMOVAL

Hedgerows removed will be reinstated in accordance with the Outline Landscape and Ecology Management Plan (EN-010131/APPI7.10)

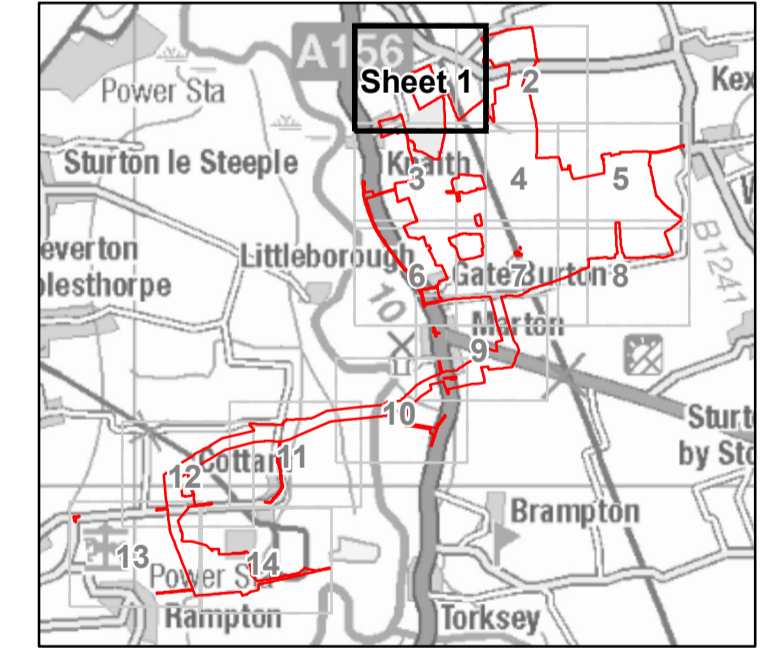

**NOTES**

- Do not scale from this drawing.
- For proposed site access arrangements and photovoltaic (PV) layout refer to engineers drawings.
- Drawing to be read and printed in colour.

© Crown copyright and database rights 2022.  
Ordnance Survey 0100031673.


**ISSUE PURPOSE**

FINAL

**PROJECT NUMBER**  
60664324


**FIGURE TITLE**  
Vegetation Removal Plan  
Version 4 (Change Request Version)  
Sheet 1 of 14

**FIGURE NUMBER**  
Figure 10-21

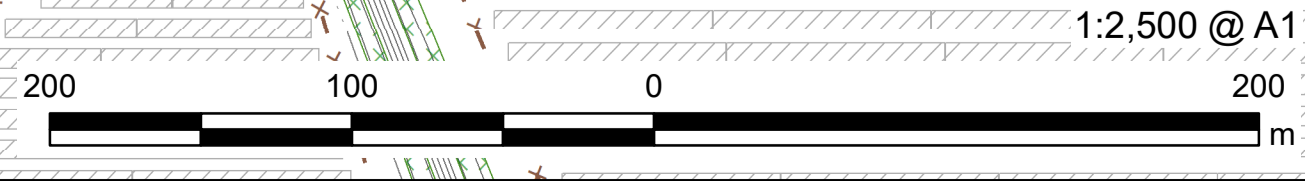

This drawing has been prepared for the use of AECOM's client. It may not be used, modified, reproduced or resold upon by third parties, except as agreed by AECOM. AECOM accepts no responsibility, and denies any liability whatsoever, to any party that uses or relies on this drawing without AECOM's express written consent. Do not seal this document. All measurements must be obtained from the stated dimensions.

Revision: 04 Drawn: VC Checked: JS Approved: WB Date: 2023-10-02  
 Filename: \\na.aecomnet.com\fs\EMEA\Croydon\UKCRD1\Legacy\UKCRD1\PP001\UKCRD1\Projects\Gate Burton Energy Park\02\_Maps\Further Environmental Information\Vegetation Removal Plan.mxd

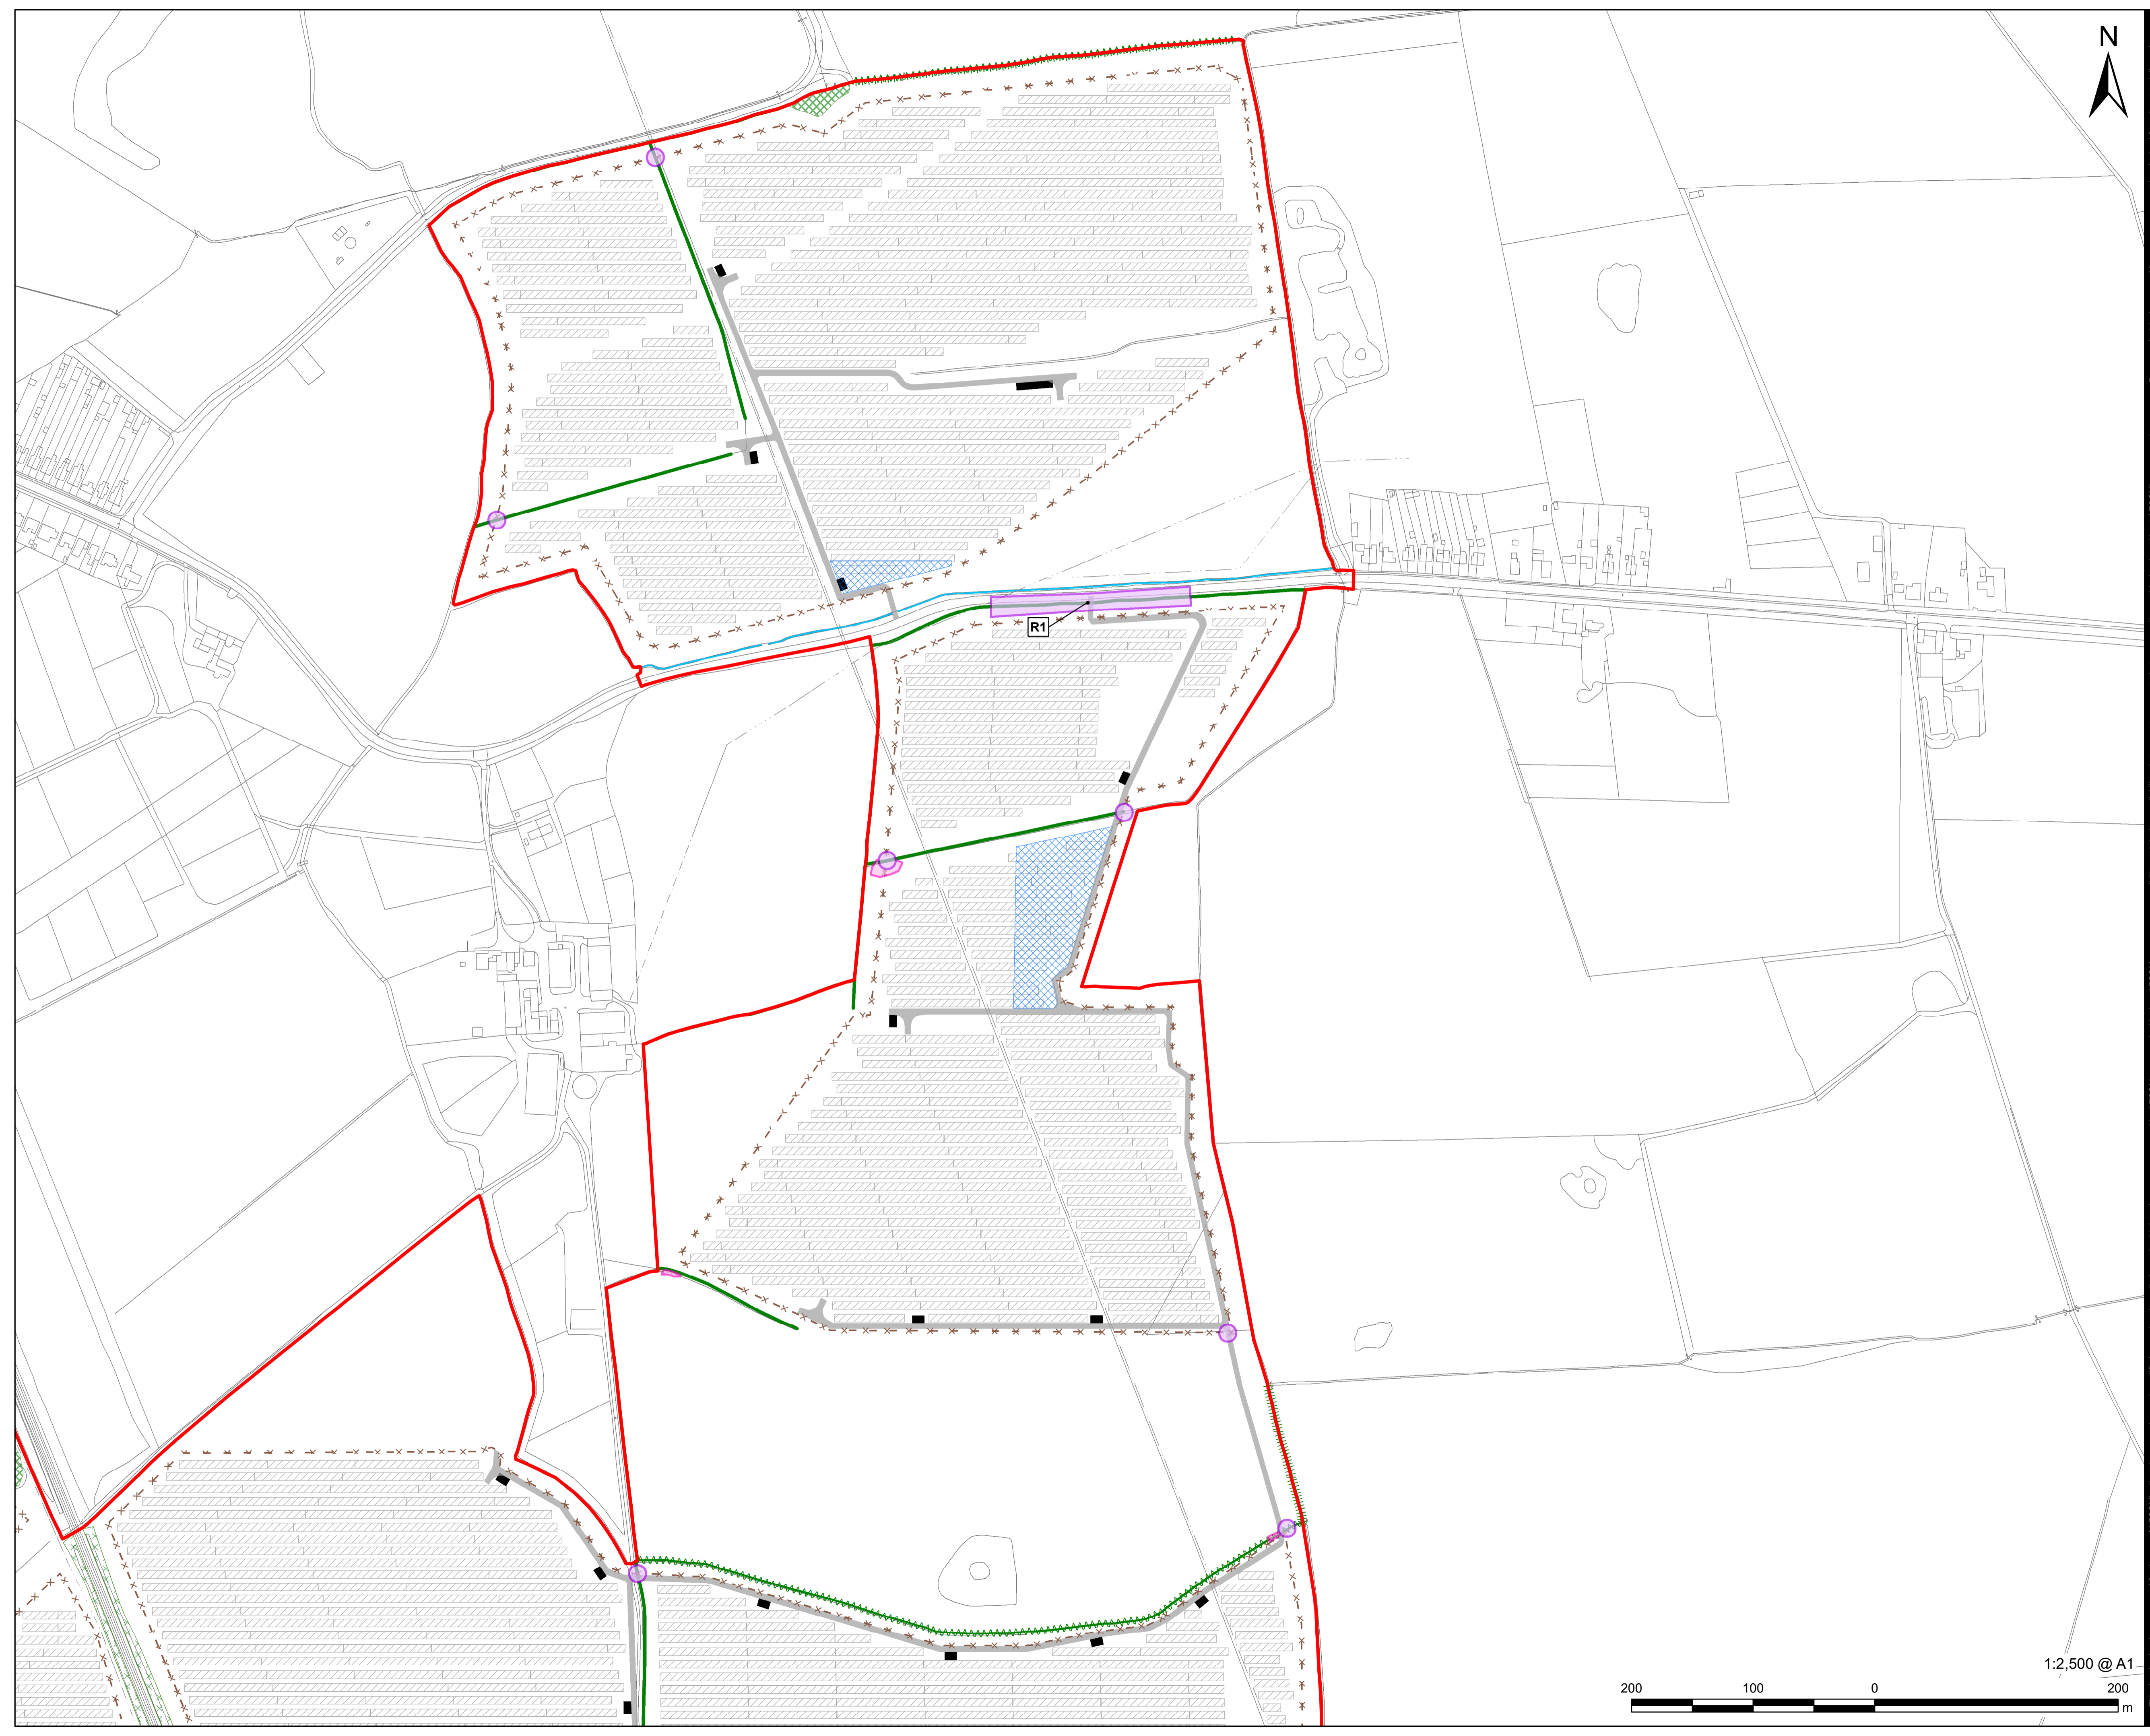

**AECOM**

PROJECT  
**Gate Burton Energy Park**

CLIENT  
  
**Gate Burton**  
 ENERGY PARK  
 CONSULTANT

AECOM Limited  
 Sunley House  
 4 Bedford Park  
 Surrey, CR0 2AP, UK  
 www.aecom.com


**LEGEND**

- ORDER LIMITS
- PHOTOVOLTAIC (PV) SOLAR PANEL
- NO TEMPORARY ACCESS
- TEMPORARY CONSTRUCTION COMPOUND
- PROPOSED LOCATION OF BATTERY ENERGY STORAGE SYSTEM (BESS)
- OVERHEAD POWERLINE AND PYLON
- PERIMETER FENCE TO SOLAR PANELS
- PROPOSED POWER CONVERSION UNIT (PCU)
- PROPOSED ACCESS TRACK
- G2 - RUNNING WATER
- J2.1.1 - INTACT HEDGE - NATIVE SPECIES-RICH
- J2.1.2 - INTACT HEDGE - SPECIES-POOR
- J2.3.1 - HEDGE WITH TREES - NATIVE SPECIES-RICH
- J2.3.2 - HEDGE WITH TREES - SPECIES-POOR
- A2.1 - SCRUB - DENSE/CONTINUOUS
- A2.2 - SCRUB - SCATTERED

**POTENTIAL AREAS OF VEGETATION REMOVAL**

- HEDGEROW REMOVAL
- PERIMETER FENCE REMOVAL
- WOODLAND REMOVAL

Hedgerows removed will be reinstated in accordance with the Outline Landscape and Ecology Management Plan (EN-010131/APPI7.10)

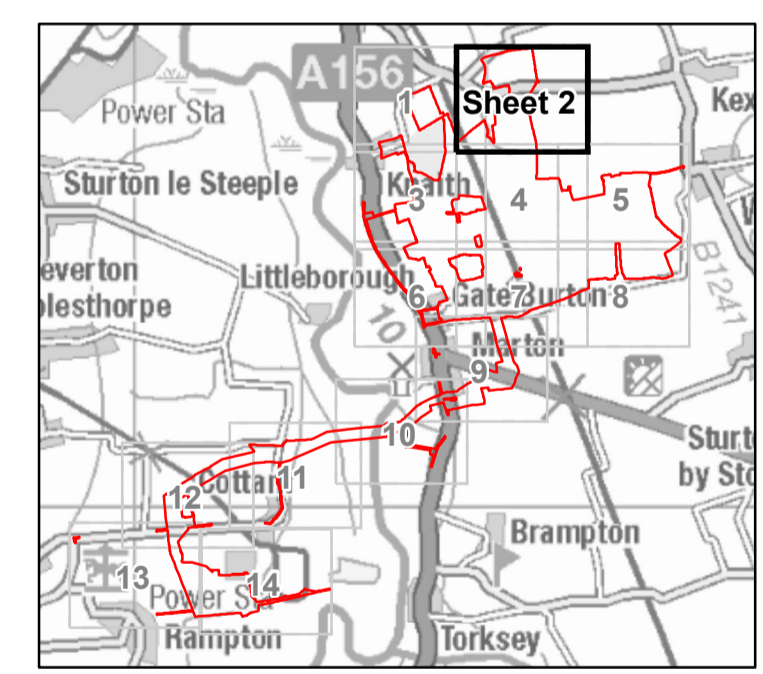

**NOTES**

1. Do not scale from this drawing.
2. For proposed site access arrangements and photovoltaic (PV) layout refer to engineers drawings.
3. Drawing to be read and printed in colour.

© Crown copyright and database rights 2022.  
 Ordnance Survey 0100031673.

**ISSUE PURPOSE**

FINAL

**PROJECT NUMBER**


60664324

**FIGURE TITLE**


Vegetation Removal Plan  
 Version 4 (Change Request Version)  
 Sheet 2 of 14

**FIGURE NUMBER**

Figure 10-21

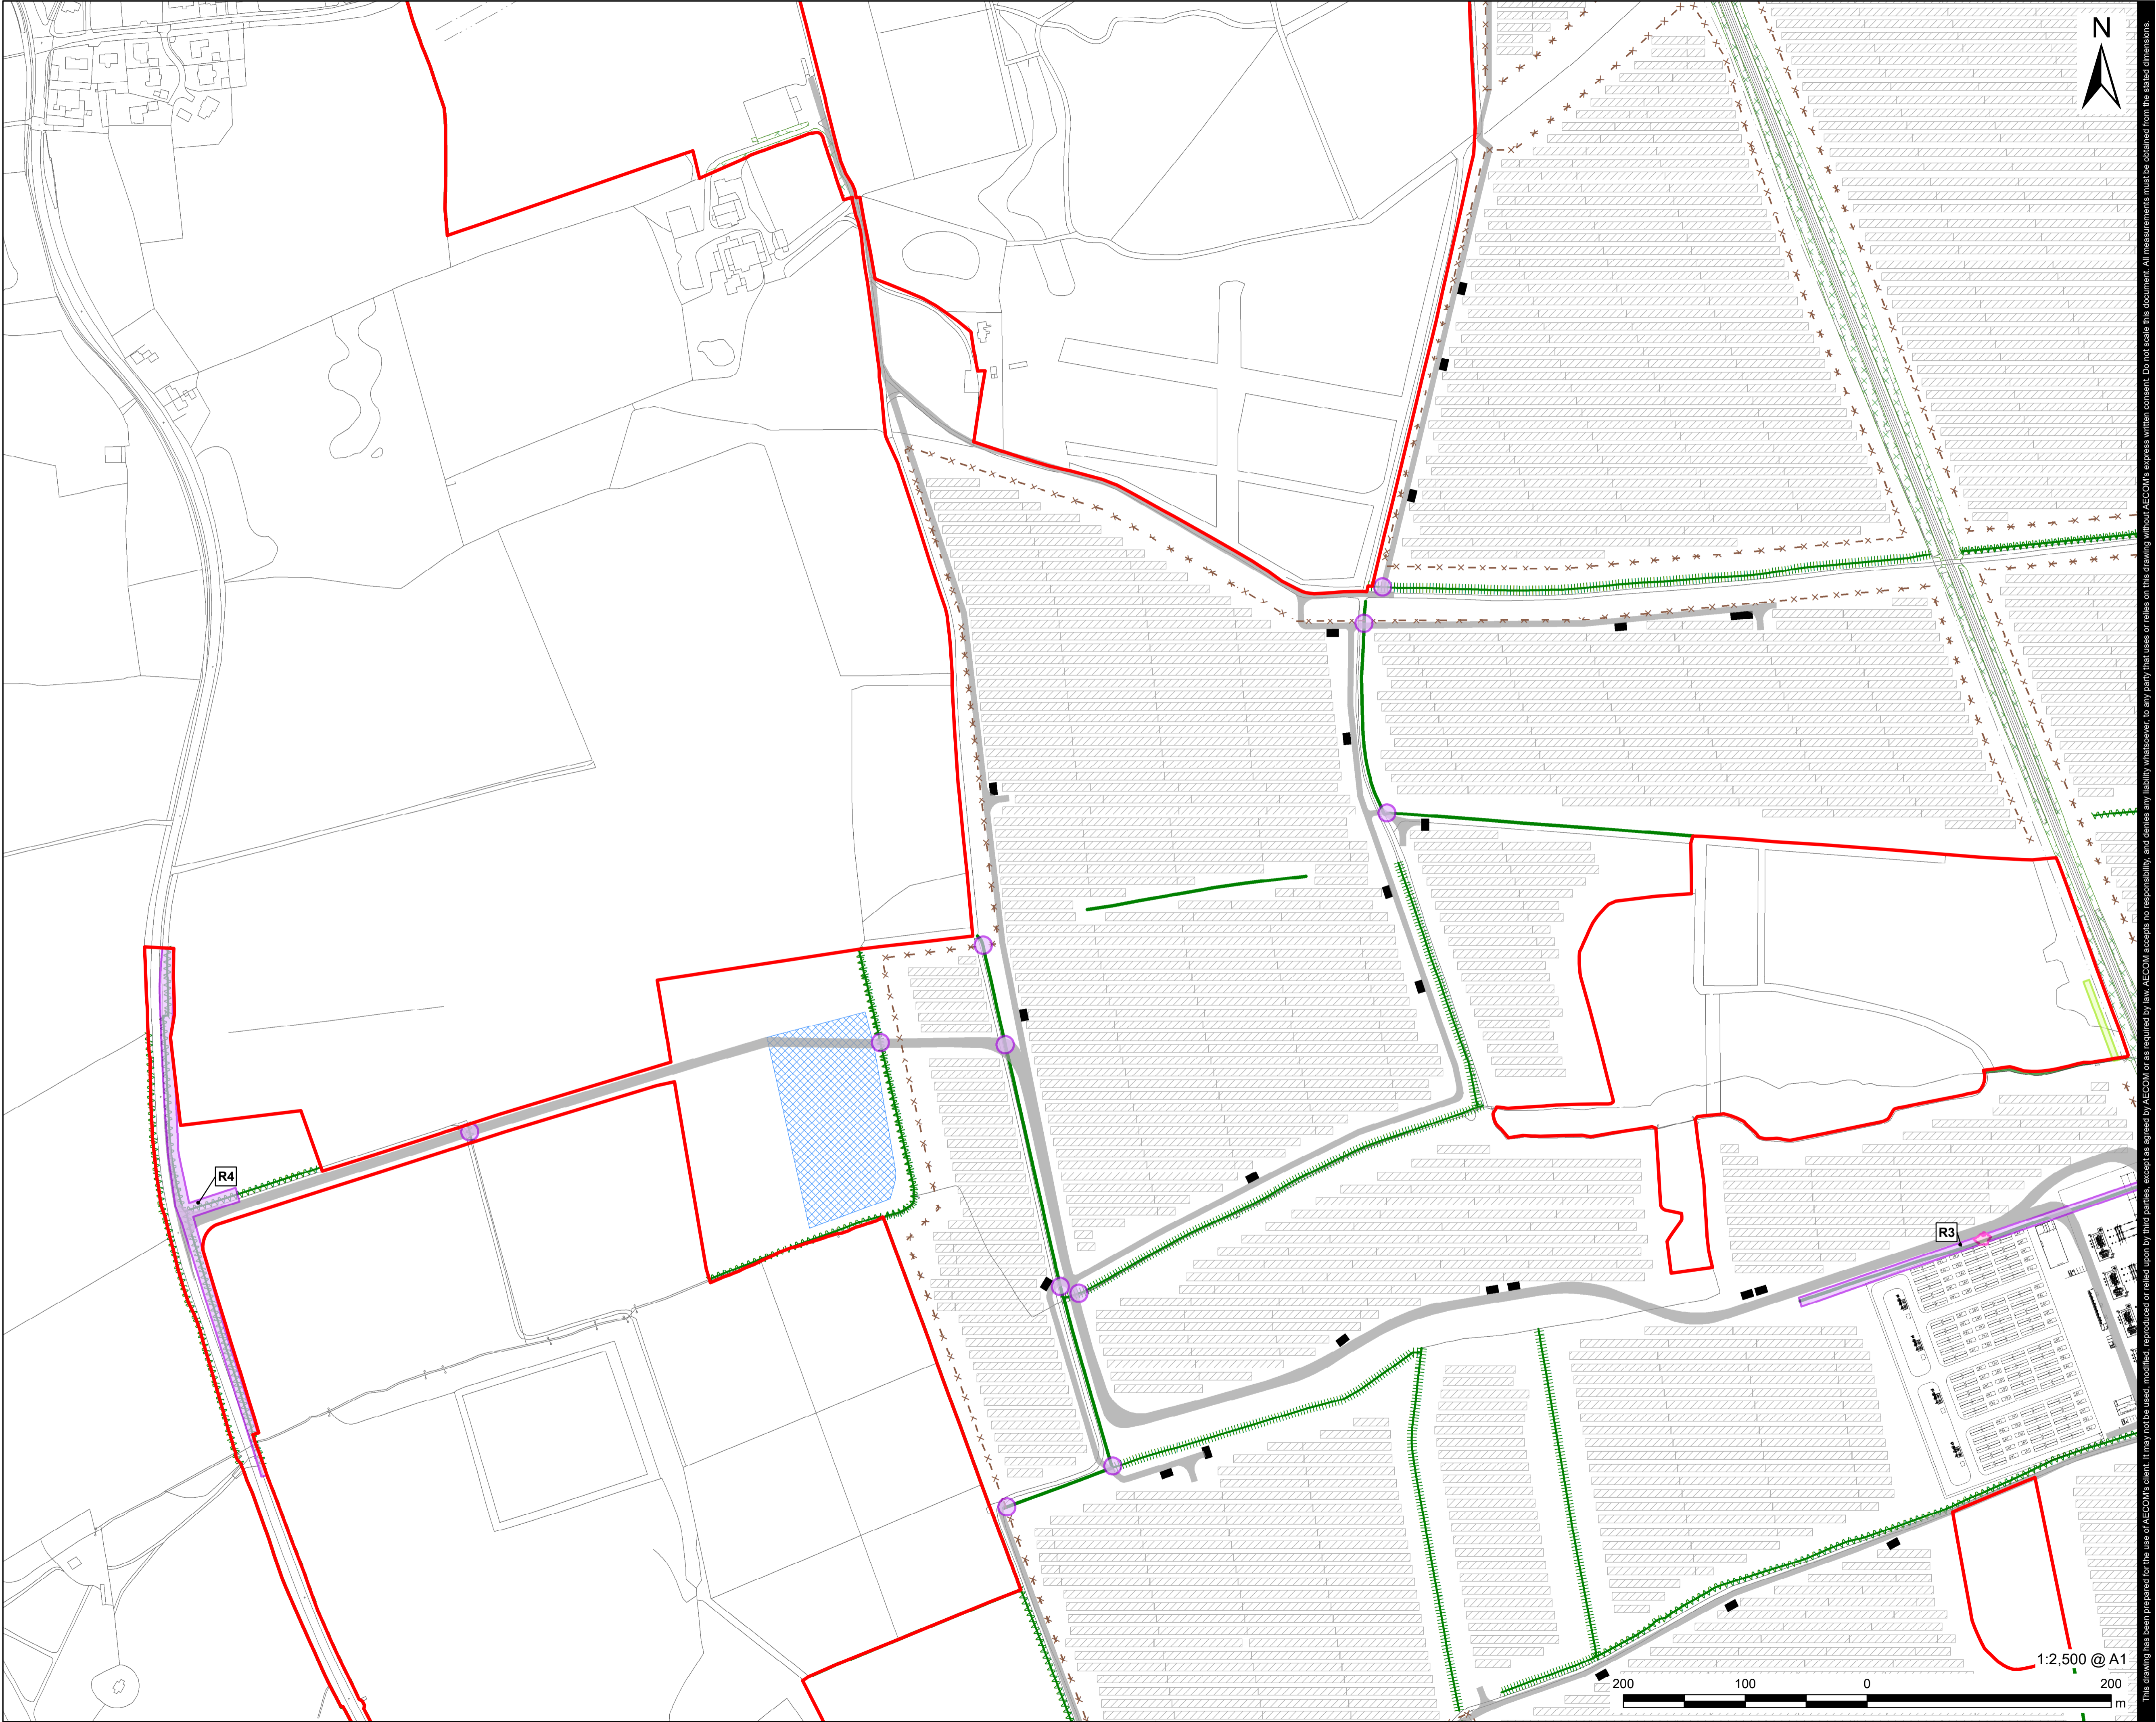


**PROJECT**  
 Gate Burton Energy Park

**CLIENT**  
  
**Gate Burton**  
 ENERGY PARK  
**CONSULTANT**

AECOM Limited  
 Sunley House  
 4 Bedford Park  
 Surrey, CR0 2AP, UK  
 www.aecom.com

- LEGEND**
- ORDER LIMITS
  - PHOTOVOLTAIC (PV) SOLAR PANEL
  - NO TEMPORARY ACCESS
  - TEMPORARY CONSTRUCTION COMPOUND
  - PROPOSED LOCATION OF BATTERY ENERGY STORAGE SYSTEM (BESS)
  - OVERHEAD POWERLINE AND PYLON
  - PERIMETER FENCE TO SOLAR PANELS
  - PROPOSED POWER CONVERSION UNIT (PCU)
  - PROPOSED ACCESS TRACK
  - J2.1.1 - INTACT HEDGE - NATIVE SPECIES-RICH
  - J2.1.2 - INTACT HEDGE - SPECIES-POOR
  - J2.2 - DEFUNCT HEDGE - SPECIES-POOR
  - J2.3.1 - HEDGE WITH TREES - NATIVE SPECIES-
  - J2.3.2 - HEDGE WITH TREES - SPECIES-
  - A1.1.1 - BROADLEAVED WOODLAND - SEMI-NATURAL
  - A2.2 - SCRUB - SCATTERED
  - POTENTIAL AREAS OF VEGETATION REMOVAL**
  - HEDGEROW REMOVAL
  - PERIMETER FENCE REMOVAL
  - WOODLAND REMOVAL
- Hedgerows removed will be reinstated in accordance with the Outline Landscape and Ecology Management Plan (EN-010131/AP/17.10)

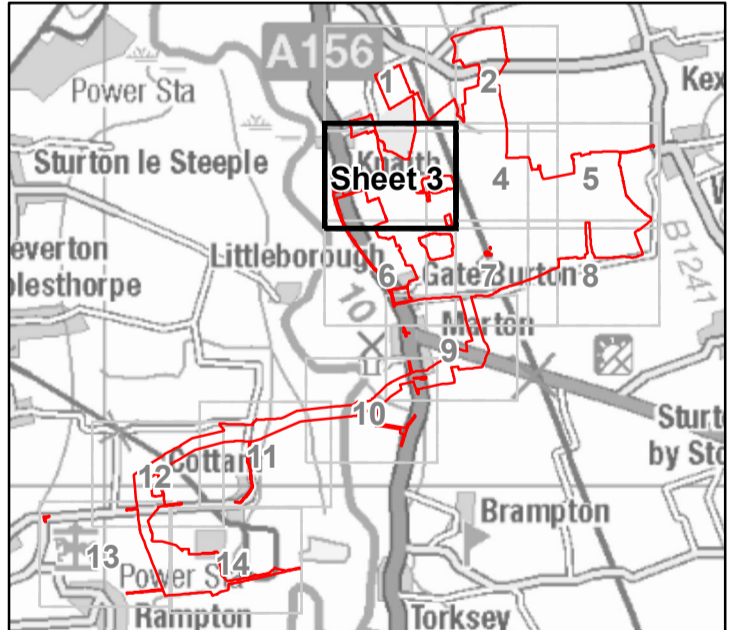

- NOTES**
1. Do not scale from this drawing.
  2. For proposed site access arrangements and photovoltaic (PV) layout refer to engineers drawings.
  3. Drawing to be read and printed in colour.

© Crown copyright and database rights 2022.  
 Ordnance Survey 0100031673.

**ISSUE PURPOSE**  
 FINAL


**PROJECT NUMBER**  
 60664324

**FIGURE TITLE**  
 Vegetation Removal Plan  
 Version 4 (Change Request Version)  
 Sheet 3 of 14

**FIGURE NUMBER**  
 Figure 10-21

This drawing has been prepared for the use of AECOM's client. It may not be used, modified, reproduced or relied upon by third parties, except as agreed by AECOM. AECOM accepts no responsibility, and denies any liability whatsoever, to any party that uses or relies on this drawing without AECOM's express written consent. Do not scale this document. All measurements must be obtained from the stated dimensions.

Revision: 04 Drawn: VC Checked: JS Approved: WB Date: 2023-10-02  
Filename: \\na.aecomnet.com\its\EMEA\Croydon-UK\CRD1\Legacy\UKCRD1\PP001\UKCRD1\Projects\Gate Burton Energy Park\02\_Maps\Further Environmental Information\Vegetation Removal Plan.mxd

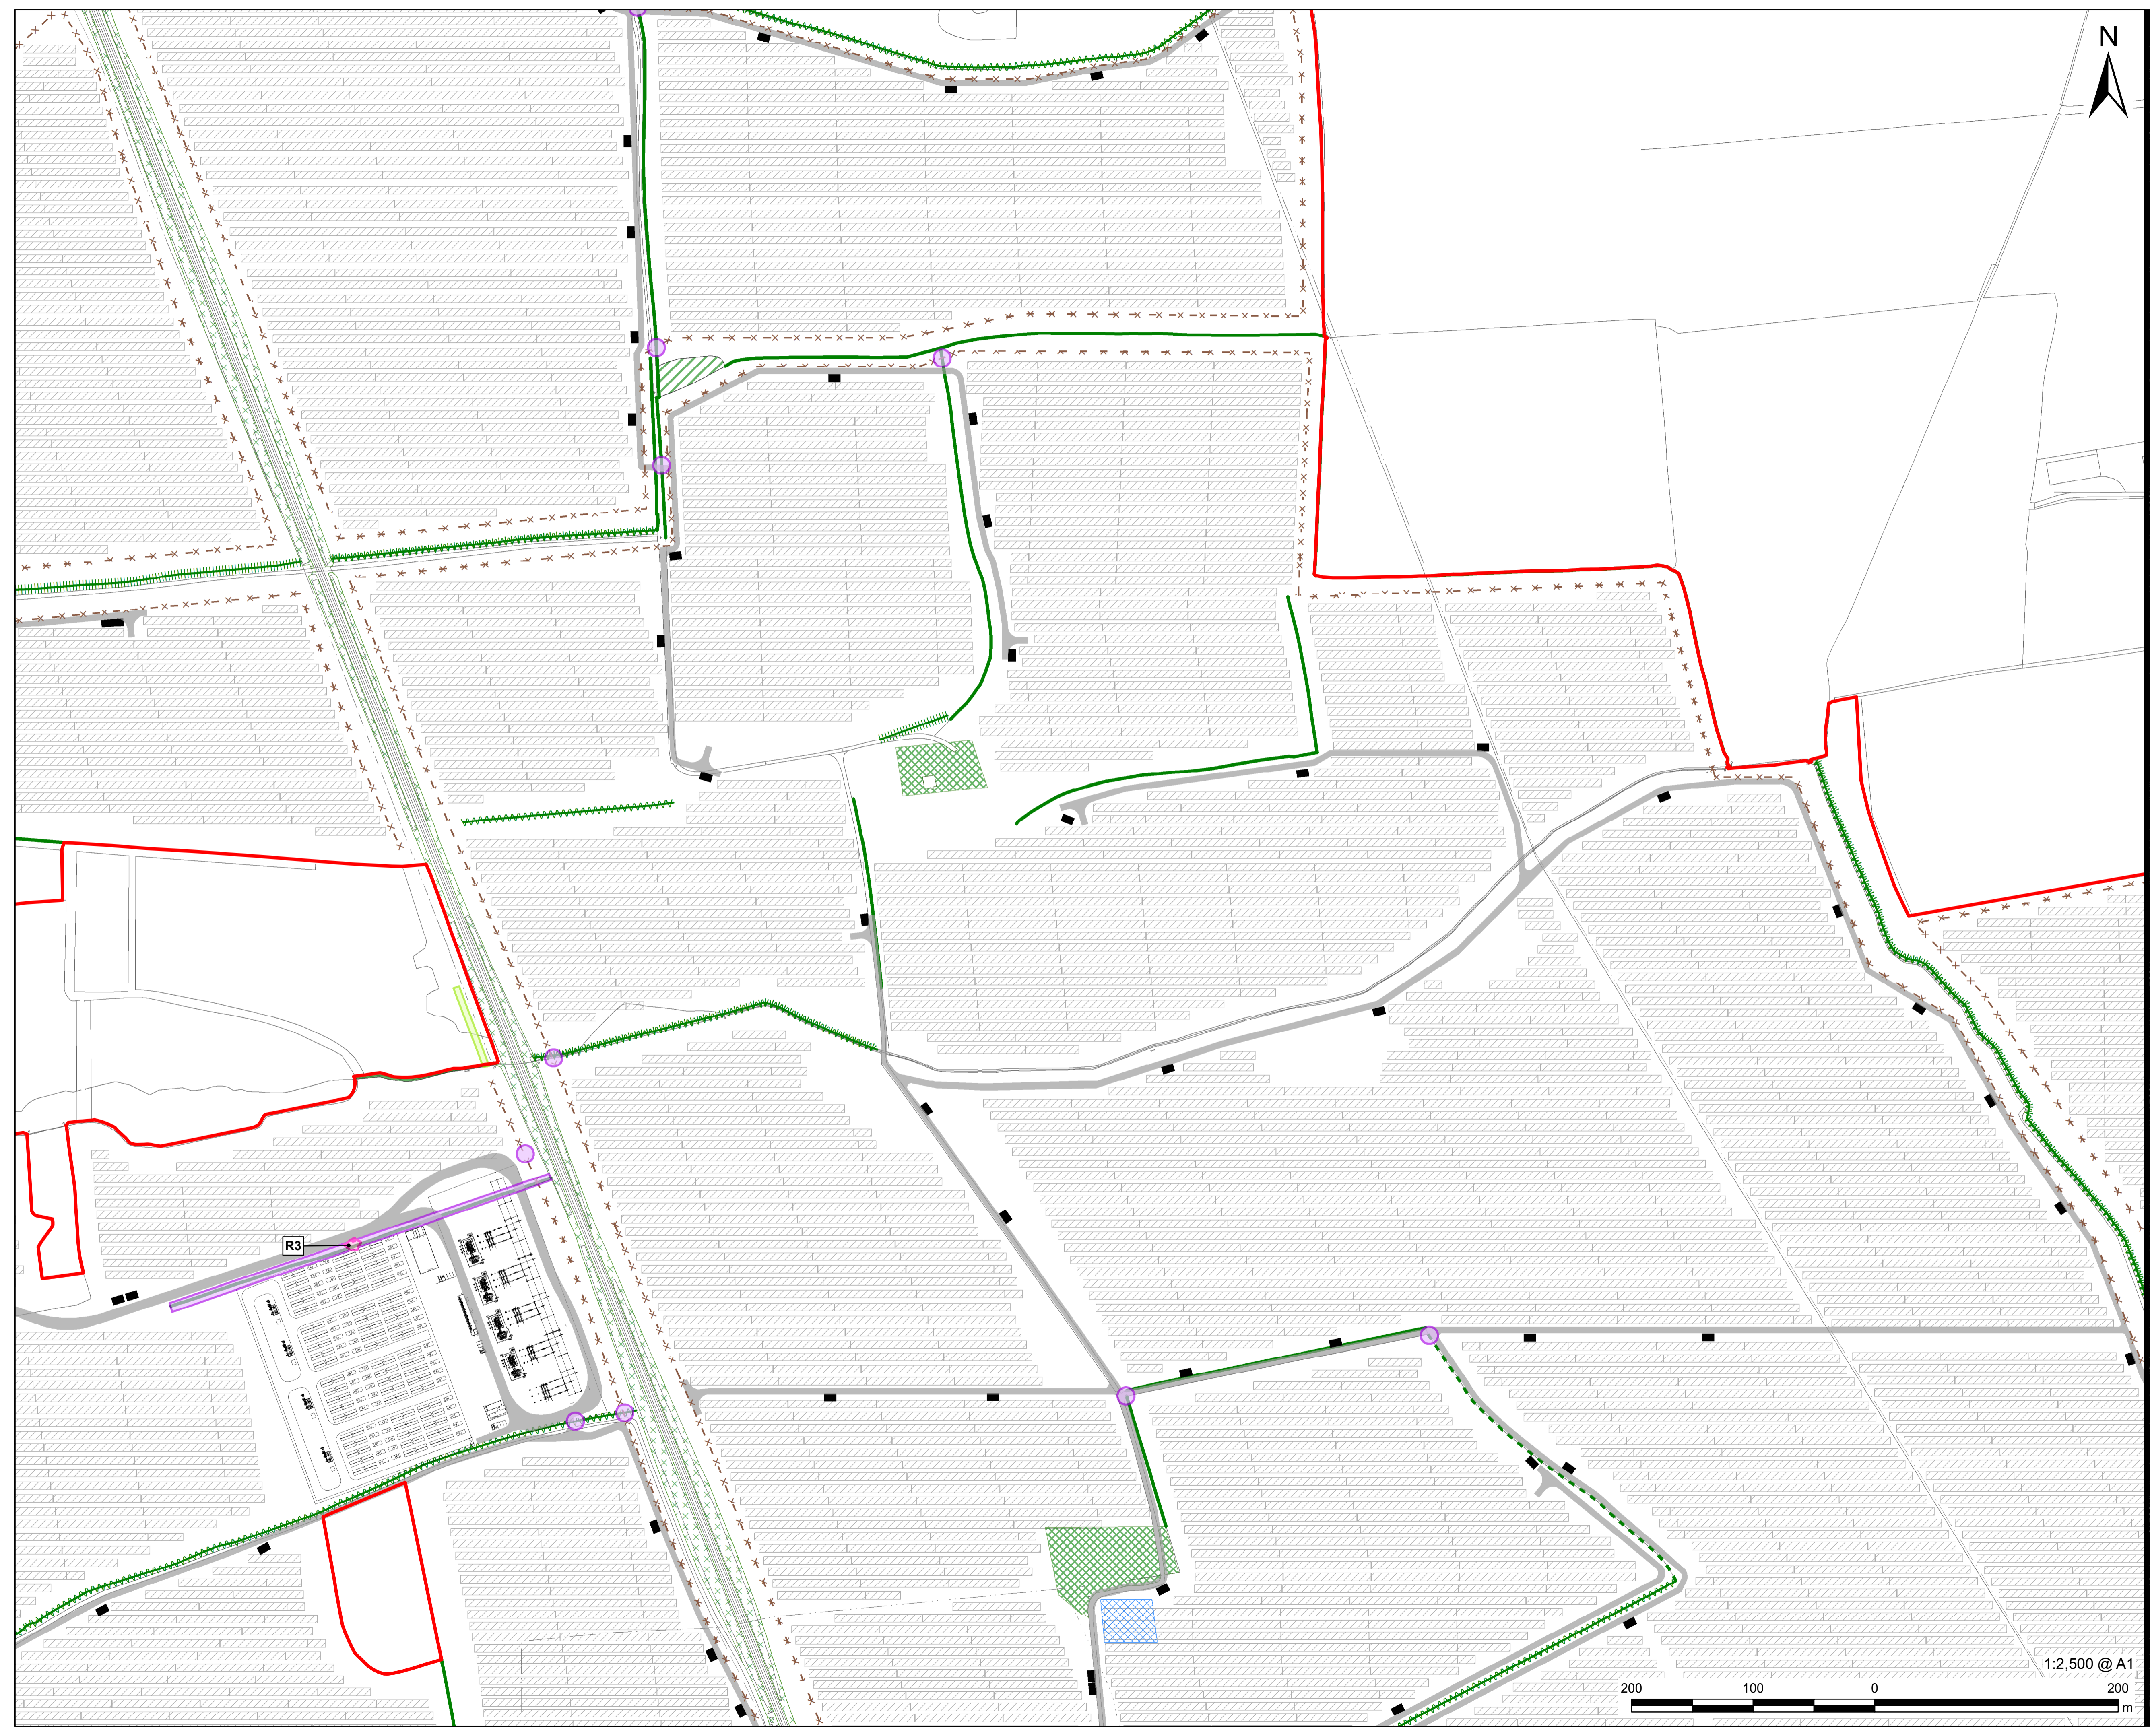

**AECOM**

PROJECT  
**Gate Burton Energy Park**

CLIENT  
**Gate Burton**  
ENERGY PARK  
CONSULTANT

AECOM Limited  
Sunley House  
4 Bedford Park  
Surrey, CR0 2AP, UK  
www.aecom.com

**LEGEND**

- ORDER LIMITS
- PHOTOVOLTAIC (PV) SOLAR PANEL
- NO TEMPORARY ACCESS
- TEMPORARY CONSTRUCTION COMPOUND
- PROPOSED LOCATION OF BATTERY ENERGY STORAGE SYSTEM (BESS)
- OVERHEAD POWERLINE AND PYLON
- PERIMETER FENCE TO SOLAR PANELS
- PROPOSED POWER CONVERSION UNIT (PCU)
- PROPOSED ACCESS TRACK
- J2.1.1 - INTACT HEDGE - NATIVE SPECIES-RICH
- J2.1.2 - INTACT HEDGE - SPECIES-POOR
- J2.2 - DEFUNCT HEDGE - SPECIES-POOR
- J2.3.1 - HEDGE WITH TREES - NATIVE SPECIES
- J2.3.2 - HEDGE WITH TREES - SPECIES
- A1.1.1 - BROADLEAVED WOODLAND - SEMI-NATURAL
- A1.1.2 - BROADLEAVED WOODLAND - PLANTATION
- A2.1 - SCRUB - DENSE/CONTINUOUS
- A2.2 - SCRUB - SCATTERED
- POTENTIAL AREAS OF VEGETATION REMOVAL
- HEDGEROW REMOVAL
- PERIMETER FENCE REMOVAL
- WOODLAND REMOVAL

Hedgerows removed will be reinstated in accordance with the Outline Landscape and Ecology Management Plan (EN-010131/APPT/10)

**NOTES**

- Do not scale from this drawing.
- For proposed site access arrangements and photovoltaic (PV) layout refer to engineers drawings.
- Drawing to be read and printed in colour.

© Crown copyright and database rights 2022.  
Ordnance Survey 0100031673.

**ISSUE PURPOSE**

FINAL

**PROJECT NUMBER**

60664324

**FIGURE TITLE**

Vegetation Removal Plan  
Version 4 (Change Request Version)  
Sheet 4 of 14


**FIGURE NUMBER**

Figure 10-21


1:2,500 @ A1  
200 100 0 200 m



Revision: 04 Drawn: VC Checked: JS Approved: WB Date: 2023-10-02  
 Filename: \\na.aecomnet.com\fs\EMEA\Croydon\UKCRD1\Legacy\UKCRD1\Projects\Gate Burton Energy Park\02\_Maps\Further Environmental Information\Vegetation Removal Plan.mxd

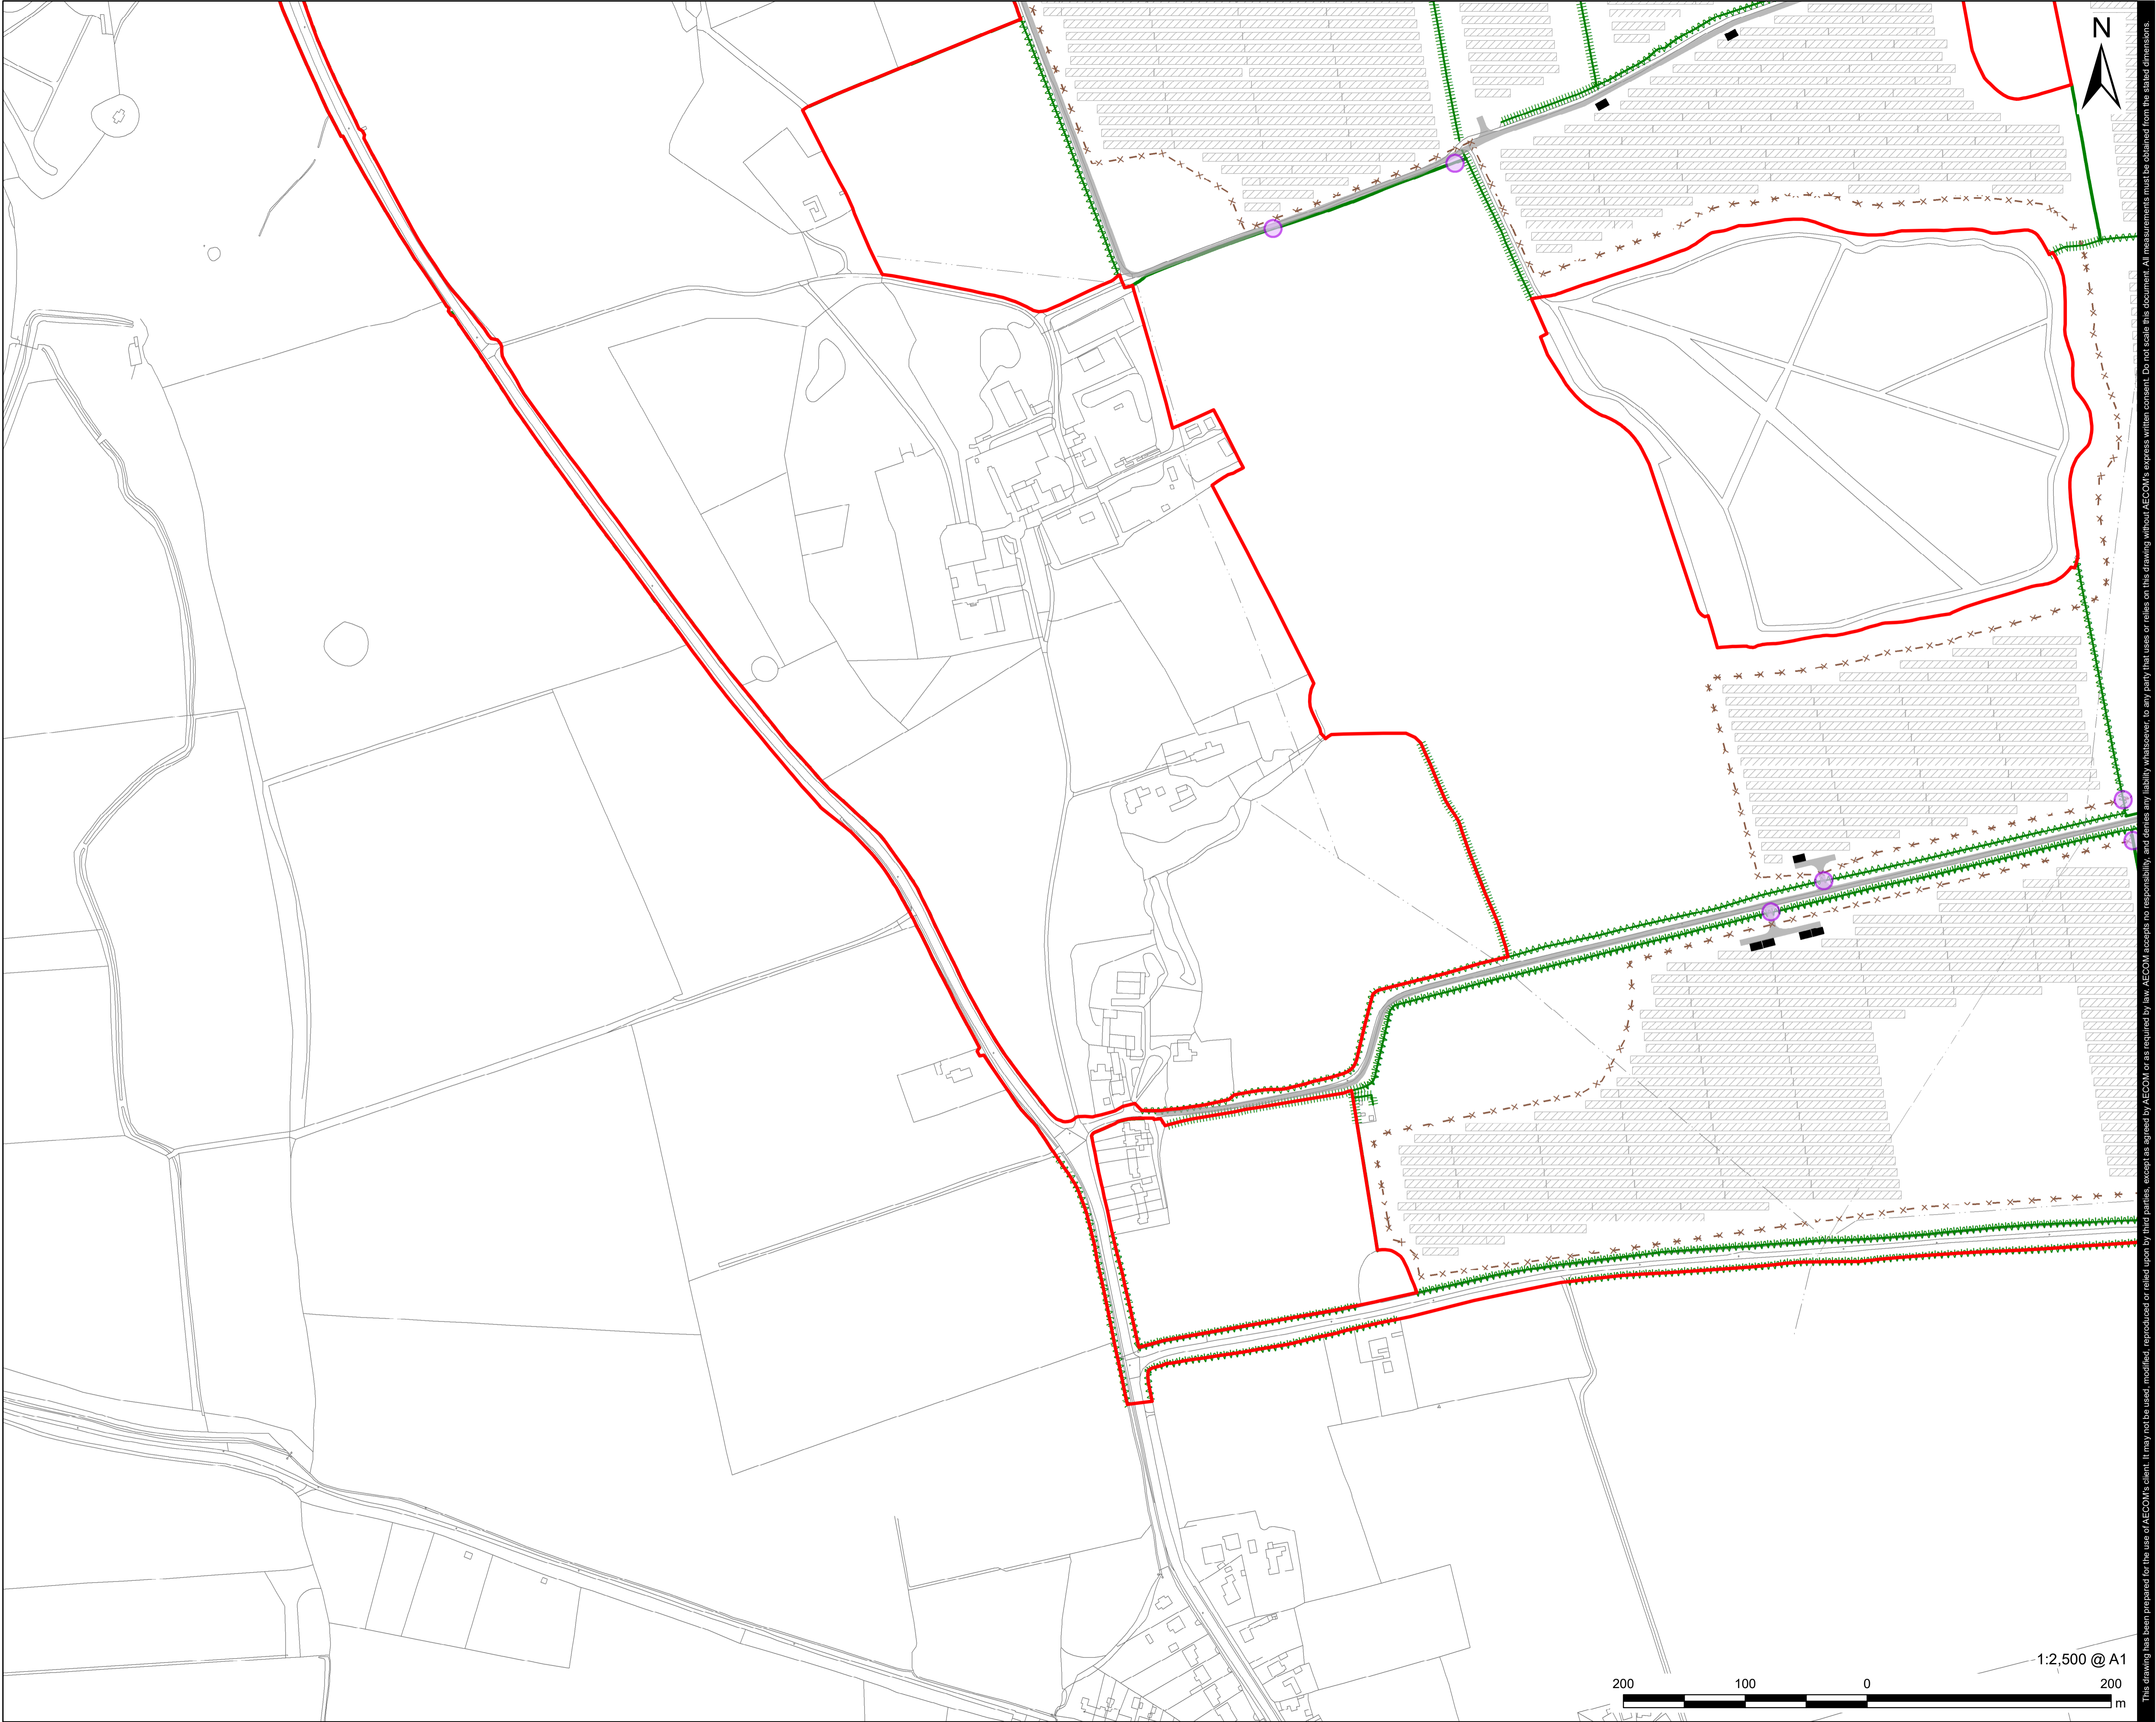




















**PROJECT**  
 Gate Burton Energy Park


**CLIENT**  
  
 Gate Burton  
 ENERGY PARK  
 CONSULTANT

AECOM Limited  
 Sunley House  
 4 Bedford Park  
 Surrey, CR0 2AP, UK  
 www.aecom.com

**LEGEND**

	ORDER LIMITS
	PHOTOVOLTAIC (PV) SOLAR PANEL
	NO TEMPORARY ACCESS
	TEMPORARY CONSTRUCTION COMPOUND
	PROPOSED LOCATION OF BATTERY ENERGY STORAGE SYSTEM (BESS)
	OVERHEAD POWERLINE AND PYLON
	PERIMETER FENCE TO SOLAR
	PROPOSED POWER CONVERSION UNIT (PCU)
	PROPOSED ACCESS TRACK
	J2.1.1 - INTACT HEDGE - NATIVE SPECIES-
	J2.1.2 - INTACT HEDGE - SPECIES-
	J2.2 - DEFUNCT HEDGE - SPECIES-
	J2.3.1 - HEDGE WITH TREES - NATIVE SPECIES-
	J2.3.2 - HEDGE WITH TREES - SPECIES-
	A1.1.1 - BROADLEAVED WOODLAND - SEMI-
	A1.3.2 - MIXED WOODLAND - PLANTATION
<b>POTENTIAL AREAS OF VEGETATION</b>	
	HEDGEROW REMOVAL
	PERIMETER FENCE REMOVAL
	WOODLAND REMOVAL

Hedgerows removed will be reinstated in accordance with the Outline Landscape and Ecology Management Plan (EN-010131/AP/17.10)

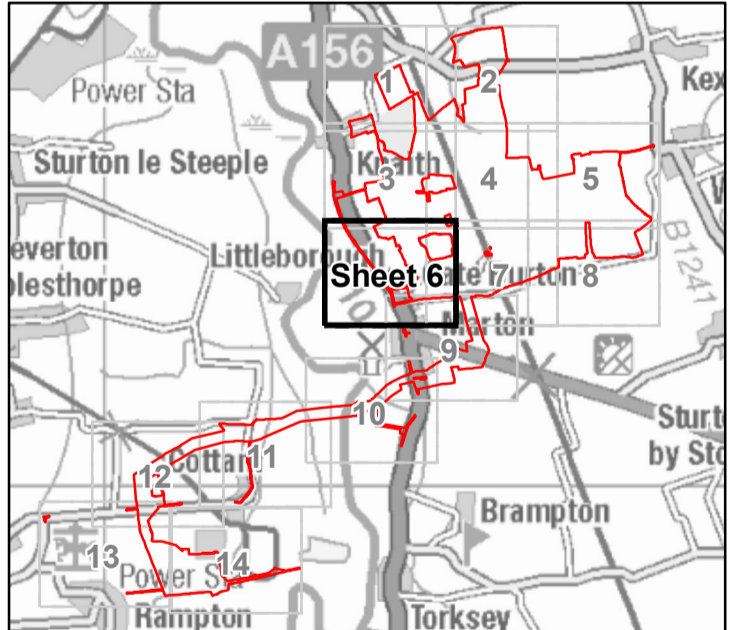

**NOTES**  
 1. Do not scale from this drawing.  
 2. For proposed site access arrangements and photovoltaic (PV) layout refer to engineers drawings.  
 3. Drawing to be read and printed in colour.

© Crown copyright and database rights 2022.  
 Ordnance Survey 0100031673.

**ISSUE PURPOSE**

FINAL

**PROJECT NUMBER**


60664324

**FIGURE TITLE**


Vegetation Removal Plan  
 Version 4 (Change Request Version)  
 Sheet 6 of 14

**FIGURE NUMBER**

Figure 10-21

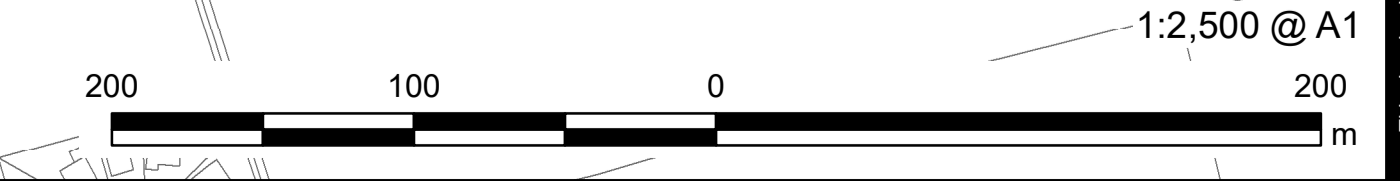


This drawing has been prepared for the use of AECOM's client. It may not be used, modified, reproduced or relied upon by third parties, except as agreed by AECOM. AECOM accepts no responsibility, and denies any liability whatsoever, to any party that uses or relies on this drawing without AECOM's express written consent. Do not seal this document. All measurements must be obtained from the stated dimensions.

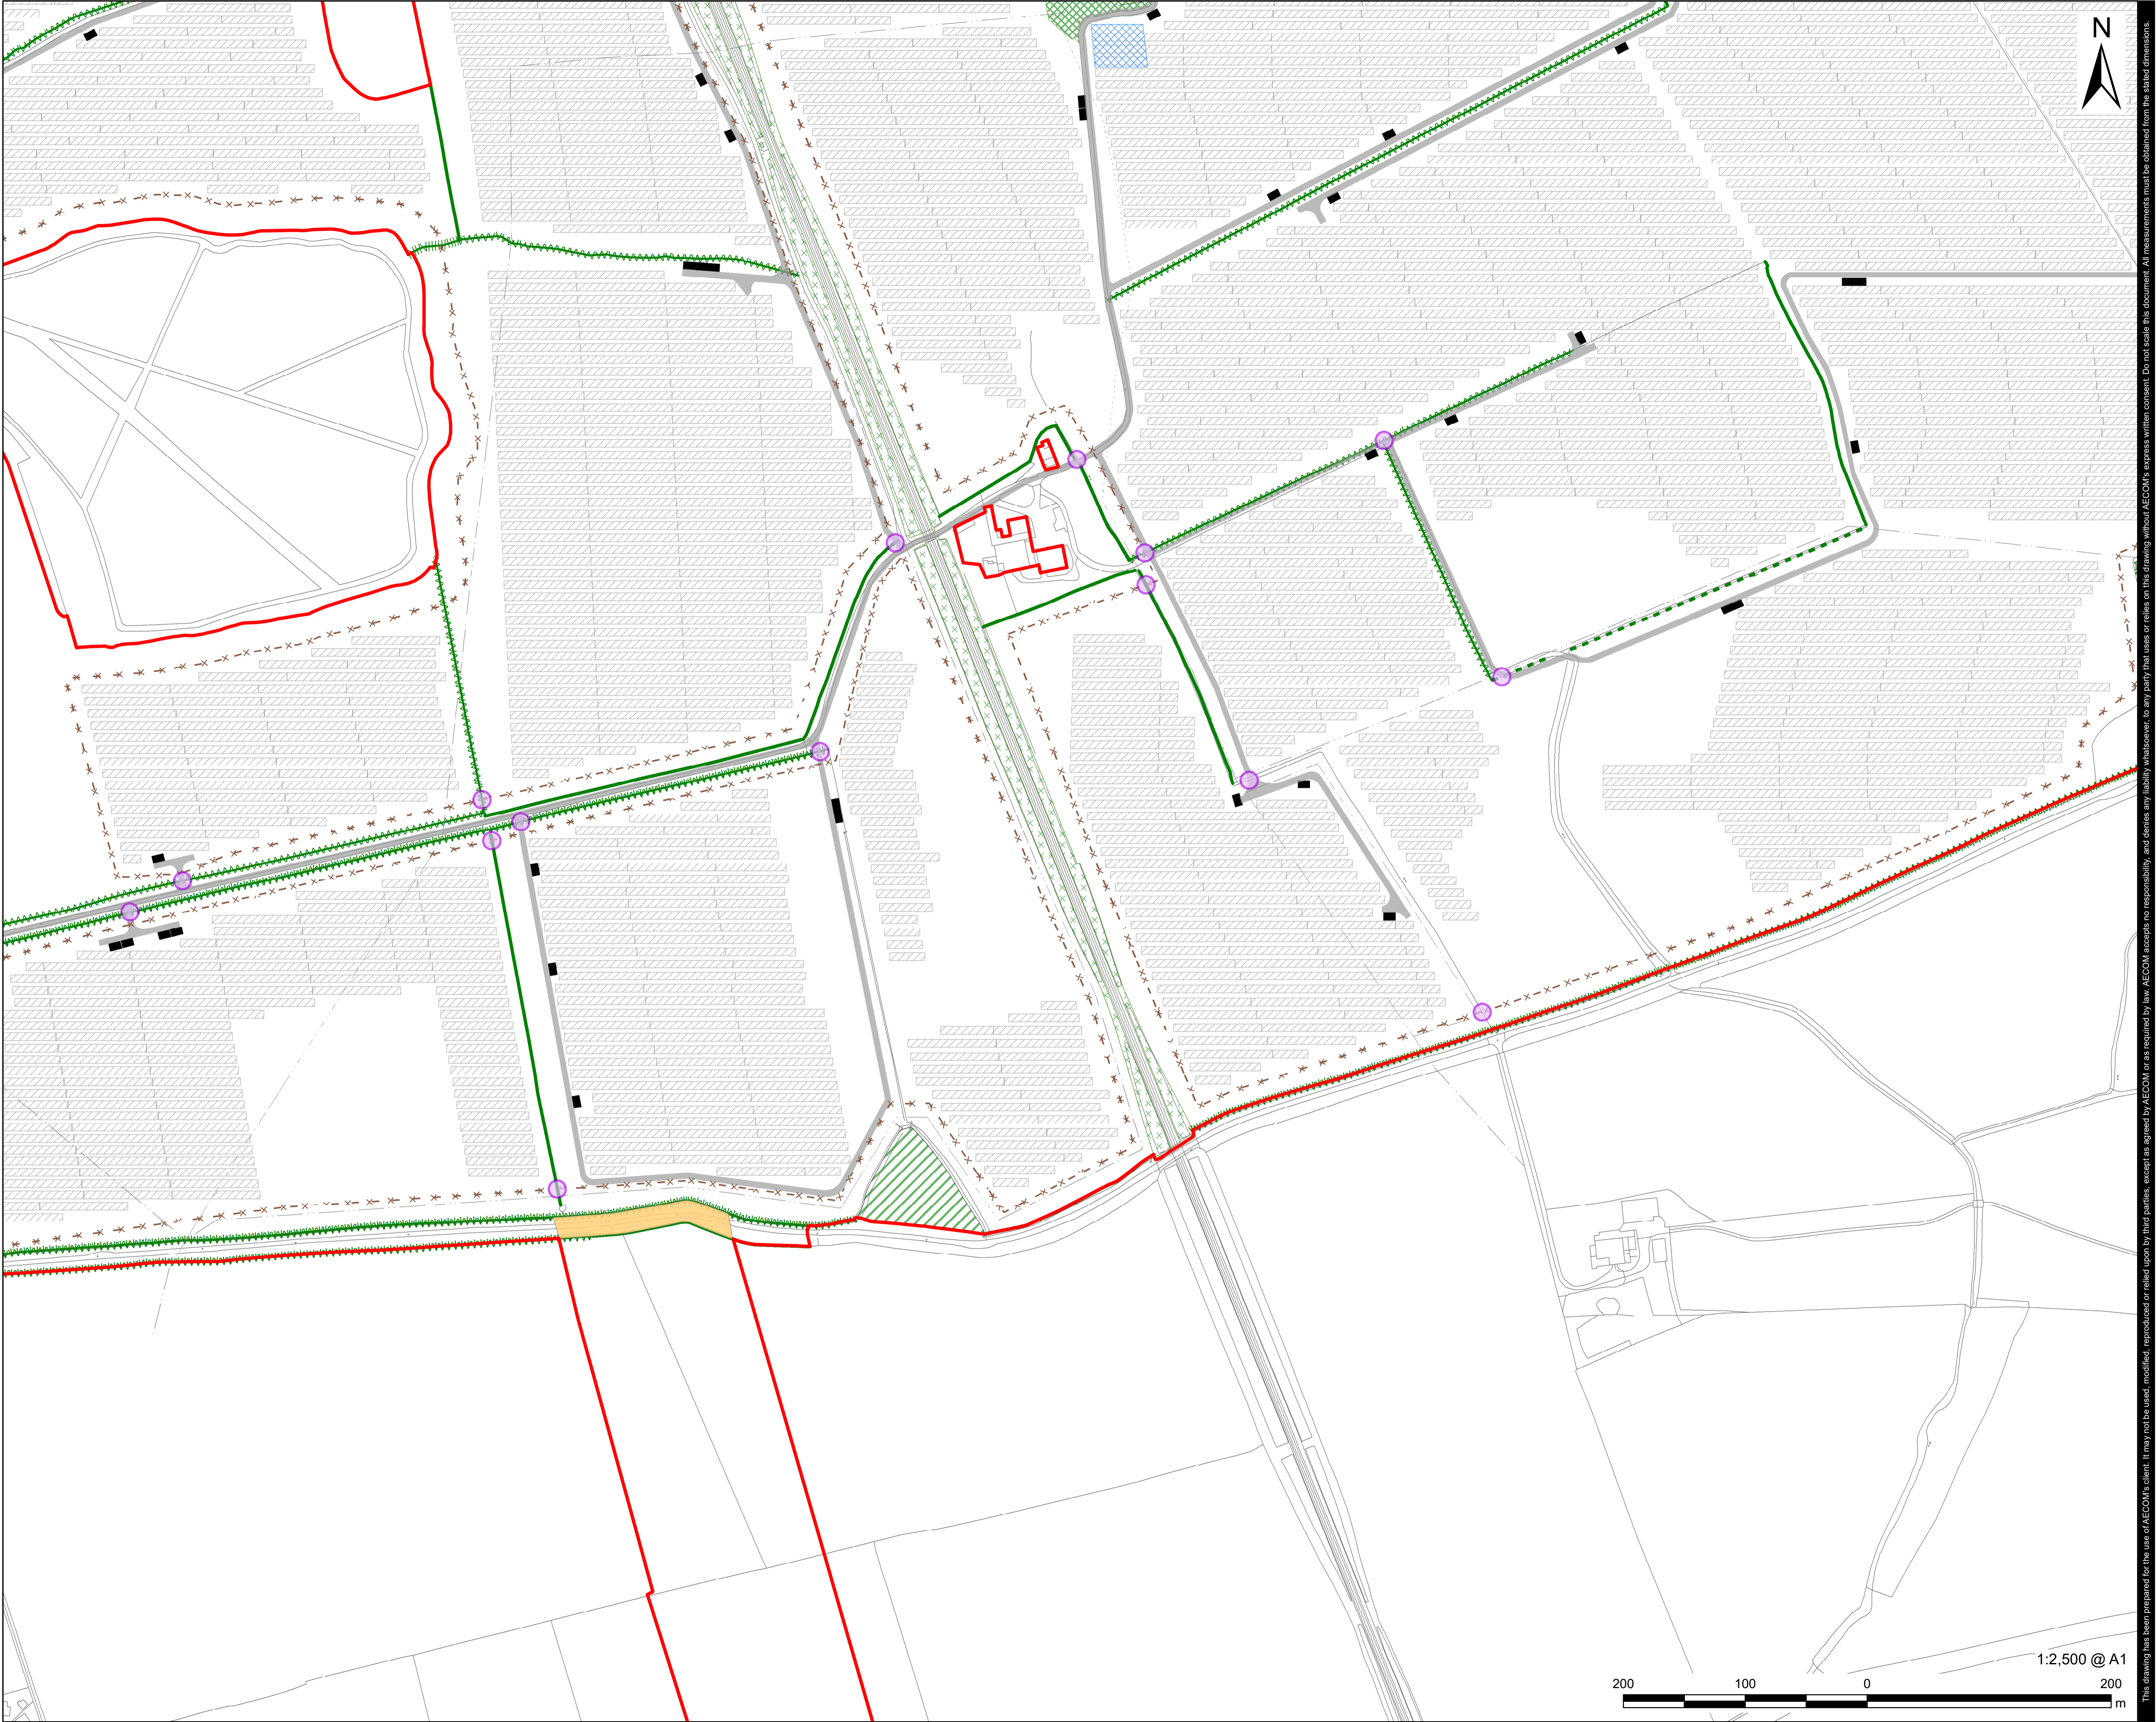

**LEGEND**

	ORDER LIMITS
	PHOTOVOLTAIC (PV) SOLAR PANEL
	NO TEMPORARY ACCESS
	TEMPORARY CONSTRUCTION COMPOUND
	PROPOSED LOCATION OF BATTERY ENERGY STORAGE SYSTEM (BESS)
	OVERHEAD POWERLINE AND PYLON
	PERIMETER FENCE TO SOLAR PANELS
	PROPOSED POWER CONVERSION UNIT (PCU)
	PROPOSED ACCESS TRACK
	J2.1.1 - INTACT HEDGE - NATIVE SPECIES-RICH
	J2.1.2 - INTACT HEDGE - SPECIES-POOR
	J2.2 - DEFUNCT HEDGE - SPECIES-POOR
	J2.3.1 - HEDGE WITH TREES - NATIVE SPECIES-
	J2.3.2 - HEDGE WITH TREES - SPECIES-
	A1.1.1 - BROADLEAVED WOODLAND - SEMI-NATURAL
	A1.1.2 - BROADLEAVED WOODLAND - PLANTATION
	A2.1 - SCRUB - DENSE/CONTINUOUS
	A2.2 - SCRUB - SCATTERED
	POTENTIAL AREAS OF VEGETATION REMOVAL
	HEDGEROW REMOVAL
	PERIMETER FENCE REMOVAL
	WOODLAND REMOVAL

Hedgerows removed will be reinstated in accordance with the Outline Landscape and Ecology Management Plan (EN-010131/APPT/10)

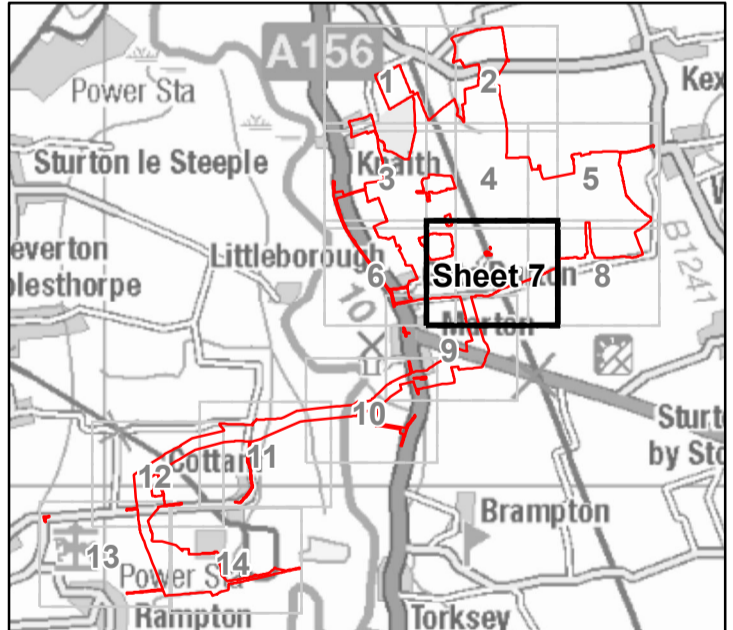

**NOTES**

1. Do not scale from this drawing.
2. For proposed site access arrangements and photovoltaic (PV) layout refer to engineers drawings.
3. Drawing to be read and printed in colour.

© Crown copyright and database rights 2022. Ordnance Survey 0100031673.

**ISSUE PURPOSE**

FINAL

**PROJECT NUMBER**


60664324

**FIGURE TITLE**

Vegetation Removal Plan  
Version 4 (Change Request Version)  
Sheet 7 of 14


**FIGURE NUMBER**

Figure 10-21

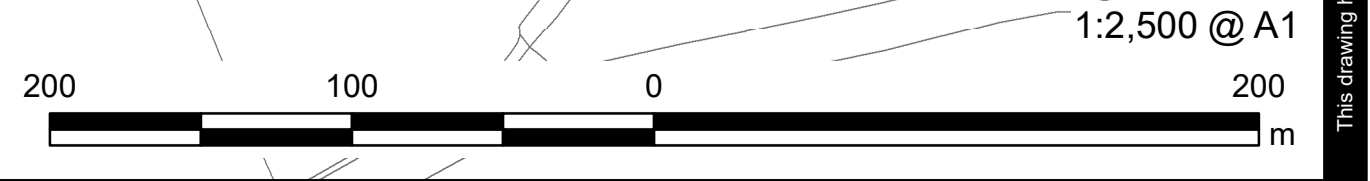

This drawing has been prepared for the use of AECOM's client. It may not be used, modified, reproduced or relied upon by third parties, except as agreed by AECOM or as required by law. AECOM accepts no responsibility, and denies any liability whatsoever, to any party that uses or relies on this drawing without AECOM's express written consent. Do not seal this document. All measurements must be obtained from the stated dimensions.

Revision: 04 Drawn: VC Checked: JS Approved: WB Date: 2023-10-02  
Filename: \\na.aecomnet.com\fs\EMEA\Croydon\UKCRD1\Legacy\UKCRD1\PP001\UKCRD1\Projects\Gate Burton Energy Park\02\_Maps\Further Environmental Information\Vegetation Removal Plan.mxd

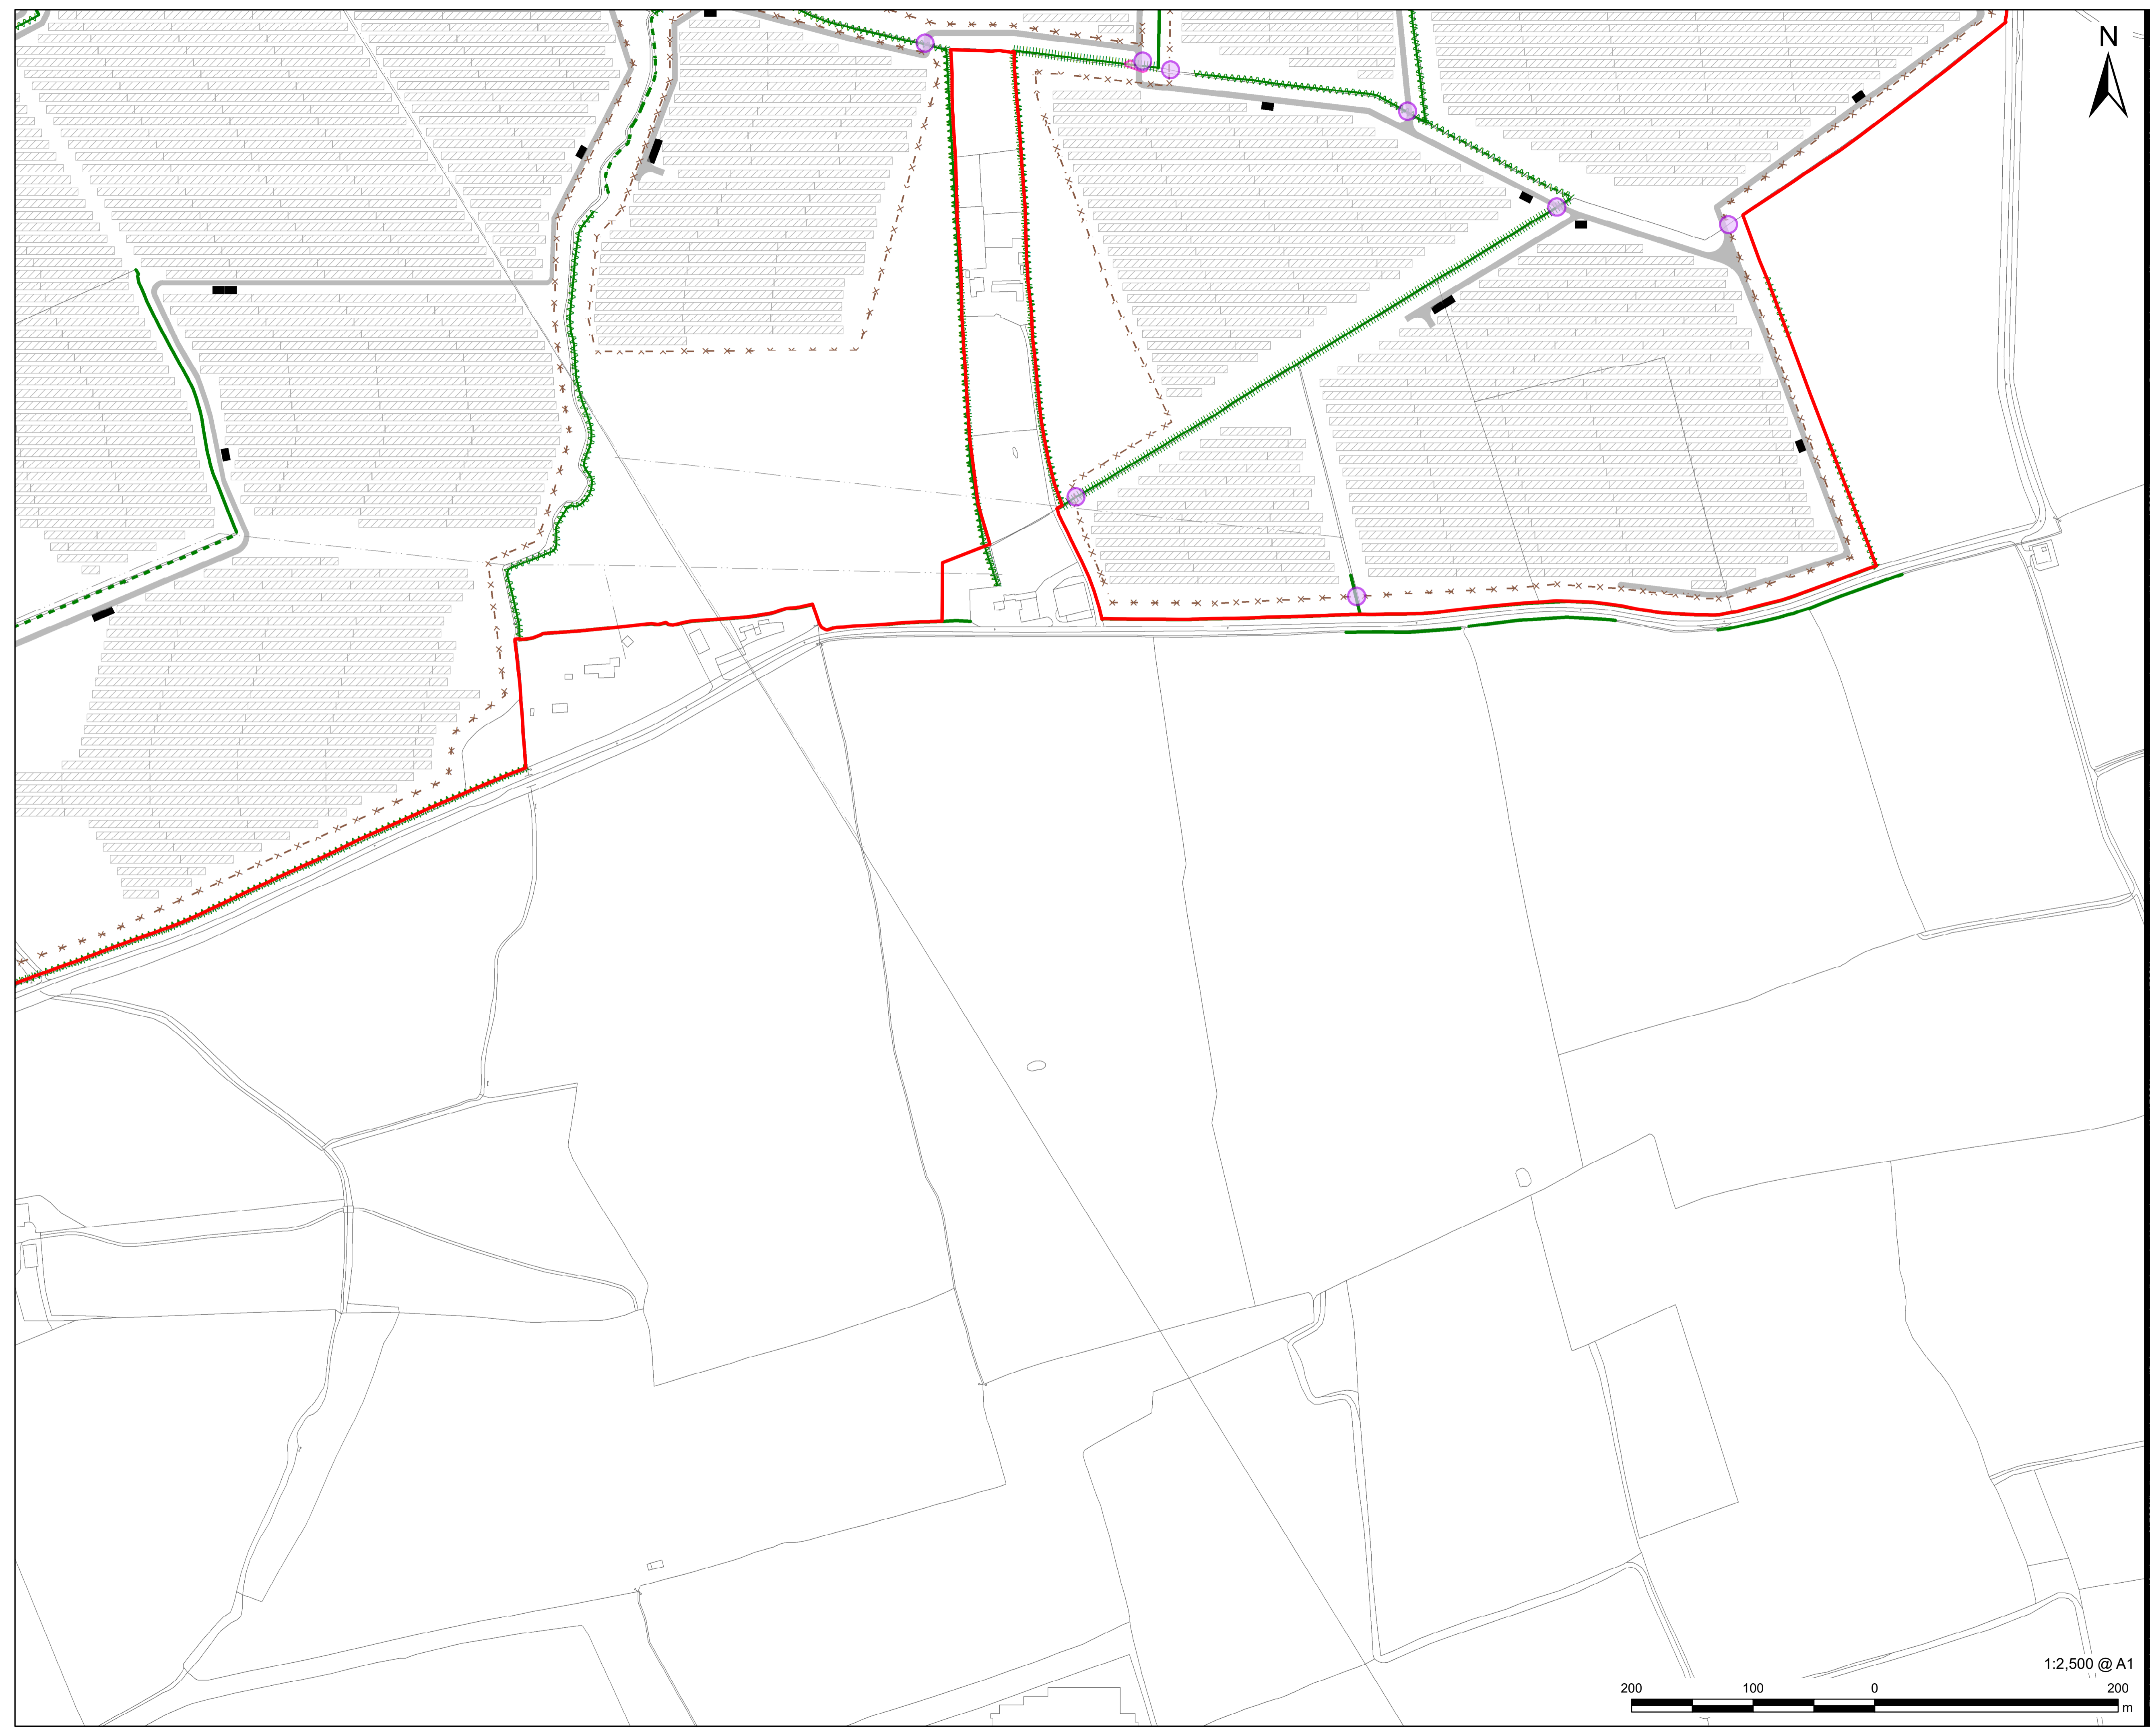


**AECOM**

PROJECT  
**Gate Burton Energy Park**

CLIENT  
**Gate Burton**  
ENERGY PARK  
CONSULTANT

AECOM Limited  
Sunley House  
4 Bedford Park  
Surrey, CR0 2AP, UK  
www.aecom.com

- LEGEND**
- ORDER LIMITS
  - PHOTOVOLTAIC (PV) SOLAR PANEL
  - NO TEMPORARY ACCESS
  - TEMPORARY CONSTRUCTION COMPOUND
  - PROPOSED LOCATION OF BATTERY ENERGY STORAGE SYSTEM (BESS)
  - OVERHEAD POWERLINE AND PYLON
  - PERIMETER FENCE TO SOLAR PANELS
  - PROPOSED POWER CONVERSION UNIT (PCU)
  - PROPOSED ACCESS TRACK
  - J2.1.1 - INTACT HEDGE - NATIVE SPECIES-RICH
  - J2.1.2 - INTACT HEDGE - SPECIES-POOR
  - J2.1.1 - DEFUNCT HEDGE - NATIVE SPECIES-RICH
  - J2.2.2 - DEFUNCT HEDGE - SPECIES-POOR
  - J2.2.2 - DEFUNCT HEDGE - SPECIES-POOR
  - J2.3.1 - HEDGE WITH TREES - NATIVE SPECIES-RICH
  - J2.3.2 - HEDGE WITH TREES - SPECIES-POOR
  - J2.3.2 - HEDGE WITH TREES - SPECIES-POOR
- POTENTIAL AREAS OF VEGETATION REMOVAL**
- HEDGEROW REMOVAL
  - PERIMETER FENCE REMOVAL
  - WOODLAND REMOVAL
- Hedgerows removed will be reinstated in accordance with the Outline Landscape and Ecology Management Plan (EN-010131/AP/17.10)

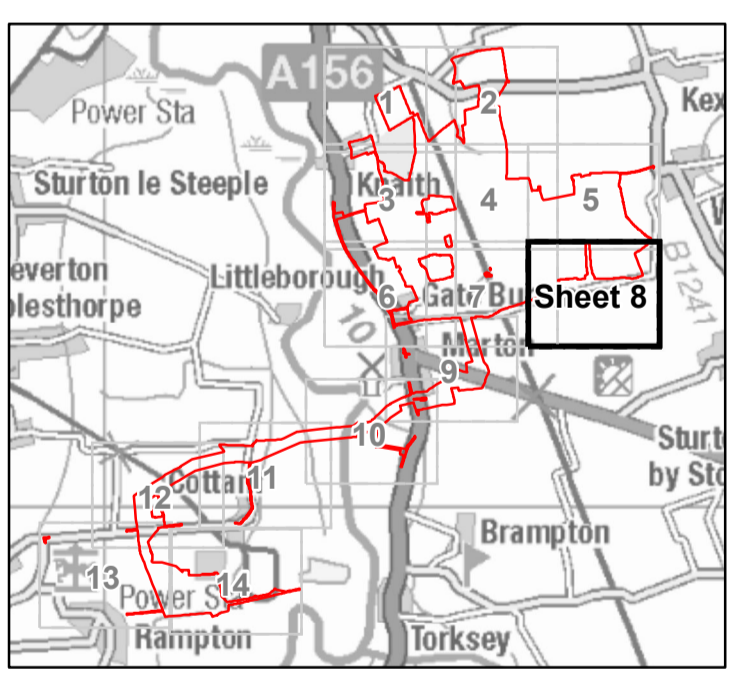

- NOTES**
1. Do not scale from this drawing.
  2. For proposed site access arrangements and photovoltaic (PV) layout refer to engineers drawings.
  3. Drawing to be read and printed in colour.

© Crown copyright and database rights 2022.  
Ordnance Survey 0100031673.

**ISSUE PURPOSE**

FINAL

**PROJECT NUMBER**


60664324

**FIGURE TITLE**

Vegetation Removal Plan  
Version 4 (Change Request Version)  
Sheet 8 of 14

**FIGURE NUMBER**


Figure 10-21

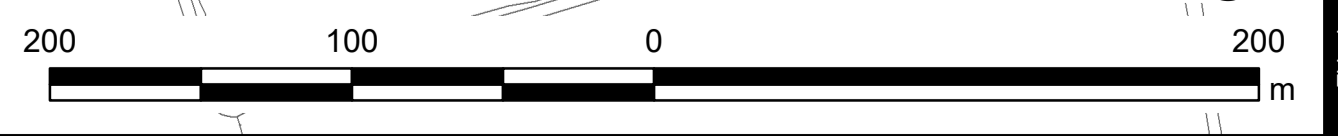

This drawing has been prepared for the use of AECOM's client. It may not be used, modified, reproduced or relied upon by third parties, except as agreed by AECOM or as required by law. AECOM accepts no responsibility, and denies any liability whatsoever, to any party that uses or relies on this drawing without AECOM's express written consent. Do not seal this document. All measurements must be obtained from the stated dimensions.



Revision: 04 Drawn: VC Checked: JS Approved: WB Date: 2023-10-02  
Filename: \\na.aecomnet.com\fs\EMEA\Croydon\UKCRD1\Legacy\UKCRD1\Projects\Gate Burton Energy Park\02\_Maps\Further Environmental Information\Vegetation Removal Plan.mxd

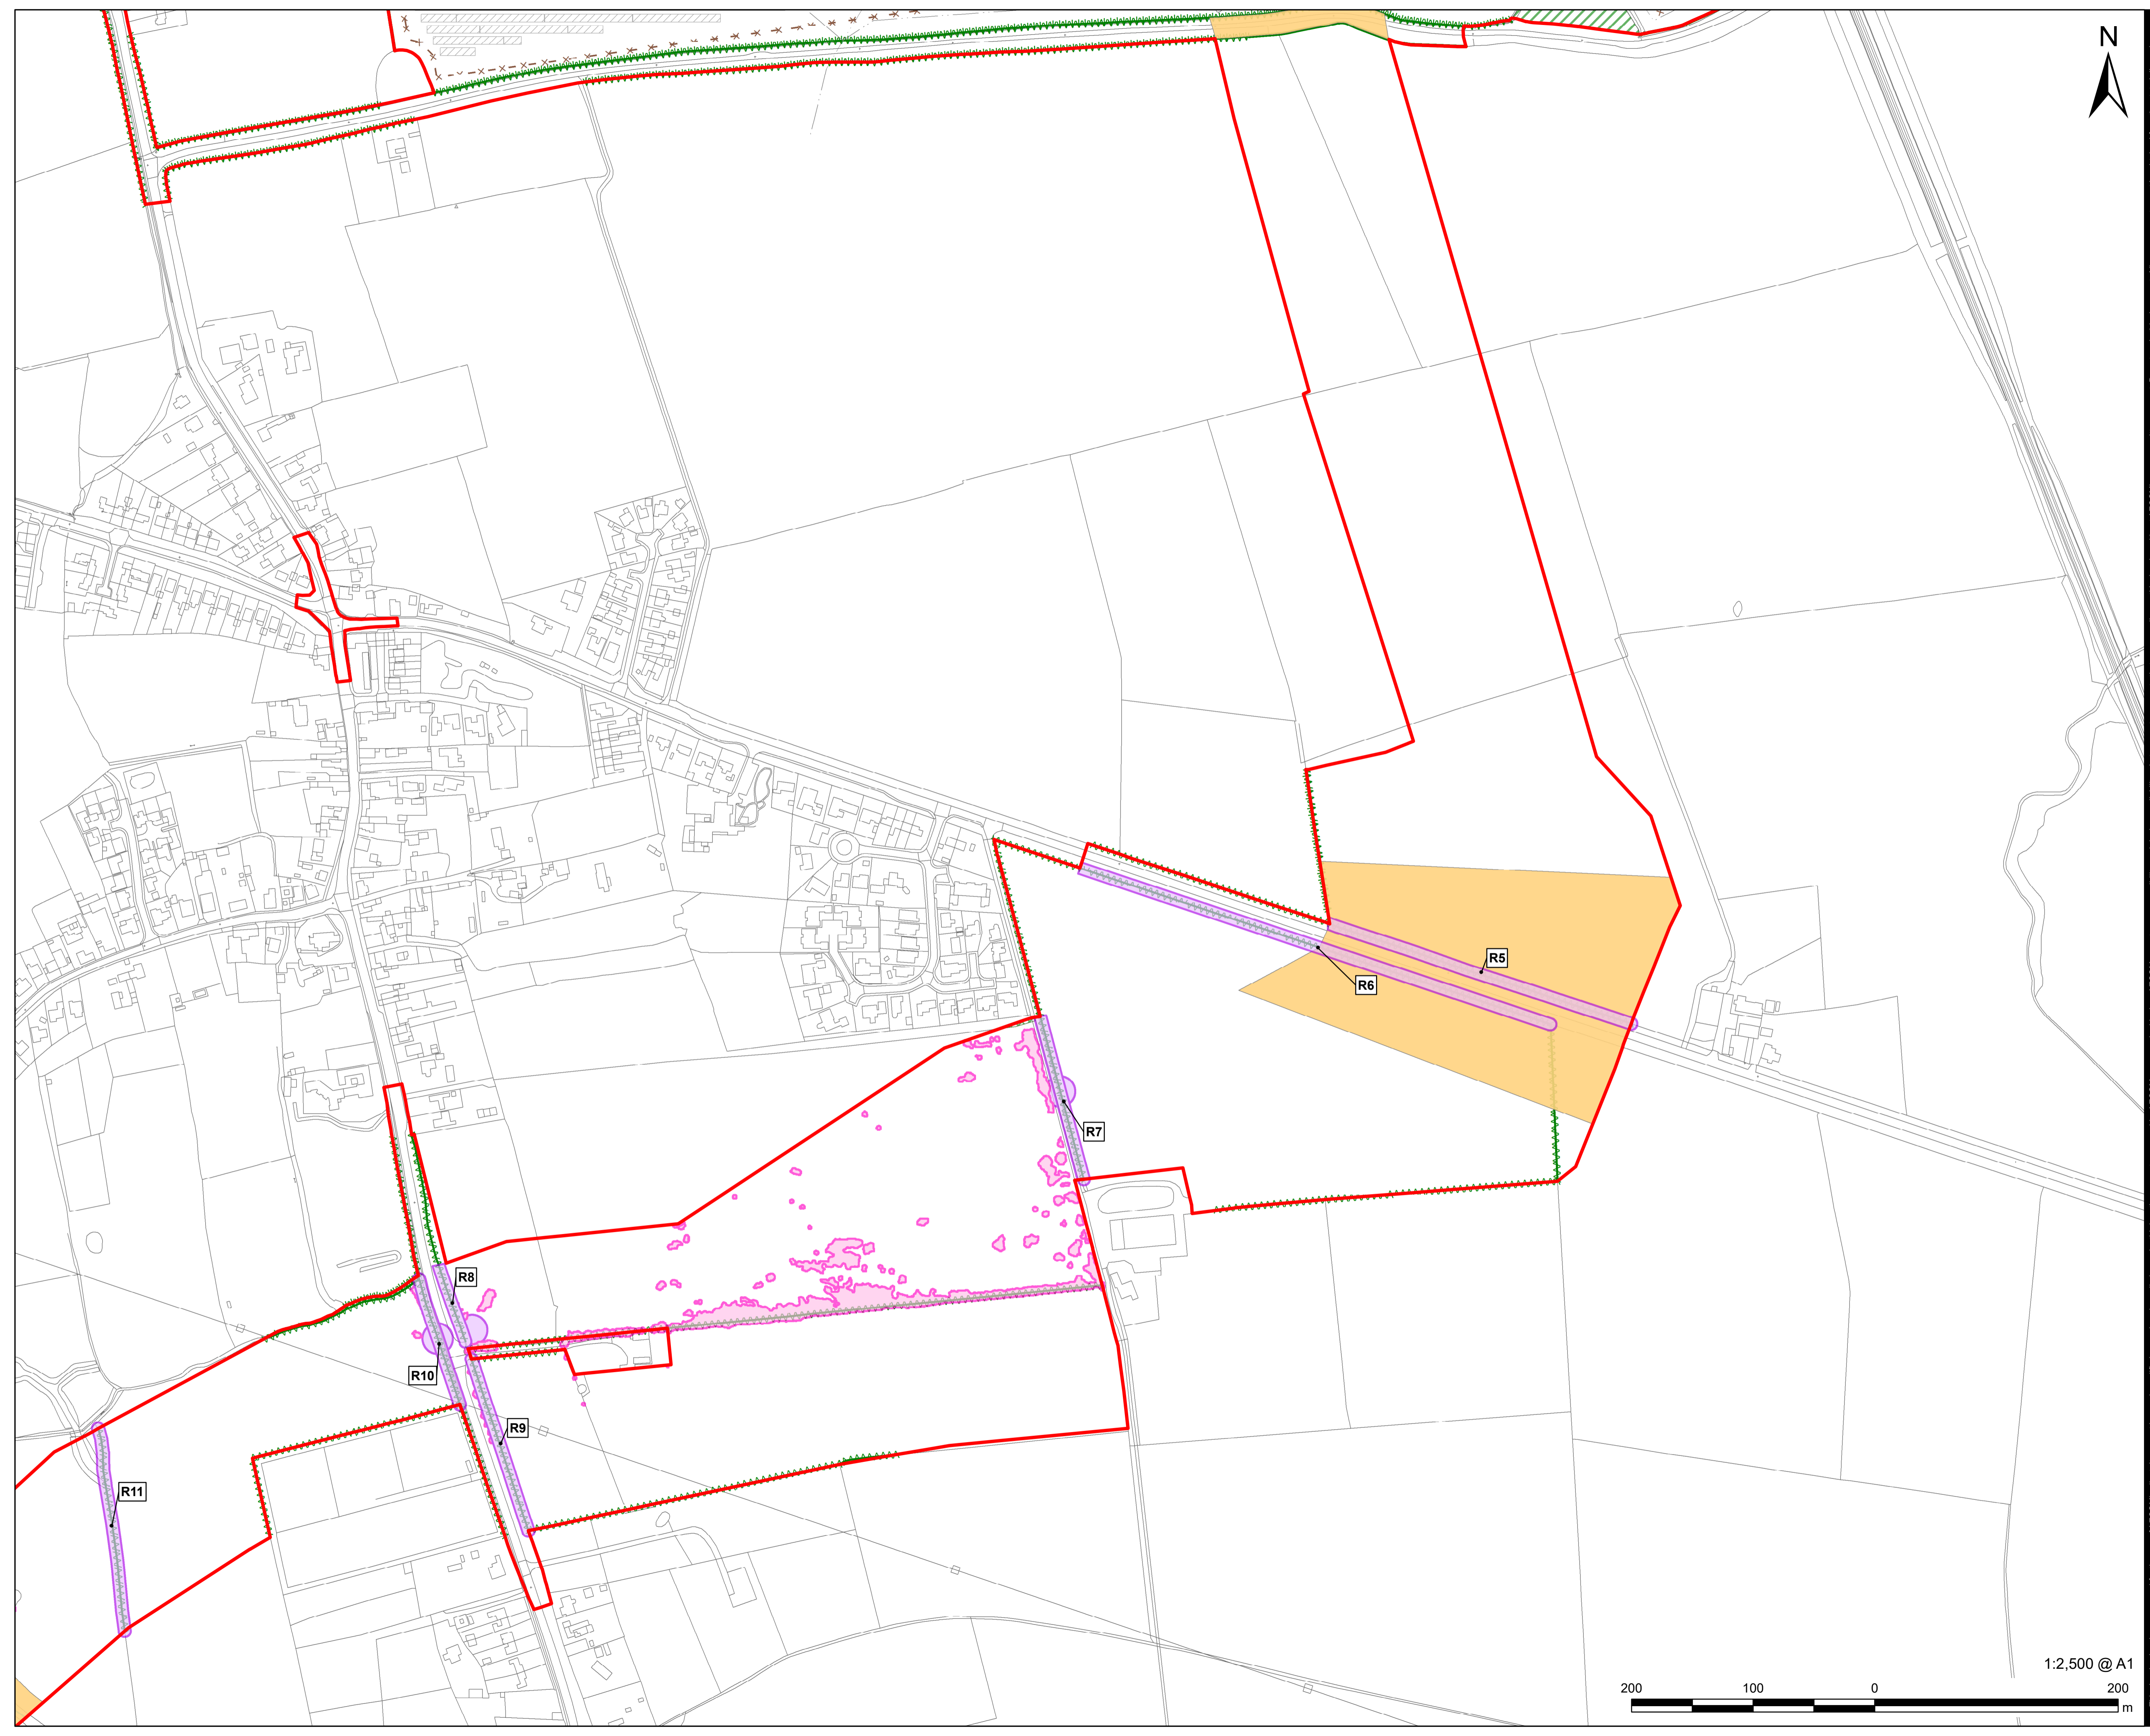

**AECOM**

PROJECT  
**Gate Burton Energy Park**

CLIENT  
**Gate Burton**  
ENERGY PARK  
CONSULTANT

AECOM Limited  
Sunley House  
4 Bedford Park  
Surrey, CR0 2AP, UK  
www.aecom.com


**LEGEND**

- ORDER LIMITS
- PHOTOVOLTAIC (PV) SOLAR PANEL
- NO TEMPORARY ACCESS
- TEMPORARY CONSTRUCTION COMPOUND
- PROPOSED LOCATION OF BATTERY ENERGY STORAGE SYSTEM (BESS)
- OVERHEAD POWERLINE AND PYLON
- PERIMETER FENCE TO SOLAR
- PROPOSED POWER CONVERSION UNIT (PCU)
- PROPOSED ACCESS TRACK
- G2 - RUNNING WATER
- J2.1.1 - INTACT HEDGE - NATIVE SPECIES
- J2.1.2 - INTACT HEDGE - SPECIES
- J2.3.1 - HEDGE WITH TREES - NATIVE SPECIES
- A1.1.2 - BROADLEAVED WOODLAND
- A1.3.2 - MIXED WOODLAND - PLANTATION
- A2.1 - SCRUB - DENSE/CONTINUOUS

**POTENTIAL AREAS OF VEGETATION**

- HEDGEROW REMOVAL
- PERIMETER FENCE REMOVAL
- WOODLAND REMOVAL

Hedgerows removed will be reinstated in accordance with the Outline Landscape and Ecology Management Plan (EN-010131APP17.10)

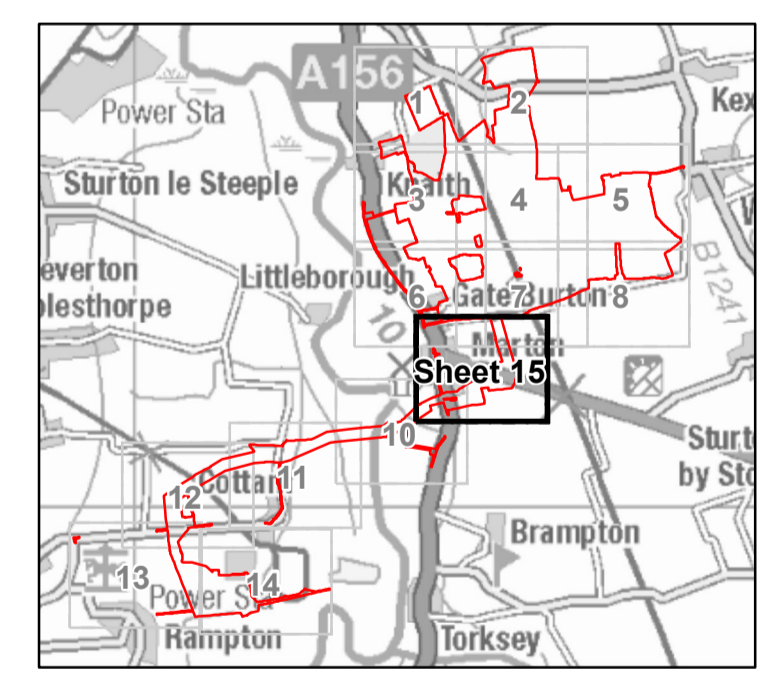

**NOTES**

- Do not scale from this drawing.
- For proposed site access arrangements and photovoltaic (PV) layout refer to engineers drawings.
- Drawing to be read and printed in colour.

© Crown copyright and database rights 2022.  
Ordnance Survey 0100031673.

**ISSUE PURPOSE**

FINAL


**PROJECT NUMBER**  
60664324

**FIGURE TITLE**  
Vegetation Removal Plan  
Version 4 (Change Request Version)  
Sheet 9 of 14


**FIGURE NUMBER**  
Figure 10-21



This drawing has been prepared for the use of AECOM's client. It may not be used, modified, reproduced or relied upon by third parties, except as agreed by AECOM or as required by law. AECOM accepts no responsibility, and denies any liability whatsoever, to any party that uses or relies on this drawing without AECOM's express written consent. Do not seal this document. All measurements must be obtained from the stated dimensions.

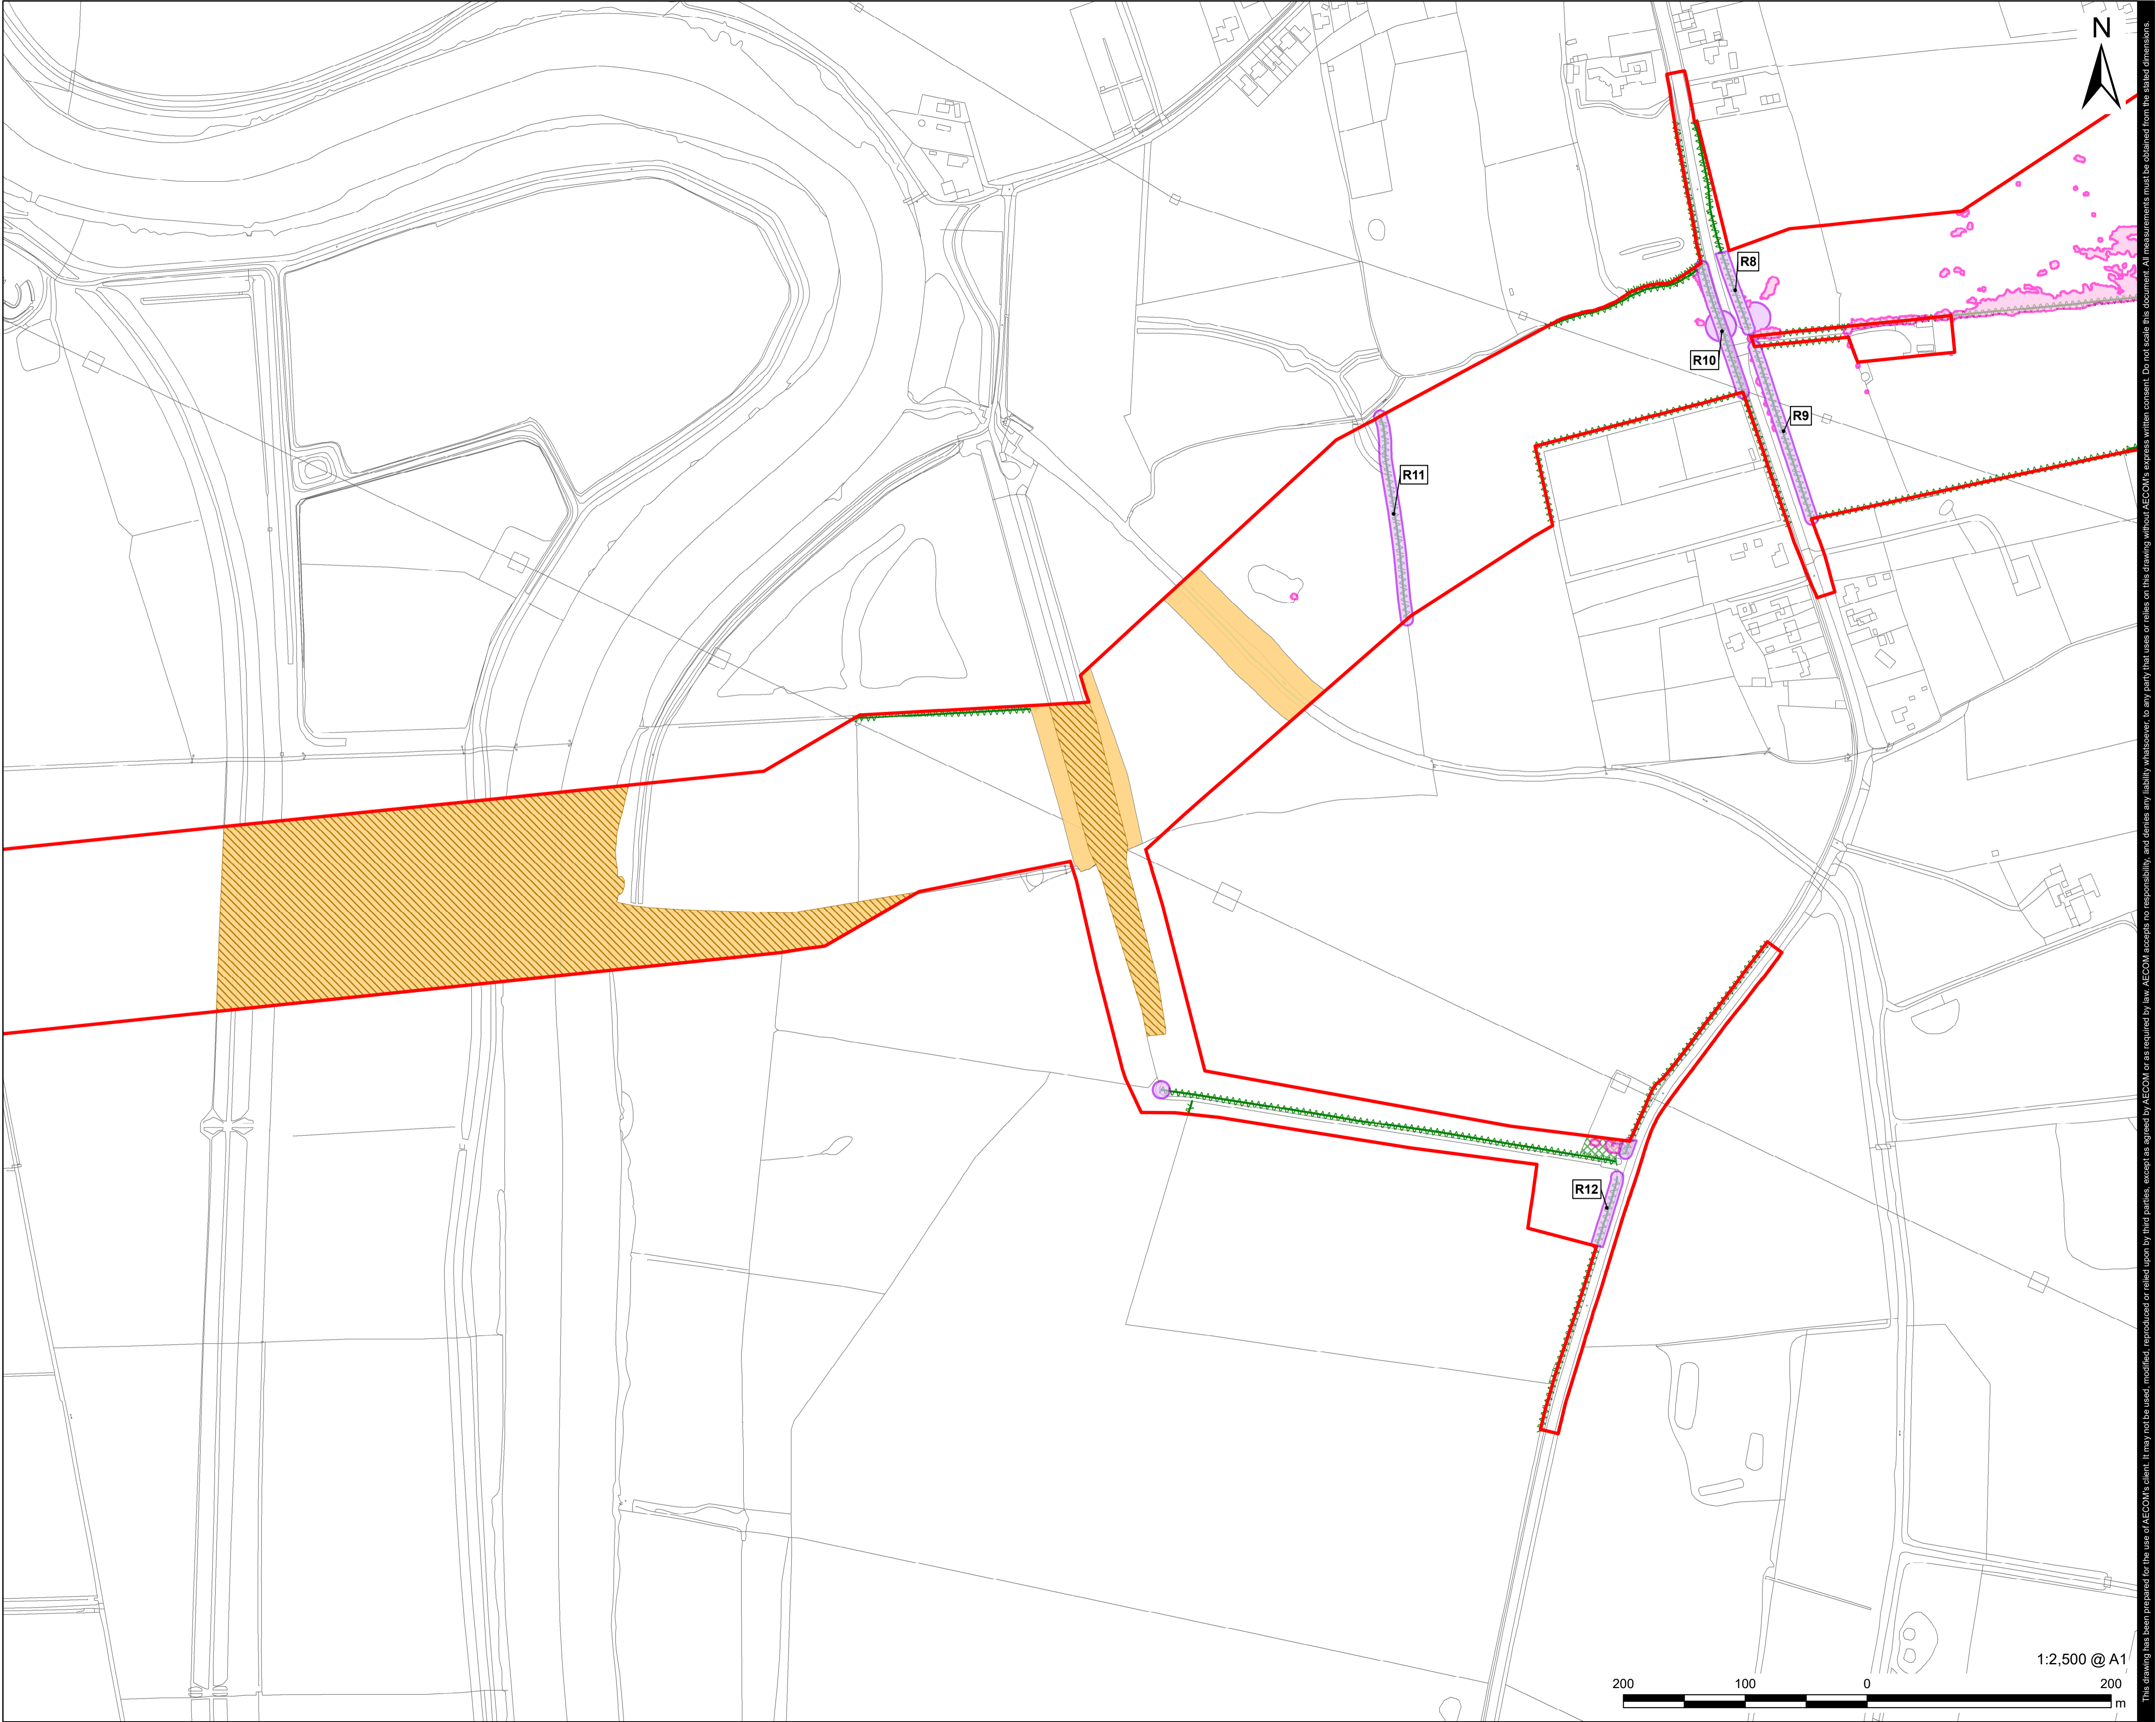


**PROJECT**  
 Gate Burton Energy Park

**CLIENT**  
  
 Gate Burton  
 ENERGY PARK  
 CONSULTANT

AECOM Limited  
 Sunley House  
 4 Bedford Park  
 Surrey, CR0 2AP, UK  
 www.aecom.com

- LEGEND**
- ORDER LIMITS
  - PHOTOVOLTAIC (PV) SOLAR PANEL
  - NO TEMPORARY ACCESS
  - TEMPORARY CONSTRUCTION COMPOUND
  - PROPOSED LOCATION OF BATTERY ENERGY STORAGE SYSTEM (BESS)
  - OVERHEAD POWERLINE AND PYLON
  - PERIMETER FENCE TO SOLAR
  - PROPOSED POWER CONVERSION UNIT (PCU)
  - PROPOSED ACCESS TRACK
  - G2 - RUNNING WATER
  - J2.1.1 - INTACT HEDGE - NATIVE SPECIES-
  - J2.1.2 - INTACT HEDGE - SPECIES-
  - J2.2.2 - DEFUNCT HEDGE - SPECIES-
  - J2.3.1 - HEDGE WITH TREES - NATIVE SPECIES-
  - A2.1 - SCRUB - DENSE/CONTINUOUS
  - POTENTIAL AREAS OF VEGETATION**
  - HEDGEROW REMOVAL
  - PERIMETER FENCE REMOVAL
  - WOODLAND REMOVAL
- Hedgerows removed will be reinstated in accordance with the Outline Landscape and Ecology Management Plan (EN-01013 LAPP7.10)

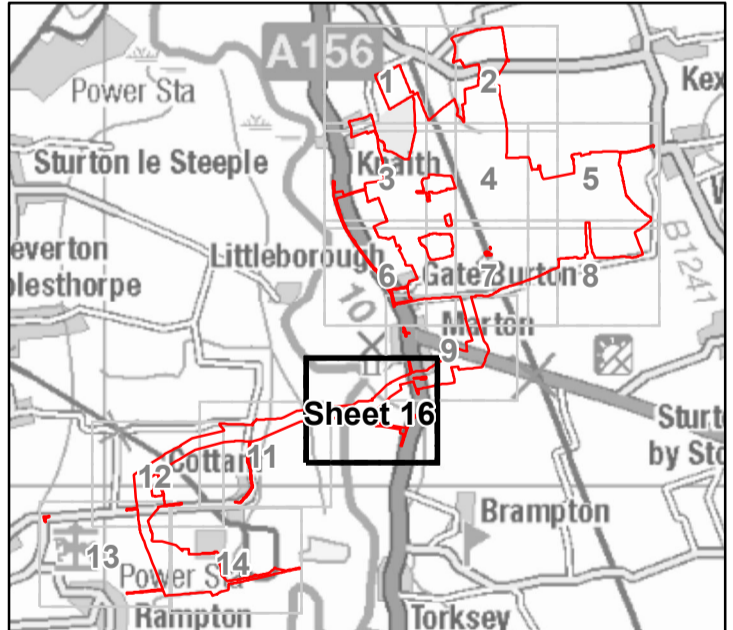

- NOTES**
1. Do not scale from this drawing.
  2. For proposed site access arrangements and photovoltaic (PV) layout refer to engineers drawings.
  3. Drawing to be read and printed in colour.

© Crown copyright and database rights 2022.  
 Ordnance Survey 0100031673.

**ISSUE PURPOSE**

FINAL

**PROJECT NUMBER**

60664324

**FIGURE TITLE**

Vegetation Removal Plan  
 Version 4 (Change Request Version)  
 Sheet 10 of 14


**FIGURE NUMBER**

Figure 10-21




This drawing has been prepared for the use of AECOM's client. It may not be used, modified, reproduced or relied upon by third parties, except as agreed by AECOM or as required by law. AECOM accepts no responsibility, and denies any liability whatsoever, to any party that uses or relies on this drawing without AECOM's express written consent. Do not scale this document. All measurements must be obtained from the stated dimensions.

Revision: 04 Drawn: VC Checked: JS Approved: WB Date: 2023-10-02  
Filename: \\na.aecomnet.com\fs\EMEA\Croydon\UKCRD1\Legacy\UKCRD1\PP001\UKCRD1\Projects\Gate Burton Energy Park\02\_Maps\Further Environmental Information\Vegetation Removal Plan.mxd

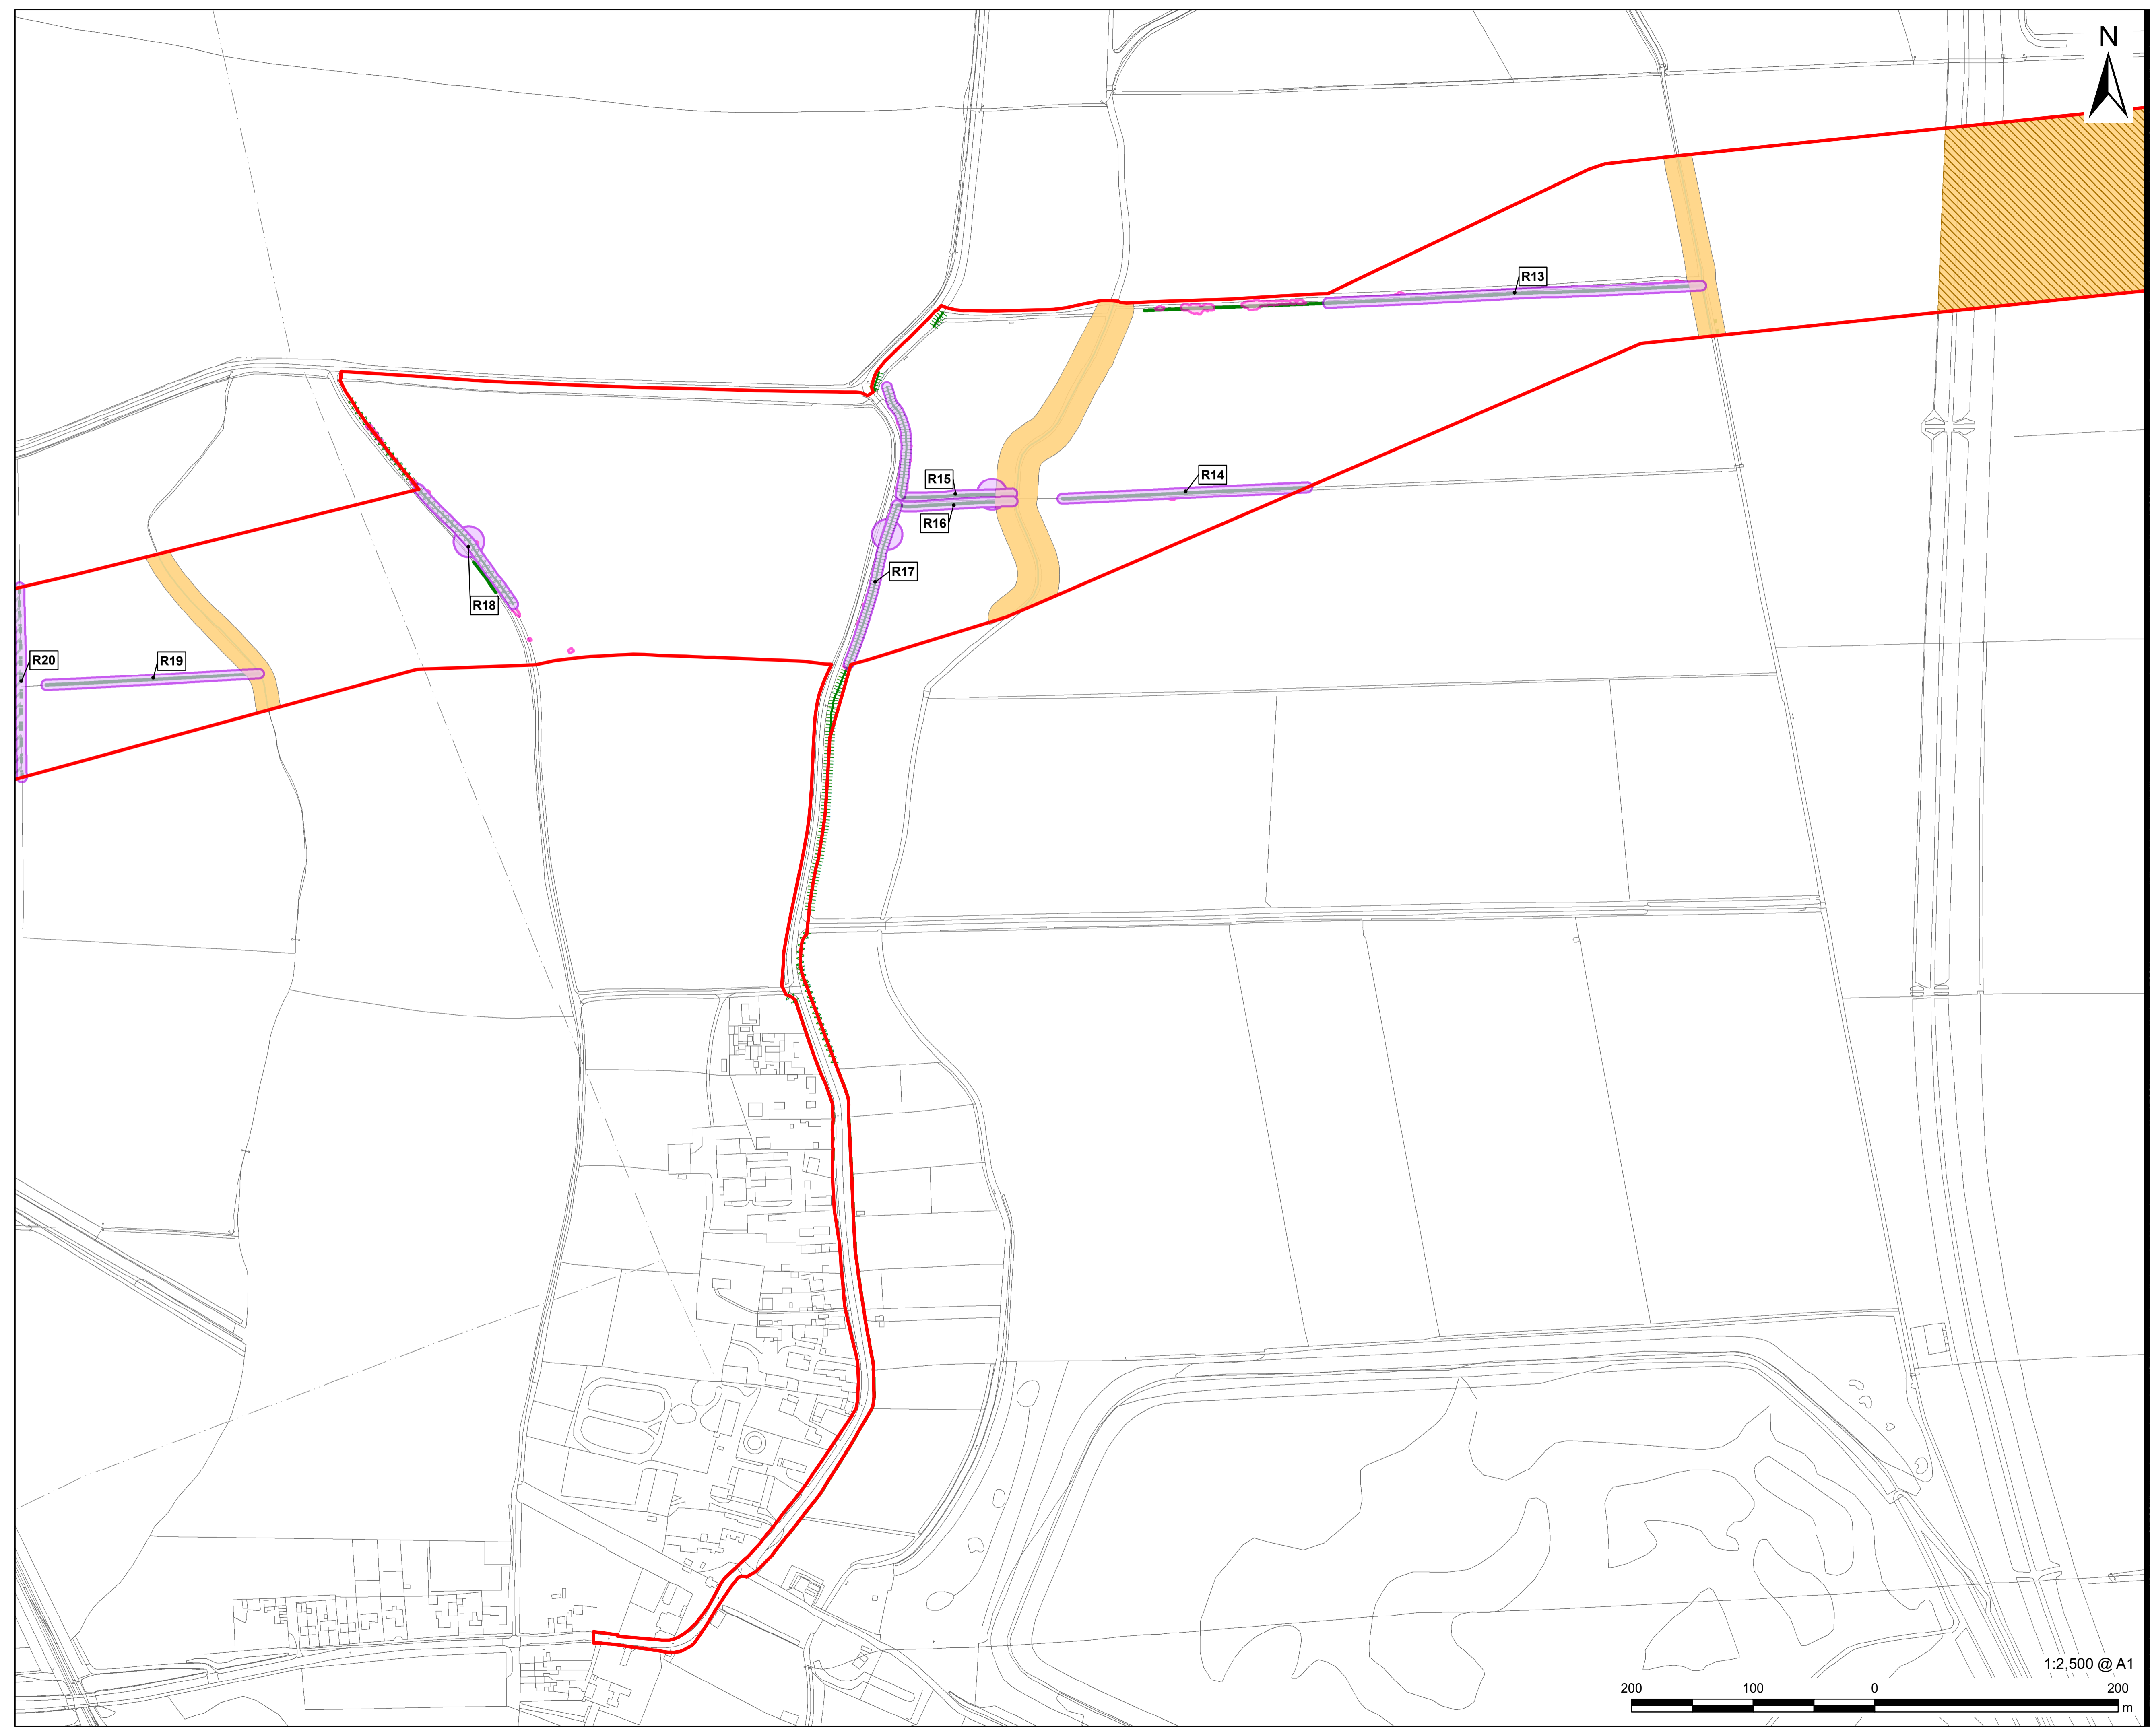

**AECOM**

**PROJECT**  
Gate Burton Energy Park

**CLIENT**  
  
Gate Burton  
ENERGY PARK  
CONSULTANT

AECOM Limited  
Sunley House  
4 Bedford Park  
Surrey, CR0 2AP, UK  
www.aecom.com

**LEGEND**

- ORDER LIMITS
- PHOTOVOLTAIC (PV) SOLAR PANEL
- NO TEMPORARY ACCESS
- TEMPORARY CONSTRUCTION COMPOUND
- PROPOSED LOCATION OF BATTERY ENERGY STORAGE SYSTEM (BESS)
- OVERHEAD POWERLINE AND PYLON
- PERIMETER FENCE TO SOLAR PANELS
- PROPOSED POWER CONVERSION UNIT (PCU)
- PROPOSED ACCESS TRACK
- G2 - RUNNING WATER
- J2.1.1 - INTACT HEDGE - NATIVE SPECIES-RICH
- J2.1.2 - INTACT HEDGE - SPECIES-POOR
- J2.2.2 - DEFUNCT HEDGE - SPECIES-POOR
- J2.3.2 - HEDGE WITH TREES - SPECIES-POOR
- A1.1.2 - BROADLEAVED WOODLAND - PLANTATION
- POTENTIAL AREAS OF VEGETATION REMOVAL
  - HEDGEROW REMOVAL
  - PERIMETER FENCE REMOVAL
  - WOODLAND REMOVAL

Hedgerows removed will be reinstated in accordance with the Outline Landscape and Ecology Management Plan (EN-010131/APPT/10).

**NOTES**

- Do not scale from this drawing.
- For proposed site access arrangements and photovoltaic (PV) layout refer to engineers drawings.
- Drawing to be read and printed in colour.


© Crown copyright and database rights 2022.  
Ordnance Survey 0100031673.


**ISSUE PURPOSE**  
FINAL


**PROJECT NUMBER**  
60664324

**FIGURE TITLE**  
Vegetation Removal Plan  
Version 4 (Change Request Version)  
Sheet 11 of 14


**FIGURE NUMBER**  
Figure 10-21

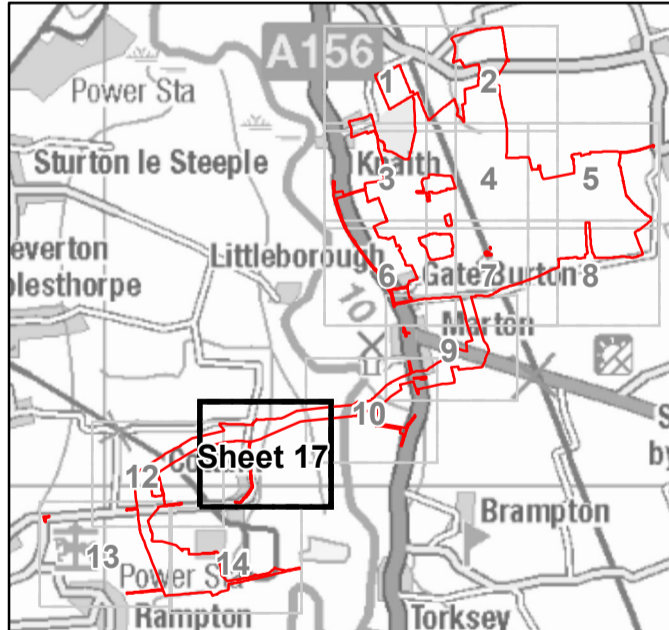

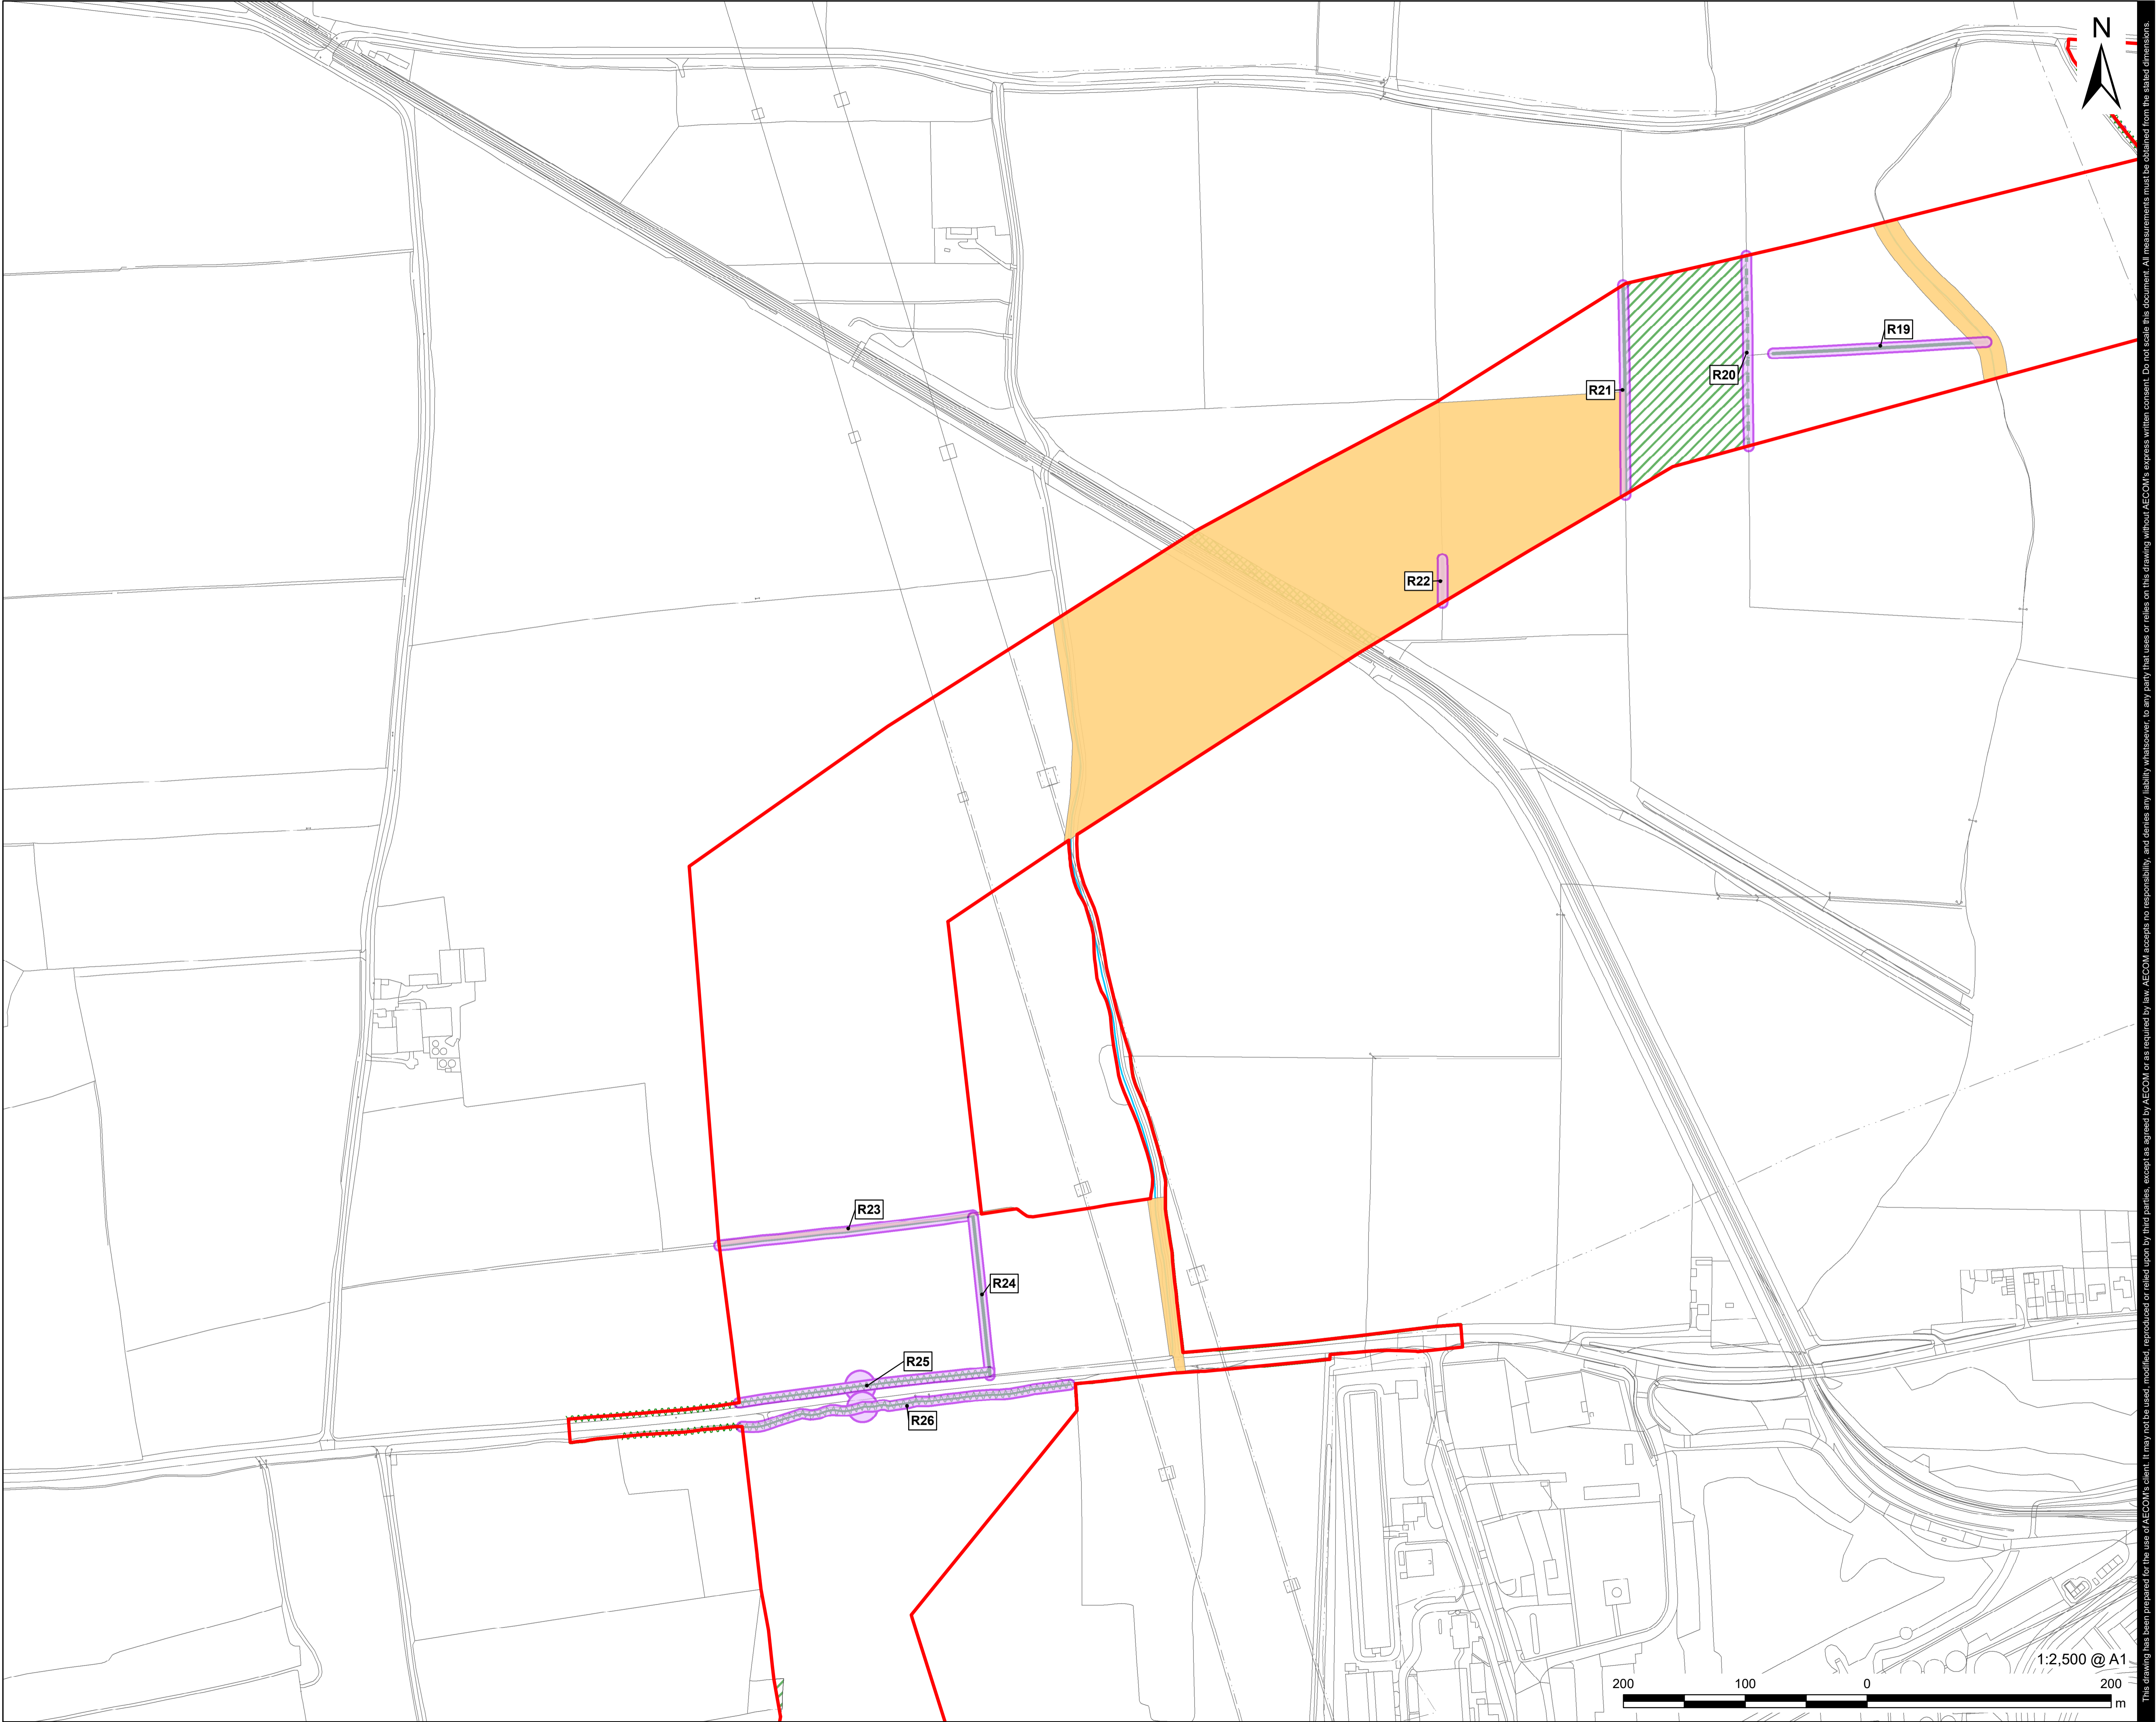



**PROJECT**  
Gate Burton Energy Park

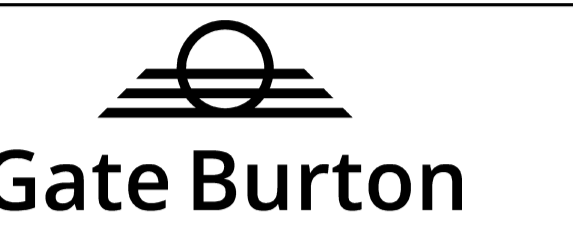**CLIENT**  
  
Gate Burton  
ENERGY PARK  
CONSULTANT

AECOM Limited  
Sunley House  
4 Bedford Park  
Surrey, CR0 2AP, UK  
www.aecom.com

**LEGEND**

- ORDER LIMITS
- PHOTOVOLTAIC (PV) SOLAR PANEL
- NO TEMPORARY ACCESS
- TEMPORARY CONSTRUCTION COMPOUND
- PROPOSED LOCATION OF BATTERY ENERGY STORAGE SYSTEM (BESS)
- OVERHEAD POWERLINE AND PYLON
- PERIMETER FENCE TO SOLAR PANELS
- PROPOSED POWER CONVERSION UNIT (PCU)
- PROPOSED ACCESS TRACK
- G2 - RUNNING WATER
- J2.1.1 - INTACT HEDGE - NATIVE SPECIES-RICH
- J2.1.2 - INTACT HEDGE - SPECIES-POOR
- J2.2.2 - DEFUNCT HEDGE - SPECIES-POOR
- A1.1.2 - BROADLEAVED WOODLAND - PLANTATION
- A2.1 - SCRUB - DENSE/CONTINUOUS
- POTENTIAL AREAS OF VEGETATION REMOVAL
- HEDGEROW REMOVAL
- PERIMETER FENCE REMOVAL
- WOODLAND REMOVAL

Hedgerows removed will be reinstated in accordance with the Outline Landscape and Ecology Management Plan (EN-01013 UAPPV7.10)

**NOTES**

1. Do not scale from this drawing.
2. For proposed site access arrangements and photovoltaic (PV) layout refer to engineers drawings.
3. Drawing to be read and printed in colour.

© Crown copyright and database rights 2022. Ordnance Survey 0100031673.

**ISSUE PURPOSE**

FINAL

**PROJECT NUMBER**

60664324


**FIGURE TITLE**


Vegetation Removal Plan  
Version 4 (Change Request Version)  
Sheet 12 of 14

**FIGURE NUMBER**


Figure 10-21

1:2,500 @ A1



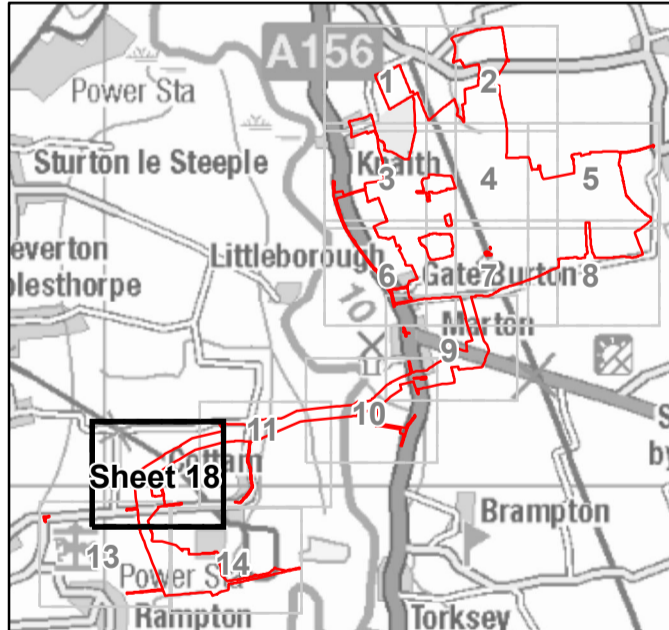

Revision: 04 Drawn: VC Checked: JS Approved: WB Date: 2023-10-02  
 Filename: \\na.aecomnet.com\fs\EMEA\Croydon\UKCRD1\Legacy\UKCRD1\PP001\UKCRD1\Projects\Gate Burton Energy Park\02\_Maps\Further Environmental Information\Vegetation Removal Plan.mxd

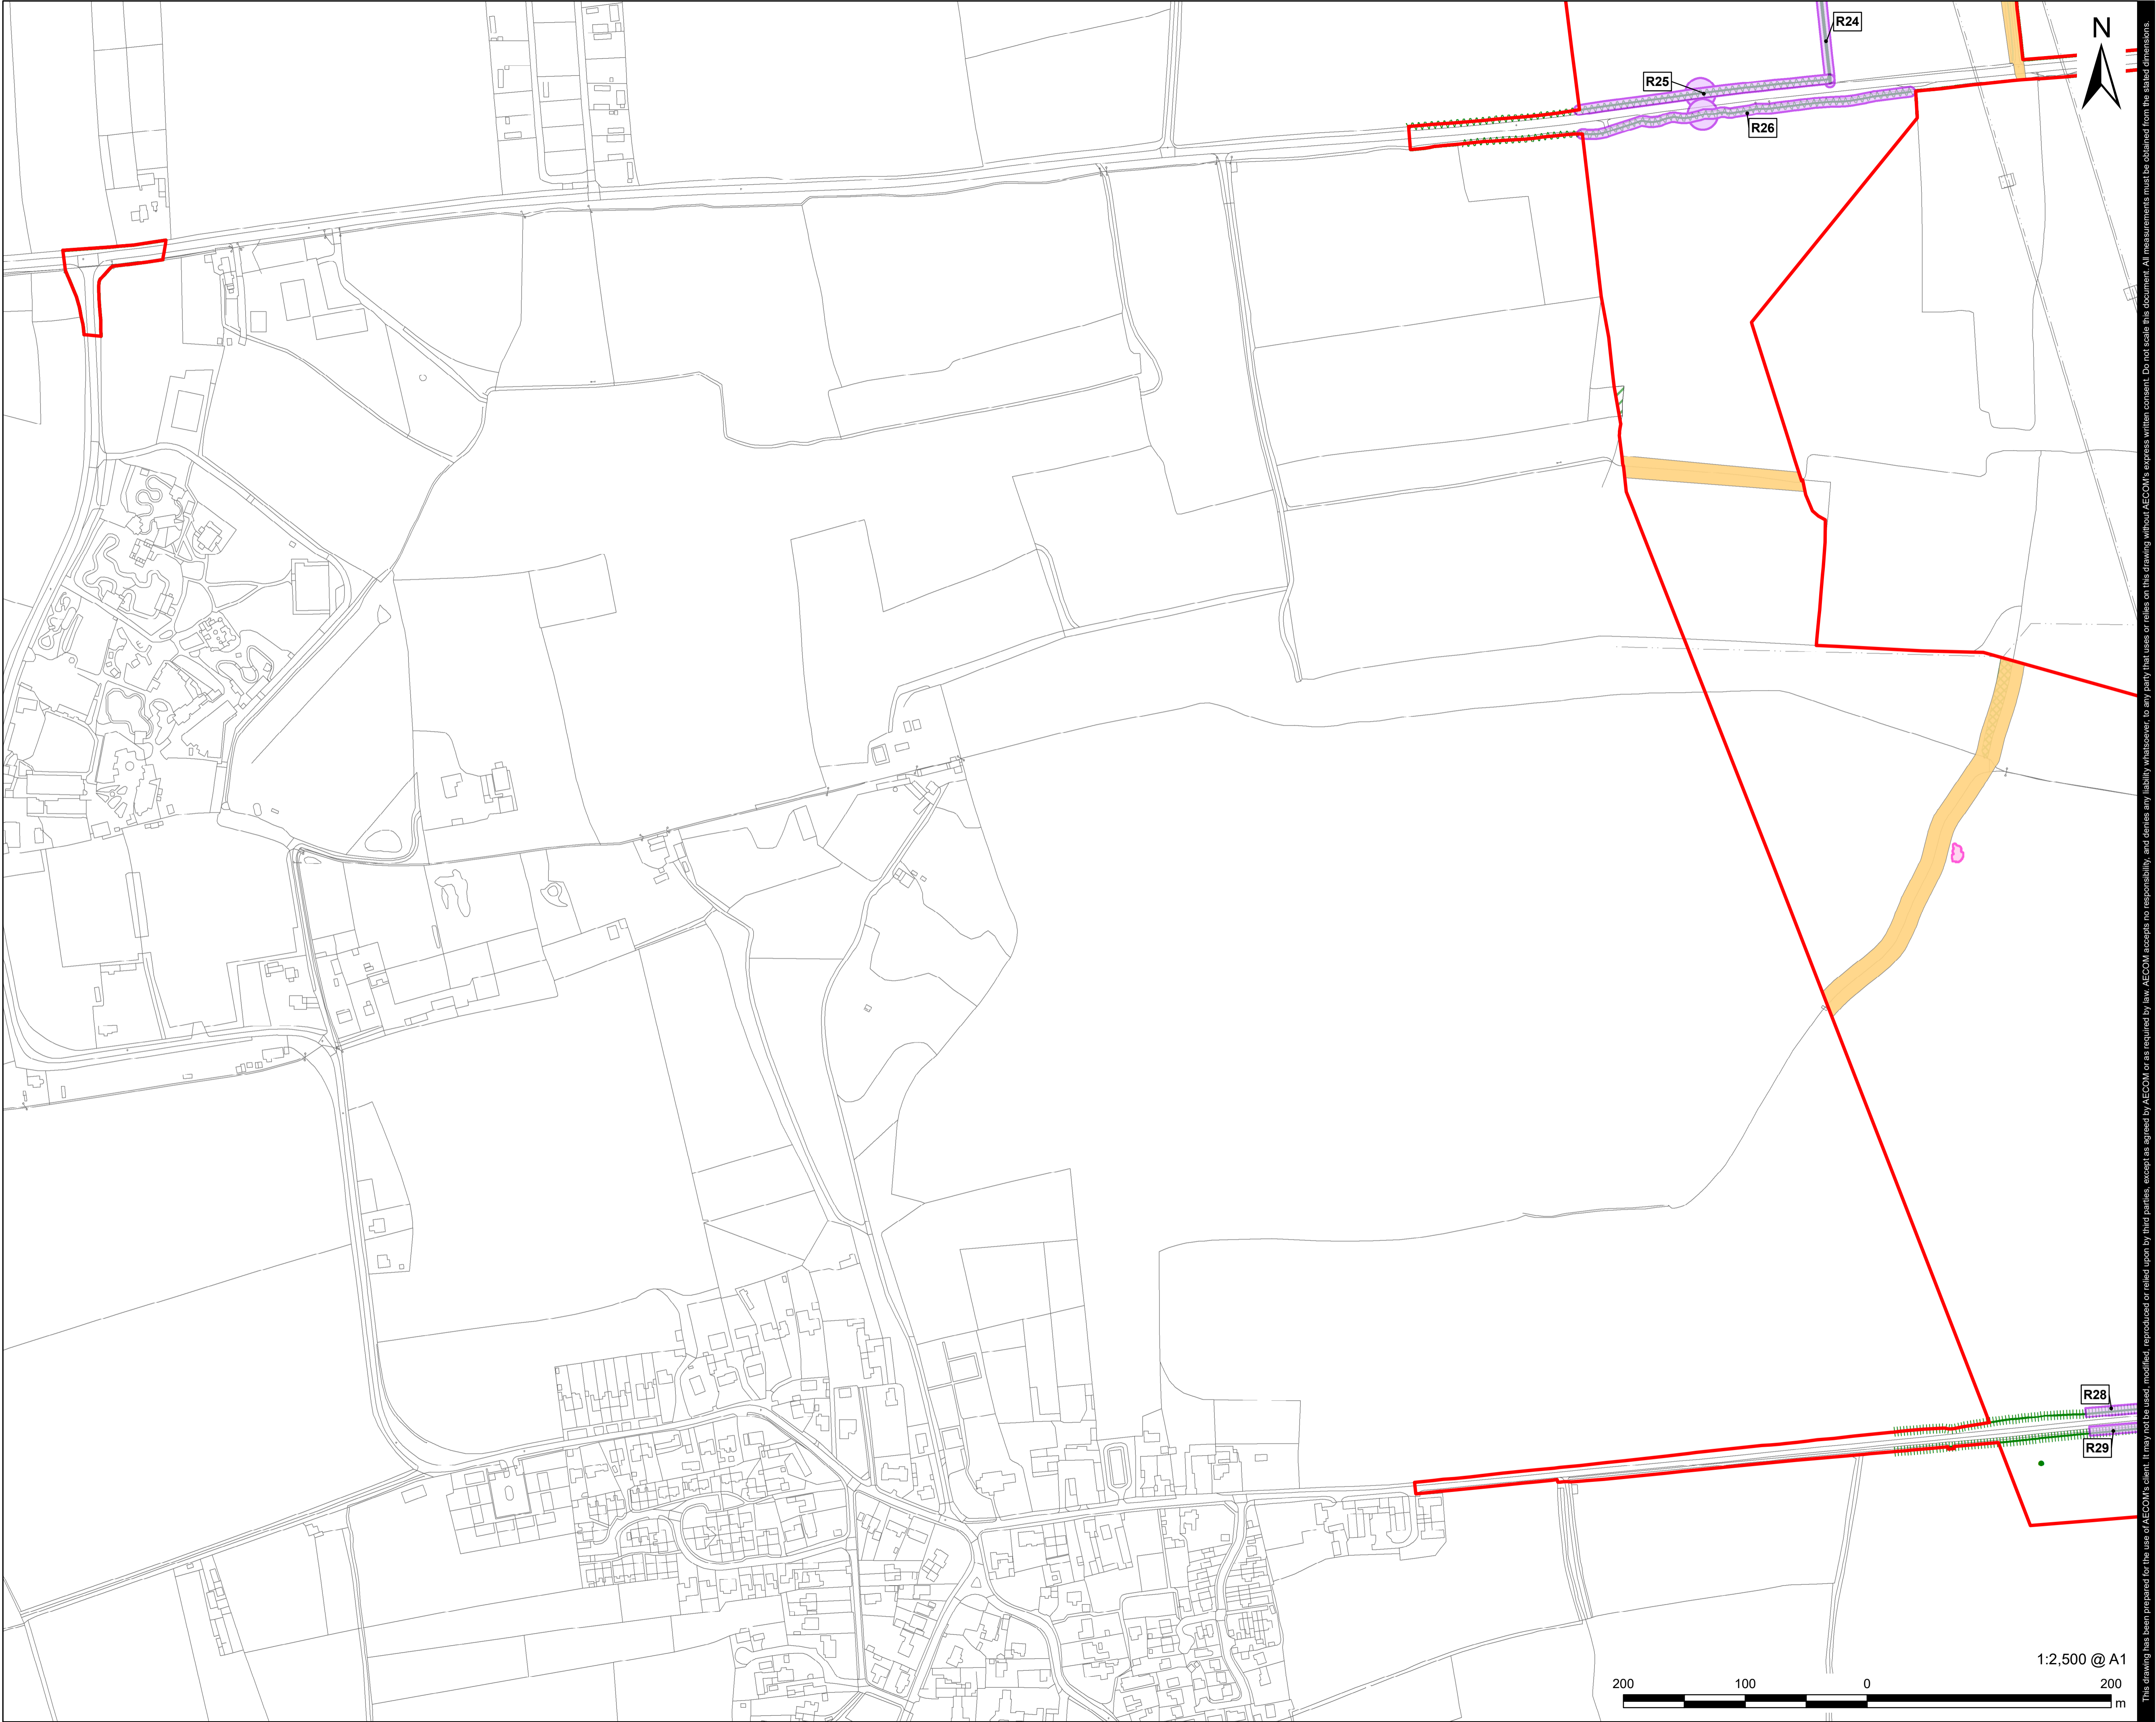

**AECOM**

PROJECT  
**Gate Burton Energy Park**

CLIENT  
**Gate Burton**  
 ENERGY PARK  
 CONSULTANT

AECOM Limited  
 Sunley House  
 4 Bedford Park  
 Surrey, CR0 2AP, UK  
 www.aecom.com

**LEGEND**

- ORDER LIMITS
- PHOTOVOLTAIC (PV) SOLAR
- NO TEMPORARY ACCESS
- TEMPORARY CONSTRUCTION COMPOUND
- PROPOSED LOCATION OF BATTERY ENERGY STORAGE SYSTEM (BESS)
- OVERHEAD POWERLINE AND PYLON
- PERIMETER FENCE TO SOLAR
- PROPOSED POWER CONVERSION UNIT (PCU)
- PROPOSED ACCESS TRACK


**PHASE 1 HABITAT**

- A3.1 - BROADLEAVED
- G2 - RUNNING WATER
- J2.1.1 - INTACT HEDGE - NATIVE SPECIES
- J2.1.2 - INTACT HEDGE - SPECIES
- J2.2.2 - DEFUNCT HEDGE - SPECIES
- J2.3.2 - HEDGE WITH TREES - SPECIES
- A1.1.2 - BROADLEAVED WOODLAND -
- A2.1 - SCRUB -

**POTENTIAL AREAS OF VEGETATION**

- HEDGEROW REMOVAL
- PERIMETER FENCE REMOVAL
- WOODLAND REMOVAL

Hedgerows removed will be reinstated in accordance with the Outline Landscape and Ecology Management Plan (EN-01013) (APP7.10)

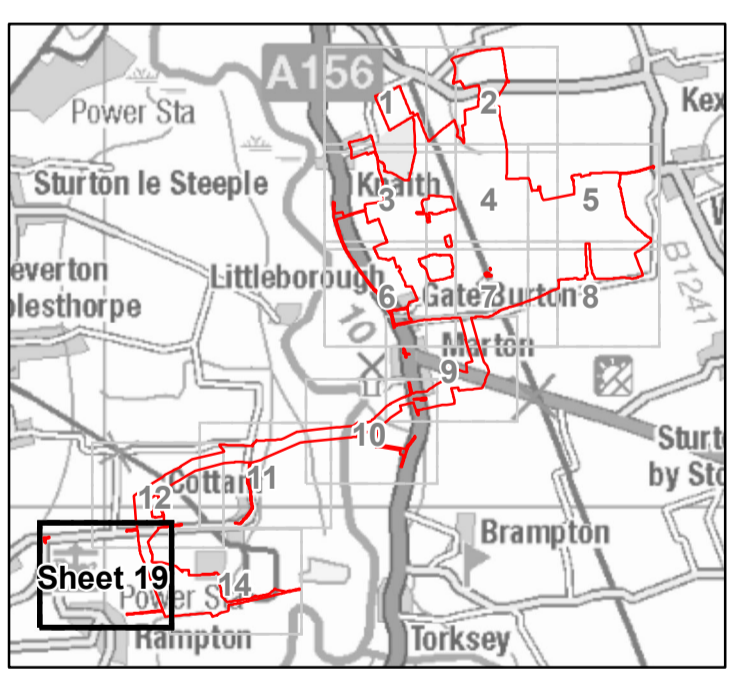

**NOTES**

- Do not scale from this drawing.
- For proposed site access arrangements and photovoltaic (PV) layout refer to engineers drawings.
- Drawing to be read and printed in colour.

© Crown copyright and database rights 2022.  
 Ordnance Survey 0100031673.


**ISSUE PURPOSE**

FINAL

**PROJECT NUMBER**  
 60664324


**FIGURE TITLE**  
 Vegetation Removal Plan  
 Version 4 (Change Request Version)  
 Sheet 13 of 14

**FIGURE NUMBER**  
 Figure 10-21

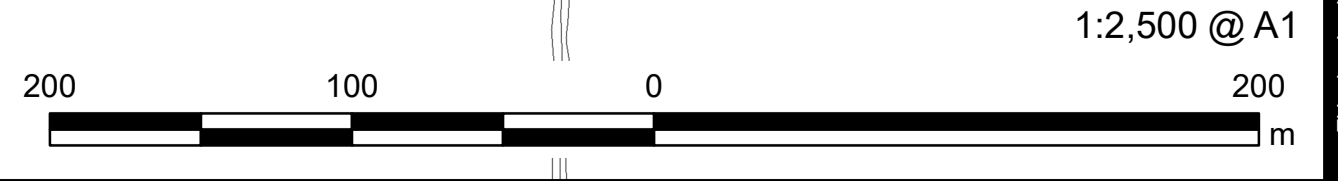


This drawing has been prepared for the use of AECOM's client. It may not be used, modified, reproduced or relied upon by third parties, except as agreed by AECOM or as required by law. AECOM accepts no responsibility, and denies any liability whatsoever, to any party that uses or relies on this drawing without AECOM's express written consent. Do not seal this document. All measurements must be obtained from the stated dimensions.

Revision: 04 Drawn: VC Checked: JS Approved: WB Date: 2023-10-02  
Filename: \\na.aecomnet.com\fs\EMEA\Croydon\UKCRD1\Legacy\UKCRD1\Projects\Gate Burton Energy Park\02\_Maps\Further Environmental Information\Vegetation Removal Plan.mxd

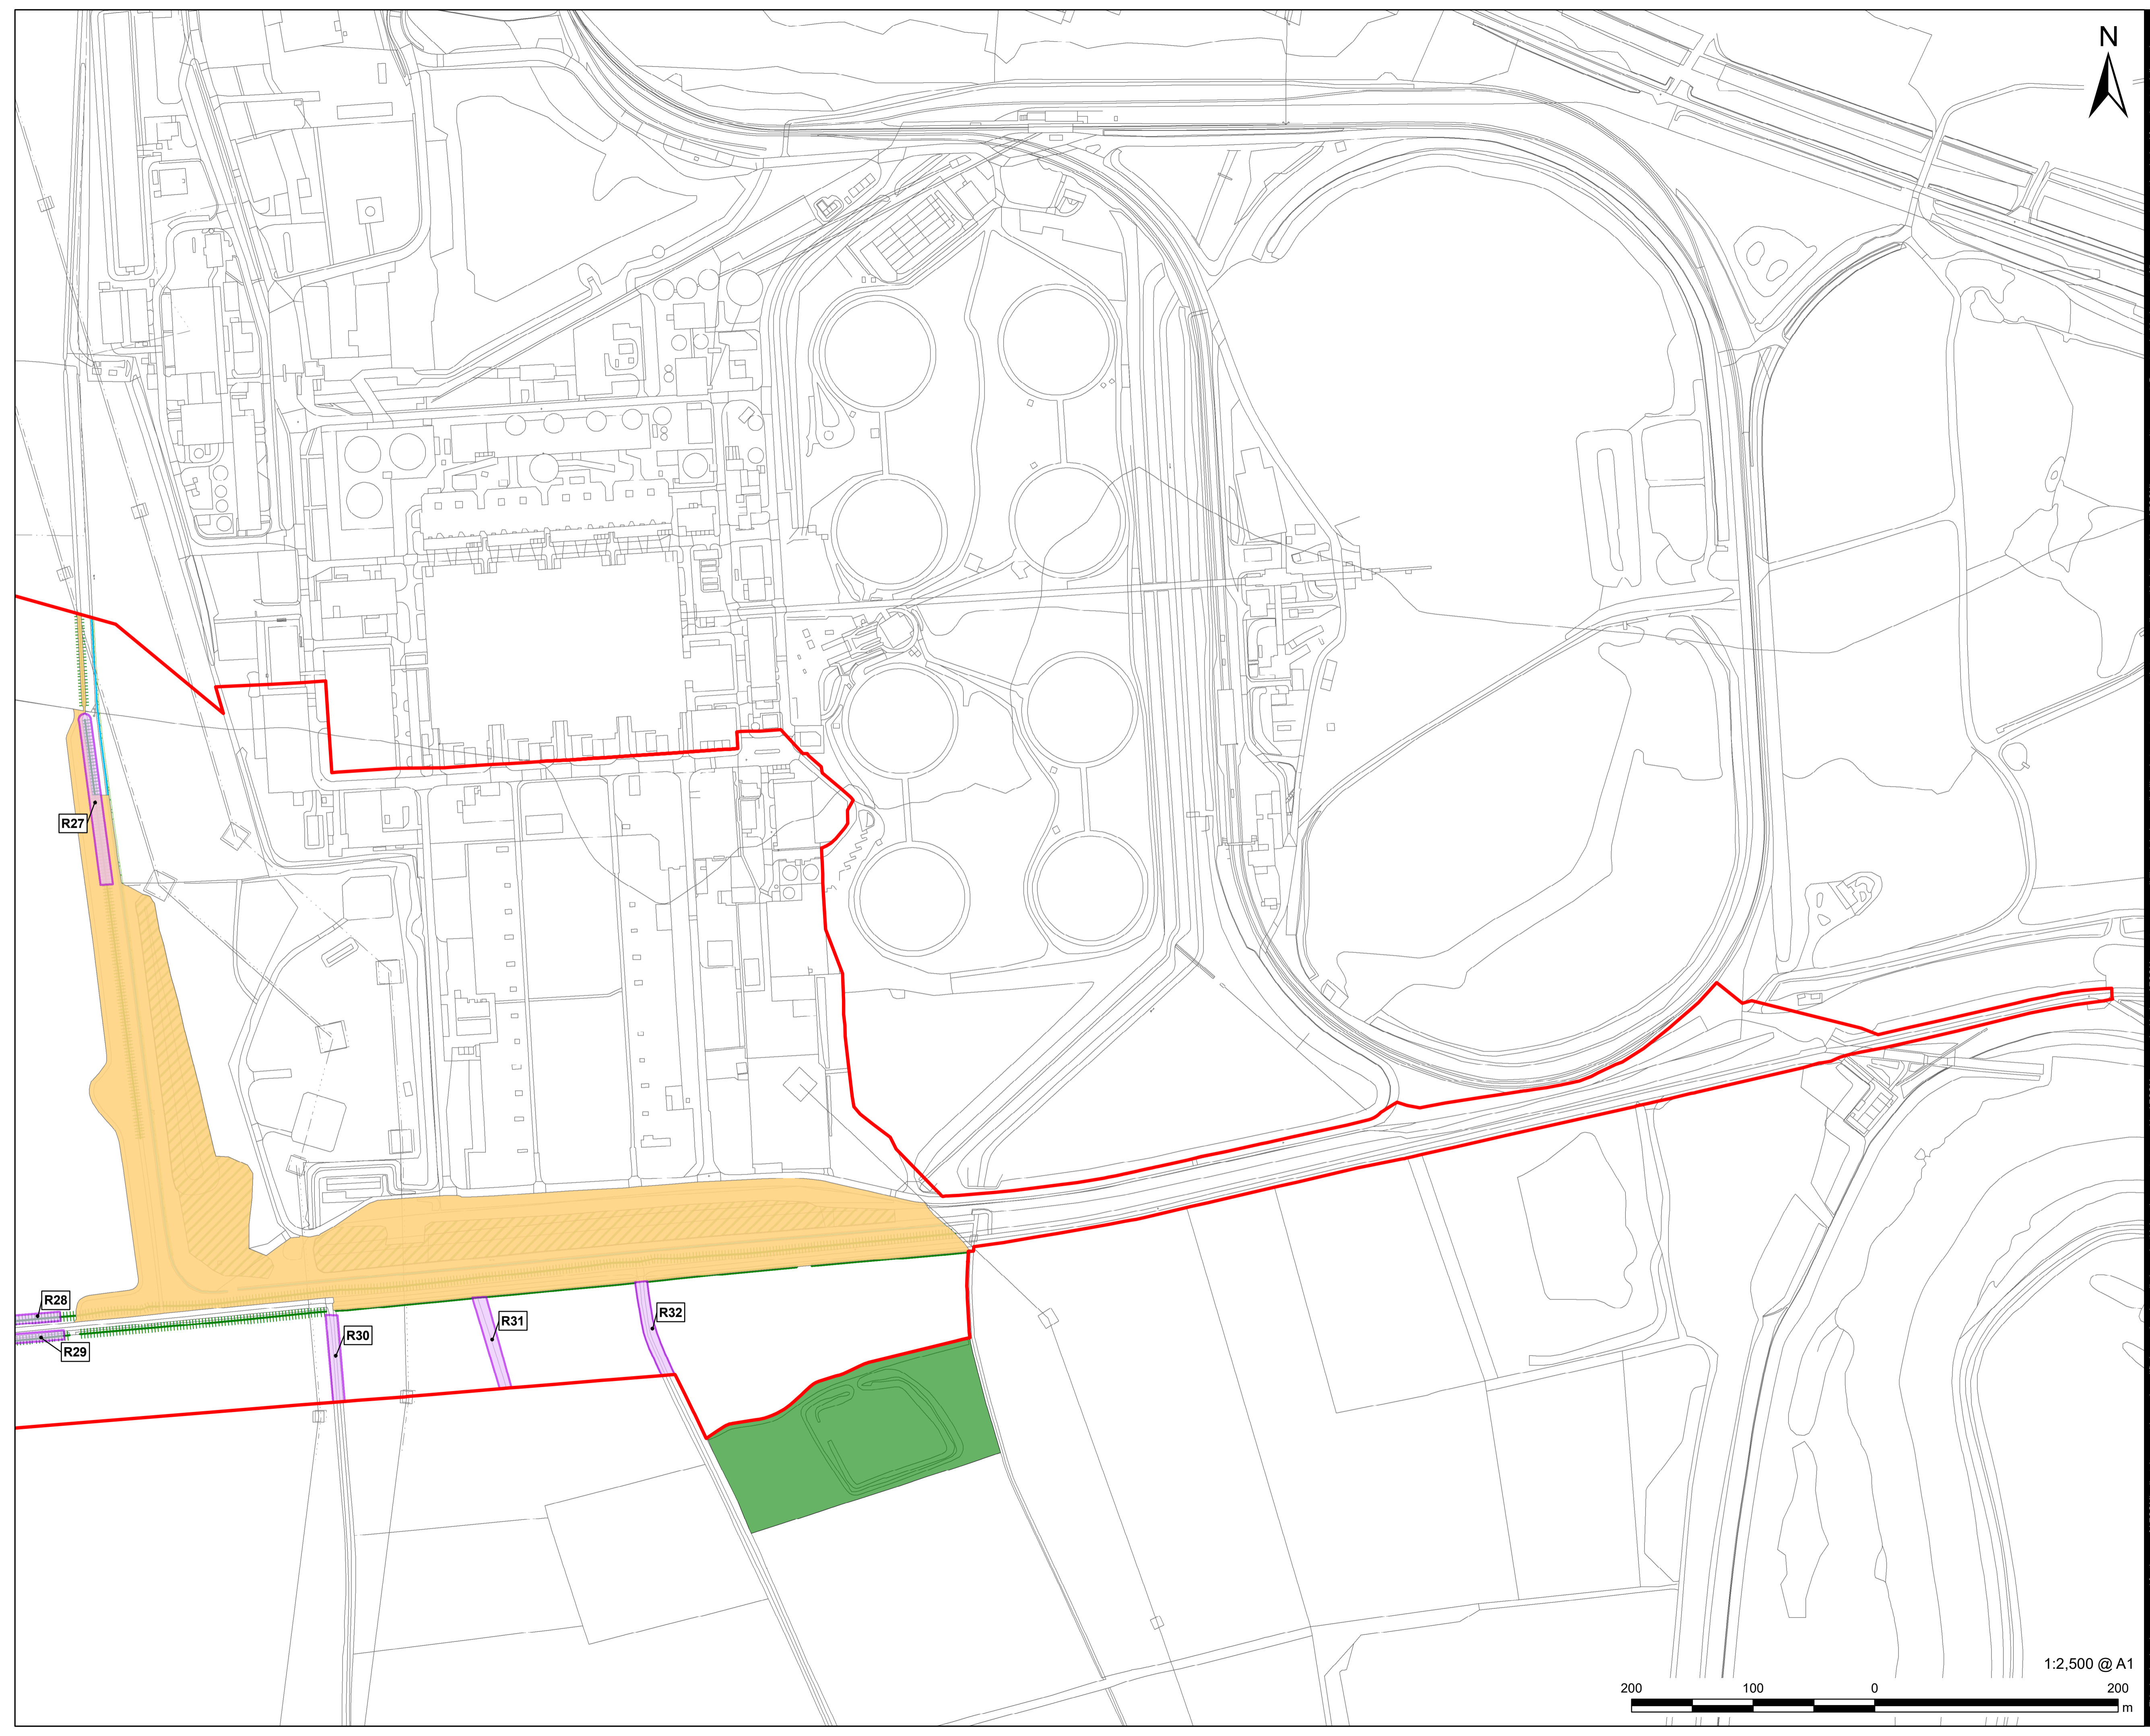

**PROJECT**  
Gate Burton Energy Park


**CLIENT**  
  
Gate Burton  
ENERGY PARK  
CONSULTANT

AECOM Limited  
Sunley House  
4 Bedford Park  
Surrey, CR0 2AP, UK  
www.aecom.com

**LEGEND**

[Red outline]	ORDER LIMITS
[Orange hatched]	PHOTOVOLTAIC (PV) SOLAR
[Yellow hatched]	NO TEMPORARY ACCESS
[Blue hatched]	TEMPORARY CONSTRUCTION COMPOUND
[Dotted]	PROPOSED LOCATION OF BATTERY ENERGY STORAGE SYSTEM (BESS)
[Grey line]	OVERHEAD POWERLINE AND PYLON
[X-X]	PERIMETER FENCE TO SOLAR
[Black rectangle]	PROPOSED POWER CONVERSION UNIT (PCU)
[Grey rectangle]	PROPOSED ACCESS TRACK
[Blue line]	G2 - RUNNING WATER
[Green line]	J2.1.2 - INTACT HEDGE - SPECIES-
[Green hatched]	J2.3.2 - HEDGE WITH TREES - SPECIES-
[Green hatched]	A1.1.1 - BROADLEAVED WOODLAND - SEMI-
[Green hatched]	A1.1.2 - BROADLEAVED WOODLAND -
[Green hatched]	A2.2 - SCRUB - SCATTERED
[Green hatched]	POTENTIAL AREAS OF VEGETATION
[Purple hatched]	HEDGEROW REMOVAL
[Light green hatched]	PERIMETER FENCE REMOVAL
[Pink hatched]	WOODLAND REMOVAL

**NOTES**  
Hedgerows removed will be reinstated in accordance with the Outline Landscape and Ecology Management Plan (EN-010131/APPT.10)

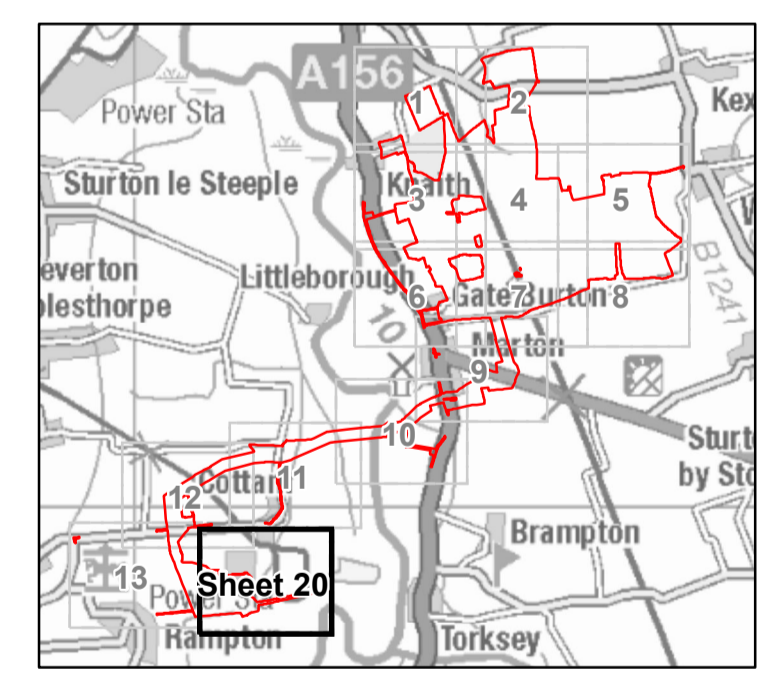

**NOTES**  
1. Do not scale from this drawing.  
2. For proposed site access arrangements and photovoltaic (PV) layout refer to engineers drawings.  
3. Drawing to be read and printed in colour.

© Crown copyright and database rights 2022.  
Ordnance Survey 0100031673.

**ISSUE PURPOSE**

**FINAL**

**PROJECT NUMBER**


60664324

**FIGURE TITLE**

Vegetation Removal Plan  
Version 4 (Change Request Version)  
Sheet 14 of 14

**FIGURE NUMBER**

Figure 10-21

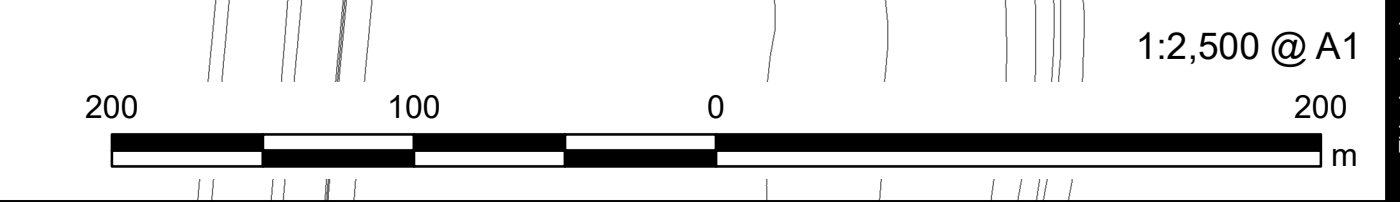

This drawing has been prepared for the use of AECOM's client. It may not be used, modified, reproduced or relied upon by third parties, except as agreed by AECOM. AECOM accepts no responsibility, and denies any liability whatsoever, to any party that uses or relies on this drawing without AECOM's express written consent. Do not seal this document. All measurements must be obtained from the stated dimensions.