


**Tillbridge Solar Project
EN010142**

**Volume 6
Environmental Statement
Figure 3-4a: Indicative Substation A Layout
Document Reference: EN010142/APP/6.3**

**Regulation 5(2)(a)
Infrastructure Planning (Applications: Prescribed Forms and
Procedure) Regulations 2009**

**April 2024
Revision Number: 00**

tillbridgesolar.com

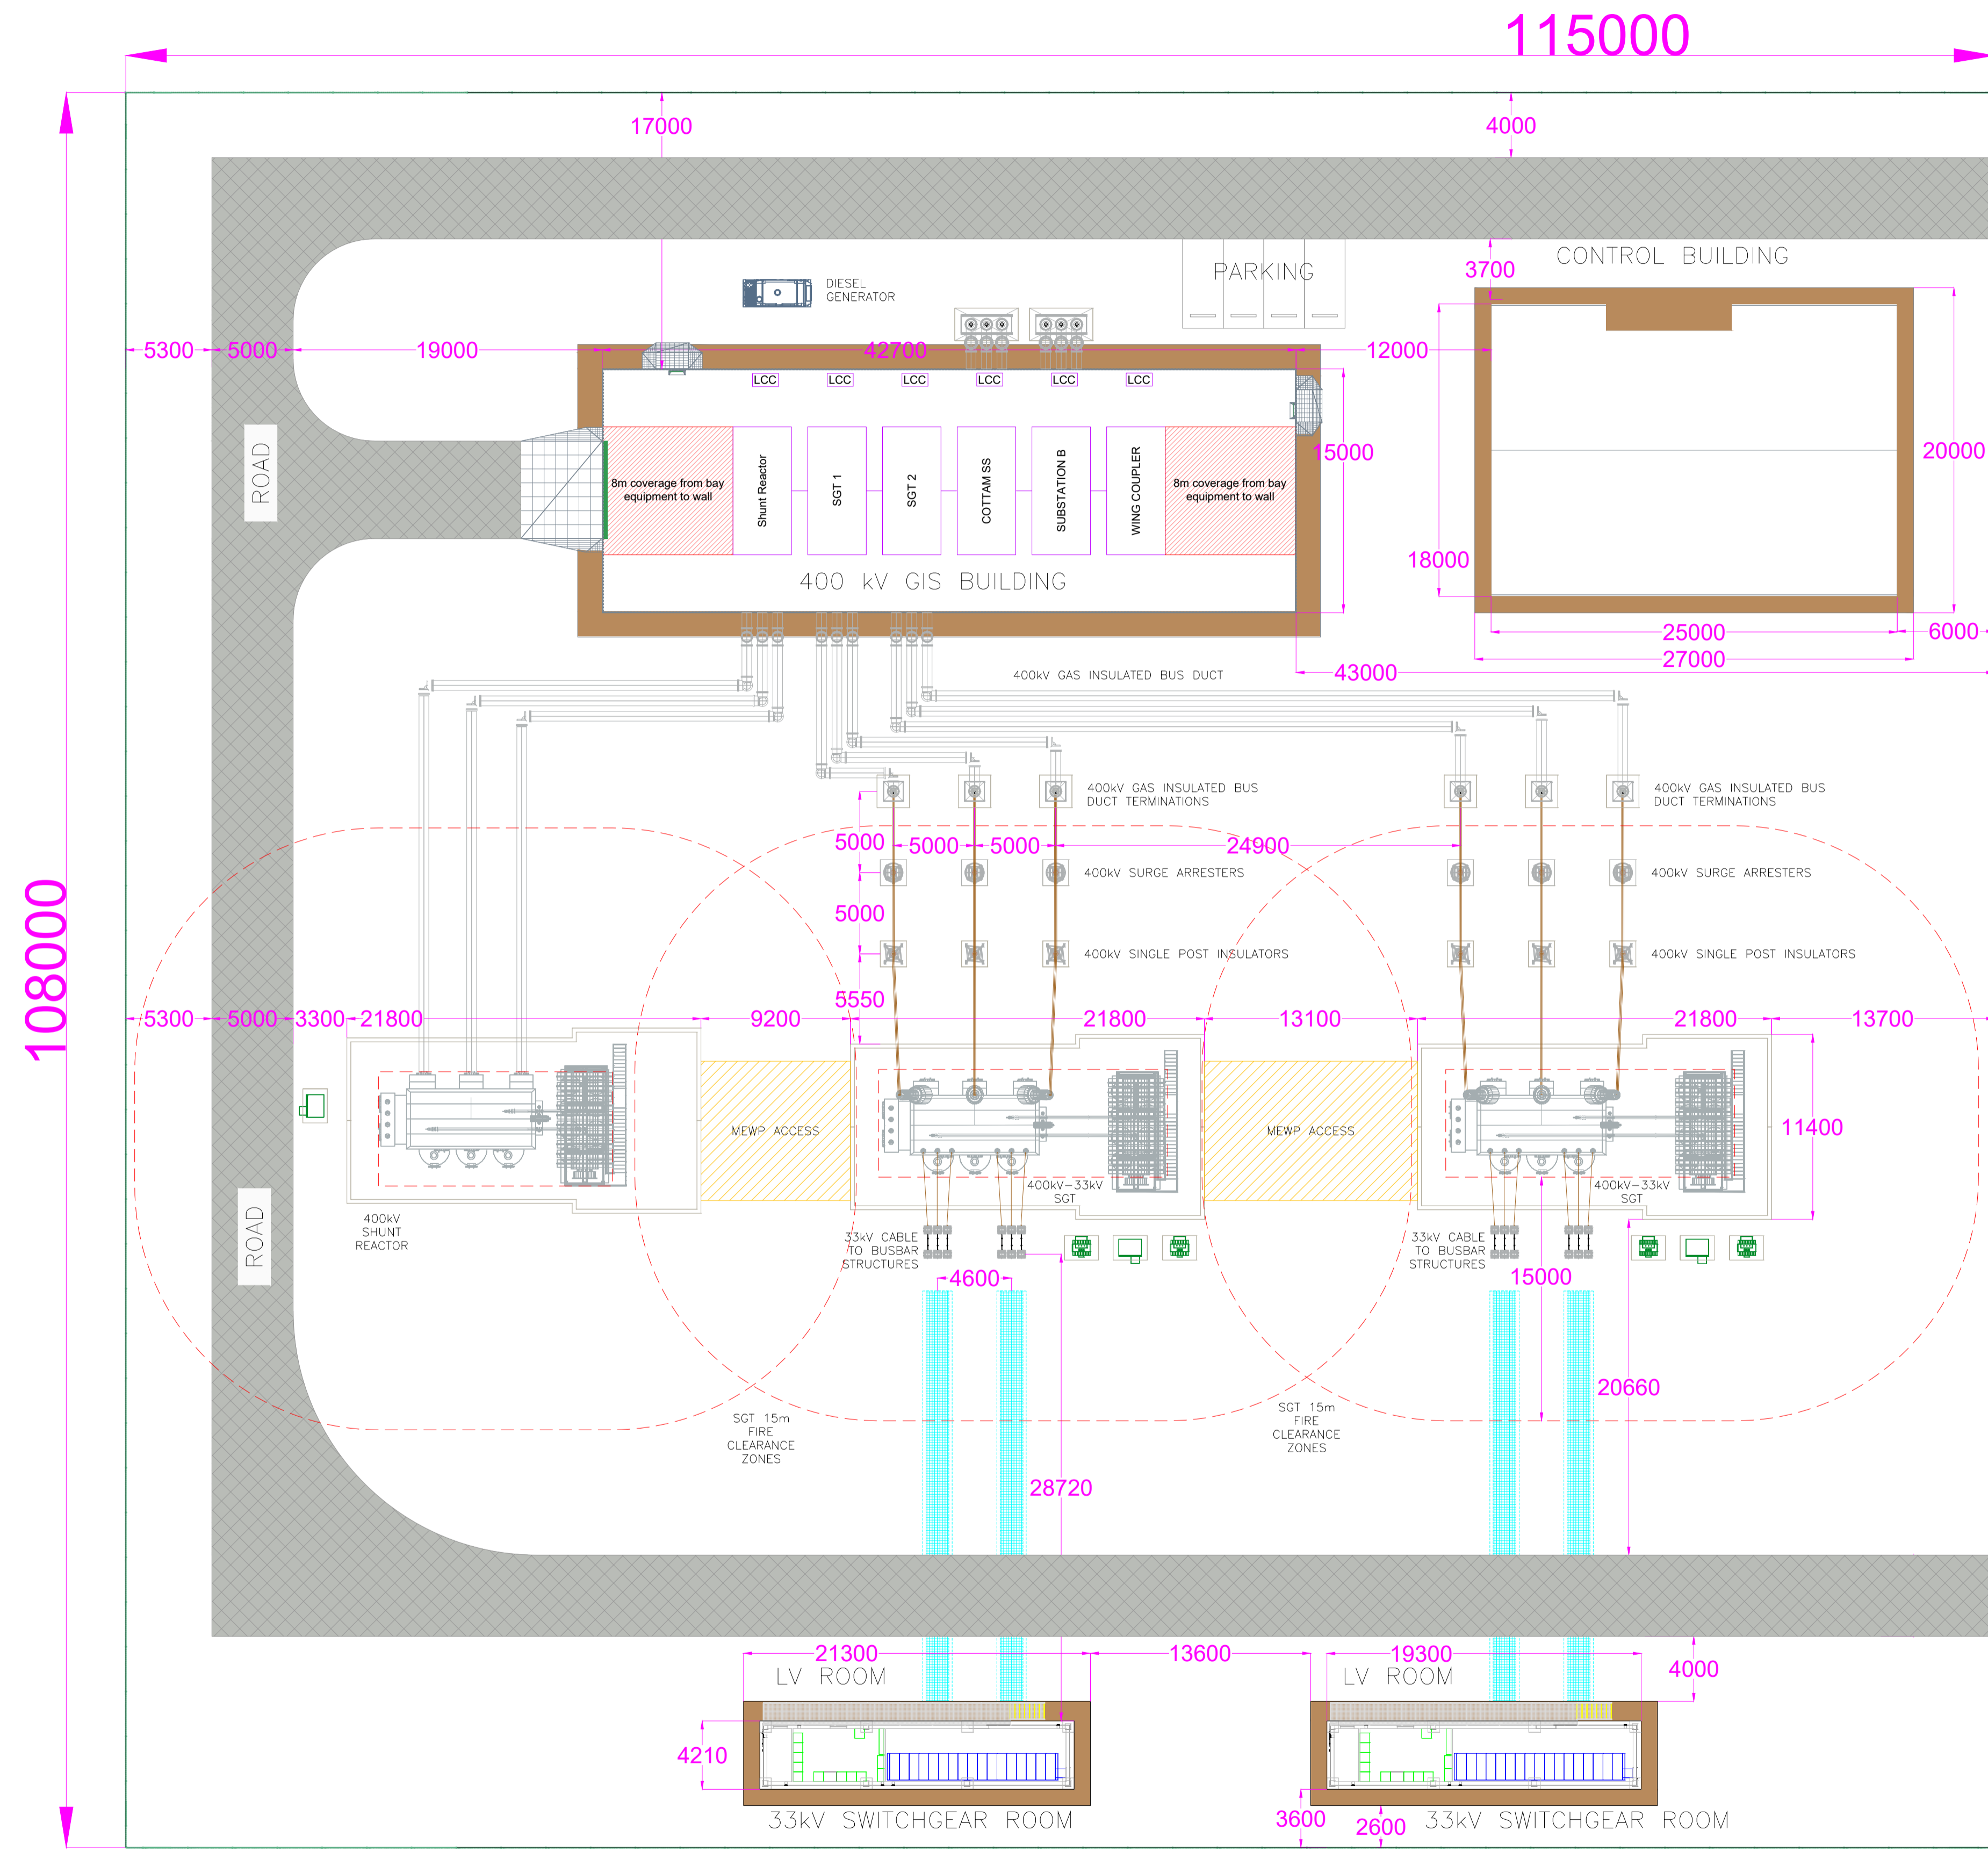

- NOTES**
1. THE EQUIPMENT LAYOUTS ARE INDICATIVE AND DIMENSIONS MAY CHANGE ONCE THE EXACT SPECIFICATIONS ARE DETERMINED.
 2. DIMENSIONS ARE PRESENTED IN MILLIMETRES UNLESS OTHERWISE STATED.
 3. DRAWING SCALE @ A1 = 1:250
 4. THIS DRAWING IS TO BE PRINTED IN COLOUR.

- KEY**
1. LCC = LOCAL CONTROL CABINET
 2. GIS BUILDING = GAS INSULATED SWITCH BUILDING
 3. LV = LOW VOLTAGE
 4. KV = KILOVOLT
 5. SGT = SUPER GRID TRANSFORMER
 6. COTTAM SS = COTTAM SUBSTATION CONNECTION
 7. MEWP ACCESS = MOBILE ELEVATING WORK PLATFORM (FOR INSTALLATION AND MAINTENANCE)

PURPOSE OF ISSUE
 DCO SUBMISSION

APPROVED FOR ISSUE

A	OB	KMCD	PB
I/R	DRAWN BY	CHECKED	APPROVED

ISSUE/REVISION

	MARCH 2024	
A	06/04/2023	FIRST REVISION
I/R	DATE	DESCRIPTION

PROJECT NUMBER
 60589004

SHEET TITLE
 FIGURE 3-4A: INDICATIVE SUBSTATION A LAYOUT

SHEET NUMBER
 60589004-ACM-XX-00-DR-EL-1002

This drawing has been prepared for the use of AECOM's client. It may not be used, modified, reproduced or relied upon by third parties, except as agreed by AECOM or as required by law. AECOM accepts no responsibility, and denies any liability, whatsoever, to any party that uses or relies on this drawing without AECOM's express written consent. Do not scale this document. All measurements must be obtained from the stated dimensions.