

**Tillbridge Solar Project  
EN010142**


**Volume 6  
Environmental Statement  
Figure 3-5a: Indicative Substation B Layout  
Document Reference: EN010142/APP/6.3**

**Regulation 5(2)(a)  
Infrastructure Planning (Applications: Prescribed Forms and  
Procedure) Regulations 2009**

**April 2024  
Revision Number: 00**

**tillbridgesolar.com**

---

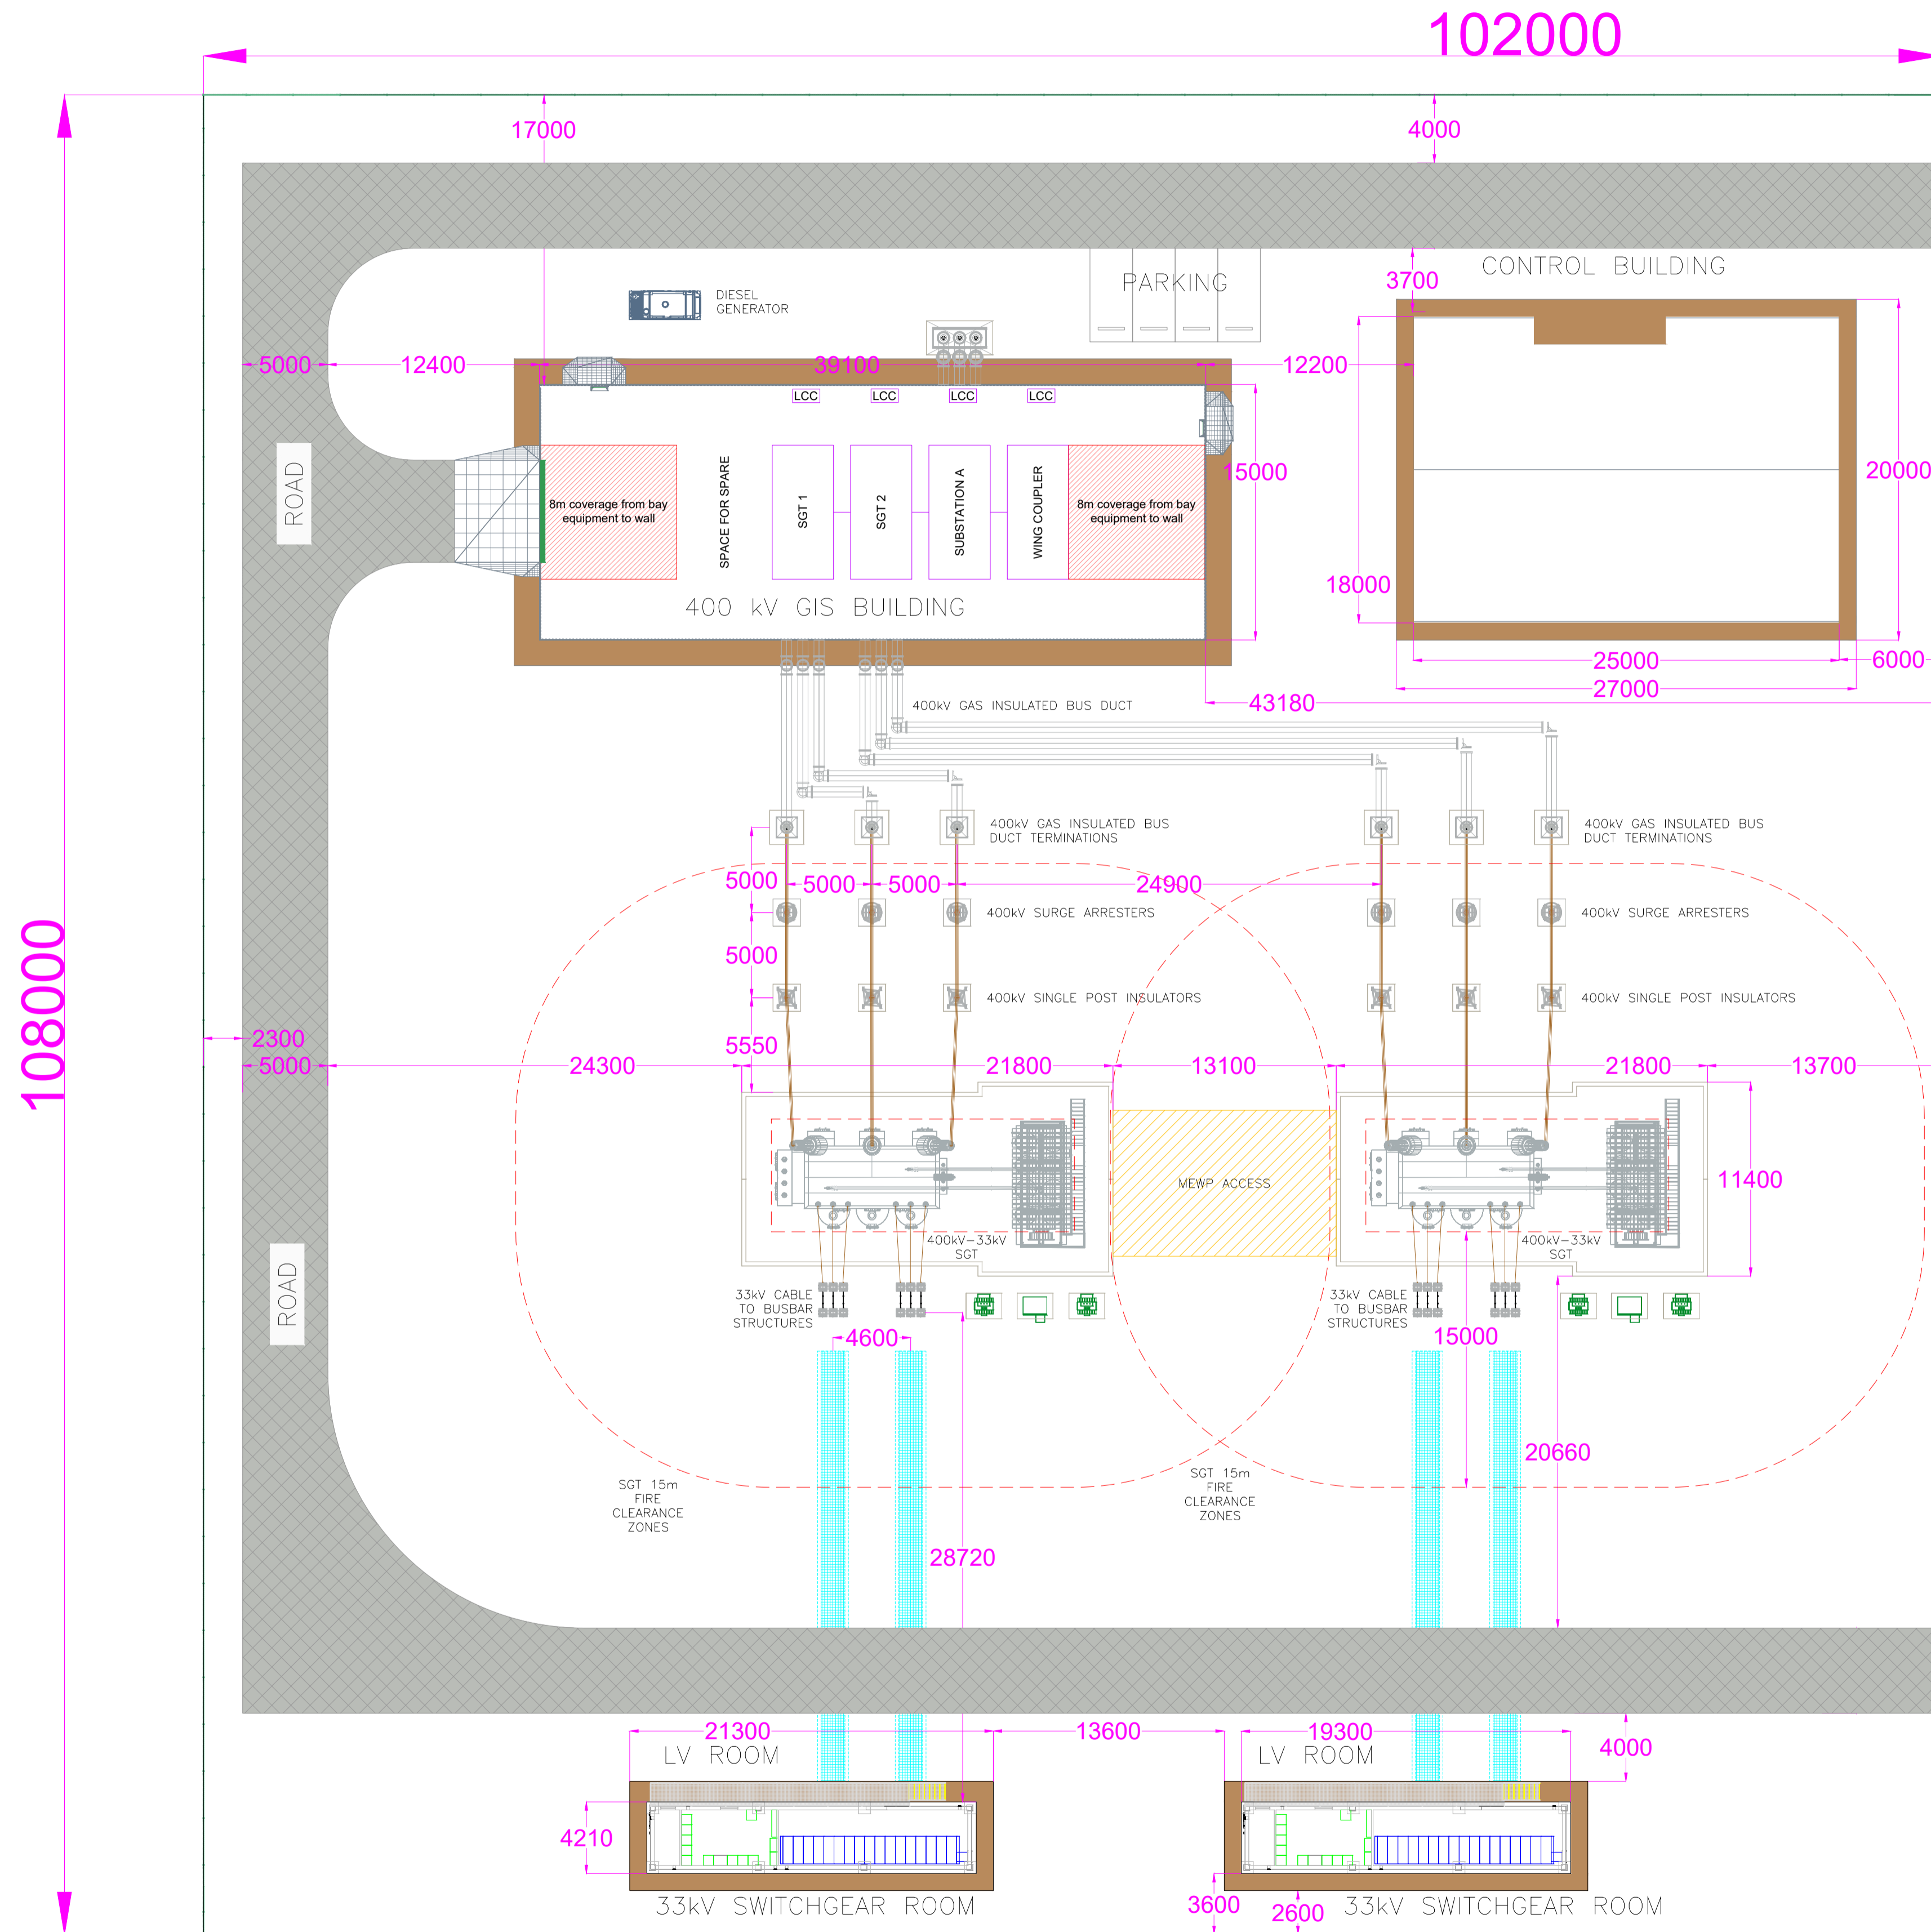

**PROJECT**

TILLBRIDGE SOLAR PROJECT

**CLIENT**

TILLBRIDGE SOLAR LTD.

**CONSULTANT**

AECOM  
 Aldgate Tower  
 2 Leman Street  
 London  
 E1 8FA  
 Tel +44 (0) 20 7061 7000  
 www.aecom.com

**NOTES**

1. THE EQUIPMENT LAYOUTS ARE INDICATIVE AND DIMENSIONS MAY CHANGE ONCE THE EXACT SPECIFICATIONS ARE DETERMINED.
2. DIMENSIONS ARE PRESENTED IN MILLIMETRES UNLESS OTHERWISE STATED.
3. DRAWING SCALE @ A1 = 1:250
4. THIS DRAWING IS TO BE PRINTED IN COLOUR.

**KEY**

1. LCC = LOCAL CONTROL CABINET
2. GIS BUILDING = GAS INSULATED SWITCH BUILDING
3. LV = LOW VOLTAGE
4. KV = KILOVOLT
5. SGT = SUPER GRID TRANSFORMER
6. COTTAM SS = COTTAM SUBSTATION CONNECTION
7. MEWP ACCESS = MOBILE ELEVATING WORK PLATFORM (FOR INSTALLATION AND MAINTENANCE)

**PURPOSE OF ISSUE**

DCO SUBMISSION

**APPROVED FOR ISSUE**

B	PC	OB	PB
A	OB	KMCD	PB
I/R	DRAWN BY	CHECKED	APPROVED

**ISSUE/REVISION**

	MARCH 2024	
B	22/08/2023	GIS BUILDING HEIGHT
A	06/04/2023	FIRST REVISION
I/R	DATE	DESCRIPTION

**PROJECT NUMBER**

60589004

**SHEET TITLE**

FIGURE 3-5A: INDICATIVE SUBSTATION B LAYOUT

**SHEET NUMBER**

60589004-ACM-XX-00-DR-EL-1012

This drawing has been prepared for the use of AECOM's client. It may not be used, modified, reproduced or relied upon by third parties, except as agreed by AECOM or as required by law. AECOM accepts no responsibility, and denies any liability, whatsoever, to any party that uses or relies on this drawing without AECOM's express written consent. Do not scale this document. All measurements must be obtained from the stated dimensions.