



SECTION F-F

BETWEEN PC9 & PC10

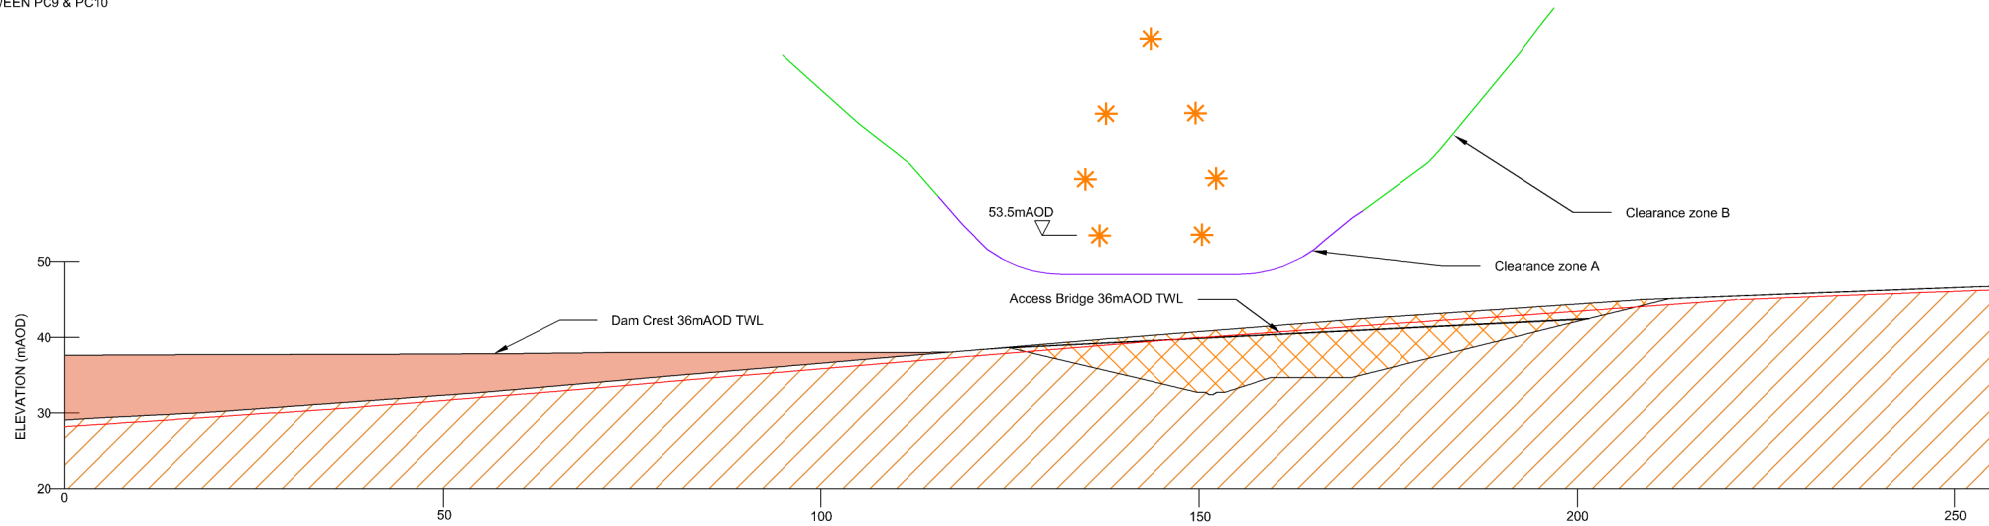

SECTION G-G

BETWEEN PC9 & PC10

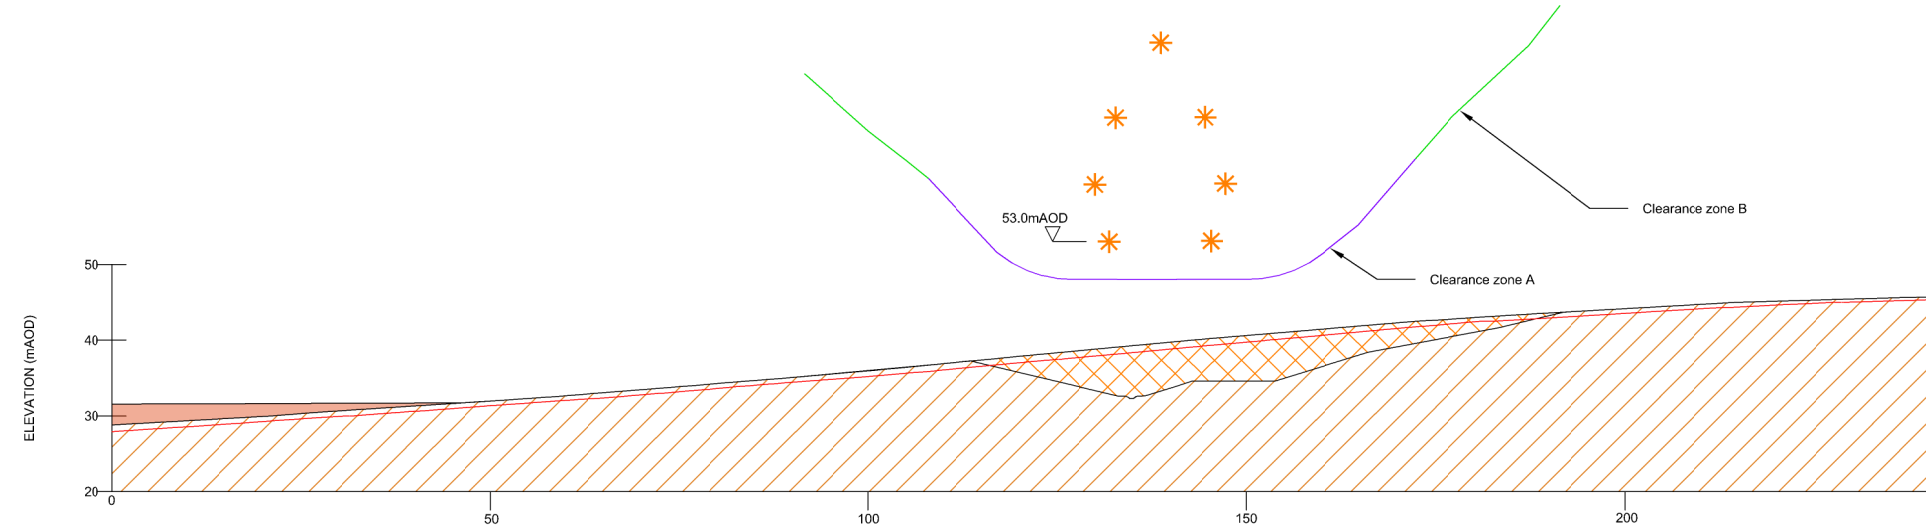

DIMENSION TABLE SECTION F-F

Item	Ref	Spot Level from SEW Contour Plan (m AOD)	Difference between SEW contours and Lidar levels (m)	Distance from Spot Level to Clearance Zone (m)
36m AOD Reservoir River Cutting	a	38.65	+0.74	13
	b	35.69	+0.82	13
	c	32.73	+0.76	16
	d	32.43	+0.81	16
	e	32.73	+0.81	16
	f	34.68	+0.86	14
	g	34.68	+0.94	21
	h	39.91	+0.98	37
	i	45.14	+0.80	>40

1). For location of reference point along cross section, see drawing B14000AT-501.

DIMENSION TABLE SECTION G-G


Item	Ref	Spot Level from SEW Contour Plan (m AOD)	Difference between SEW contours and Lidar levels (m)	Distance from Spot Level to Clearance Zone (m)
36m AOD Reservoir River Cutting	a	37.26	+0.84	18
	b	34.95	+0.85	14
	c	32.63	+0.91	15
	d	32.33	+0.91	16
	e	32.63	+0.91	15
	f	34.59	+0.91	13
	g	34.60	+0.85	14
	h	39.69	+0.71	25
	i	43.70	+0.64	41

1). For location of reference point along cross section, see drawing B14000AT-501.

- Notes:
- All sections are taken perpendicular to the RCP looking east.
 - Clearance Zone based upon clearances in the Electricity Networks Association (ENA) Technical Specification 43-8 issue 4 2015. Clearance Zone A shown is for climbable trees 5.3m clearance provided to the conductor. For Coppiced trees clearance zone A will be 2.2M higher towards the RCP conductors (3.1m clearance provided to the conductor). Clearance Zone B is for falling trees with 3.1m clearance provided to the conductor.
 - Clearance zone for fixed trees to conductor swing includes an offset of 3m to account for breadth of canopy, such that the zone can reflect maximum tree height.
 - Clearance from bridge deck to conductor must be at least 8.1m and from other physical infrastructure on bridge to conductor 5.3m. SEW do not anticipate that handrails or lights to be greater than the 2.8m difference. Thus provided 8.1m clearance is achieved this is satisfactory.
 - Exclusion zone of 32m and Maintenance zone at 50m shown around pylons is generic zone as per NG proposal. Exact size and extent will be advised by NG to account for physical obstruction and minimum required access and working space.
 - The clearance zone is for maximum permissible tree height and does not represent tree heights attained between maintenance activity periods when trees will be substantially lowered to allow for growth within agreed maintenance scheduled frequency.
 - Clearance zone B (falling trees) shown to maximum height of 40m above ground level to reflect maximum height of tree species proposed (e.g. Oak).
 - The tables give distances at different points along the cross section. The minimum distance from the finished ground surface to the clearance zone may be less than the lowest value shown in the table.

- KEY:
- Excavation for 36mAOD TWL
 - Existing Ground
 - Primary Dam
 - RCP Overhead Line
 - Lidar Ground Level
 - Ground Level based on SEW contours
 - 36mAOD TWL Reservoir
 - Clearance Zone A (36mAOD TWL Reservoir)
 - Clearance Zone B (36mAOD TWL Reservoir)

0	07-09-2016	FINAL DRAFT FOR AGREEMENT WITH NG	PS	CF	JDG	AJS
Rev	Revision Date	Purpose of revision	Drawn	Checked	Reviewed	App'd



1100 Salsford Road, Wivernish, Westingham, NG24 5TU
Tel: +44(0)115 945 7000 Fax: +44(0)115 945 7001 www.jacobs.com

Project: BROAD OAK RESERVOIR

Drawing title: SECTIONS F-F & G-G FOR 36mAOD RESERVOIR SCHEME

Drawing status: DRAFT

Scale: 1:500 @ A1 Do not scale

Drawing number: B14000AT-605 Rev: 0

The drawing is not to be used in whole or part other than for the intended purpose and project as defined on this drawing. Refer to the contract for full terms and conditions.

