



Triton Knoll Offshore Wind Farm Limited Triton Knoll Electrical System

.....

**Appendix 6: Slides presented at
hearings on the 19th and 21st
January 2016**

Date: 01 February 2016

**Appendix 6 of the Applicant's
response to Deadline 5**



TK Electrical System Hearings



Figure 6 *Indicative Trenched 132kV Cable Circuit Plan - Addendum A- Further detail regarding the TKES corridor (Appendix 29, Part 2 of the Applicant's response to Deadline 4 [REP4-057])*

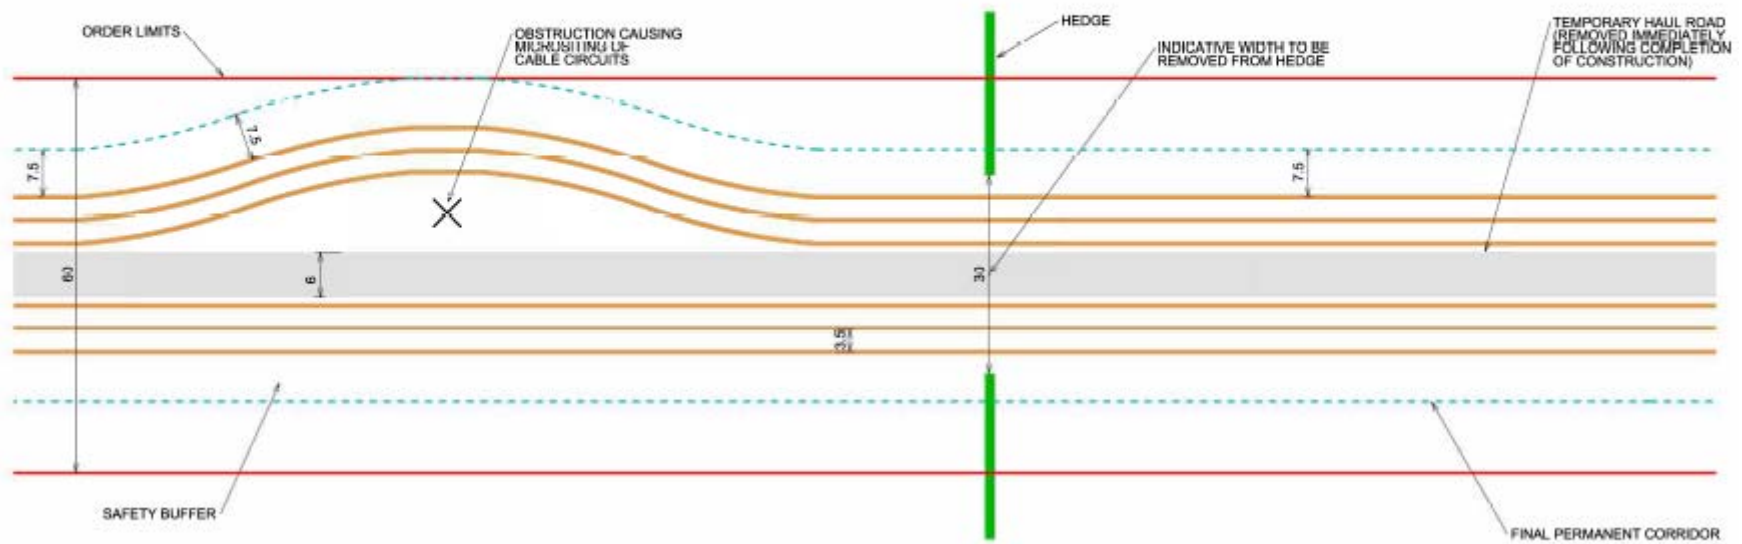


Figure 8 Indicative Trenched 132kV Cable Circuit Plan where drain or small road is crossed - Addendum A- Further detail regarding the TKES corridor (Appendix 29, Part C of the Applicant's response to Deadline 4 [REP4-057])

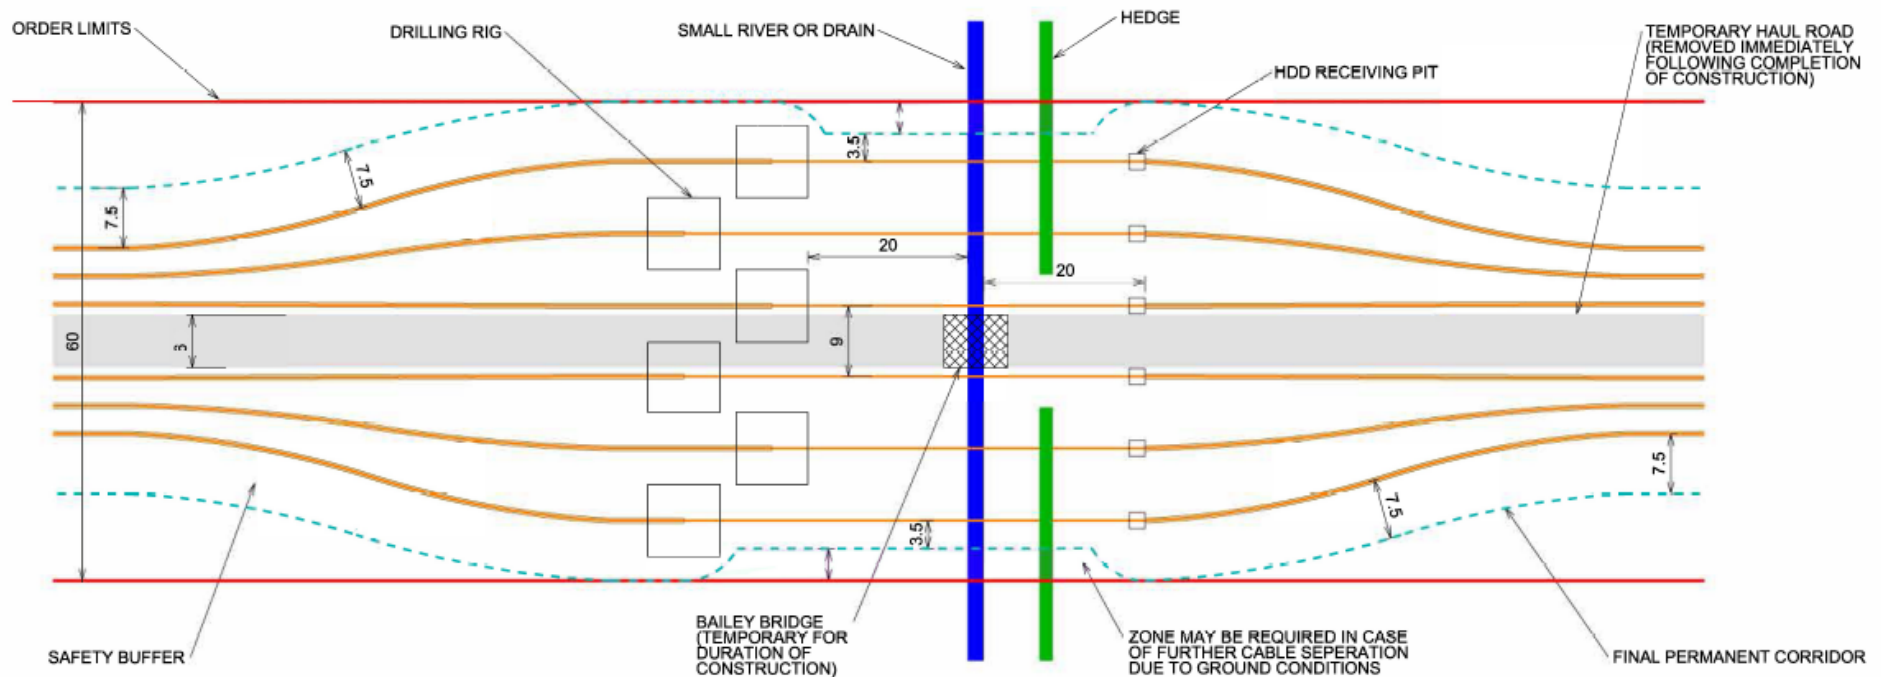


Figure 10 Indicative Trenched 132kV Cable Circuit Plan where large road is crossed –
 Addendum A- Further detail regarding the TKES corridor
 (Appendix 29, Part C of the Applicant’s response to Deadline 4 [REP4-058])

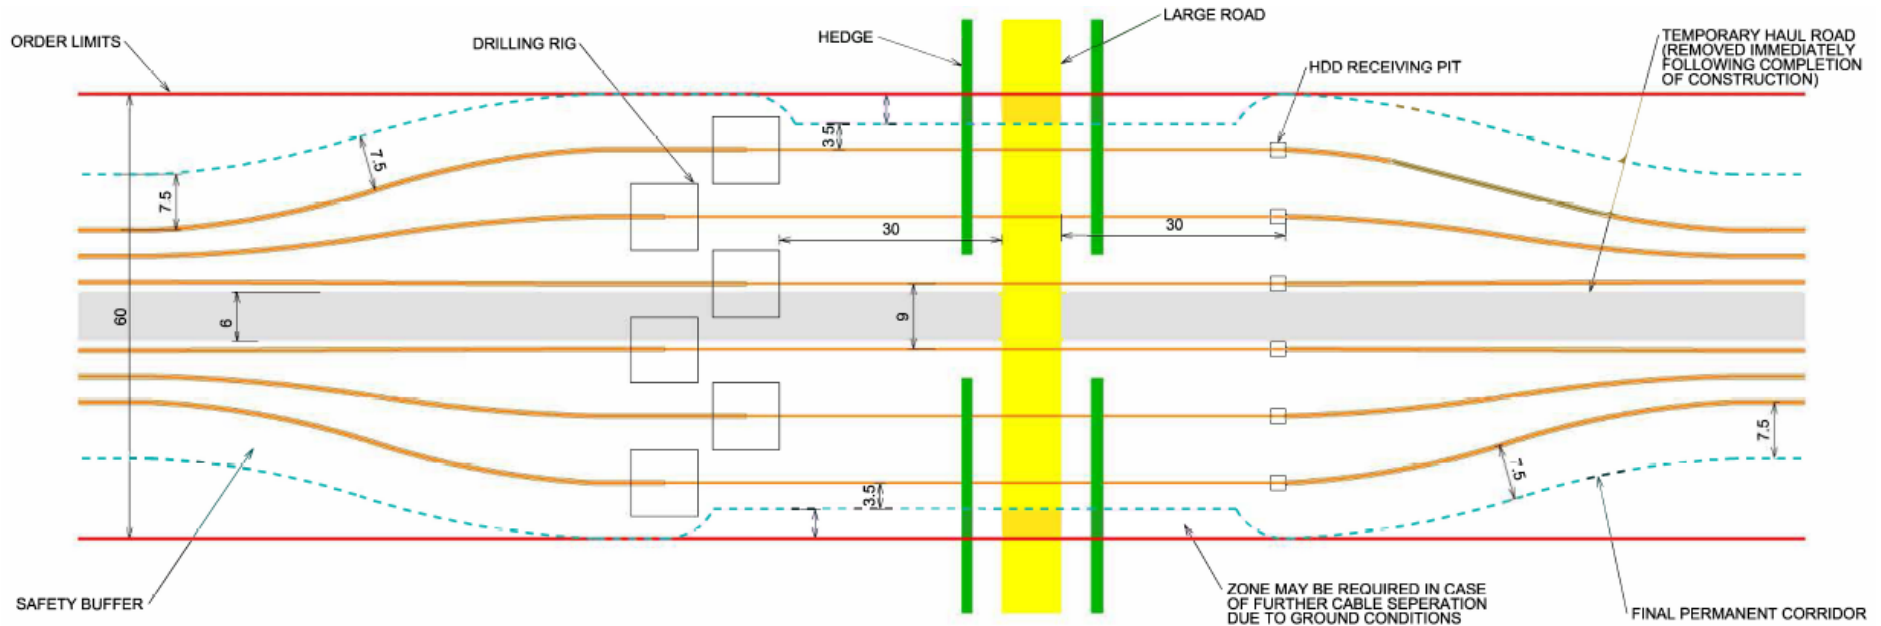


Figure 12 Indicative Trenched 132kV Cable Circuit Plan where very large obstacles are crossed -
 Addendum A- Further detail regarding the TKES corridor
 (Appendix 29, Part D of the Applicant’s response to Deadline 4 [REP4-059])

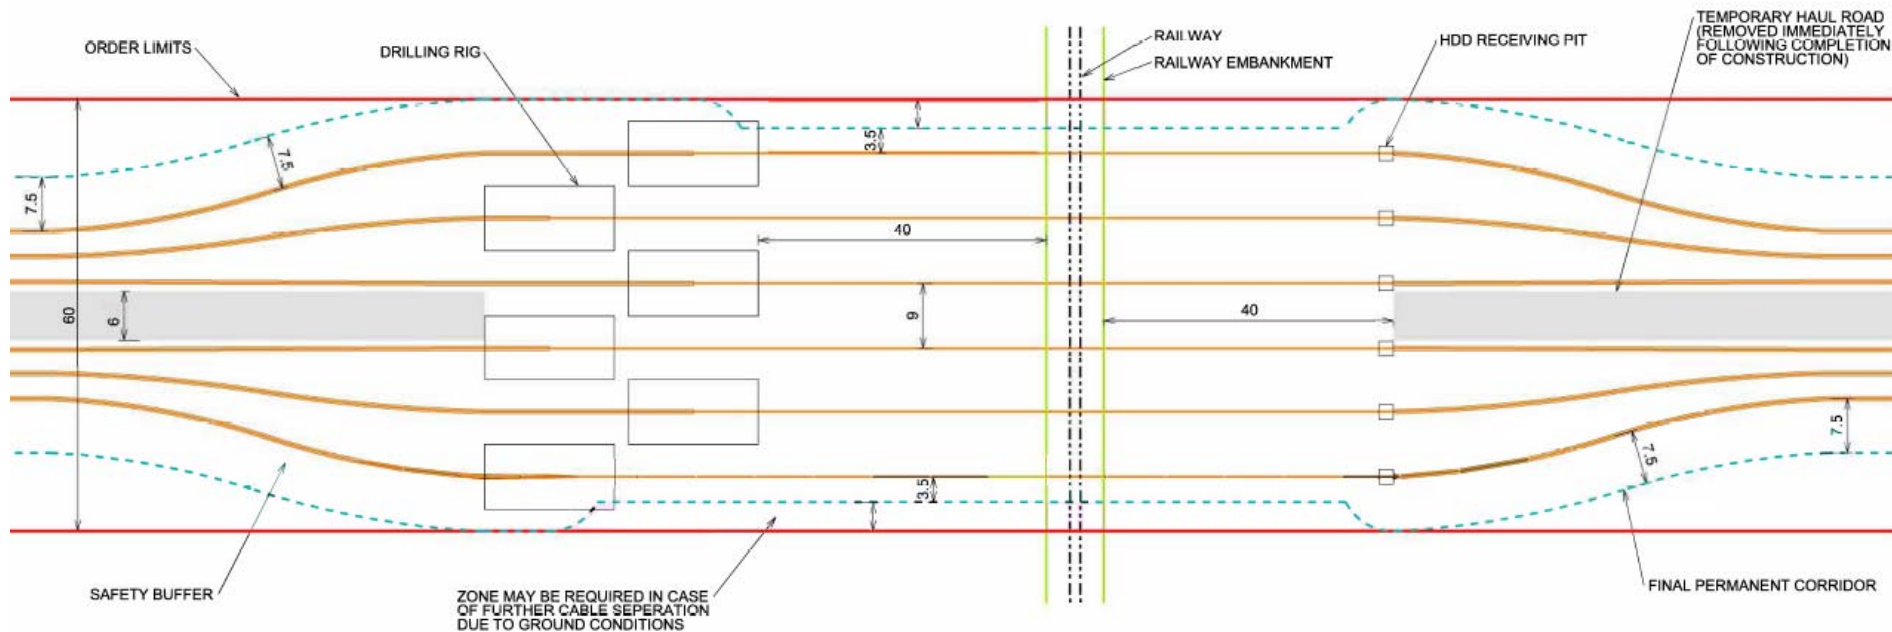


Figure 7-1 Intermediate Electrical Compound Landscape and Visual Mitigation Strategy - Outline Landscape Strategy and Ecological Management Plan
 (Application document reference 8.8 [APP-109])

