

# SP MANWEB



## **Reinforcement to the North Shropshire Electricity Distribution Network**

SP Manweb's Responses to S51 Advice and Comments on the S55 Checklist

Application Reference: EN020021

**Works Plans V7**

**Document reference 2.3.0 - 2.3.16**

---

**SP MANWEB**


**Reinforcement to the North Shropshire Electricity  
Distribution Network**

**Works Plans V7**

**PINS Reference EN020021**

**QA Box**

<b>Author</b>		<b>SP Manweb</b>	
<b>Planning Inspectorate Application Reference APP-007</b>		<b>EN020021</b>	
<b>Date</b>			
<b>Date</b>	<b>Version</b>	<b>Status</b>	<b>Description/Changes</b>
06/03/2019	7	Final	Works Plans ( <b>DCO Documents 2.3.0 – 2.3.16</b> (APP-007)) updated in response to S51 Advice / S55 checklist comments from PINS 10/12/18  Submitted to PINS

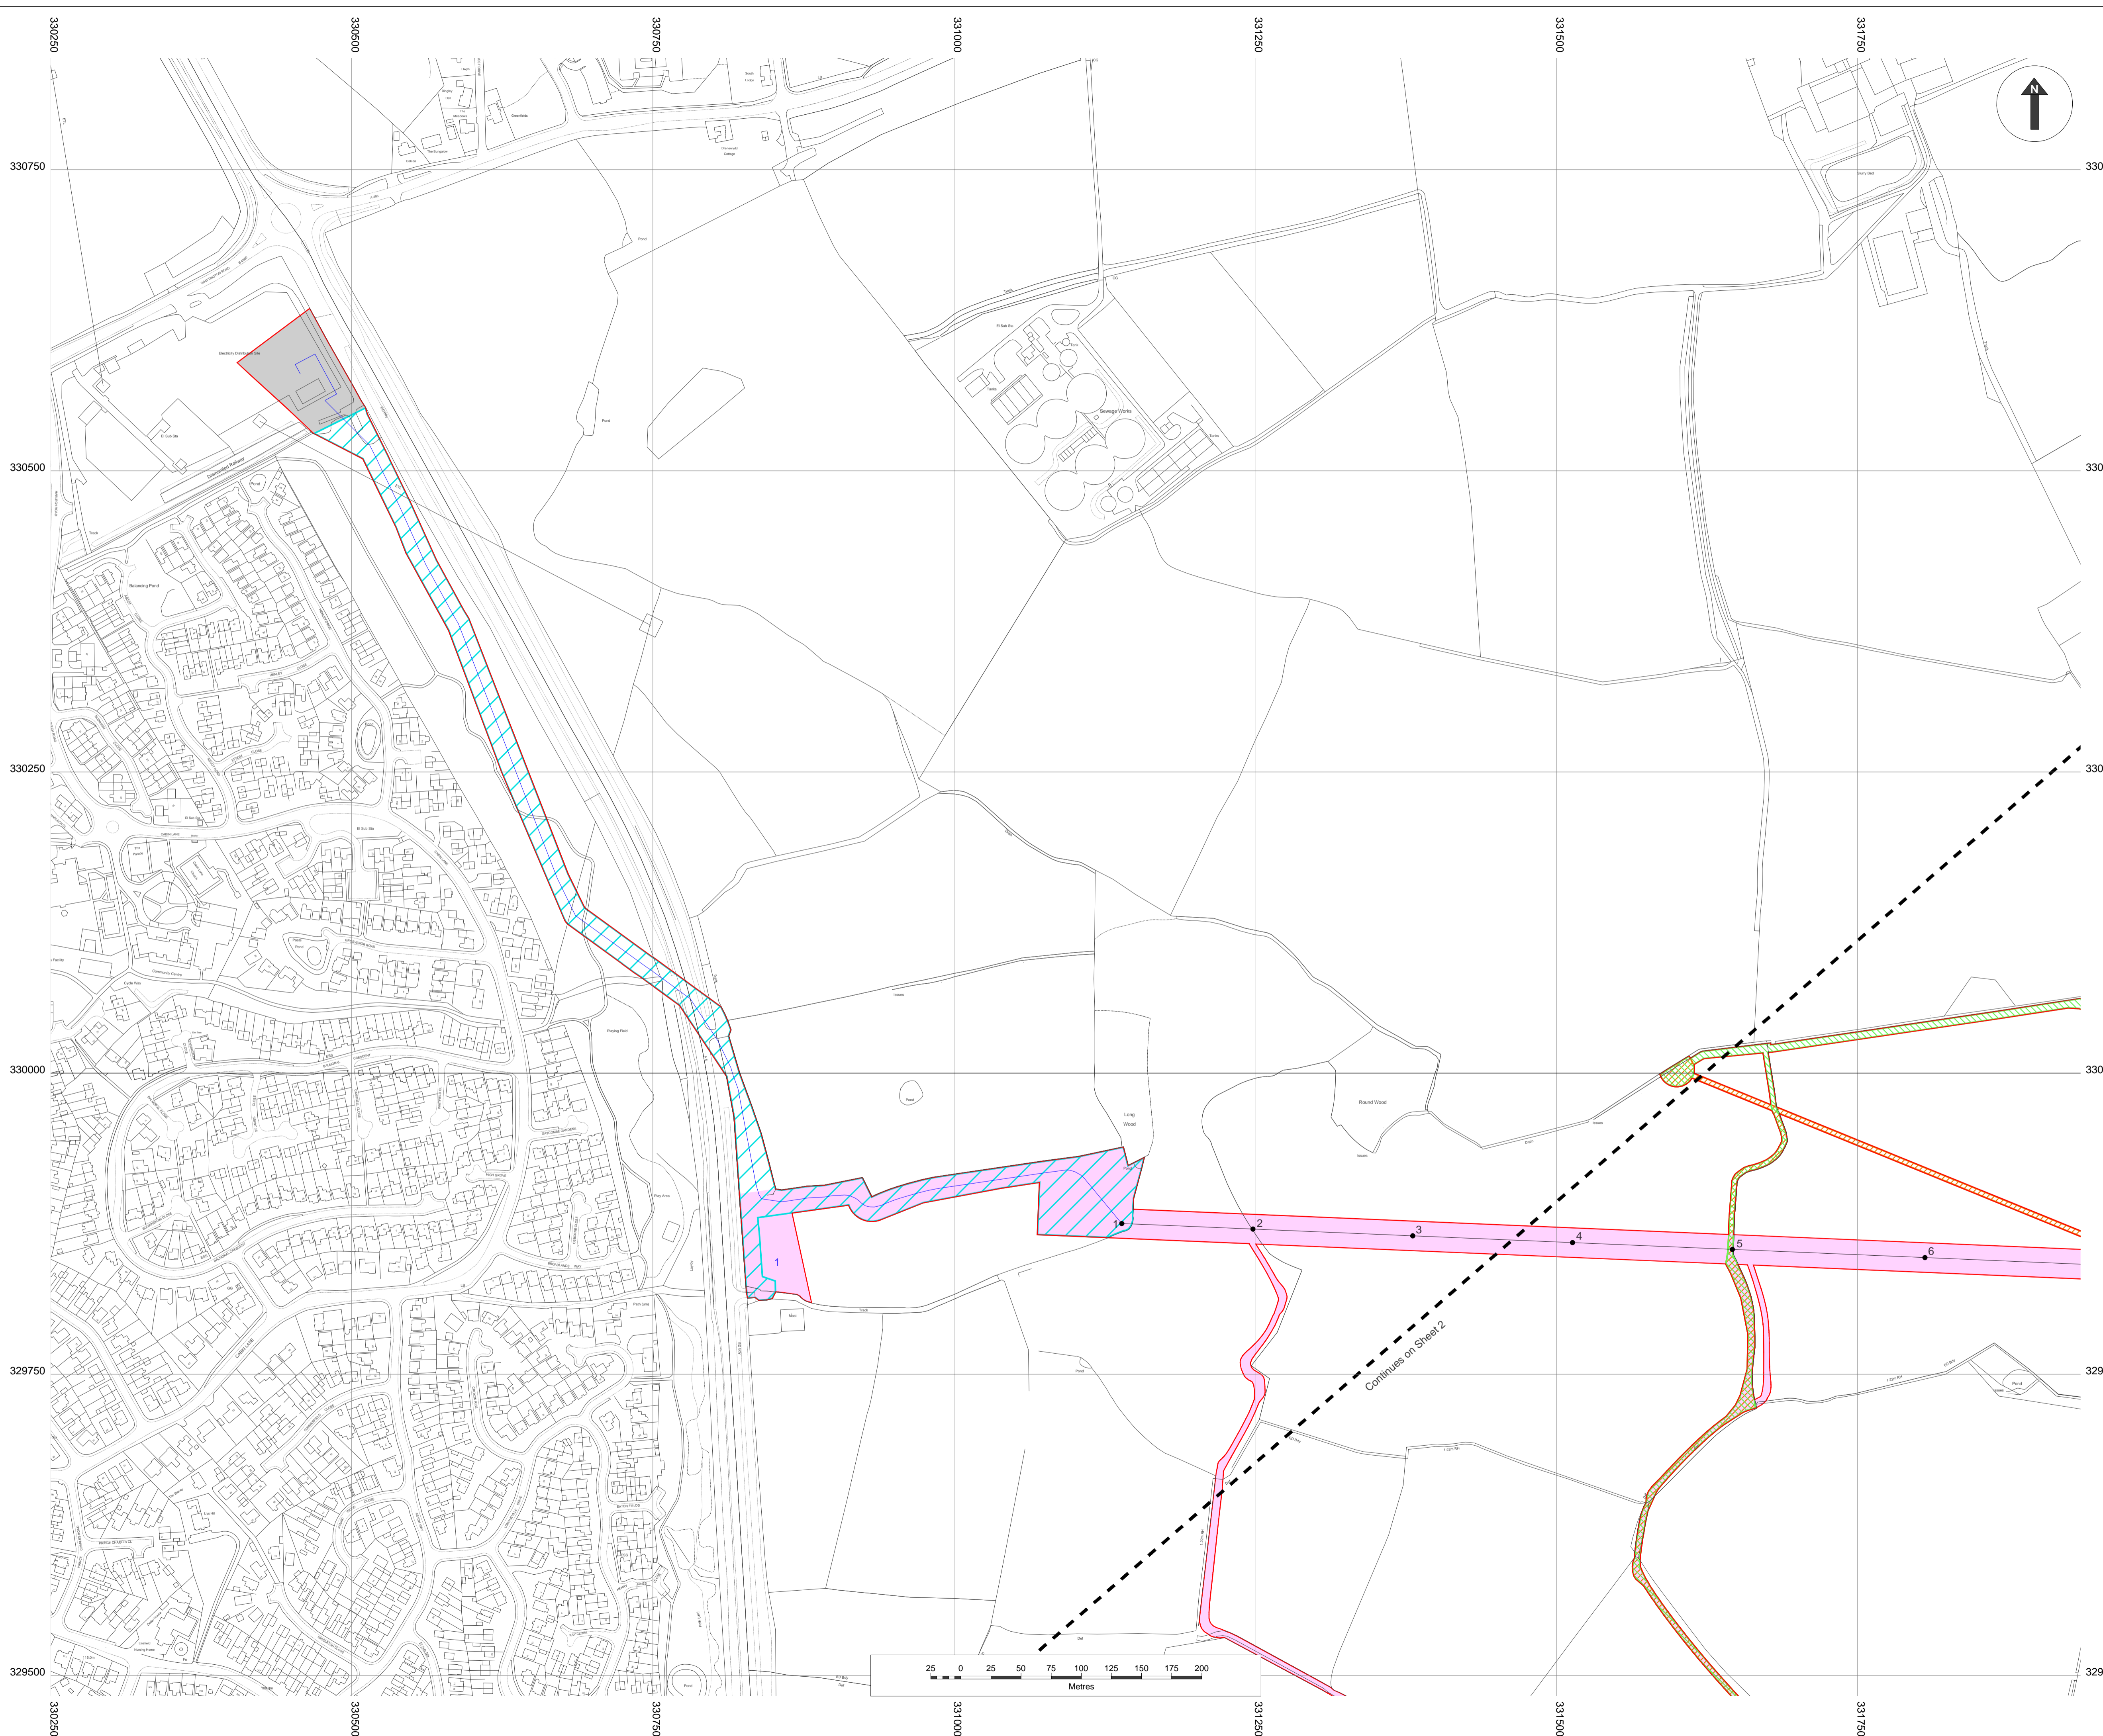

© Crown copyright. All rights reserved.  
2017 Licence number 100019036

- Legend:**
- Land required for, or affected by, the authorised development (the Order Limits)
  - Centre Line of numbered works 3 and indicative pole locations
  - Centre Line of numbered works 2
  - Works No. 1 (Works at Oswestry substation)
  - Works No. 2 (Construction and installation and keeping of a 132kV underground cable and fibre optic cable 1.2km in length)
  - Works No. 3 (Construction and installation and of an 132kV overhead electric line and including laydown areas numbered)
  - Works No. 4a (Removal of existing 11kV and 33kV overhead lines)
  - Works No. 4b (Undergrounding of 11kV and 33kV cables)
  - Works No. 5 (Works at Wem substation)
  - Works No. 2 and 3
  - Works No. 3 and 4a
  - Works No. 3 and 4b
  - Works No. 3 and 4a and 4b
  - Works No. 4a and 4b

- Notes:**
1. The Legend is identical on all sheets of the Works Plans and therefore not all items detailed in the Legend are represented on each sheet.
  2. Poles (indicated by number) are not shown to scale. Numbered poles may move up to 5 metres in any direction from their indicative location but may not be sited within 1 metre from the outside edge of any hedgerow. This is referred to as the 'Limit of Deviation' as set out in Requirement 4 to the draft DCO.
  3. Laydown areas are numbered in blue.

Created by:  
TerraQuest Solutions Limited  
Quayside Tower  
252-260 Broad Street  
Birmingham  
B1 2HF  
w: [www.terraquest.co.uk](http://www.terraquest.co.uk)  
e: [info@terraquest.co.uk](mailto:info@terraquest.co.uk)





**TerraQuest**  
Business & Property Solutions  
A Meas Group plc Company

Created for:  
SP Manweb plc  
3 Prenton Way  
North Cheshire Trading Estate  
Prenton  
CH43 3ET  
w: [www.scottishpower.com](http://www.scottishpower.com)

**Title:**  
Reinforcement to North Shropshire Electricity  
Distribution Network Order 201X  
Works Plan (Sheet 1 of 16)  
Document 2.3.1  
Regulation 5(2)(j)

<b>Scale:</b> 1:2,500@A1	<b>Date:</b> February 2019
<b>Drawing No:</b> Sheet 1 of 16	<b>Revision:</b> v5.0
<b>Approved By:</b> AME	<b>Checked By:</b> ABR
	<b>Drawn By:</b> LME

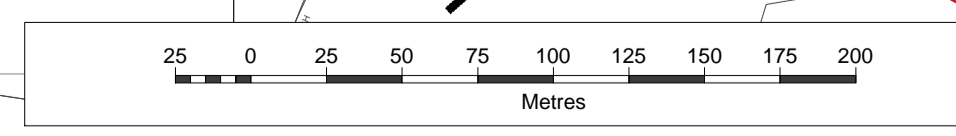

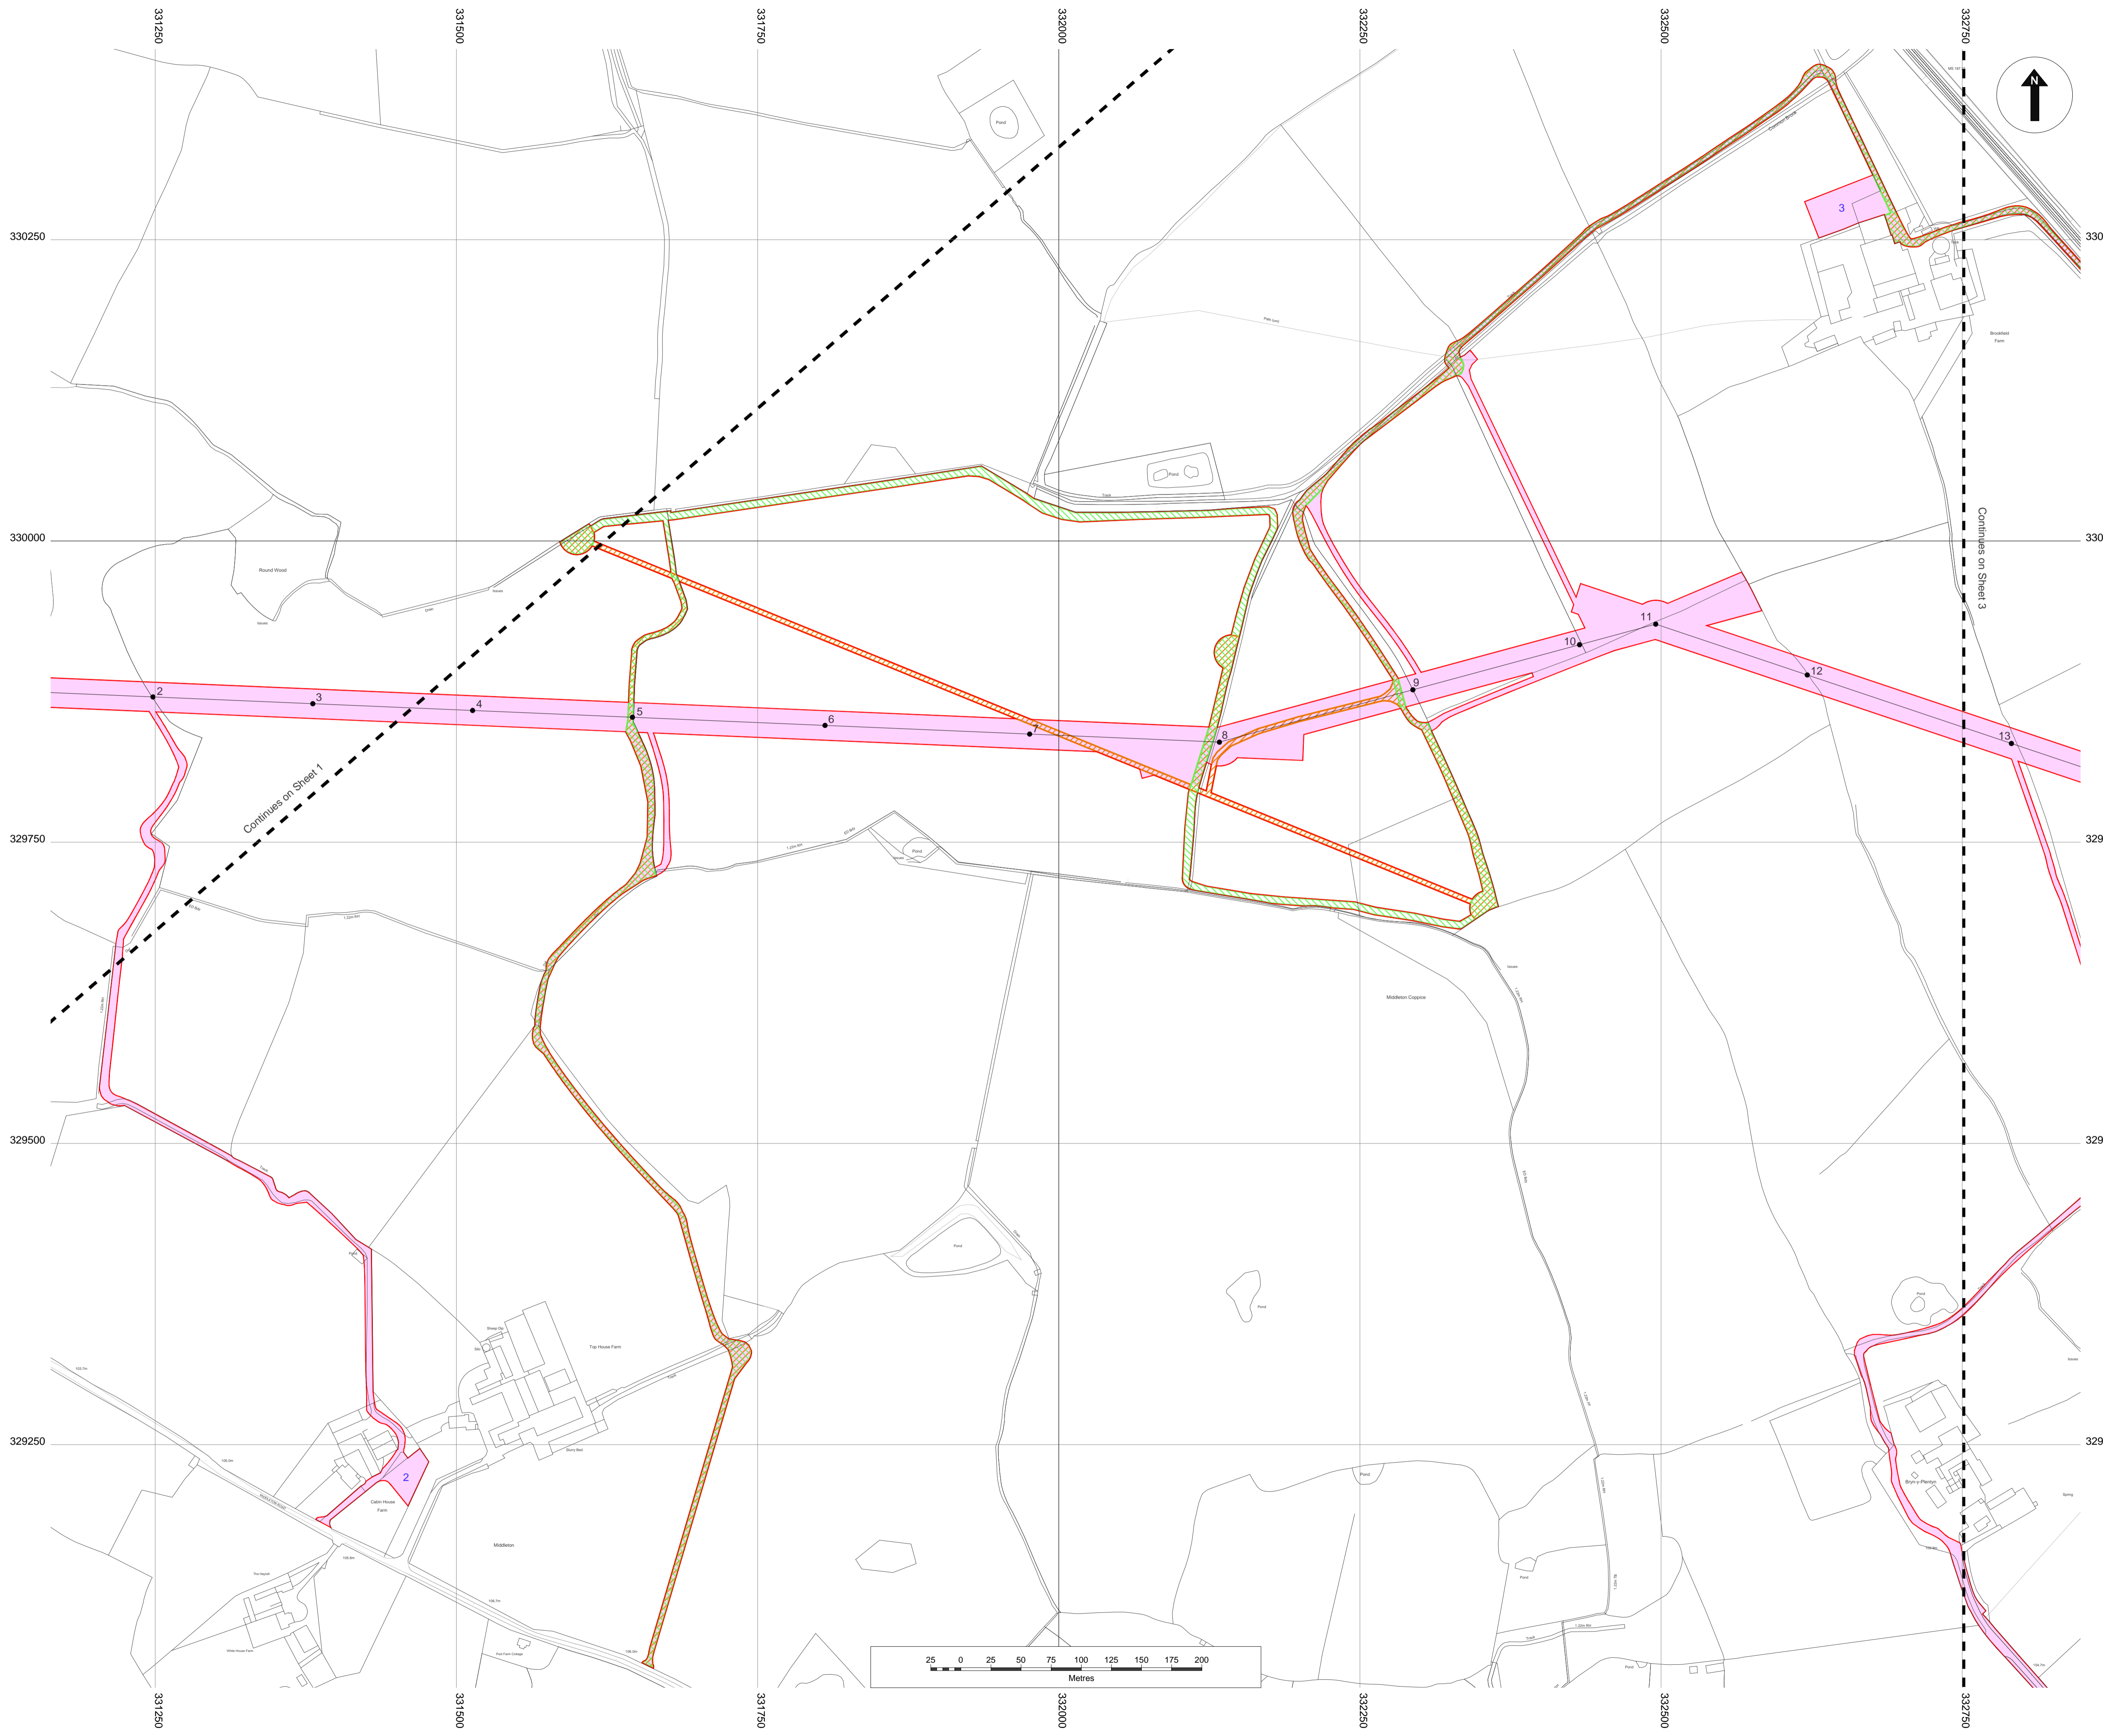

© Crown copyright. All rights reserved.  
2017 Licence number 100019036

- Legend:**
- Land required for, or affected by, the authorised development (the Order Limits)
  - Centre Line of numbered works 3 and indicative pole locations
  - Centre Line of numbered works 2
  - Works No. 1 (Works at Oswestry substation)
  - Works No. 2 (Construction and installation and keeping of a 132kV underground cable and fibre optic cable 1.2km in length)
  - Works No. 3 (Construction and installation and of an 132kV overhead electric line and including laydown areas numbered)
  - Works No. 4a (Removal of existing 11kV and 33kV overhead lines)
  - Works No. 4b (Undergrounding of 11kV and 33kV cables)
  - Works No. 5 (Works at Wem substation)
  - Works No. 2 and 3
  - Works No. 3 and 4a
  - Works No. 3 and 4b
  - Works No. 3 and 4a and 4b
  - Works No. 4a and 4b

- Notes:**
1. The Legend is identical on all sheets of the Works Plans and therefore not all items detailed in the Legend are represented on each sheet.
  2. Poles (indicated by number) are not shown to scale. Numbered poles may move up to 5 metres in any direction from their indicative location but may not be sited within 1 metre from the outside edge of any hedgerow. This is referred to as the 'Limit of Deviation' as set out in Requirement 4 to the draft DCO.
  3. Laydown areas are numbered in blue.

Created by:  
TerraQuest Solutions Limited  
Quayside Tower  
252-260 Broad Street  
Birmingham  
B1 2HF  
w: [www.terraquest.co.uk](http://www.terraquest.co.uk)  
e: [info@terraquest.co.uk](mailto:info@terraquest.co.uk)





**TerraQuest**  
Business & Property Solutions  
A Mears Group plc Company

Created for:  
SP Manweb plc  
3 Prenton Way  
North Cheshire Trading Estate  
Prenton  
CH43 3ET  
w: [www.scottishpower.com](http://www.scottishpower.com)

Title:  
Reinforcement to North Shropshire Electricity  
Distribution Network Order 201X  
Works Plan (Sheet 2 of 16)  
Document 2.3.2  
Regulation 5(2)(j)

Scale: 1:2,500@A1	Date: February 2019
Drawing No: Sheet 2 of 16	Revision: v5.0
Approved By: AME	Checked By: ABR
	Drawn By: LME

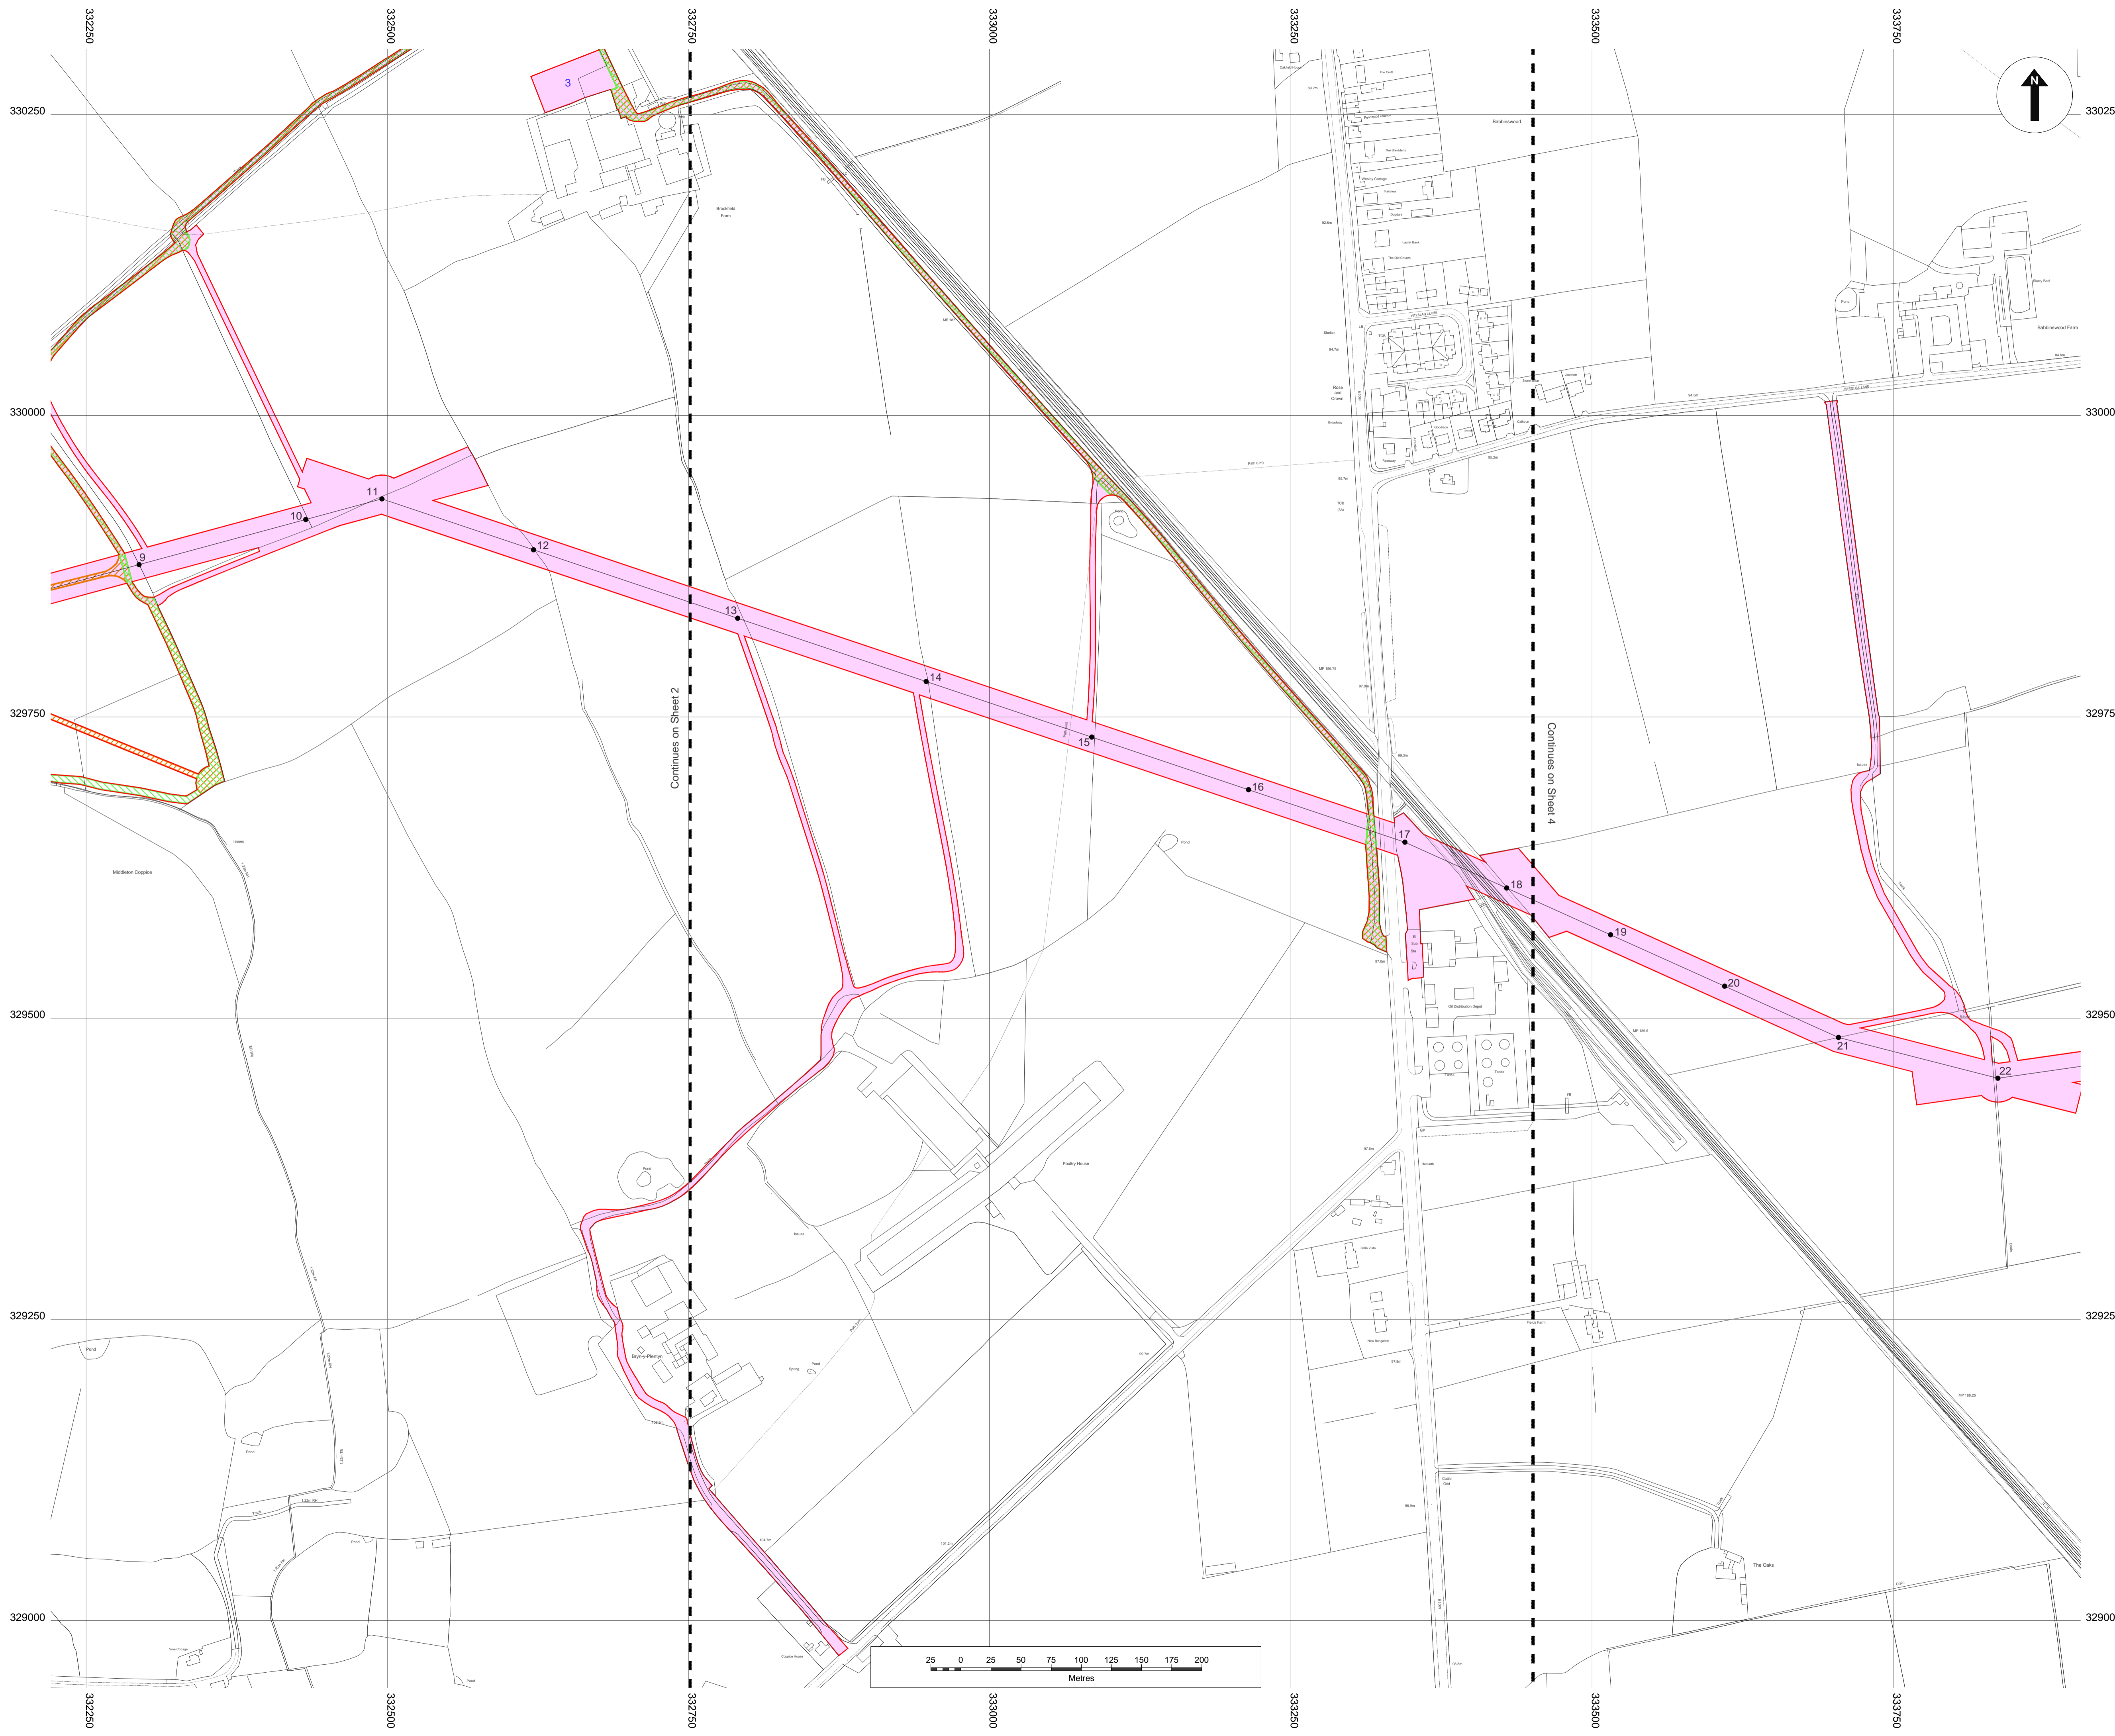

© Crown copyright. All rights reserved.  
2017 Licence number 100019036

- Legend:**
- Land required for, or affected by, the authorised development (the Order Limits)
  - Centre Line of numbered works 3 and indicative pole locations
  - Centre Line of numbered works 2
  - Works No. 1 (Works at Oswestry substation)
  - Works No. 2 (Construction and installation and keeping of a 132kV underground cable and fibre optic cable 1.2km in length)
  - Works No. 3 (Construction and installation of an 132kV overhead electric line and including laydown areas numbered)
  - Works No. 4a (Removal of existing 11kV and 33kV overhead lines)
  - Works No. 4b (Undergrounding of 11kV and 33kV cables)
  - Works No. 5 (Works at Wem substation)
  - Works No. 2 and 3
  - Works No. 3 and 4a
  - Works No. 3 and 4b
  - Works No. 3 and 4a and 4b
  - Works No. 4a and 4b

- Notes:**
1. The Legend is identical on all sheets of the Works Plans and therefore not all items detailed in the Legend are represented on each sheet.
  2. Poles (indicated by number) are not shown to scale. Numbered poles may move up to 5 metres in any direction from their indicative location but may not be sited within 1 metre from the outside edge of any hedgerow. This is referred to as the 'Limit of Deviation' as set out in Requirement 4 to the draft DCO.
  3. Laydown areas are numbered in blue.

Created by:  
TerraQuest Solutions Limited  
Quayside Tower  
252-260 Broad Street  
Birmingham  
B1 2HF  
w: [www.terraquest.co.uk](http://www.terraquest.co.uk)  
e: [info@terraquest.co.uk](mailto:info@terraquest.co.uk)




**TerraQuest**  
Business & Property Solutions  
A Mears Group plc Company

Created for:  
SP Manweb plc  
3 Prenton Way  
North Cheshire Trading Estate  
Prenton  
CH43 3ET  
w: [www.scottishpower.com](http://www.scottishpower.com)

**Title:**  
Reinforcement to North Shropshire Electricity  
Distribution Network Order 201X  
Works Plan (Sheet 3 of 16)  
Document 2.3.3  
Regulation 5(2)(j)

<b>Scale:</b> 1:2,500@A1	<b>Date:</b> February 2019
<b>Drawing No:</b> Sheet 3 of 16	<b>Revision:</b> v5.0
<b>Approved By:</b> AME	<b>Checked By:</b> ABR
	<b>Drawn By:</b> LME

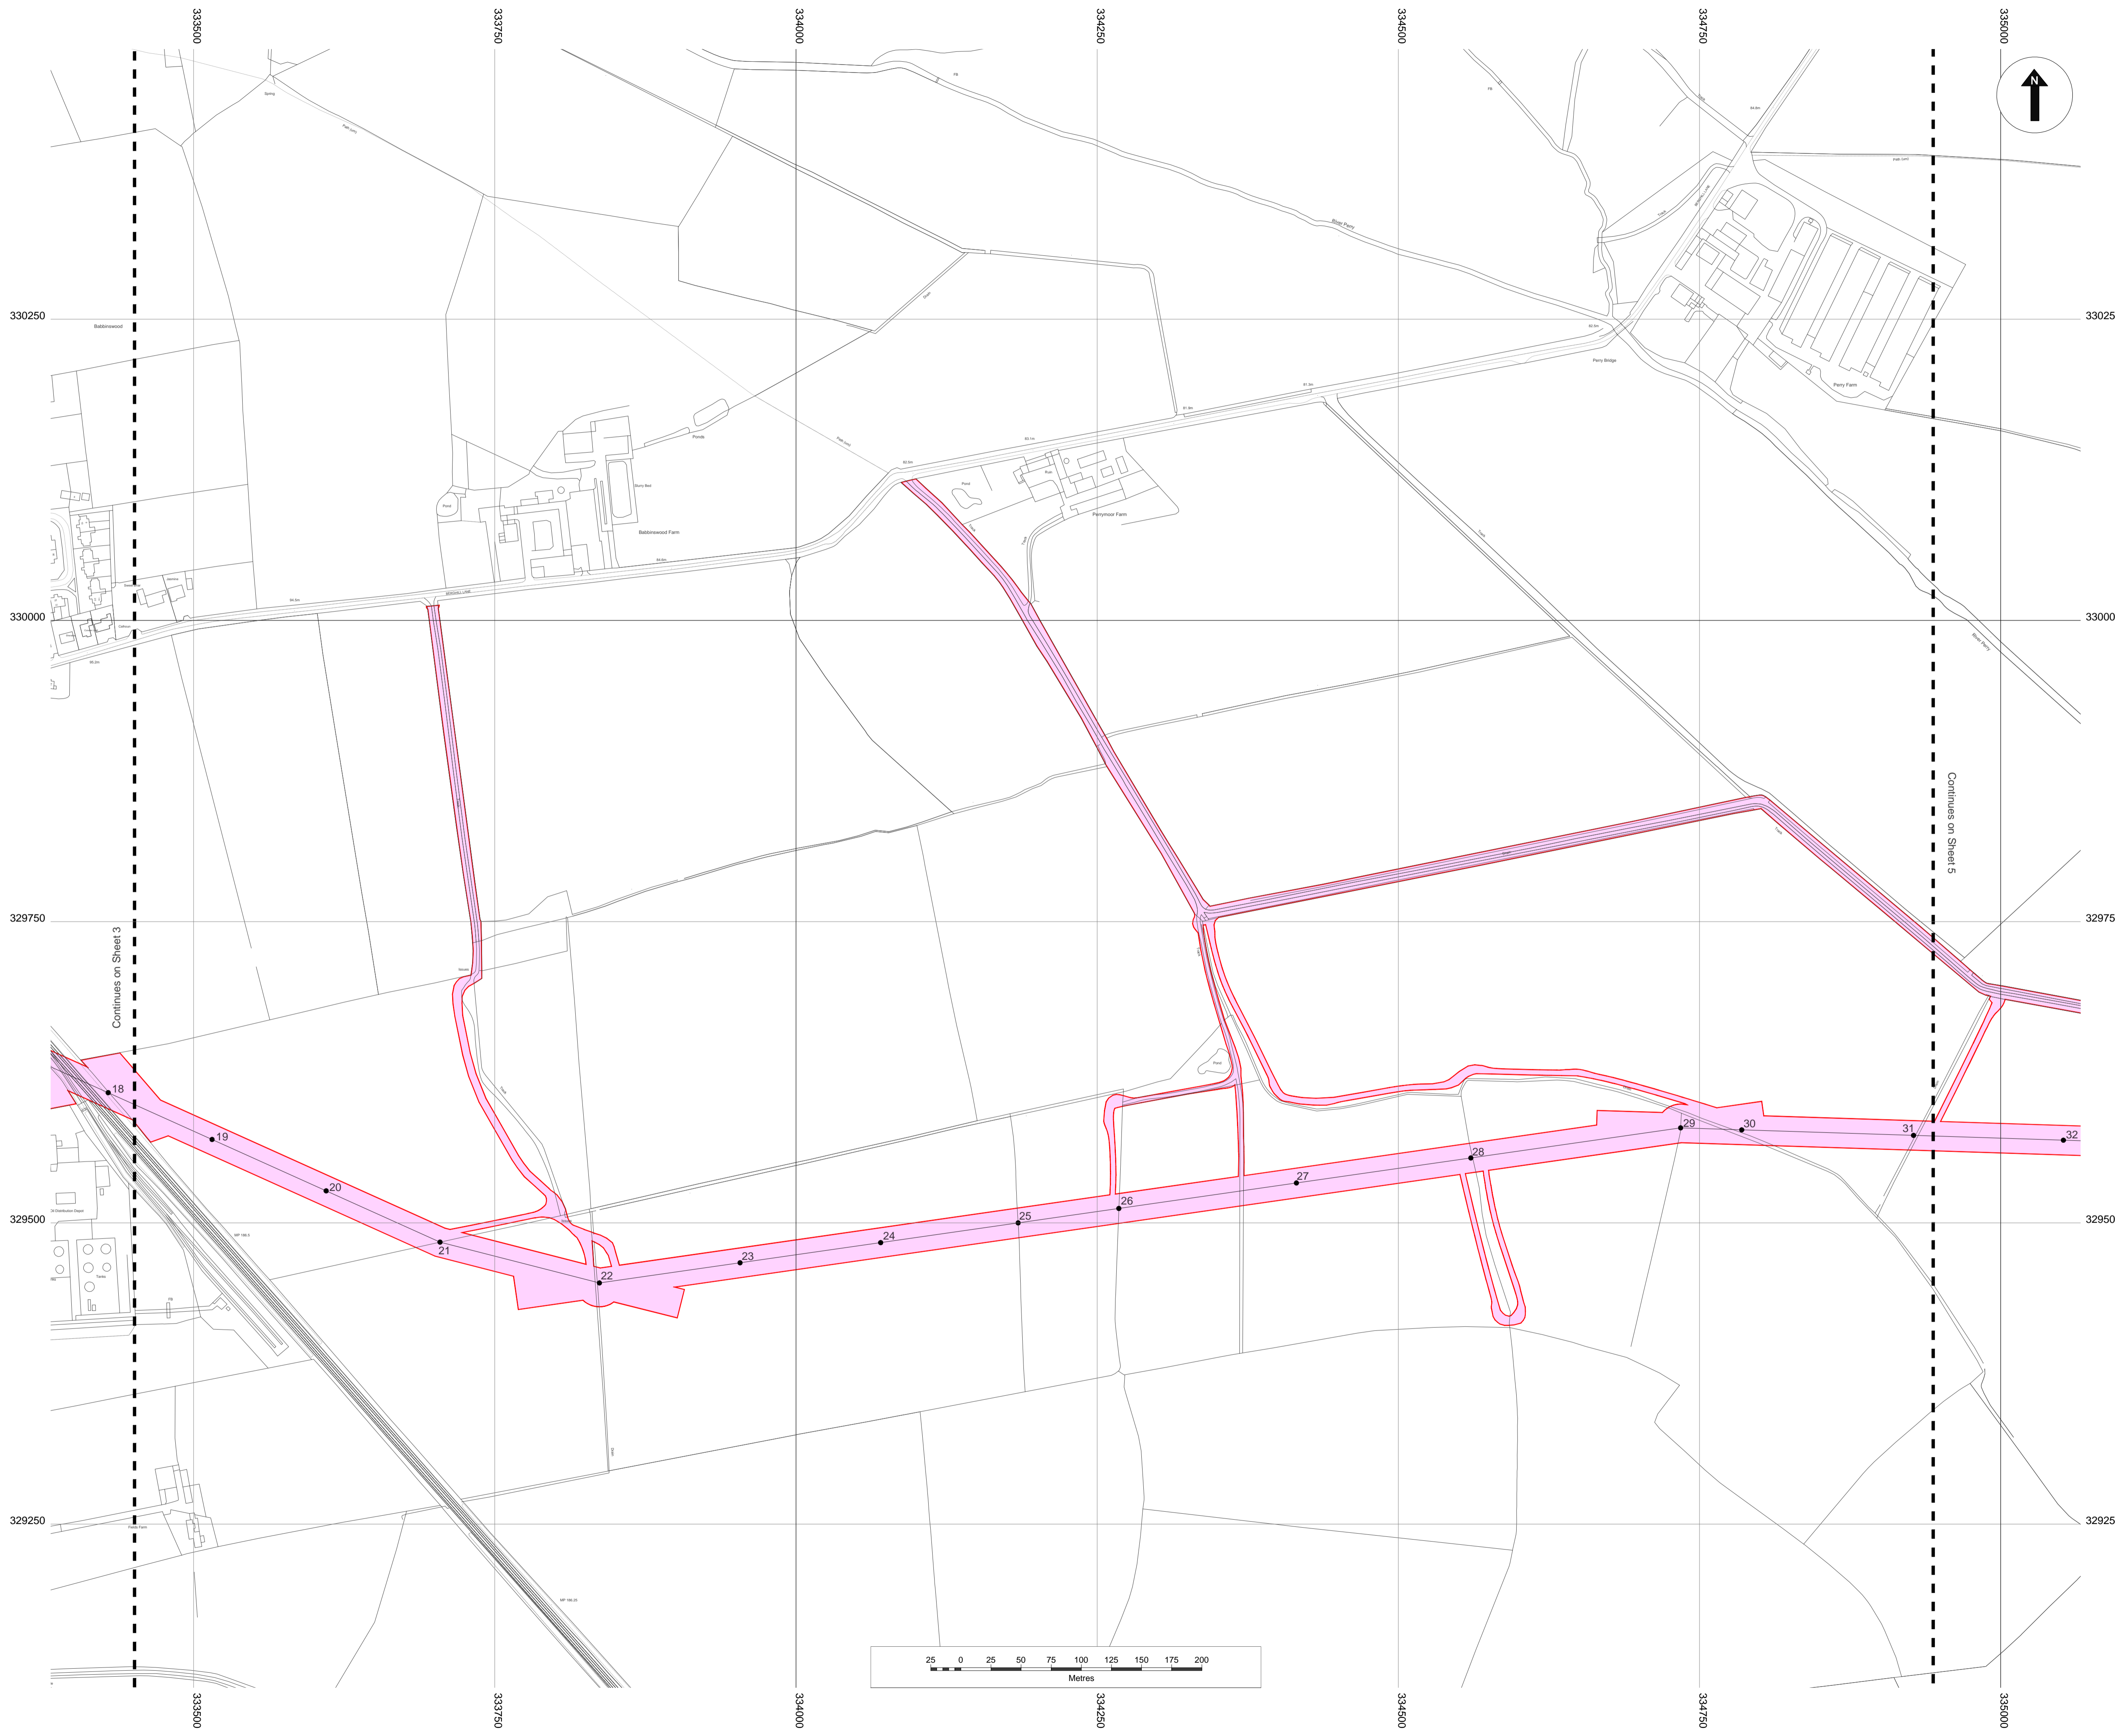

© Crown copyright. All rights reserved.  
2017 Licence number 100019036

- Legend:**
- Land required for, or affected by, the authorised development (the Order Limits)
  - Centre Line of numbered works 3 and indicative pole locations
  - Centre Line of numbered works 2
  - Works No. 1 (Works at Oswestry substation)
  - Works No. 2 (Construction and installation and keeping of a 132kV underground cable and fibre optic cable 1.2km in length)
  - Works No. 3 (Construction and installation of an 132kV overhead electric line and including laydown areas numbered)
  - Works No. 4a (Removal of existing 11kV and 33kV overhead lines)
  - Works No. 4b (Undergrounding of 11kV and 33kV cables)
  - Works No. 5 (Works at Wem substation)
  - Works No. 2 and 3
  - Works No. 3 and 4a
  - Works No. 3 and 4b
  - Works No. 3 and 4a and 4b
  - Works No. 4a and 4b

- Notes:**
1. The Legend is identical on all sheets of the Works Plans and therefore not all items detailed in the Legend are represented on each sheet.
  2. Poles (indicated by number) are not shown to scale. Numbered poles may move up to 5 metres in any direction from their indicative location but may not be sited within 1 metre from the outside edge of any hedgerow. This is referred to as the 'Limit of Deviation' as set out in Requirement 4 to the draft DCO.
  3. Laydown areas are numbered in blue.

Created by:  
TerraQuest Solutions Limited  
Quayside Tower  
252-260 Broad Street  
Birmingham  
B1 2HF  
w: [www.terraquest.co.uk](http://www.terraquest.co.uk)  
e: [info@terraquest.co.uk](mailto:info@terraquest.co.uk)





**TerraQuest**  
Business & Property Solutions  
A Mears Group plc Company

Created for:  
SP Manweb plc  
3 Prenton Way  
North Cheshire Trading Estate  
Prenton  
CH43 3ET  
w: [www.scottishpower.com](http://www.scottishpower.com)

Title:  
Reinforcement to North Shropshire Electricity  
Distribution Network Order 201X  
Works Plan (Sheet 4 of 16)  
Document 2.3.4  
Regulation 5(2)(j)

Scale: 1:2,500@A1	Date: February 2019	
Drawing No: Sheet 4 of 16	Revision: v5.0	
Approved By: AME	Checked By: ABR	Drawn By: LME

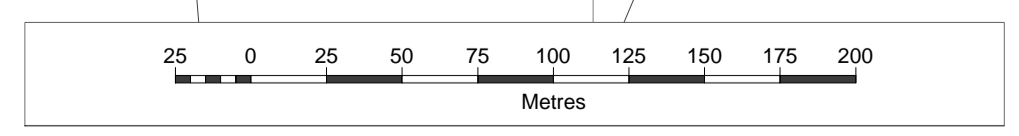

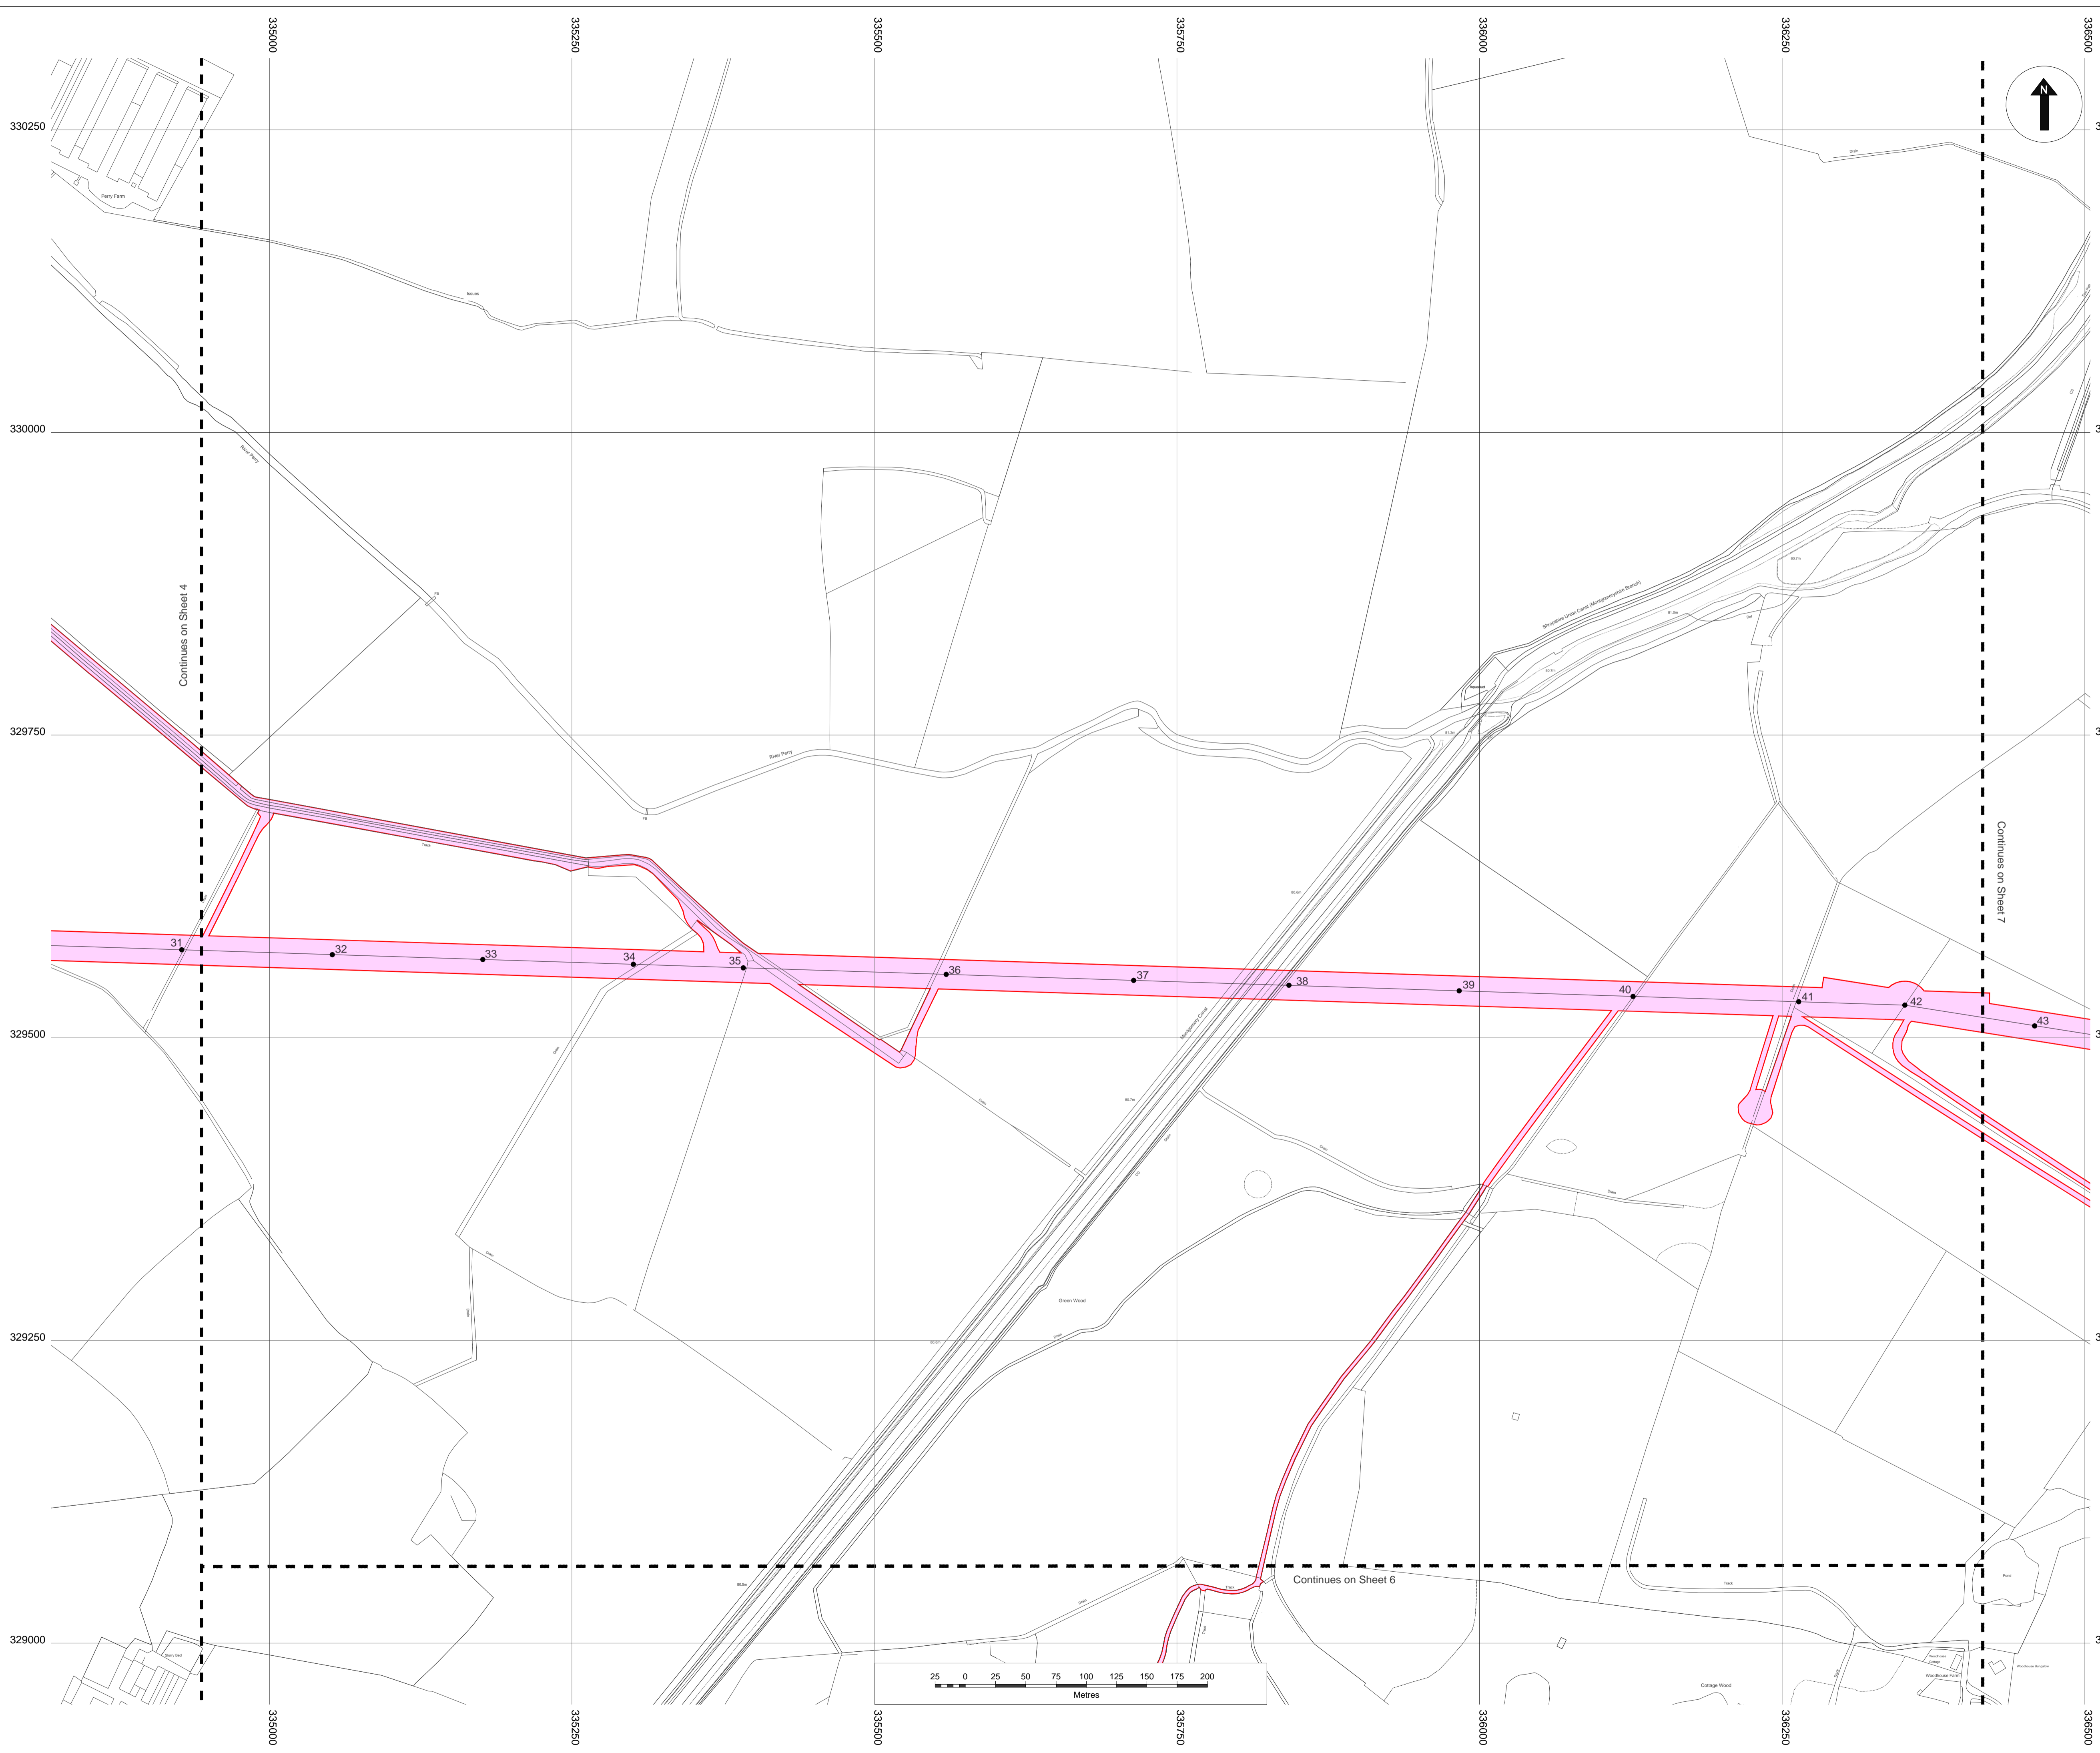

© Crown copyright. All rights reserved.  
2017 Licence number 100019036

- Legend:**
- Land required for, or affected by, the authorised development (the Order Limits)
  - Centre Line of numbered works 3 and indicative pole locations
  - Centre Line of numbered works 2
  - Works No. 1 (Works at Oswestry substation)
  - Works No. 2 (Construction and installation and keeping of a 132kV underground cable and fibre optic cable 1.2km in length)
  - Works No. 3 (Construction and installation of an 132kV overhead electric line and including laydown areas numbered)
  - Works No. 4a (Removal of existing 11kV and 33kV overhead lines)
  - Works No. 4b (Undergrounding of 11kV and 33kV cables)
  - Works No. 5 (Works at Wem substation)
  - Works No. 2 and 3
  - Works No. 3 and 4a
  - Works No. 3 and 4b
  - Works No. 3 and 4a and 4b
  - Works No. 4a and 4b

- Notes:**
1. The Legend is identical on all sheets of the Works Plans and therefore not all items detailed in the Legend are represented on each sheet.
  2. Poles (indicated by number) are not shown to scale. Numbered poles may move up to 5 metres in any direction from their indicative location but may not be sited within 1 metre from the outside edge of any hedgerow. This is referred to as the 'Limit of Deviation' as set out in Requirement 4 to the draft DCO.
  3. Laydown areas are numbered in blue.

Created by:  
TerraQuest Solutions Limited  
Quayside Tower  
252-260 Broad Street  
Birmingham  
B1 2HF  
w: [www.terraquest.co.uk](http://www.terraquest.co.uk)  
e: [info@terraquest.co.uk](mailto:info@terraquest.co.uk)




**TerraQuest**  
Business & Property Solutions  
A Mears Group plc Company



Created for:  
SP Manweb plc  
3 Prenton Way  
North Cheshire Trading Estate  
Prenton  
CH43 3ET  
w: [www.scottishpower.com](http://www.scottishpower.com)

Title:  
Reinforcement to North Shropshire Electricity  
Distribution Network Order 201X  
Works Plan (Sheet 5 of 16)  
Document 2.3.5  
Regulation 5(2)(j)

Scale: 1:2,500@A1	Date: February 2019	
Drawing No: Sheet 5 of 16	Revision: v5.0	
Approved By: AME	Checked By: ABR	Drawn By: LME

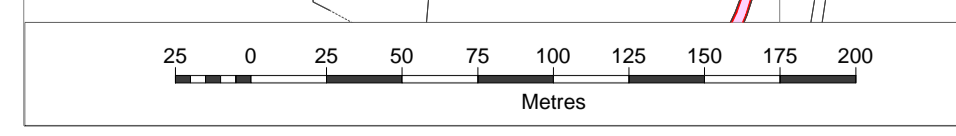



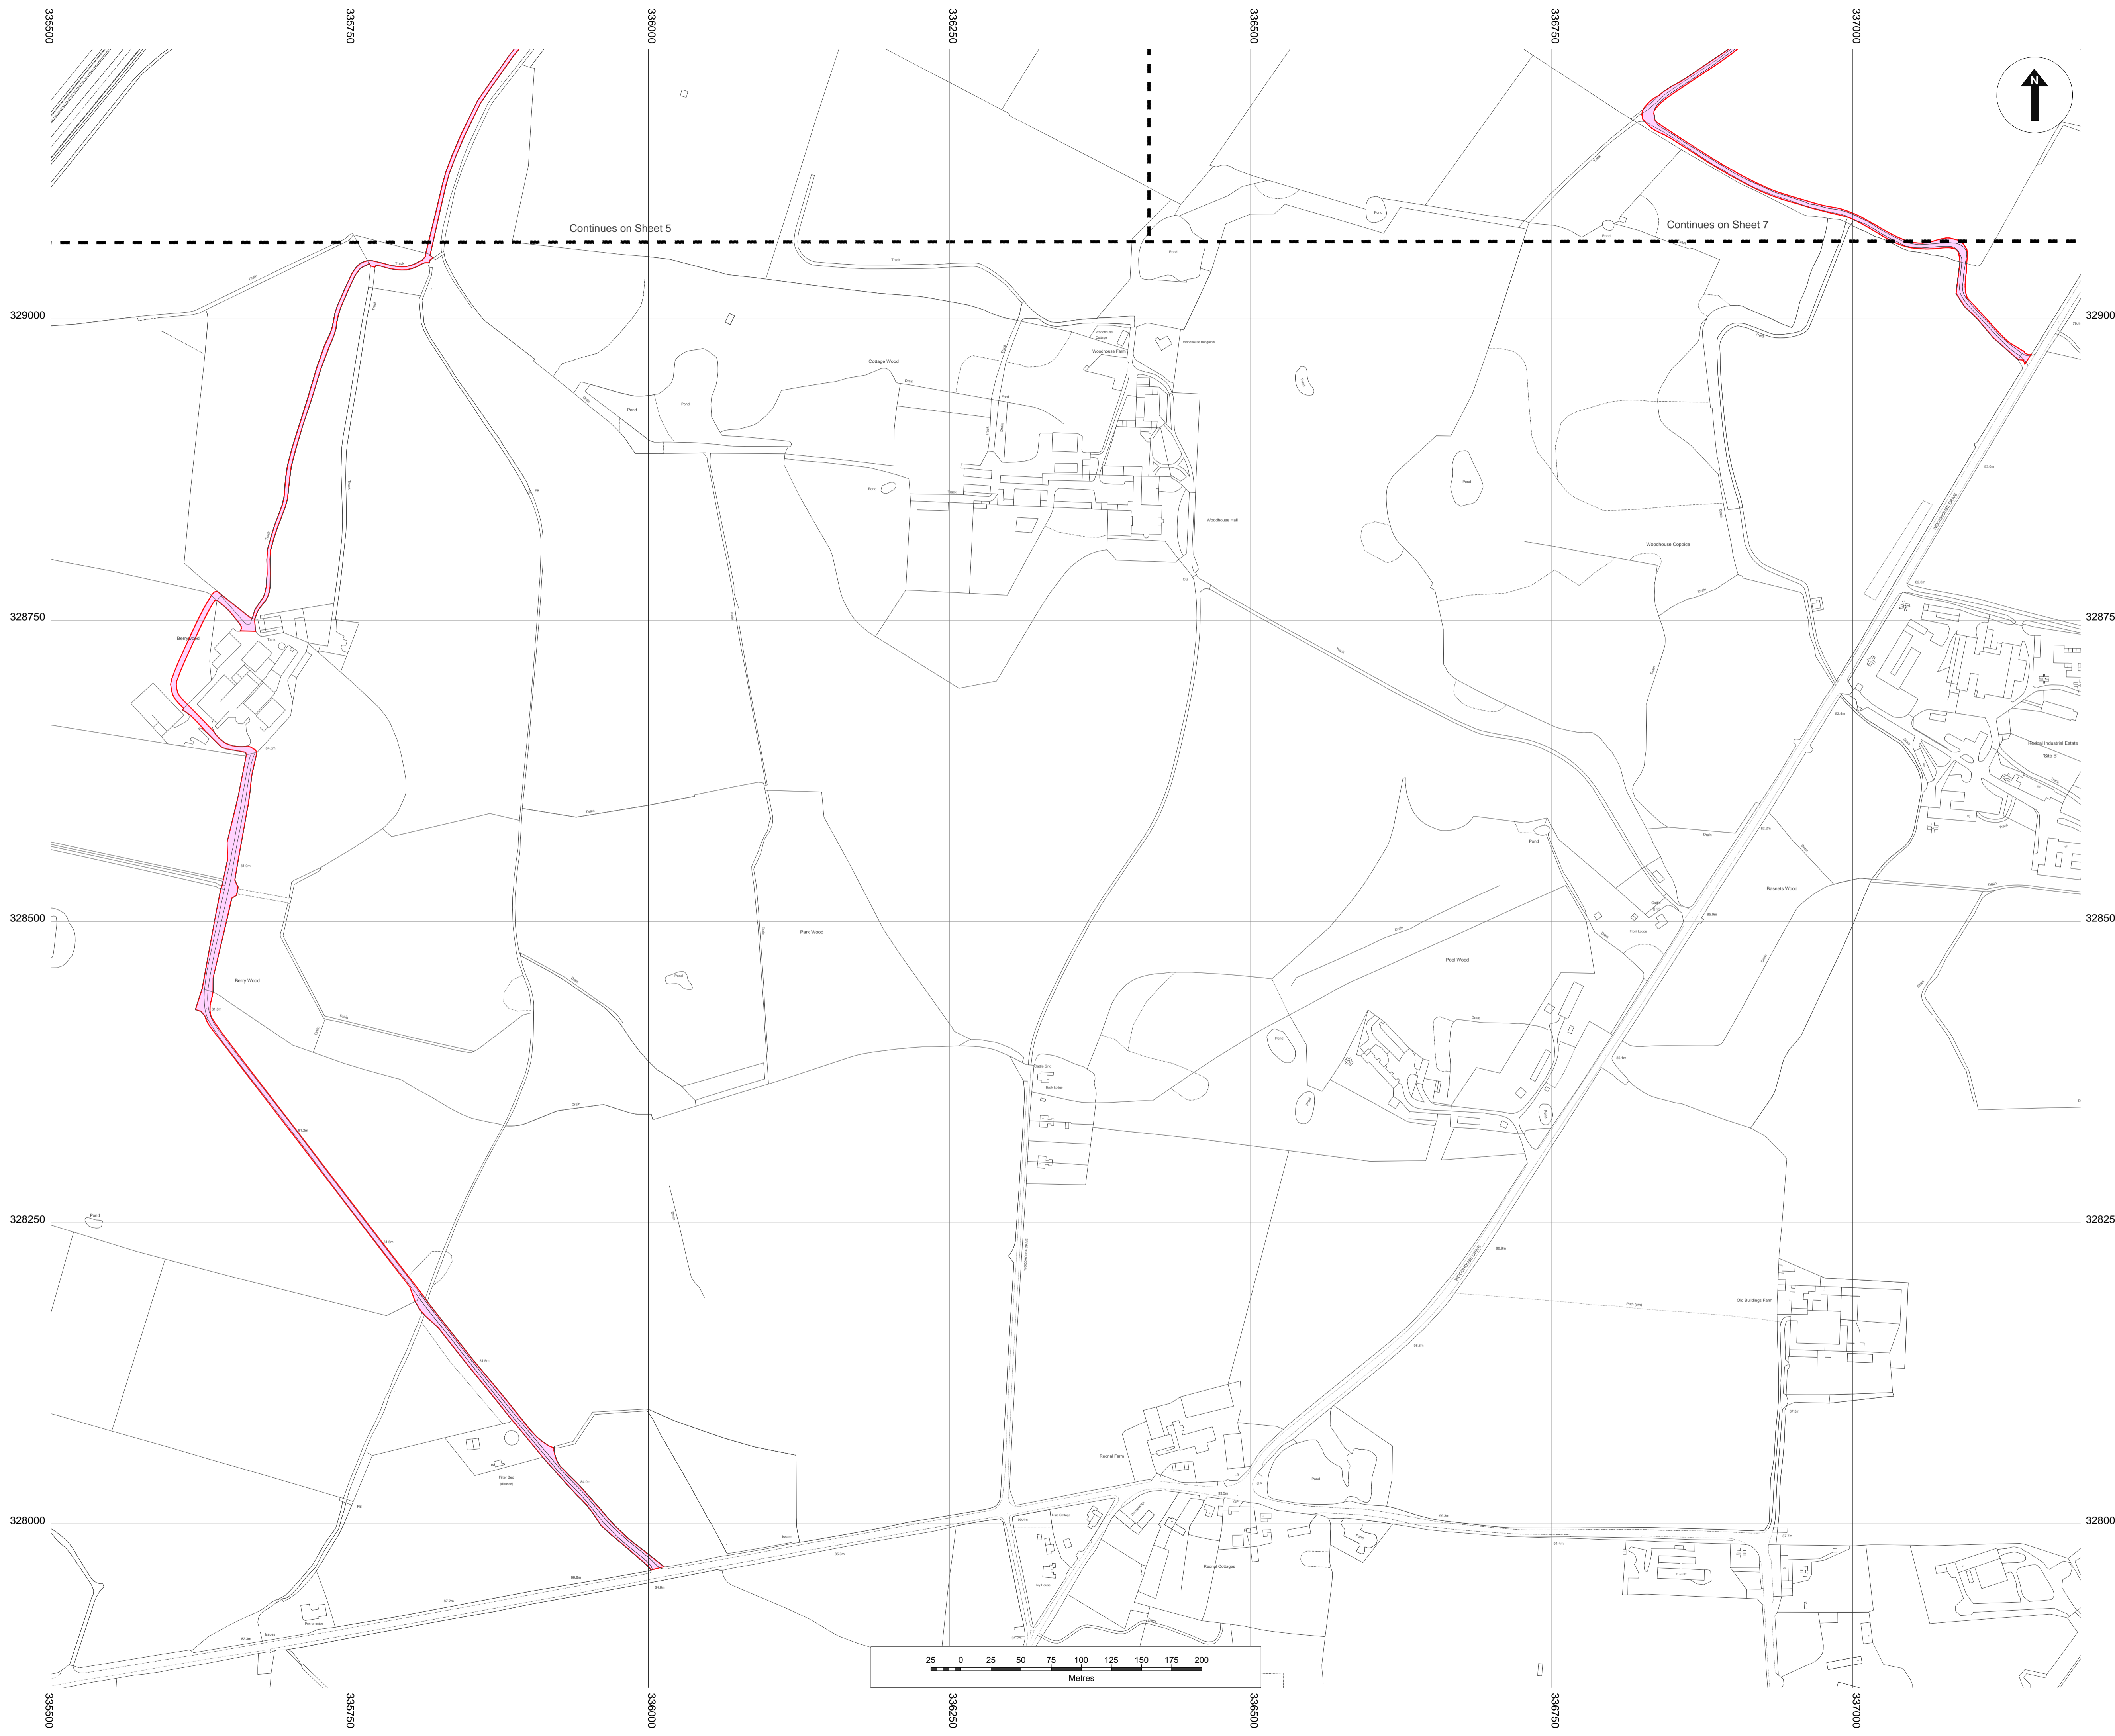

© Crown copyright. All rights reserved.  
2017 Licence number 100019036

- Legend:**
- Land required for, or affected by, the authorised development (the Order Limits)
  - Centre Line of numbered works 3 and indicative pole locations
  - Centre Line of numbered works 2
  - Works No. 1 (Works at Oswestry substation)
  - Works No. 2 (Construction and installation and keeping of a 132kV underground cable and fibre optic cable 1.2km in length)
  - Works No. 3 (Construction and installation of an 132kV overhead electric line and including laydown areas numbered)
  - Works No. 4a (Removal of existing 11kV and 33kV overhead lines)
  - Works No. 4b (Undergrounding of 11kV and 33kV cables)
  - Works No. 5 (Works at Wem substation)
  - Works No. 2 and 3
  - Works No. 3 and 4a
  - Works No. 3 and 4b
  - Works No. 3 and 4a and 4b
  - Works No. 4a and 4b

- Notes:**
1. The Legend is identical on all sheets of the Works Plans and therefore not all items detailed in the Legend are represented on each sheet.
  2. Poles (indicated by number) are not shown to scale. Numbered poles may move up to 5 metres in any direction from their indicative location but may not be sited within 1 metre from the outside edge of any hedgerow. This is referred to as the 'Limit of Deviation' as set out in Requirement 4 to the draft DCO.
  3. Laydown areas are numbered in blue.

Created by:  
TerraQuest Solutions Limited  
Quayside Tower  
252-260 Broad Street  
Birmingham  
B1 2HF  
w: [www.terraquest.co.uk](http://www.terraquest.co.uk)  
e: [info@terraquest.co.uk](mailto:info@terraquest.co.uk)




**TerraQuest**  
A Mears Group plc Company

Created for:  
SP Manweb plc  
3 Prenton Way  
North Cheshire Trading Estate  
Prenton  
CH43 3ET  
w: [www.scottishpower.com](http://www.scottishpower.com)

Title:  
Reinforcement to North Shropshire Electricity  
Distribution Network Order 201X  
Works Plan (Sheet 6 of 16)  
Document 2.3.6  
Regulation 5(2)(j)

Scale: 1:2,500@A1	Date: February 2019	
Drawing No: Sheet 6 of 16	Revision: v5.0	
Approved By: AME	Checked By: ABR	Drawn By: LME

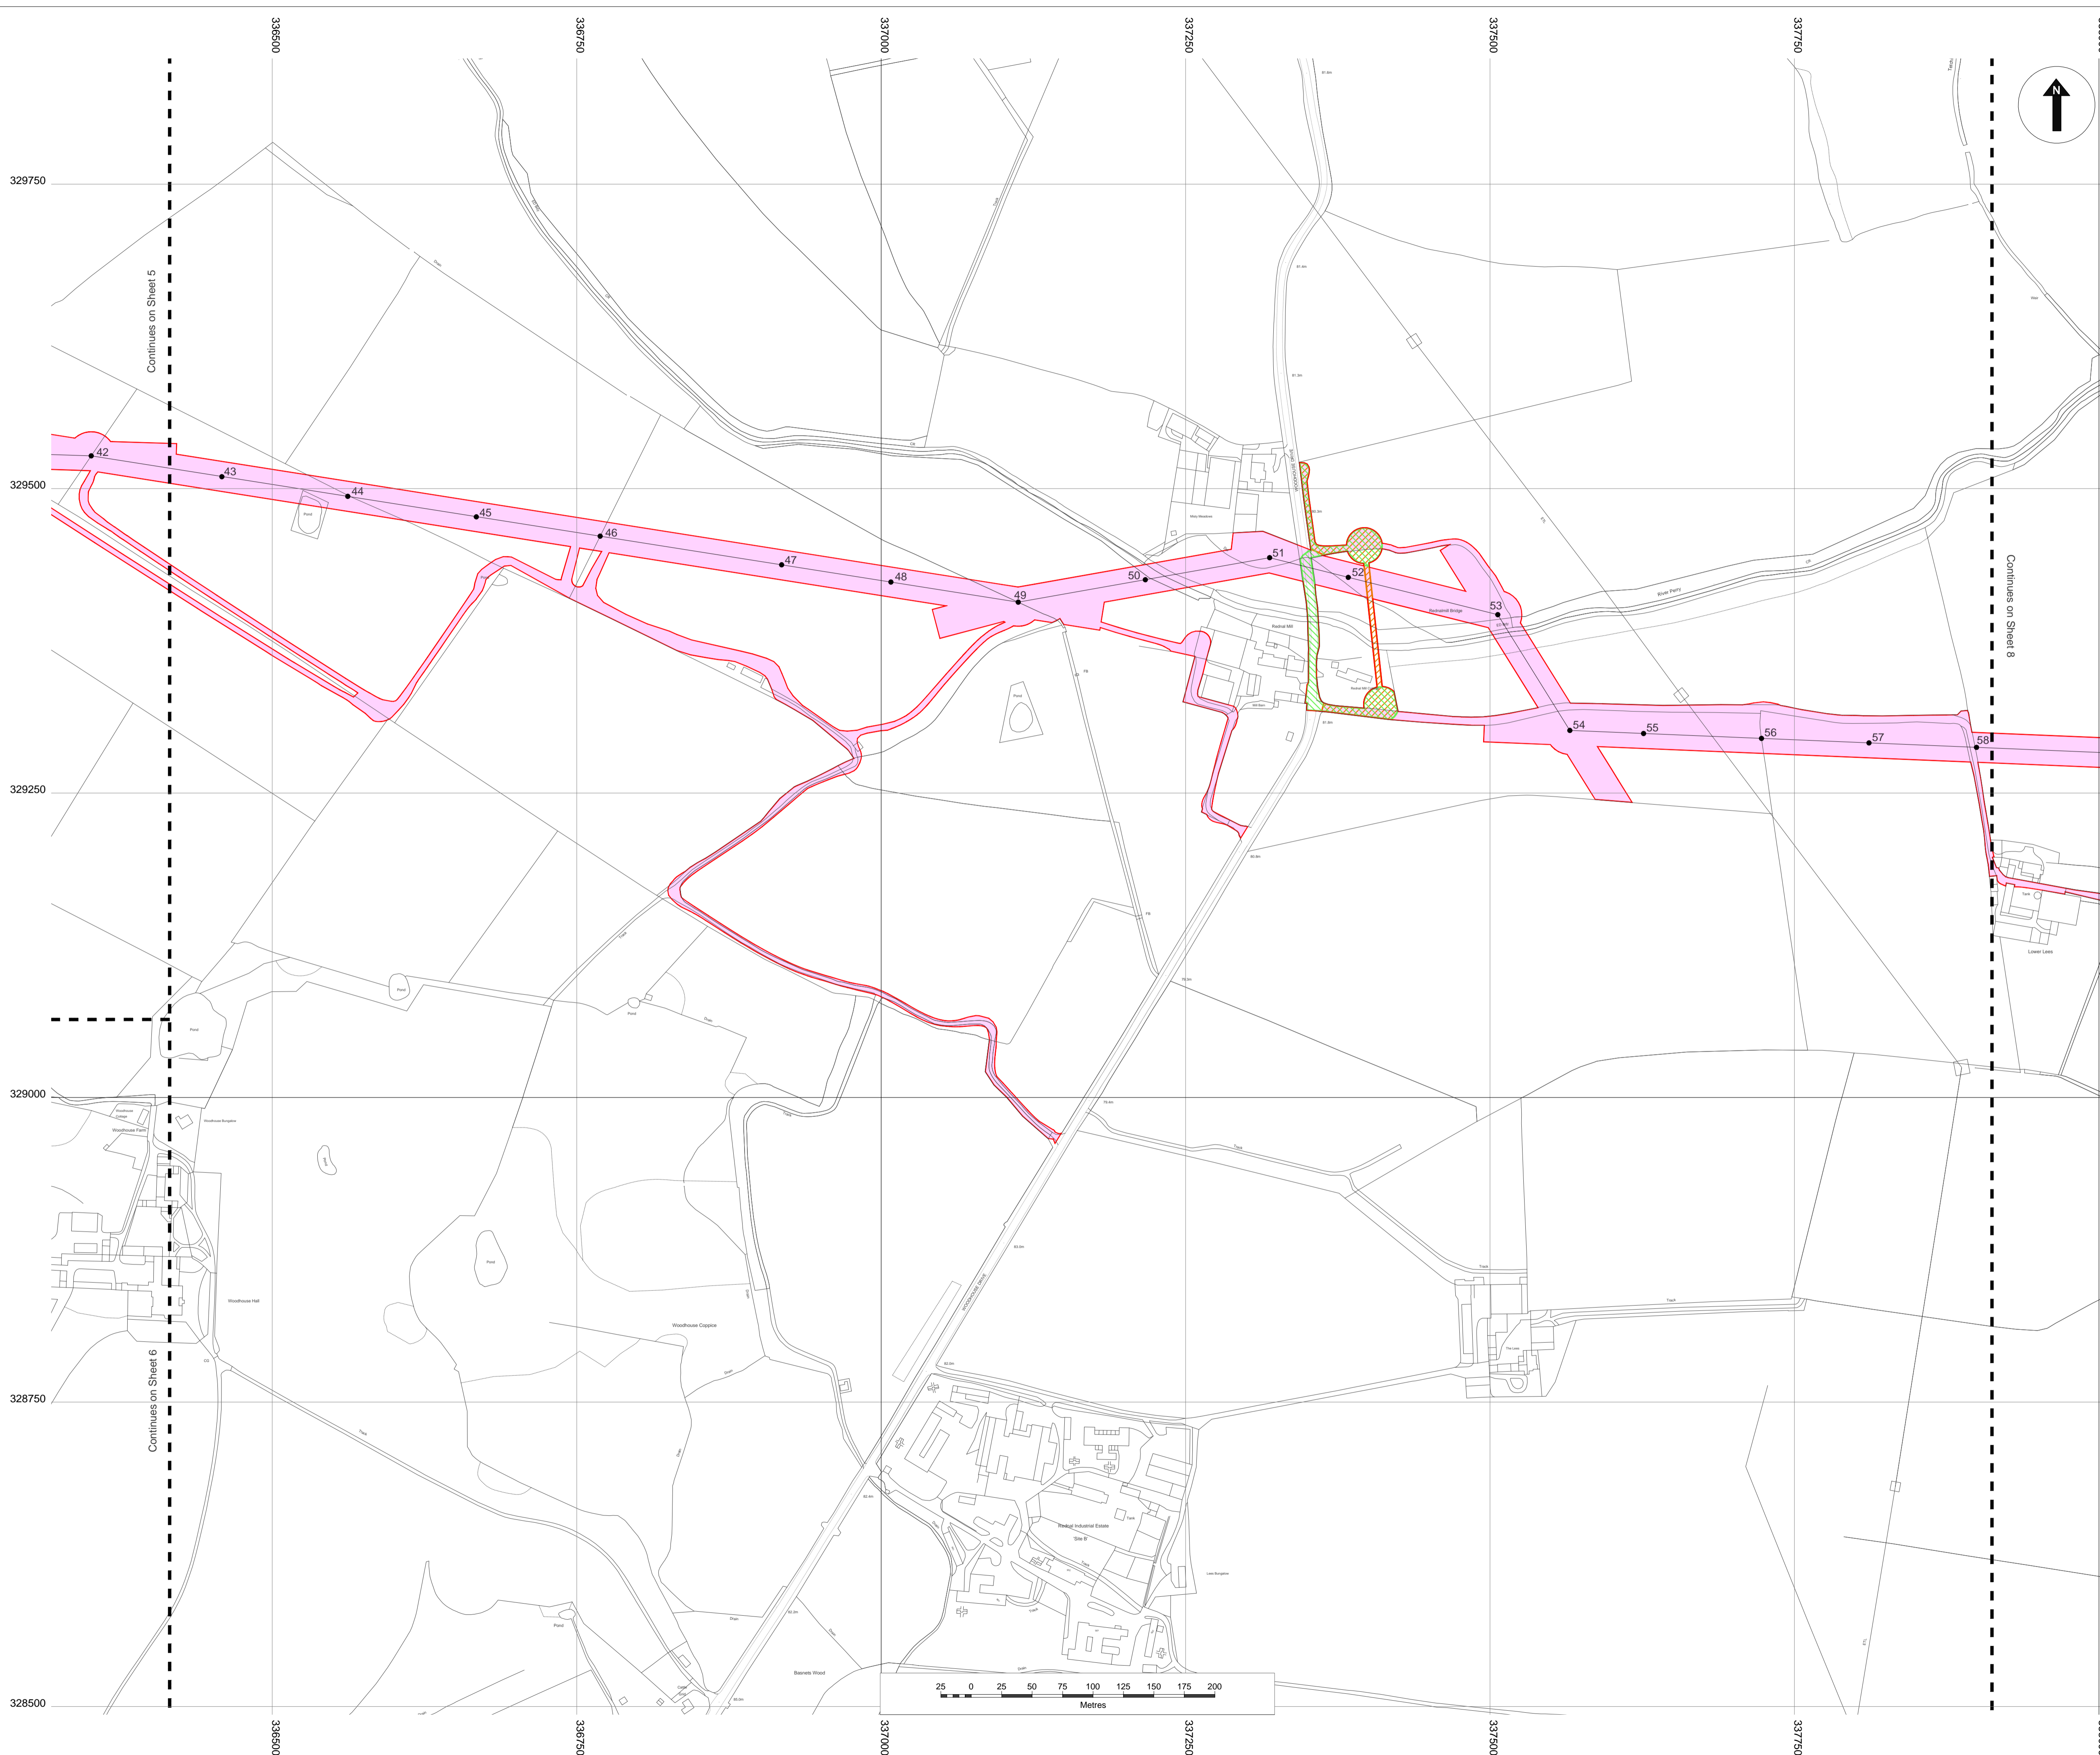

© Crown copyright. All rights reserved.  
2017 Licence number 100019036

- Legend:**
- Land required for, or affected by, the authorised development (the Order Limits)
  - Centre Line of numbered works 3 and indicative pole locations
  - Centre Line of numbered works 2
  - Works No. 1 (Works at Oswestry substation)
  - Works No. 2 (Construction and installation and keeping of a 132kV underground cable and fibre optic cable 1.2km in length)
  - Works No. 3 (Construction and installation of an 132kV overhead electric line and including laydown areas numbered)
  - Works No. 4a (Removal of existing 11kV and 33kV overhead lines)
  - Works No. 4b (Undergrounding of 11kV and 33kV cables)
  - Works No. 5 (Works at Wem substation)
  - Works No. 2 and 3
  - Works No. 3 and 4a
  - Works No. 3 and 4b
  - Works No. 3 and 4a and 4b
  - Works No. 4a and 4b

- Notes:**
1. The Legend is identical on all sheets of the Works Plans and therefore not all items detailed in the Legend are represented on each sheet.
  2. Poles (indicated by number) are not shown to scale. Numbered poles may move up to 5 metres in any direction from their indicative location but may not be sited within 1 metre from the outside edge of any hedgerow. This is referred to as the 'Limit of Deviation' as set out in Requirement 4 to the draft DCO.
  3. Laydown areas are numbered in blue.

Created by:  
TerraQuest Solutions Limited  
Quayside Tower  
252-260 Broad Street  
Birmingham  
B1 2HF  
w: [www.terraquest.co.uk](http://www.terraquest.co.uk)  
e: [info@terraquest.co.uk](mailto:info@terraquest.co.uk)



**TerraQuest**  
Business & Property Solutions  
A Mears Group plc Company

Created for:  
SP Manweb plc  
3 Prenton Way  
North Cheshire Trading Estate  
Prenton  
CH43 3ET  
w: [www.scottishpower.com](http://www.scottishpower.com)

**Title:**  
Reinforcement to North Shropshire Electricity  
Distribution Network Order 201X  
Works Plan (Sheet 7 of 16)  
Document 2.3.7  
Regulation 5(2)(j)

<b>Scale:</b> 1:2,500@A1	<b>Date:</b> February 2019
<b>Drawing No:</b> Sheet 7 of 16	<b>Revision:</b> v5.0
<b>Approved By:</b> AME	<b>Checked By:</b> ABR
	<b>Drawn By:</b> LME



© Crown copyright. All rights reserved.  
2017 Licence number 100019036

- Legend:**
- Land required for, or affected by, the authorised development (the Order Limits)
  - Centre Line of numbered works 3 and indicative pole locations
  - Centre Line of numbered works 2
  - Works No. 1 (Works at Oswestry substation)
  - Works No. 2 (Construction and installation and keeping of a 132kV underground cable and fibre optic cable 1.2km in length)
  - Works No. 3 (Construction and installation of an 132kV overhead electric line and including laydown areas numbered)
  - Works No. 4a (Removal of existing 11kV and 33kV overhead lines)
  - Works No. 4b (Undergrounding of 11kV and 33kV cables)
  - Works No. 5 (Works at Wem substation)
  - Works No. 2 and 3
  - Works No. 3 and 4a
  - Works No. 3 and 4b
  - Works No. 3 and 4a and 4b
  - Works No. 4a and 4b

- Notes:**
1. The Legend is identical on all sheets of the Works Plans and therefore not all items detailed in the Legend are represented on each sheet.
  2. Poles (indicated by number) are not shown to scale. Numbered poles may move up to 5 metres in any direction from their indicative location but may not be sited within 1 metre from the outside edge of any hedgerow. This is referred to as the 'Limit of Deviation' as set out in Requirement 4 to the draft DCO.
  3. Laydown areas are numbered in blue.

Created by:  
TerraQuest Solutions Limited  
Quayside Tower  
252-260 Broad Street  
Birmingham  
B1 2HF  
w: [www.terraquest.co.uk](http://www.terraquest.co.uk)  
e: [info@terraquest.co.uk](mailto:info@terraquest.co.uk)





**TerraQuest**  
Business & Property Solutions  
A Mears Group plc Company

Created for:  
SP Manweb plc  
3 Prenton Way  
North Cheshire Trading Estate  
Prenton  
CH43 3ET  
w: [www.scottishpower.com](http://www.scottishpower.com)

Title:  
Reinforcement to North Shropshire Electricity  
Distribution Network Order 201X  
Works Plan (Sheet 8 of 16)  
Document 2.3.8  
Regulation 5(2)(j)

Scale: 1:2,500@A1	Date: February 2019	
Drawing No: Sheet 8 of 16	Revision: v5.0	
Approved By: AME	Checked By: ABR	Drawn By: LME

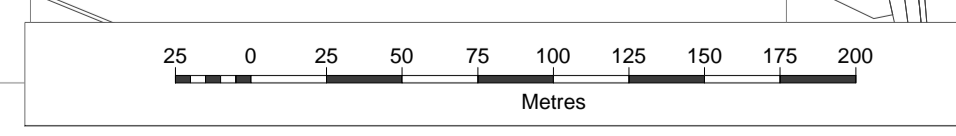

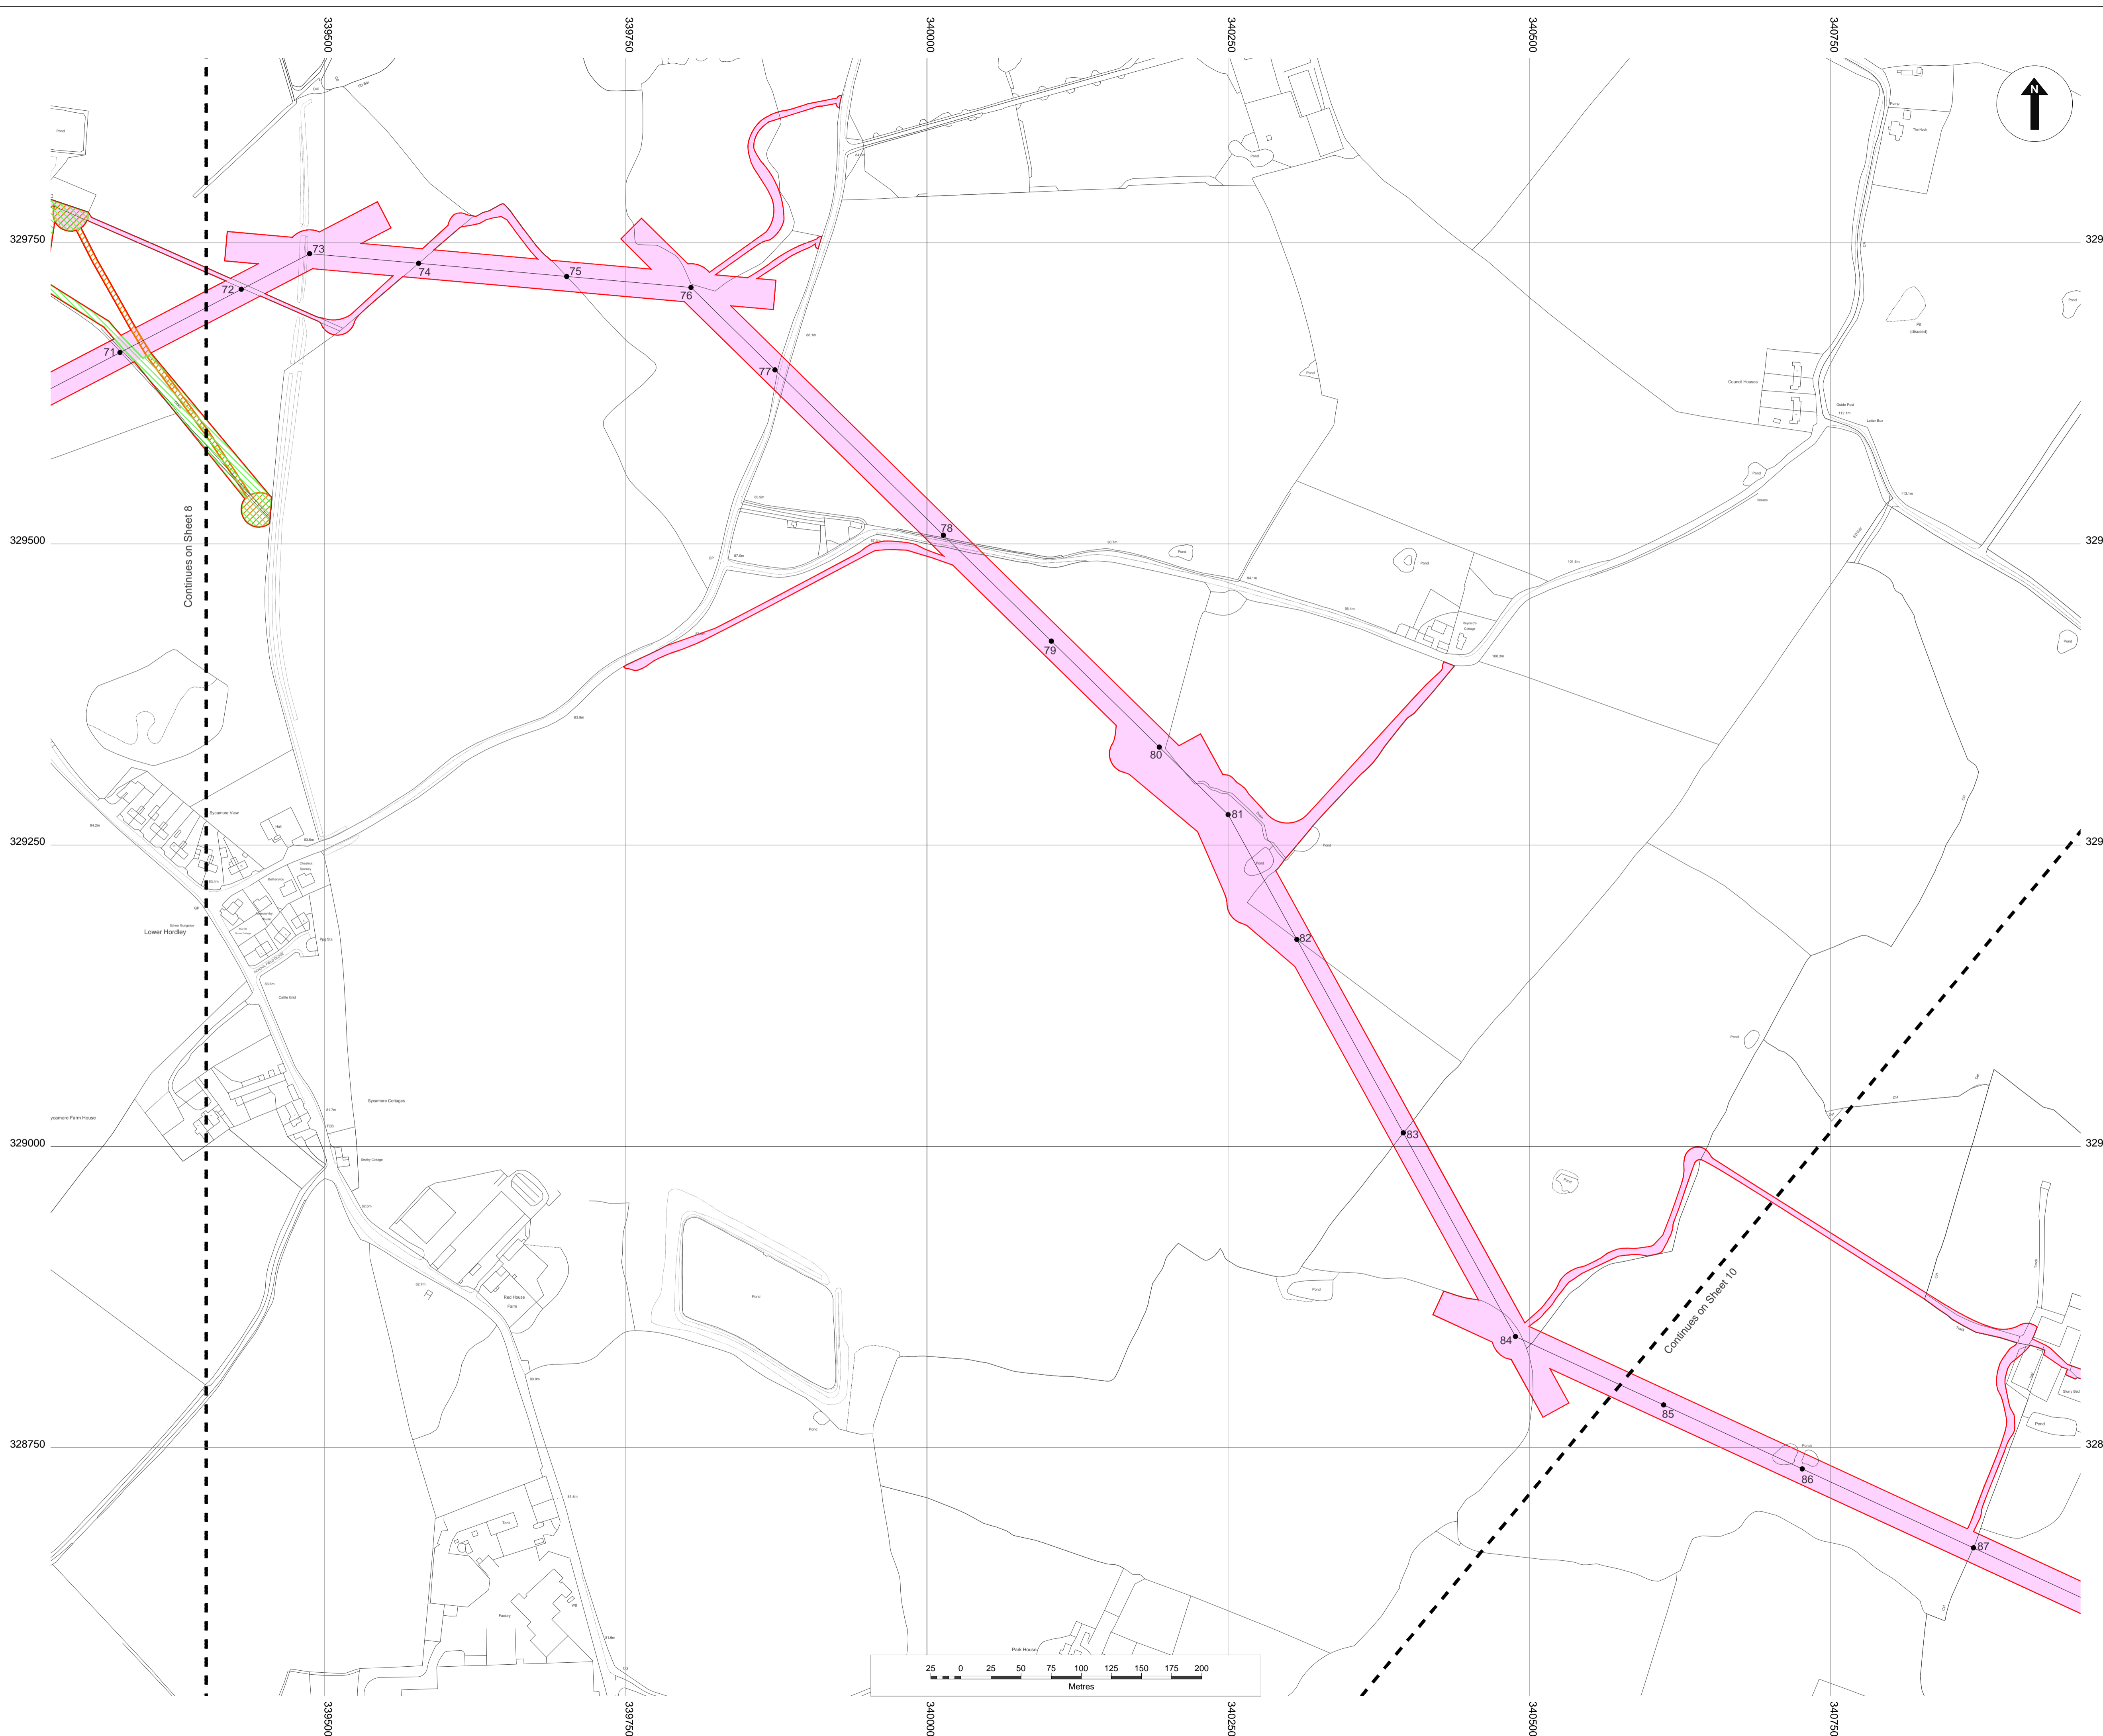

© Crown copyright. All rights reserved.  
2017 Licence number 100019036

- Legend:**
- Land required for, or affected by, the authorised development (the Order Limits)
  - Centre Line of numbered works 3 and indicative pole locations
  - Centre Line of numbered works 2
  - Works No. 1 (Works at Oswestry substation)
  - Works No. 2 (Construction and installation and keeping of a 132kV underground cable and fibre optic cable 1.2km in length)
  - Works No. 3 (Construction and installation of an 132kV overhead electric line and including laydown areas numbered)
  - Works No. 4a (Removal of existing 11kV and 33kV overhead lines)
  - Works No. 4b (Undergrounding of 11kV and 33kV cables)
  - Works No. 5 (Works at Wem substation)
  - Works No. 2 and 3
  - Works No. 3 and 4a
  - Works No. 3 and 4b
  - Works No. 3 and 4a and 4b
  - Works No. 4a and 4b

- Notes:**
1. The Legend is identical on all sheets of the Works Plans and therefore not all items detailed in the Legend are represented on each sheet.
  2. Poles (indicated by number) are not shown to scale. Numbered poles may move up to 5 metres in any direction from their indicative location but may not be sited within 1 metre from the outside edge of any hedgerow. This is referred to as the 'Limit of Deviation' as set out in Requirement 4 to the draft DCO.
  3. Laydown areas are numbered in blue.

Created by:  
TerraQuest Solutions Limited  
Quayside Tower  
252-260 Broad Street  
Birmingham  
B1 2HF  
w: [www.terraquest.co.uk](http://www.terraquest.co.uk)  
e: [info@terraquest.co.uk](mailto:info@terraquest.co.uk)




**TerraQuest**  
Business & Property Solutions  
A Mears Group plc Company

Created for:  
SP Manweb plc  
3 Prenton Way  
North Cheshire Trading Estate  
Prenton  
CH43 3ET  
w: [www.scottishpower.com](http://www.scottishpower.com)

Title:  
Reinforcement to North Shropshire Electricity  
Distribution Network Order 201X  
Works Plan (Sheet 9 of 16)  
Document 2.3.9  
Regulation 5(2)(j)

Scale: 1:2,500@A1	Date: February 2019	
Drawing No: Sheet 9 of 16	Revision: v5.0	
Approved By: AME	Checked By: ABR	Drawn By: LME

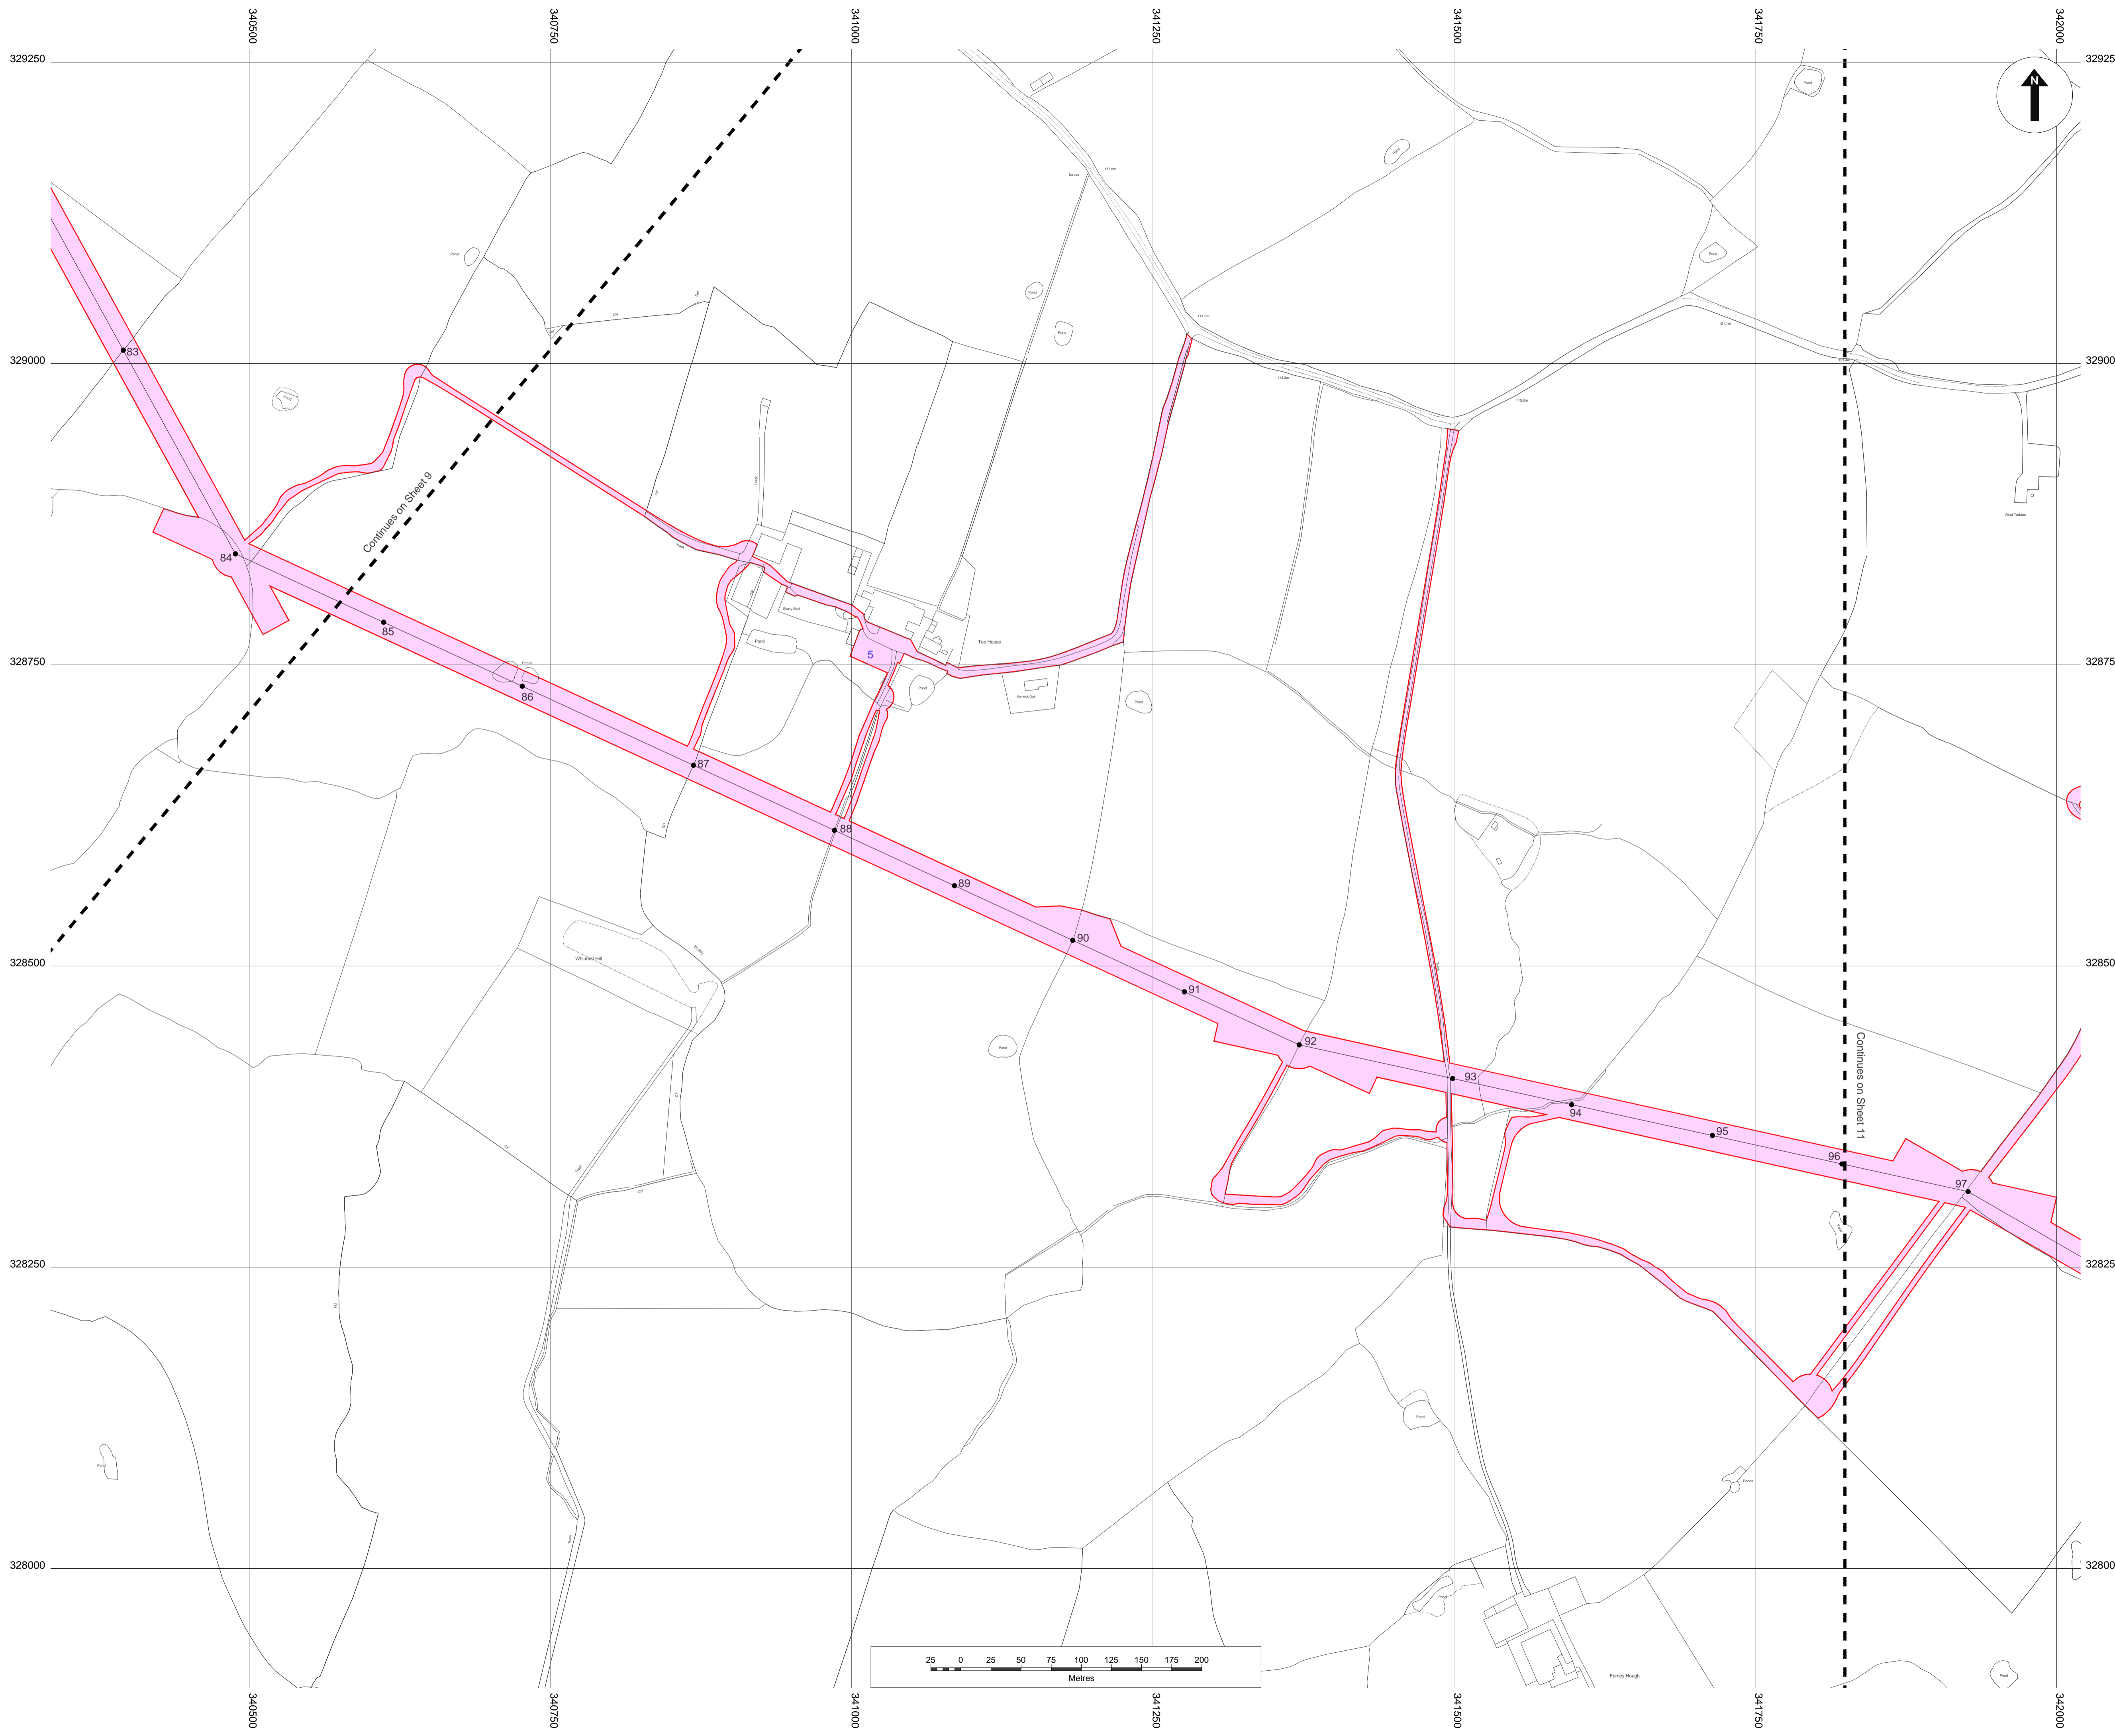

© Crown copyright. All rights reserved.  
2017 Licence number 100019036

- Legend:**
- Land required for, or affected by, the authorised development (the Order Limits)
  - Centre Line of numbered works 3 and indicative pole locations
  - Centre Line of numbered works 2
  - Works No. 1 (Works at Oswestry substation)
  - Works No. 2 (Construction and installation and keeping of a 132kV underground cable and fibre optic cable 1.2km in length)
  - Works No. 3 (Construction and installation and of an 132kV overhead electric line and including laydown areas numbered)
  - Works No. 4a (Removal of existing 11kV and 33kV overhead lines)
  - Works No. 4b (Undergrounding of 11kV and 33kV cables)
  - Works No. 5 (Works at Wem substation)
  - Works No. 2 and 3
  - Works No. 3 and 4a
  - Works No. 3 and 4b
  - Works No. 3 and 4a and 4b
  - Works No. 4a and 4b

- Notes:**
1. The Legend is identical on all sheets of the Works Plans and therefore not all items detailed in the Legend are represented on each sheet.
  2. Poles (indicated by number) are not shown to scale. Numbered poles may move up to 5 metres in any direction from their indicative location but may not be sited within 1 metre from the outside edge of any hedgerow. This is referred to as the 'Limit of Deviation' as set out in Requirement 4 to the draft DCO.
  3. Laydown areas are numbered in blue.

Created by:  
TerraQuest Solutions Limited  
Quayside Tower  
252-260 Broad Street  
Birmingham  
B1 2HF  
w: [www.terraquest.co.uk](http://www.terraquest.co.uk)  
e: [info@terraquest.co.uk](mailto:info@terraquest.co.uk)





**TerraQuest**  
A Mears Group plc Company

Created for:  
SP Manweb plc  
3 Prenton Way  
North Cheshire Trading Estate  
Prenton  
CH43 3ET  
w: [www.scottishpower.com](http://www.scottishpower.com)

Title:  
Reinforcement to North Shropshire Electricity  
Distribution Network Order 201X  
Works Plan (Sheet 10 of 16)  
Document 2.3.10  
Regulation 5(2)(j)

Scale: 1:2,500@A1	Date: February 2019
Drawing No: Sheet 10 of 16	Revision: v5.0
Approved By: AME	Checked By: ABR
	Drawn By: LME

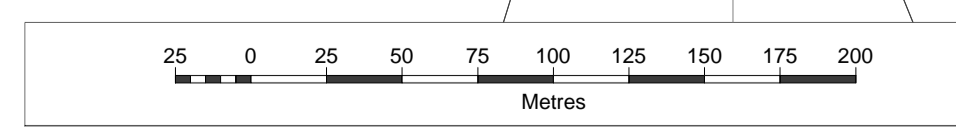

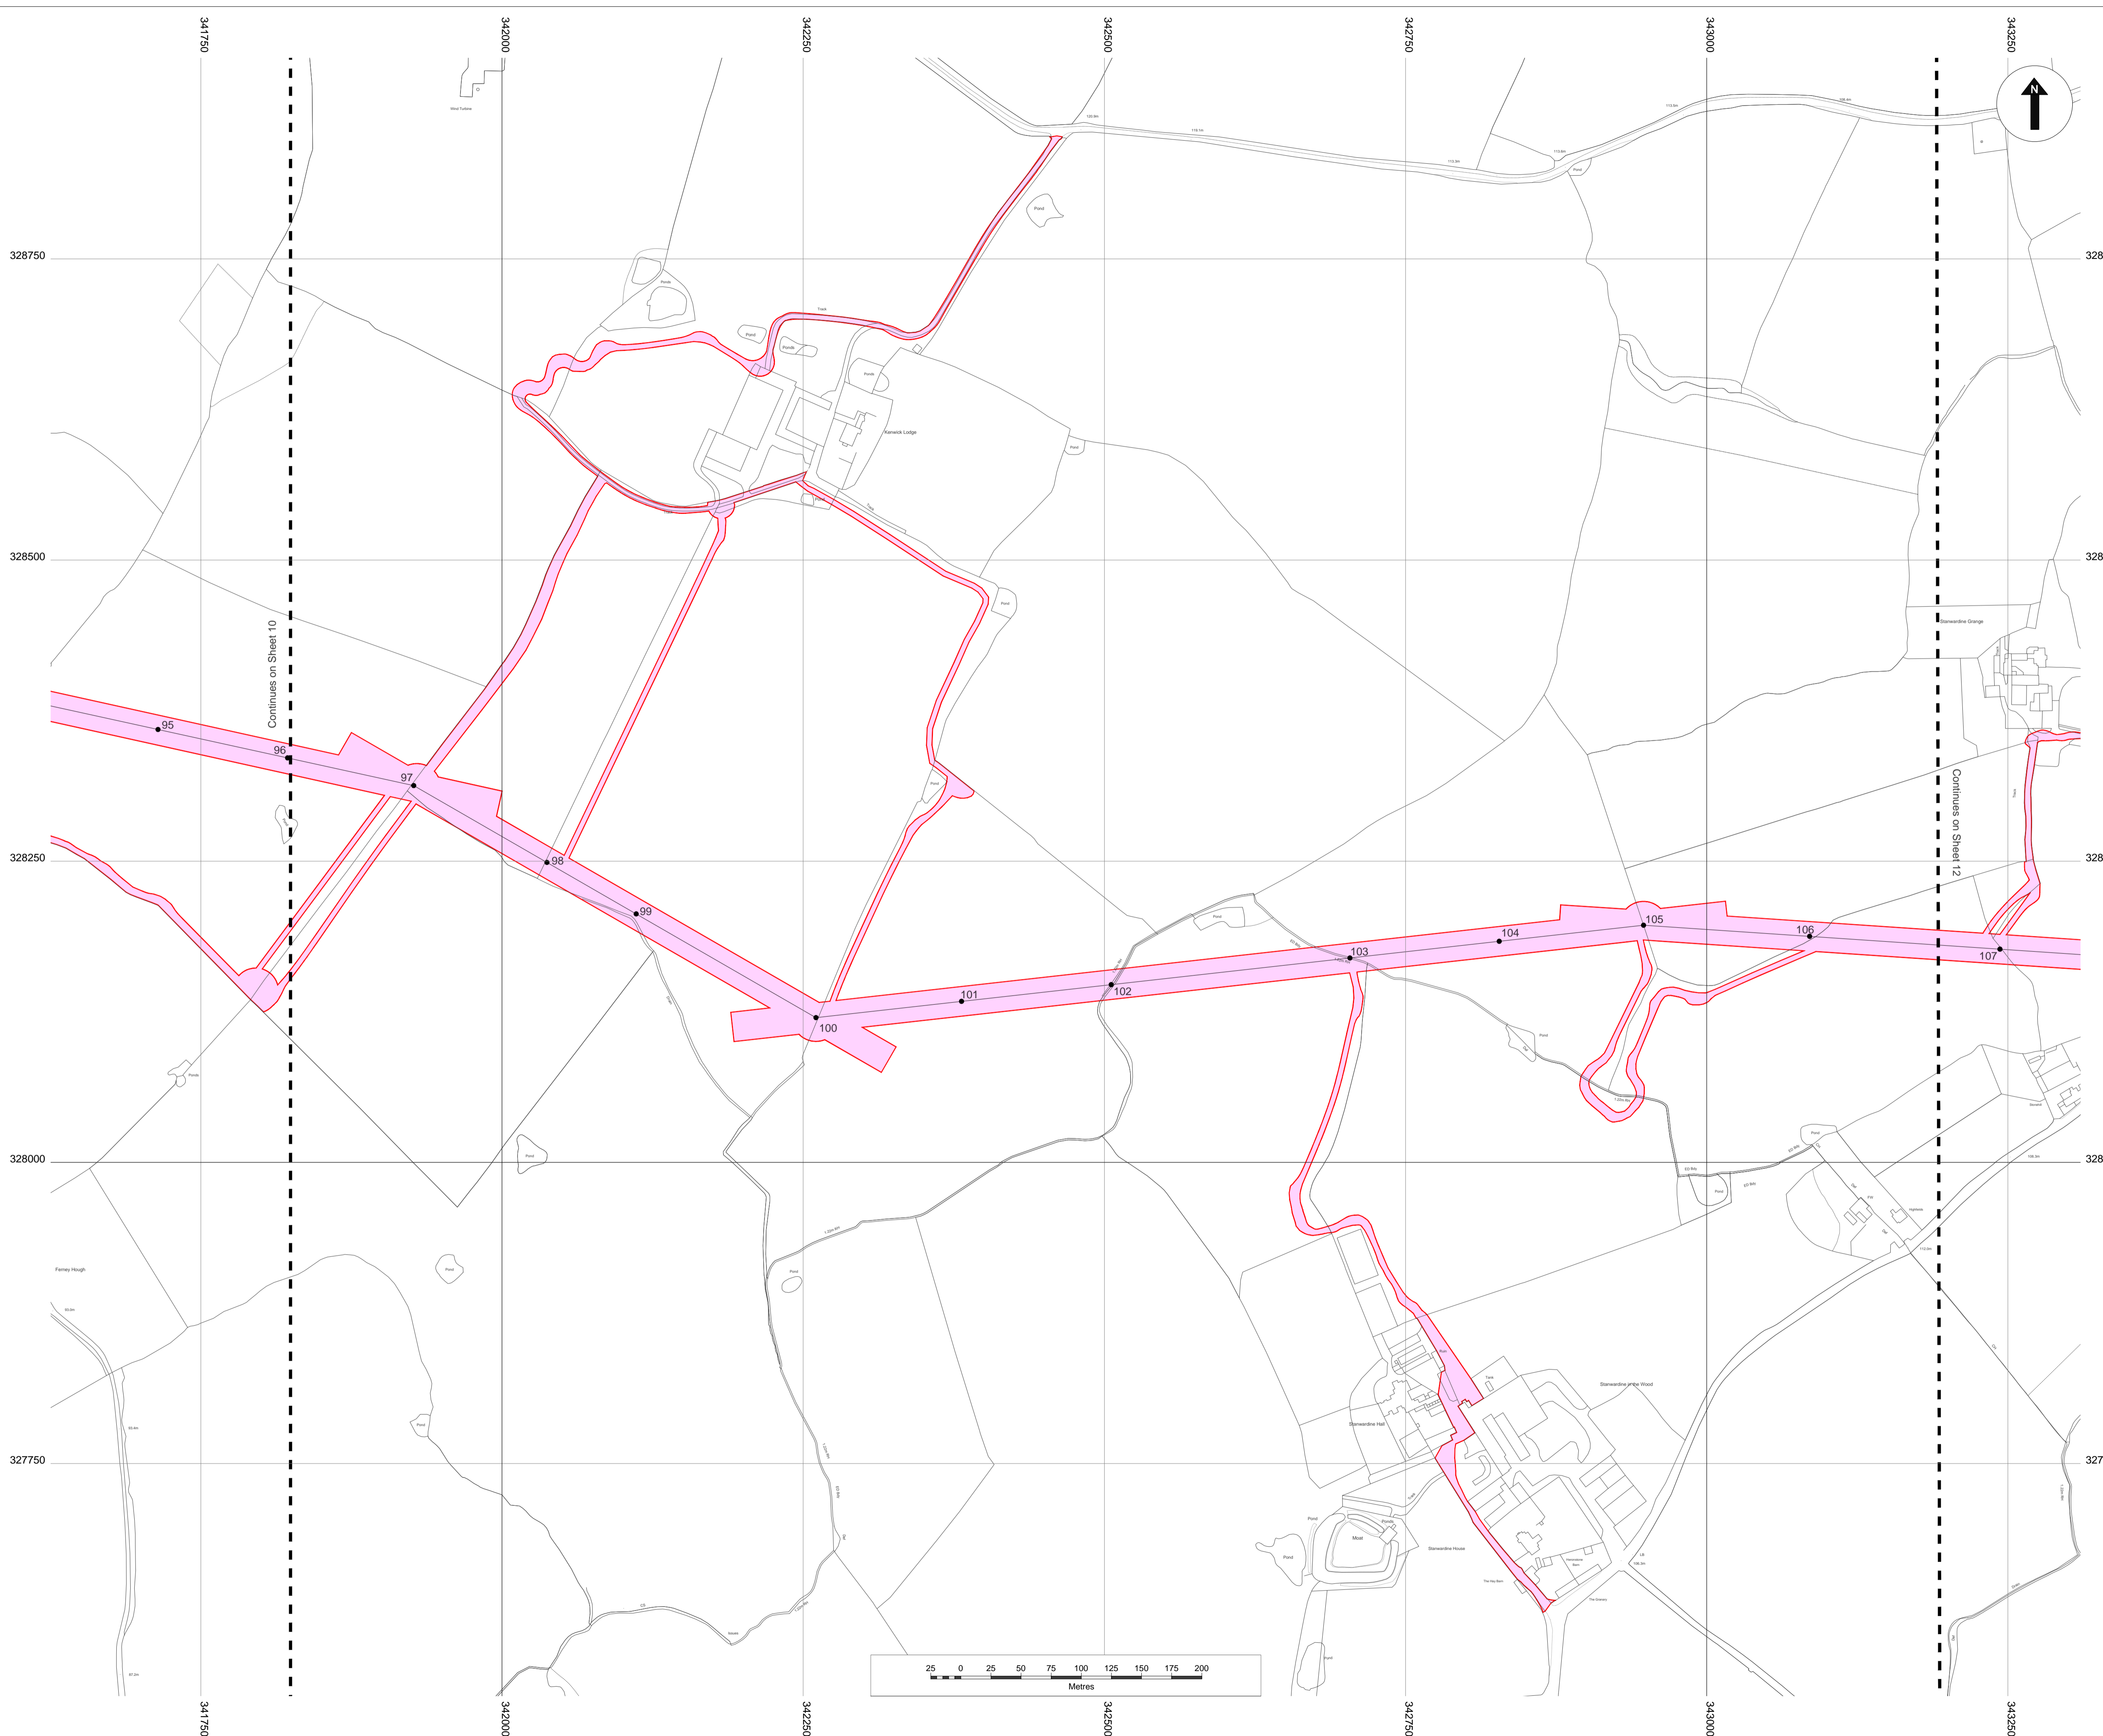

© Crown copyright. All rights reserved.  
2017 Licence number 100019036

- Legend:**
- Land required for, or affected by, the authorised development (the Order Limits)
  - Centre Line of numbered works 3 and indicative pole locations
  - Centre Line of numbered works 2
  - Works No. 1 (Works at Oswestry substation)
  - Works No. 2 (Construction and installation and keeping of a 132kV underground cable and fibre optic cable 1.2km in length)
  - Works No. 3 (Construction and installation of an 132kV overhead electric line and including laydown areas numbered)
  - Works No. 4a (Removal of existing 11kV and 33kV overhead lines)
  - Works No. 4b (Undergrounding of 11kV and 33kV cables)
  - Works No. 5 (Works at Wem substation)
  - Works No. 2 and 3
  - Works No. 3 and 4a
  - Works No. 3 and 4b
  - Works No. 3 and 4a and 4b
  - Works No. 4a and 4b

- Notes:**
1. The Legend is identical on all sheets of the Works Plans and therefore not all items detailed in the Legend are represented on each sheet.
  2. Poles (indicated by number) are not shown to scale. Numbered poles may move up to 5 metres in any direction from their indicative location but may not be sited within 1 metre from the outside edge of any hedgerow. This is referred to as the 'Limit of Deviation' as set out in Requirement 4 to the draft DCO.
  3. Laydown areas are numbered in blue.

Created by:  
TerraQuest Solutions Limited  
Quayside Tower  
252-260 Broad Street  
Birmingham  
B1 2HF  
w: [www.terraquest.co.uk](http://www.terraquest.co.uk)  
e: [info@terraquest.co.uk](mailto:info@terraquest.co.uk)




**Business & Property Solutions**  
A Measurs Group plc Company

Created for:  
SP Manweb plc  
3 Prenton Way  
North Cheshire Trading Estate  
Prenton  
CH43 3ET  
w: [www.scottishpower.com](http://www.scottishpower.com)

Title:  
Reinforcement to North Shropshire Electricity  
Distribution Network Order 201X  
Works Plan (Sheet 11 of 16)  
Document 2.3.11  
Regulation 5(2)(j)

Scale: 1:2,500@A1	Date: February 2019	
Drawing No: Sheet 11 of 16	Revision: v5.0	
Approved By: AME	Checked By: ABR	Drawn By: LME

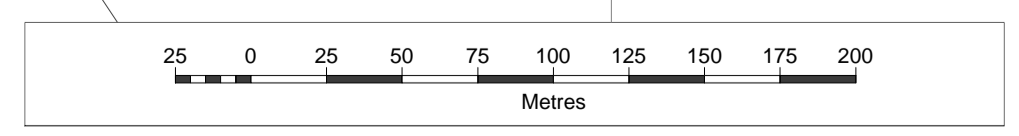

© Crown copyright. All rights reserved.  
2017 Licence number 100019036

Legend:

- Land required for, or affected by, the authorised development (the Order Limits)
- Centre Line of numbered works 3 and indicative pole locations
- Centre Line of numbered works 2
- Works No. 1 (Works at Oswestry substation)
- Works No. 2 (Construction and installation and keeping of a 132kV underground cable and fibre optic cable 1.2km in length)
- Works No. 3 (Construction and installation of an 132kV overhead electric line and including laydown areas numbered)
- Works No. 4a (Removal of existing 11kV and 33kV overhead lines)
- Works No. 4b (Undergrounding of 11kV and 33kV cables)
- Works No. 5 (Works at Wem substation)
- Works No. 2 and 3
- Works No. 3 and 4a
- Works No. 3 and 4b
- Works No. 3 and 4a and 4b
- Works No. 4a and 4b

Notes:

1. The Legend is identical on all sheets of the Works Plans and therefore not all items detailed in the Legend are represented on each sheet.
2. Poles (indicated by number) are not shown to scale. Numbered poles may move up to 5 metres in any direction from their indicative location but may not be sited within 1 metre from the outside edge of any hedgerow. This is referred to as the 'Limit of Deviation' as set out in Requirement 4 to the draft DCO.
3. Laydown areas are numbered in blue.

Created by:

TerraQuest Solutions Limited  
Quayside Tower  
252-260 Broad Street  
Birmingham  
B1 2HF  
w: www.terraquest.co.uk  
e: info@terraquest.co.uk




Created for:


SP Manweb plc  
3 Prenton Way  
North Cheshire Trading Estate  
Prenton  
CH43 3ET  
w: www.scottishpower.com

Title:

Reinforcement to North Shropshire Electricity  
Distribution Network Order 201X  
Works Plan (Sheet 12 of 16)  
Document 2.3.12  
Regulation 5(2)(j)

Scale: 1:2,500@A1	Date: February 2019	
Drawing No: Sheet 12 of 16	Revision: v5.0	
Approved By: AME	Checked By: ABR	Drawn By: LME

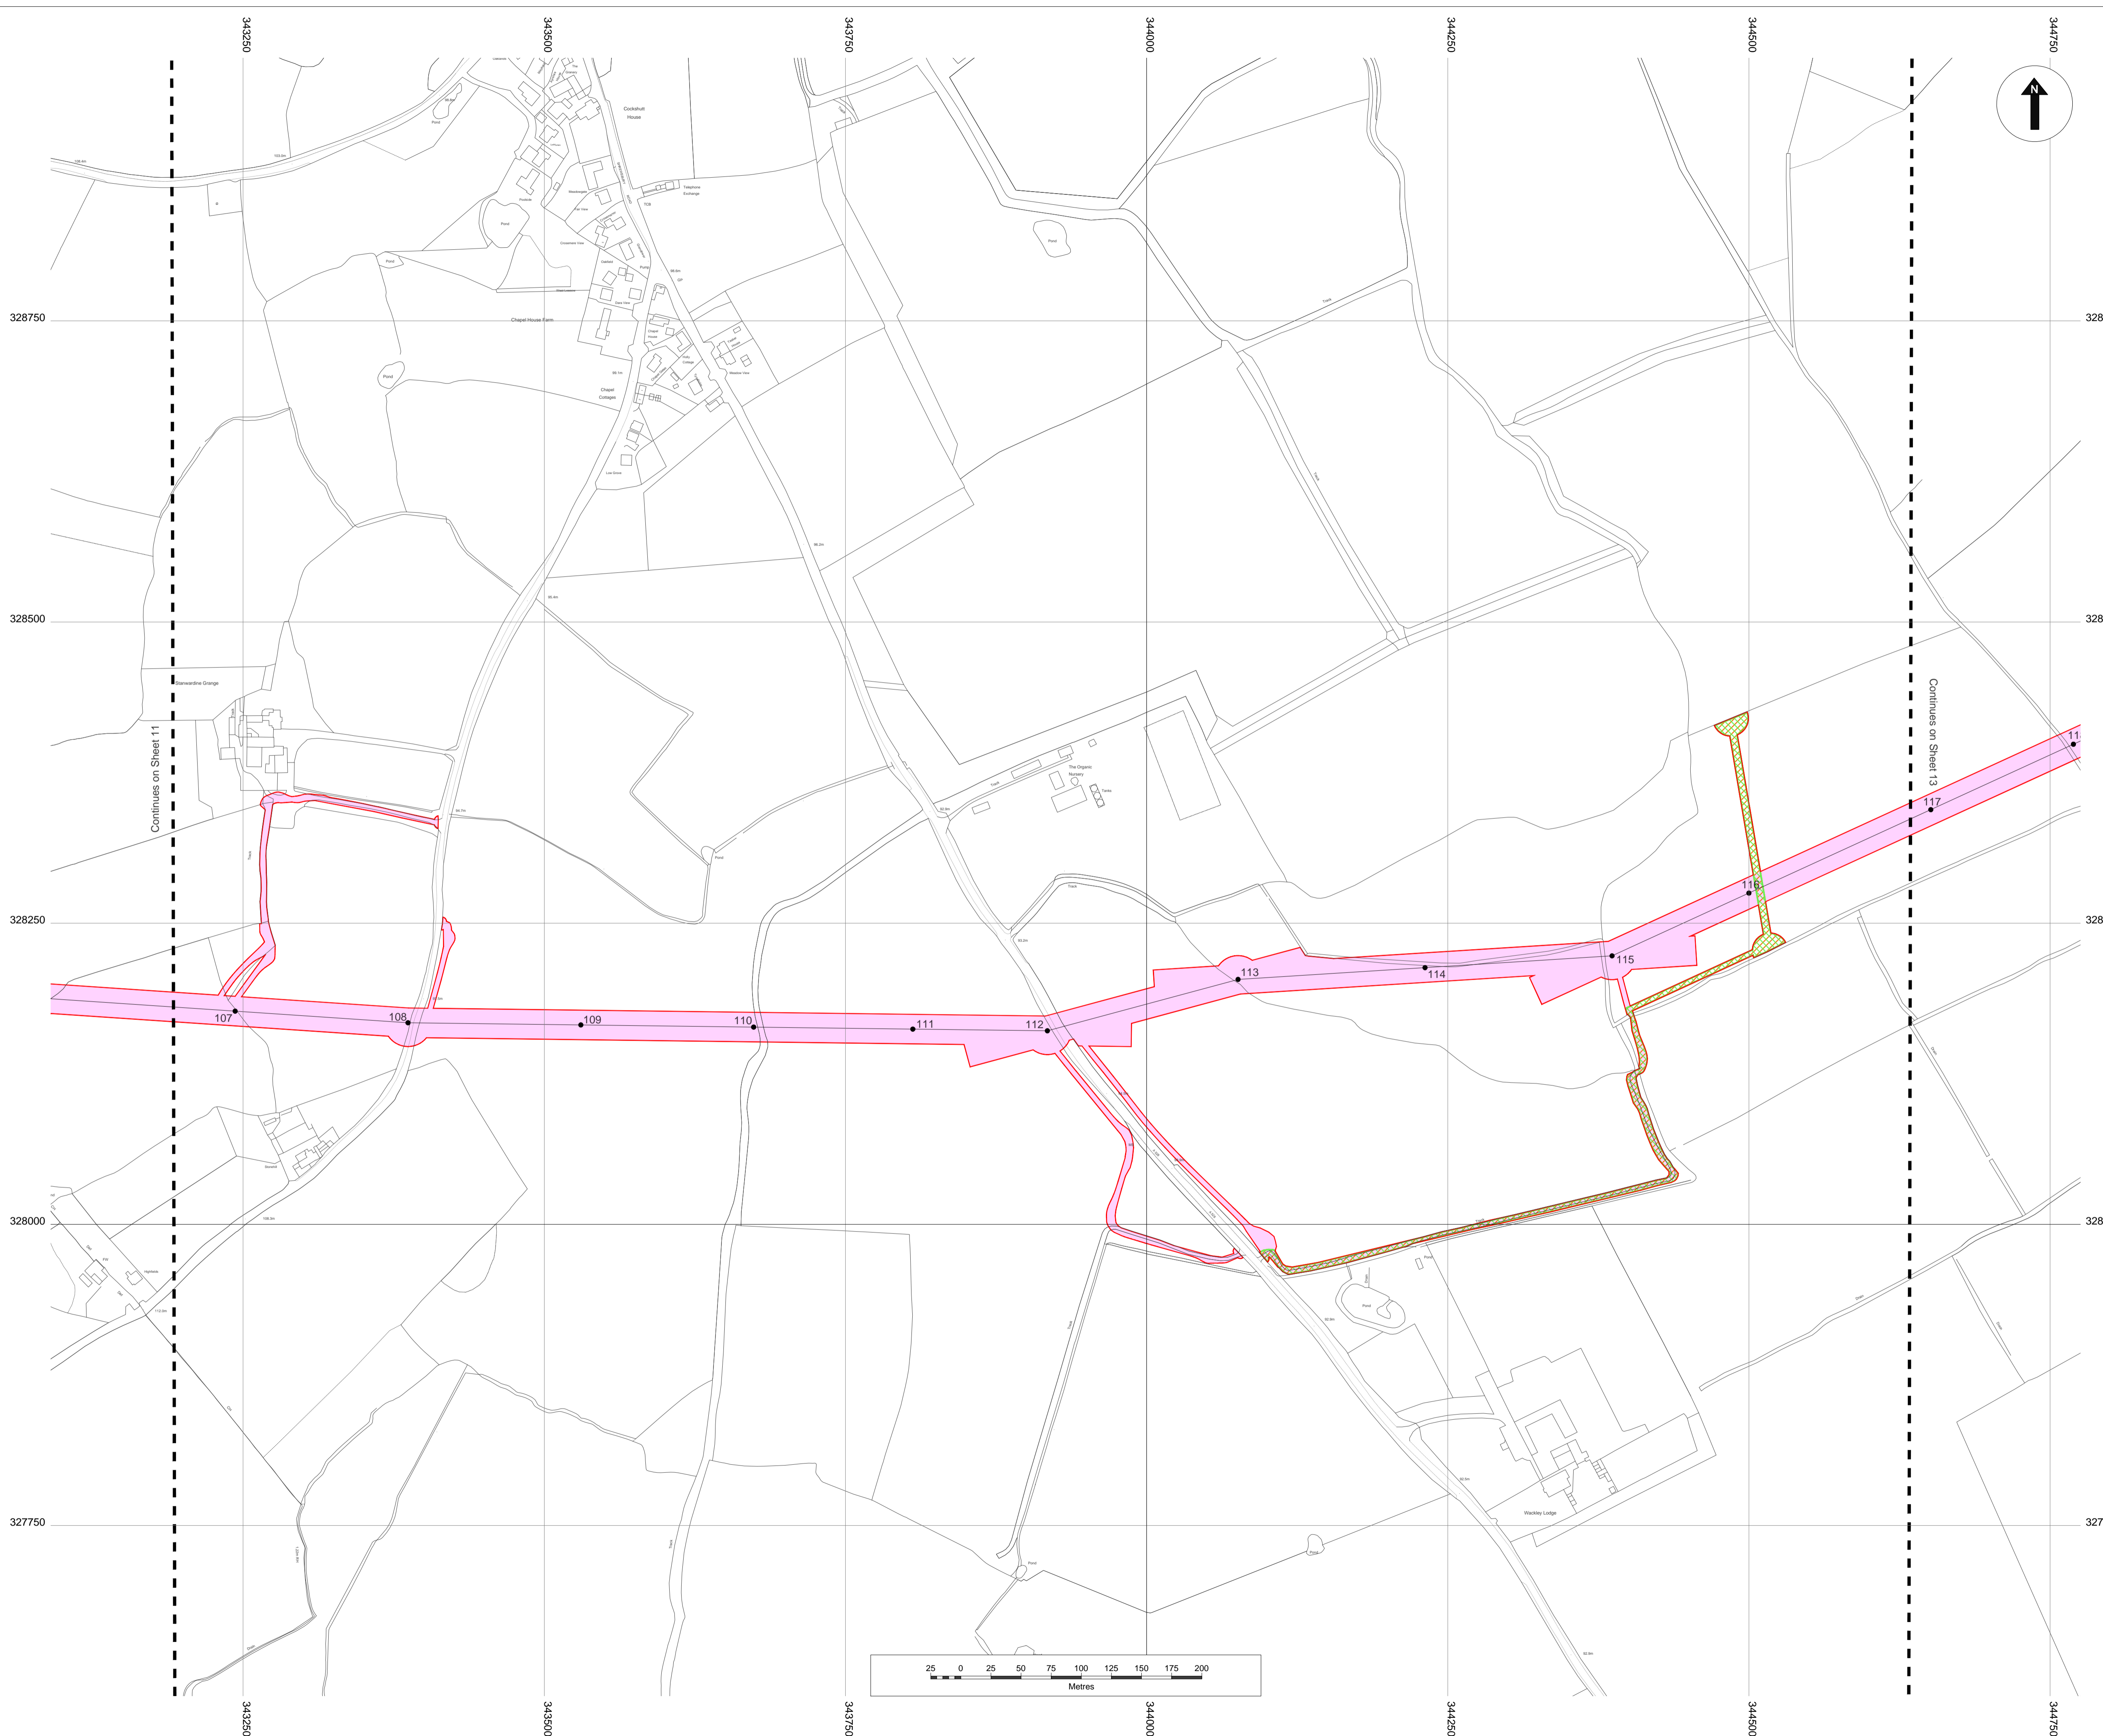

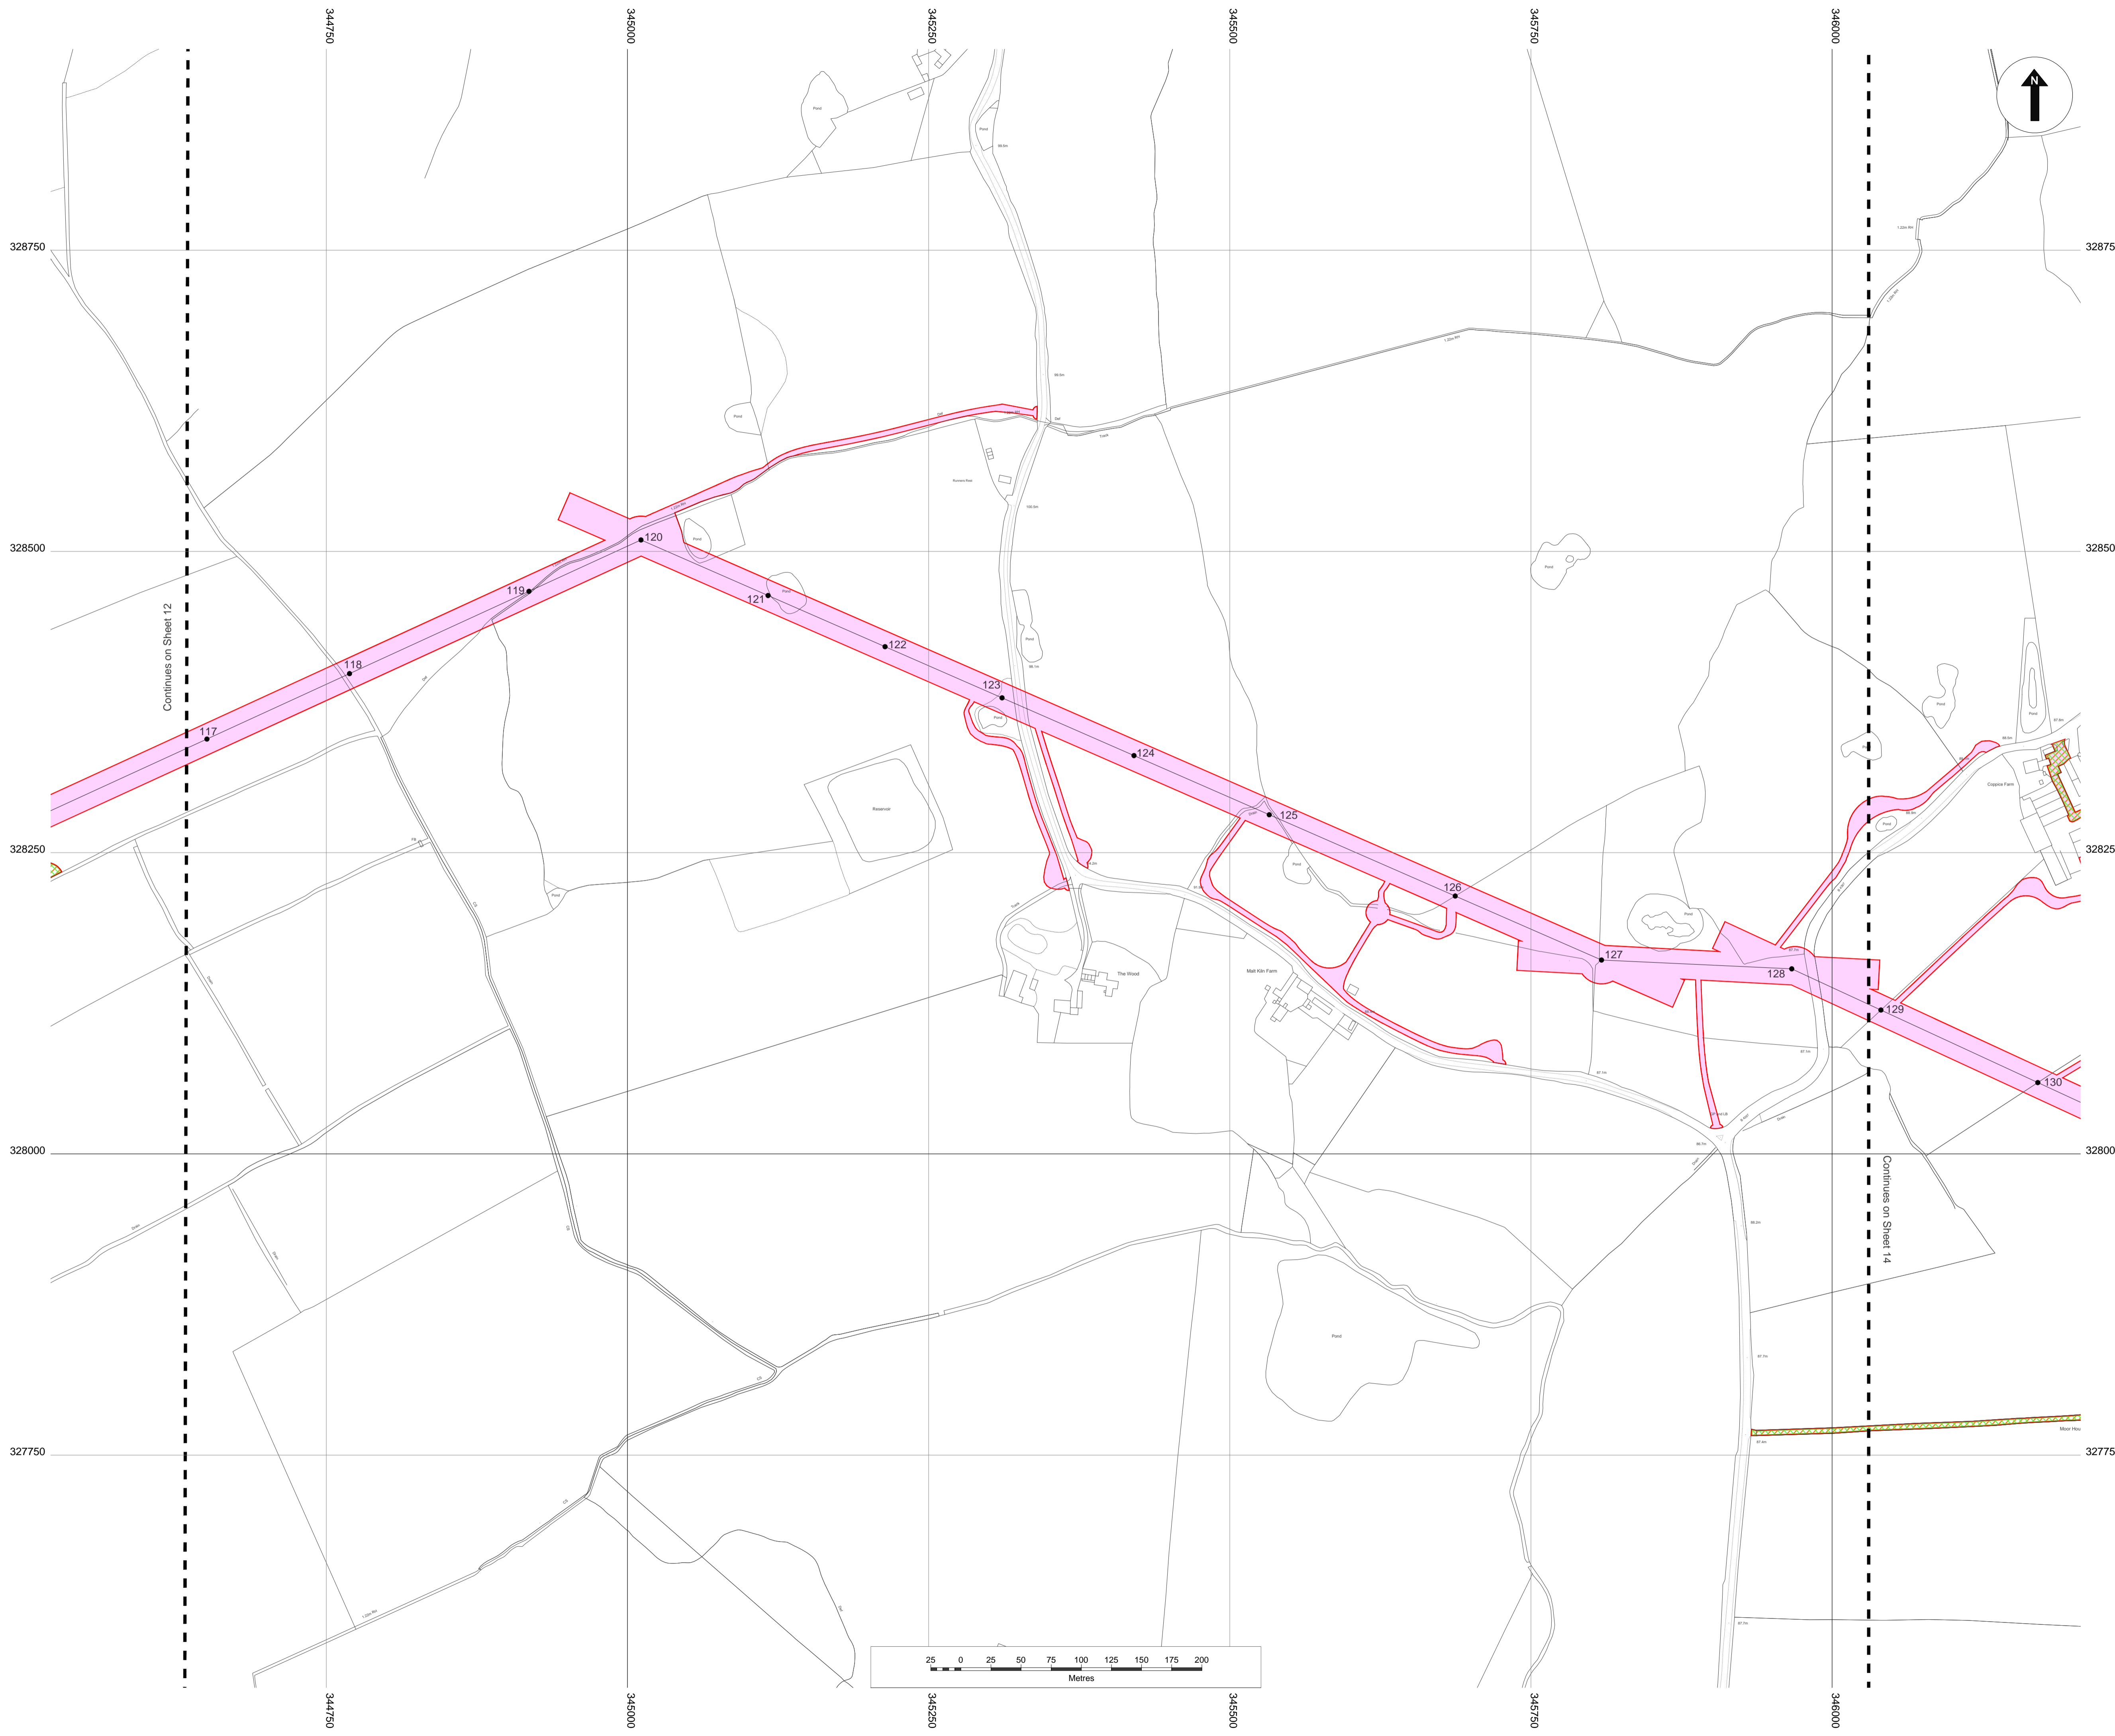

© Crown copyright. All rights reserved.  
2017 Licence number 100019036

- Legend:**
- Land required for, or affected by, the authorised development (the Order Limits)
  - Centre Line of numbered works 3 and indicative pole locations
  - Centre Line of numbered works 2
  - Works No. 1 (Works at Oswestry substation)
  - Works No. 2 (Construction and installation and keeping of a 132kV underground cable and fibre optic cable 1.2km in length)
  - Works No. 3 (Construction and installation of an 132kV overhead electric line and including laydown areas numbered)
  - Works No. 4a (Removal of existing 11kV and 33kV overhead lines)
  - Works No. 4b (Undergrounding of 11kV and 33kV cables)
  - Works No. 5 (Works at Wem substation)
  - Works No. 2 and 3
  - Works No. 3 and 4a
  - Works No. 3 and 4b
  - Works No. 3 and 4a and 4b
  - Works No. 4a and 4b

- Notes:**
1. The Legend is identical on all sheets of the Works Plans and therefore not all items detailed in the Legend are represented on each sheet.
  2. Poles (indicated by number) are not shown to scale. Numbered poles may move up to 5 metres in any direction from their indicative location but may not be sited within 1 metre from the outside edge of any hedgerow. This is referred to as the 'Limit of Deviation' as set out in Requirement 4 to the draft DCO.
  3. Laydown areas are numbered in blue.

Created by:  
TerraQuest Solutions Limited  
Quayside Tower  
252-260 Broad Street  
Birmingham  
B1 2HF  
w: [www.terraquest.co.uk](http://www.terraquest.co.uk)  
e: [info@terraquest.co.uk](mailto:info@terraquest.co.uk)




**Business & Property Solutions**  
A Meads Group plc Company


Created for:  
SP Manweb plc  
3 Prenton Way  
North Cheshire Trading Estate  
Prenton  
CH43 3ET  
w: [www.scottishpower.com](http://www.scottishpower.com)

Title:  
Reinforcement to North Shropshire Electricity  
Distribution Network Order 201X  
Works Plan (Sheet 13 of 16)  
Document 2.3.13  
Regulation 5(2)(j)

Scale: 1:2,500@A1	Date: February 2019	
Drawing No: Sheet 13 of 16	Revision: v5.0	
Approved By: AME	Checked By: ABR	Drawn By: LME

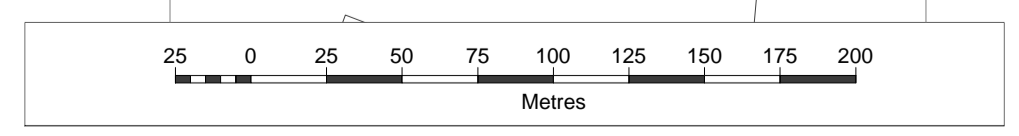



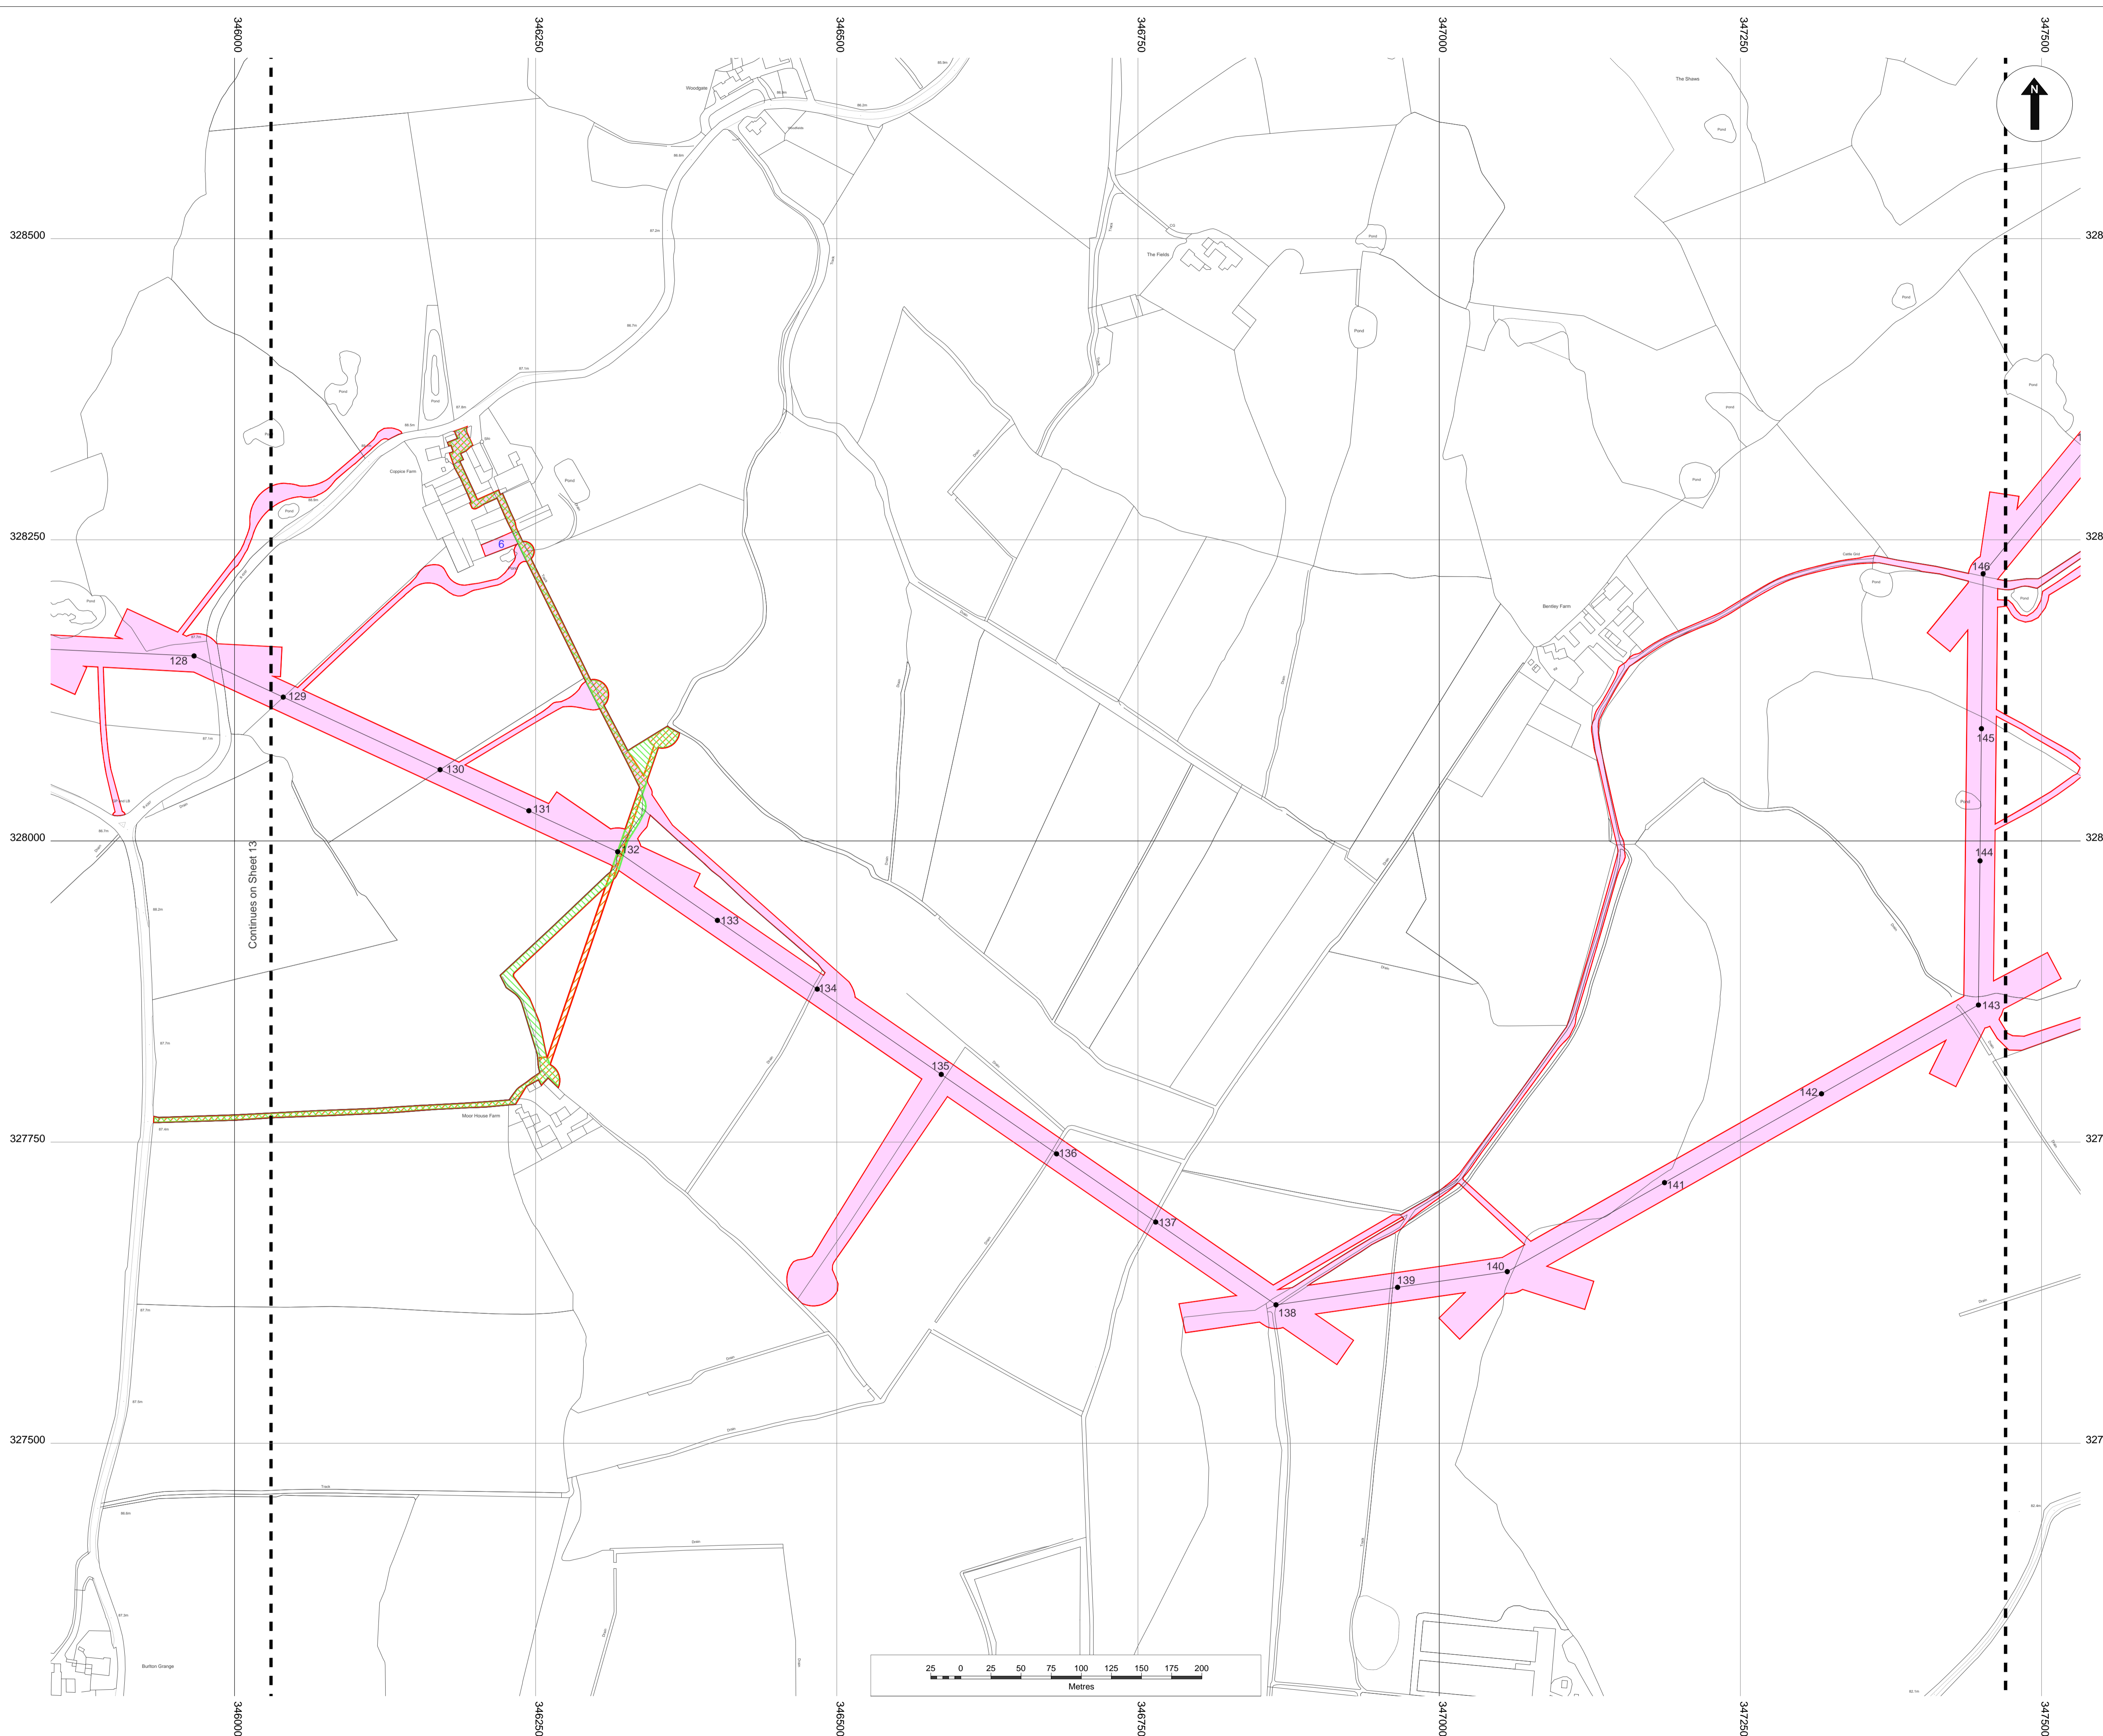

© Crown copyright. All rights reserved.  
2017 Licence number 100019036


**Legend:**

- Land required for, or affected by, the authorised development (the Order Limits)
- Centre Line of numbered works 3 and indicative pole locations
- Centre Line of numbered works 2
- Works No. 1 (Works at Oswestry substation)
- Works No. 2 (Construction and installation and keeping of a 132kV underground cable and fibre optic cable 1.2km in length)
- Works No. 3 (Construction and installation and of an 132kV overhead electric line and including laydown areas numbered)
- Works No. 4a (Removal of existing 11kV and 33kV overhead lines)
- Works No. 4b (Undergrounding of 11kV and 33kV cables)
- Works No. 5 (Works at Wem substation)
- Works No. 2 and 3
- Works No. 3 and 4a
- Works No. 3 and 4b
- Works No. 3 and 4a and 4b
- Works No. 4a and 4b

**Notes:**

1. The Legend is identical on all sheets of the Works Plans and therefore not all items detailed in the Legend are represented on each sheet.
2. Poles (indicated by number) are not shown to scale. Numbered poles may move up to 5 metres in any direction from their indicative location but may not be sited within 1 metre from the outside edge of any hedgerow. This is referred to as the 'Limit of Deviation' as set out in Requirement 4 to the draft DCO.
3. Laydown areas are numbered in blue.


**Created by:**  
TerraQuest Solutions Limited  
Quayside Tower  
252-260 Broad Street  
Birmingham  
B1 2HF  
w: [www.terraquest.co.uk](http://www.terraquest.co.uk)  
e: [info@terraquest.co.uk](mailto:info@terraquest.co.uk)




**Created for:**  
SP Manweb plc  
3 Prenton Way  
North Cheshire Trading Estate  
Prenton  
CH43 3ET  
w: [www.scottishpower.com](http://www.scottishpower.com)

**Title:**  
Reinforcement to North Shropshire Electricity  
Distribution Network Order 201X  
Works Plan (Sheet 14 of 16)  
Document 2.3.14  
Regulation 5(2)(j)

Scale: 1:2,500@A1	Date: February 2019	
Drawing No: Sheet 14 of 16	Revision: v5.0	
Approved By: AME	Checked By: ABR	Drawn By: LME

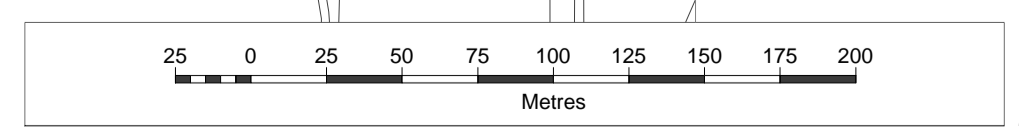

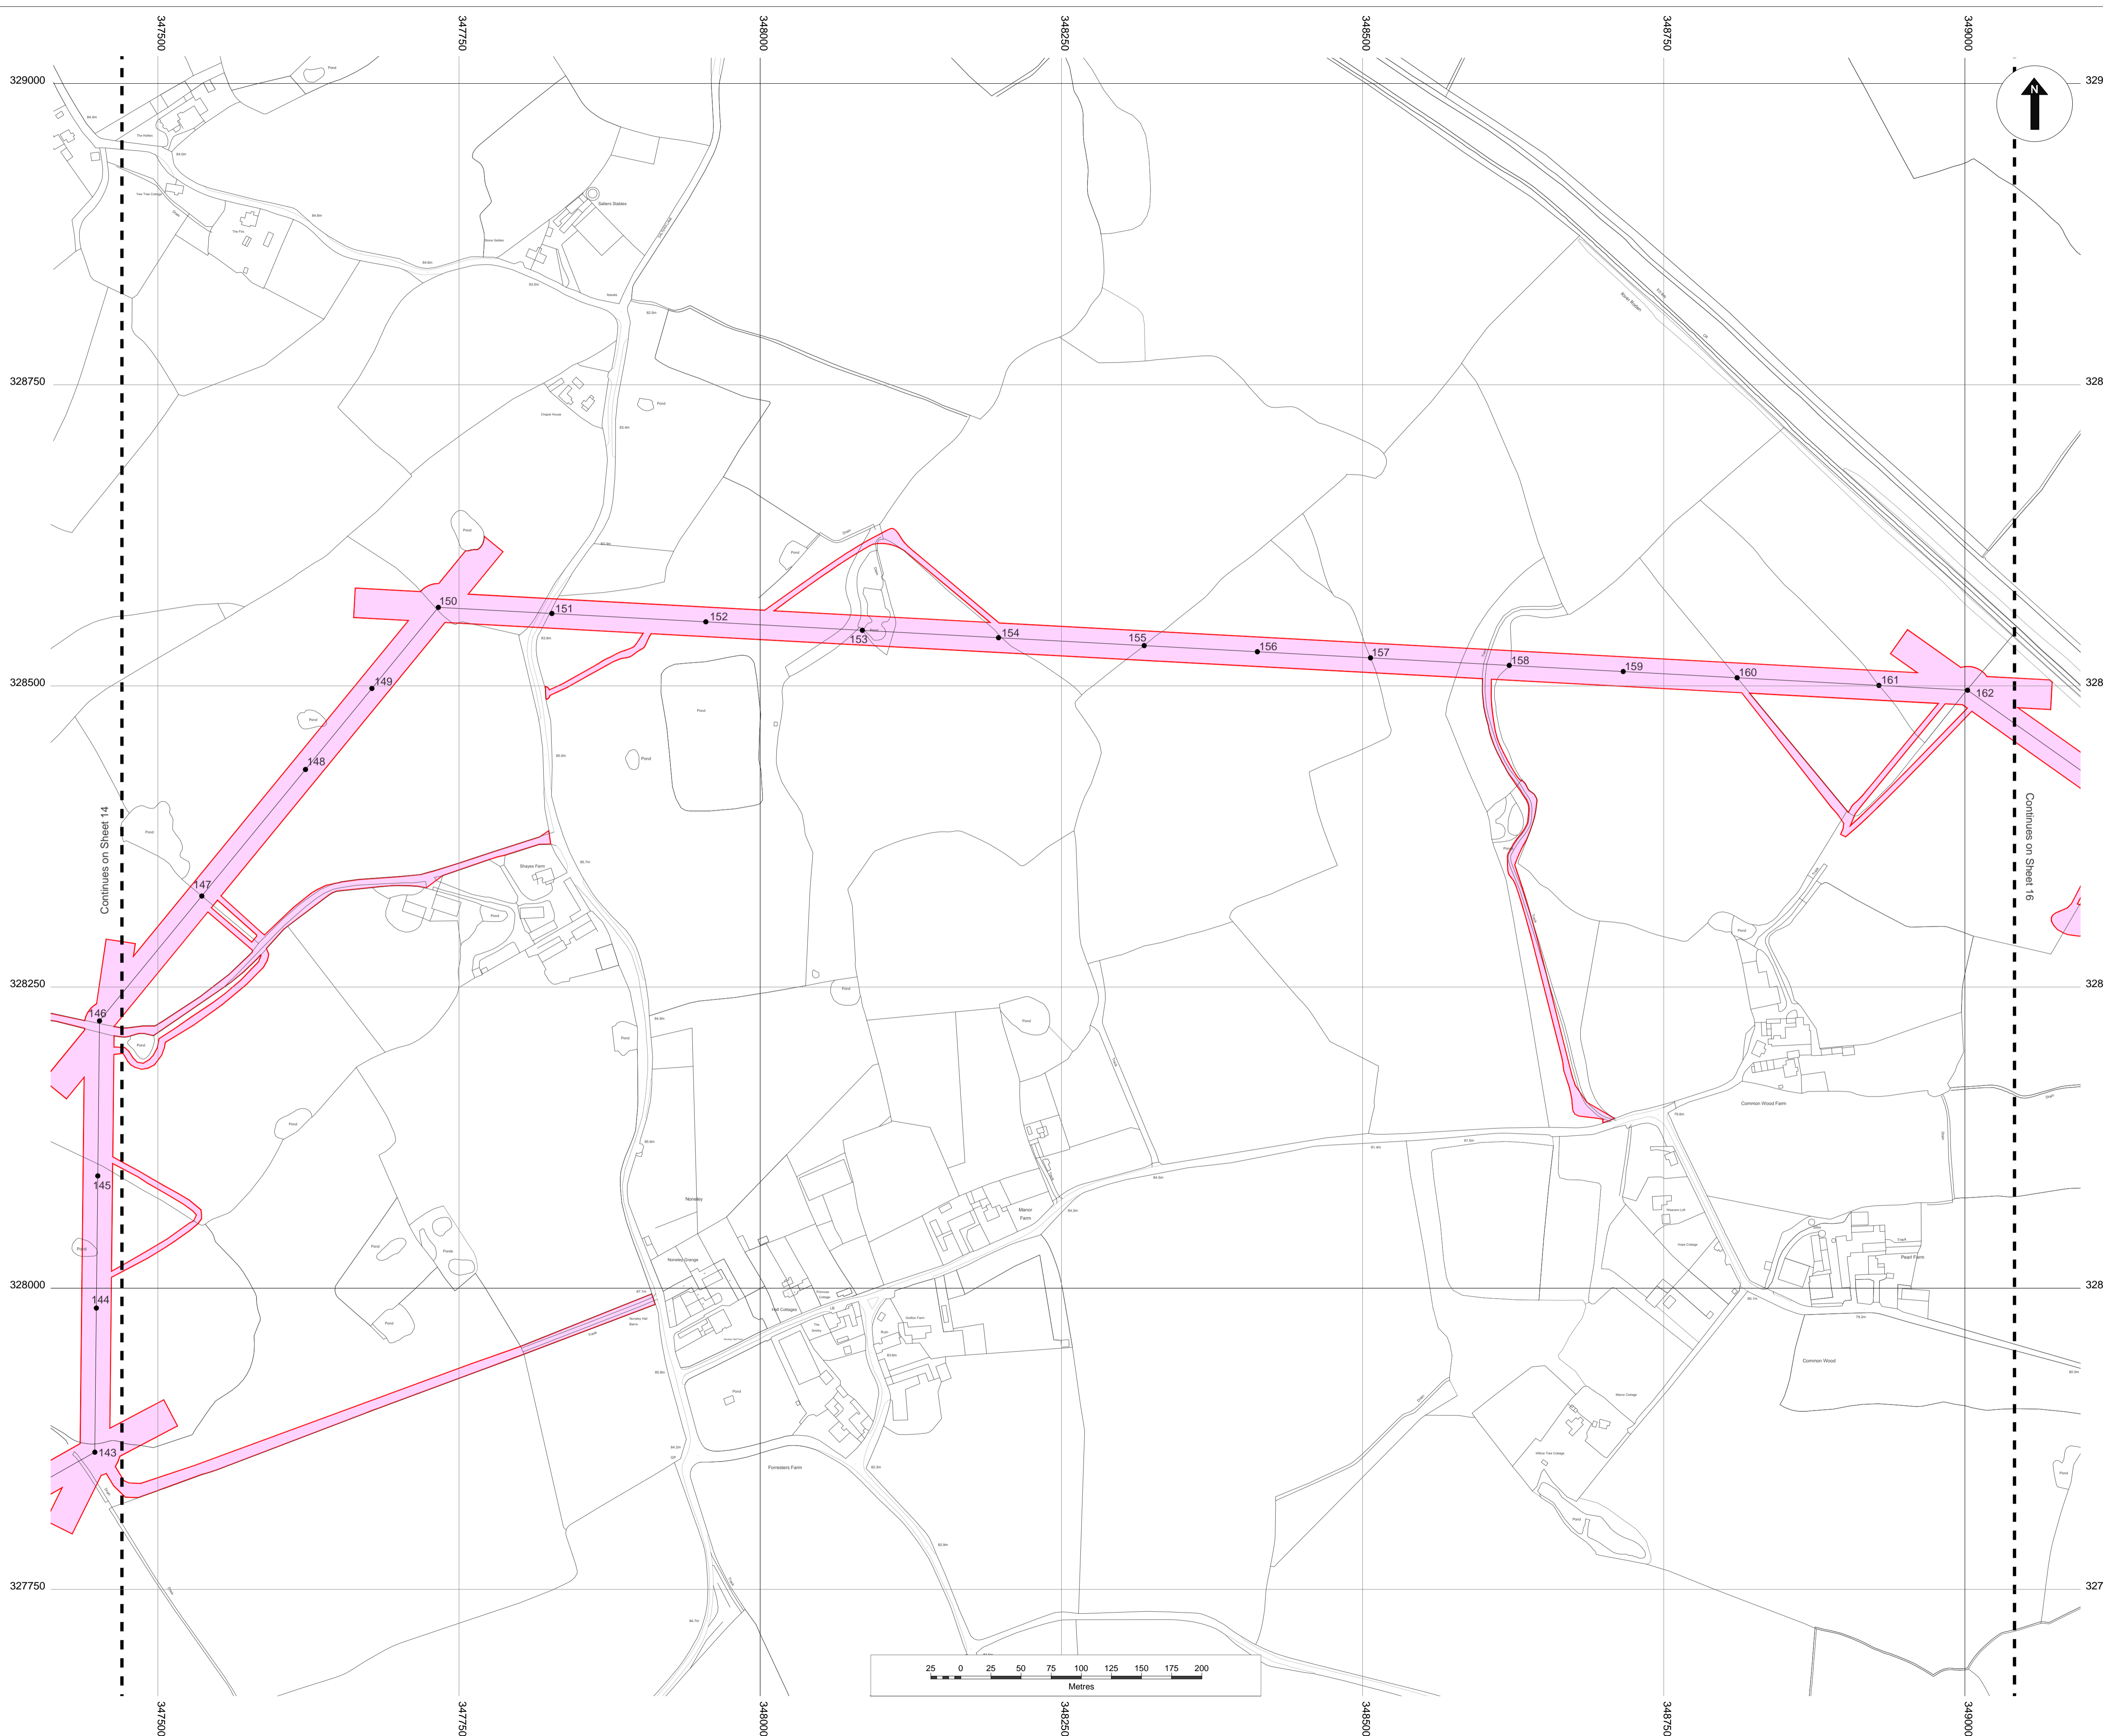

© Crown copyright. All rights reserved.  
2017 Licence number 100019036

- Legend:**
- Land required for, or affected by, the authorised development (the Order Limits)
  - Centre Line of numbered works 3 and indicative pole locations
  - Centre Line of numbered works 2
  - Works No. 1 (Works at Oswestry substation)
  - Works No. 2 (Construction and installation and keeping of a 132kV underground cable and fibre optic cable 1.2km in length)
  - Works No. 3 (Construction and installation and of an 132kV overhead electric line and including laydown areas numbered)
  - Works No. 4a (Removal of existing 11kV and 33kV overhead lines)
  - Works No. 4b (Undergrounding of 11kV and 33kV cables)
  - Works No. 5 (Works at Wem substation)
  - Works No. 2 and 3
  - Works No. 3 and 4a
  - Works No. 3 and 4b
  - Works No. 3 and 4a and 4b
  - Works No. 4a and 4b

- Notes:**
1. The Legend is identical on all sheets of the Works Plans and therefore not all items detailed in the Legend are represented on each sheet.
  2. Poles (indicated by number) are not shown to scale. Numbered poles may move up to 5 metres in any direction from their indicative location but may not be sited within 1 metre from the outside edge of any hedgerow. This is referred to as the 'Limit of Deviation' as set out in Requirement 4 to the draft DCO.
  3. Laydown areas are numbered in blue.

Created by:  
TerraQuest Solutions Limited  
Quayside Tower  
252-260 Broad Street  
Birmingham  
B1 2HF  
w: [www.terraquest.co.uk](http://www.terraquest.co.uk)  
e: [info@terraquest.co.uk](mailto:info@terraquest.co.uk)




**TerraQuest**  
Business & Property Solutions  
A Mears Group plc Company

Created for:  
SP Manweb plc  
3 Prenton Way  
North Cheshire Trading Estate  
Prenton  
CH43 3ET  
w: [www.scottishpower.com](http://www.scottishpower.com)

Title:  
Reinforcement to North Shropshire Electricity  
Distribution Network Order 201X  
Works Plan (Sheet 15 of 16)  
Document 2.3.15  
Regulation 5(2)(j)

Scale: 1:2,500@A1	Date: February 2019	
Drawing No: Sheet 15 of 16	Revision: v5.0	
Approved By: AME	Checked By: ABR	Drawn By: LME

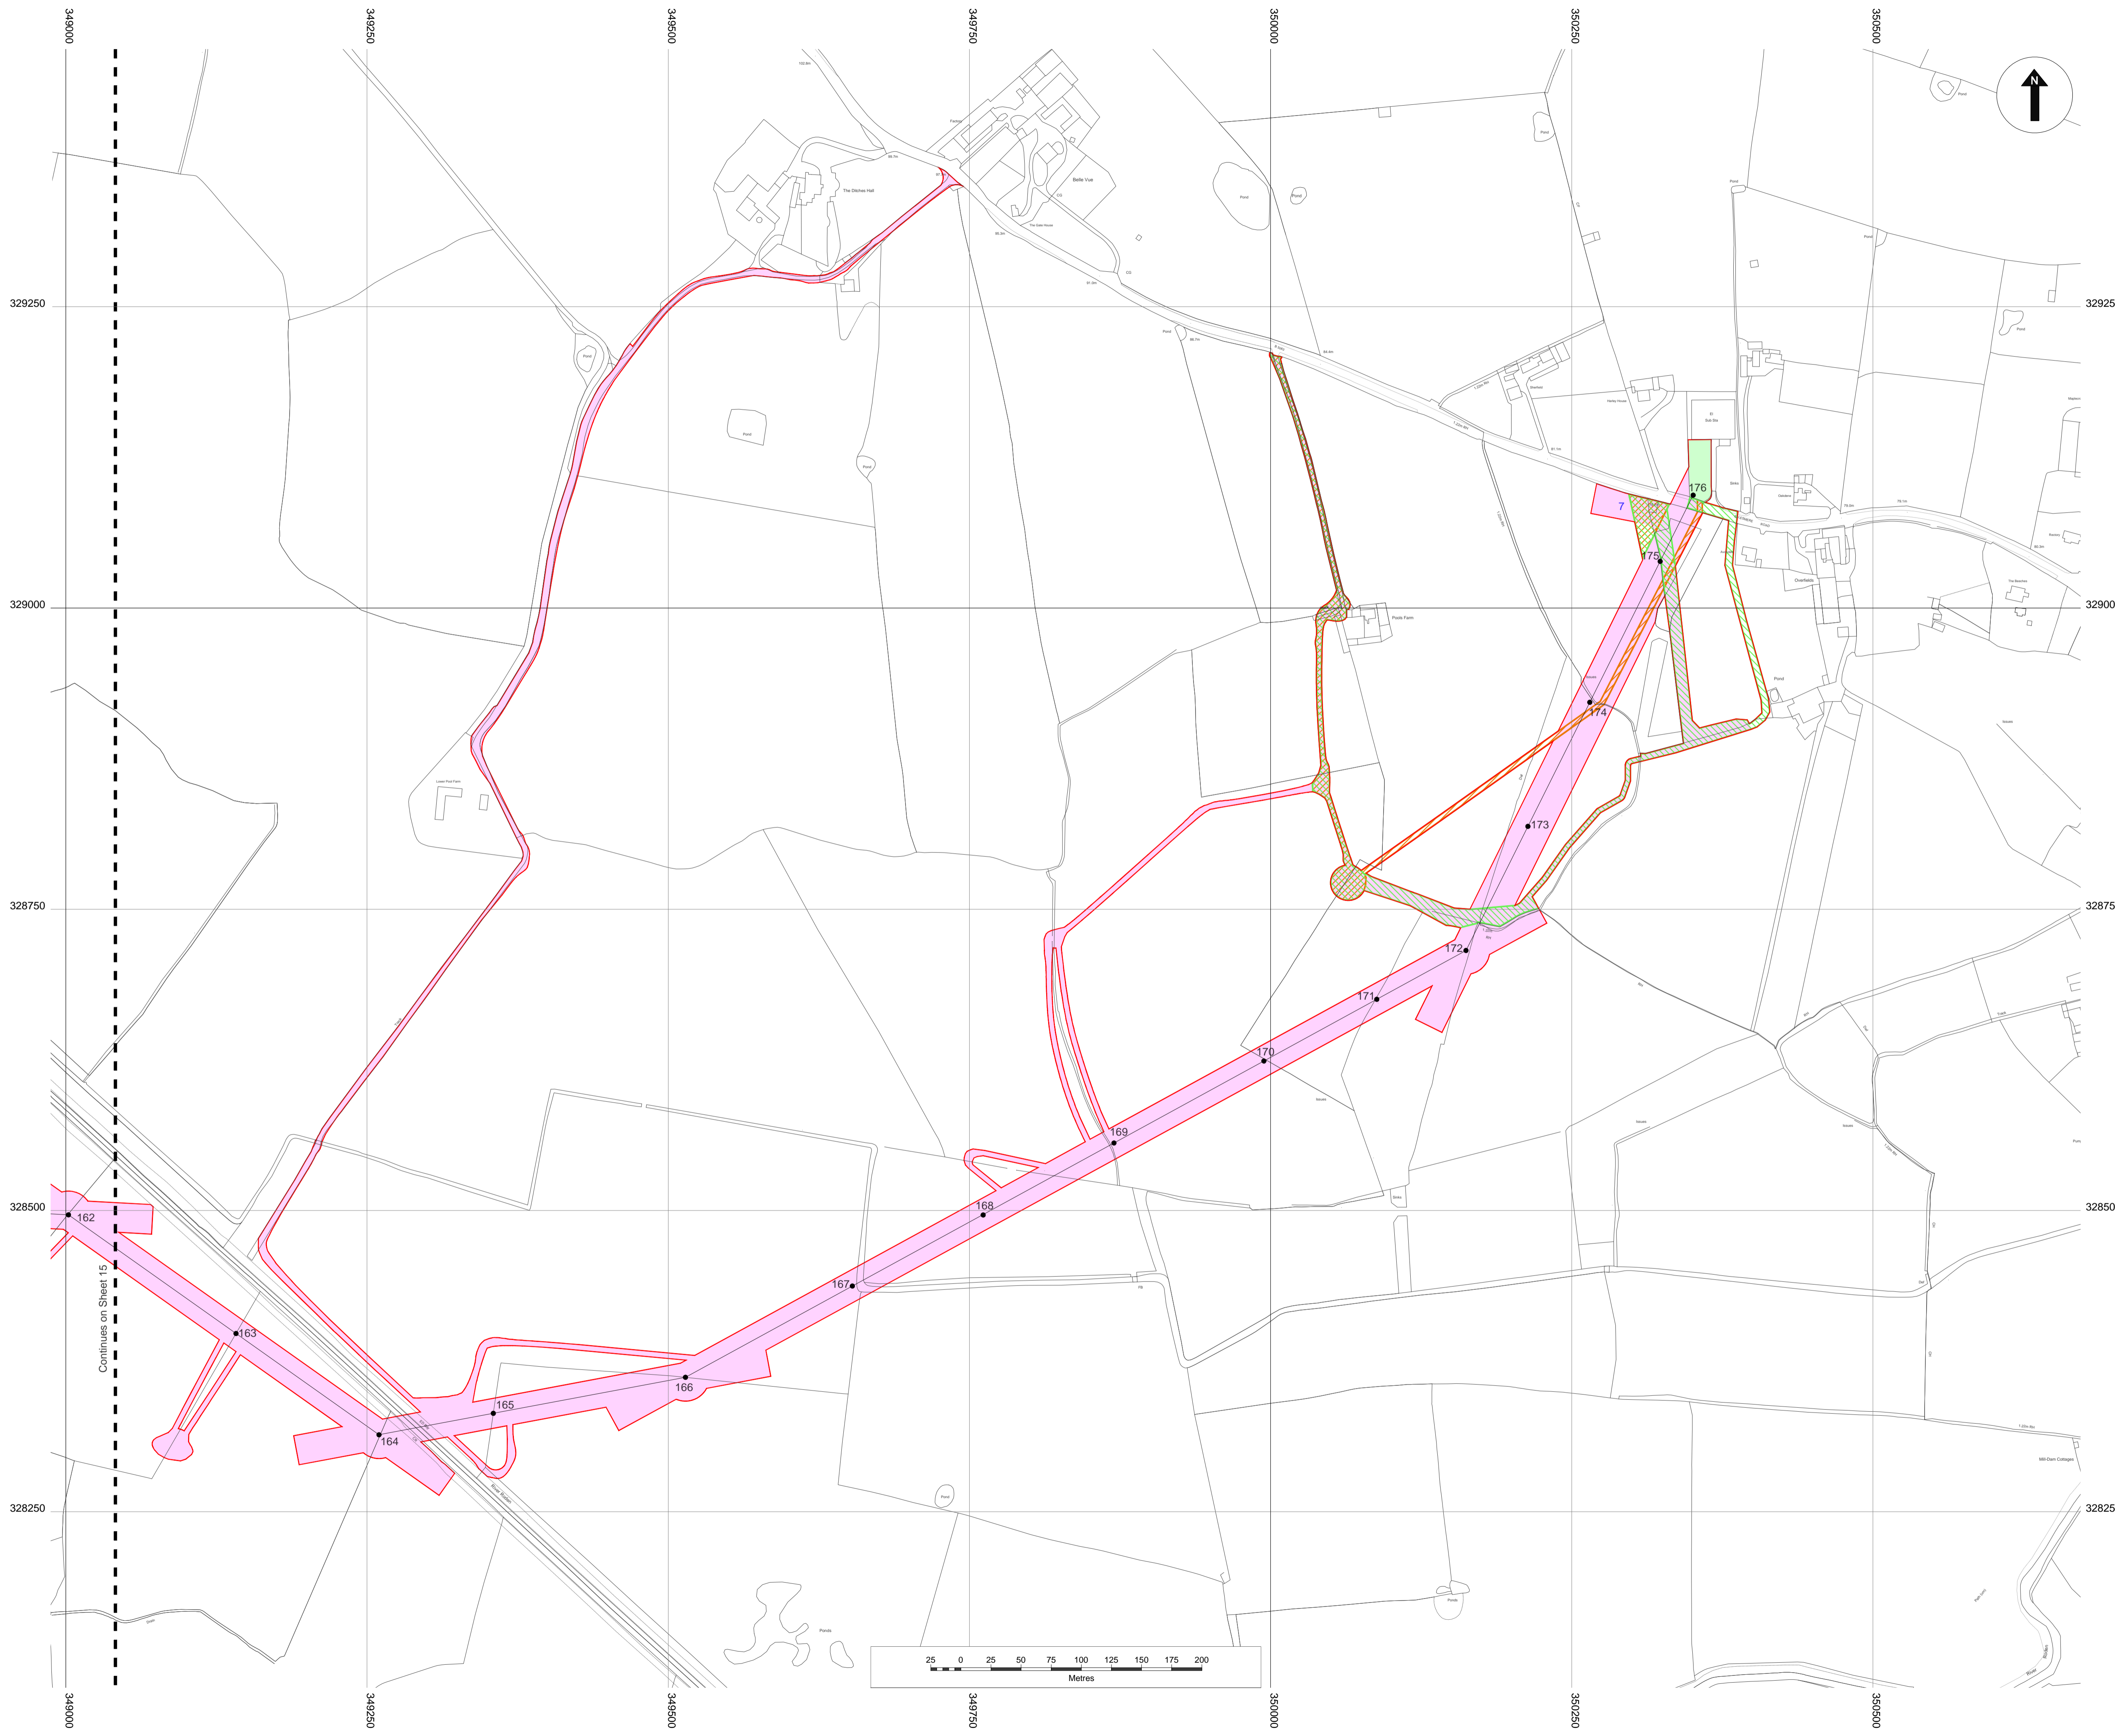

© Crown copyright. All rights reserved.  
2017 Licence number 100019036

- Legend:**
- Land required for, or affected by, the authorised development (the Order Limits)
  - Centre Line of numbered works 3 and indicative pole locations
  - Centre Line of numbered works 2
  - Works No. 1 (Works at Oswestry substation)
  - Works No. 2 (Construction and installation and keeping of a 132kV underground cable and fibre optic cable 1.2km in length)
  - Works No. 3 (Construction and installation of an 132kV overhead electric line and including laydown areas numbered)
  - Works No. 4a (Removal of existing 11kV and 33kV overhead lines)
  - Works No. 4b (Undergrounding of 11kV and 33kV cables)
  - Works No. 5 (Works at Wem substation)
  - Works No. 2 and 3
  - Works No. 3 and 4a
  - Works No. 3 and 4b
  - Works No. 3 and 4a and 4b
  - Works No. 4a and 4b

- Notes:**
1. The Legend is identical on all sheets of the Works Plans and therefore not all items detailed in the Legend are represented on each sheet.
  2. Poles (indicated by number) are not shown to scale. Numbered poles may move up to 5 metres in any direction from their indicative location but may not be sited within 1 metre from the outside edge of any hedgerow. This is referred to as the 'Limit of Deviation' as set out in Requirement 4 to the draft DCO.
  3. Laydown areas are numbered in blue.

Created by:  
TerraQuest Solutions Limited  
Quayside Tower  
252-260 Broad Street  
Birmingham  
B1 2HF  
w: [www.terraquest.co.uk](http://www.terraquest.co.uk)  
e: [info@terraquest.co.uk](mailto:info@terraquest.co.uk)



**TerraQuest**  
A Mears Group plc Company  
Business & Property Solutions

Created for:  
SP Manweb plc  
3 Prenton Way  
North Cheshire Trading Estate  
Prenton  
CH43 3ET  
w: [www.scottishpower.com](http://www.scottishpower.com)

**Title:**  
Reinforcement to North Shropshire Electricity  
Distribution Network Order 201X  
Works Plan (Sheet 16 of 16)  
Document 2.3.16  
Regulation 5(2)(j)

Scale: 1:2,500@A1	Date: February 2019
Drawing No: Sheet 16 of 16	Revision: v5.0
Approved By: AME	Checked By: ABR
	Drawn By: LME