



## **Reinforcement to the North Shropshire Electricity Distribution Network**

SP Manweb's Responses to S51 Advice and Comments on the  
S55 Checklist

Application Reference: EN020021

**Environmental Statement Fig 9.1 Mapped Flood Risk  
V2**

---

**SP MANWEB**

**Reinforcement to the North Shropshire Electricity  
Distribution Network**

**ES Figure 9.1 - Mapped Flood Risk V2**

**PINS Reference EN020021**

**QA Box**

<b>Author</b>		<b>SP Manweb</b>	
<b>Planning Inspectorate</b>		<b>EN020021</b>	
<b>Application Reference APP-083</b>			
<b>Date</b>	<b>Version</b>	<b>Status</b>	<b>Description/Changes</b>
06/03/2019	2	Final	ES Figure 9.1 ( <b>DCO Document 6.14</b> (APP-083)) updated in response to S51 Advice / S55 checklist comments from PINS 10/12/18 Submitted to PINS





- KEY**
- FINAL ROUTE ALIGNMENT
  - ORDER LIMITS
  - 500m STUDY AREA
  - PROPOSED 132 kV UNDERGROUND CABLE
  - PROPOSED TEMPORARY LAYDOWN


- PROPOSED UNDERGROUND ROUTE OF EXISTING LOWER VOLTAGE OVERHEAD LINE BEING REMOVED
- EXISTING LOWER VOLTAGE OVERHEAD LINE TO BE REMOVED
- EXISTING LOWER VOLTAGE OVERHEAD LINE TO BE REPLACED WITH NEW UNDERGROUND CABLE ON SAME ALIGNMENT

- FLOOD RISK 3
- FLOOD RISK 2
- CANAL
- RIVER / WATERCOURSE

**Notes:**  
 This drawing is scaled at an A3 paper size, therefore any prints made at a smaller size will affect the accuracy of measurement units and should not be scaled against.  
 The study areas extend from the Order Limits, but only taking into account the proposed overhead line.




BACKGROUND MAPPING INFORMATION HAS BEEN REPRODUCED FROM THE ORDNANCE SURVEY MAP BY PERMISSION OF HER MAJESTY'S STATIONERY OFFICE. CROWN COPYRIGHT AND DATABASE RIGHTS 2018. ORDNANCE SURVEY 0100031673. CONTAINS OS DATA © CROWN COPYRIGHT AND DATABASE RIGHT 2018.

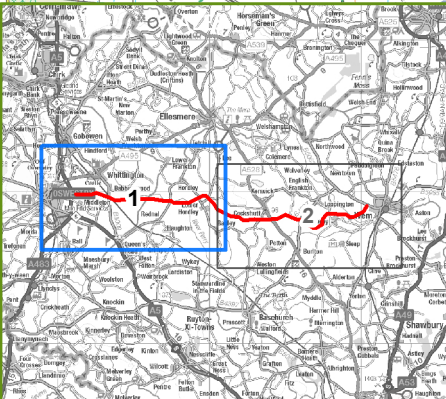

<b>GILLESPIES</b>		<b>SP MANWEB</b>	
Scheme Name: REINFORCEMENT TO NORTH SHROPSHIRE ELECTRICITY DISTRIBUTION NETWORK			
Document: ENVIRONMENTAL STATEMENT FIGURES DCO DOCUMENT 6.14			
Document Title: CHAPTER 9: HYDROLOGY FIGURE 9.1 MAPPED FLOOD RISK PAGE 1 OF 2			
Drawn: KC	Checked: ZF	Approved: JC	Date: 06/03/2019
Document Type: FIGURE		Scale: 1:30,000	Sheet: 1 OF 2
		Sheet Size: A3 (420 mm x 297 mm)	Rev: 2

**NOTE: PLAN COVERS AREA INCLUDED WITHIN PART 1: SEVERN RIVER BASIN DISTRICT, RIVER BASIN MANAGEMENT PLAN (UPDATED DECEMBER 2015)**



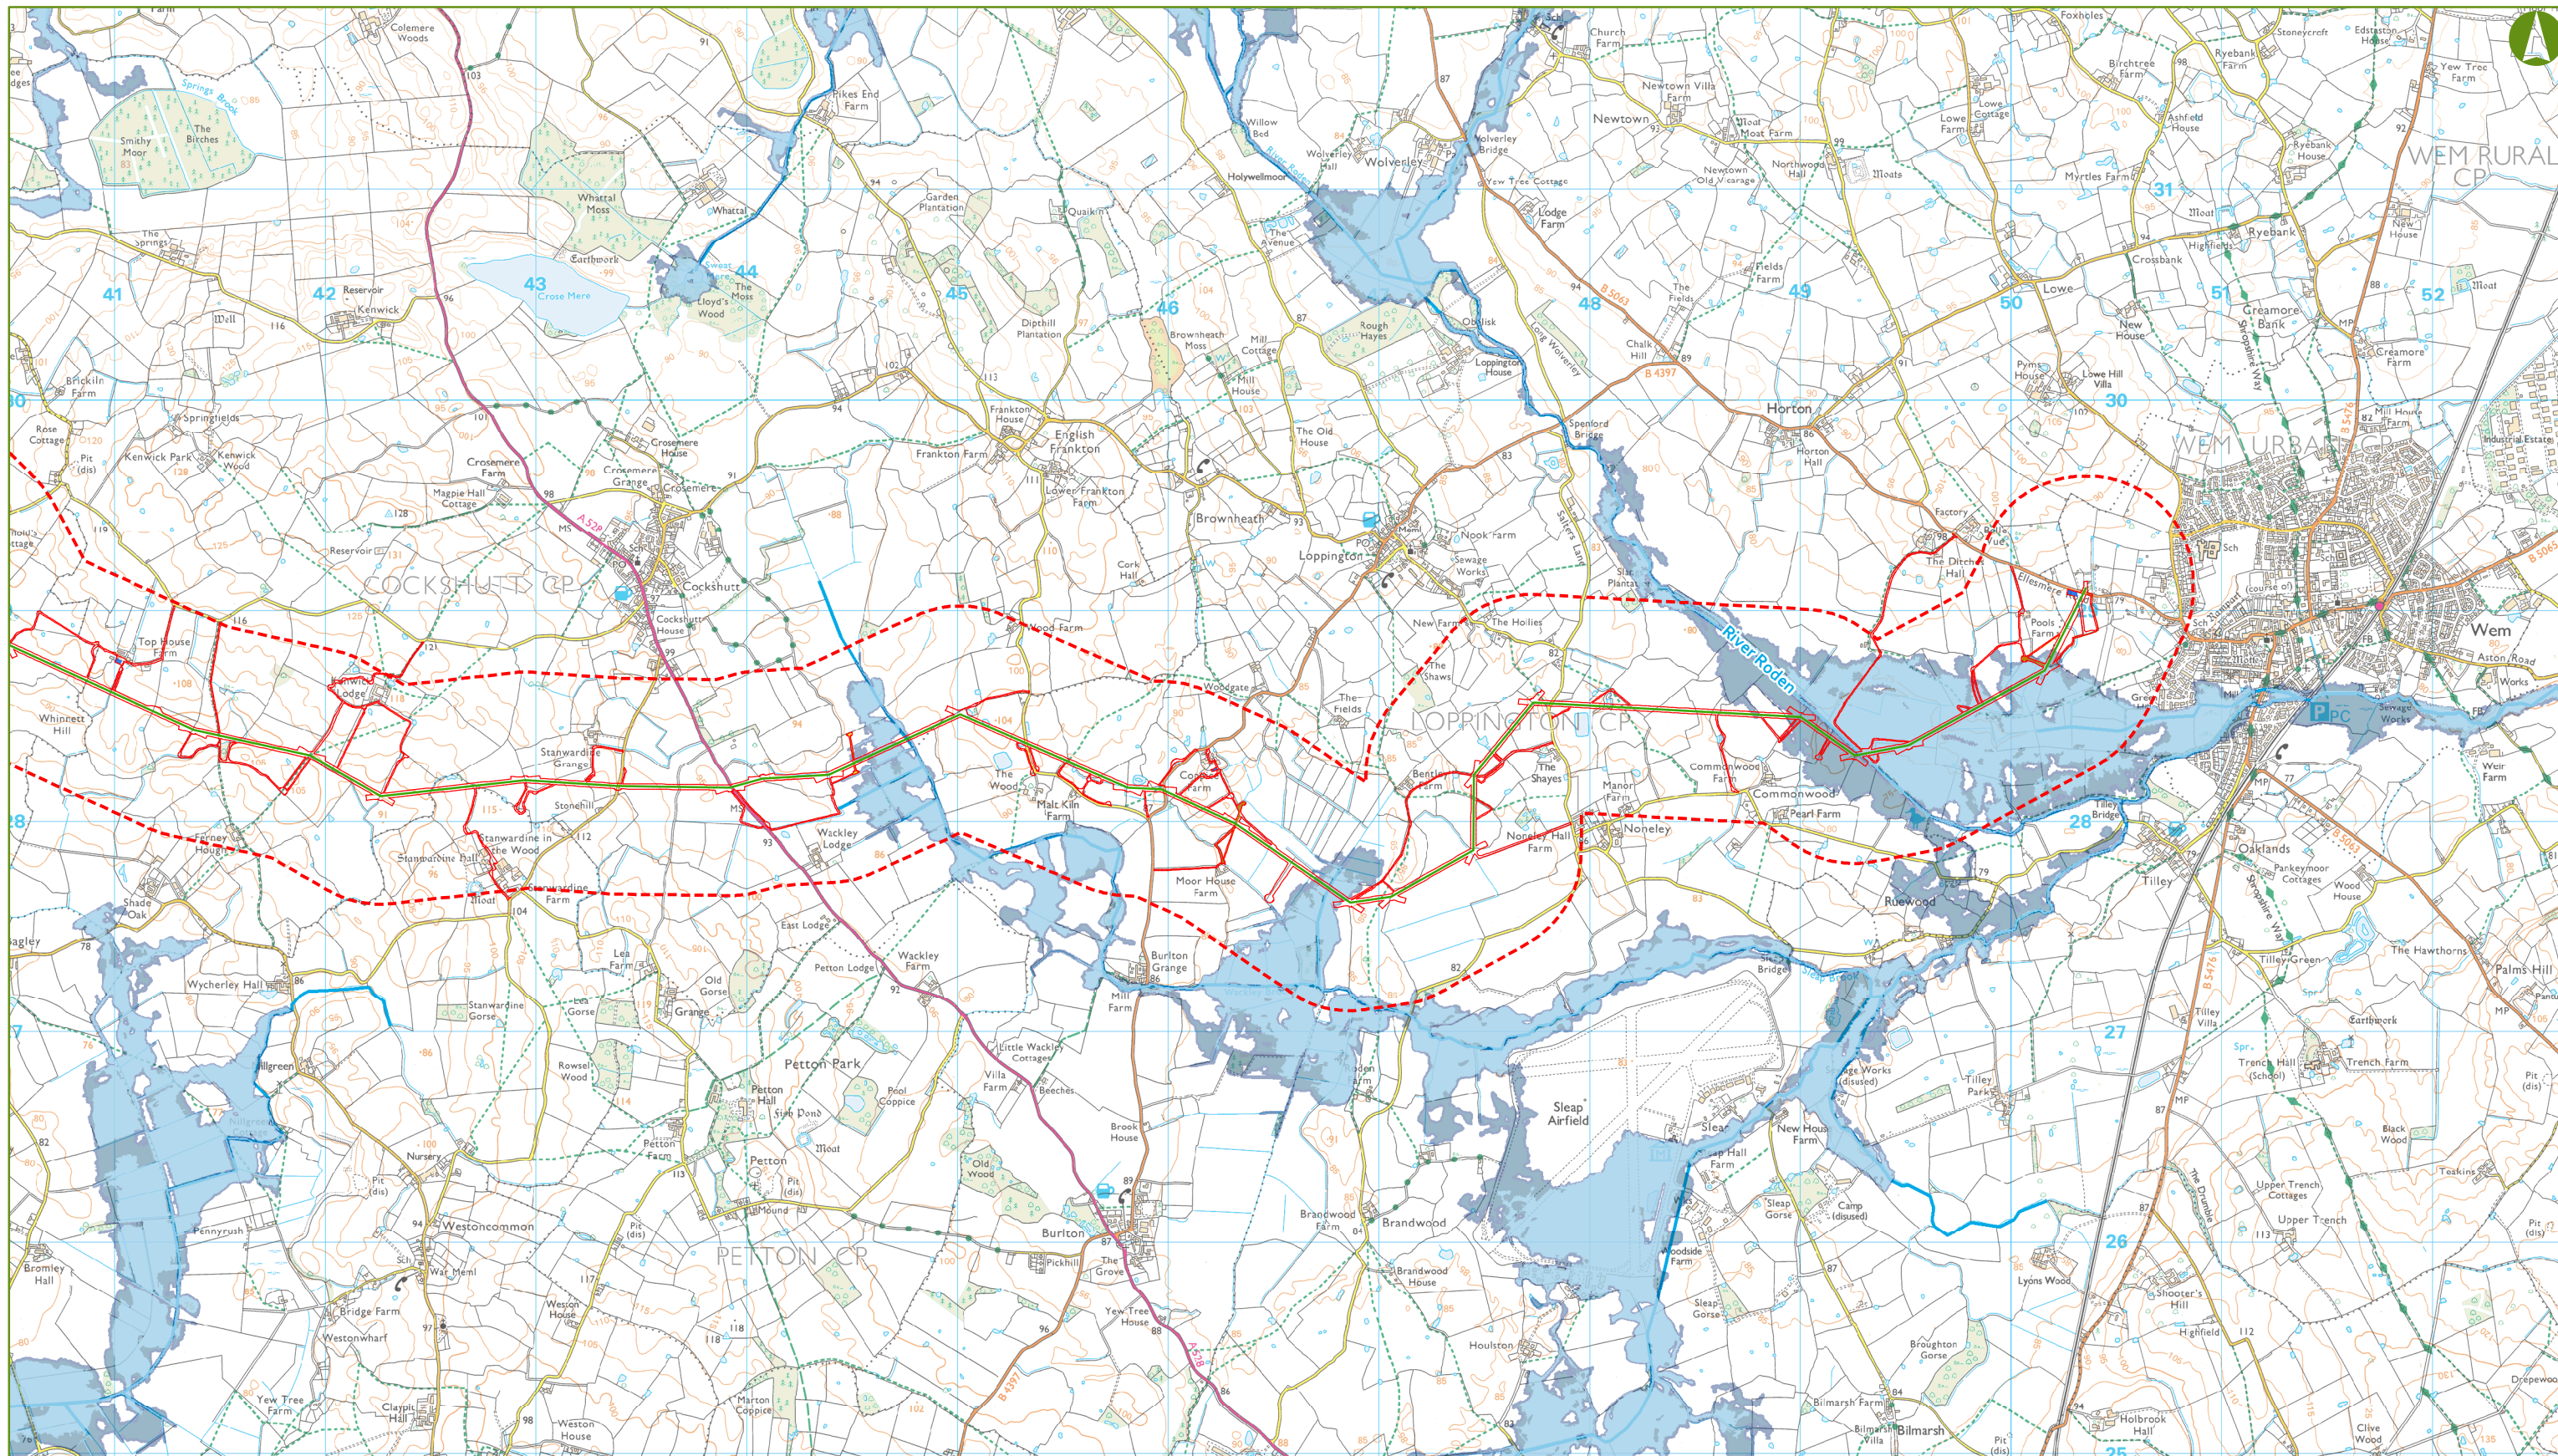

- KEY**
- FINAL ROUTE ALIGNMENT
  - ORDER LIMITS
  - 500m STUDY AREA
  - PROPOSED 132 KV UNDERGROUND CABLE
  - PROPOSED TEMPORARY LAYDOWN


- PROPOSED UNDERGROUND ROUTE OF EXISTING LOWER VOLTAGE OVERHEAD LINE BEING REMOVED
- EXISTING LOWER VOLTAGE OVERHEAD LINE TO BE REMOVED
- EXISTING LOWER VOLTAGE OVERHEAD LINE TO BE REPLACED WITH NEW UNDERGROUND CABLE ON SAME ALIGNMENT

- FLOOD RISK 3
- FLOOD RISK 2
- CANAL
- RIVER / WATERCOURSE


**Notes:**

This drawing is scaled at an A3 paper size, therefore any prints made at a smaller size will affect the accuracy of measurement units and should not be scaled against.

The study areas extend from the Order Limits, but only taking into account the proposed overhead line.



BACKGROUND MAPPING INFORMATION HAS BEEN REPRODUCED FROM THE ORDNANCE SURVEY MAP BY PERMISSION OF HER MAJESTY'S STATIONERY OFFICE. CROWN COPYRIGHT AND DATABASE RIGHTS 2018. ORDNANCE SURVEY 0100031673. CONTAINS OS DATA © CROWN COPYRIGHT AND DATABASE RIGHT 2018.

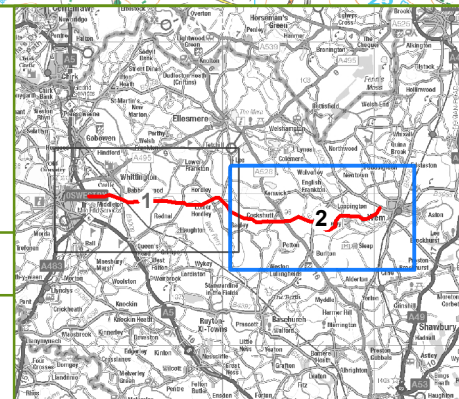

**GILLESPIES** **SP MANWEB**

Scheme Name: REINFORCEMENT TO NORTH SHROPSHIRE ELECTRICITY DISTRIBUTION NETWORK

Document: ENVIRONMENTAL STATEMENT FIGURES DCO DOCUMENT 6.14

Document Title: CHAPTER 9: HYDROLOGY  
FIGURE 9.1 MAPPED FLOOD RISK  
PAGE 2 OF 2

Drawn: KC	Checked: ZF	Approved: JC	Date: 06/03/2019	Sheet: 2 OF 2	Rev: 2
Document Type: FIGURE	Scale: 1:30,000	Sheet Size: A3 (420 mm x 297 mm)			

**NOTE: PLAN COVERS AREA INCLUDED WITHIN PART 1: SEVERN RIVER BASIN DISTRICT, RIVER BASIN MANAGEMENT PLAN (UPDATED DECEMBER 2015)**