A1 in Northumberland Part B - Map 2

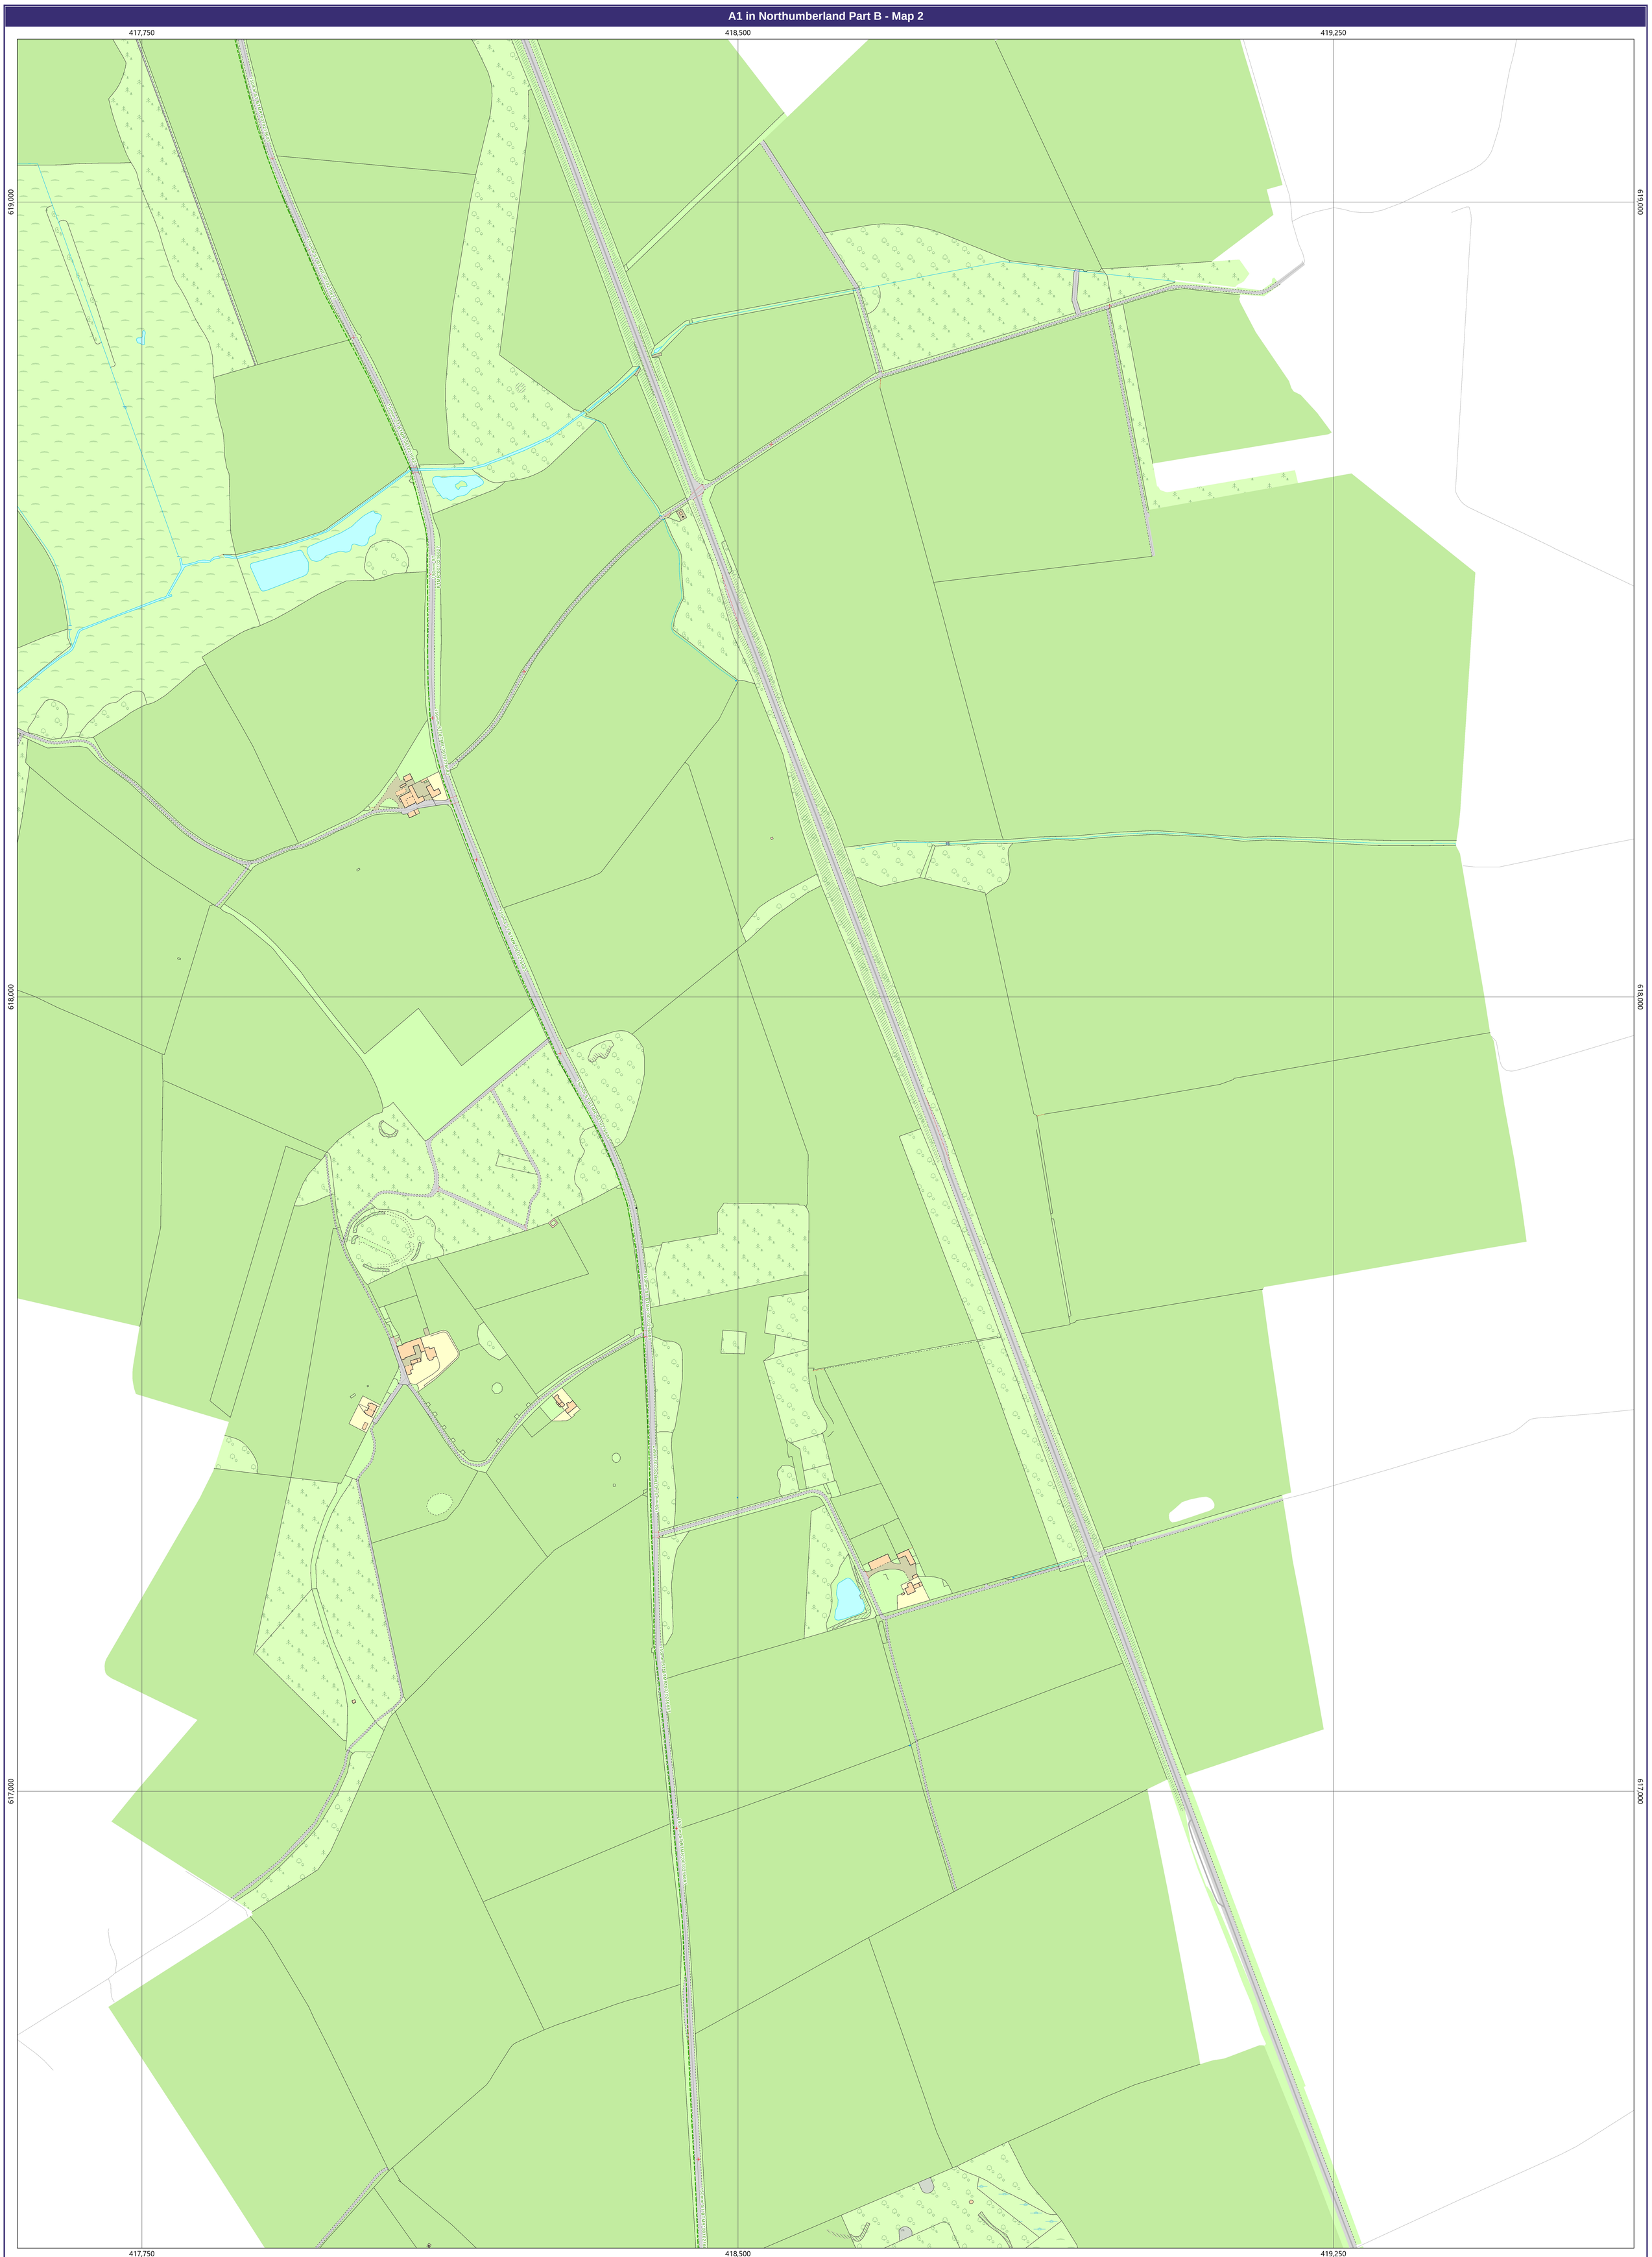

Legend

Gas Network Assets
- Mains/Service Pipe (off)
- Mains/Service Pipe (off)
- Mains/Service Pipe (on)
- Decommissioned Main/Service Pipe
- Decommissioned Main/Service Pipe (off)
- Decommissioned Main/Service Pipe (on)

Gas Infrastructure Terminology
- Mains/Service Pipe (off)
- Mains/Service Pipe (off)
- Mains/Service Pipe (on)
- Transmission Pipe (off)
- Transmission Pipe (on)
- Decommissioned Main/Service Pipe
- Decommissioned Transmission Pipe (on)

Gas Network Assets
- District Governor (off)
- District Governor (off)
- District Governor (off)
- Domestic Governor
- Domestic/commercial Governor
- Governor
- Gas Network Junction
- Mains/Service Pipe Junction
- Mains/Service Pipe Junction Vertical Pipe Junction
- Gate Valve (off)
- Gate Valve (off)
- Gate Valve (off)
- Gate Valve (off) Cross Section
- Plant Pipe Junction
- AC Offtake

Gas Network Elements
- Flow Valve (MP)
- MRS Point (LP)
- Pressure Measurement (LP)
- Pressure Measurement (MP)
- Pressure Measurement (HP)
- Purge Point (LP)
- Purge Point (MP)
- Purge Point (HP)
- Non-Return Valve (LP)
- Non-Return Valve (MP)
- Non-Return Valve (HP)
- Non-Return Valve (LP)
- Vent Point (LP)
- Vent Point (MP)
- Vent Point (LP)
- Isolation Valve (MP)
- Isolation Valve (MP)
- Tap Point (MP)
- Tap Point (LP)
- Valve (LP)
- Valve (MP)
- Valve (HP)
- Network Control Plan Point
- Decommissioned Main Point
- Decommissioned Pressure Measurement
- Decommissioned Purge Point
- Decommissioned Non-Return Valve
- Decommissioned Vent Pipe
- Decommissioned Valve
- Decommissioned Test Point
- Decommissioned Valve

Plan Network Event
- Change in Direction
- Change in Material
- Crossing Obstruction
- Crossing Commencing
- Depth of Cover
- Pipe Diameter Legend
- Stabbing
- Venting
- Protection Monitors

Legacy Dimensioned Line
- Not Specified
- As Built

Scheduled Measurement
- Remote Reading
- GIF Area
- Cadent Area Area

Wayleaves
- Expired
- Expiring

Objects
- Cross Section - Gas Mains Location
- Cross Section - Confirmed Location
- Underground Cables (11kV)
- Underground Cables (33kV)
- Underground Cables (132kV)
- Underground Cables (275kV)
- Underground Cables (400kV)
- Underground Cables (132kV)
- Underground Cables (275kV)
- Underground Cables (400kV)
- Underground 33 Water Cables
- Underground Cables (Telecom)
- Underground 33 Sewer
- Underground 33 Gas
- Underground 33 Service
- Underground Cables (Gas)
- Underground Sewer Cables
- Underground Cable (11kV) Cables (132kV)
- Underground Cable (11kV) Cables (275kV)
- Underground Cable (11kV) Cables (400kV)
- Underground Cable (11kV) Cables (132kV)
- Underground Cable (11kV) Cables (275kV)
- Underground Cable (11kV) Cables (400kV)
- Overhead Cable (11kV) Cables (132kV)
- Overhead Cable (11kV) Cables (275kV)
- Overhead Cable (11kV) Cables (400kV)
- Overhead Cable (11kV) Cables (132kV)
- Overhead Cable (11kV) Cables (275kV)
- Overhead Cable (11kV) Cables (400kV)
- Overhead Cable (11kV) Cables (132kV)
- Overhead Cable (11kV) Cables (275kV)
- Overhead Cable (11kV) Cables (400kV)
- Overhead 33 Water
- Overhead 33 Service
- Overhead Sections

0 — 1: 2,500 — 250
Meters

Disclaimer Information

This plan shows those pipes owned by Northern Gas Networks or the relevant Gas Distribution Network in their roles as Licensed Gas Transporters (GT). Gas pipes owned by other GTs, or otherwise privately owned, may be present in this area. Information with regard to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections, etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Northern Gas Networks, the relevant Gas Distribution Network, or their agents, servants or contractors for any error or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

This plan is reproduced or based on the OS map by Northern Gas Networks, with the sanction of the controller of HM Stationary Office. Crown Copyright Reserved.

User ID	Jennie Adams
Date	29/04/2024
Grid Ref	418610 / 617815

Northern Gas Networks

Advanced Plot