A1 in Northumberland Part B - Map 4

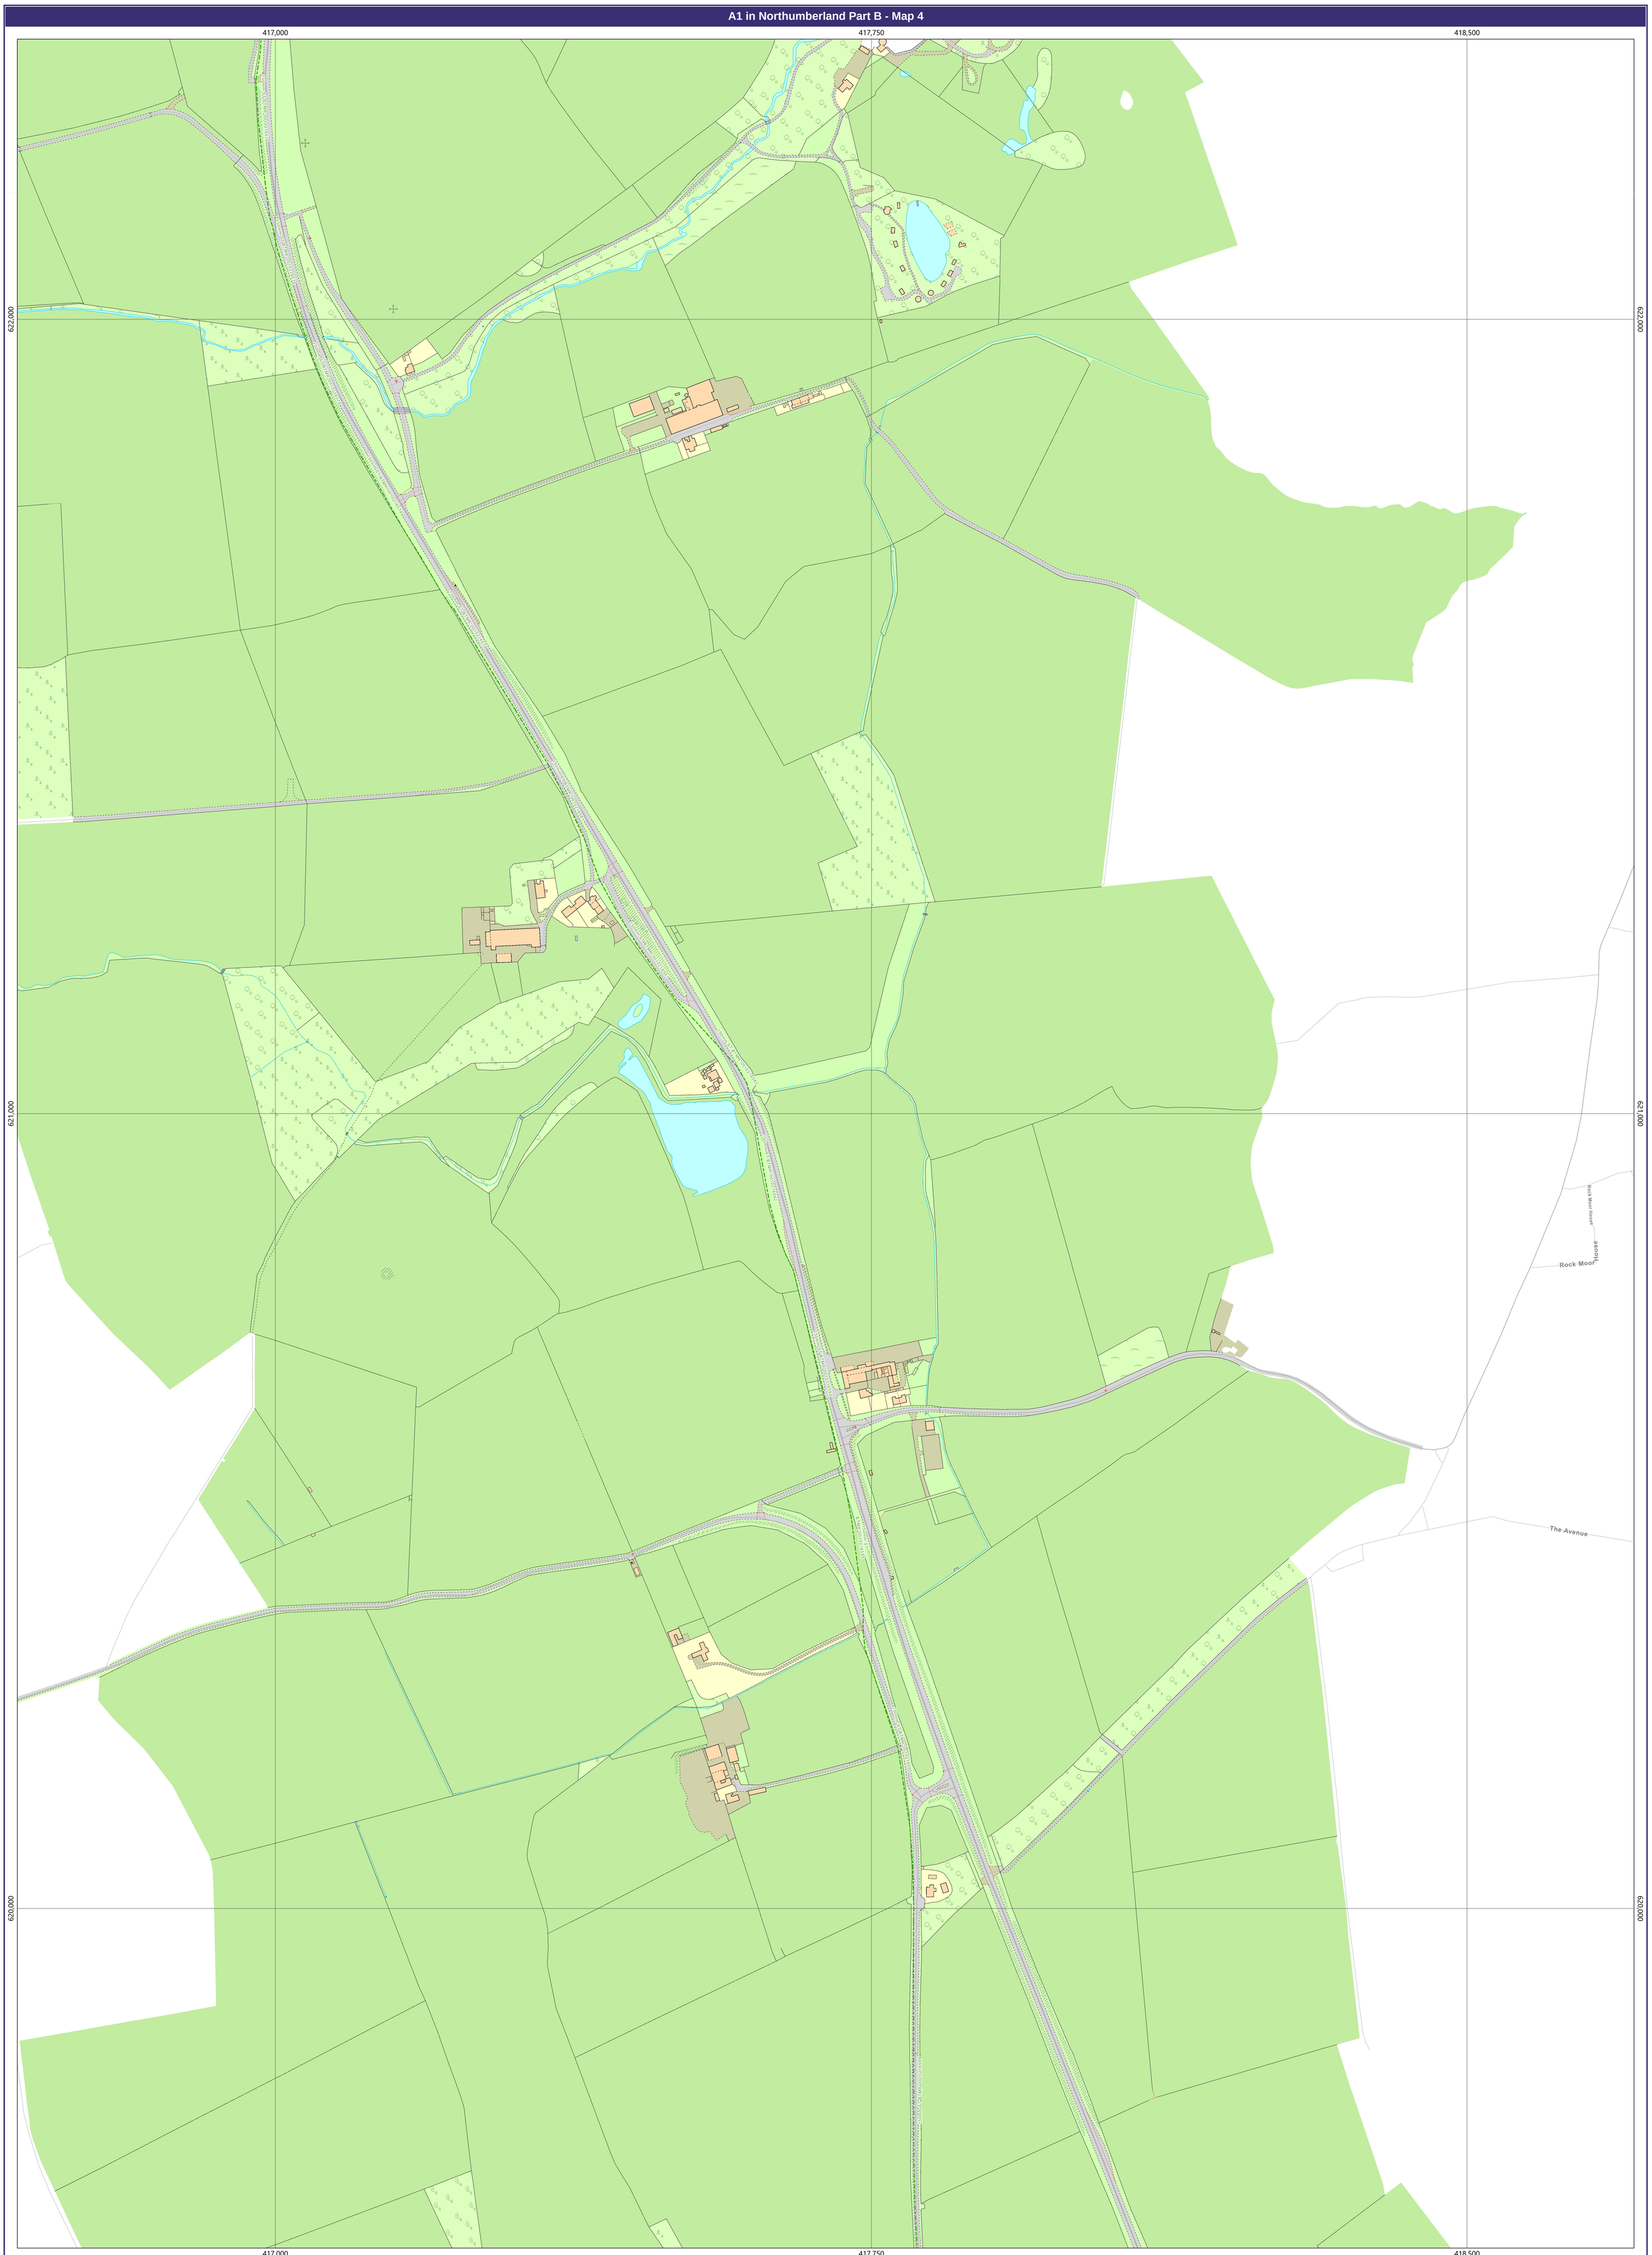

Legend

Gas Network Assets
- Main/Service Pipe (off)
- Main/Service Pipe (alt)
- Main/Service Pipe (ut)
- Decommissioned Main/Service Pipe
- Decommissioned Main/Service Pipe (ut)
- Decommissioned Service

Gas Network Installations
- Main/Service Pipe Junction
- Main/Service Pipe Junction Vertical Pipe Junction
- Valve (alt)
- Valve (ut)
- Gas Source (alt)
- Gas Source (ut)
- Decommissioned Gas Source
- Riser Pipe Junction
- UG Offset

Gas Network Electric
- District Governor (alt)
- District Governor (ut)
- District Governor
- Decommissioned Governor
- Flow Valve (alt)
- Flow Valve (ut)
- Pressure Measurement (alt)
- Pressure Measurement (ut)
- Pressure Measurement (alt)
- Purge Point (alt)
- Purge Point (ut)
- Decommissioned Purge Point
- Decommissioned Pressure Measurement
- Decommissioned Purge Point
- Decommissioned Flow Valve
- Decommissioned Pipe
- Decommissioned Valve
- Decommissioned Governor
- Decommissioned Valve
- Agitator (alt)
- Agitator (ut)
- Agitator (ut)
- Test Point (alt)
- Test Point (ut)
- Valve (alt)
- Valve (ut)
- Valve (alt)
- Decommissioned Valve
- Decommissioned Test Point
- Decommissioned Agitator
- Decommissioned Test Point
- Decommissioned Valve

Gas Network Asset
- Change in Diameter
- Change in Material
- Crossover Connection
- Depth of Cover
- Pressure Logics
- Stabbing
- Venting
- Fracture Monitors

Legacy Dimensioned Line
- Not Built
- As Built

Scheduled Monument
- Reference Analysis
- LAT Area
- Cadwell
- Centre Line Area

Map Layers
- Cross Section - Cut Marker Location
- Cross Section - Confirmed Location
- Underground Cables (alt)
- Underground Cables (alt)
- Underground Cables (22kV)
- Underground Cables (11kV)
- Underground Cables (33kV)
- Underground Cables (132kV)
- Underground Cables (275kV)
- Underground Cables (400kV)
- Underground Water Cables
- Underground Cables (other)
- Underground Service
- Underground Cables (alt)
- Underground Service
- Underground Cables (alt)
- Underground Notifiers (alt)
- Underground LV Dry Cables (22kV)
- Underground LV Dry Cables (11kV)
- Underground LV Dry Cables (33kV)
- Underground LV Dry Cables (132kV)
- Underground LV Dry Cables (275kV)
- Underground LV Dry Cables (400kV)
- Underground LV Dry Cables (other)
- Overhead LV Dry Cables (22kV)
- Overhead LV Dry Cables (11kV)
- Overhead LV Dry Cables (33kV)
- Overhead LV Dry Cables (132kV)
- Overhead LV Dry Cables (275kV)
- Overhead LV Dry Cables (400kV)
- Overhead LV Dry Cables (other)
- Overhead Conductors (alt)
- Overhead Conductors (alt)
- Overhead Conductors (22kV)
- Overhead Conductors (11kV)
- Overhead Conductors (33kV)
- Overhead Conductors (132kV)
- Overhead Conductors (275kV)
- Overhead Conductors (400kV)
- Overhead Conductors (other)
- Overhead Wires
- Overhead Service
- Overhead Notifiers

1: 2,500

0 — 250

Meters

Disclaimer Information

This plan shows those pipes owned by Northern Gas Networks or the relevant Gas Distribution Network in their roles as Licensed Gas Transporters (GT). Gas pipes owned by other GTs, or otherwise privately owned, may be present in this area. Information with regard to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections, etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Northern Gas Networks, the relevant Gas Distribution Network, or their agents, servants or contractors for any error or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

This plan is reproduced or based on the OS map by Northern Gas Networks, with the sanction of the controller of HM Stationary Office. Crown Copyright Reserved.

User ID	Jennie Adams
Date	29/04/2024
Grid Ref	417692 / 620962

Northern Gas Networks

Advanced Plot