A1 in Northumberland Part B - Map 5

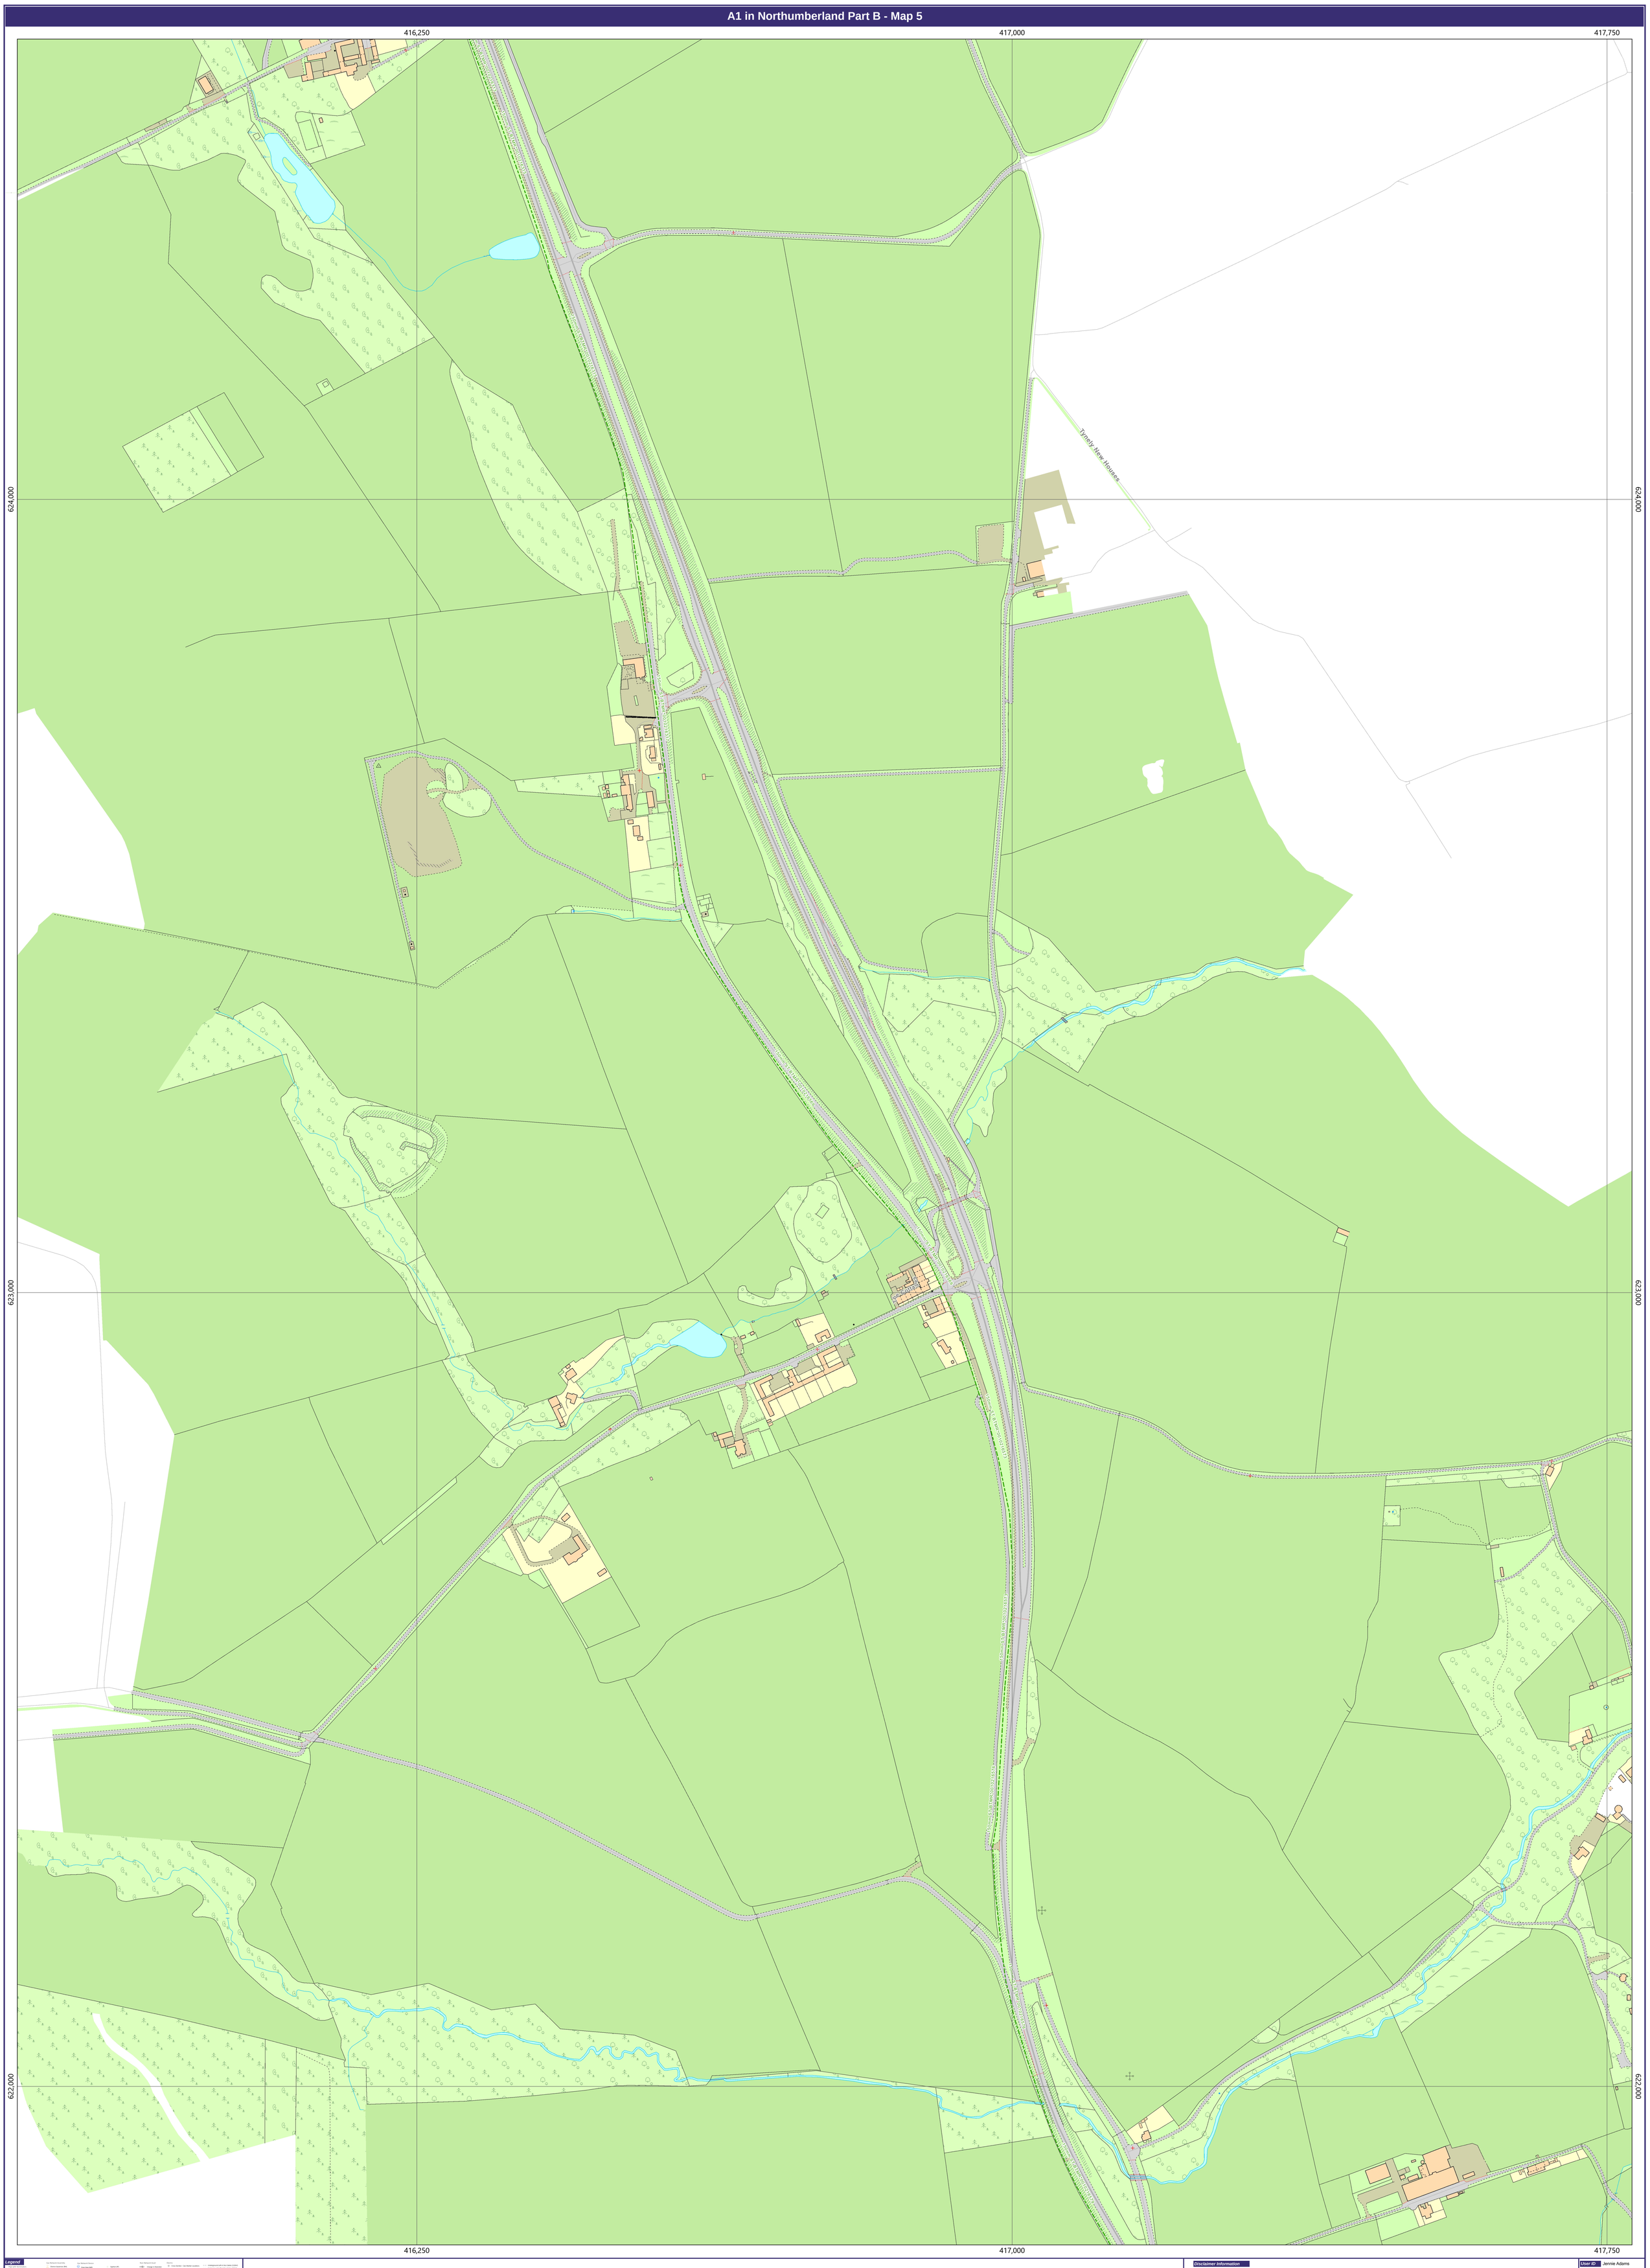

Legend

Gas Network Assets
- Intermediate Pressure
- Mains/Service Pipe (IP)
- Mains/Service Pipe (IP)
- Mains/Service Pipe (IP)
- Transmission Main (IP)
- Decommissioned Mains/Service Pipe
- Decommissioned Transmission Pipe (IP)

Gas National Transmission
- Mains/Service Pipe (LP)
- Mains/Service Pipe (MP)
- Mains/Service Pipe (LP)
- Mains/Service Pipe (MP)
- Decommissioned Mains/Service Pipe
- Decommissioned Transmission Pipe (LP)

Gas Network Assets
- Governor Installation (MP)
- Governor Installation (IP)
- Governor Installation (LP)
- Governor Installation (IP)
- Decommissioned Governor Installation
- Meter/Service Pipe Junction
- Decommissioned Meter/Service Pipe Junction
- Stub Closure (IP)
- End Closure (MP)
- End Closure (LP)
- Decommissioned End Closure
- Riser Pipe Junction
- LP Offtake

Gas Network Device
- Valve Site (MP)
- MRS Rural (LP)
- Pressure Measurement (IP)
- Pressure Measurement (MP)
- Pressure Measurement (LP)
- Purge Point (LP)
- Purge Point (MP)
- Purge Point (IP)
- Site Valve Point (IP)
- Site Valve Point (LP)
- Site Valve Point (MP)
- Site Valve Point (IP)
- Point Plot (IP)
- Point Plot (MP)
- Point Plot (LP)
- Syphon (IP)
- Syphon (MP)
- Syphon (LP)
- Test Point (MP)
- Test Point (LP)
- Valve (MP)
- Valve (IP)
- Valve (LP)
- Decommissioned Pipe Ring
- Decommissioned MRS Rural
- Decommissioned Pressure Measurement
- Decommissioned Purge Point
- Decommissioned Site Valve Point
- Decommissioned Point Plot
- Decommissioned Pipe Point
- Decommissioned Test Point
- Decommissioned Valve

Gas Network Asset
- Change in Diameter
- Change in Material
- Change in Wall Thickness
- Depth of Cover

Asset Protection Layers
- Cathodic Protection Monitoring
- Protective Wrapping

Legacy Emission Line
- Abandoned
- Active

Legacy Emission Line
- Underground Measurement Site
- AIS Area
- ATS
- Carbon Dioxide Area

Other
- Cross Section - Cast Market Locations
- Cross Section - Conditioned Locations
- Underground Cables (132kV)
- Underground Cables (33kV)
- Underground Cables (20kV)
- Underground Cables (11kV)
- Underground Cables (6.6kV)
- Underground Cables (3.3kV)
- Underground Cables (400V)
- Underground Cables (230V)
- Underground Cables (Unknown)
- Underground Mains Cables
- Underground Service Cables
- Underground Cable Ducts
- Assembly Point Cables
- Underground Cable Ducts
- Legend Connection Cables
- Underground Northern Cables
- Underground Left in Situ Cables (132kV)
- Underground Left in Situ Cables (33kV)
- Underground Left in Situ Cables (20kV)
- Underground Left in Situ Cables (11kV)
- Underground Left in Situ Cables (6.6kV)
- Underground Left in Situ Cables (3.3kV)
- Underground Left in Situ Cables (400V)
- Underground Left in Situ Cables (230V)
- Underground Left in Situ HV Cables
- Overhead Conductors (132kV)
- Overhead Conductors (33kV)
- Overhead Conductors (20kV)
- Overhead Conductors (11kV)
- Overhead Conductors (6.6kV)
- Overhead Conductors (3.3kV)
- Overhead Conductors (0kV)
- Overhead Conductors (0kV)
- Overhead Service
- Overhead Auxiliary

1: 2,500

0 250

Meters

Disclaimer Information

This plan shows those pipes owned by Northern Gas Networks or the relevant Gas Distribution Network in their roles as Licensed Gas Transporters (GT). Gas pipes owned by other GTs, or otherwise privately owned, may be present in this area. Information with regard to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections, etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Northern Gas Networks, the relevant Gas Distribution Network, or their agents, servants or contractors for any error or omission. Safe digging practices, in accordance with HSG47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

This plan is reproduced or based on the OS map by Northern Gas Networks, with the sanction of the controller of HM Stationary Office. Crown Copyright Reserved.

User ID	Jennie Adams
Date	29/04/2024
Grid Ref	416763 / 623189

Northern Gas Networks

Advanced Plot