

**Cambridge Waste Water Treatment Plant Relocation Project**  
Anglian Water Services Limited

# Book of Figures - Biodiversity

Application Document Reference: 5.3.8  
PINS Project Reference: WW010003  
APFP Regulation No. 5(2)a










**Revision No. 02**  
September 2023


The plans listed below contain confidential information in line with Institute of Ecology and Environmental Management (CIEEM) guidance which states *'It may be necessary to mark the report as confidential where locational details are provided of sensitive species (where the locations need to be kept confidential due to the risk of human interference)'*. Therefore they are only available on request to those who have a legitimate need to view the Information. To request a copy of the redacted plans please contact the Applicant or Planning Inspectorate.

Redacted Figures:

- Figures 8.22 to 8.33 associated with the Ornithology baseline technical appendix (Appendix 8.4, App Doc Ref 5.4.8.4) and ES Chapter 8: Biodiversity (App Doc Ref 5.2.8).
- Figures 8.71 to 8.73 associated with the Badger baseline technical appendix (Appendix 8.8, App Doc Ref 5.4.8.8) and ES Chapter 8: Biodiversity (App Doc Ref 5.2.8).



 Scheme Order Limits	 Study area (10km buffer)
 Proposed WWTP	 Site of Special Scientific Interest
 Existing Cambridge WWTP	 Special Area of Conservation
 Final effluent pipeline	 Ramsar
 Proposed transfer tunnel	

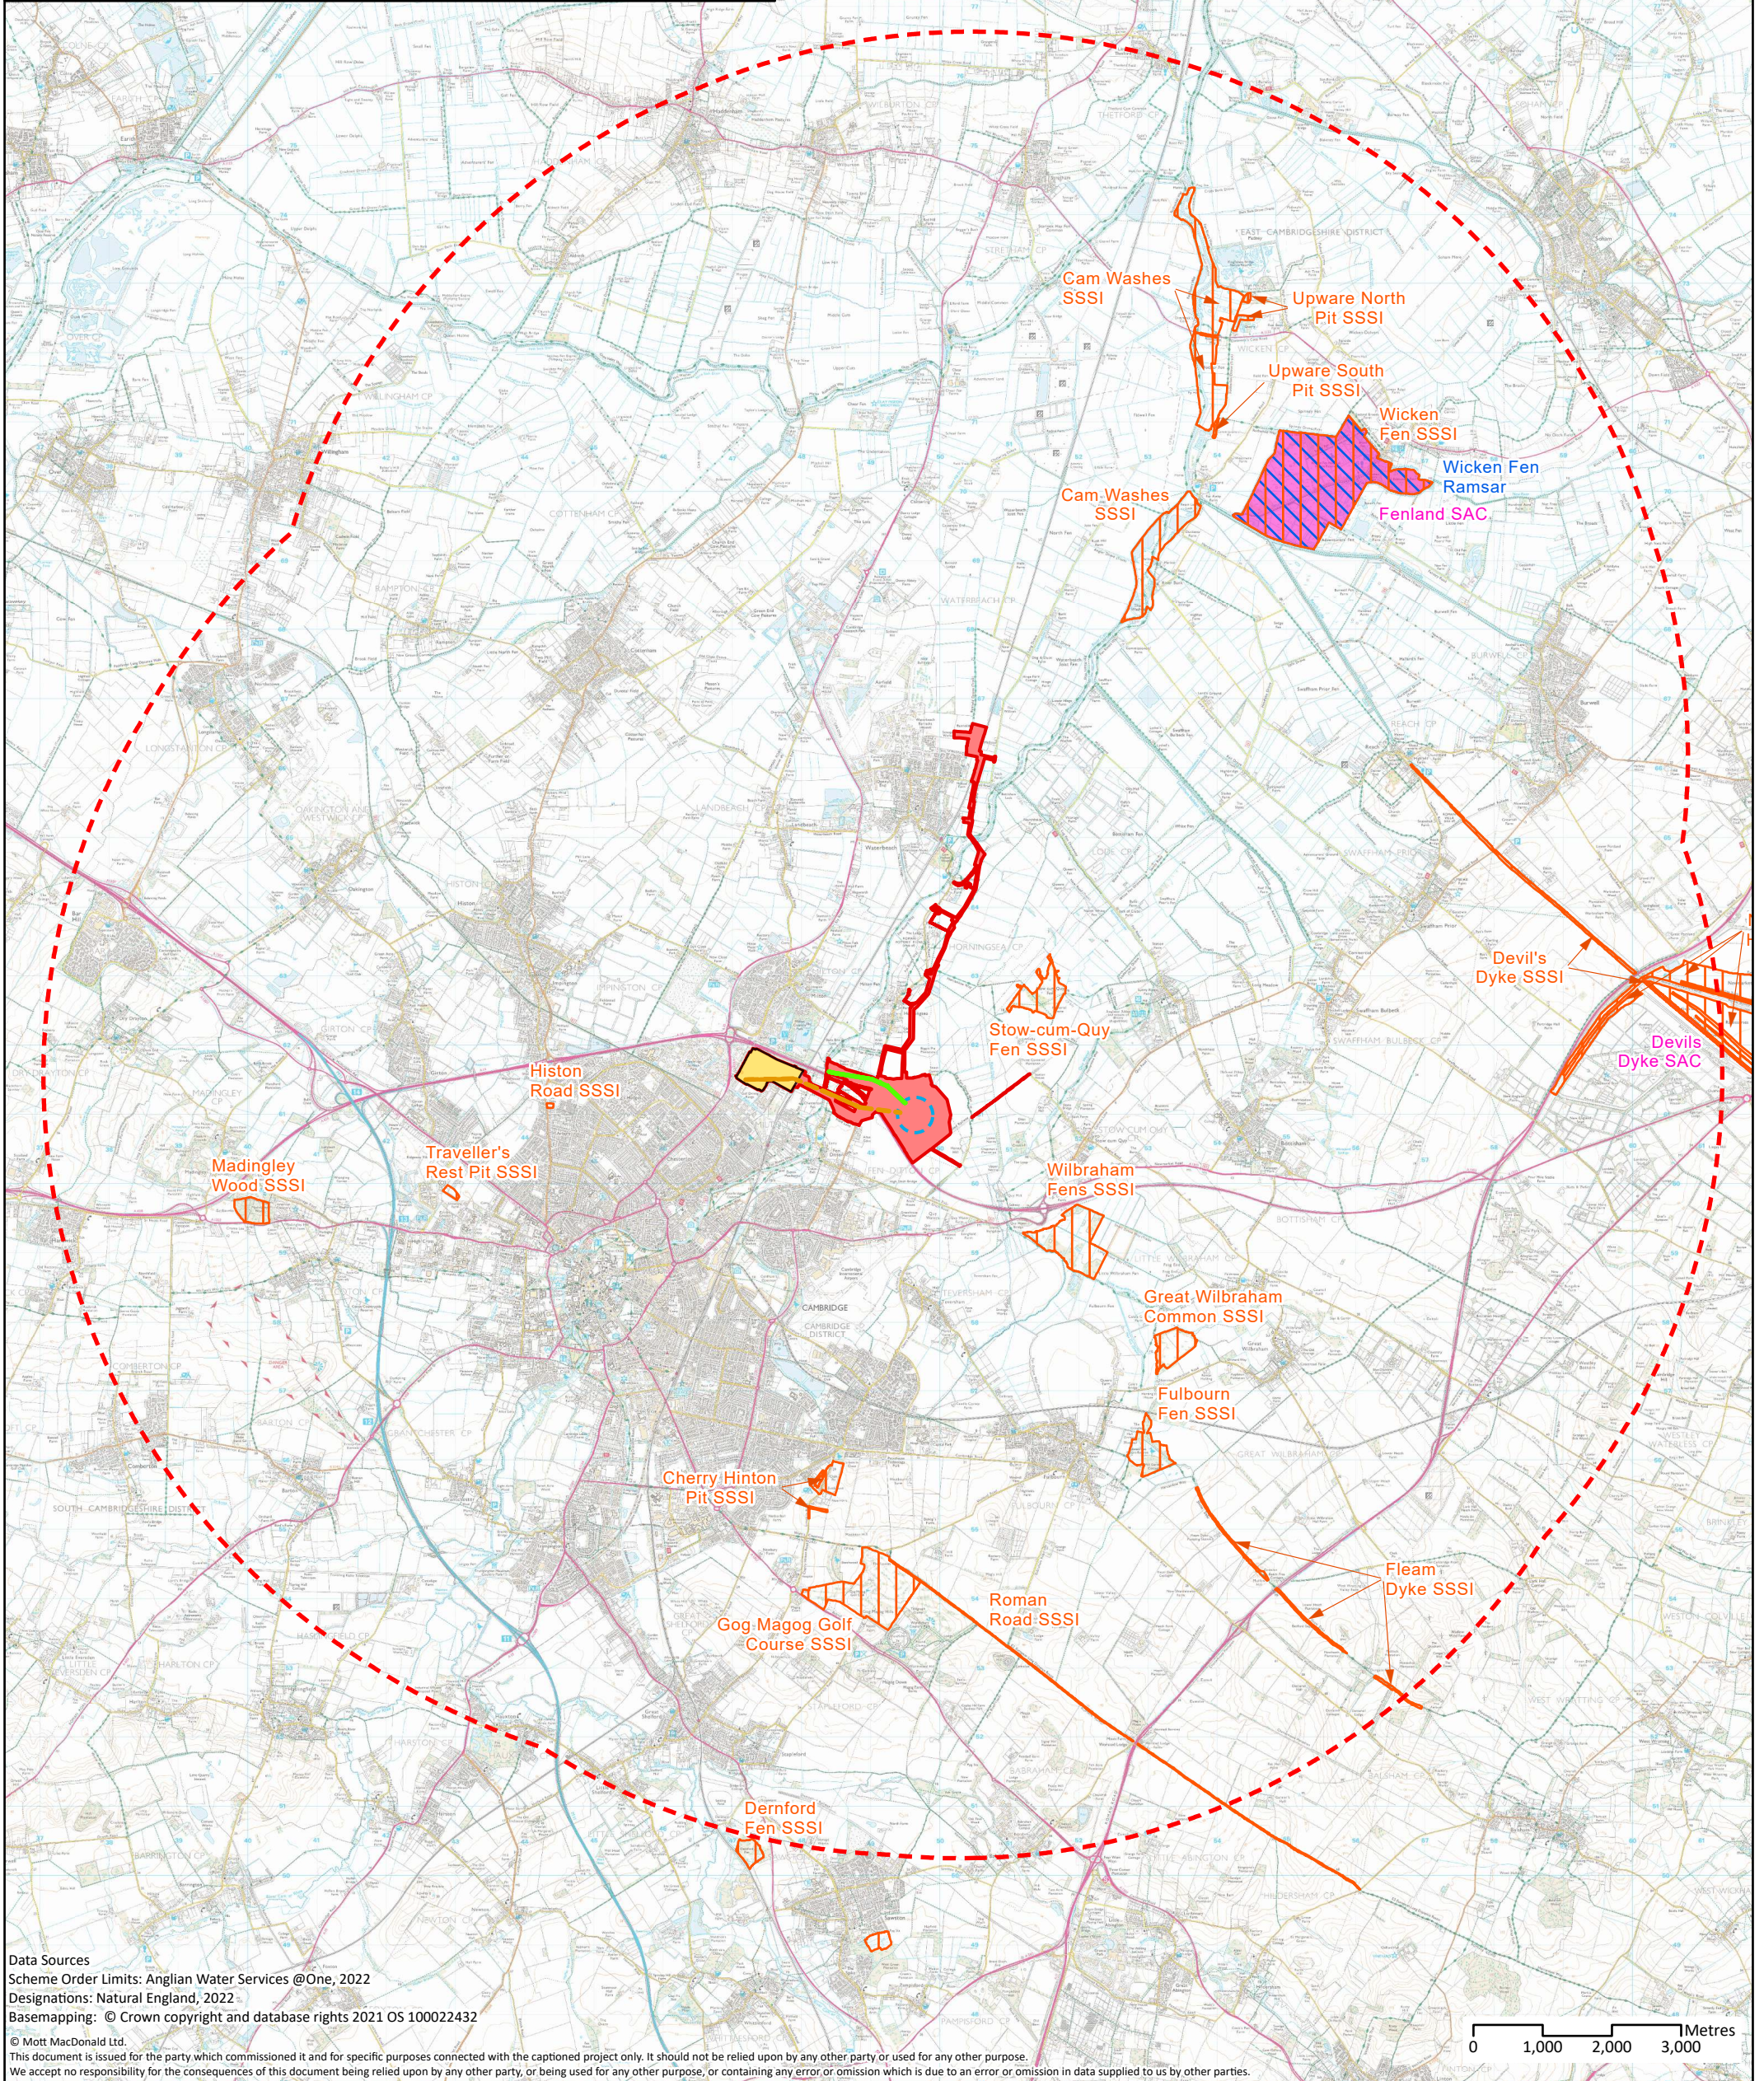


Data Sources  
 Scheme Order Limits: Anglian Water Services @One, 2022  
 Designations: Natural England, 2022  
 Basemapping: © Crown copyright and database rights 2021 OS 100022432  
 © Mott MacDonald Ltd.  
 This document is issued for the party which commissioned it and for specific purposes connected with the captioned project only. It should not be relied upon by any other party, or used for any other purpose.  
 We accept no responsibility for the consequences of this document being relied upon by any other party, or being used for any other purpose, or containing any error or omission which is due to an error or omission in data supplied to us by other parties.

 <p>22 Station Road Cambridge CB1 2JD United Kingdom</p> <p>T +44 (0)20 8774 2000 F +44 (0)20 8681 5706 W mottmac.com</p>	<p>Client</p> 					<p>Title</p> <p>Cambridge Waste Water Treatment Plant Relocation Project Environmental Statement Biodiversity - Designations within 10km</p>			Drawn	KL								
	<table border="1"> <thead> <tr> <th>Rev</th> <th>Date</th> <th>Drawn</th> <th>Description</th> <th>Ch'k'd</th> <th>App'd</th> </tr> </thead> <tbody> <tr> <td>P1</td> <td>02/11/22</td> <td>KL</td> <td>First Draft</td> <td>AW</td> <td>CS</td> </tr> </tbody> </table>		Rev	Date	Drawn	Description	Ch'k'd	App'd	P1	02/11/22	KL	First Draft	AW	CS	<p>Drawing Number</p> <p>Figure 8.1</p>			Checked
Rev	Date	Drawn	Description	Ch'k'd	App'd													
P1	02/11/22	KL	First Draft	AW	CS													
					<p>Approved</p> <p>CS</p>			<p>Scale at A3</p> <p>1:90,000</p>										
					<p>Security</p> <p>STD</p>			Status	PRE									
								Rev	P1									




- Scheme Order Limits
- Proposed WWTP
- Existing Cambridge WWTP
- Final effluent pipeline
- Proposed transfer tunnel
- County Wildlife Site (linear)
- County Wildlife Site
- City Wildlife Site
- Protected Road Verge

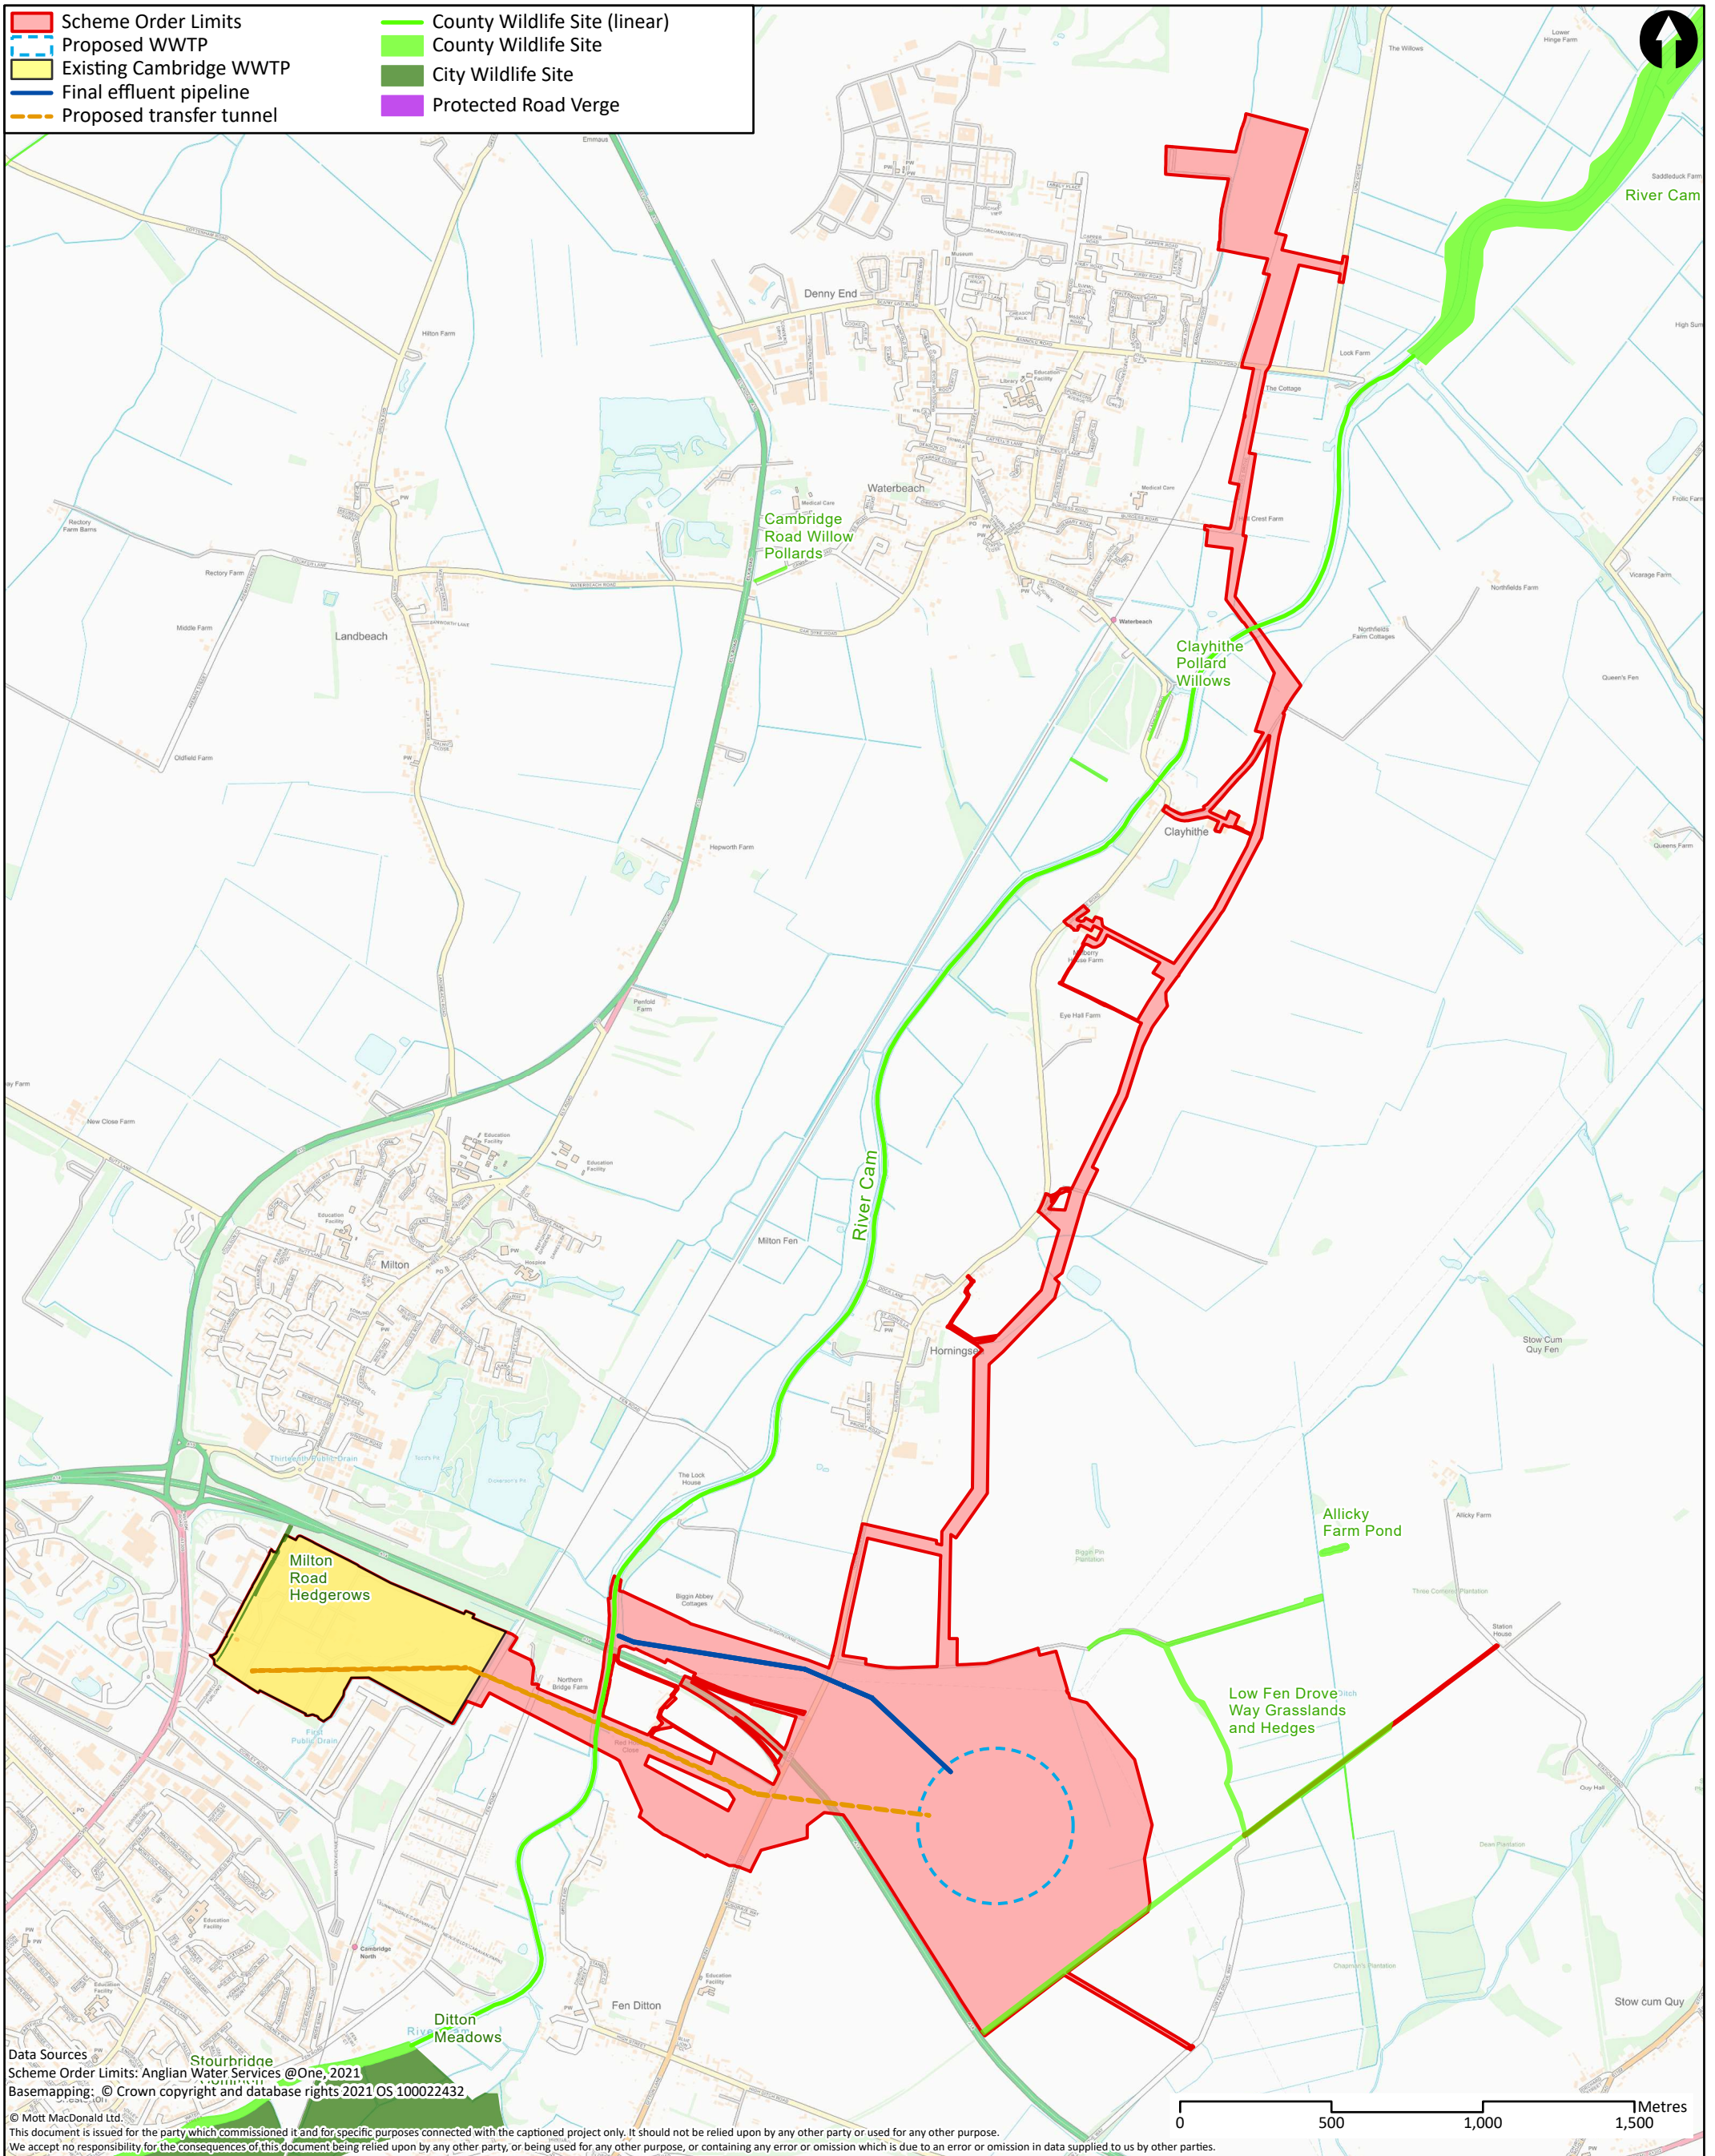

Data Sources  
 Scheme Order Limits: Anglian Water Services @One, 2021  
 Basemapping: © Crown copyright and database rights 2021 OS 100022432  
 © Mott MacDonald Ltd.  
 This document is issued for the party which commissioned it and for specific purposes connected with the captioned project only. It should not be relied upon by any other party or used for any other purpose.  
 We accept no responsibility for the consequences of this document being relied upon by any other party, or being used for any other purpose, or containing any error or omission which is due to an error or omission in data supplied to us by other parties.

	22 Station Road Cambridge CB1 2JD United Kingdom  T +44 (0)20 8774 2000 F +44 (0)20 8681 5706 W mottmac.com	Client 					Title Cambridge Waste Water Treatment Plant Relocation Project Environmental Statement Non-statutory designations			Drawn JB												
		<table border="1" style="width: 100%; border-collapse: collapse;"> <thead> <tr> <th>Rev</th> <th>Date</th> <th>Drawn</th> <th>Description</th> <th>Ch'k'd</th> <th>App'd</th> </tr> </thead> <tbody> <tr> <td>P1</td> <td>28/10/22</td> <td>JB</td> <td>First Draft</td> <td>PR</td> <td>CS</td> </tr> </tbody> </table>					Rev	Date	Drawn	Description	Ch'k'd	App'd	P1	28/10/22	JB	First Draft	PR	CS	Checked PR  Approved CS			Scale at A3 1:20,000
		Rev	Date	Drawn	Description	Ch'k'd	App'd															
P1	28/10/22	JB	First Draft	PR	CS																	
Drawing Number Figure 8.2						Security STD	Status PRE	Rev P1														




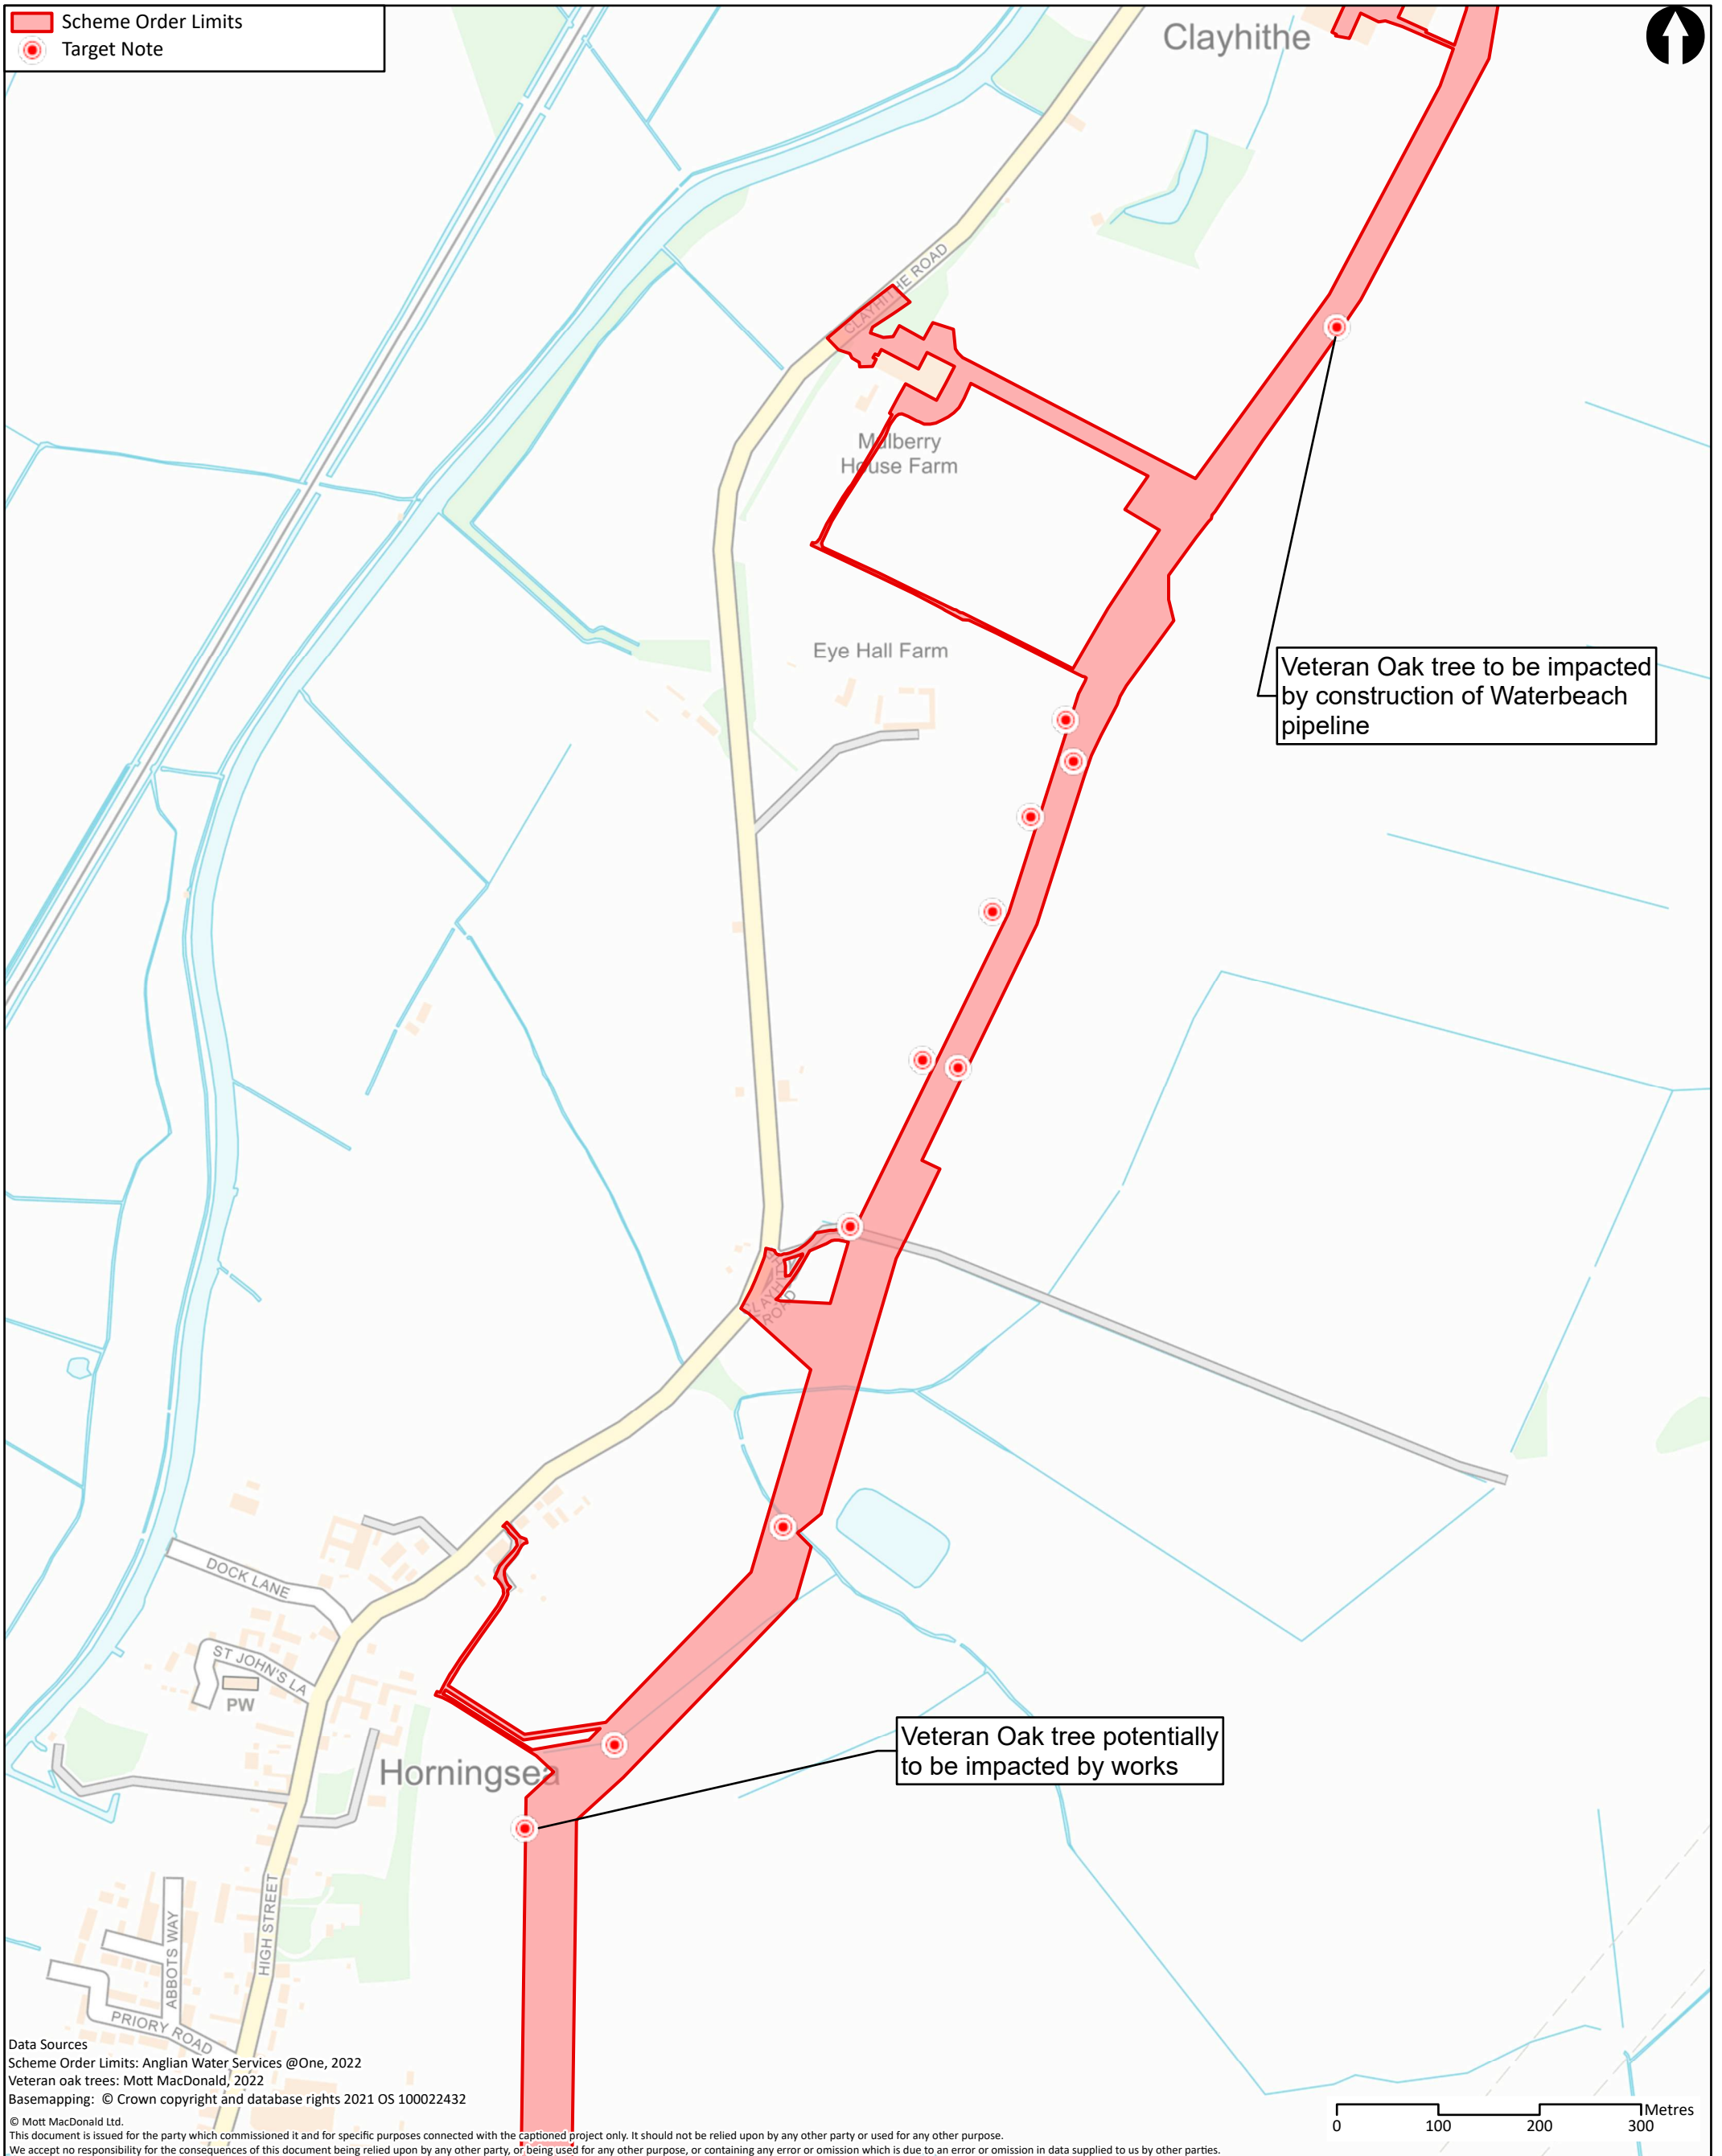

Data Sources  
 Scheme Order Limits: Anglian Water Services @One, 2022  
 Veteran oak trees: Mott MacDonald, 2022  
 Basemapping: © Crown copyright and database rights 2021 OS 100022432  
 © Mott MacDonald Ltd.  
 This document is issued for the party which commissioned it and for specific purposes connected with the captioned project only. It should not be relied upon by any other party or used for any other purpose.  
 We accept no responsibility for the consequences of this document being relied upon by any other party, or being used for any other purpose, or containing any error or omission which is due to an error or omission in data supplied to us by other parties.

<p>22 Station Road          Cambridge CB1 2JD          United Kingdom</p> <p>T +44 (0)20 8774 2000          F +44 (0)20 8681 5706          W mottmac.com</p>	Client					Title <b>Cambridge Waste Water Treatment Plant Relocation Project Environmental Statement Veteran oak trees</b>	Drawn	JB											
							Checked	PR											
							Approved	CS											
<table border="1"> <thead> <tr> <th>Rev</th> <th>Date</th> <th>Drawn</th> <th>Description</th> <th>Ch'k'd</th> <th>App'd</th> </tr> </thead> <tbody> <tr> <td>P1</td> <td>02/11/22</td> <td>JB</td> <td>First Draft</td> <td>PR</td> <td>CS</td> </tr> </tbody> </table>						Rev	Date	Drawn	Description	Ch'k'd	App'd	P1	02/11/22	JB	First Draft	PR	CS	Scale at A3 1:6,000	
Rev	Date	Drawn	Description	Ch'k'd	App'd														
P1	02/11/22	JB	First Draft	PR	CS														
Drawing Number <p style="text-align: center;">Figure 8.3</p>						Security	Status	Rev											
						STD	PRE	P1											



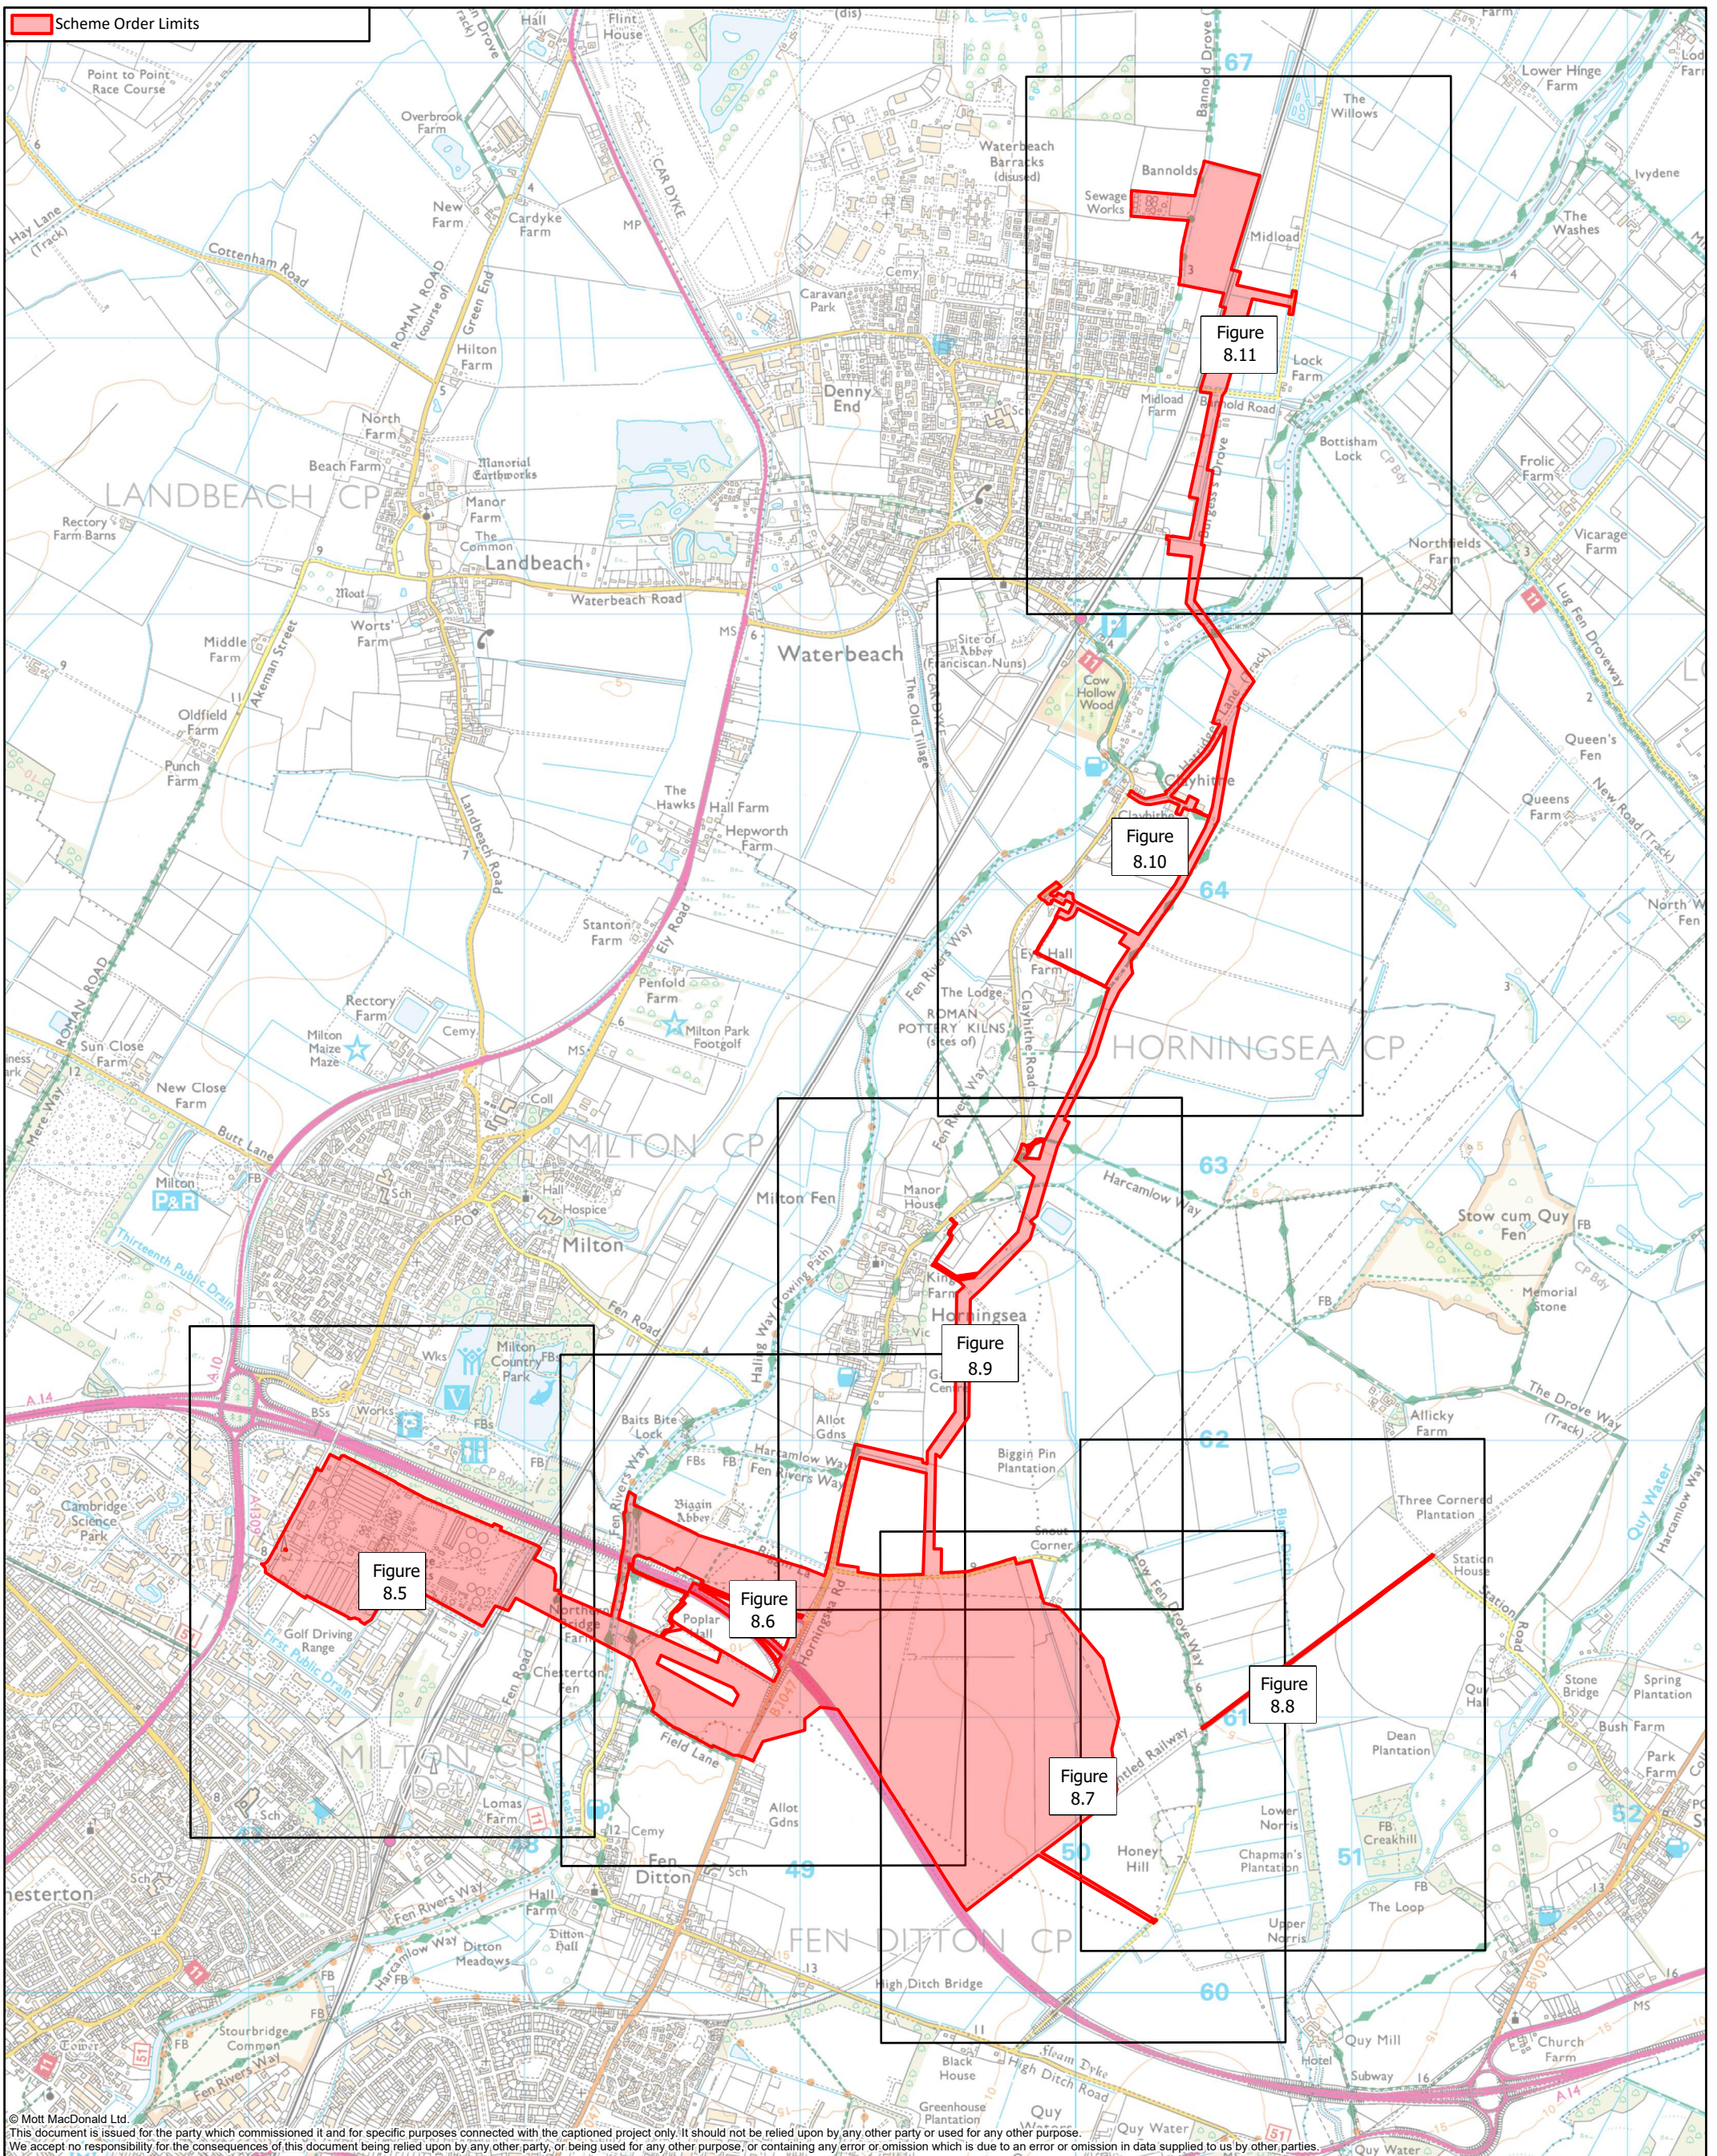


© Mott MacDonald Ltd. This document is issued for the party which commissioned it and for specific purposes connected with the captioned project only. It should not be relied upon by any other party or used for any other purpose. We accept no responsibility for the consequences of this document being relied upon by any other party, or being used for any other purpose, or containing any error or omission which is due to an error or omission in data supplied to us by other parties.

 <p>22 Station Road Cambridge CB1 2JD United Kingdom</p> <p>T +44 (0)20 8774 2000 F +44 (0)20 8681 5706 W mottmac.com</p>	<p>Client</p> 					<p>Title</p> <p>Cambridge Waste Water Treatment Plant Relocation Project Environmental Statement Phase 1 habitat - Location map</p>			Drawn	KL												
	<table border="1"> <thead> <tr> <th>Rev</th> <th>Date</th> <th>Drawn</th> <th>Description</th> <th>Ch'k'd</th> <th>App'd</th> </tr> </thead> <tbody> <tr> <td>P1</td> <td>02/11/22</td> <td>KL</td> <td>First Draft</td> <td>AW</td> <td>CS</td> </tr> </tbody> </table>					Rev	Date	Drawn	Description	Ch'k'd	App'd	P1	02/11/22	KL	First Draft	AW	CS	<p>Drawing Number</p> <p>Figure 8.4</p>			Checked	AW
	Rev	Date	Drawn	Description	Ch'k'd	App'd																
P1	02/11/22	KL	First Draft	AW	CS																	
					<p>Approved</p> <p>CS</p>			Approved	CS													
					<p>Scale at A3</p> <p>1:22,000</p>			Scale at A3	1:22,000													
					<p>Security</p> <p>STD</p>			Status <p>PRE</p>	Rev <p>P1</p>													



Scheme Order Limits	A2.1 - Scrub - dense/continuous
<b>Phase 1 habitat description</b>	A2.2 - Scrub - scattered
A3.1 - Broadleaved parkland/scattered trees	B2.2 - Neutral grassland - semi-improved
A3.2 - Coniferous parkland/scattered trees	B5 - Marsh/marshy grassland
G2 - Running water	B6 - Poor semi-improved grassland
J2.1.1 - Intact hedge - native species-rich	G1 - Standing water
J2.1.2 - Intact hedge - species-poor	G1.1 - Standing water - eutrophic
J2.2.2 - Defunct hedge - species-poor	G2 - Running water
J2.4 - Fence	Hardstanding
J2.6 - Dry ditch	J1.2 - Cultivated/disturbed land - amenity grassland
A1.1.1 - Broadleaved woodland - semi-natural	J1.3 - Cultivated/disturbed land - ephemeral/short perennial
A1.1.2 - Broadleaved woodland - plantation	J1.4 - Introduced shrub
A1.2.2 - Coniferous woodland - plantation	J3.6 - Buildings
A1.3.2 - Mixed woodland - plantation	J4 - Bare ground
	J5 - Hardstanding

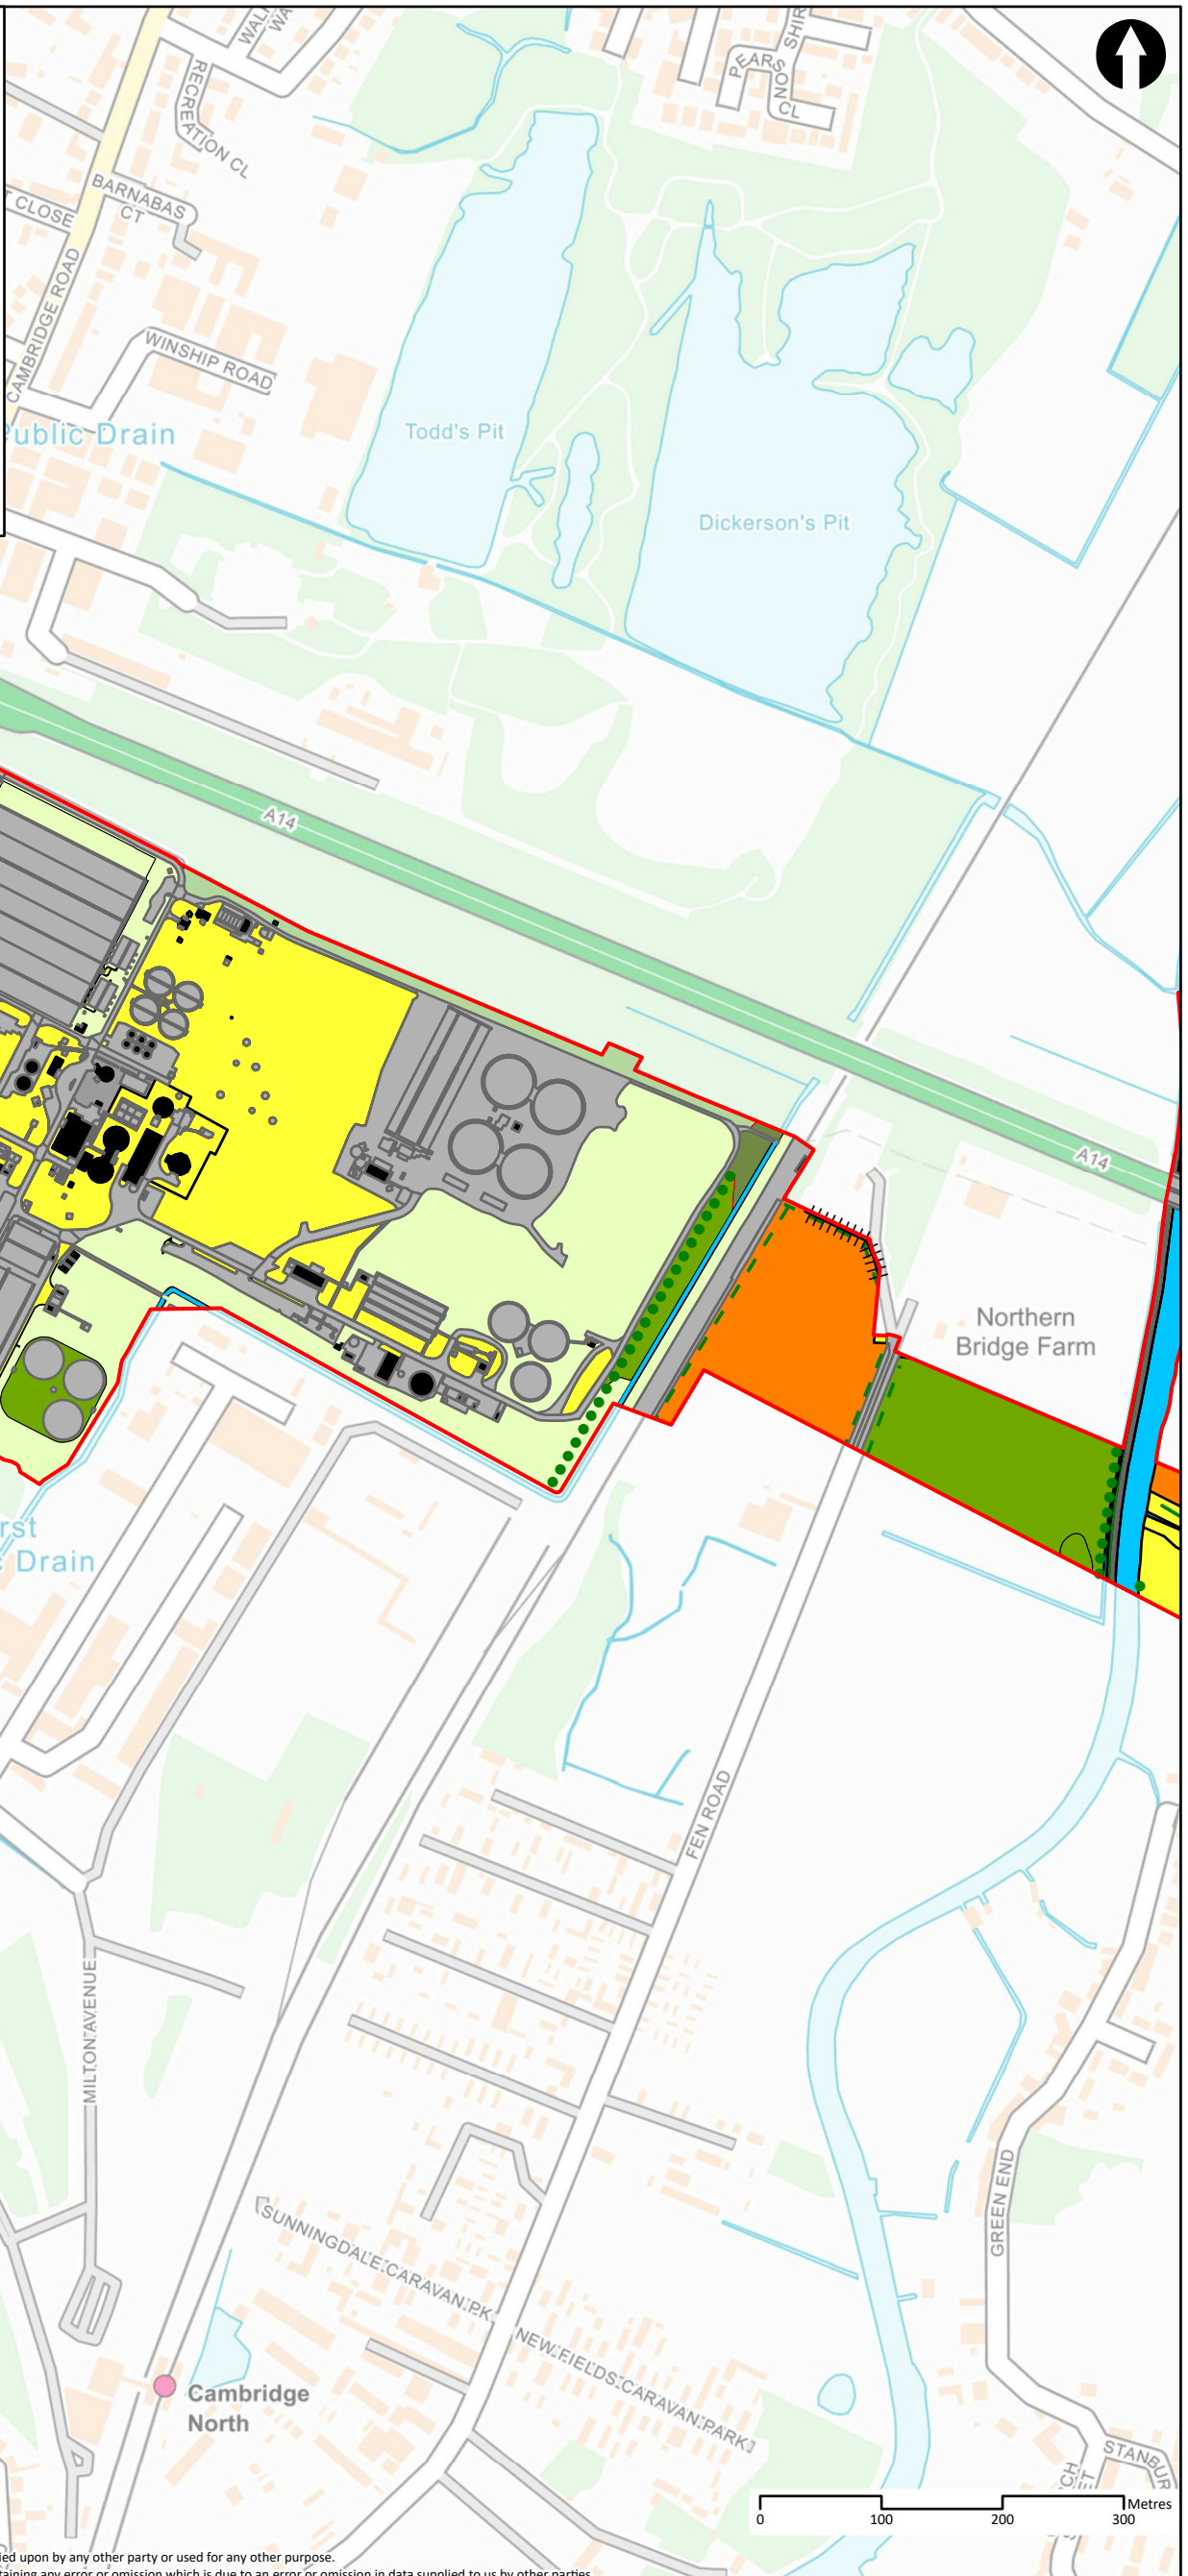


Data Sources  
 Scheme order limits: Anglian Water Services @One, 2022  
 Habitat survey data: Mott MacDonald 2022  
 Basemapping : © Crown copyright and database rights 2021 OS 100022432  
 © Mott MacDonald Ltd.  
 This document is issued for the party which commissioned it and for specific purposes connected with the captioned project only. It should not be relied upon by any other party or used for any other purpose.  
 We accept no responsibility for the consequences of this document being relied upon by any other party, or being used for any other purpose, or containing any error or omission which is due to an error or omission in data supplied to us by other parties.

 22 Station Road Cambridge CB1 2JD United Kingdom  T +44 (0)20 8774 2000 F +44 (0)20 8681 5706 W mottmac.com	Client 					Title Cambridge Waste Water Treatment Plant Relocation Project Environmental Statement Phase 1 habitat			Drawn	KL							
	<table border="1"> <thead> <tr> <th>Rev</th> <th>Date</th> <th>Drawn</th> <th>Description</th> <th>Ch'k'd</th> <th>App'd</th> </tr> </thead> <tbody> <tr> <td>P1</td> <td>02/11/22</td> <td>KL</td> <td>First Draft</td> <td>AW</td> <td>CS</td> </tr> </tbody> </table>	Rev	Date	Drawn	Description	Ch'k'd	App'd	P1	02/11/22	KL	First Draft	AW	CS	Drawing Number <p style="text-align: center;">Figure 8.5</p>			Checked
Rev	Date	Drawn	Description	Ch'k'd	App'd												
P1	02/11/22	KL	First Draft	AW	CS												
						Approved	CS	Scale at A3									
						1:6,000		Security	Status	Rev							
						STD	PRE	P1									




Scheme Order Limits	A2.1 - Scrub - dense/continuous
<b>Phase 1 habitat description</b>	A2.2 - Scrub - scattered
A3.1 - Broadleaved parkland/scattered trees	B2.2 - Neutral grassland - semi-improved
G2 - Running water	B4 - Improved grassland
J2.1.1 - Intact hedge - native species-rich	B5 - Marsh/marshy grassland
J2.1.2 - Intact hedge - species-poor	B6 - Poor semi-improved grassland
J2.2.2 - Defunct hedge - species-poor	C3.1 - Other tall herb and fern - ruderal
J2.3.1 - Hedge with trees - native species-rich	F2.2 - Marginal and inundation - inundation vegetation
J2.3.2 - Hedge with trees - species-poor	G1 - Standing water
J2.4 - Fence	G2 - Running water
J2.6 - Dry ditch	J1.1 - Cultivated/disturbed land - arable
J2.8 - Earth bank	J1.2 - Cultivated/disturbed land - amenity grassland
A1.1.1 - Broadleaved woodland - semi-natural	J1.3 - Cultivated/disturbed land - ephemeral/short perennial
A1.1.2 - Broadleaved woodland - plantation	J3.6 - Buildings
	J5 - Hardstanding

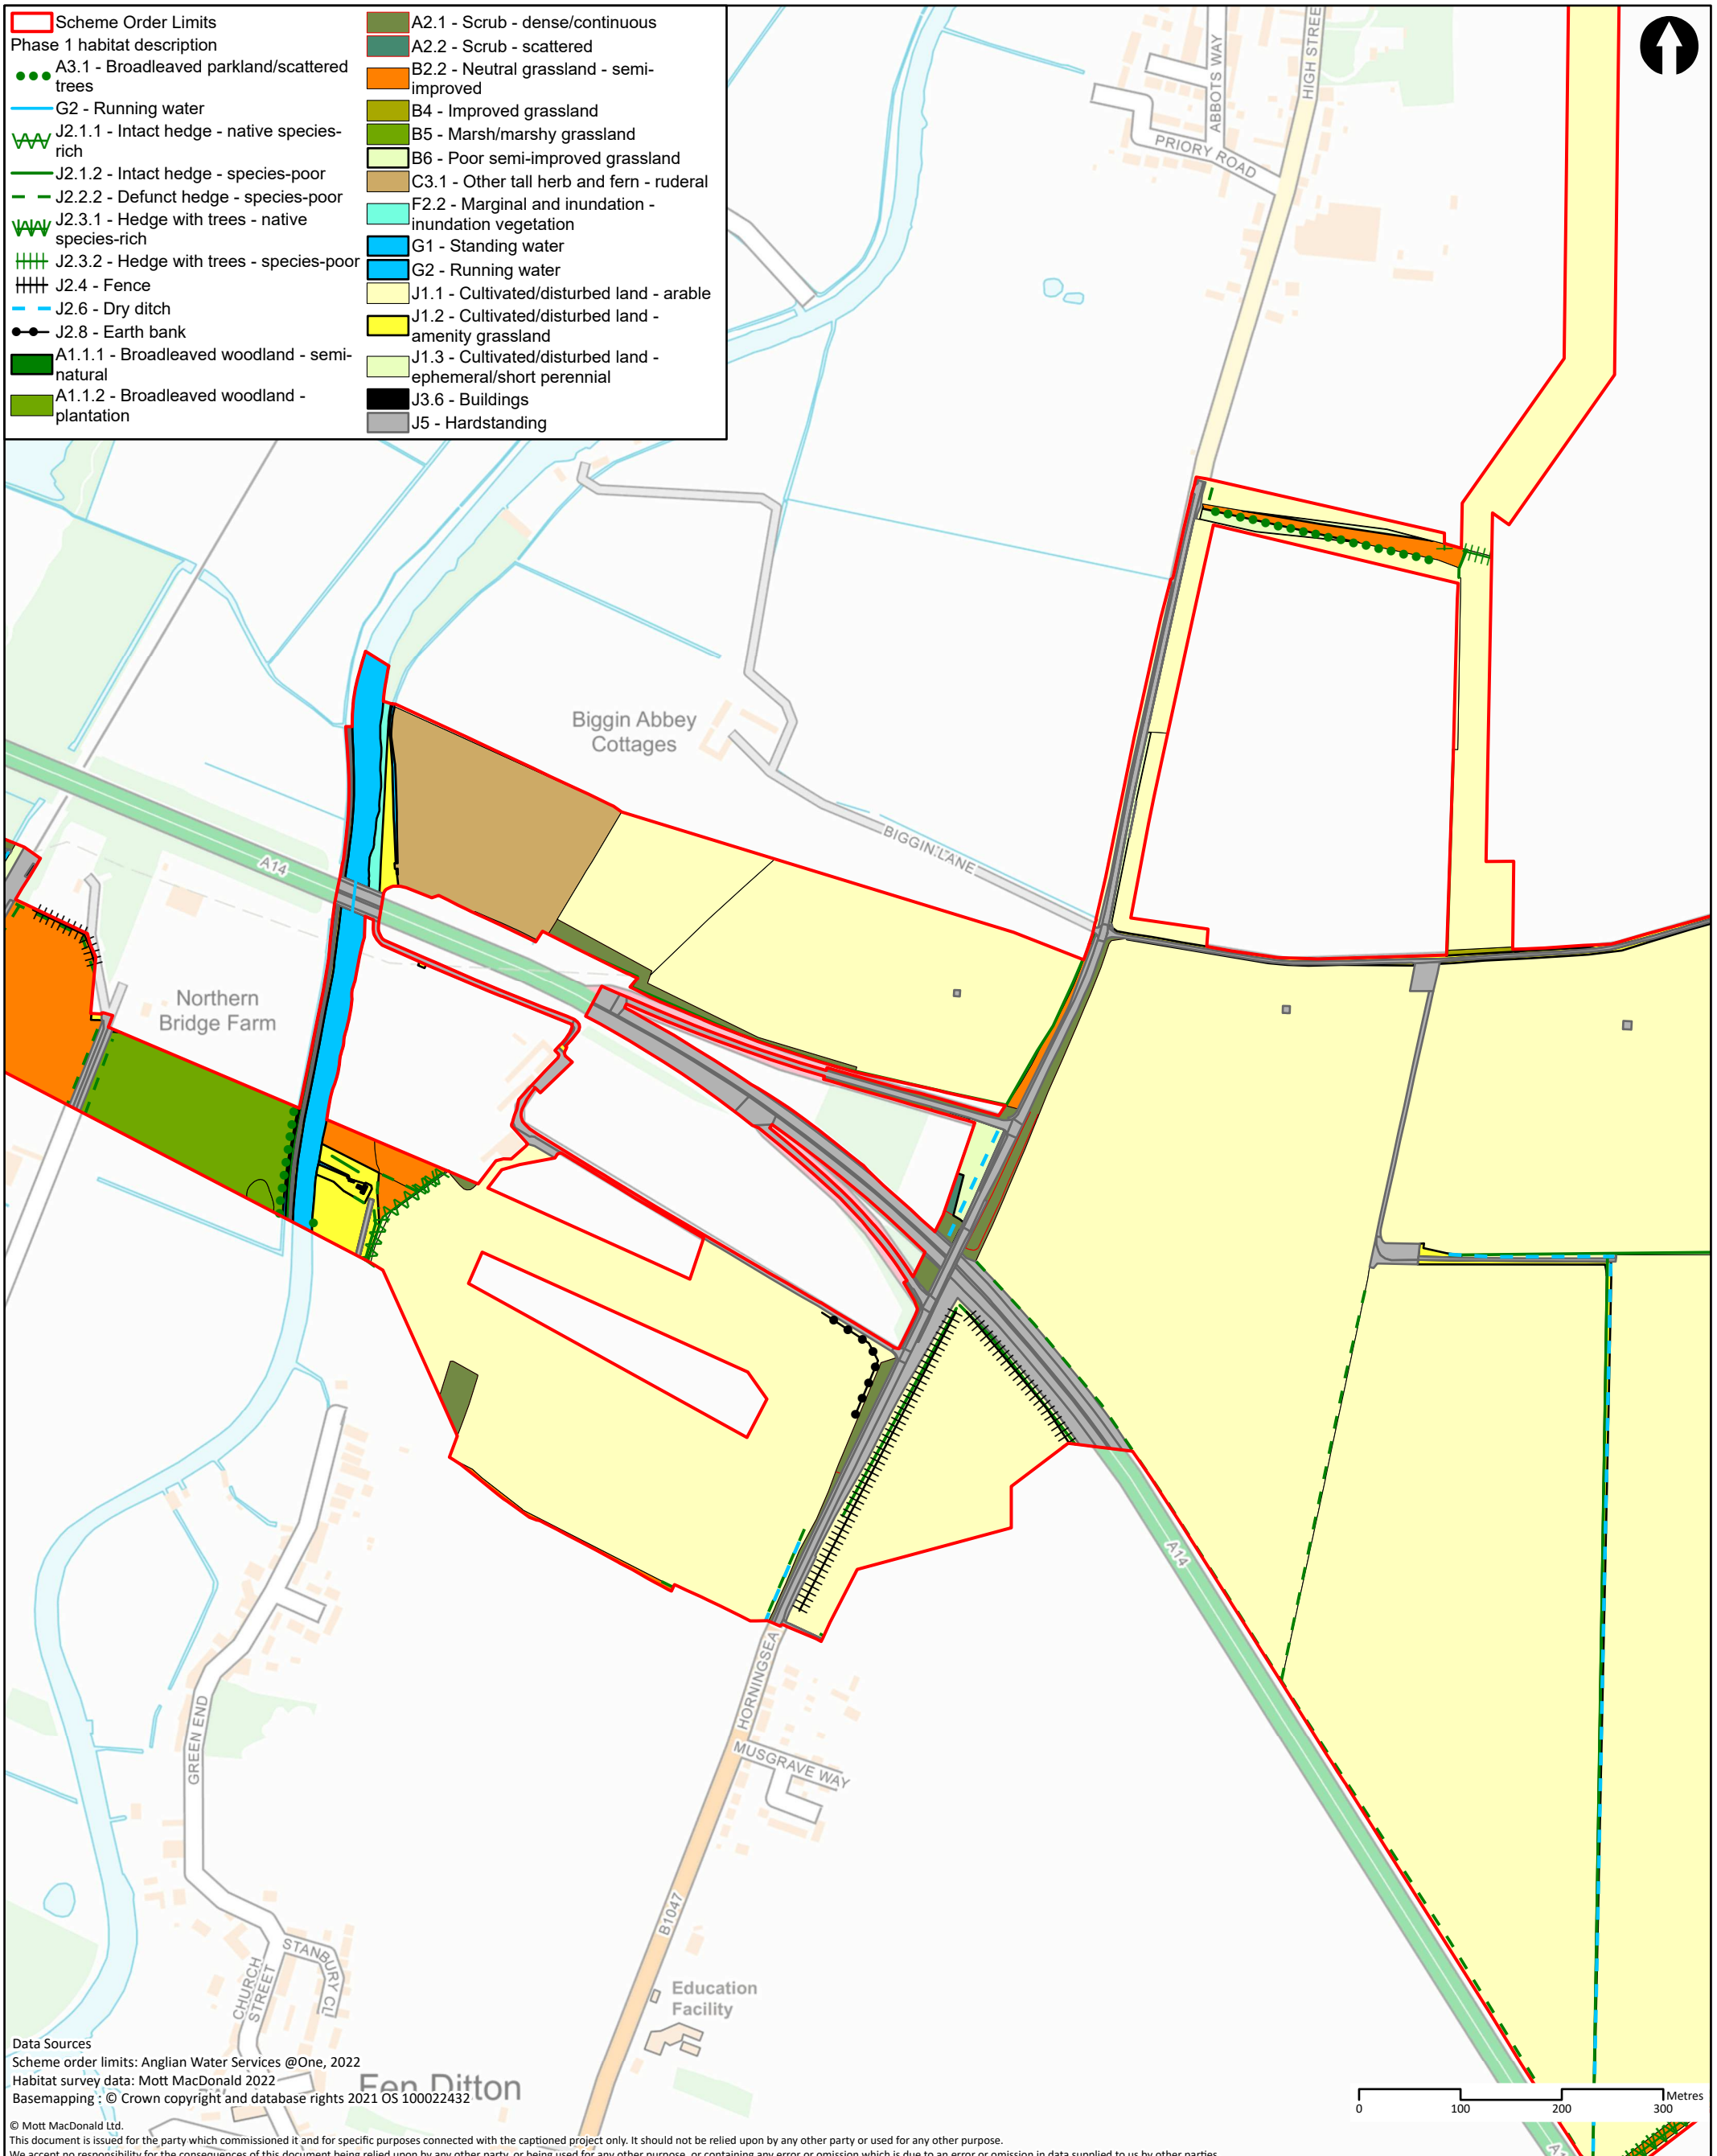

Data Sources  
 Scheme order limits: Anglian Water Services @One, 2022  
 Habitat survey data: Mott MacDonald 2022  
 Basemapping : © Crown copyright and database rights 2021 OS 100022432

© Mott MacDonald Ltd.  
 This document is issued for the party which commissioned it and for specific purposes connected with the captioned project only. It should not be relied upon by any other party or used for any other purpose.  
 We accept no responsibility for the consequences of this document being relied upon by any other party, or being used for any other purpose, or containing any error or omission which is due to an error or omission in data supplied to us by other parties.


<p>22 Station Road          Cambridge CB1 2JD          United Kingdom</p> <p>T +44 (0)20 8774 2000          F +44 (0)20 8681 5706          W mottmac.com</p>	Client 					Title Cambridge Waste Water Treatment Plant Relocation Project Environmental Statement Phase 1 habitat			Drawn	KL												
	<table border="1"> <thead> <tr> <th>Rev</th> <th>Date</th> <th>Drawn</th> <th>Description</th> <th>Ch'k'd</th> <th>App'd</th> </tr> </thead> <tbody> <tr> <td>P1</td> <td>02/11/22</td> <td>KL</td> <td>First Draft</td> <td>AW</td> <td>CS</td> </tr> </tbody> </table>					Rev	Date	Drawn	Description	Ch'k'd	App'd	P1	02/11/22	KL	First Draft	AW	CS	Checked Approved			AW	CS
	Rev	Date	Drawn	Description	Ch'k'd	App'd																
P1	02/11/22	KL	First Draft	AW	CS																	
Drawing Number <p style="text-align: center;">Figure 8.6</p>					Scale at A3 1:6,000			Security	Status	Rev												
								STD	PRE	P1												

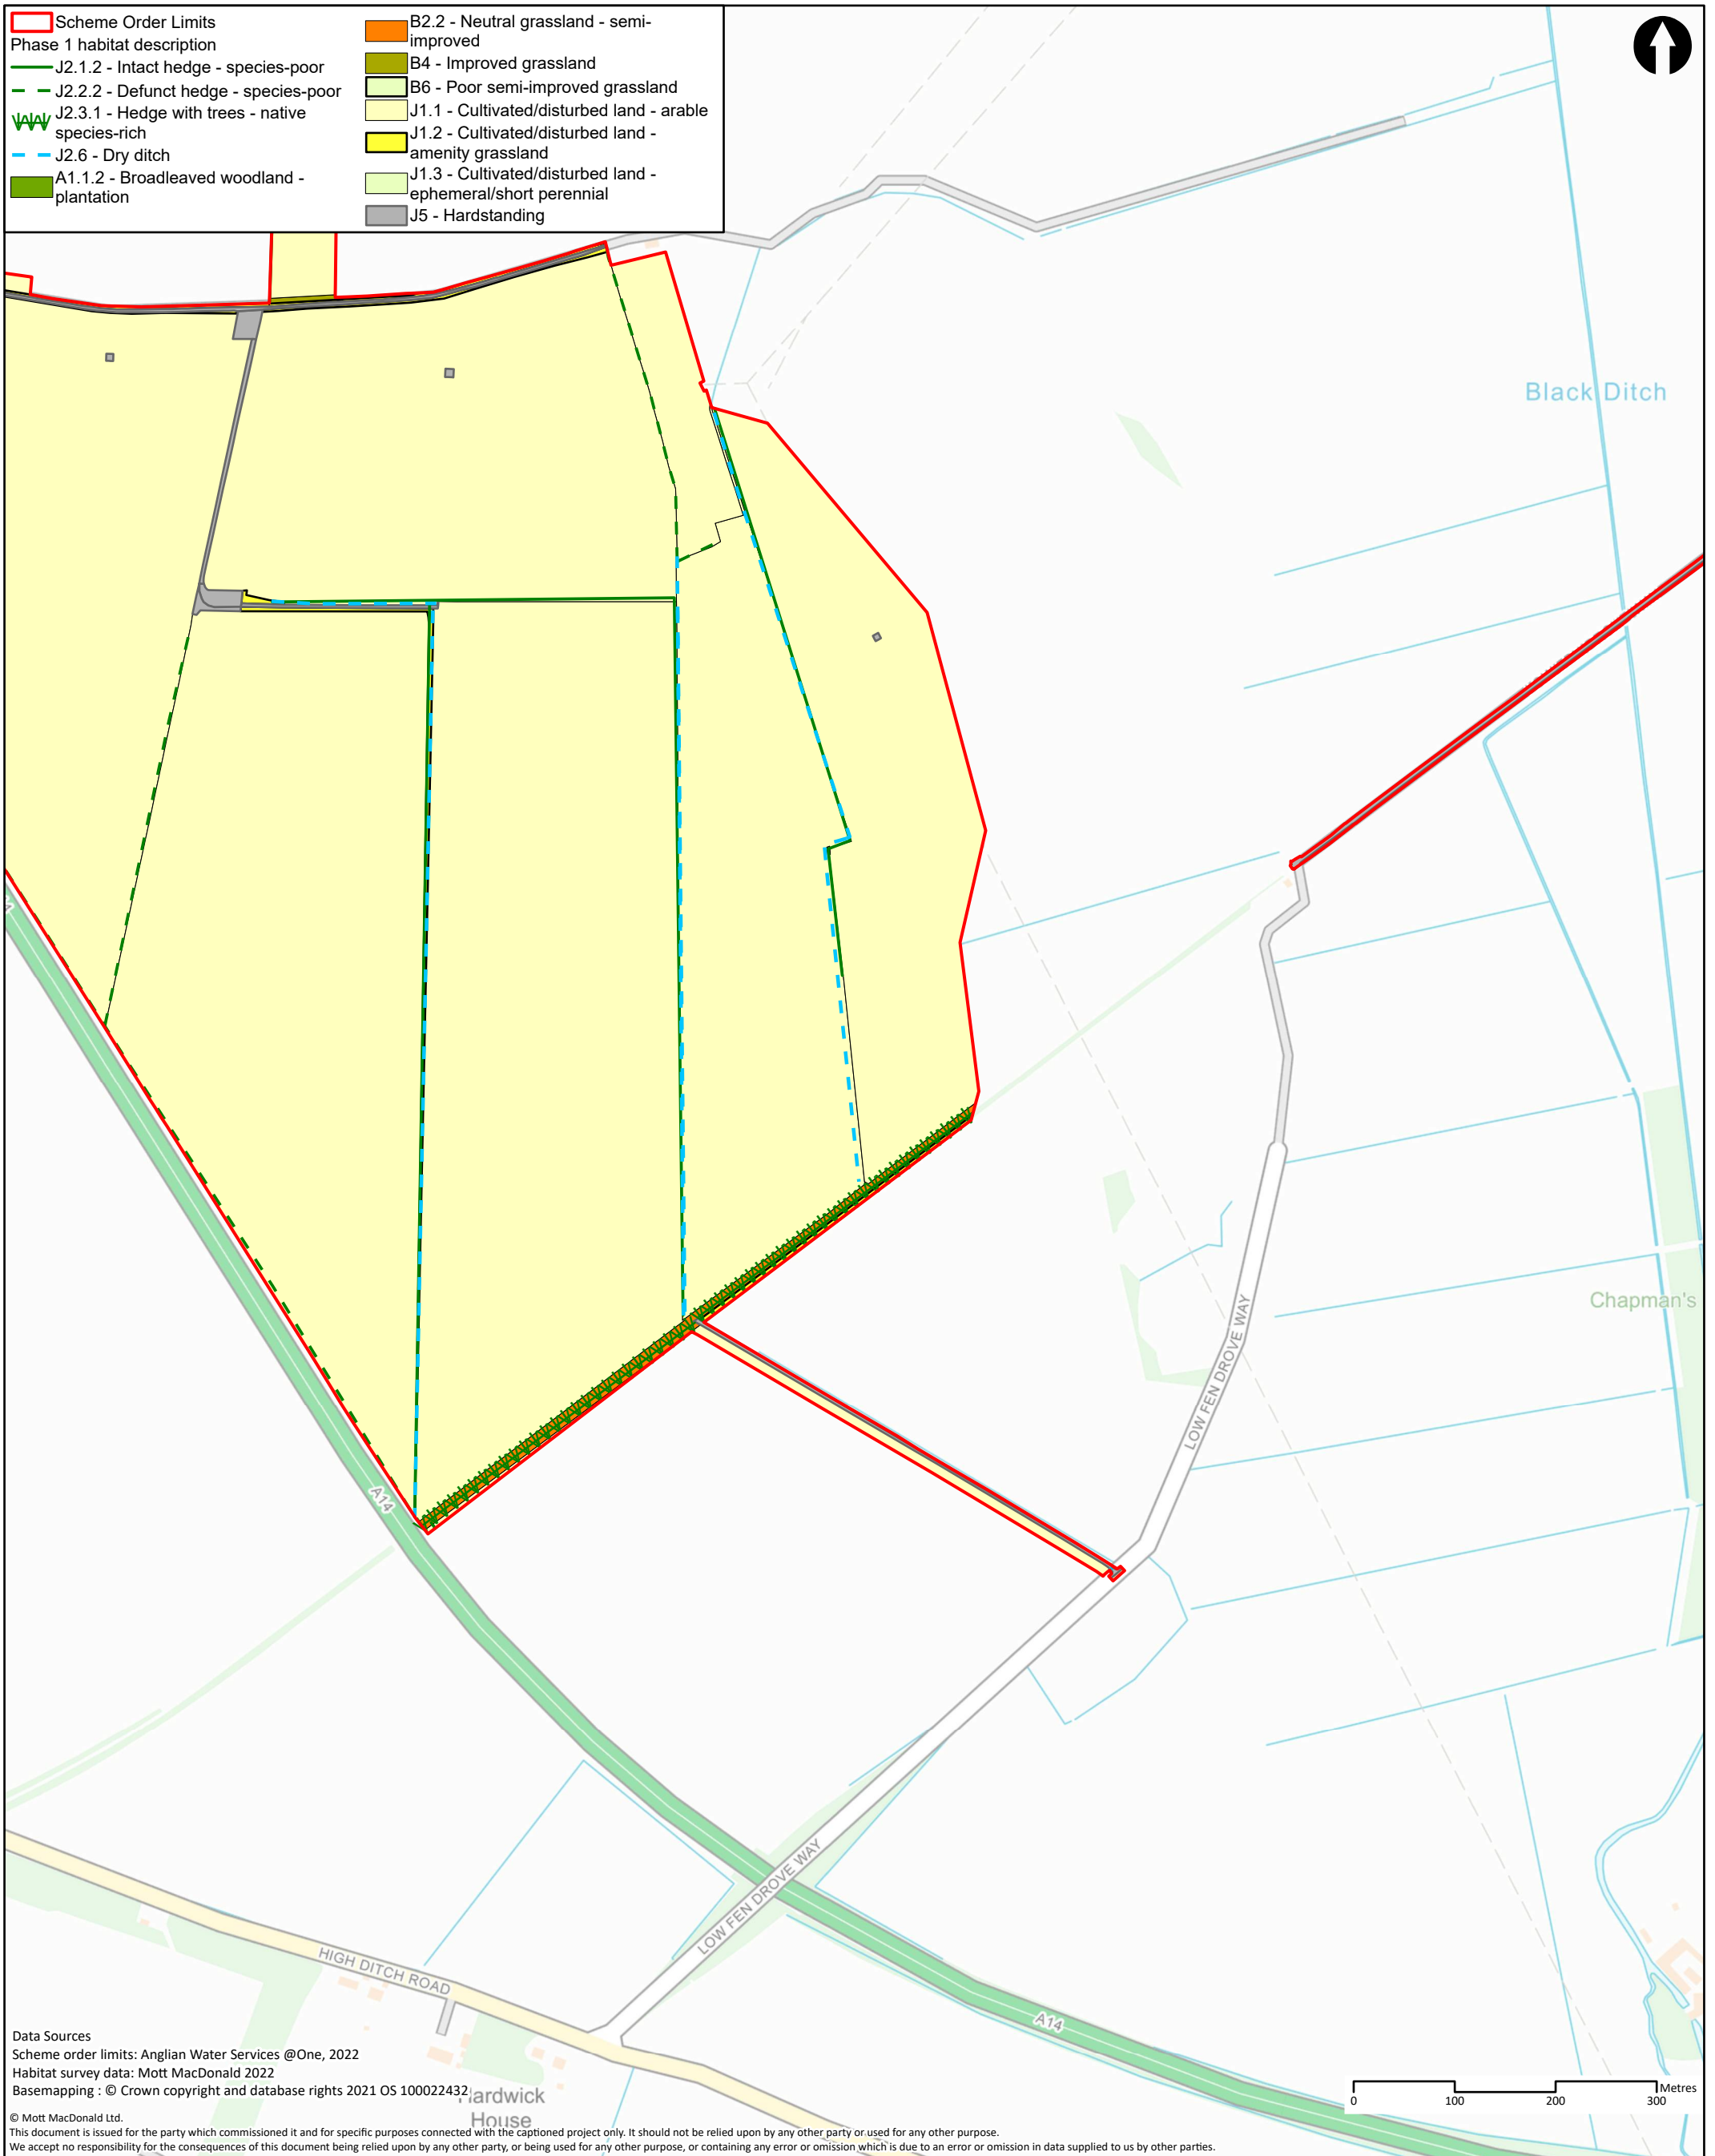


<p>22 Station Road Cambridge CB1 2JD United Kingdom</p> <p>T +44 (0)20 8774 2000 F +44 (0)20 8681 5706 W mottmac.com</p>	Client 					Title Cambridge Waste Water Treatment Plant Relocation Project Environmental Statement Phase 1 habitat			Drawn	KL												
	<table border="1"> <thead> <tr> <th>Rev</th> <th>Date</th> <th>Drawn</th> <th>Description</th> <th>Ch'k'd</th> <th>App'd</th> </tr> </thead> <tbody> <tr> <td>P1</td> <td>02/11/22</td> <td>KL</td> <td>First Draft</td> <td>AW</td> <td>CS</td> </tr> </tbody> </table>					Rev	Date	Drawn	Description	Ch'k'd	App'd	P1	02/11/22	KL	First Draft	AW	CS	Drawing Number <p style="text-align: center;">Figure 8.7</p>			Checked	AW
	Rev	Date	Drawn	Description	Ch'k'd	App'd																
P1	02/11/22	KL	First Draft	AW	CS																	
					Approved CS			Scale at A3 1:6,000														
								Security	Status	Rev												
								STD	PRE	P1												



Scheme Order Limits	B2.2 - Neutral grassland - semi-improved
<b>Phase 1 habitat description</b>	B6 - Poor semi-improved grassland
J2.1.2 - Intact hedge - species-poor	J1.1 - Cultivated/disturbed land - arable
J2.2.2 - Defunct hedge - species-poor	J1.2 - Cultivated/disturbed land - amenity grassland
J2.3.1 - Hedge with trees - native species-rich	J5 - Hardstanding
J2.6 - Dry ditch	
A1.1.2 - Broadleaved woodland - plantation	

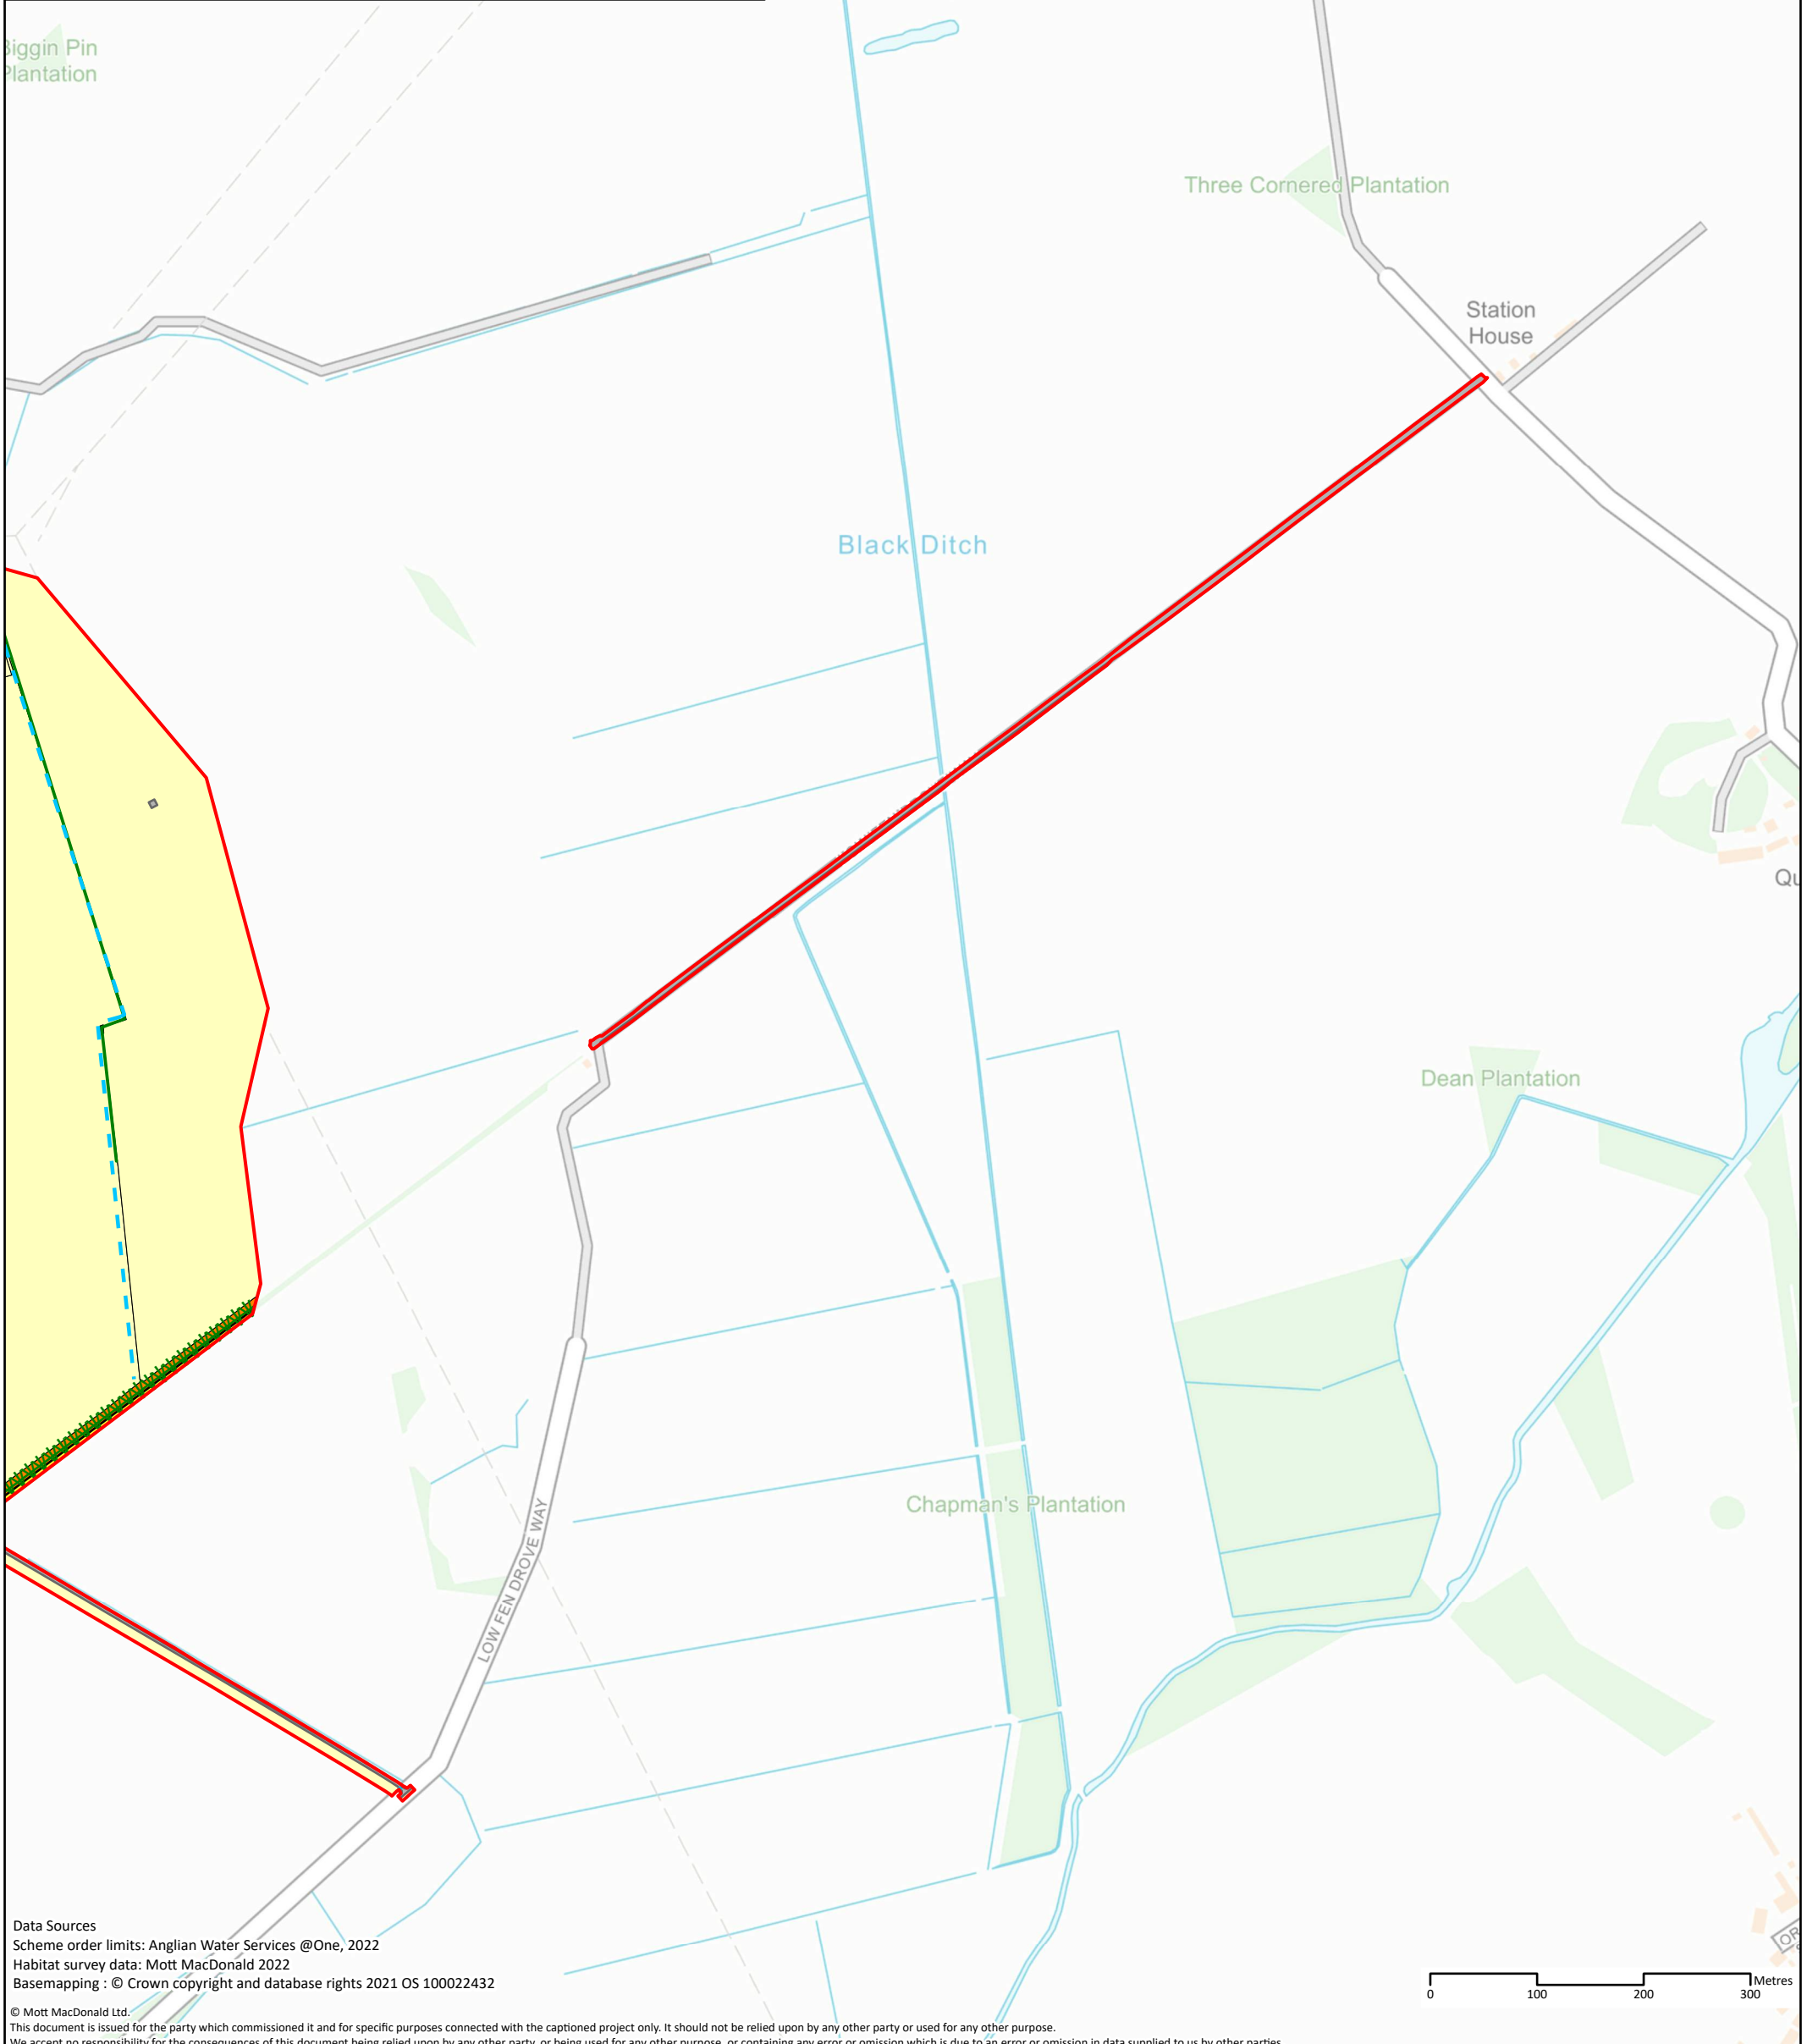

Data Sources  
 Scheme order limits: Anglian Water Services @One, 2022  
 Habitat survey data: Mott MacDonald 2022  
 Basemapping : © Crown copyright and database rights 2021 OS 100022432




© Mott MacDonald Ltd.  
 This document is issued for the party which commissioned it and for specific purposes connected with the captioned project only. It should not be relied upon by any other party or used for any other purpose.  
 We accept no responsibility for the consequences of this document being relied upon by any other party, or being used for any other purpose, or containing any error or omission which is due to an error or omission in data supplied to us by other parties.

	22 Station Road Cambridge CB1 2JD United Kingdom  T +44 (0)20 8774 2000 F +44 (0)20 8681 5706 W mottmac.com	Client					Title <b>Cambridge Waste Water Treatment Plant Relocation Project Environmental Statement Phase 1 habitat</b>  Drawing Number <b>Figure 8.8</b>	Drawn	KL												
								Checked	AW												
								Approved	CS												
							Scale at A3 1:6,000														
<table border="1"> <thead> <tr> <th>Rev</th> <th>Date</th> <th>Drawn</th> <th>Description</th> <th>Ch'k'd</th> <th>App'd</th> </tr> </thead> <tbody> <tr> <td>P1</td> <td>02/11/22</td> <td>KL</td> <td>First Draft</td> <td>AW</td> <td>CS</td> </tr> </tbody> </table>							Rev	Date	Drawn	Description	Ch'k'd	App'd	P1	02/11/22	KL	First Draft	AW	CS	Security	Status	Rev
Rev	Date	Drawn	Description	Ch'k'd	App'd																
P1	02/11/22	KL	First Draft	AW	CS																
							STD	PRE	P1												



Scheme Order Limits	A2.2 - Scrub - scattered
<b>Phase 1 habitat description</b>	B2.2 - Neutral grassland - semi-improved
A3.1 - Broadleaved parkland/scattered trees	B4 - Improved grassland
J2.1.1 - Intact hedge - native species-rich	B6 - Poor semi-improved grassland
J2.1.2 - Intact hedge - species-poor	G1 - Standing water
J2.2.2 - Defunct hedge - species-poor	J1.1 - Cultivated/disturbed land - arable
J2.3.2 - Hedge with trees - species-poor	J1.2 - Cultivated/disturbed land - amenity grassland
J2.6 - Dry ditch	J1.3 - Cultivated/disturbed land - ephemeral/short perennial
A1.1.2 - Broadleaved woodland - plantation	J5 - Hardstanding
A2.1 - Scrub - dense/continuous	

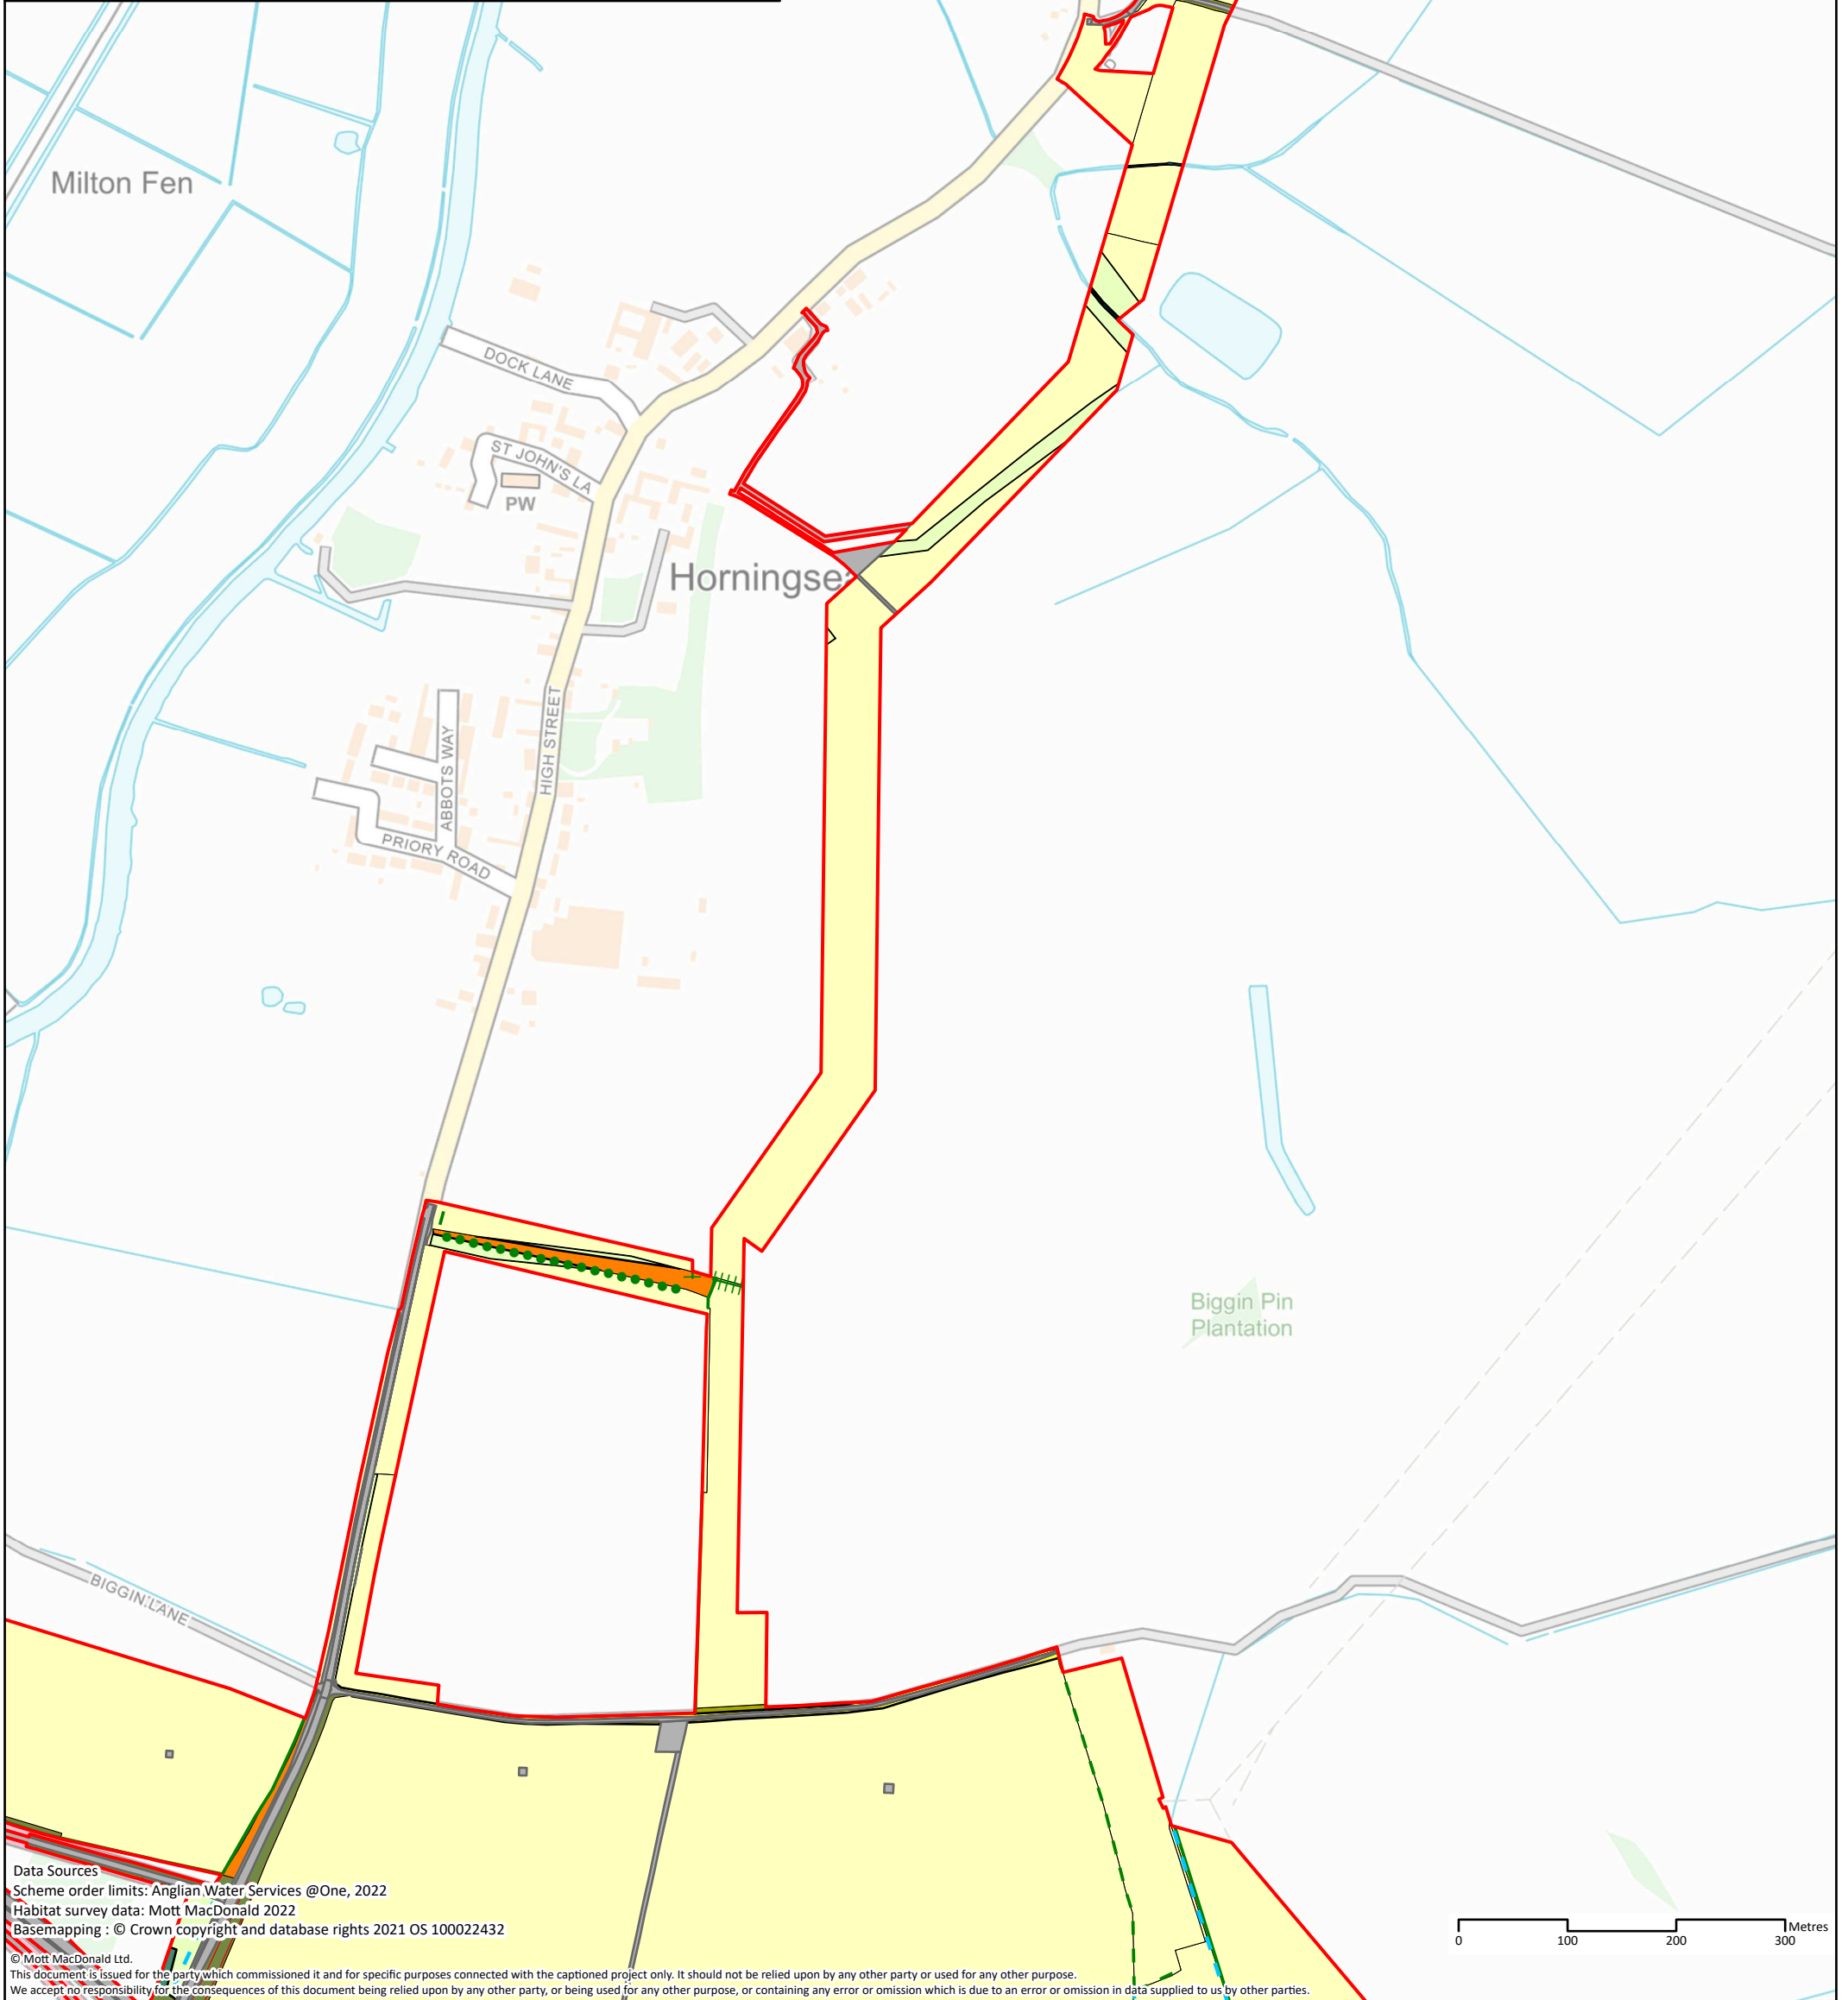


Data Sources  
 Scheme order limits: Anglian Water Services @One, 2022  
 Habitat survey data: Mott MacDonald 2022  
 Basemapping : © Crown copyright and database rights 2021 OS 100022432

© Mott MacDonald Ltd.  
 This document is issued for the party which commissioned it and for specific purposes connected with the captioned project only. It should not be relied upon by any other party or used for any other purpose.  
 We accept no responsibility for the consequences of this document being relied upon by any other party, or being used for any other purpose, or containing any error or omission which is due to an error or omission in data supplied to us by other parties.

<p>22 Station Road Cambridge CB1 2JD United Kingdom</p> <p>T +44 (0)20 8774 2000 F +44 (0)20 8681 5706 W mottmac.com</p>	Client 					Title Cambridge Waste Water Treatment Plant Relocation Project Environmental Statement Phase 1 habitat			Drawn	KL												
	<table border="1"> <thead> <tr> <th>Rev</th> <th>Date</th> <th>Drawn</th> <th>Description</th> <th>Ch'k'd</th> <th>App'd</th> </tr> </thead> <tbody> <tr> <td>P1</td> <td>02/11/22</td> <td>KL</td> <td>First Draft</td> <td>AW</td> <td>CS</td> </tr> </tbody> </table>					Rev	Date	Drawn	Description	Ch'k'd	App'd	P1	02/11/22	KL	First Draft	AW	CS	Drawing Number <b>Figure 8.9</b>			Checked	AW
	Rev	Date	Drawn	Description	Ch'k'd	App'd																
P1	02/11/22	KL	First Draft	AW	CS																	
					Approved CS			Scale at A3 <b>1:6,000</b>														
								Security	Status	Rev												
								STD	PRE	P1												

Scheme Order Limits	B4 - Improved grassland
<b>Phase 1 habitat description</b>	B6 - Poor semi-improved grassland
A2.2 - Scrub - scattered	F2.2 - Marginal and inundation - inundation vegetation
A3.1 - Broadleaved parkland/scattered trees	G1 - Standing water
G2 - Running water	G2 - Running water
J2.1.1 - Intact hedge - native species-rich	J1.1 - Cultivated/disturbed land - arable
J2.1.2 - Intact hedge - species-poor	J1.2 - Cultivated/disturbed land - amenity grassland
J2.6 - Dry ditch	J3.6 - Buildings
A1.1.1 - Broadleaved woodland - semi-natural	J4 - Bare ground
A1.1.2 - Broadleaved woodland - plantation	J5 - Hardstanding

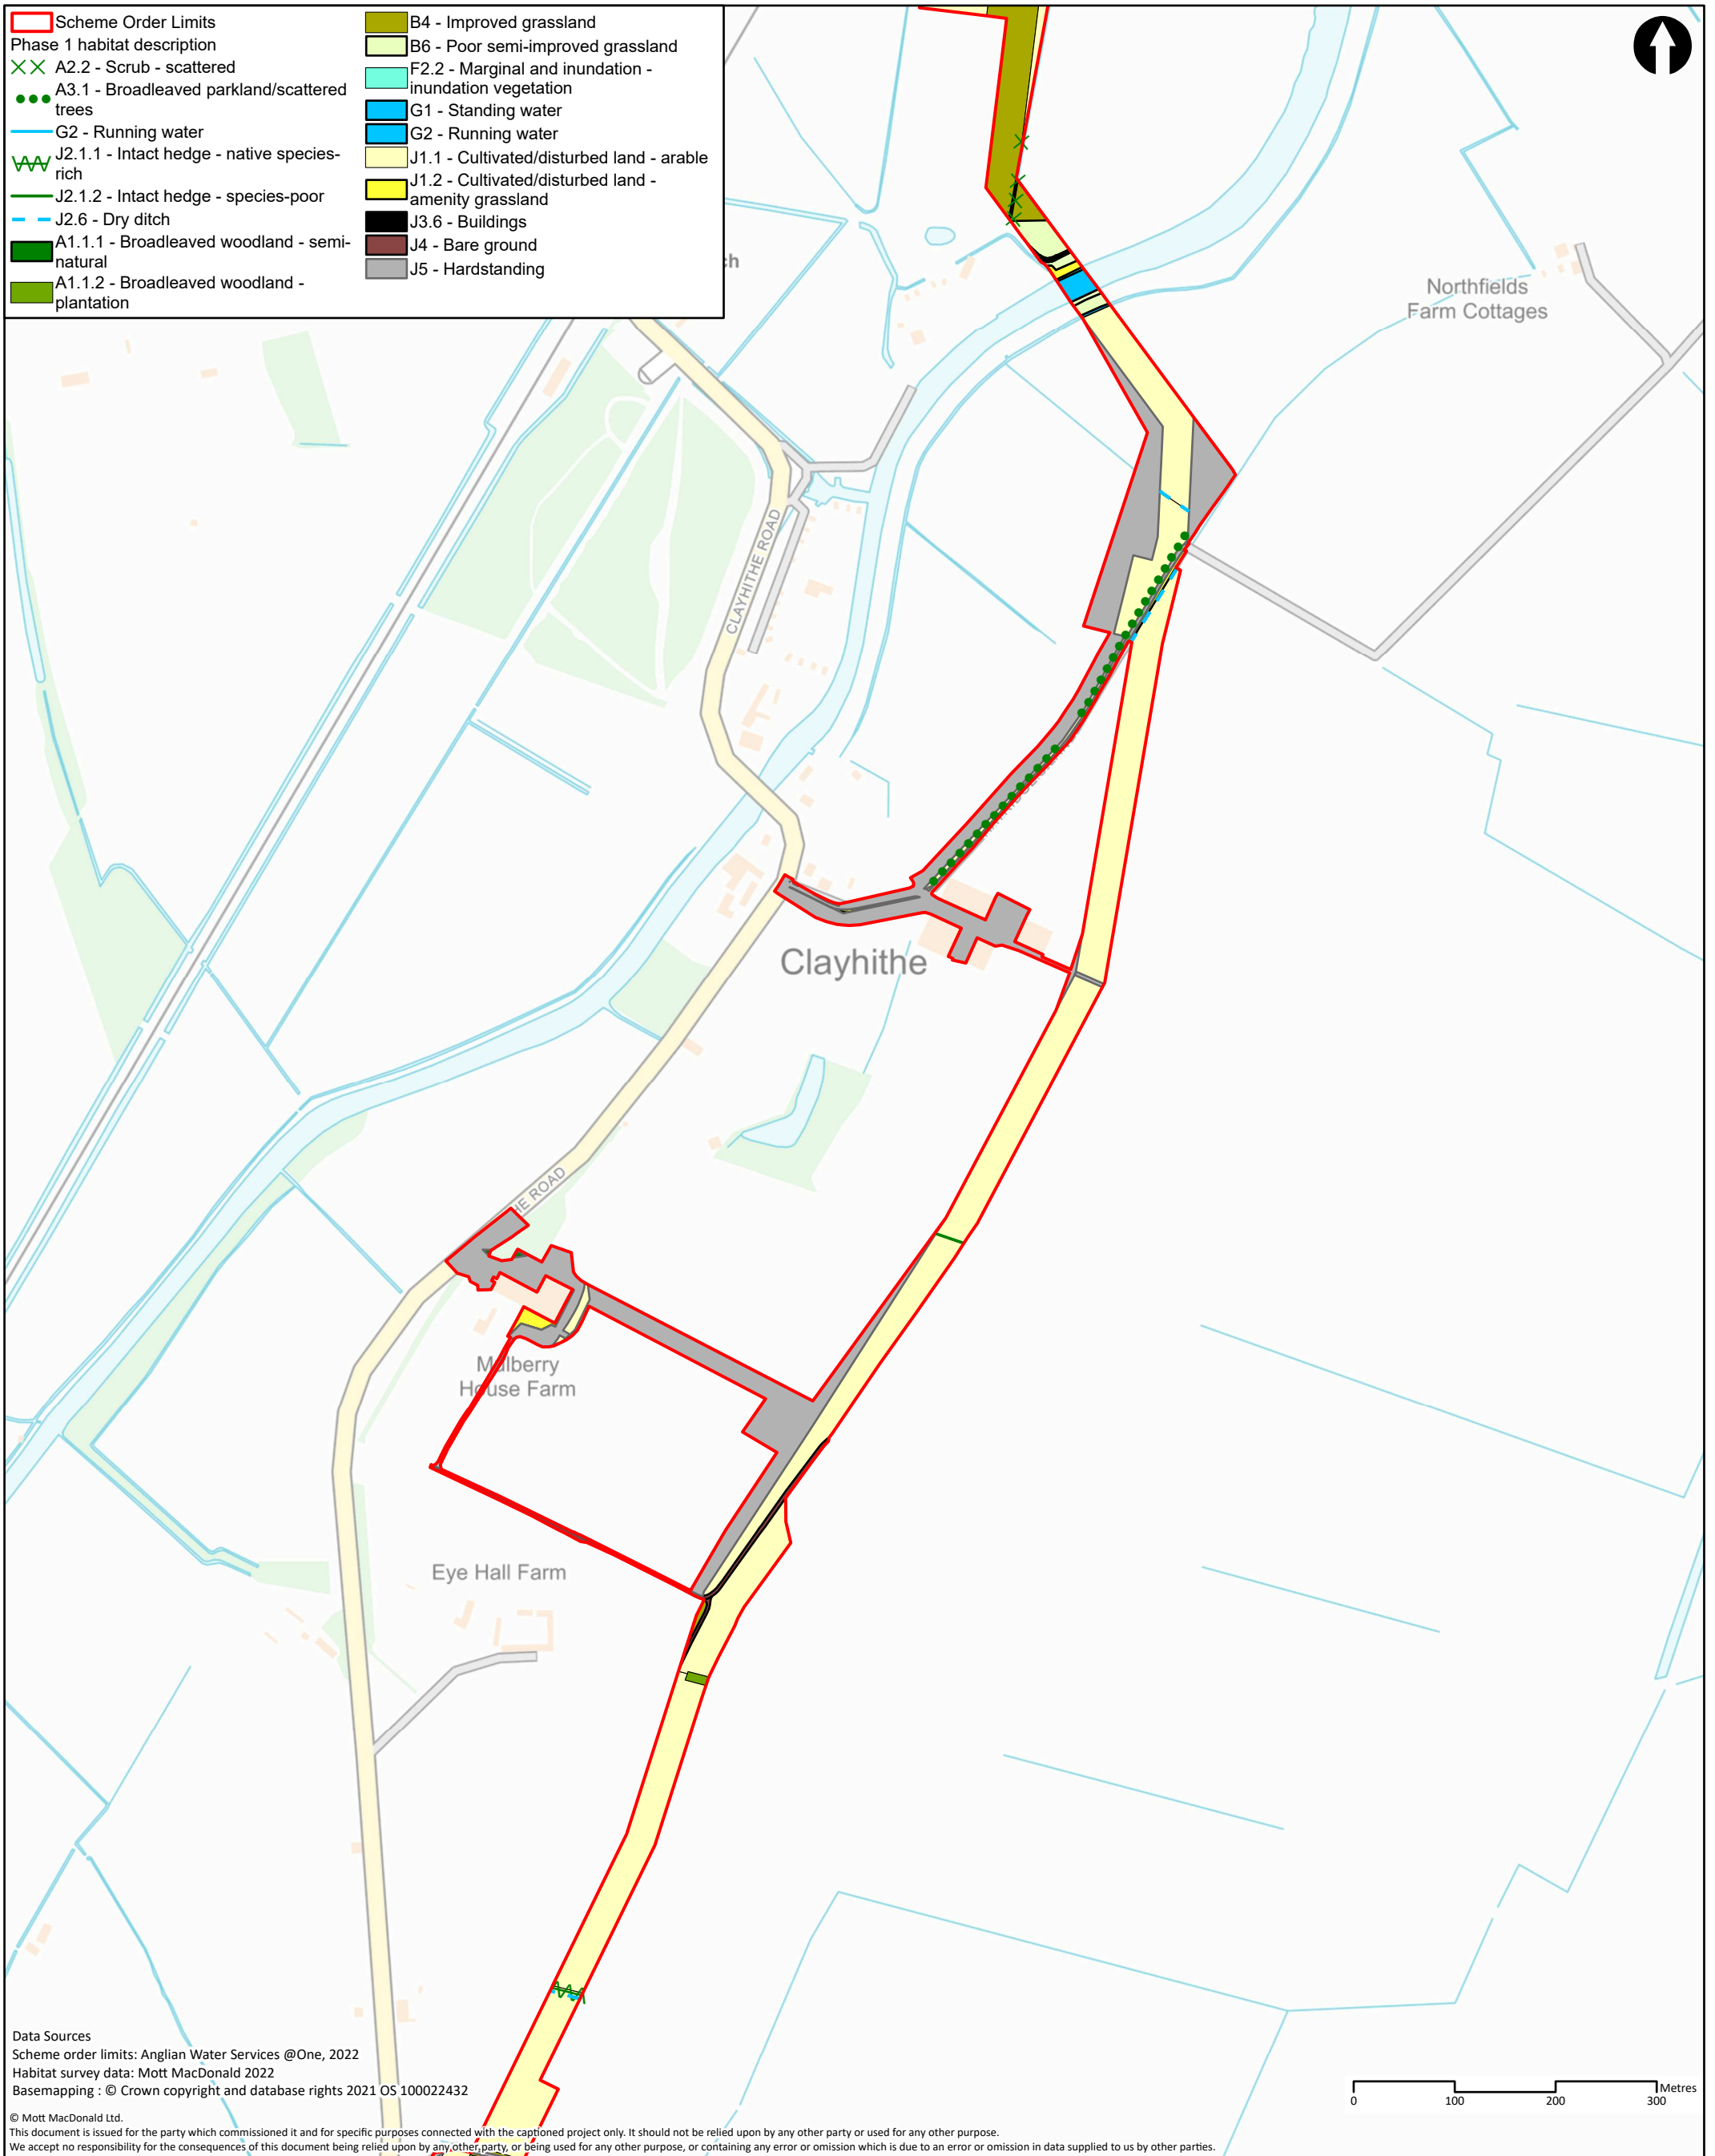


Data Sources  
 Scheme order limits: Anglian Water Services @One, 2022  
 Habitat survey data: Mott MacDonald 2022  
 Basemapping : © Crown copyright and database rights 2021 OS 100022432

© Mott MacDonald Ltd.  
 This document is issued for the party which commissioned it and for specific purposes connected with the captioned project only. It should not be relied upon by any other party or used for any other purpose.  
 We accept no responsibility for the consequences of this document being relied upon by any other party, or being used for any other purpose, or containing any error or omission which is due to an error or omission in data supplied to us by other parties.

<p>22 Station Road          Cambridge CB1 2JD          United Kingdom</p> <p>T +44 (0)20 8774 2000          F +44 (0)20 8681 5706          W mottmac.com</p>	Client 					Title Cambridge Waste Water Treatment Plant Relocation Project Environmental Statement Phase 1 habitat			Drawn	KL												
	<table border="1"> <thead> <tr> <th>Rev</th> <th>Date</th> <th>Drawn</th> <th>Description</th> <th>Ch'k'd</th> <th>App'd</th> </tr> </thead> <tbody> <tr> <td>P1</td> <td>02/11/22</td> <td>KL</td> <td>First Draft</td> <td>AW</td> <td>CS</td> </tr> </tbody> </table>					Rev	Date	Drawn	Description	Ch'k'd	App'd	P1	02/11/22	KL	First Draft	AW	CS	Drawing Number <b>Figure 8.10</b>			Checked	AW
	Rev	Date	Drawn	Description	Ch'k'd	App'd																
P1	02/11/22	KL	First Draft	AW	CS																	
					Scale at A3 <b>1:6,000</b>			Approved	CS													
								Security	Status	Rev												
								STD	PRE	P1												




Scheme Order Limits	F2.2 - Marginal and inundation - inundation vegetation
<b>Phase 1 habitat description</b>	G1 - Standing water
A2.2 - Scrub - scattered	G2 - Running water
A3.1 - Broadleaved parkland/scattered trees	J1.1 - Cultivated/disturbed land - arable
G2 - Running water	J1.2 - Cultivated/disturbed land - amenity grassland
J2.2.2 - Defunct hedge - species-poor	J1.3 - Cultivated/disturbed land - ephemeral/short perennial
J2.3.2 - Hedge with trees - species-poor	J3.6 - Buildings
J2.6 - Dry ditch	J4 - Bare ground
B4 - Improved grassland	J5 - Hardstanding
B6 - Poor semi-improved grassland	
C3.1 - Other tall herb and fern - ruderal	

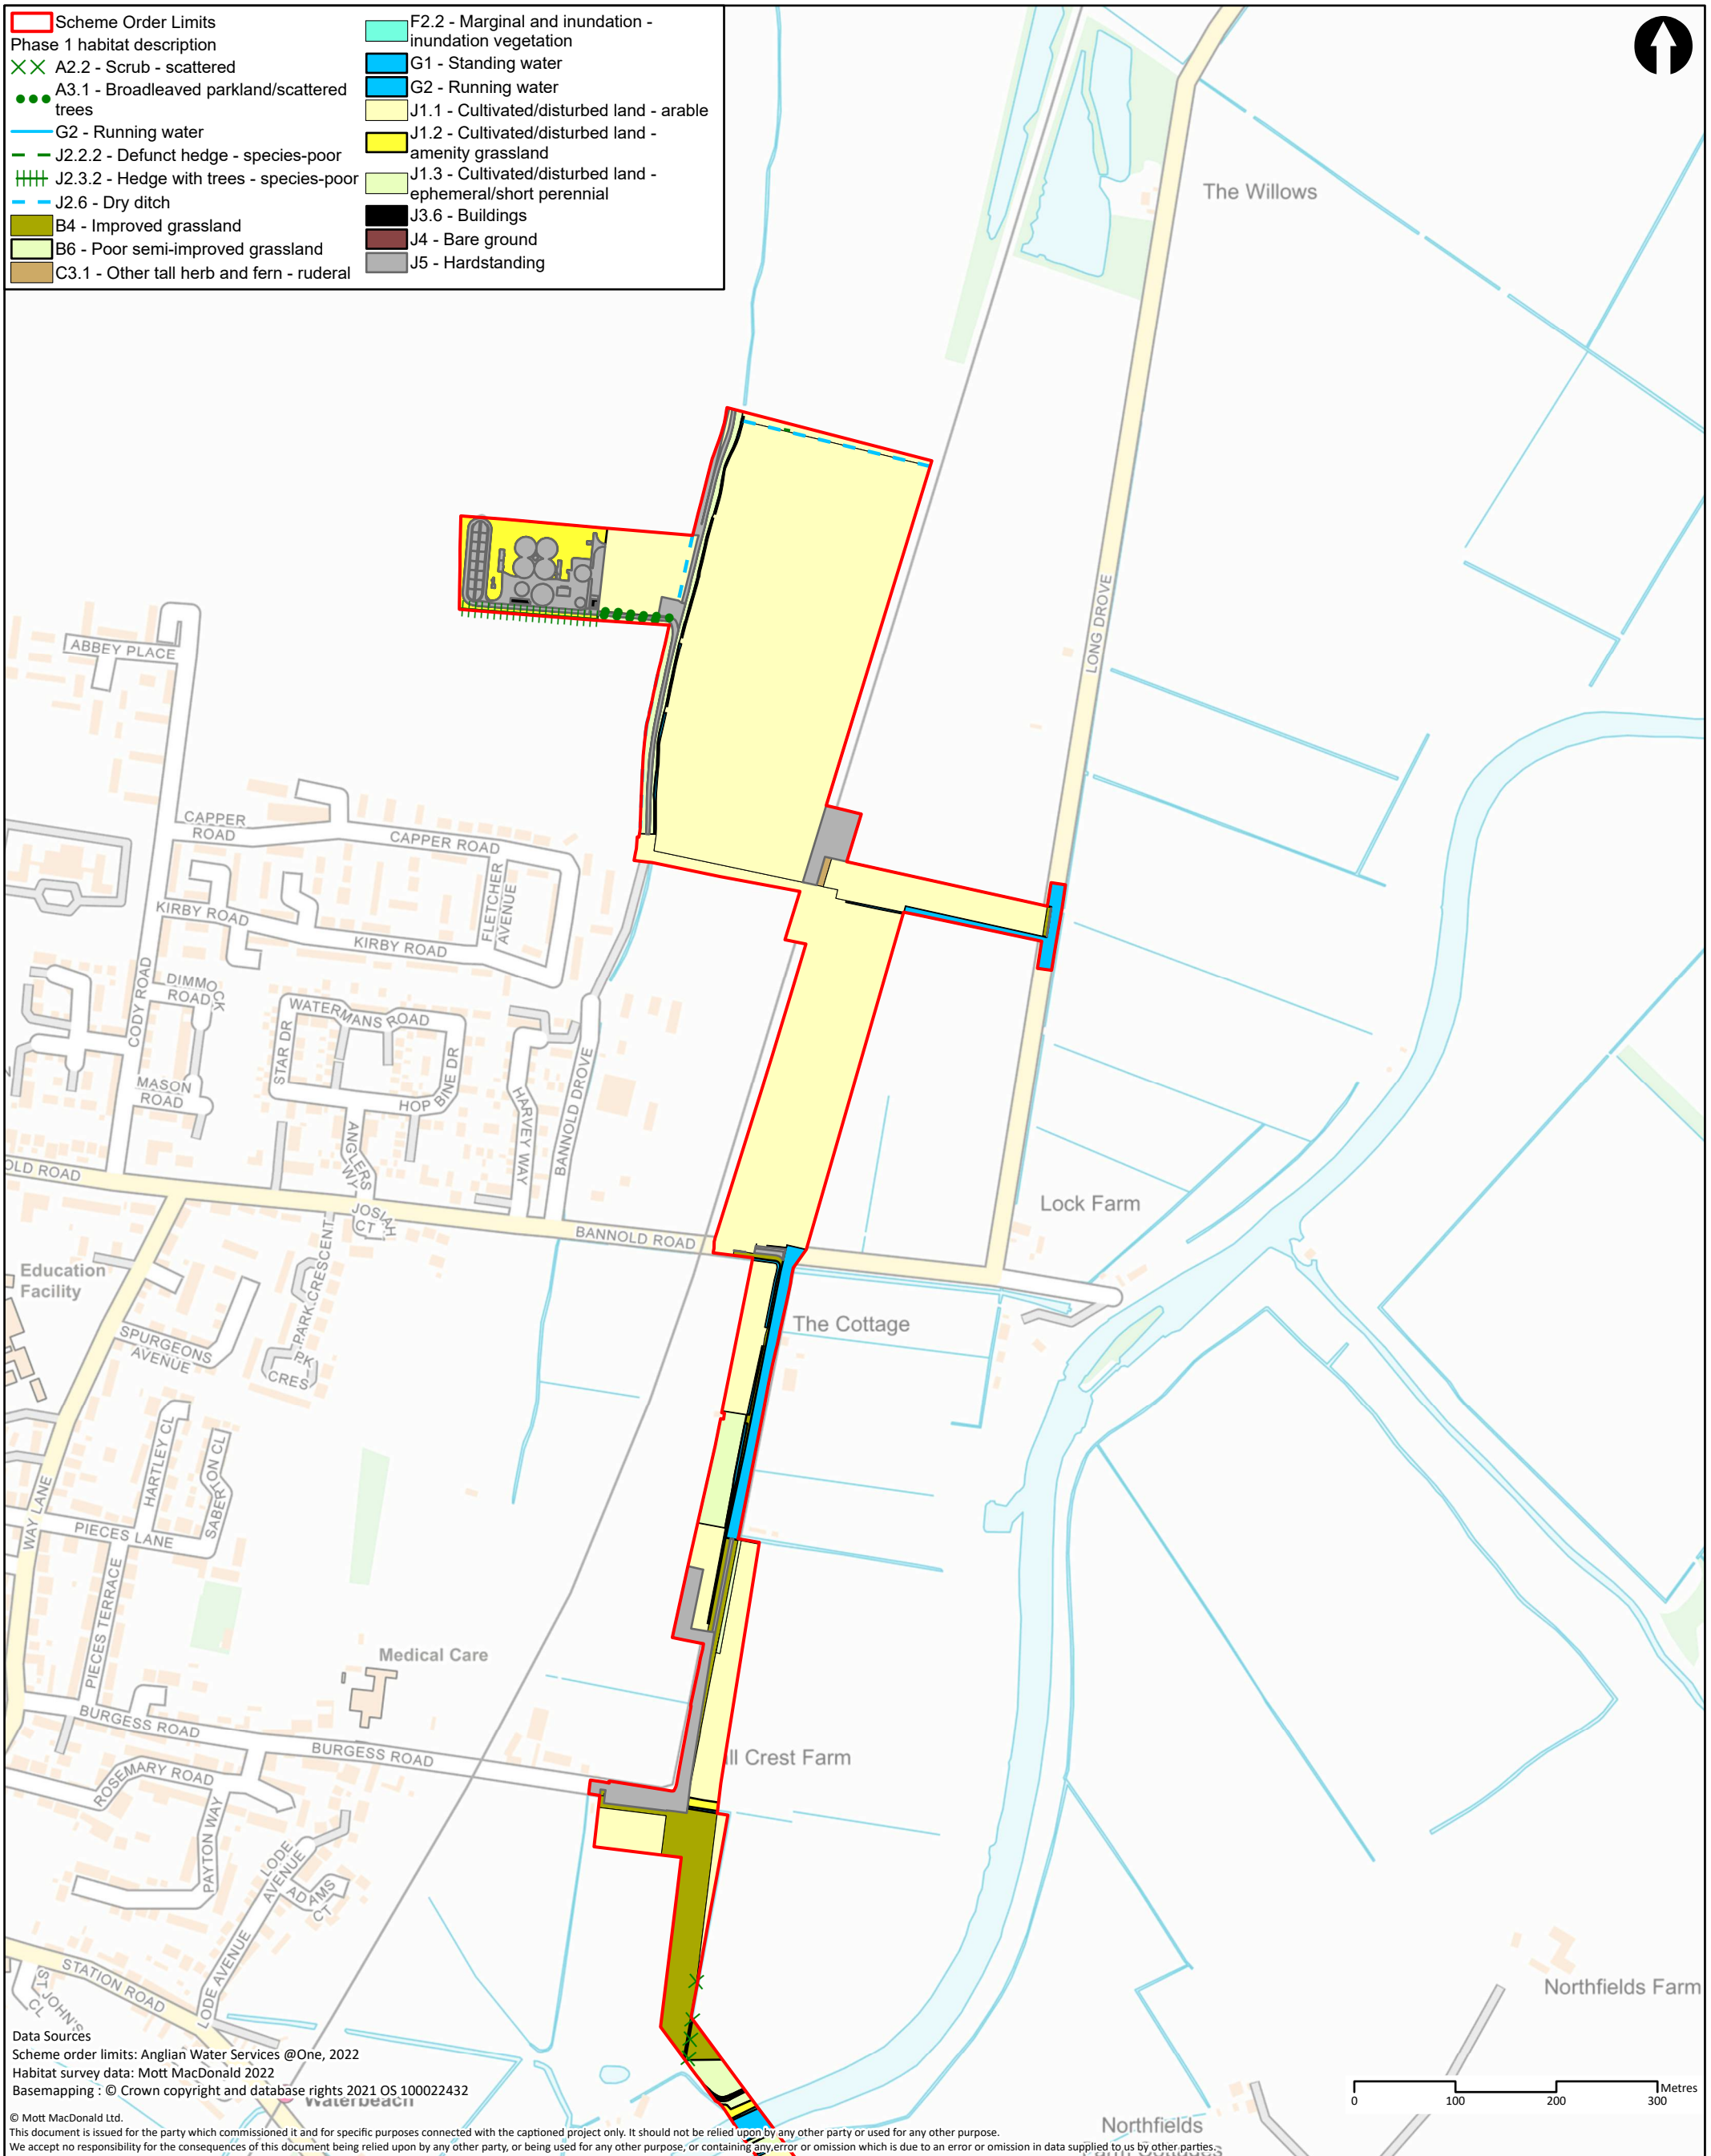


Data Sources  
 Scheme order limits: Anglian Water Services @One, 2022  
 Habitat survey data: Mott MacDonald 2022  
 Basemapping : © Crown copyright and database rights 2021 OS 100022432  
 © Mott MacDonald Ltd.  
 This document is issued for the party which commissioned it and for specific purposes connected with the captioned project only. It should not be relied upon by any other party or used for any other purpose.  
 We accept no responsibility for the consequences of this document being relied upon by any other party, or being used for any other purpose, or containing any error or omission which is due to an error or omission in data supplied to us by other parties.

	22 Station Road Cambridge CB1 2JD United Kingdom  T +44 (0)20 8774 2000 F +44 (0)20 8681 5706 W mottmac.com	Client 					Title Cambridge Waste Water Treatment Plant Relocation Project Environmental Statement Phase 1 habitat			Drawn KL						
		<table border="1"> <thead> <tr> <th>Rev</th> <th>Date</th> <th>Drawn</th> <th>Description</th> <th>Ch'k'd</th> <th>App'd</th> </tr> </thead> <tbody> <tr> <td>P1</td> <td>02/11/22</td> <td>KL</td> <td>First Draft</td> <td>AW</td> <td>CS</td> </tr> </tbody> </table>	Rev	Date	Drawn	Description	Ch'k'd	App'd	P1	02/11/22	KL	First Draft	AW	CS	Drawing Number Figure 8.11	
Rev	Date	Drawn	Description	Ch'k'd	App'd											
P1	02/11/22	KL	First Draft	AW	CS											
						Approved CS			Scale at A3 1:6,000							
						Security STD	Status PRE	Rev P1								

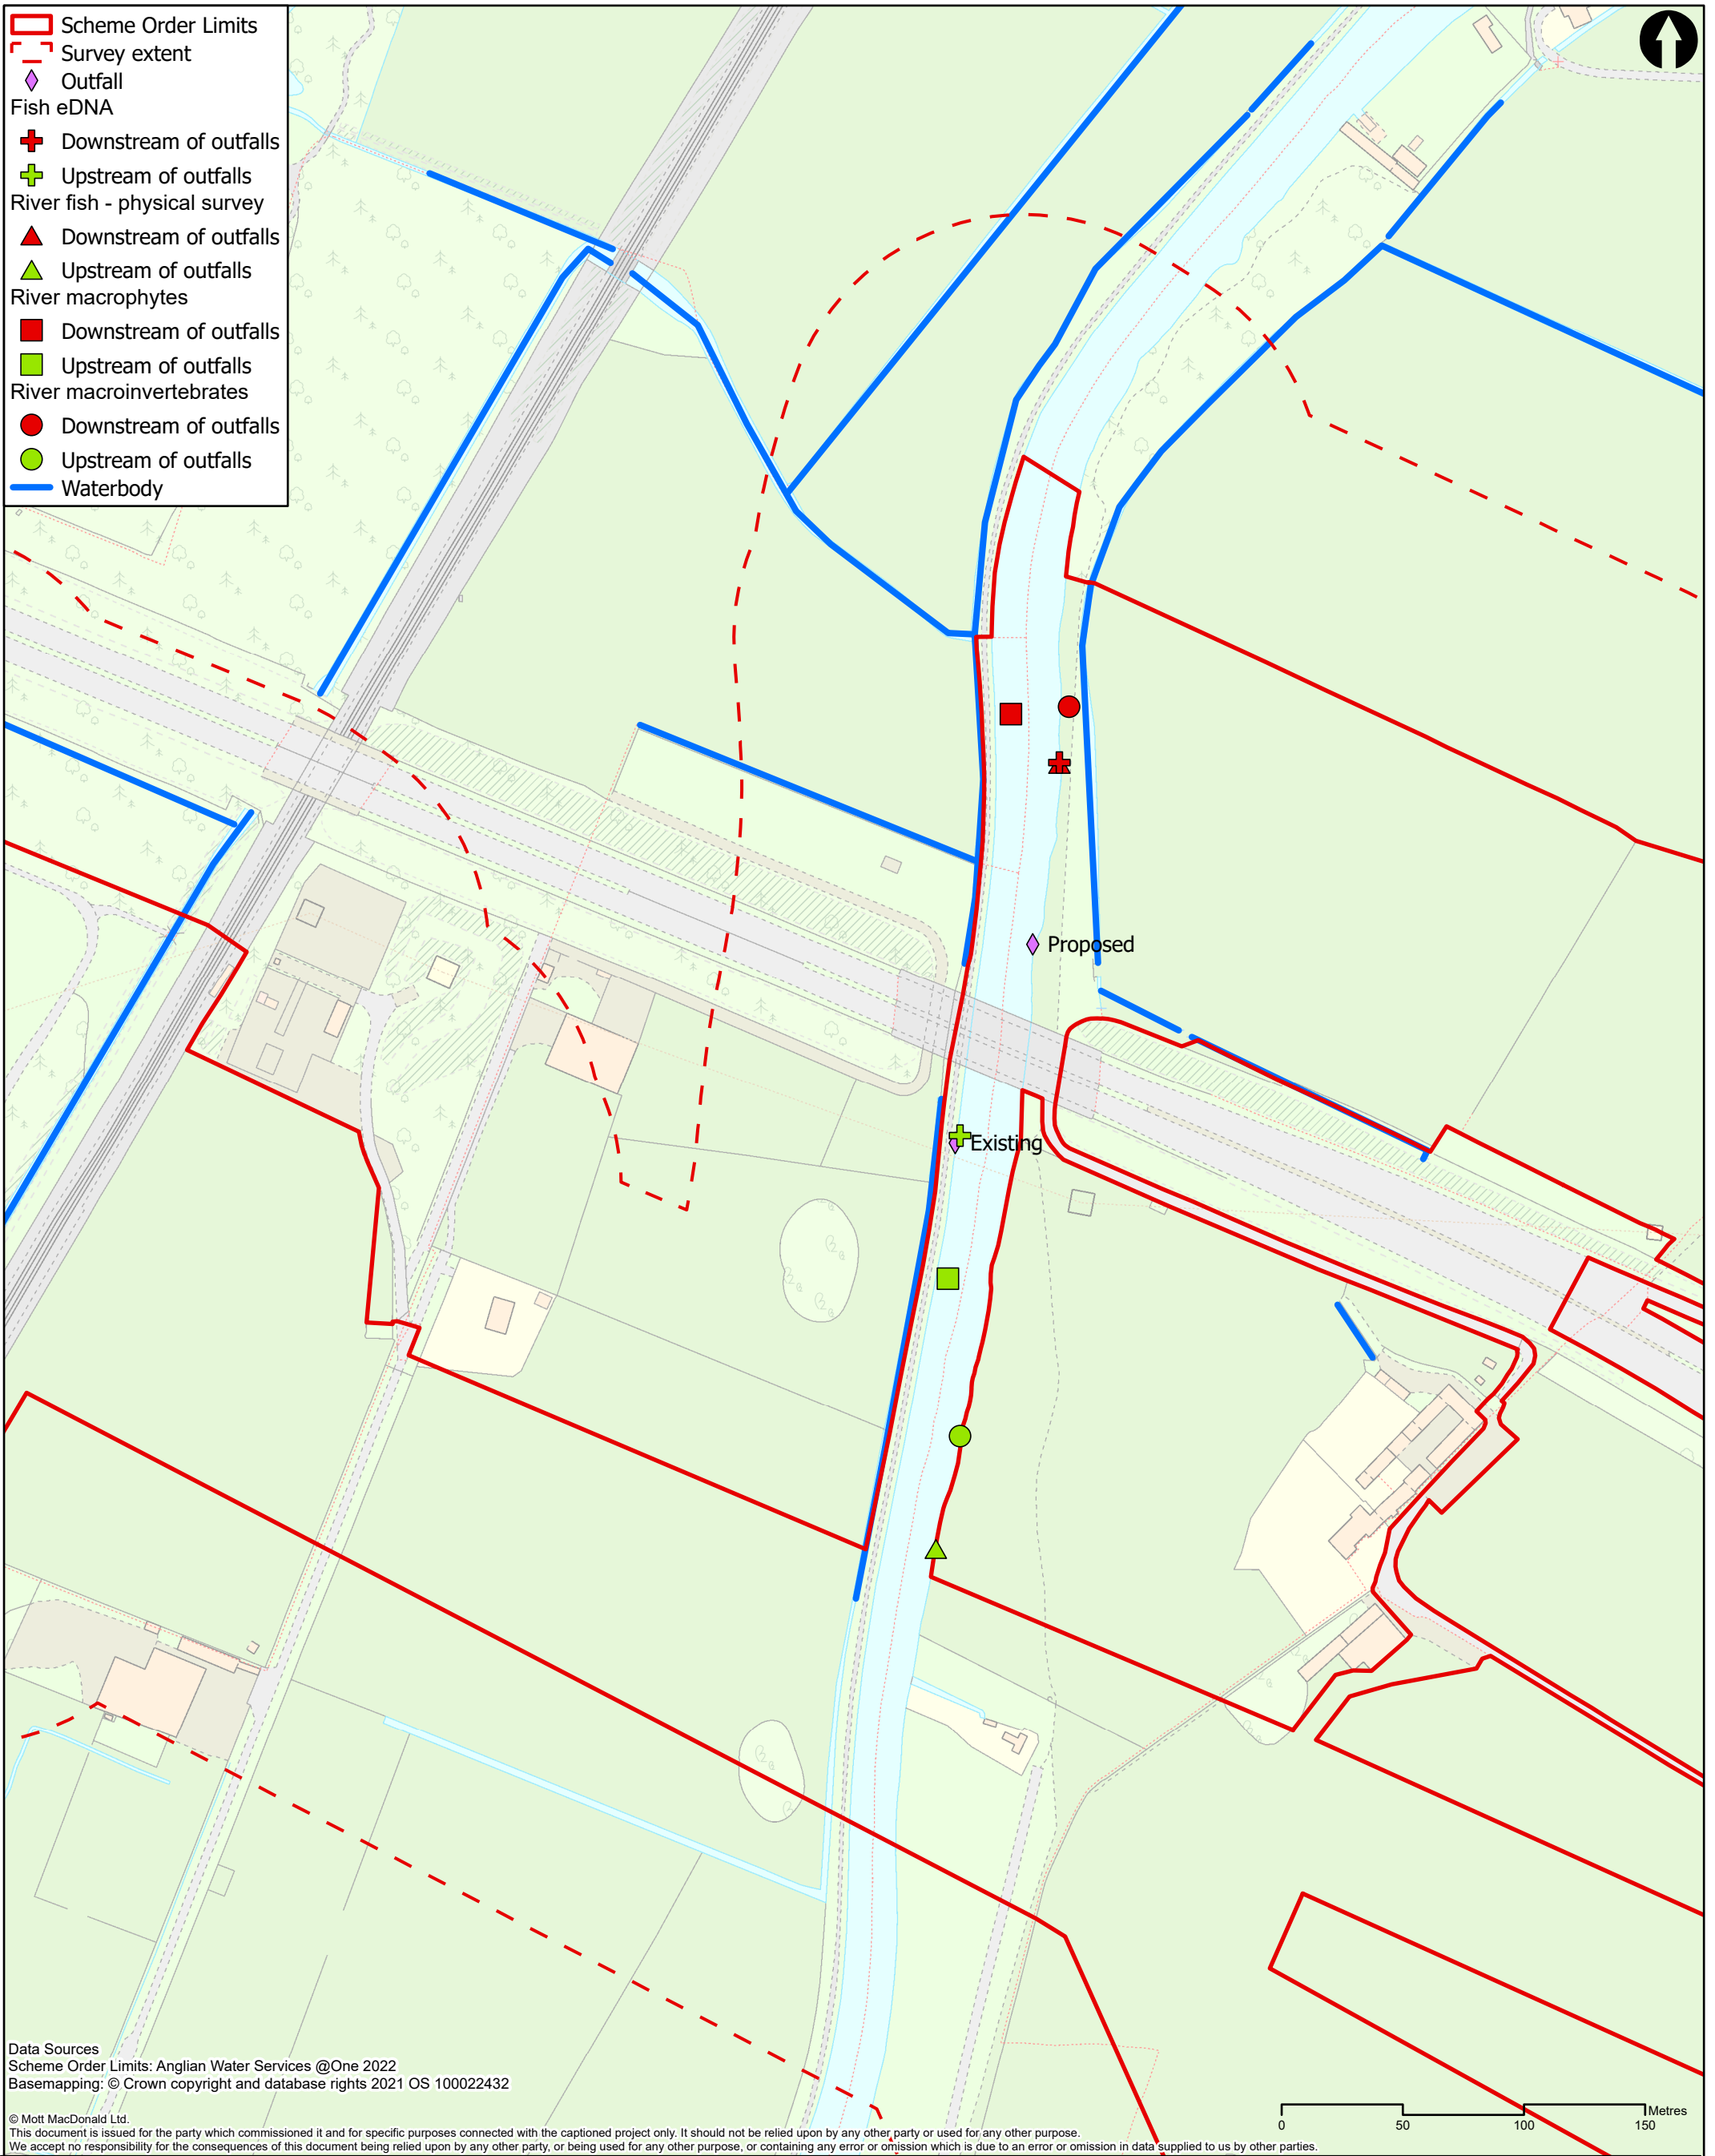


<p><b>MOTT MACDONALD</b></p> <p>22 Station Road Cambridge CB1 2JD United Kingdom</p> <p>T +44 (0)20 8774 2000 F +44 (0)20 8681 5706 W mottmac.com</p>	<p>Client</p>					<p>Title</p> <p>Cambridge Waste Water Treatment Plant Relocation Project</p> <p>Aquatics</p> <p>River fish, macroinvertebrate and macrophyte surveys</p>			Drawn	GN								
	<table border="1"> <thead> <tr> <th>Rev</th> <th>Date</th> <th>Drawn</th> <th>Description</th> <th>Ch'k'd</th> <th>App'd</th> </tr> </thead> <tbody> <tr> <td>P1</td> <td>17/11/22</td> <td>GN</td> <td>First Draft</td> <td>DR</td> <td>CS</td> </tr> </tbody> </table>		Rev	Date	Drawn	Description	Ch'k'd	App'd	P1	17/11/22	GN	First Draft	DR	CS	<p>Drawing Number</p> <p>Figure 8.12</p>			Checked
Rev	Date	Drawn	Description	Ch'k'd	App'd													
P1	17/11/22	GN	First Draft	DR	CS													
						<p>Approved</p> <p>CS</p>			<p>Scale at A3</p> <p>1:2,500</p>									
						Security	Status	Rev										
						STD	PRE	P1										



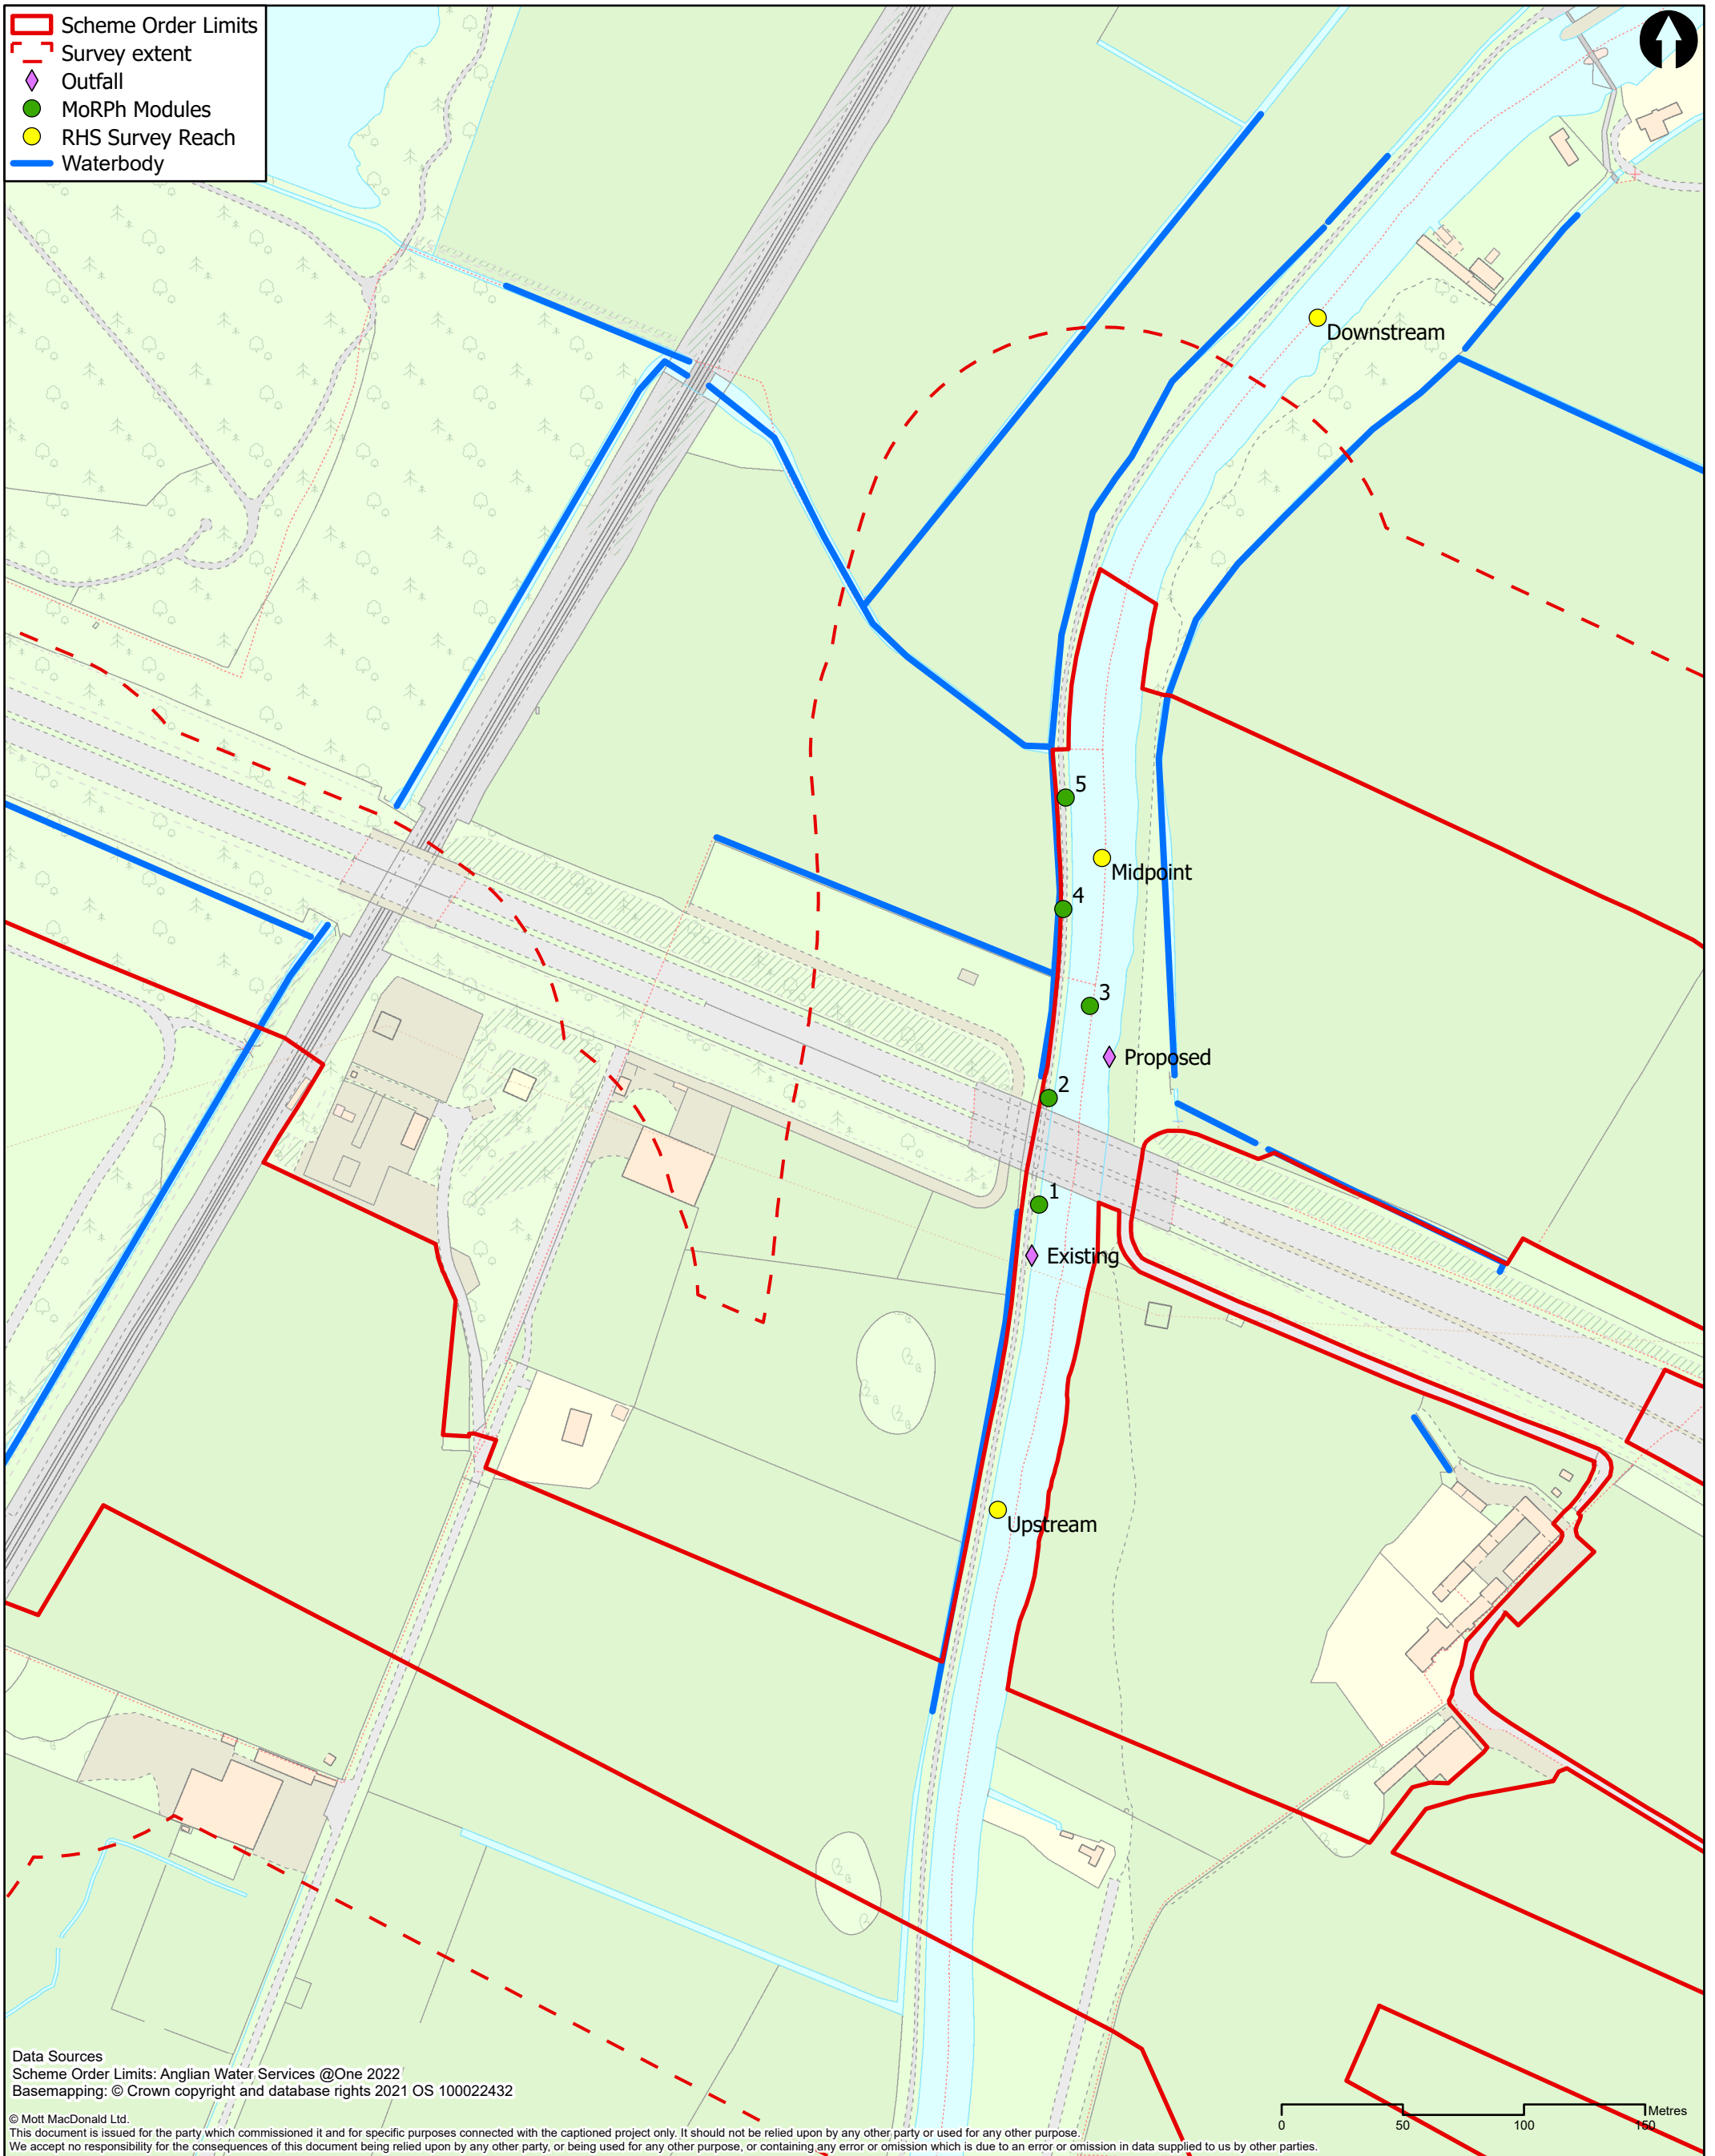

<p>22 Station Road Cambridge CB1 2JD United Kingdom</p> <p>T +44 (0)20 8774 2000 F +44 (0)20 8681 5706 W mottmac.com</p>	Client 					Title Cambridge Waste Water Treatment Plant Relocation Project Aquatics RHS and MoRPh Surveys	Drawn	GN												
	<table border="1"> <thead> <tr> <th>Rev</th> <th>Date</th> <th>Drawn</th> <th>Description</th> <th>Ch'k'd</th> <th>App'd</th> </tr> </thead> <tbody> <tr> <td>P1</td> <td>14/11/22</td> <td>GN</td> <td>First Draft</td> <td>DR</td> <td>CS</td> </tr> </tbody> </table>						Rev	Date	Drawn	Description	Ch'k'd	App'd	P1	14/11/22	GN	First Draft	DR	CS	Checked	DR
							Rev	Date	Drawn	Description	Ch'k'd	App'd								
P1	14/11/22	GN	First Draft	DR	CS															
Drawing Number Figure 8.13					Approved	CS														
					Scale at A3 1:2,500		Security	Status	Rev											
						STD	PRE	P1												



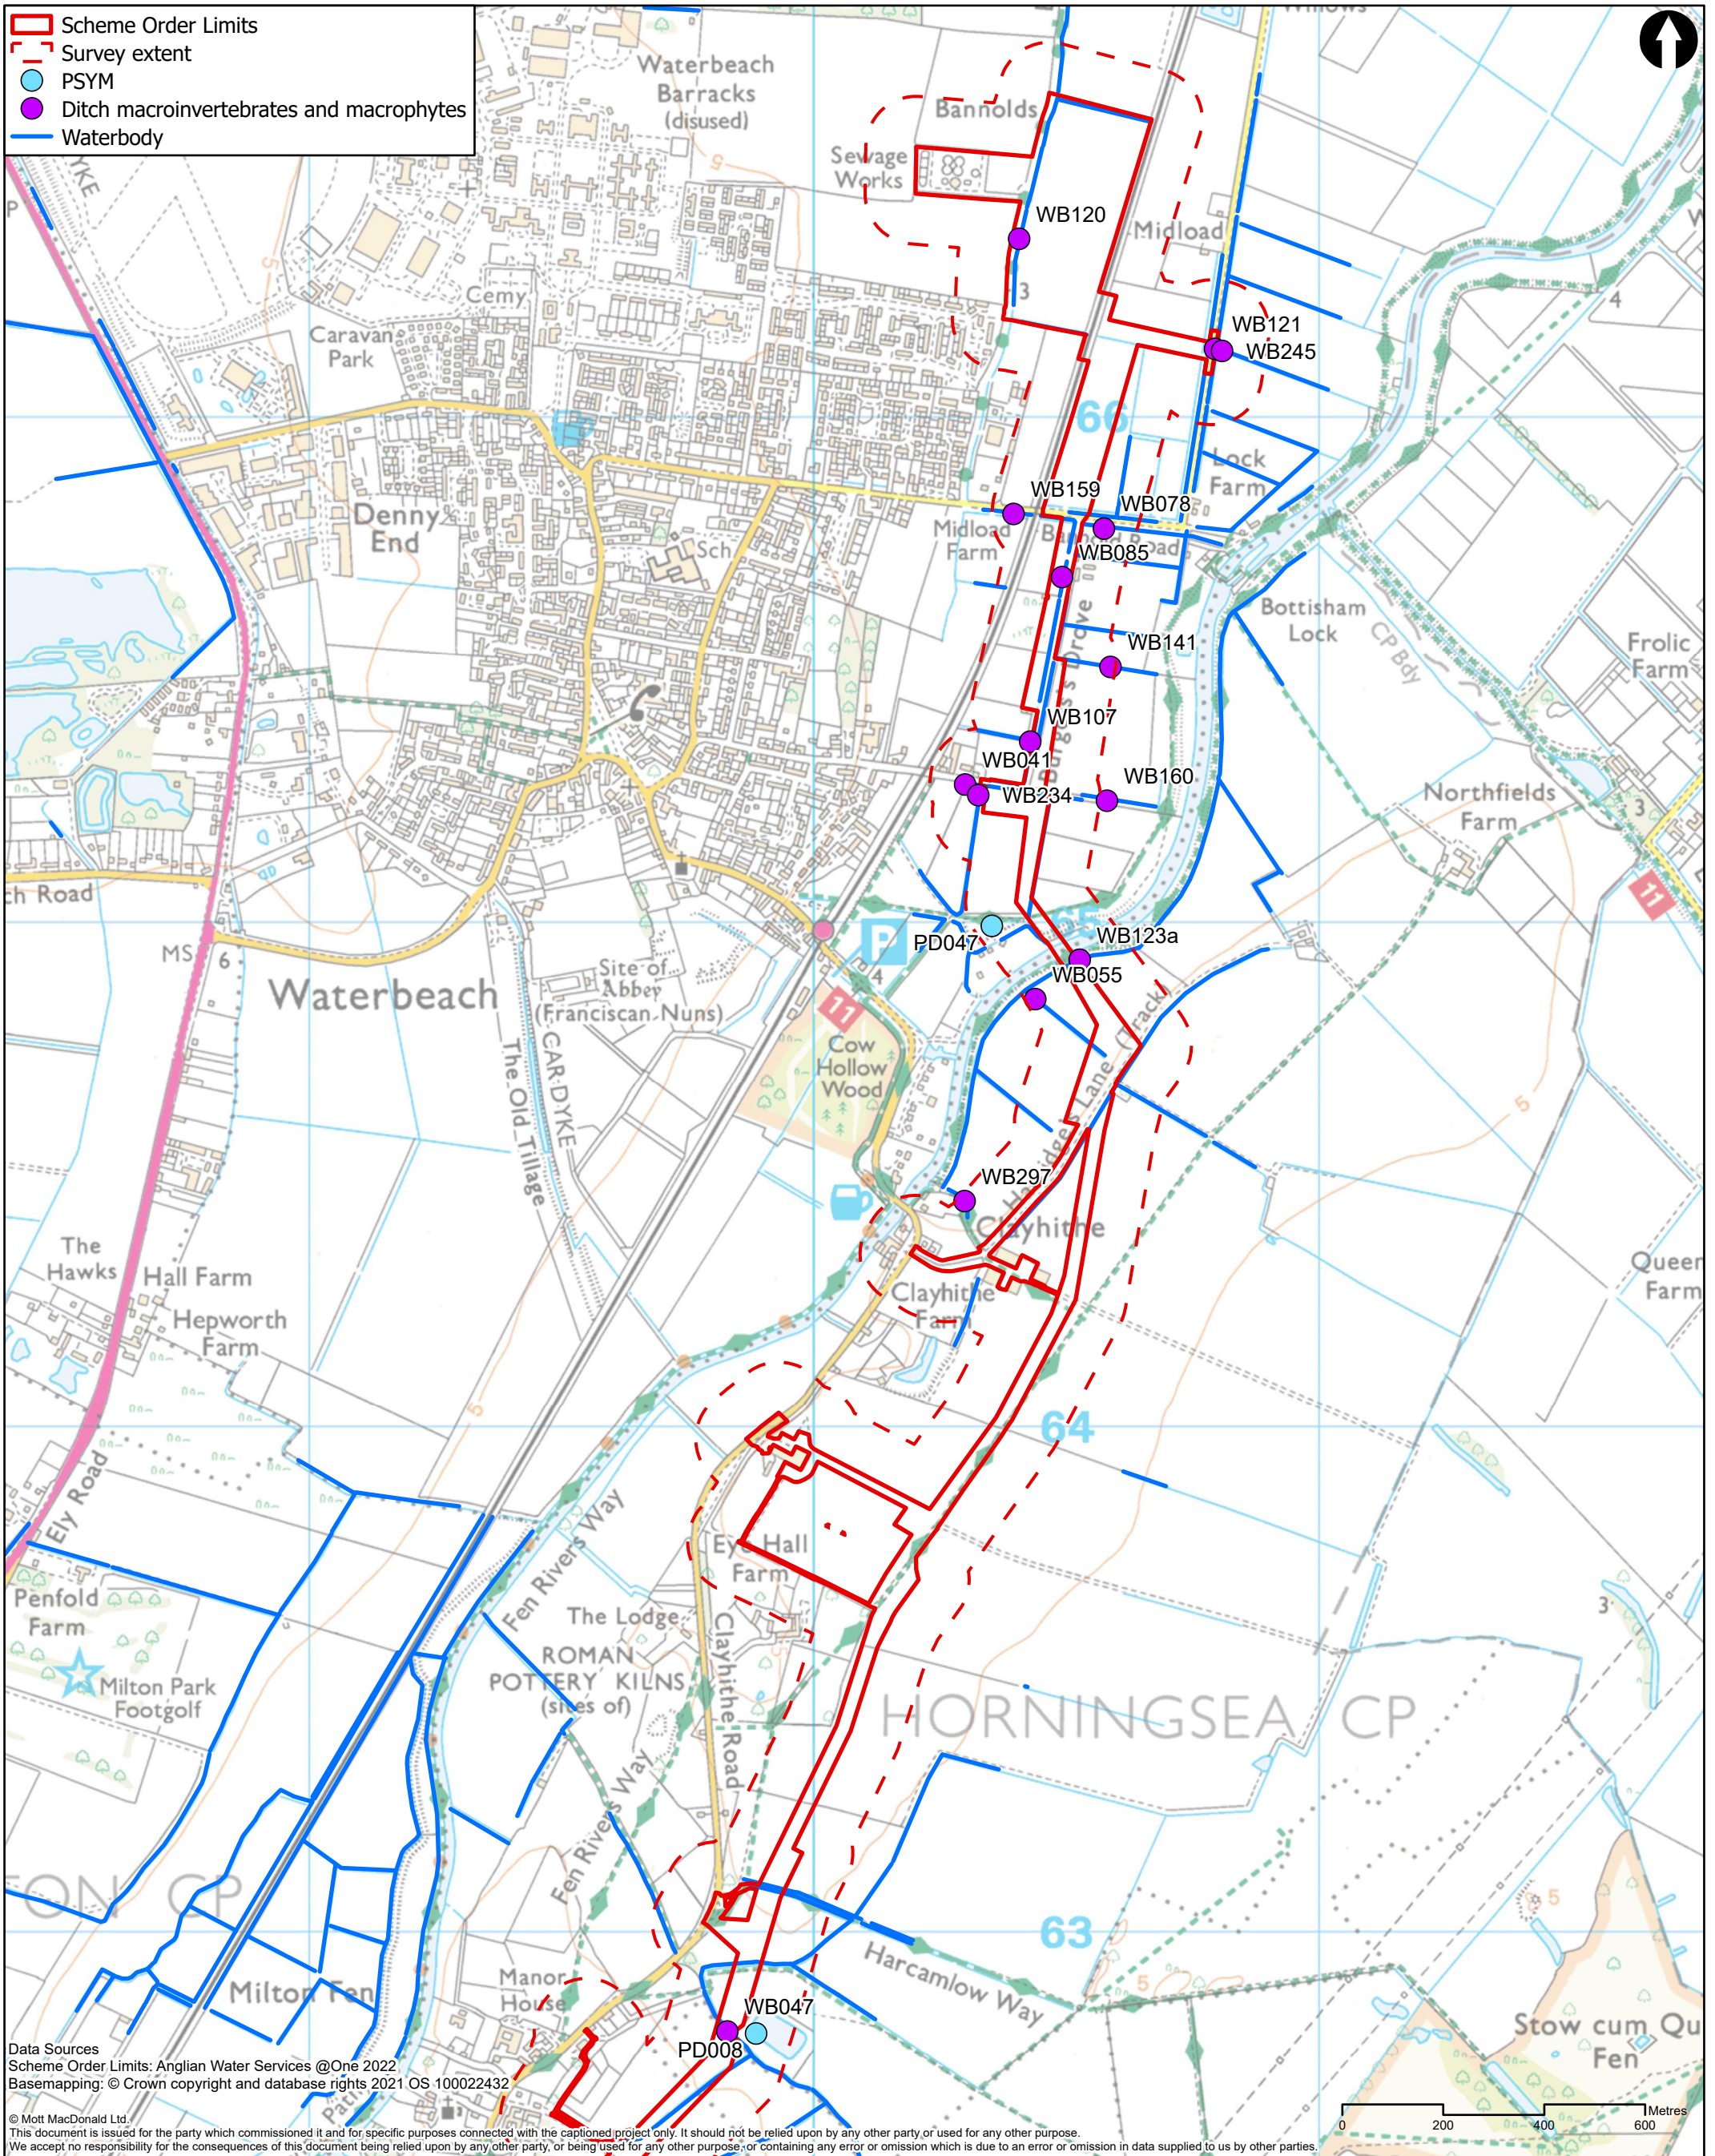


Data Sources  
 Scheme Order Limits: Anglian Water Services @One 2022  
 Basemapping: © Crown copyright and database rights 2021 OS 100022432

© Mott MacDonald Ltd.  
 This document is issued for the party which commissioned it and for specific purposes connected with the captioned project only. It should not be relied upon by any other party or used for any other purpose.  
 We accept no responsibility for the consequences of this document being relied upon by any other party, or being used for any other purpose, or containing any error or omission which is due to an error or omission in data supplied to us by other parties.

	22 Station Road Cambridge CB1 2JD United Kingdom					Title Cambridge Waste Water Treatment Plant Relocation Project Aquatics Ditch and pond macroinvertebrate and macrophyte surveys in the vicinity of the Waterbeach Pipeline		Drawn GN											
	T +44 (0)20 8774 2000 F +44 (0)20 8681 5706 W mottmac.com		<table border="1"> <thead> <tr> <th>Rev</th> <th>Date</th> <th>Drawn</th> <th>Description</th> <th>Ch'k'd</th> <th>App'd</th> </tr> </thead> <tbody> <tr> <td>P1</td> <td>17/11/22</td> <td>GN</td> <td>First Draft</td> <td>DR</td> <td>CS</td> </tr> </tbody> </table>			Rev	Date	Drawn	Description	Ch'k'd	App'd	P1	17/11/22	GN	First Draft	DR	CS	Checked DR	
	Rev	Date	Drawn	Description	Ch'k'd	App'd													
P1	17/11/22	GN	First Draft	DR	CS														
		Drawing Number Figure 8.14			Approved CS		Scale at A3 1:12,000												
					Security STD	Status PRE	Rev P1												




- ▭ Scheme Order Limits
- - - Survey extent
- PSYM
- Ditch macroinvertebrates and macrophytes
- Ditch macrophytes
- Ditch macroinvertebrates
- Waterbody

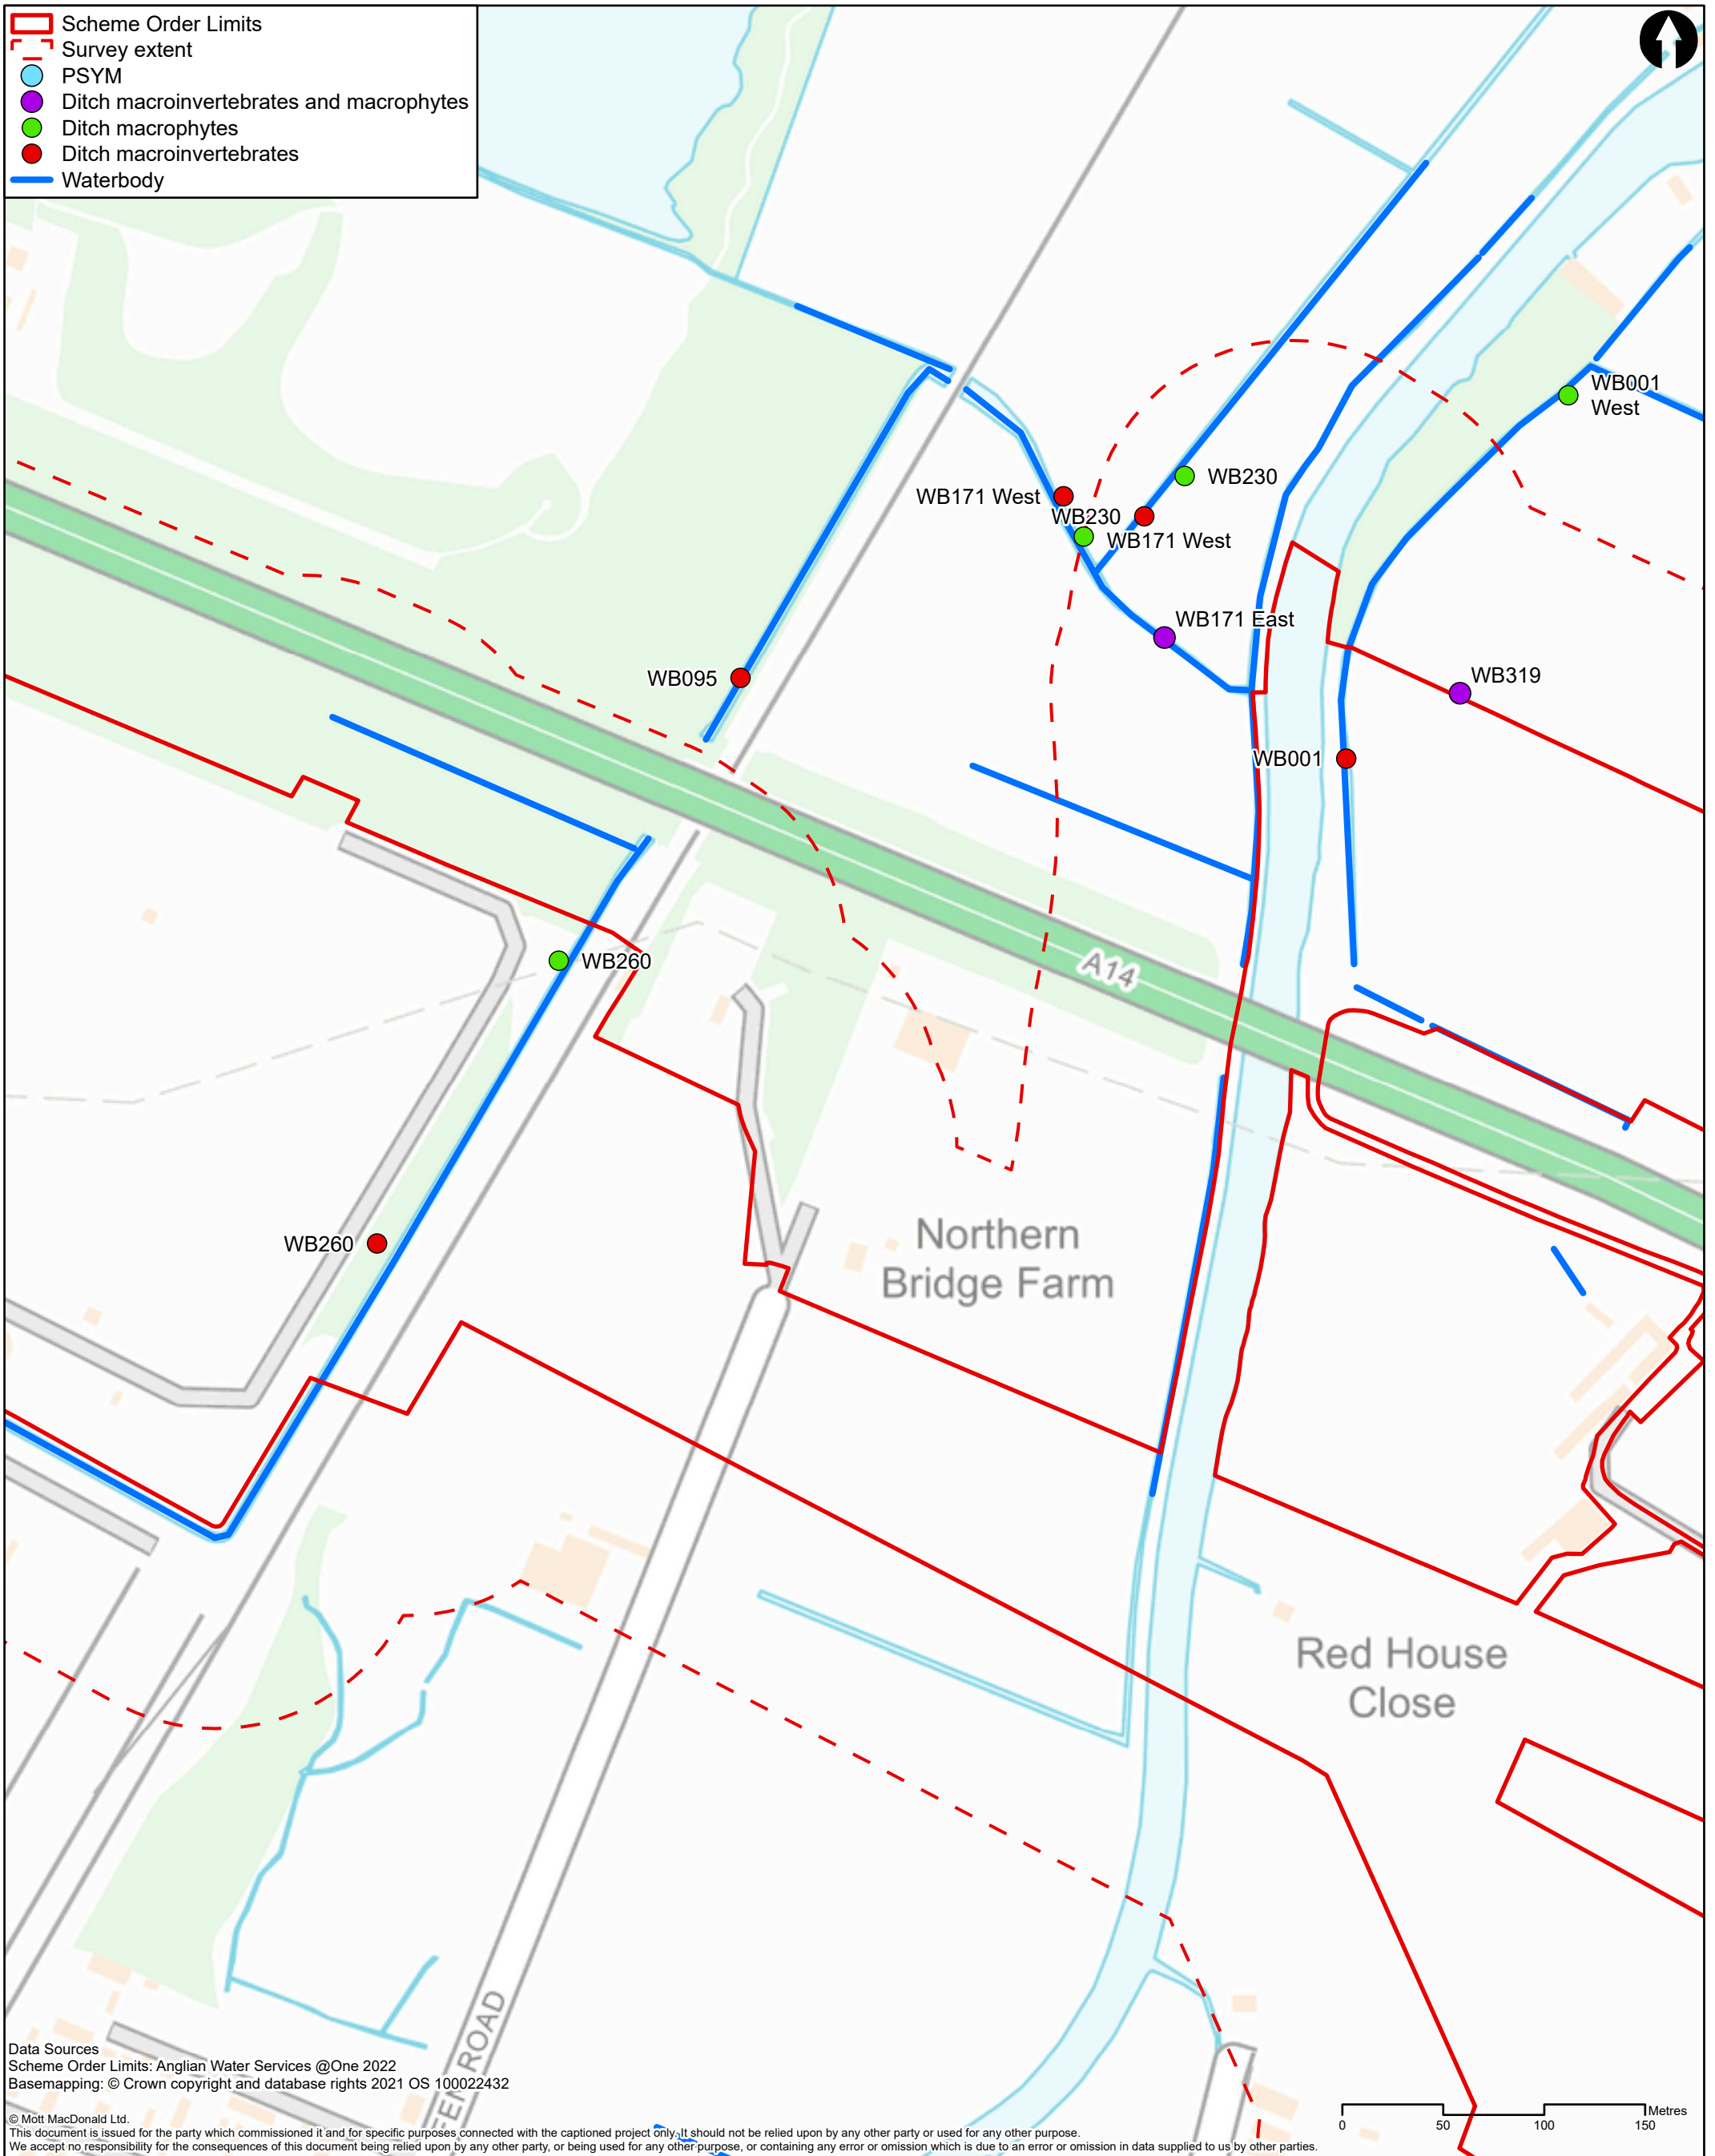


Data Sources  
 Scheme Order Limits: Anglian Water Services @One 2022  
 Basemapping: © Crown copyright and database rights 2021 OS 100022432

© Mott MacDonald Ltd.  
 This document is issued for the party which commissioned it and for specific purposes connected with the captioned project only. It should not be relied upon by any other party or used for any other purpose.  
 We accept no responsibility for the consequences of this document being relied upon by any other party, or being used for any other purpose, or containing any error or omission which is due to an error or omission in data supplied to us by other parties.



	Client 		Title Cambridge Waste Water Treatment Plant Relocation Project Aquatics Ditch macroinvertebrate and macrophyte surveys in the vicinity of the proposed WWTP			Drawn GN	Checked DR	Approved CS												
	22 Station Road Cambridge CB1 2JD United Kingdom  T +44 (0)20 8774 2000 F +44 (0)20 8681 5706 W mottmac.com		<table border="1" style="width: 100%; border-collapse: collapse;"> <thead> <tr> <th>Rev</th> <th>Date</th> <th>Drawn</th> <th>Description</th> <th>Ch'k'd</th> <th>App'd</th> </tr> </thead> <tbody> <tr> <td>P1</td> <td>17/11/22</td> <td>GN</td> <td>First Draft</td> <td>DR</td> <td>CS</td> </tr> </tbody> </table>			Rev	Date	Drawn	Description	Ch'k'd	App'd	P1	17/11/22	GN	First Draft	DR	CS	Scale at A3 1:3,000		
	Rev	Date	Drawn	Description	Ch'k'd	App'd														
P1	17/11/22	GN	First Draft	DR	CS															
			Drawing Number Figure 8.15			Security STD	Status PRE	Rev P1												




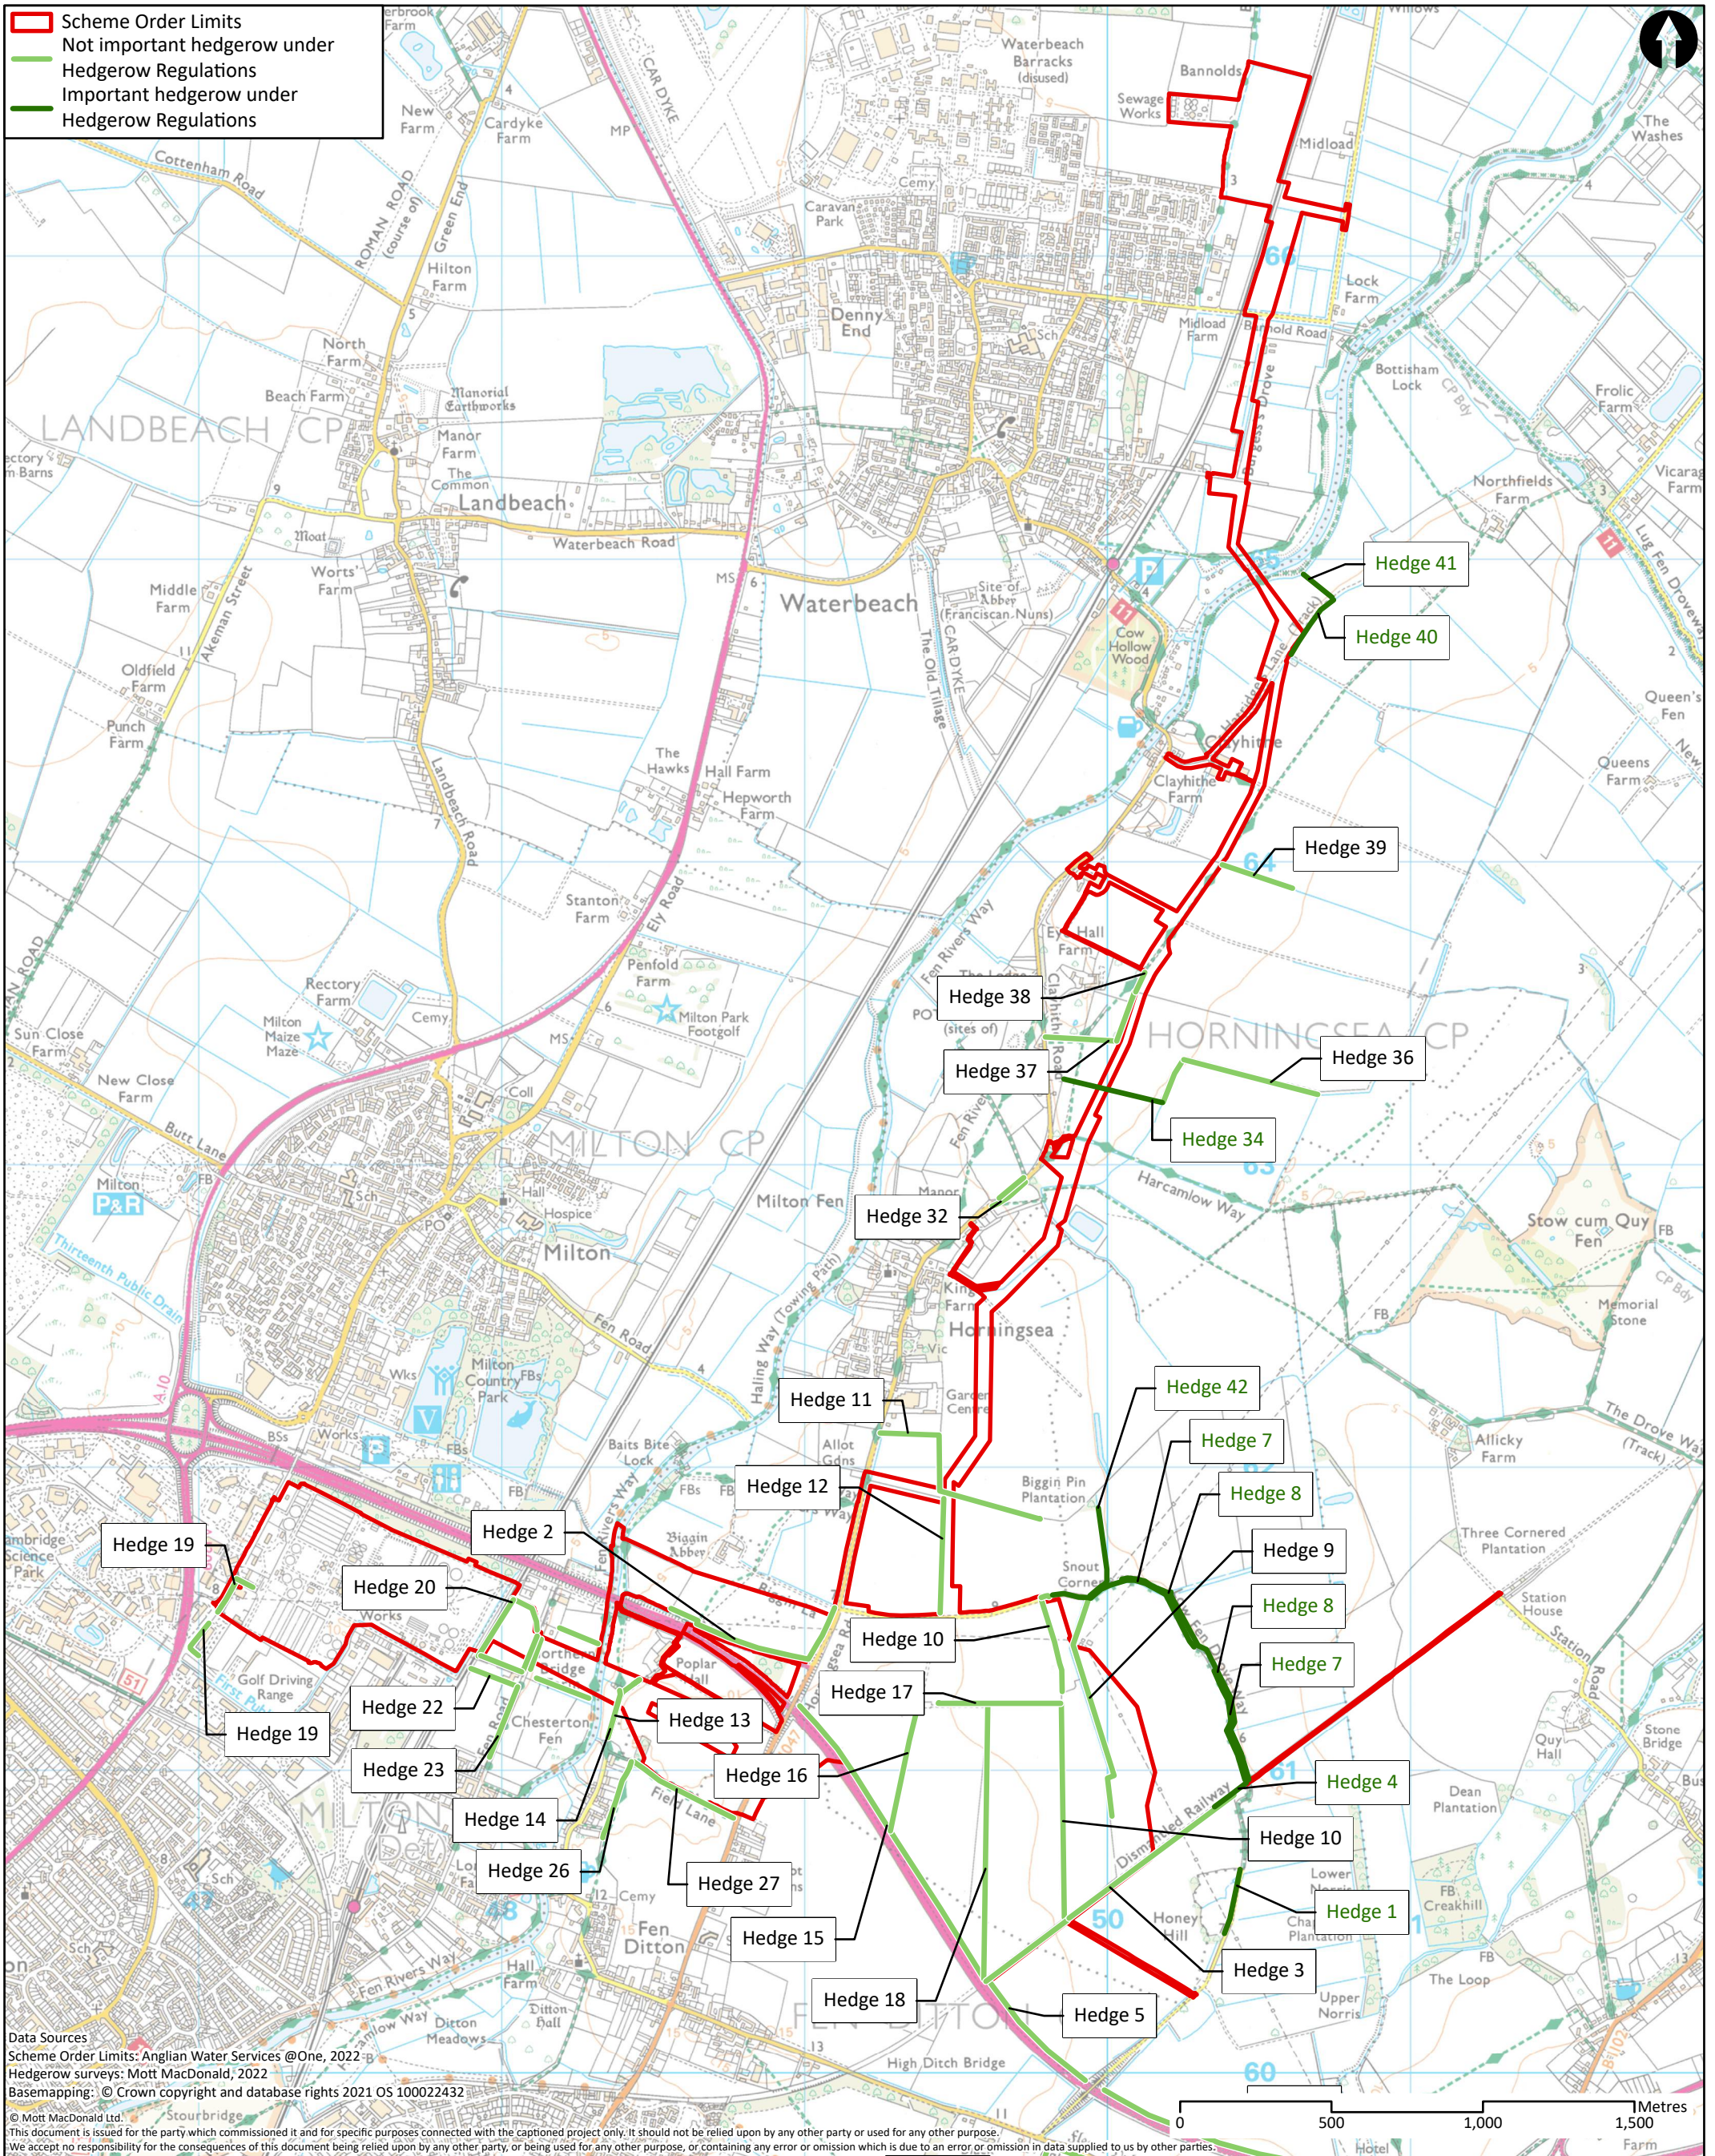

Data Sources  
 Scheme Order Limits: Anglian Water Services @One, 2022  
 Hedgerow surveys: Mott MacDonald, 2022  
 Basemapping: © Crown copyright and database rights 2021 OS 100022432  
 © Mott MacDonald Ltd.  
 This document is issued for the party which commissioned it and for specific purposes connected with the captioned project only. It should not be relied upon by any other party or used for any other purpose.  
 We accept no responsibility for the consequences of this document being relied upon by any other party, or being used for any other purpose, or containing any error or omission which is due to an error or omission in data supplied to us by other parties.

	Client 		Title Cambridge Waste Water Treatment Plant Relocation Project Hedgerows Hedgerow survey			Drawn KL																		
	22 Station Road Cambridge CB1 2JD United Kingdom  T +44 (0)20 8774 2000 F +44 (0)20 8681 5706 W mottmac.com		Drawing Number Figure 8.16			Checked AW  Approved CS  Scale at A3 1:20,000																		
<table border="1"> <thead> <tr> <th>Rev</th> <th>Date</th> <th>Drawn</th> <th>Description</th> <th>Ch'k'd</th> <th>App'd</th> </tr> </thead> <tbody> <tr> <td>P1</td> <td>11/11/22</td> <td>KL</td> <td>First Draft</td> <td>AW</td> <td>CS</td> </tr> </tbody> </table>	Rev	Date	Drawn	Description	Ch'k'd	App'd	P1	11/11/22	KL	First Draft	AW	CS						<table border="1"> <thead> <tr> <th>Security</th> <th>Status</th> <th>Rev</th> </tr> </thead> <tbody> <tr> <td>STD</td> <td>PRE</td> <td>P1</td> </tr> </tbody> </table>	Security	Status	Rev	STD	PRE	P1
Rev	Date	Drawn	Description	Ch'k'd	App'd																			
P1	11/11/22	KL	First Draft	AW	CS																			
Security	Status	Rev																						
STD	PRE	P1																						



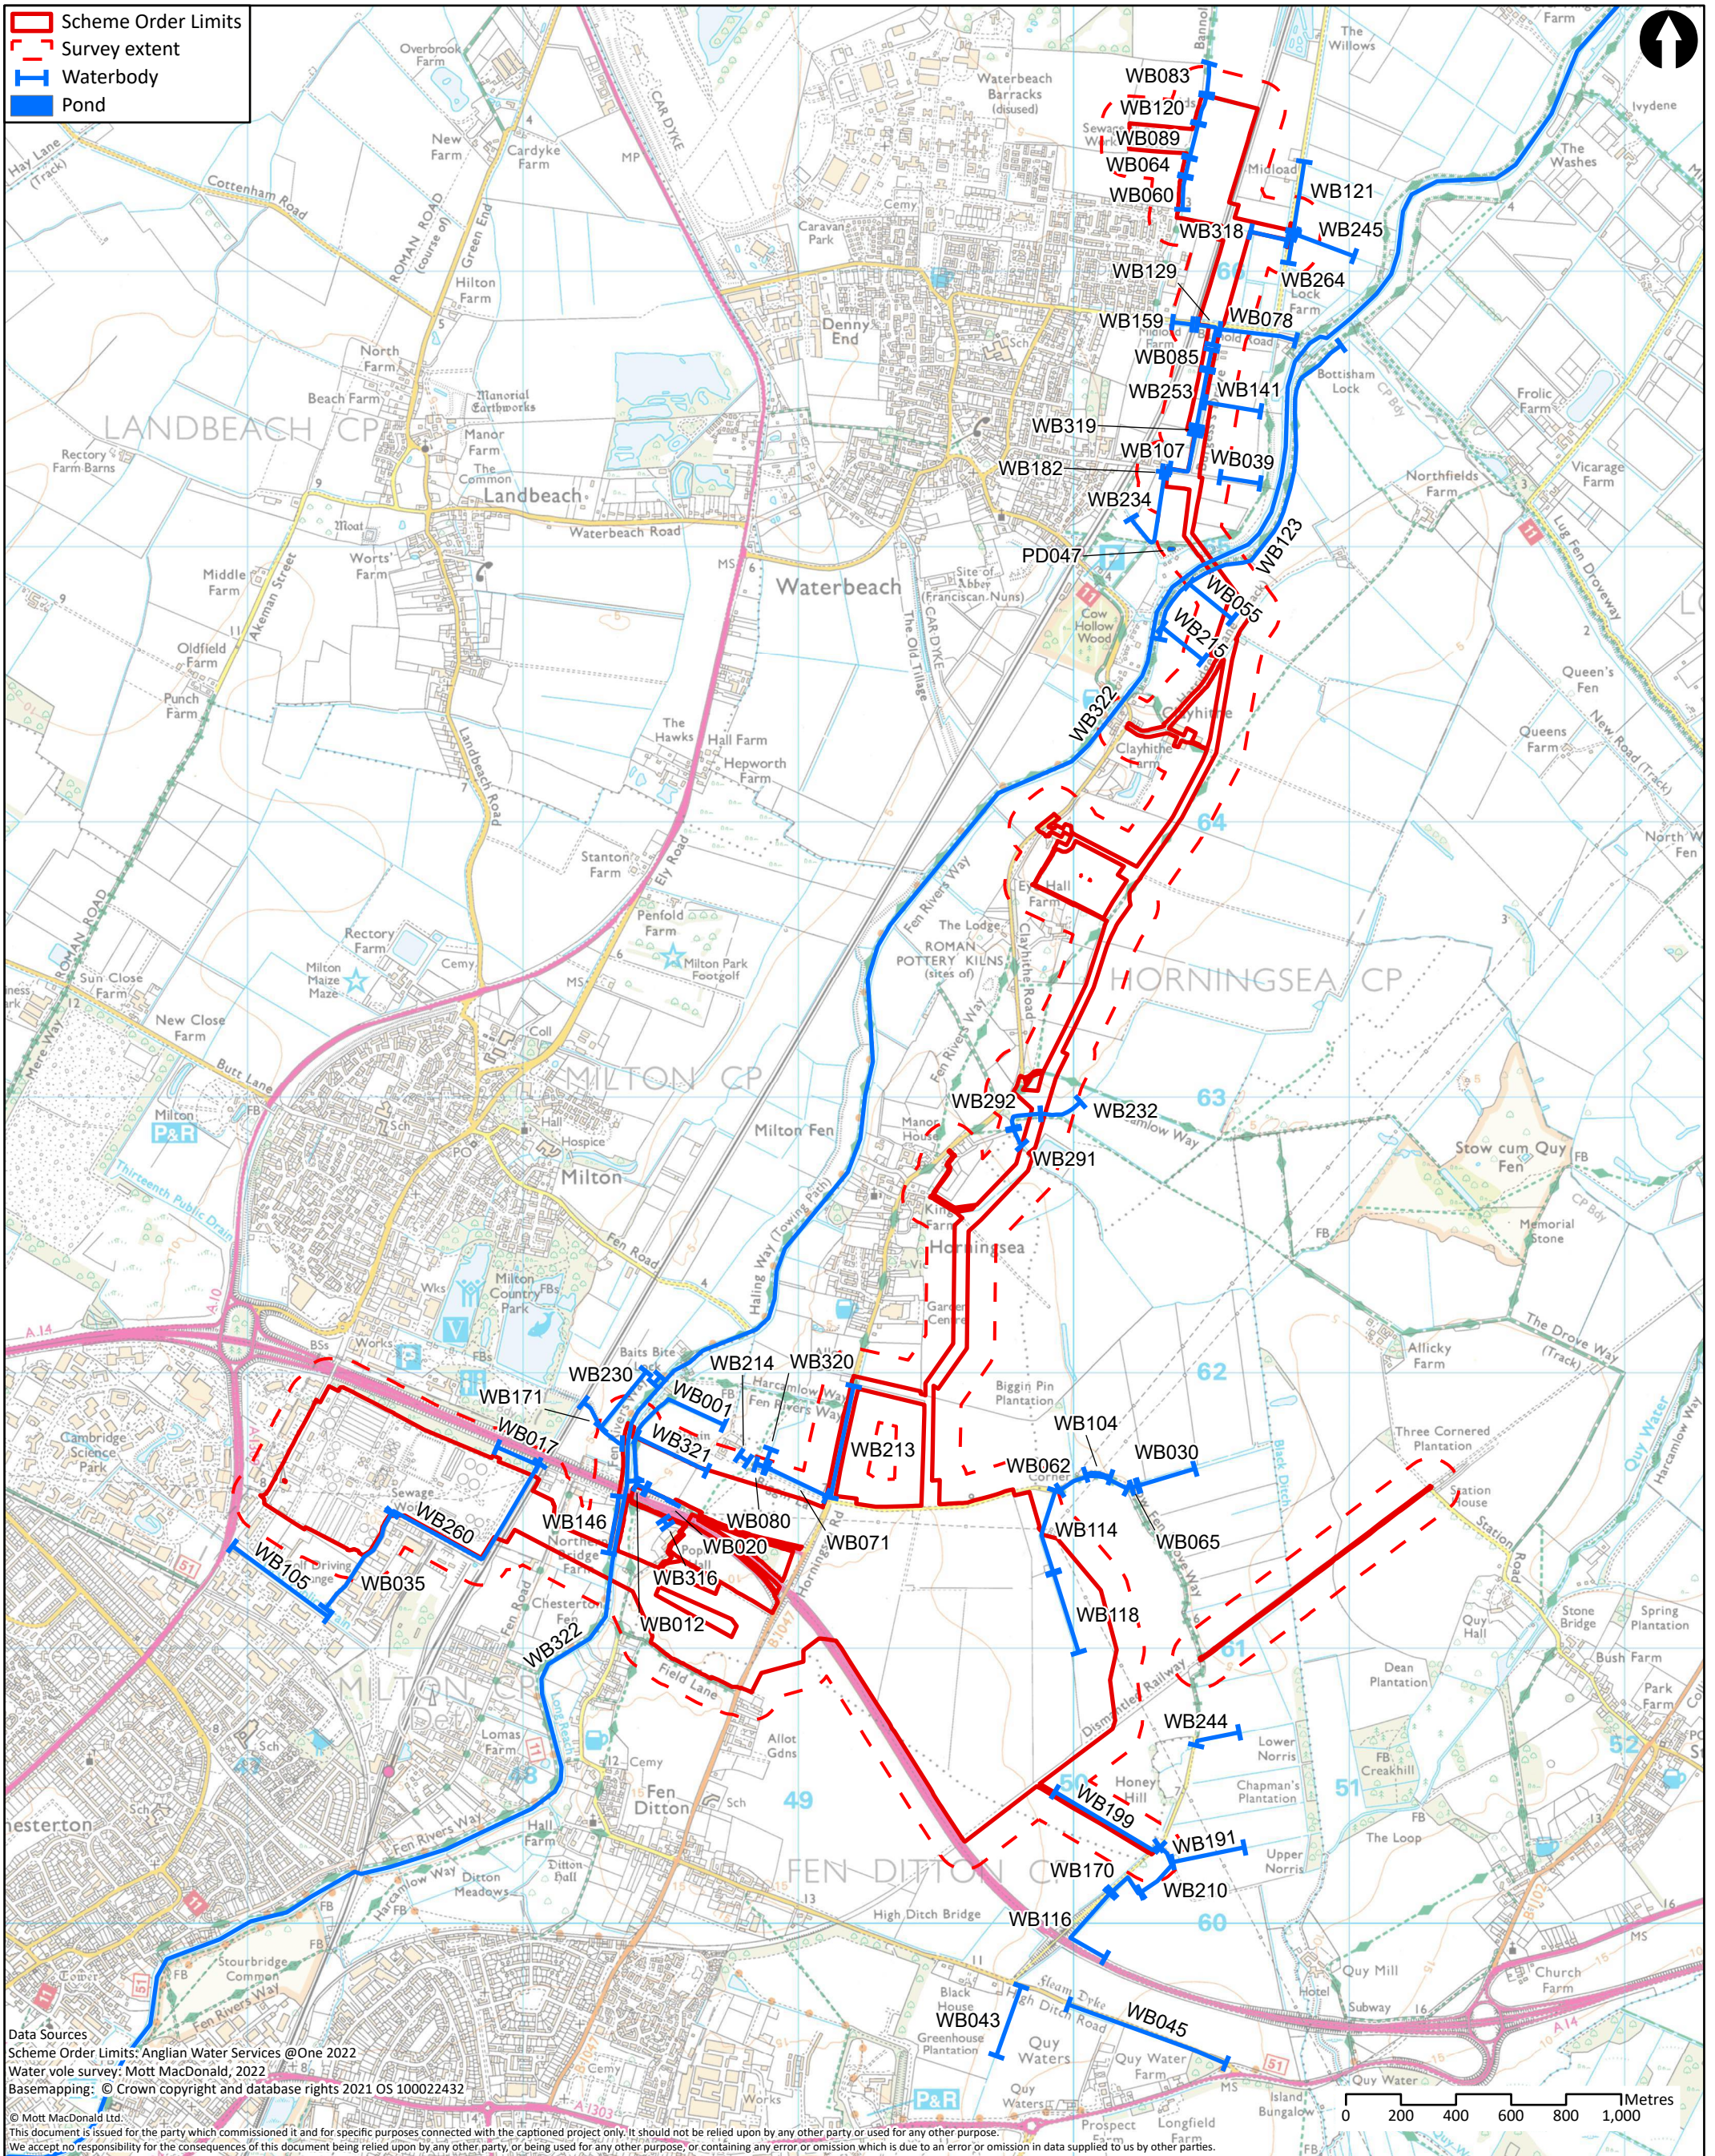

Data Sources  
 Scheme Order Limits: Anglian Water Services @One 2022  
 Water vole survey: Mott MacDonald, 2022  
 Basemapping: © Crown copyright and database rights 2021 OS 100022432  
 © Mott MacDonald Ltd.  
 This document is issued for the party which commissioned it and for specific purposes connected with the captioned project only. It should not be relied upon by any other party, or used for any other purpose.  
 We accept no responsibility for the consequences of this document being relied upon by any other party, or being used for any other purpose, or containing any error or omission which is due to an error or omission in data supplied to us by other parties.

**M**  
**M**  
**MOTT**  
**MACDONALD**

22 Station Road  
 Cambridge CB1 2JD  
 United Kingdom

T +44 (0)20 8774 2000  
 F +44 (0)20 8681 5706  
 W mottmac.com


Client					
Rev	Date	Drawn	Description	Ch'k'd	App'd
P1	25/10/22	KL	First Draft	AW	CS

Title  
 Cambridge Waste Water Treatment Plant  
 Relocation Project  
 Water voles  
 Scoped in waterbodies

Drawing Number  
 Figure 8.17

Drawn	KL	
Checked	AW	
Approved	CS	
Scale at A3	1:22,000	
Security	Status	Rev
STD	PRE	P1




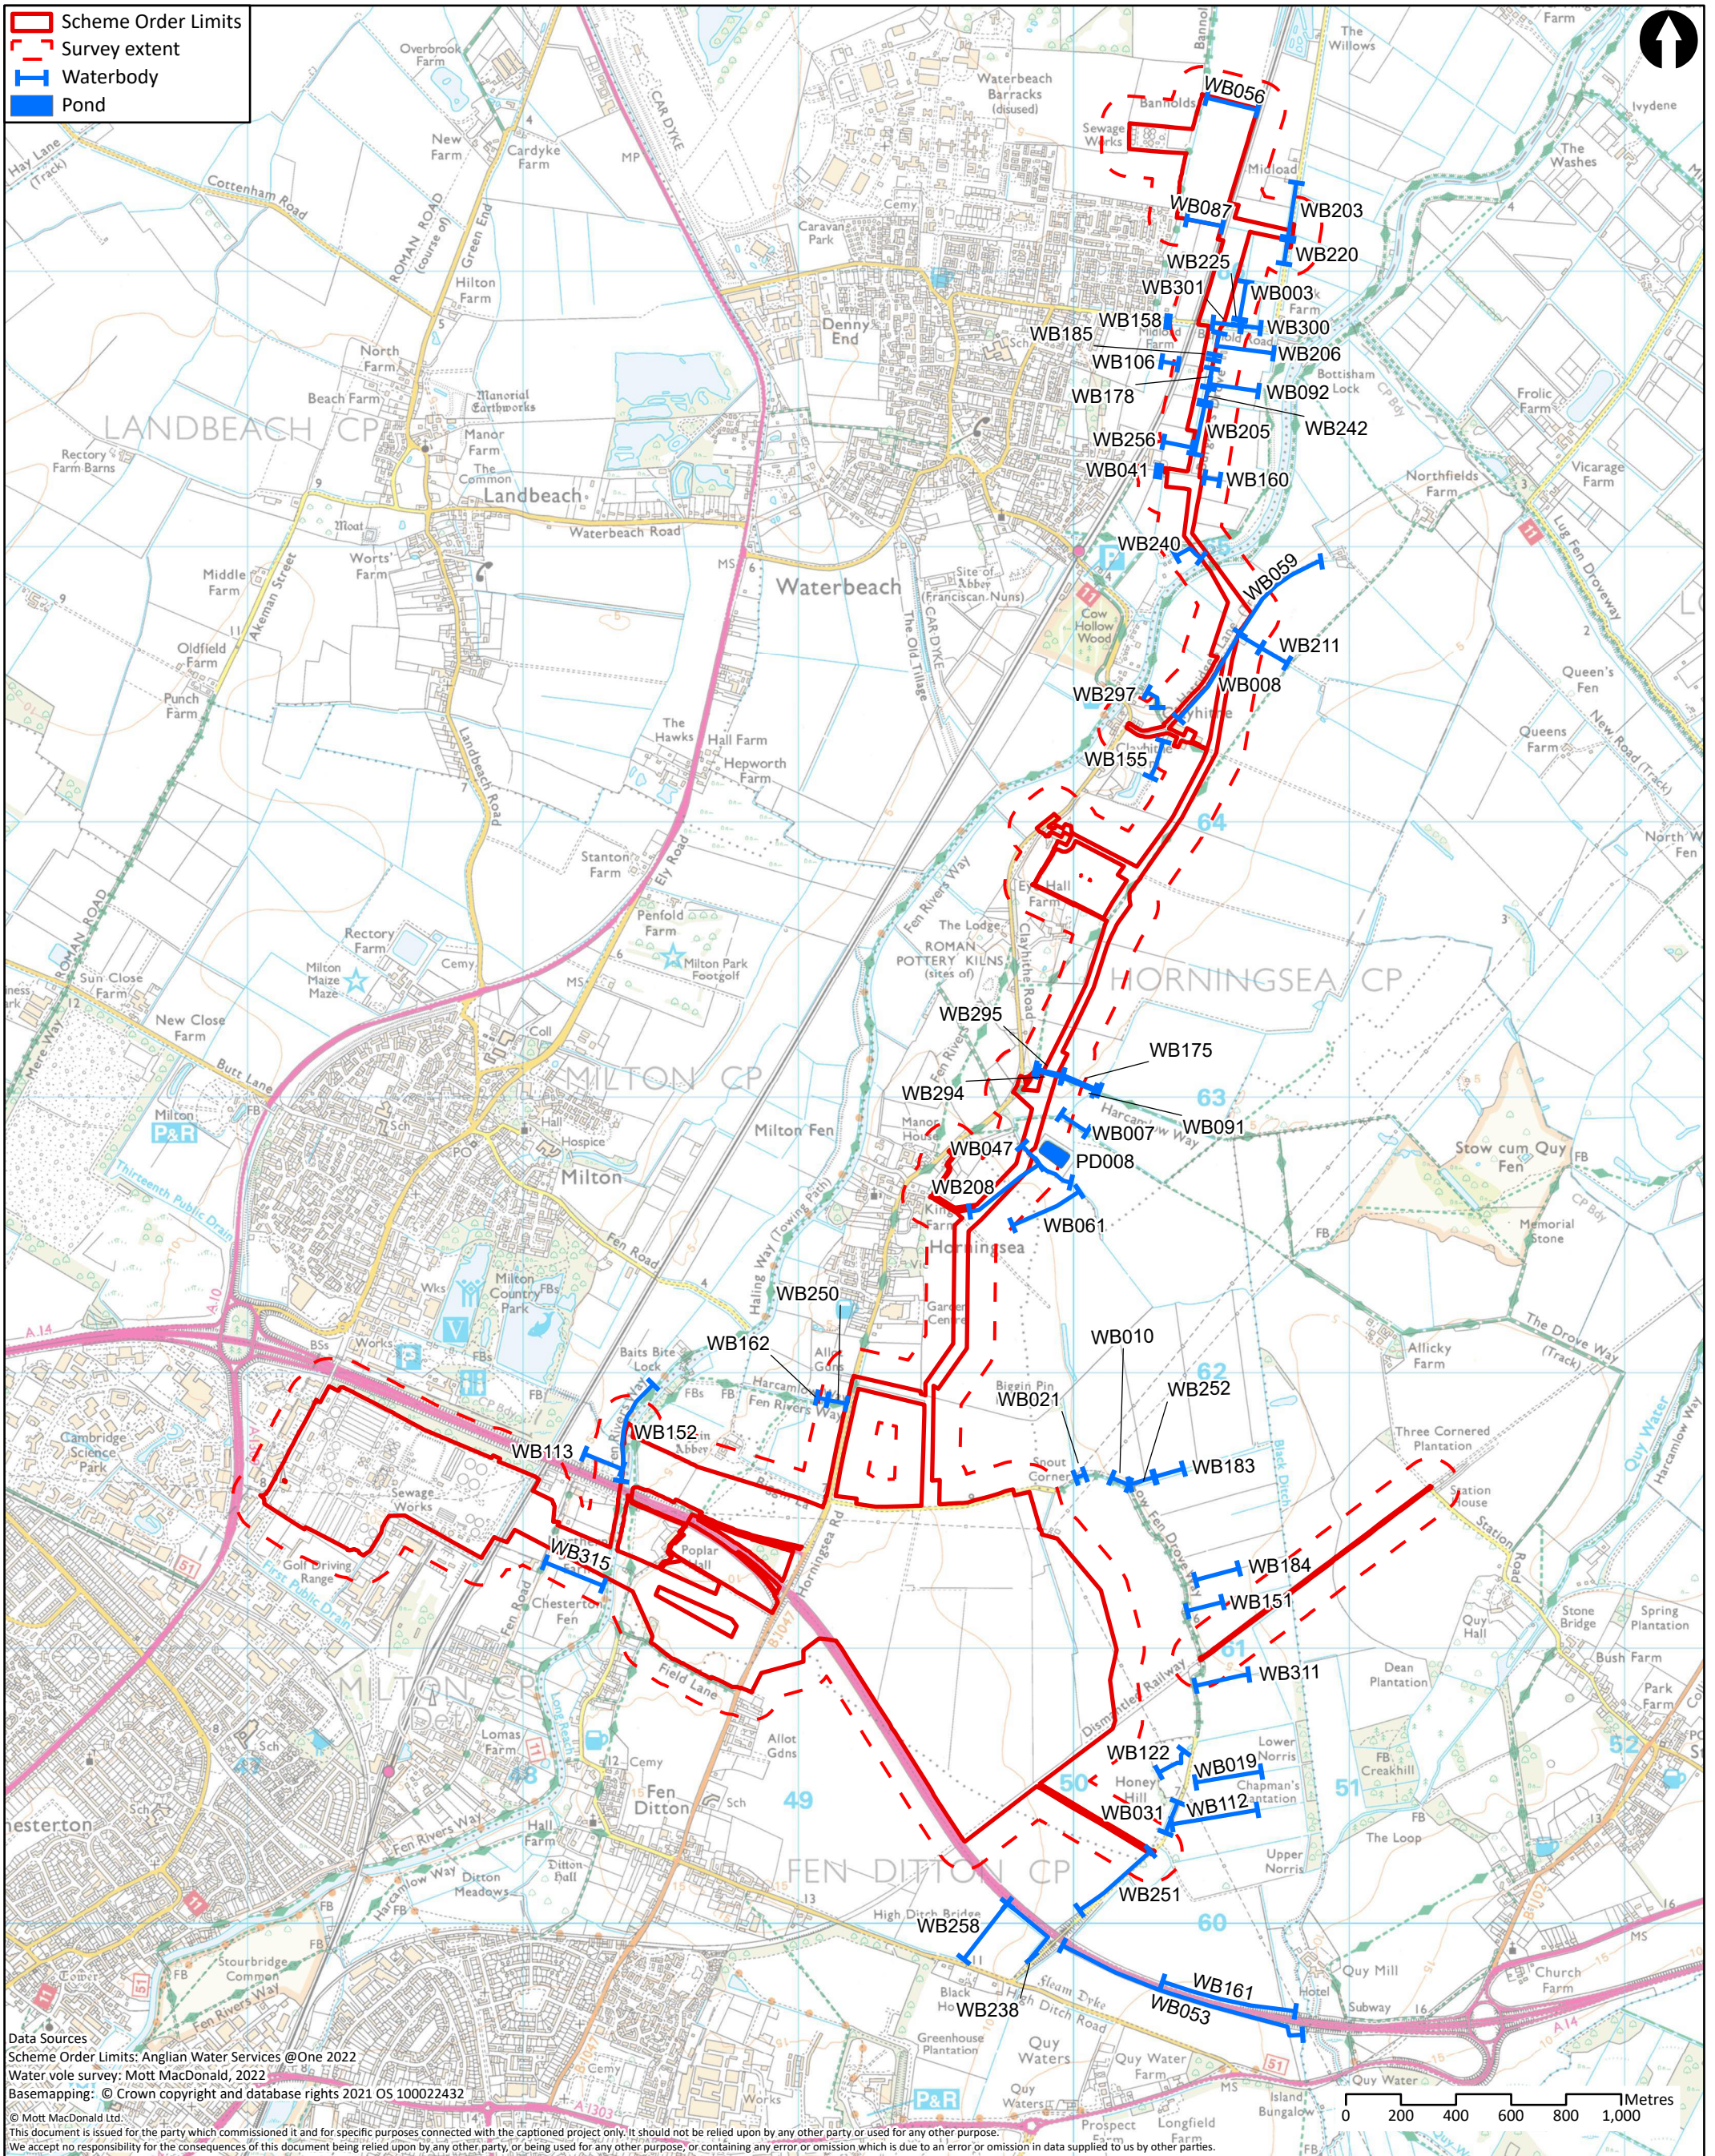

Data Sources  
 Scheme Order Limits: Anglian Water Services @One 2022  
 Water vole survey: Mott MacDonald, 2022  
 Basemapping: © Crown copyright and database rights 2021 OS 100022432  
 © Mott MacDonald Ltd.  
 This document is issued for the party which commissioned it and for specific purposes connected with the captioned project only. It should not be relied upon by any other party, or used for any other purpose.  
 We accept no responsibility for the consequences of this document being relied upon by any other party, or being used for any other purpose, or containing any error or omission which is due to an error or omission in data supplied to us by other parties.

<p>22 Station Road Cambridge CB1 2JD United Kingdom</p> <p>T +44 (0)20 8774 2000 F +44 (0)20 8681 5706 W mottmac.com</p>	Client								Title			Drawn	KL								
	<table border="1"> <thead> <tr> <th>Rev</th> <th>Date</th> <th>Drawn</th> <th>Description</th> <th>Ch'k'd</th> <th>App'd</th> </tr> </thead> <tbody> <tr> <td>P1</td> <td>25/10/22</td> <td>KL</td> <td>First Draft</td> <td>AW</td> <td>CS</td> </tr> </tbody> </table>					Rev	Date	Drawn	Description	Ch'k'd	App'd	P1	25/10/22	KL	First Draft	AW	CS	Cambridge Waste Water Treatment Plant Relocation Project			Checked
Rev	Date	Drawn	Description	Ch'k'd	App'd																
P1	25/10/22	KL	First Draft	AW	CS																
					Water voles			Approved	CS												
					Scoped out waterbodies			Scale at A3	1:22,000												
					Drawing Number			Security	Status	Rev											
					Figure 8.18			STD	PRE	P1											




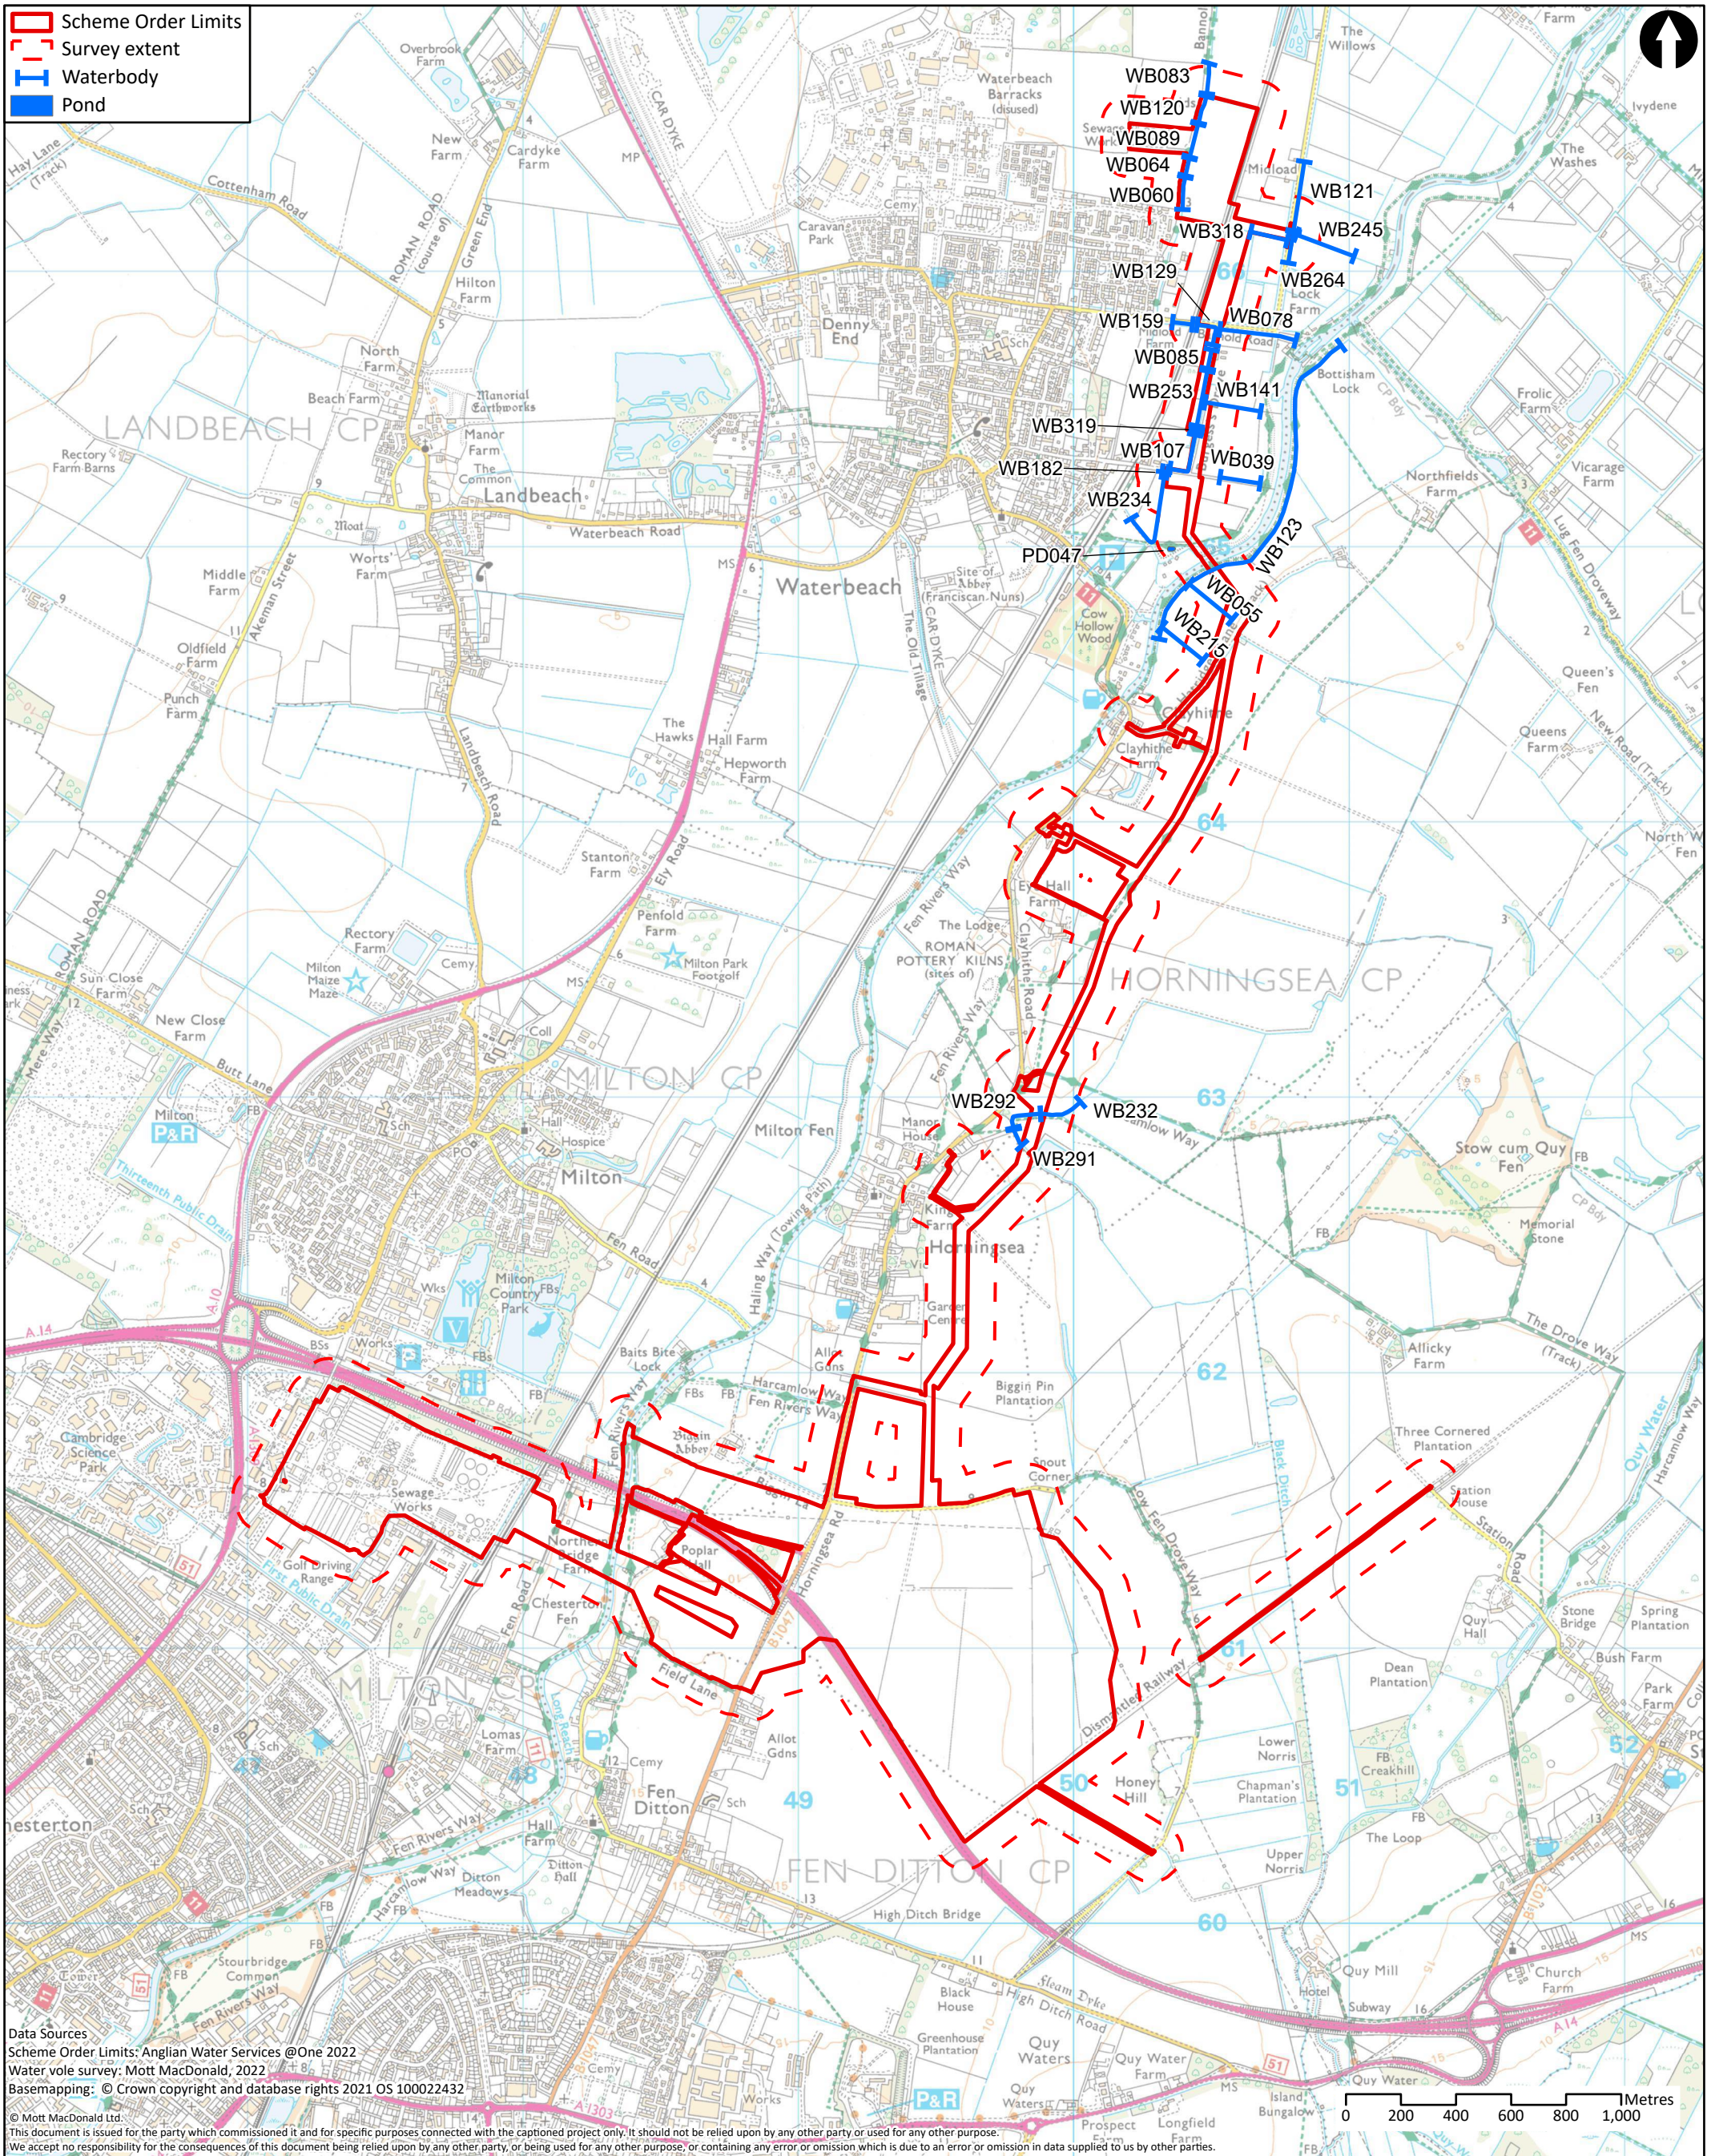

Data Sources  
 Scheme Order Limits: Anglian Water Services @One 2022  
 Water vole survey: Mott MacDonald, 2022  
 Basemapping: © Crown copyright and database rights 2021 OS 100022432  
 © Mott MacDonald Ltd.  
 This document is issued for the party which commissioned it and for specific purposes connected with the captioned project only. It should not be relied upon by any other party, or used for any other purpose.  
 We accept no responsibility for the consequences of this document being relied upon by any other party, or being used for any other purpose, or containing any error or omission which is due to an error or omission in data supplied to us by other parties.

<p><b>MOTT MACDONALD</b></p> <p>22 Station Road          Cambridge CB1 2JD          United Kingdom</p> <p>T +44 (0)20 8774 2000          F +44 (0)20 8681 5706          W mottmac.com</p>	Client					Title			Drawn	KL			
						Cambridge Waste Water Treatment Plant Relocation Project Water voles Waterbodies with installed rafts			Checked	AW			
									Approved	CS			
					Drawing Number			Scale at A3					
					Figure 8.19			1:22,000					
					Rev	Date	Drawn	Description	Ch'k'd	App'd	Security	Status	Rev
					P1	25/10/22	KL	First Draft	AW	CS	STD	PRE	P1



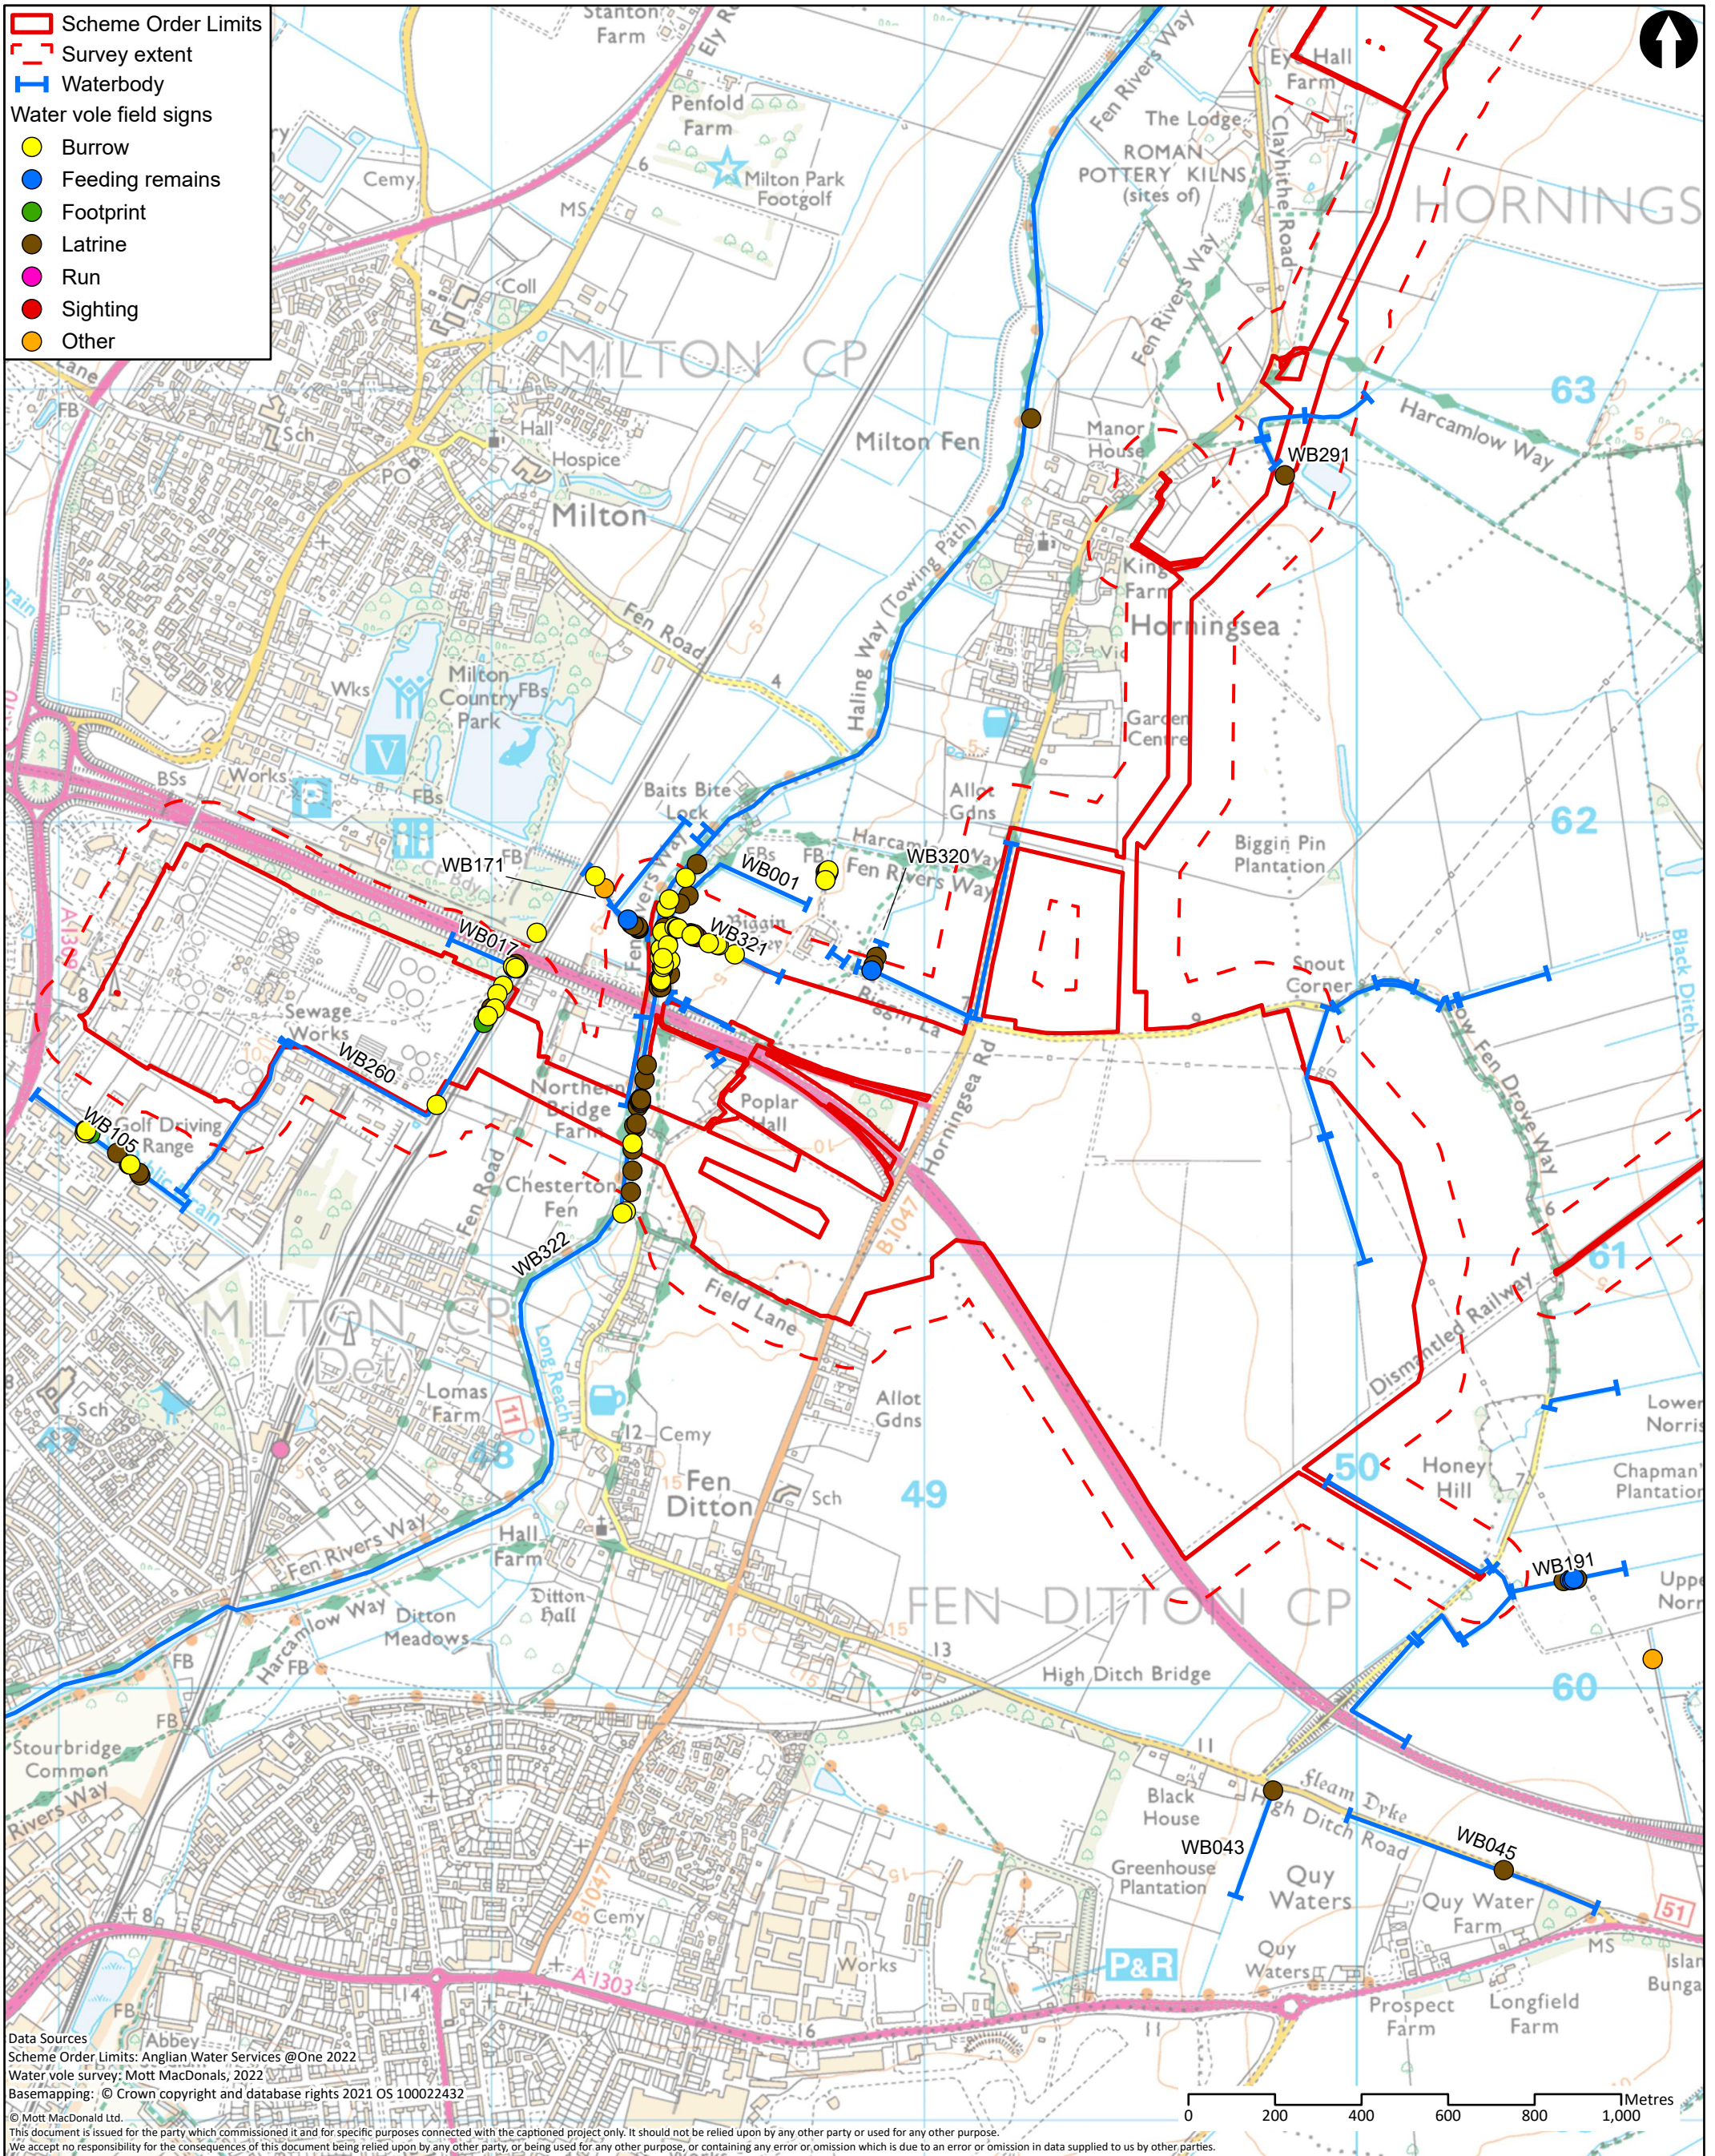


Data Sources  
 Scheme Order Limits: Anglian Water Services @One 2022  
 Water vole survey: Mott MacDonalds, 2022  
 Basemapping: © Crown copyright and database rights 2021 OS 100022432  
 © Mott MacDonald Ltd.  
 This document is issued for the party which commissioned it and for specific purposes connected with the captioned project only. It should not be relied upon by any other party or used for any other purpose.  
 We accept no responsibility for the consequences of this document being relied upon by any other party, or being used for any other purpose, or containing any error or omission which is due to an error or omission in data supplied to us by other parties.

<p>22 Station Road Cambridge CB1 2JD United Kingdom</p> <p>T +44 (0)20 8774 2000 F +44 (0)20 8681 5706 W mottmac.com</p>	<p>Client</p>					<p>Title</p> <p>Cambridge Waste Water Treatment Plant Relocation Project Water voles Field signs - Main site</p>		Drawn	KL							
	<table border="1"> <thead> <tr> <th>Rev</th> <th>Date</th> <th>Drawn</th> <th>Description</th> <th>Ch'k'd</th> <th>App'd</th> </tr> </thead> <tbody> <tr> <td>P1</td> <td>25/10/22</td> <td>KL</td> <td>First Draft</td> <td>AW</td> <td>CS</td> </tr> </tbody> </table>	Rev	Date	Drawn	Description	Ch'k'd	App'd	P1	25/10/22	KL	First Draft	AW	CS	<p>Drawing Number</p> <p>Figure 8.20</p>		Checked
Rev	Date	Drawn	Description	Ch'k'd	App'd											
P1	25/10/22	KL	First Draft	AW	CS											
				Approved	CS	Scale at A3		1:14,000								
						Security	Status	Rev								
						STD	PRE	P1								




- Scheme Order Limits
- Survey extent
- Waterbody
- Water vole field signs
- Burrow
- Feeding remains
- Footprint
- Latrine
- Run
- Sighting
- Other

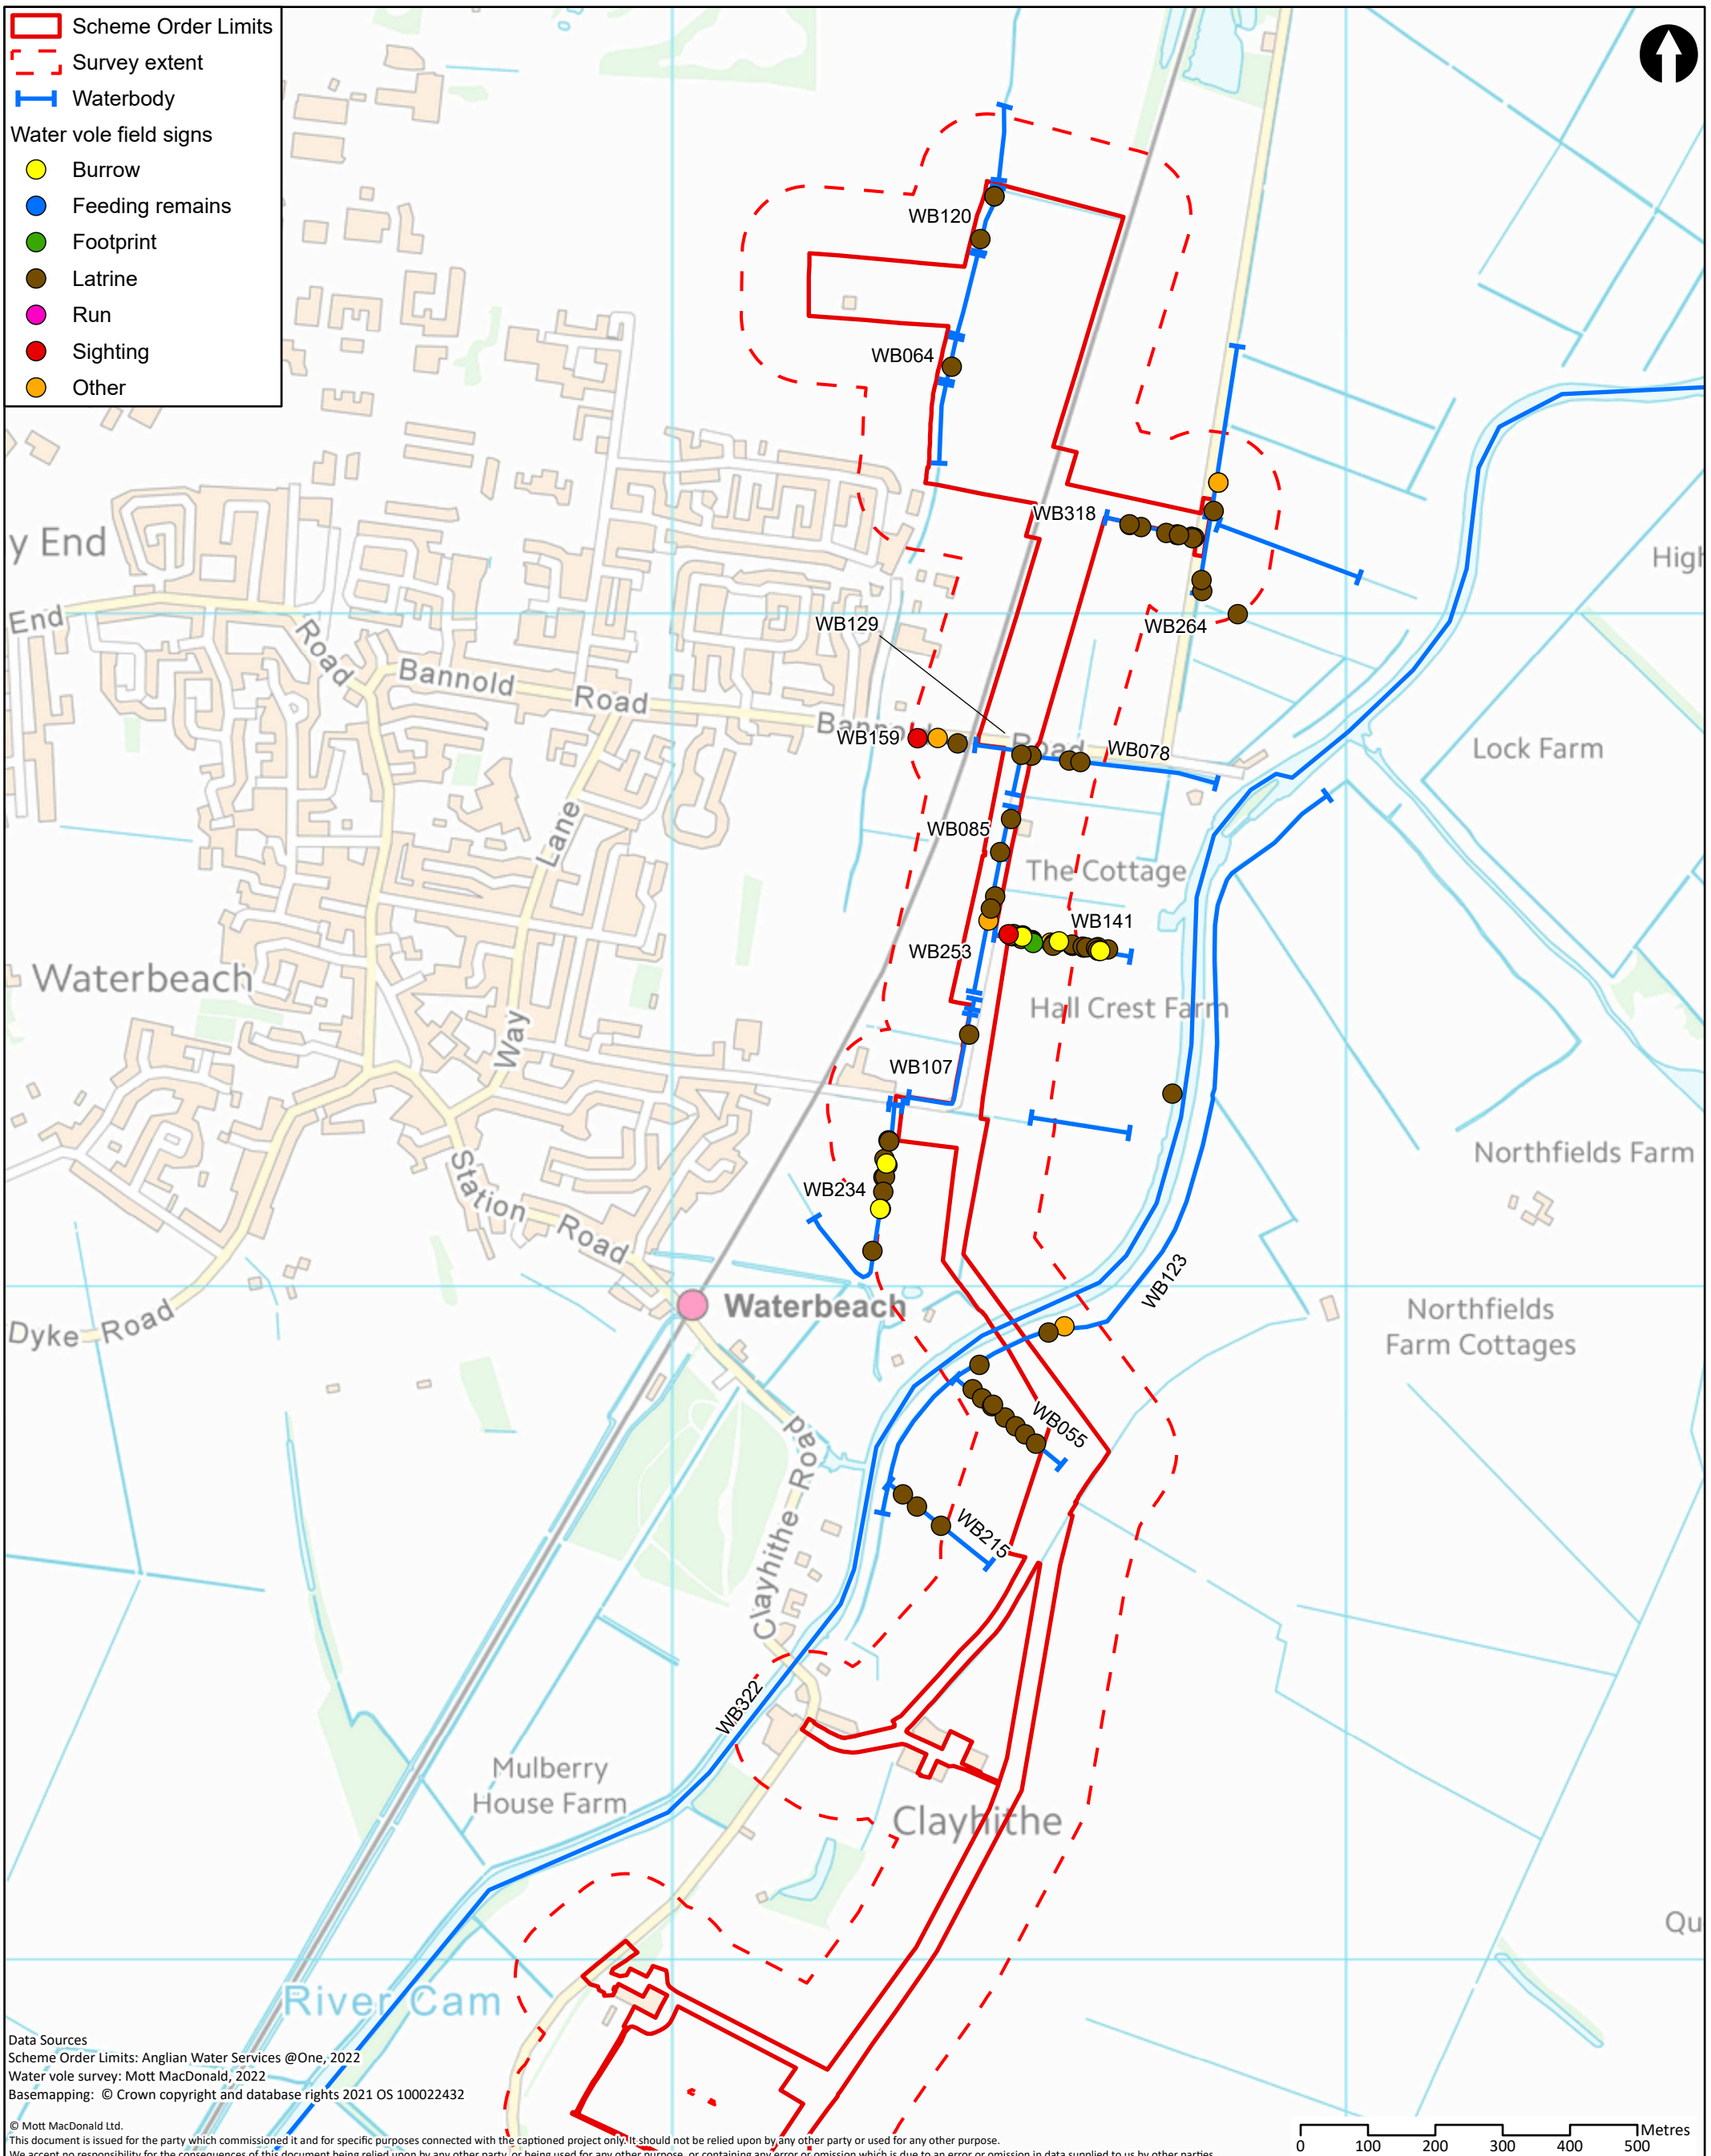


Data Sources  
 Scheme Order Limits: Anglian Water Services @One, 2022  
 Water vole survey: Mott MacDonald, 2022  
 Basemapping: © Crown copyright and database rights 2021 OS 100022432

© Mott MacDonald Ltd.  
 This document is issued for the party which commissioned it and for specific purposes connected with the captioned project only. It should not be relied upon by any other party or used for any other purpose.  
 We accept no responsibility for the consequences of this document being relied upon by any other party, or being used for any other purpose, or containing any error or omission which is due to an error or omission in data supplied to us by other parties.




<p><b>MOTT MACDONALD</b></p>	Client 		Title Cambridge Waste Water Treatment Plant Relocation Project Water voles Field signs - Waterbeach			Drawn KL																	
	22 Station Road Cambridge CB1 2JD United Kingdom  T +44 (0)20 8774 2000 F +44 (0)20 8681 5706 W mottmac.com		Drawing Number Figure 8.21			Checked AW  Approved CS  Scale at A3 1:9,000																	
	<table border="1" style="width: 100%; border-collapse: collapse;"> <thead> <tr> <th>Rev</th> <th>Date</th> <th>Drawn</th> <th>Description</th> <th>Ch'k'd</th> <th>App'd</th> </tr> </thead> <tbody> <tr> <td>P1</td> <td>25/10/22</td> <td>KL</td> <td>First Draft</td> <td>AW</td> <td>CS</td> </tr> </tbody> </table>	Rev	Date	Drawn	Description	Ch'k'd	App'd	P1	25/10/22	KL	First Draft	AW	CS	<table border="1" style="width: 100%; border-collapse: collapse;"> <thead> <tr> <th>Security</th> <th>Status</th> <th>Rev</th> </tr> </thead> <tbody> <tr> <td>STD</td> <td>PRE</td> <td>P1</td> </tr> </tbody> </table>		Security	Status	Rev	STD	PRE	P1		
Rev	Date	Drawn	Description	Ch'k'd	App'd																		
P1	25/10/22	KL	First Draft	AW	CS																		
Security	Status	Rev																					
STD	PRE	P1																					



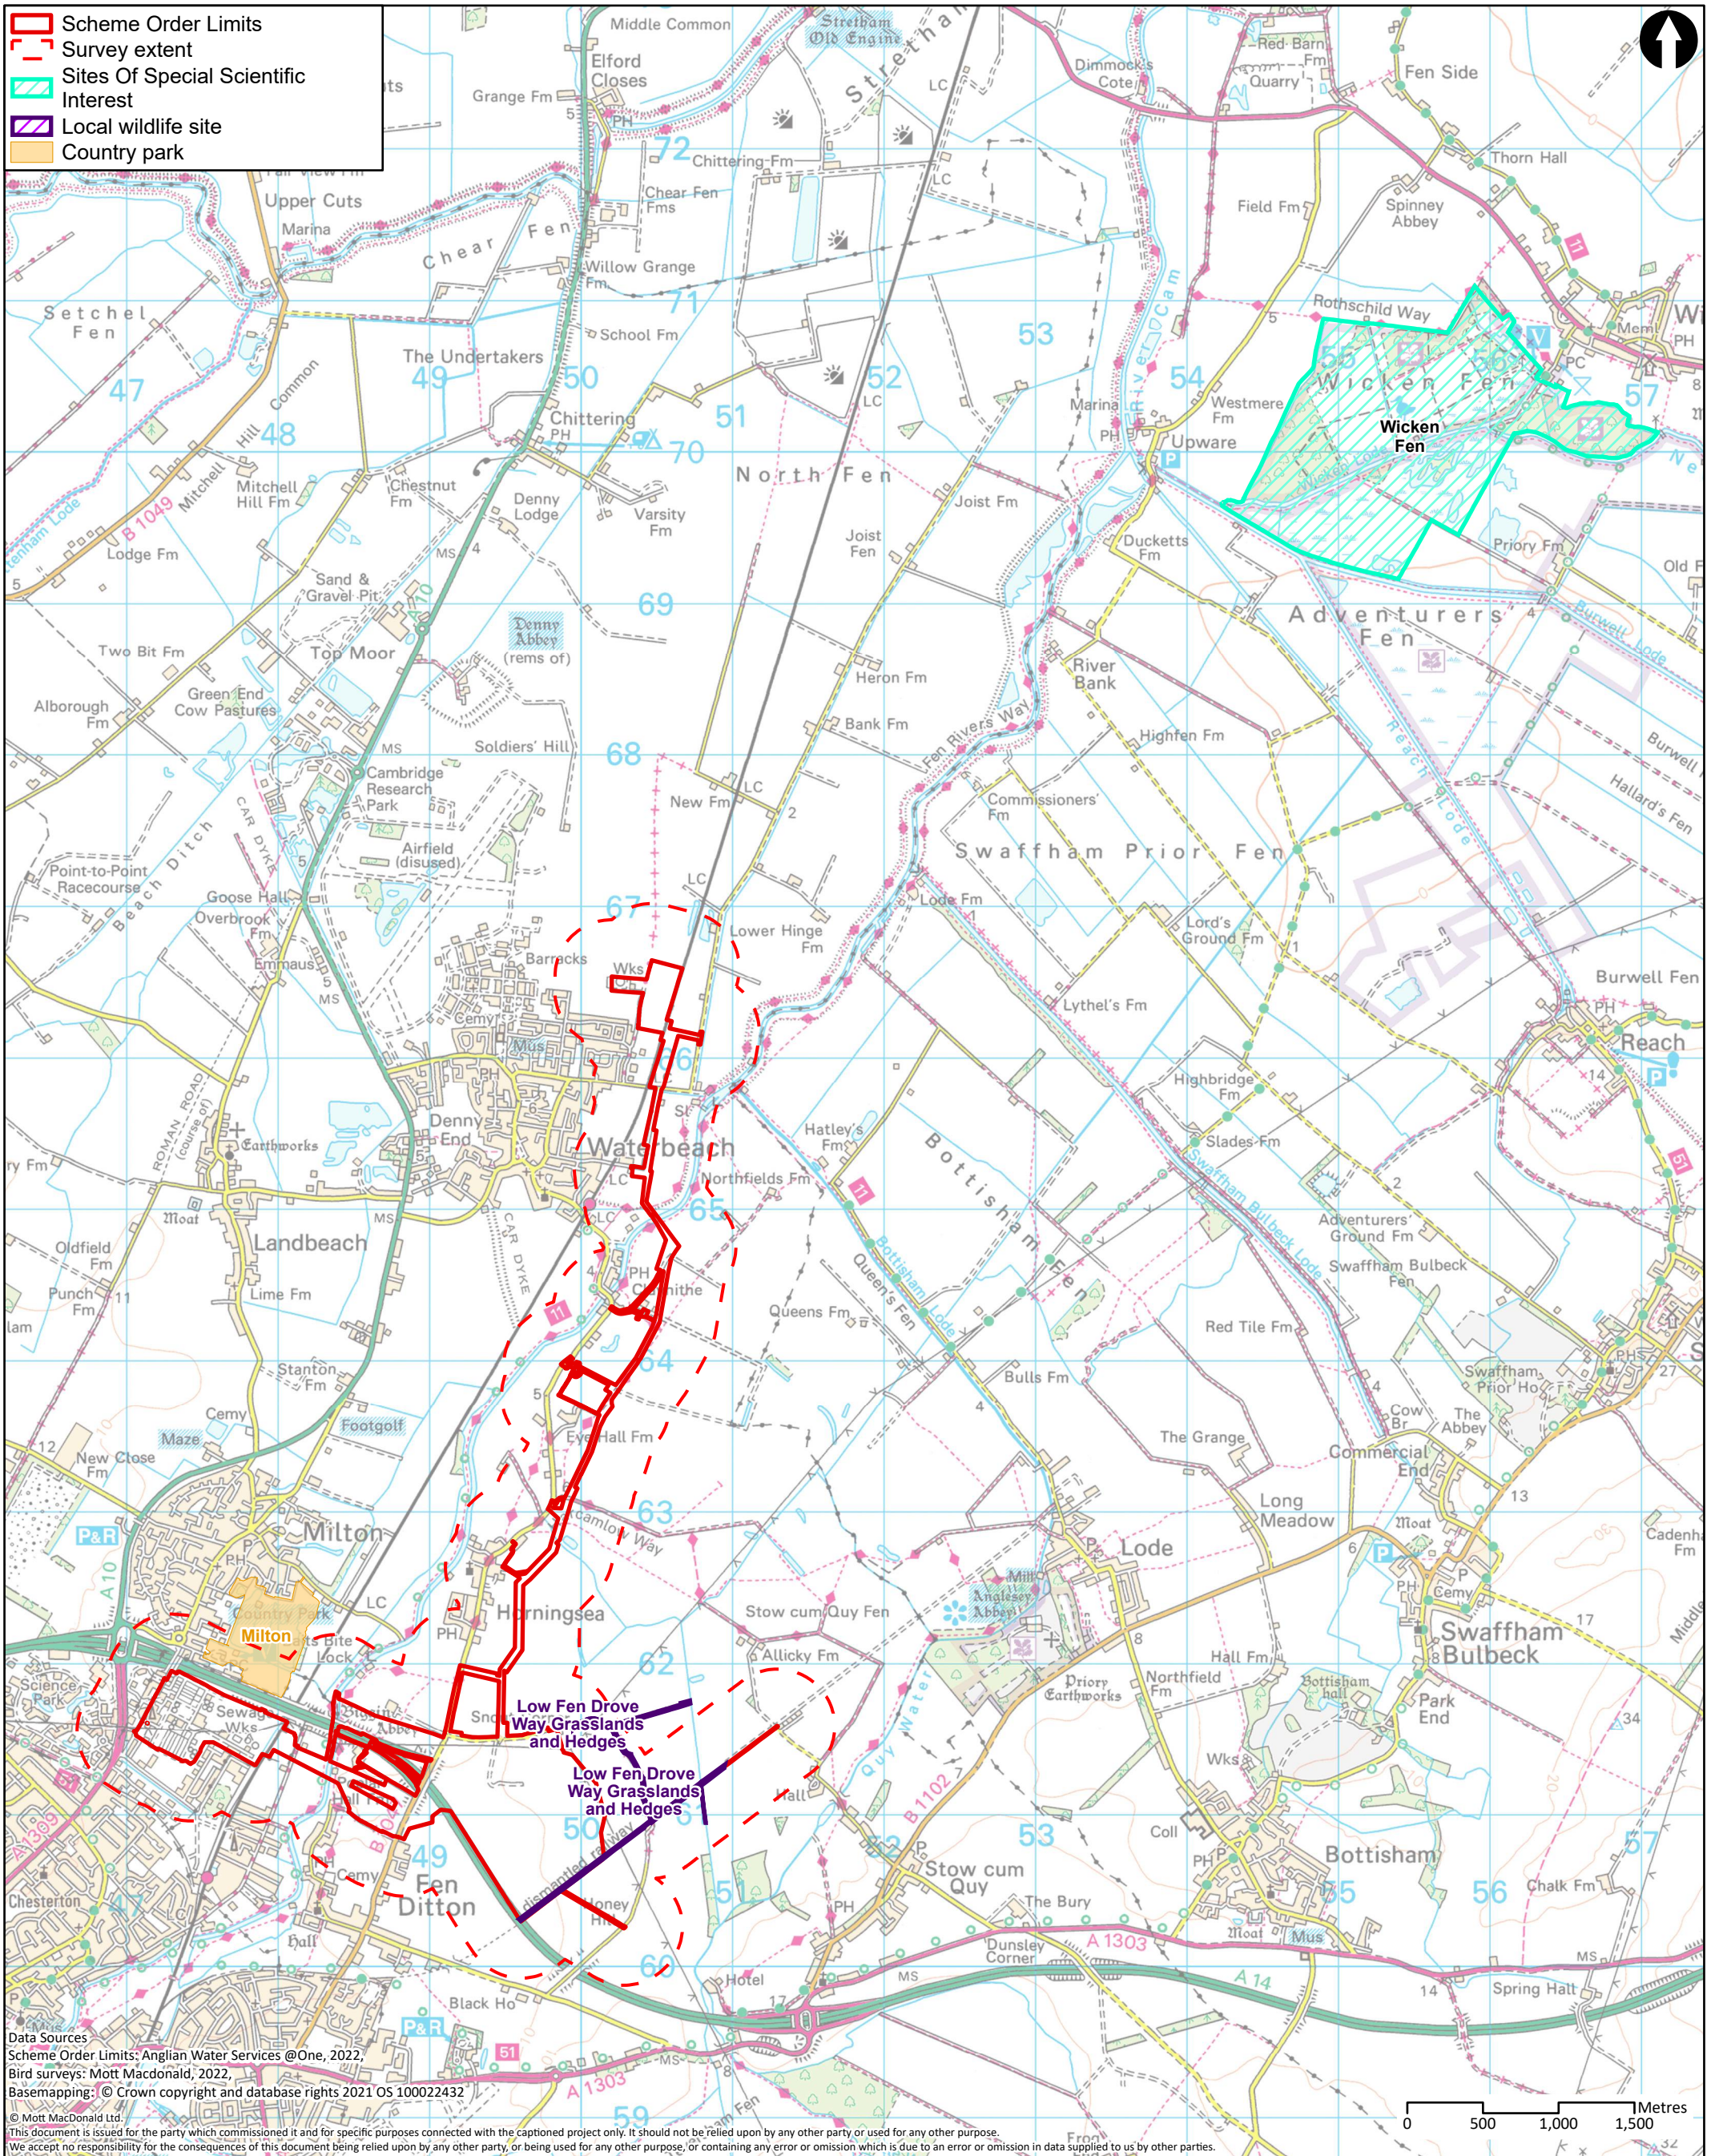

<p><b>MOTT MACDONALD</b></p> <p>22 Station Road Cambridge CB1 2JD United Kingdom</p> <p>T +44 (0)20 8774 2000 F +44 (0)20 8681 5706 W mottmac.com</p>	<p>Client</p>					<p>Title</p> <p>Cambridge Waste Water Treatment Plant Relocation Project Birds Designated and non-designated sites</p>			<p>Drawn</p> <p>KL</p>													
	<table border="1"> <thead> <tr> <th>Rev</th> <th>Date</th> <th>Drawn</th> <th>Description</th> <th>Ch'k'd</th> <th>App'd</th> </tr> </thead> <tbody> <tr> <td>P1</td> <td>26/10/22</td> <td>KL</td> <td>First Draft</td> <td>CBB</td> <td>CS</td> </tr> </tbody> </table>					Rev	Date	Drawn	Description	Ch'k'd	App'd	P1	26/10/22	KL	First Draft	CBB	CS	<p>Drawing Number</p> <p>Figure 8.33</p>			<p>Checked</p> <p>CBB</p>	
Rev	Date	Drawn	Description	Ch'k'd	App'd																	
P1	26/10/22	KL	First Draft	CBB	CS																	
					<p>Approved</p> <p>CS</p>			<p>Scale at A3</p> <p>1:40,000</p>														
					<p>Security</p> <p>STD</p>			<p>Status</p> <p>PRE</p>														
					<p>Rev</p> <p>P1</p>																	



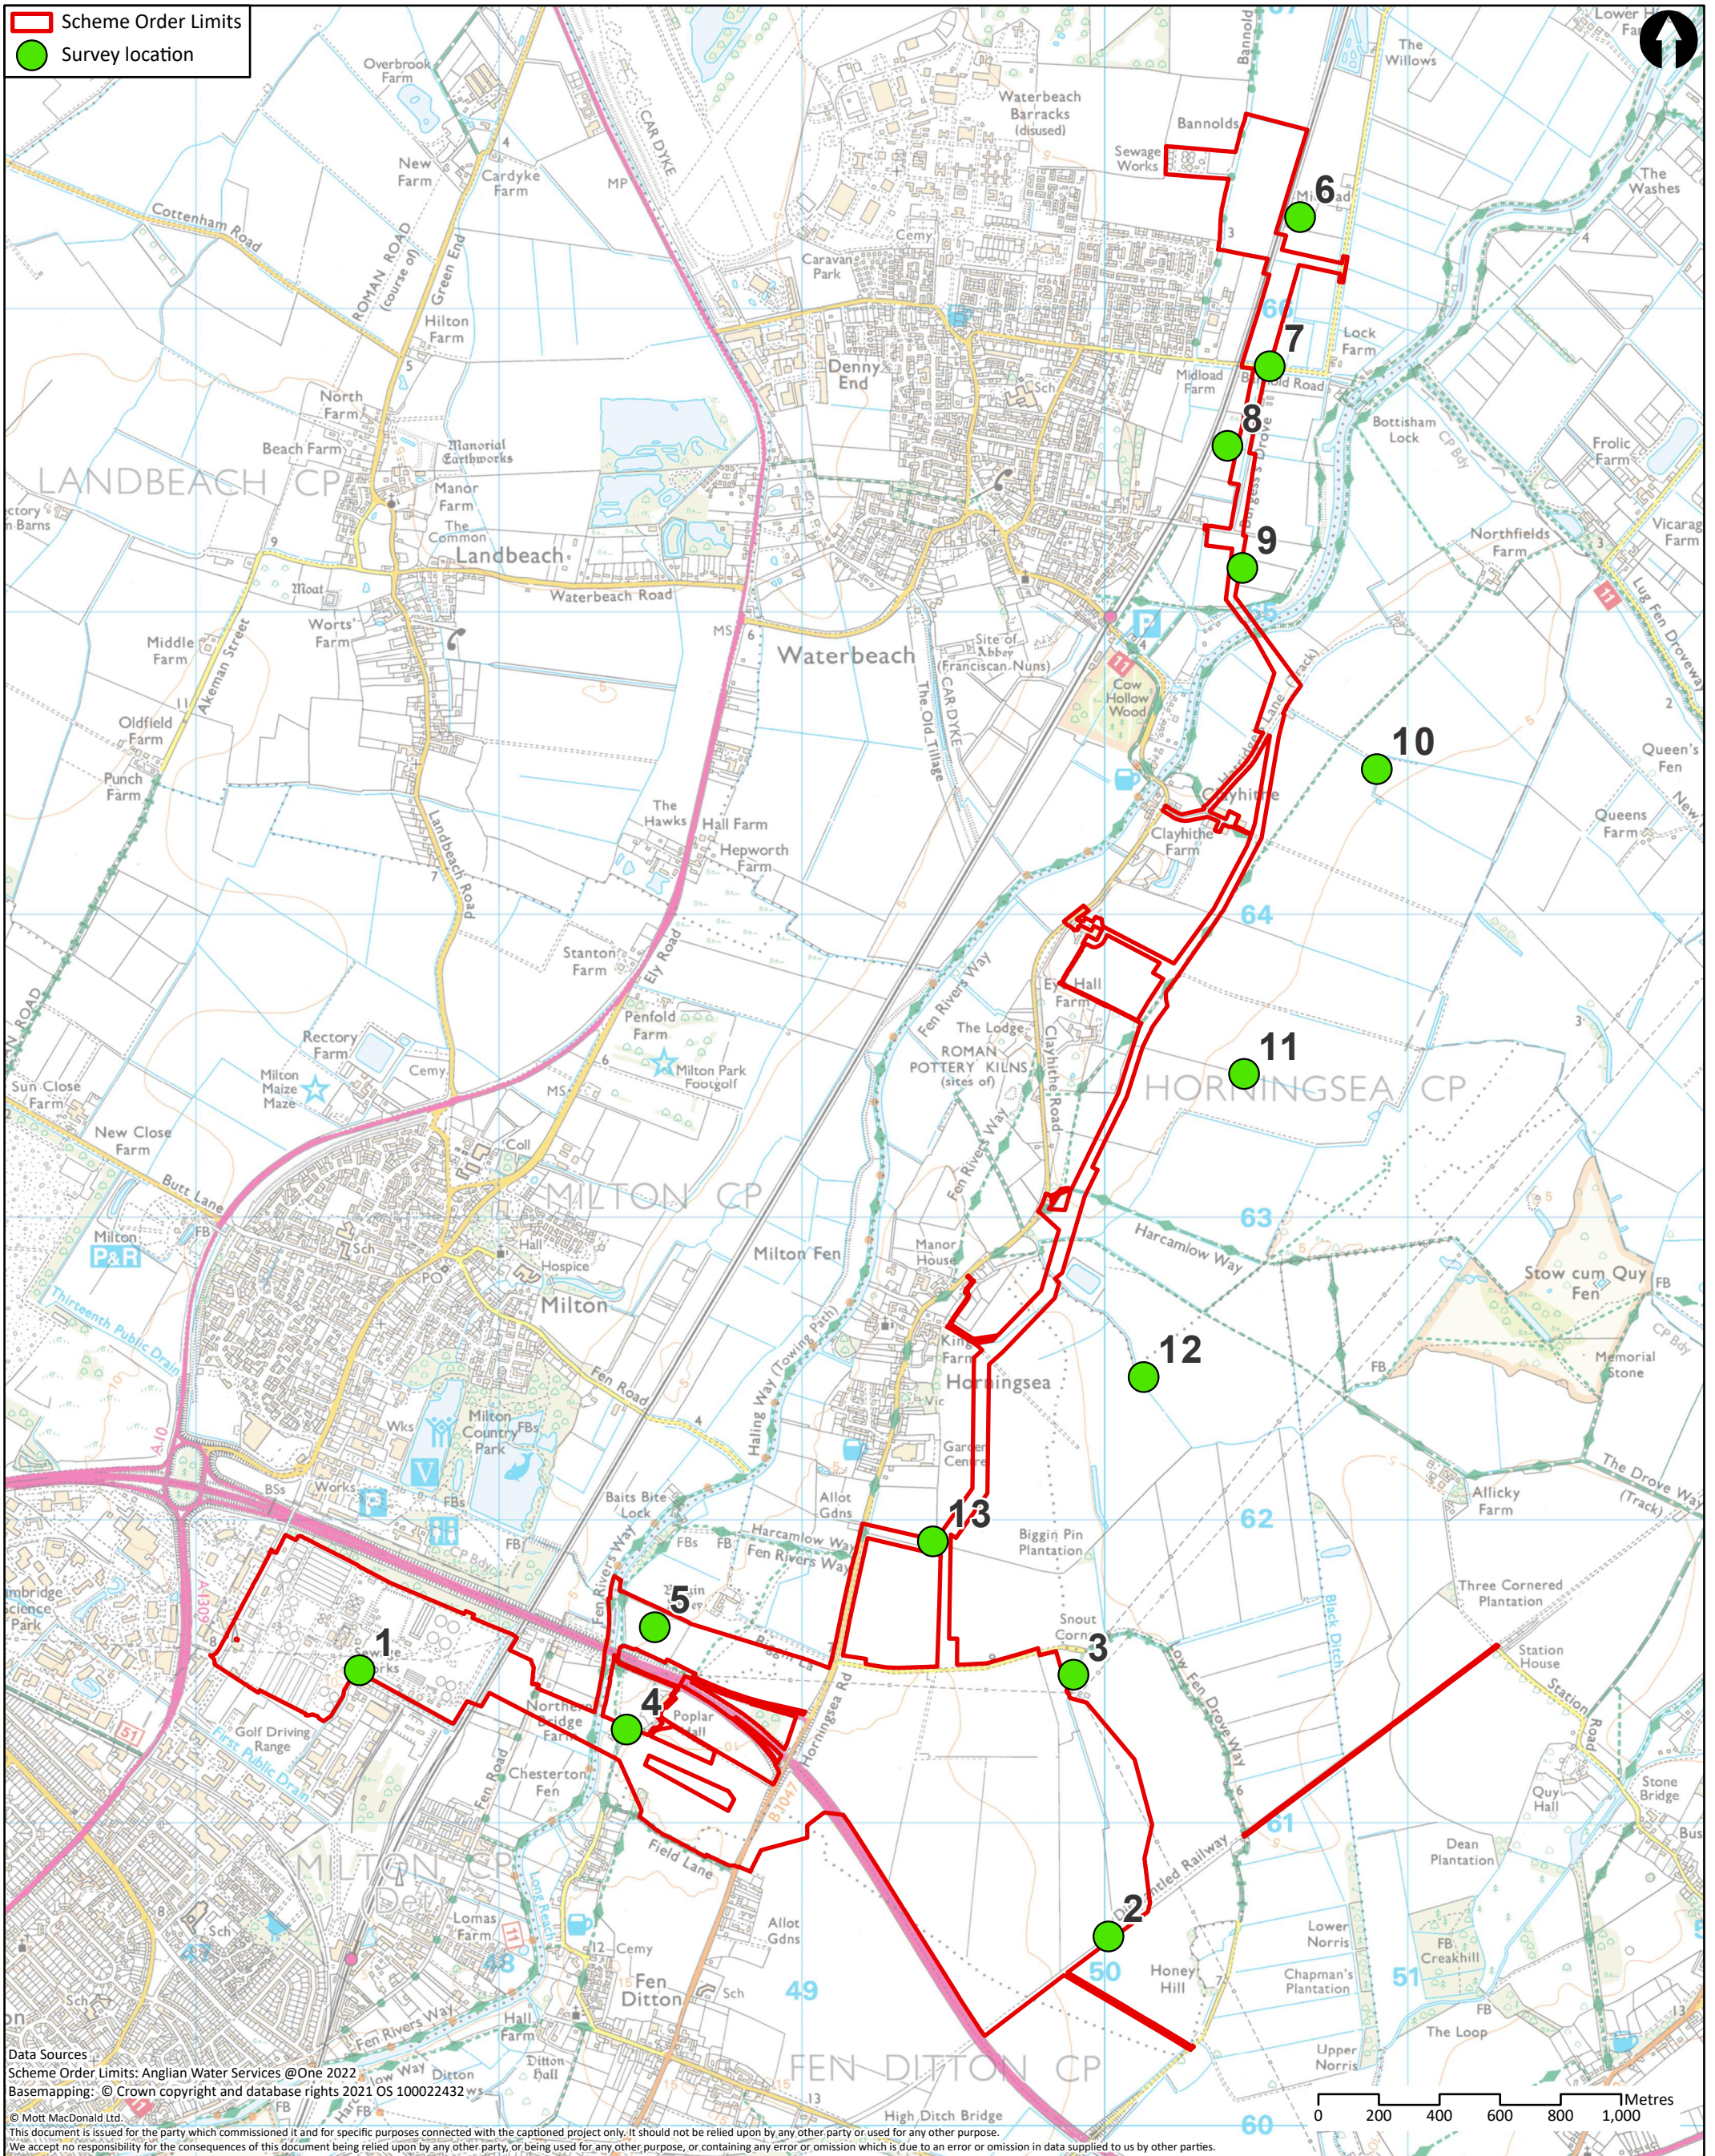

Data Sources:  
 Scheme Order Limits: Anglian Water Services @One 2022  
 Basemapping: © Crown copyright and database rights 2021 OS 100022432  
 © Mott MacDonald Ltd.  
 This document is issued for the party which commissioned it and for specific purposes connected with the captioned project only. It should not be relied upon by any other party or used for any other purpose.  
 We accept no responsibility for the consequences of this document being relied upon by any other party, or being used for any other purpose, or containing any error or omission which is due to an error or omission in data supplied to us by other parties.

**M M**  
**MOTT MACDONALD**

22 Station Road  
 Cambridge CB1 2JD  
 United Kingdom


T +44 (0)20 8774 2000  
 F +44 (0)20 8681 5706  
 W mottmac.com


Client					
Rev	Date	Drawn	Description	Ch'k'd	App'd
P1	10/11/22	AW	First Draft	AW	CS

Title		
Cambridge Waste Water Treatment Plant Relocation Project		
Reptiles		
Survey locations		
Drawing Number		
Figure 8.34		



Drawn	AW
Checked	AW
Approved	CS
Scale at A3	
1:20,000	
Security	Status
STD	PRE
Rev	P1

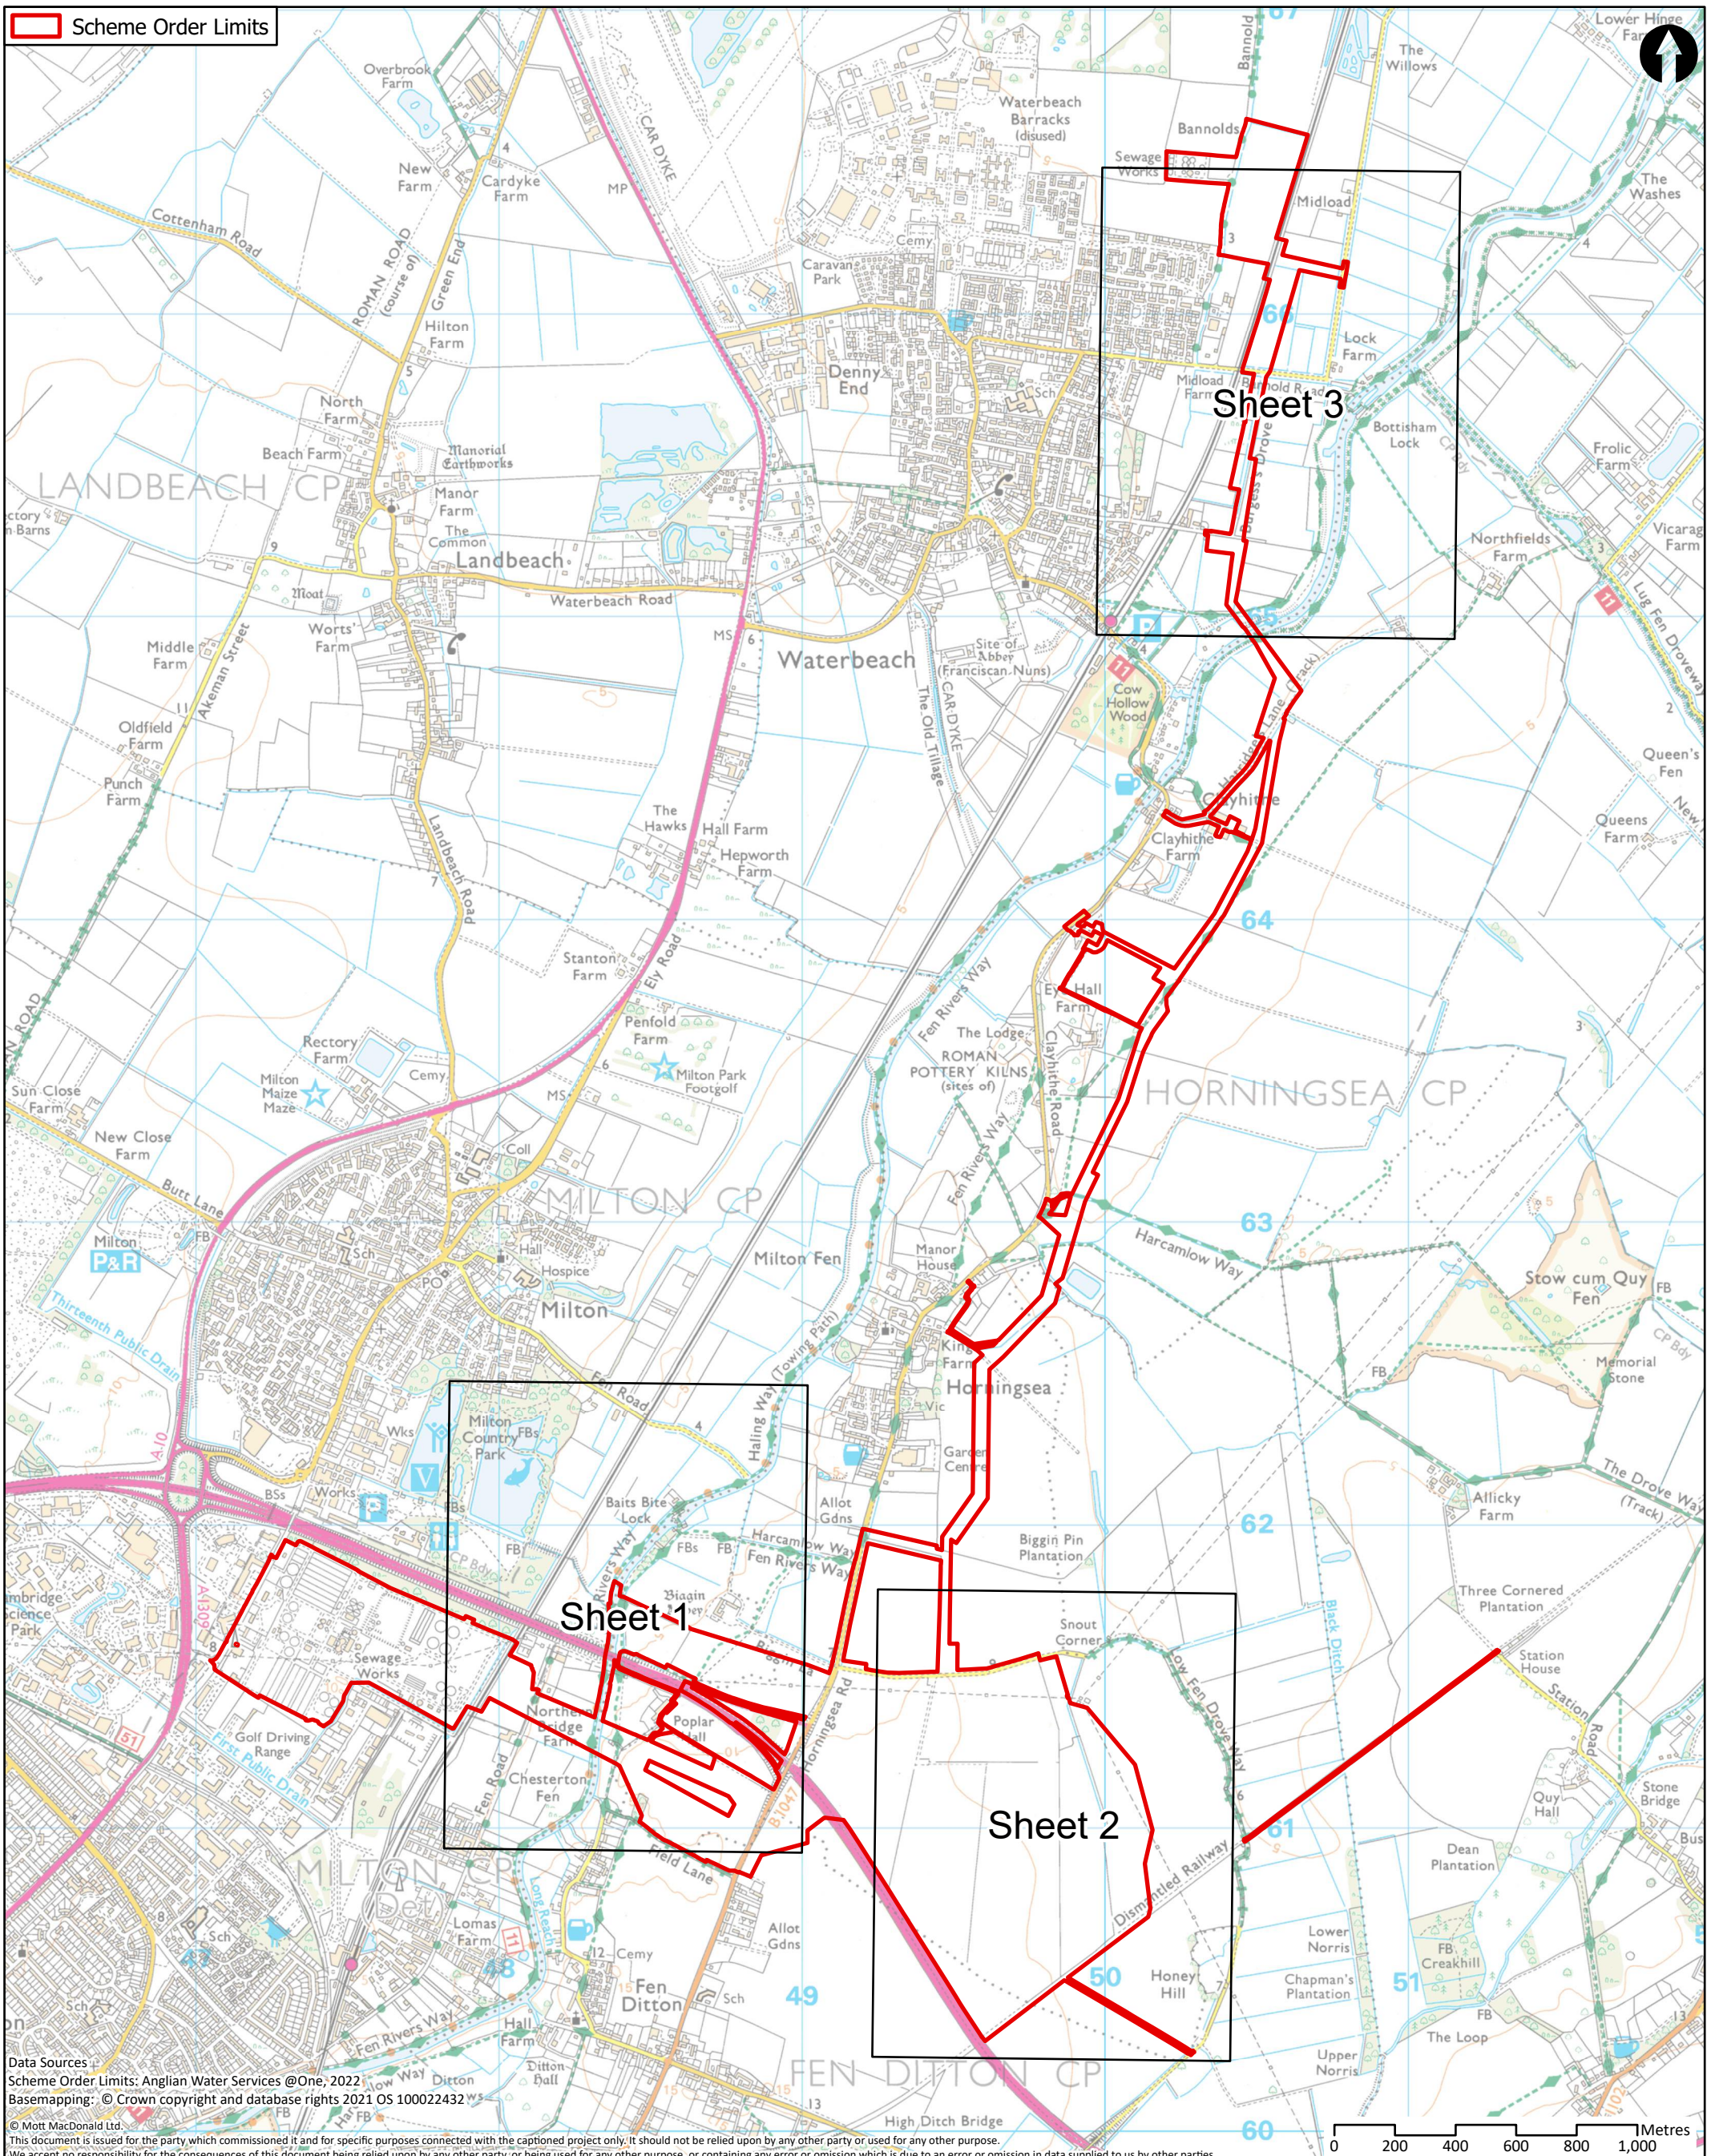

 Scheme Order Limits



Data Sources:  
 Scheme Order Limits: Anglian Water Services @One, 2022  
 Basemapping: © Crown copyright and database rights 2021 OS 100022432  
 © Mott MacDonald Ltd.  
 This document is issued for the party which commissioned it and for specific purposes connected with the captioned project only. It should not be relied upon by any other party or used for any other purpose.  
 We accept no responsibility for the consequences of this document being relied upon by any other party, or being used for any other purpose, or containing any error or omission which is due to an error or omission in data supplied to us by other parties.


 <p>22 Station Road          Cambridge CB1 2JD          United Kingdom</p> <p>T +44 (0)20 8774 2000          F +44 (0)20 8681 5706          W mottmac.com</p>	Client 					Title Cambridge Waste Water Treatment Plant Relocation Project Reptiles Survey results overview			Drawn AW	
						Drawing Number Figure 8.35			Checked AW	
									Approved CS	
								Scale at A3 1:20,000		
								Security STD	Status PRE	Rev P1



**Scheme Order Limits**


**Reptile Survey Results**

- Common lizard
- Grass snake
- ● Common lizard, Grass snake

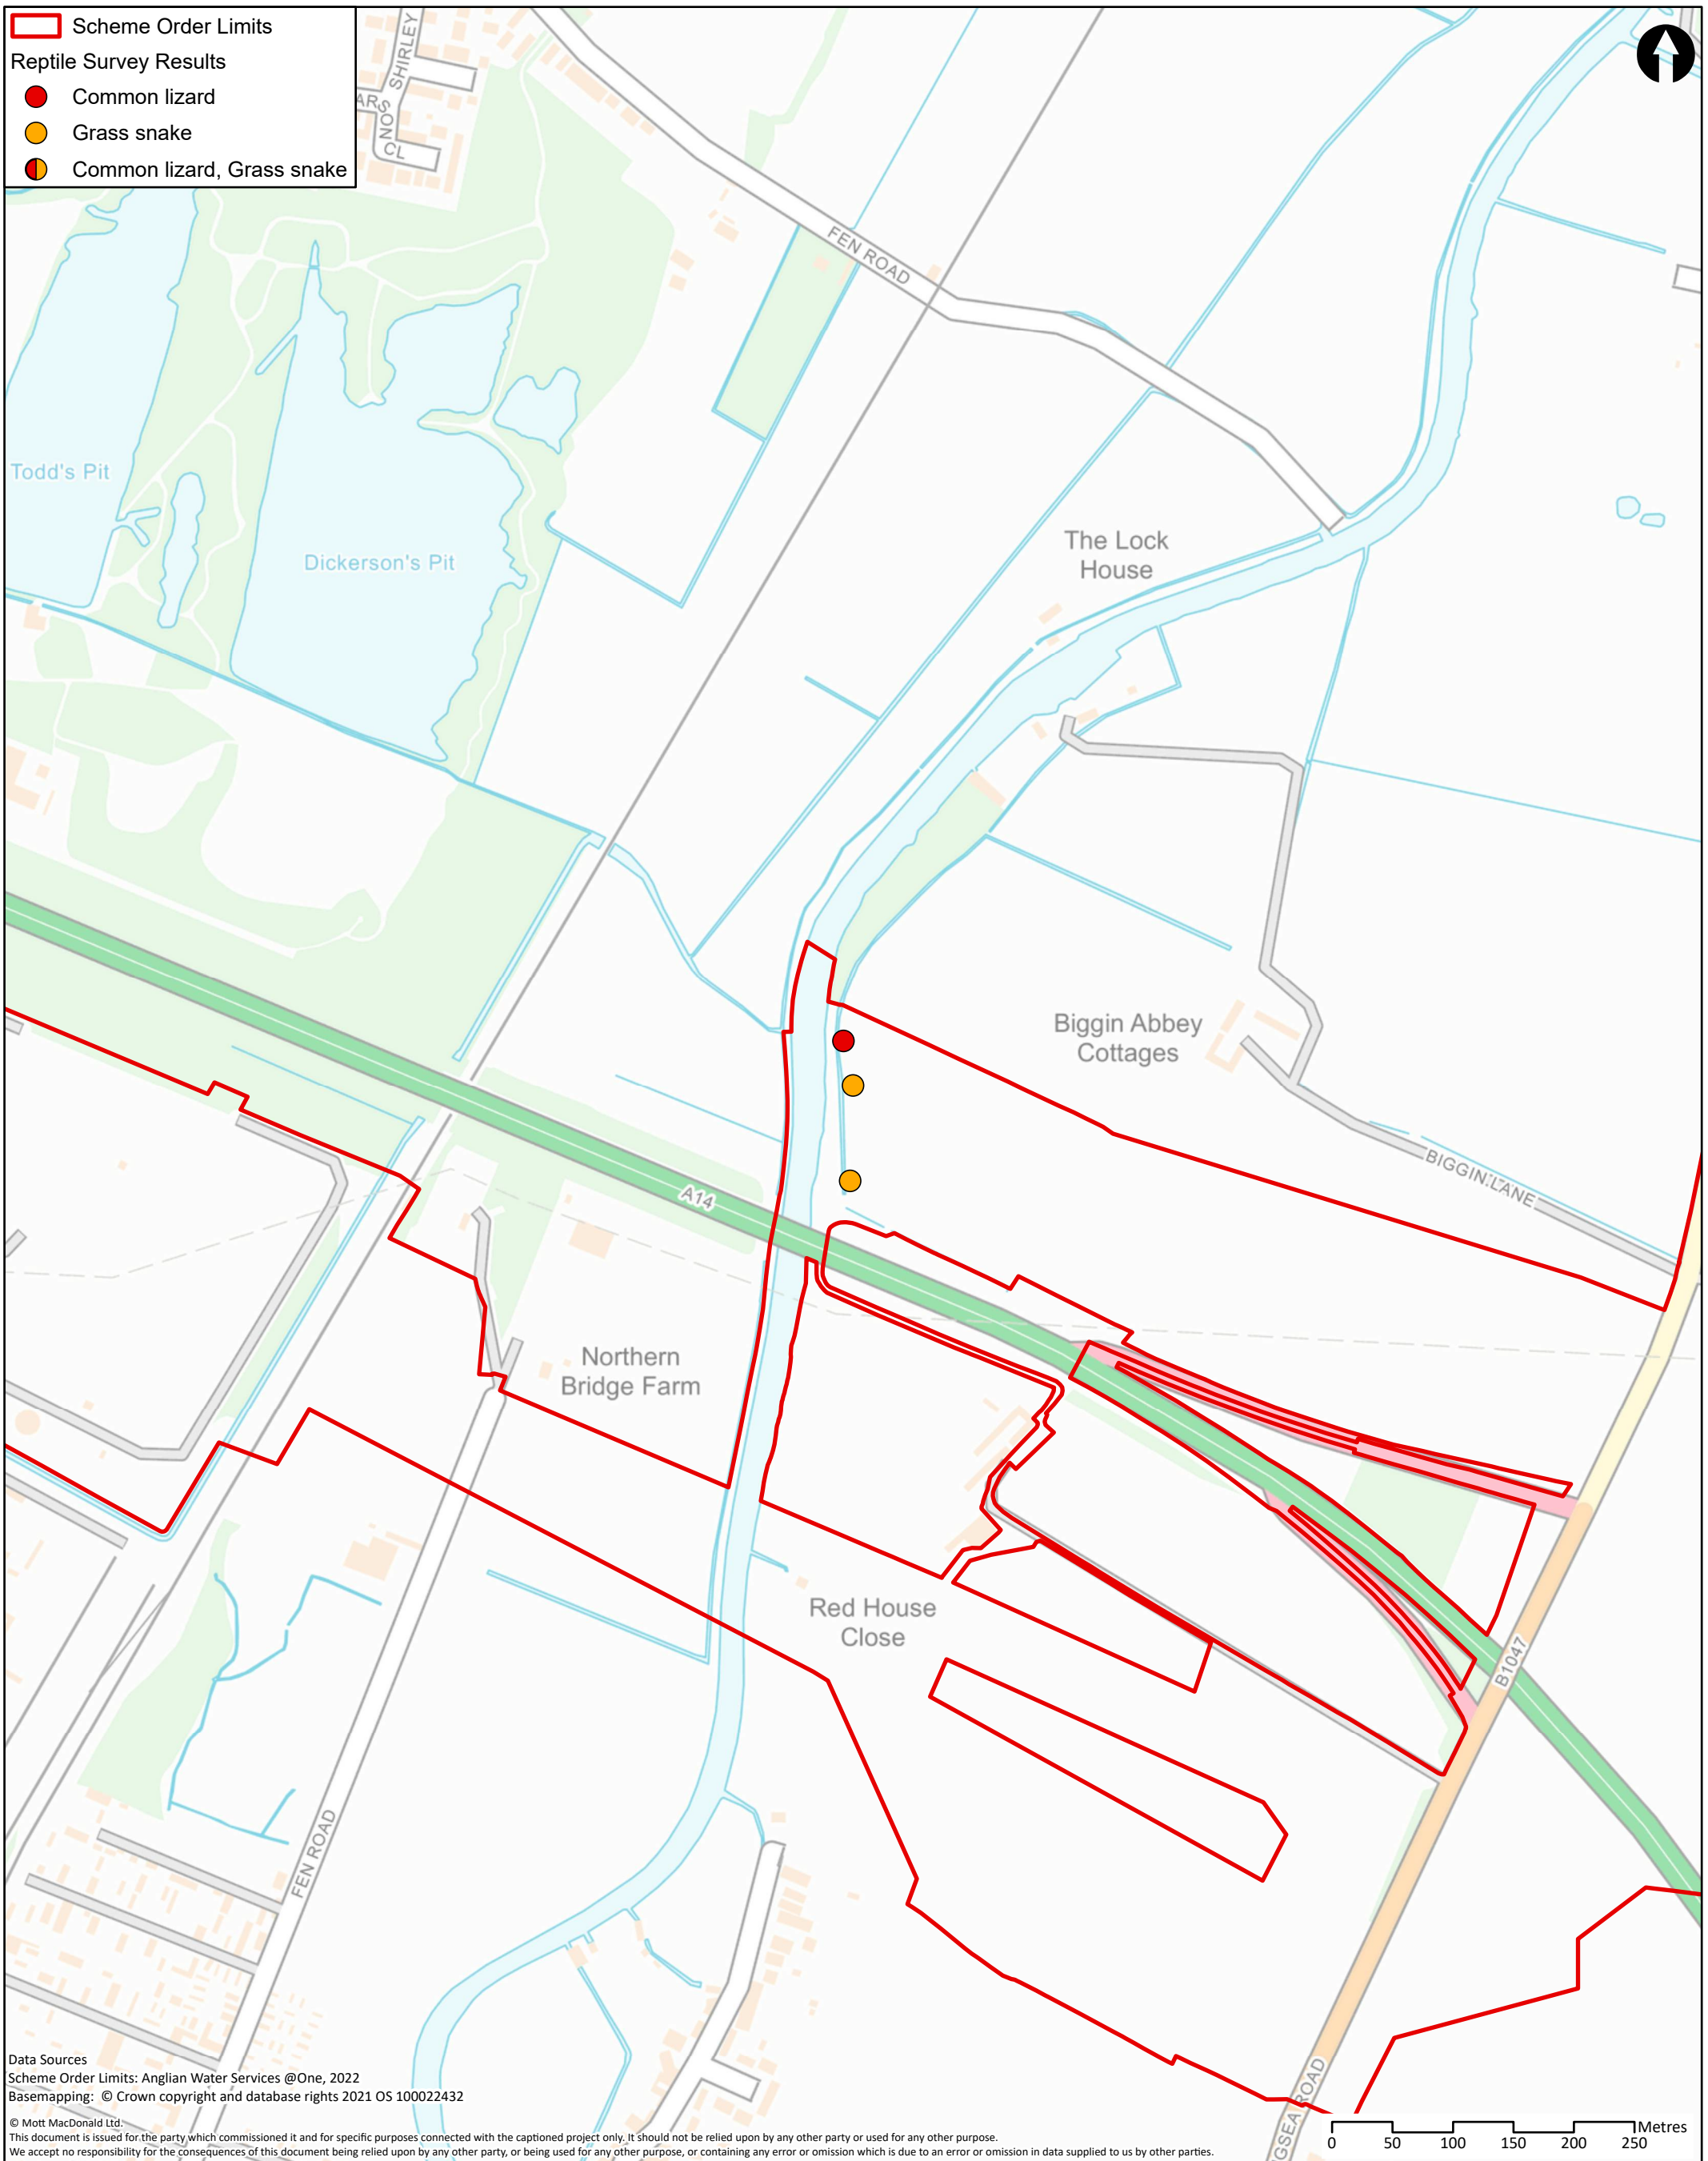

Data Sources  
 Scheme Order Limits: Anglian Water Services @One, 2022  
 Basemapping: © Crown copyright and database rights 2021 OS 100022432  
 © Mott MacDonald Ltd.  
 This document is issued for the party which commissioned it and for specific purposes connected with the captioned project only. It should not be relied upon by any other party or used for any other purpose.  
 We accept no responsibility for the consequences of this document being relied upon by any other party, or being used for any other purpose, or containing any error or omission which is due to an error or omission in data supplied to us by other parties.

<p>22 Station Road Cambridge CB1 2JD United Kingdom</p> <p>T +44 (0)20 8774 2000 F +44 (0)20 8681 5706 W mottmac.com</p>	Client 					Title Cambridge Waste Water Treatment Plant Relocation Project Reptiles Survey results - Sheet 1			Drawn	AW												
	<table border="1"> <thead> <tr> <th>Rev</th> <th>Date</th> <th>Drawn</th> <th>Description</th> <th>Ch'k'd</th> <th>App'd</th> </tr> </thead> <tbody> <tr> <td>P1</td> <td>10/11/22</td> <td>AW</td> <td>First Draft</td> <td>AW</td> <td>CS</td> </tr> </tbody> </table>					Rev	Date	Drawn	Description	Ch'k'd	App'd	P1	10/11/22	AW	First Draft	AW	CS	Drawing Number Figure 8.36			Checked	AW
	Rev	Date	Drawn	Description	Ch'k'd	App'd																
P1	10/11/22	AW	First Draft	AW	CS																	
								Approved	CS													
								Scale at A3 1:5,000														
								Security	Status	Rev												
								STD	PRE	P1												

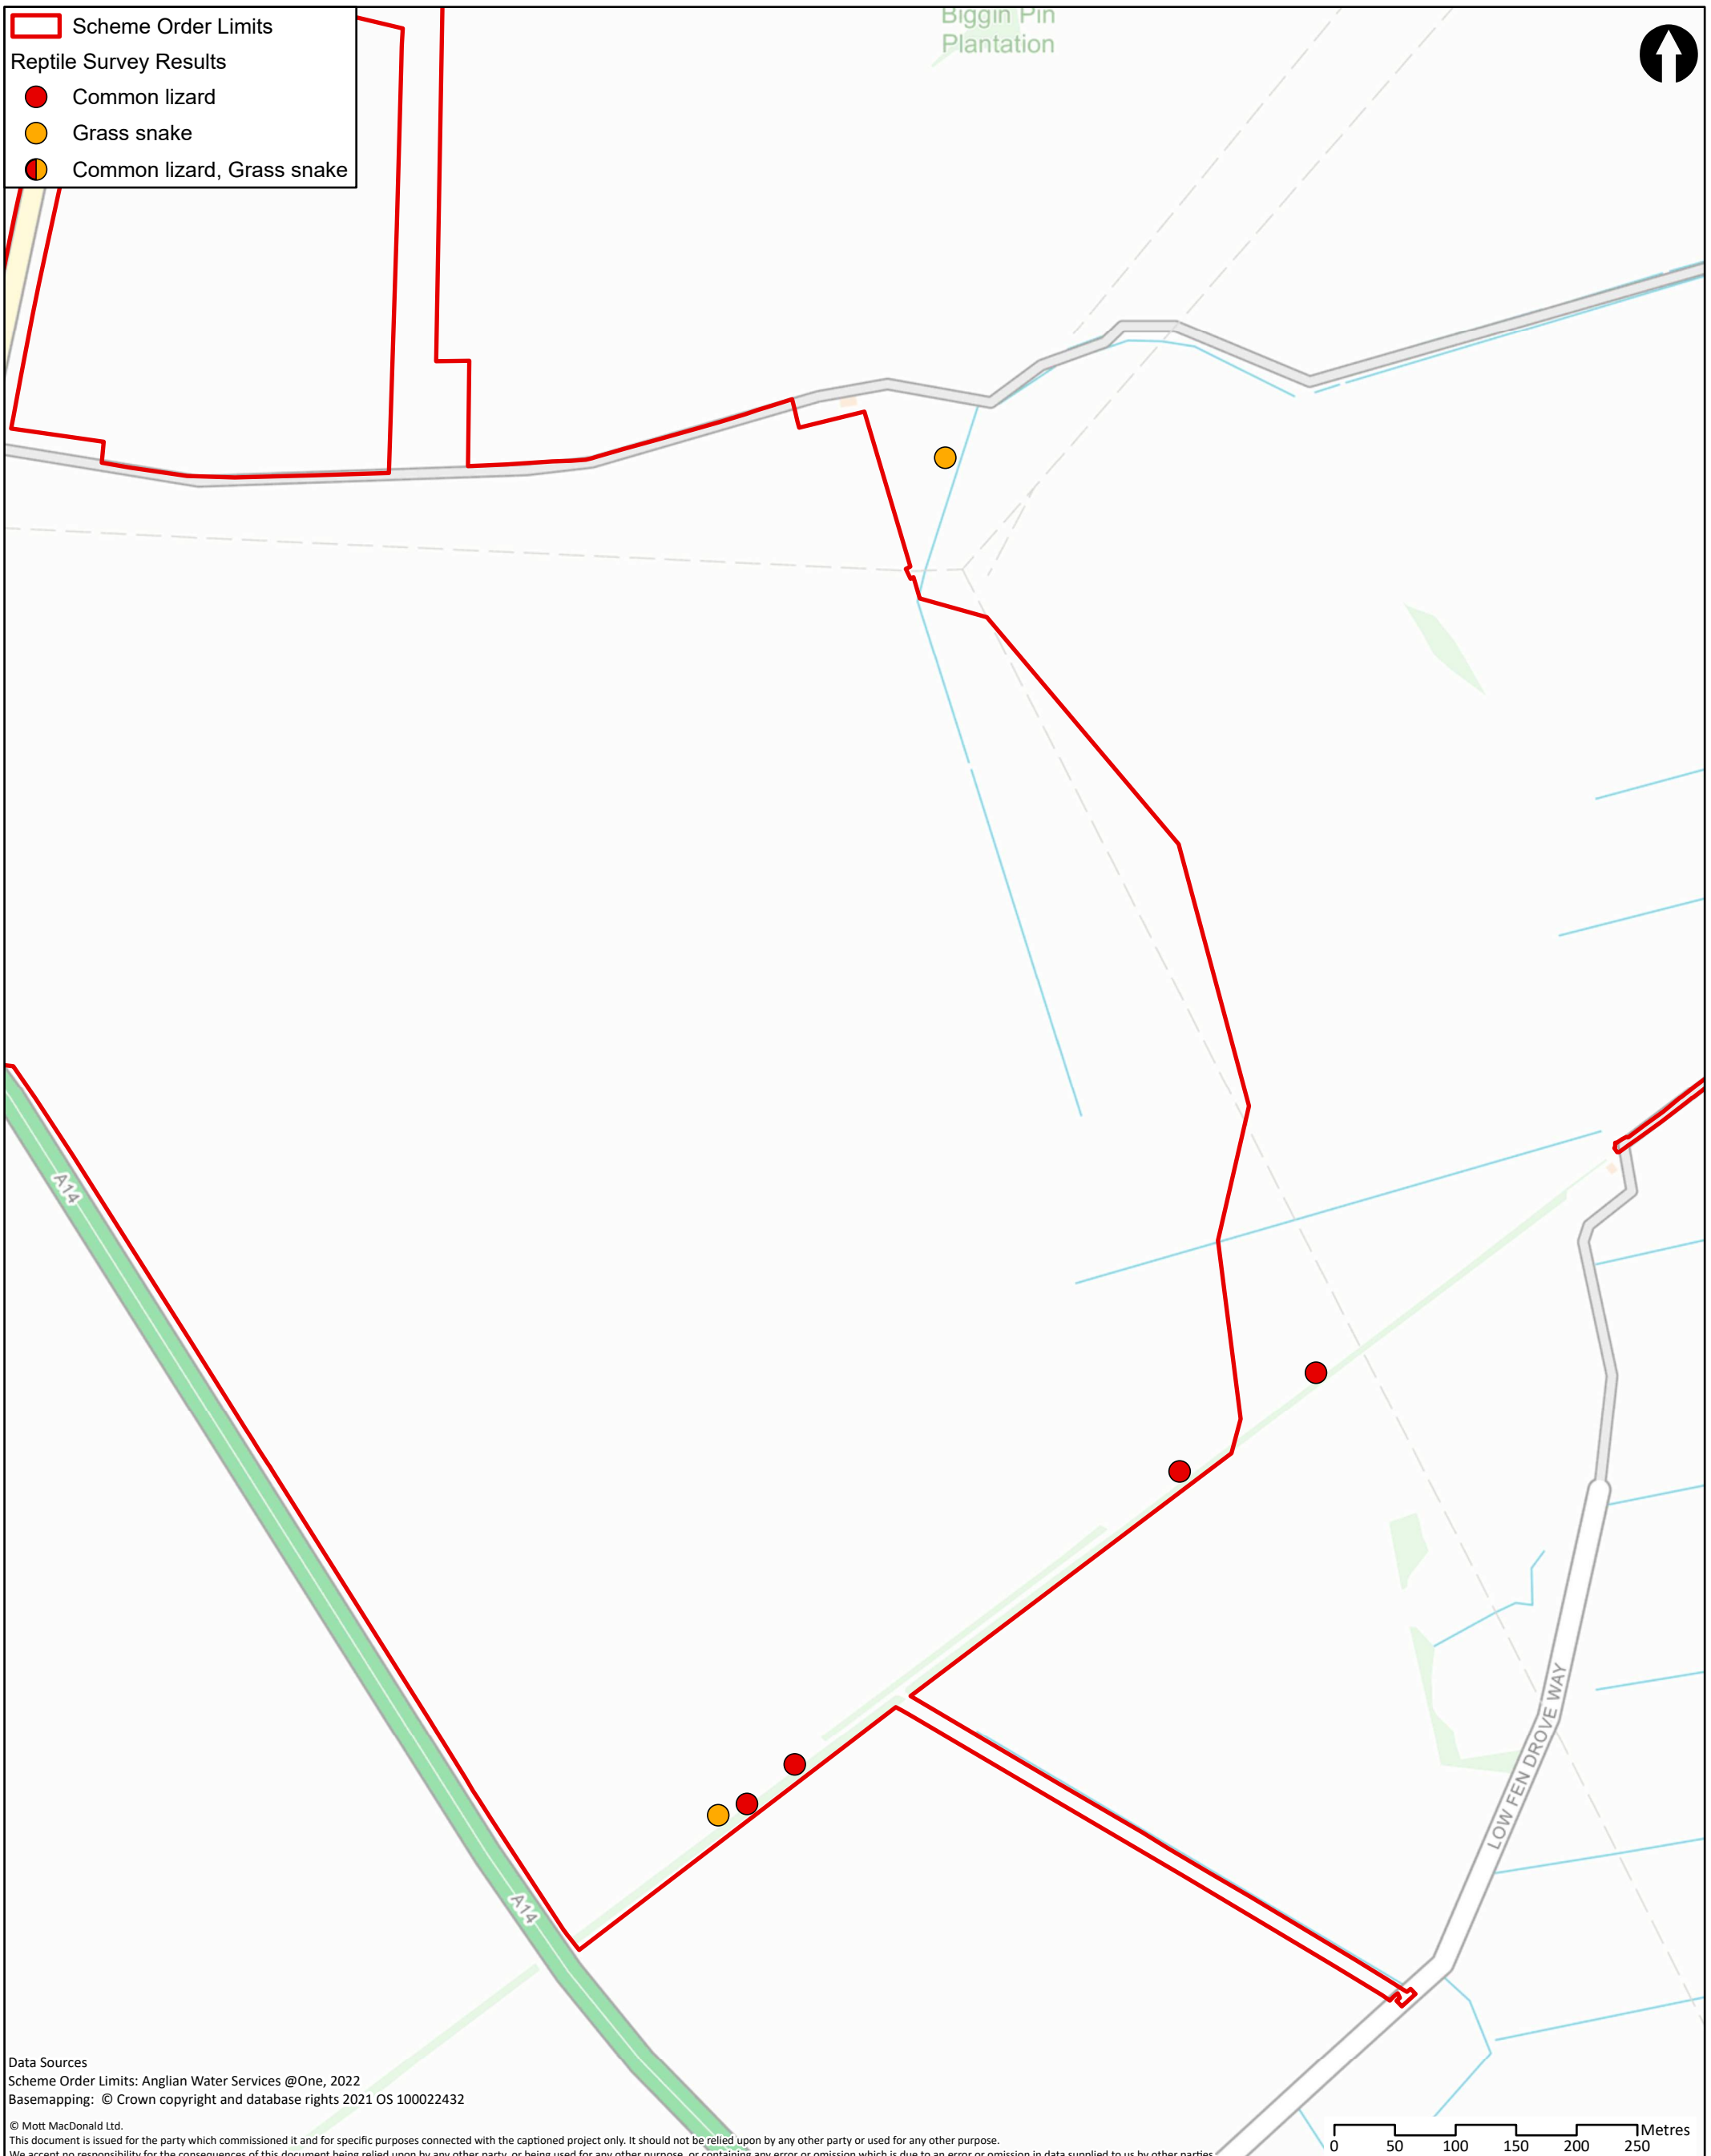


Data Sources  
 Scheme Order Limits: Anglian Water Services @One, 2022  
 Basemapping: © Crown copyright and database rights 2021 OS 100022432

© Mott MacDonald Ltd.  
 This document is issued for the party which commissioned it and for specific purposes connected with the captioned project only. It should not be relied upon by any other party or used for any other purpose.  
 We accept no responsibility for the consequences of this document being relied upon by any other party, or being used for any other purpose, or containing any error or omission which is due to an error or omission in data supplied to us by other parties.

	22 Station Road Cambridge CB1 2JD United Kingdom  T +44 (0)20 8774 2000 F +44 (0)20 8681 5706 W mottmac.com		Client 			Title Cambridge Waste Water Treatment Plant Relocation Project Reptiles Survey results - Sheet 2			Drawn AW														
							Checked AW																
							Approved CS																
						Scale at A3 1:5,000																	
			<table border="1"> <thead> <tr> <th>Rev</th> <th>Date</th> <th>Drawn</th> <th>Description</th> <th>Ch'k'd</th> <th>App'd</th> </tr> </thead> <tbody> <tr> <td>P1</td> <td>10/11/22</td> <td>AW</td> <td>First Draft</td> <td>AW</td> <td>CS</td> </tr> </tbody> </table>			Rev	Date	Drawn	Description	Ch'k'd	App'd	P1	10/11/22	AW	First Draft	AW	CS	Drawing Number Figure 8.37			Security STD	Status PRE	Rev P1
Rev	Date	Drawn	Description	Ch'k'd	App'd																		
P1	10/11/22	AW	First Draft	AW	CS																		



- Scheme Order Limits
- Reptile Survey Results
- Common lizard
- Grass snake
- ● Common lizard, Grass snake

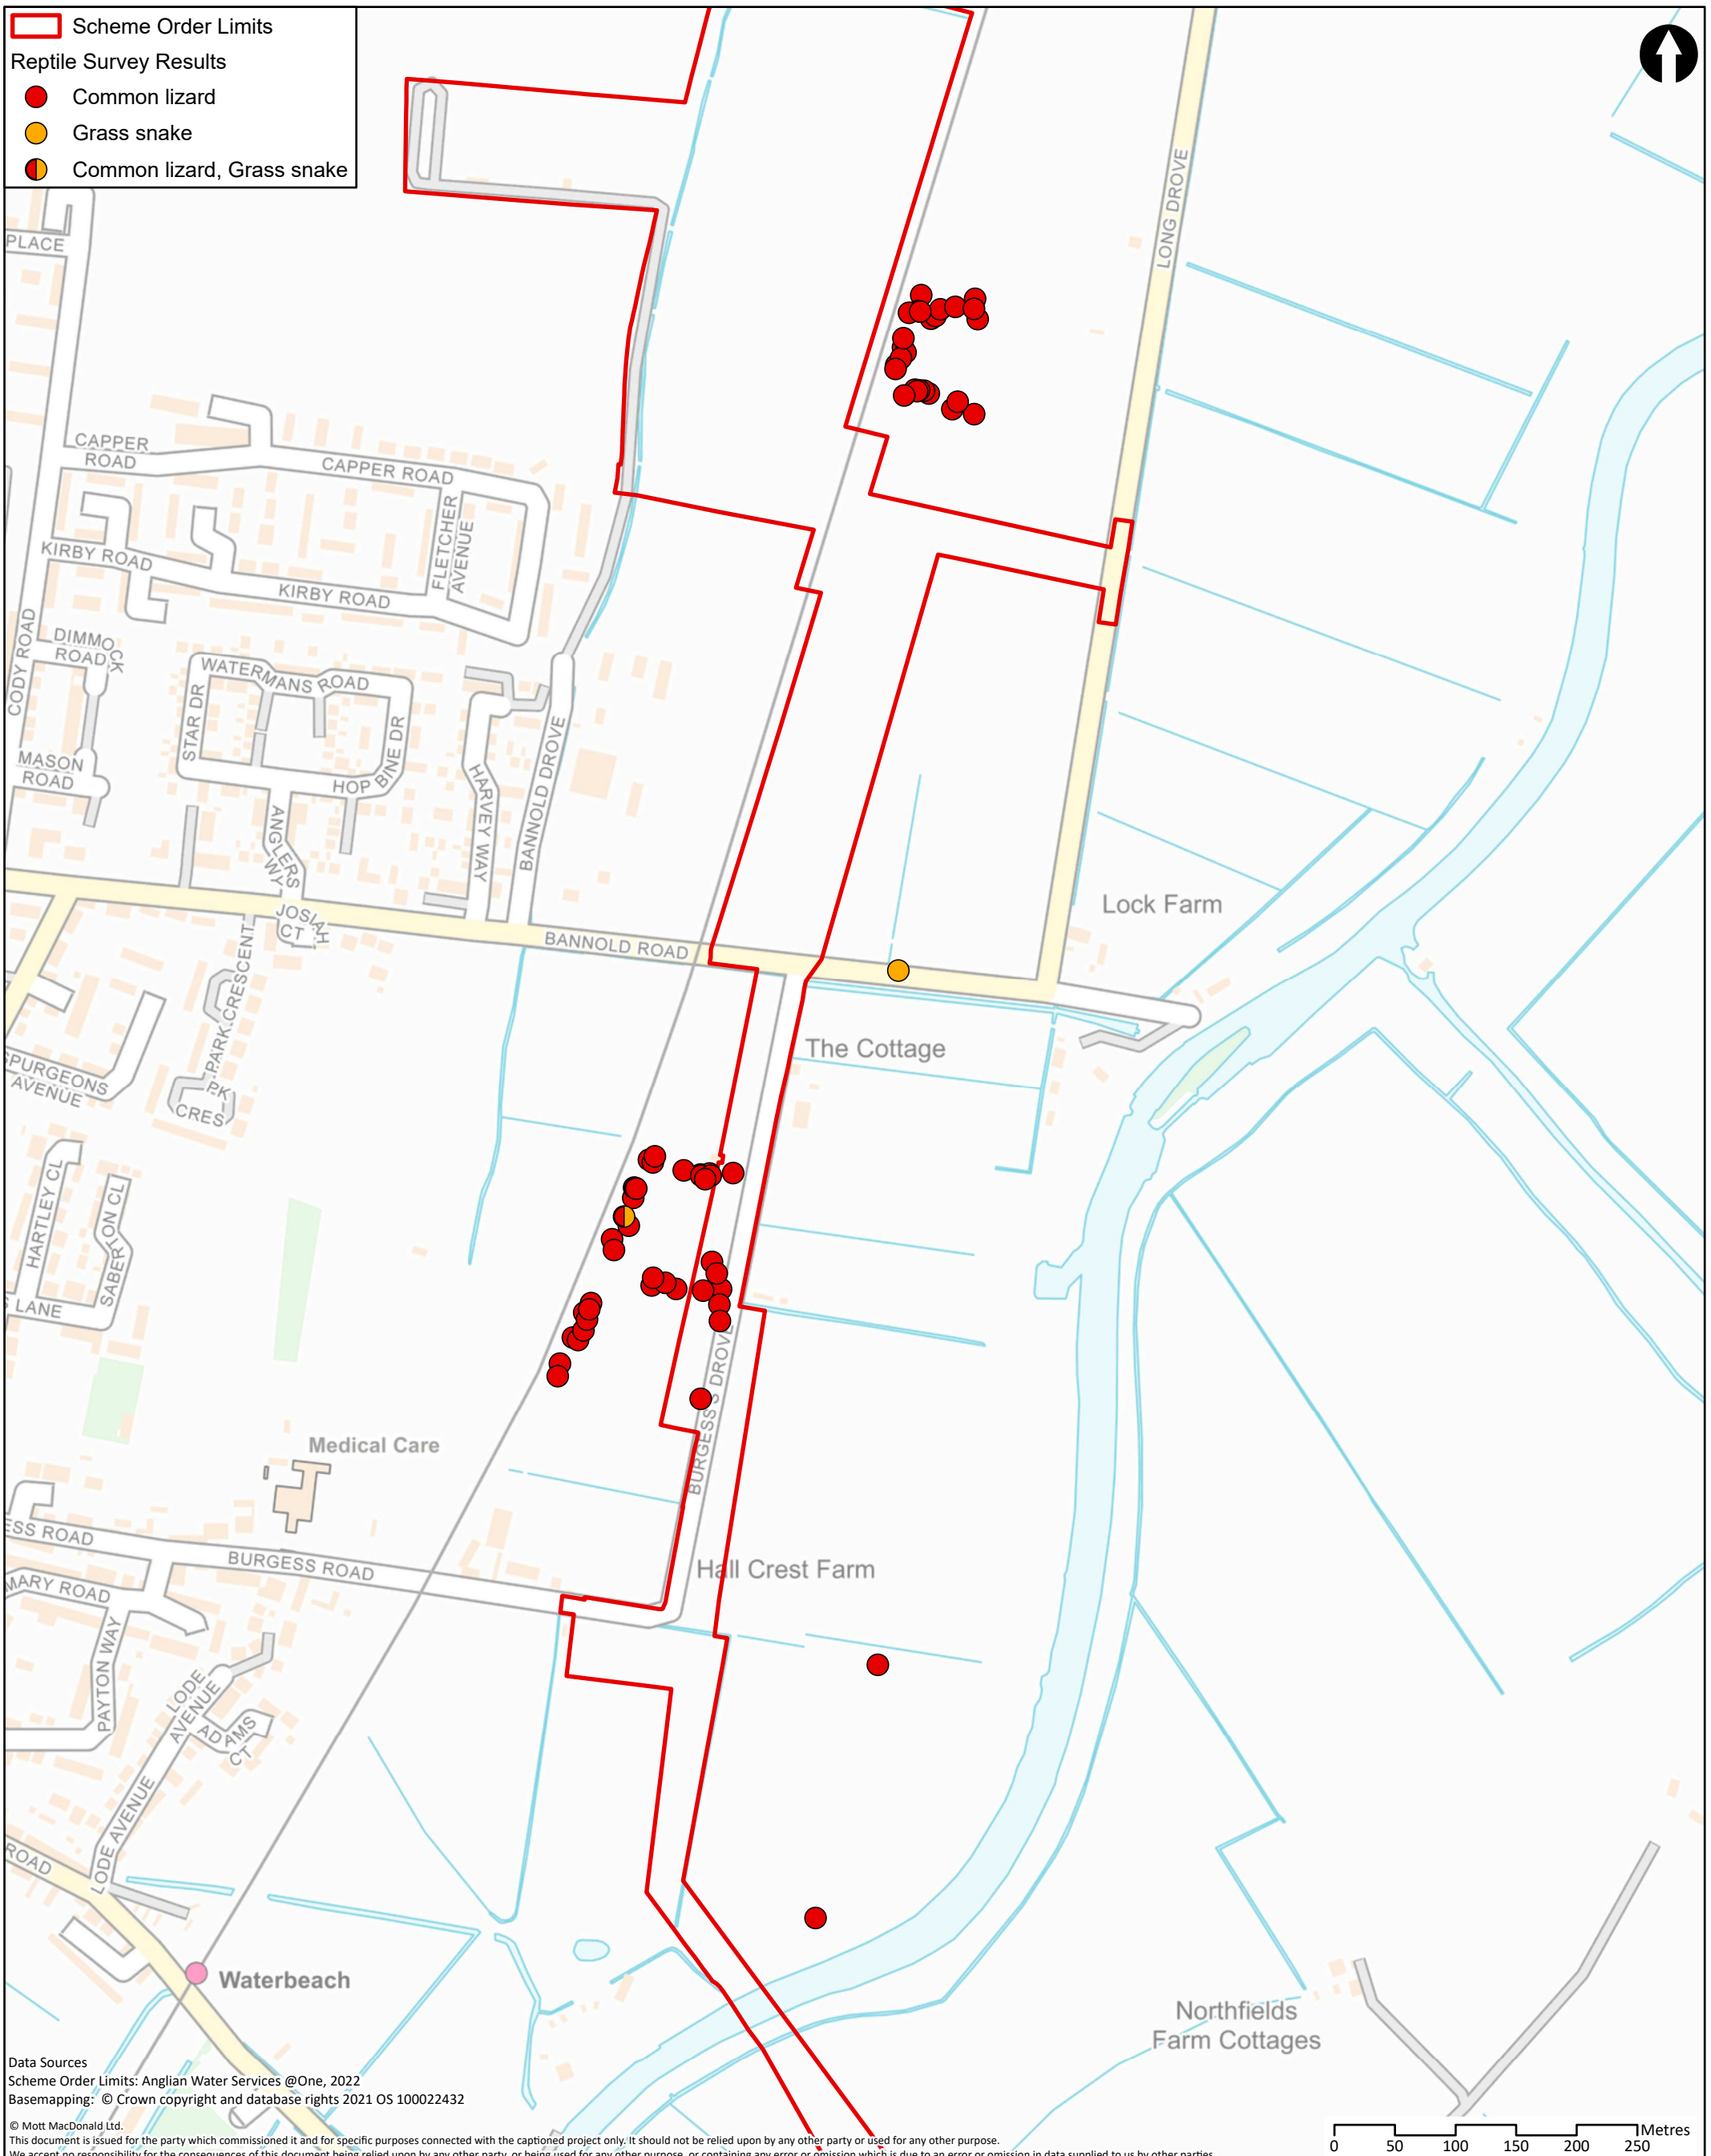

Data Sources  
 Scheme Order Limits: Anglian Water Services @One, 2022  
 Basemapping: © Crown copyright and database rights 2021 OS 100022432  
 © Mott MacDonald Ltd.  
 This document is issued for the party which commissioned it and for specific purposes connected with the captioned project only. It should not be relied upon by any other party or used for any other purpose.  
 We accept no responsibility for the consequences of this document being relied upon by any other party, or being used for any other purpose, or containing any error or omission which is due to an error or omission in data supplied to us by other parties.

**M M**  
**MOTT MACDONALD**

22 Station Road  
 Cambridge CB1 2JD  
 United Kingdom

T +44 (0)20 8774 2000  
 F +44 (0)20 8681 5706  
 W mottmac.com

Client

**love every drop**  
**anglianwater**

Rev	Date	Drawn	Description	Ch'k'd	App'd
P1	10/11/22	AW	First Draft	AW	CS

Title


Cambridge Waste Water Treatment Plant  
 Relocation Project  
 Reptiles  
 Survey results - Sheet 3

Drawing Number

Figure 8.38

Drawn	AW	
Checked	AW	
Approved	CS	
Scale at A3 1:5,000		
Security	Status	Rev
STD	PRE	P1



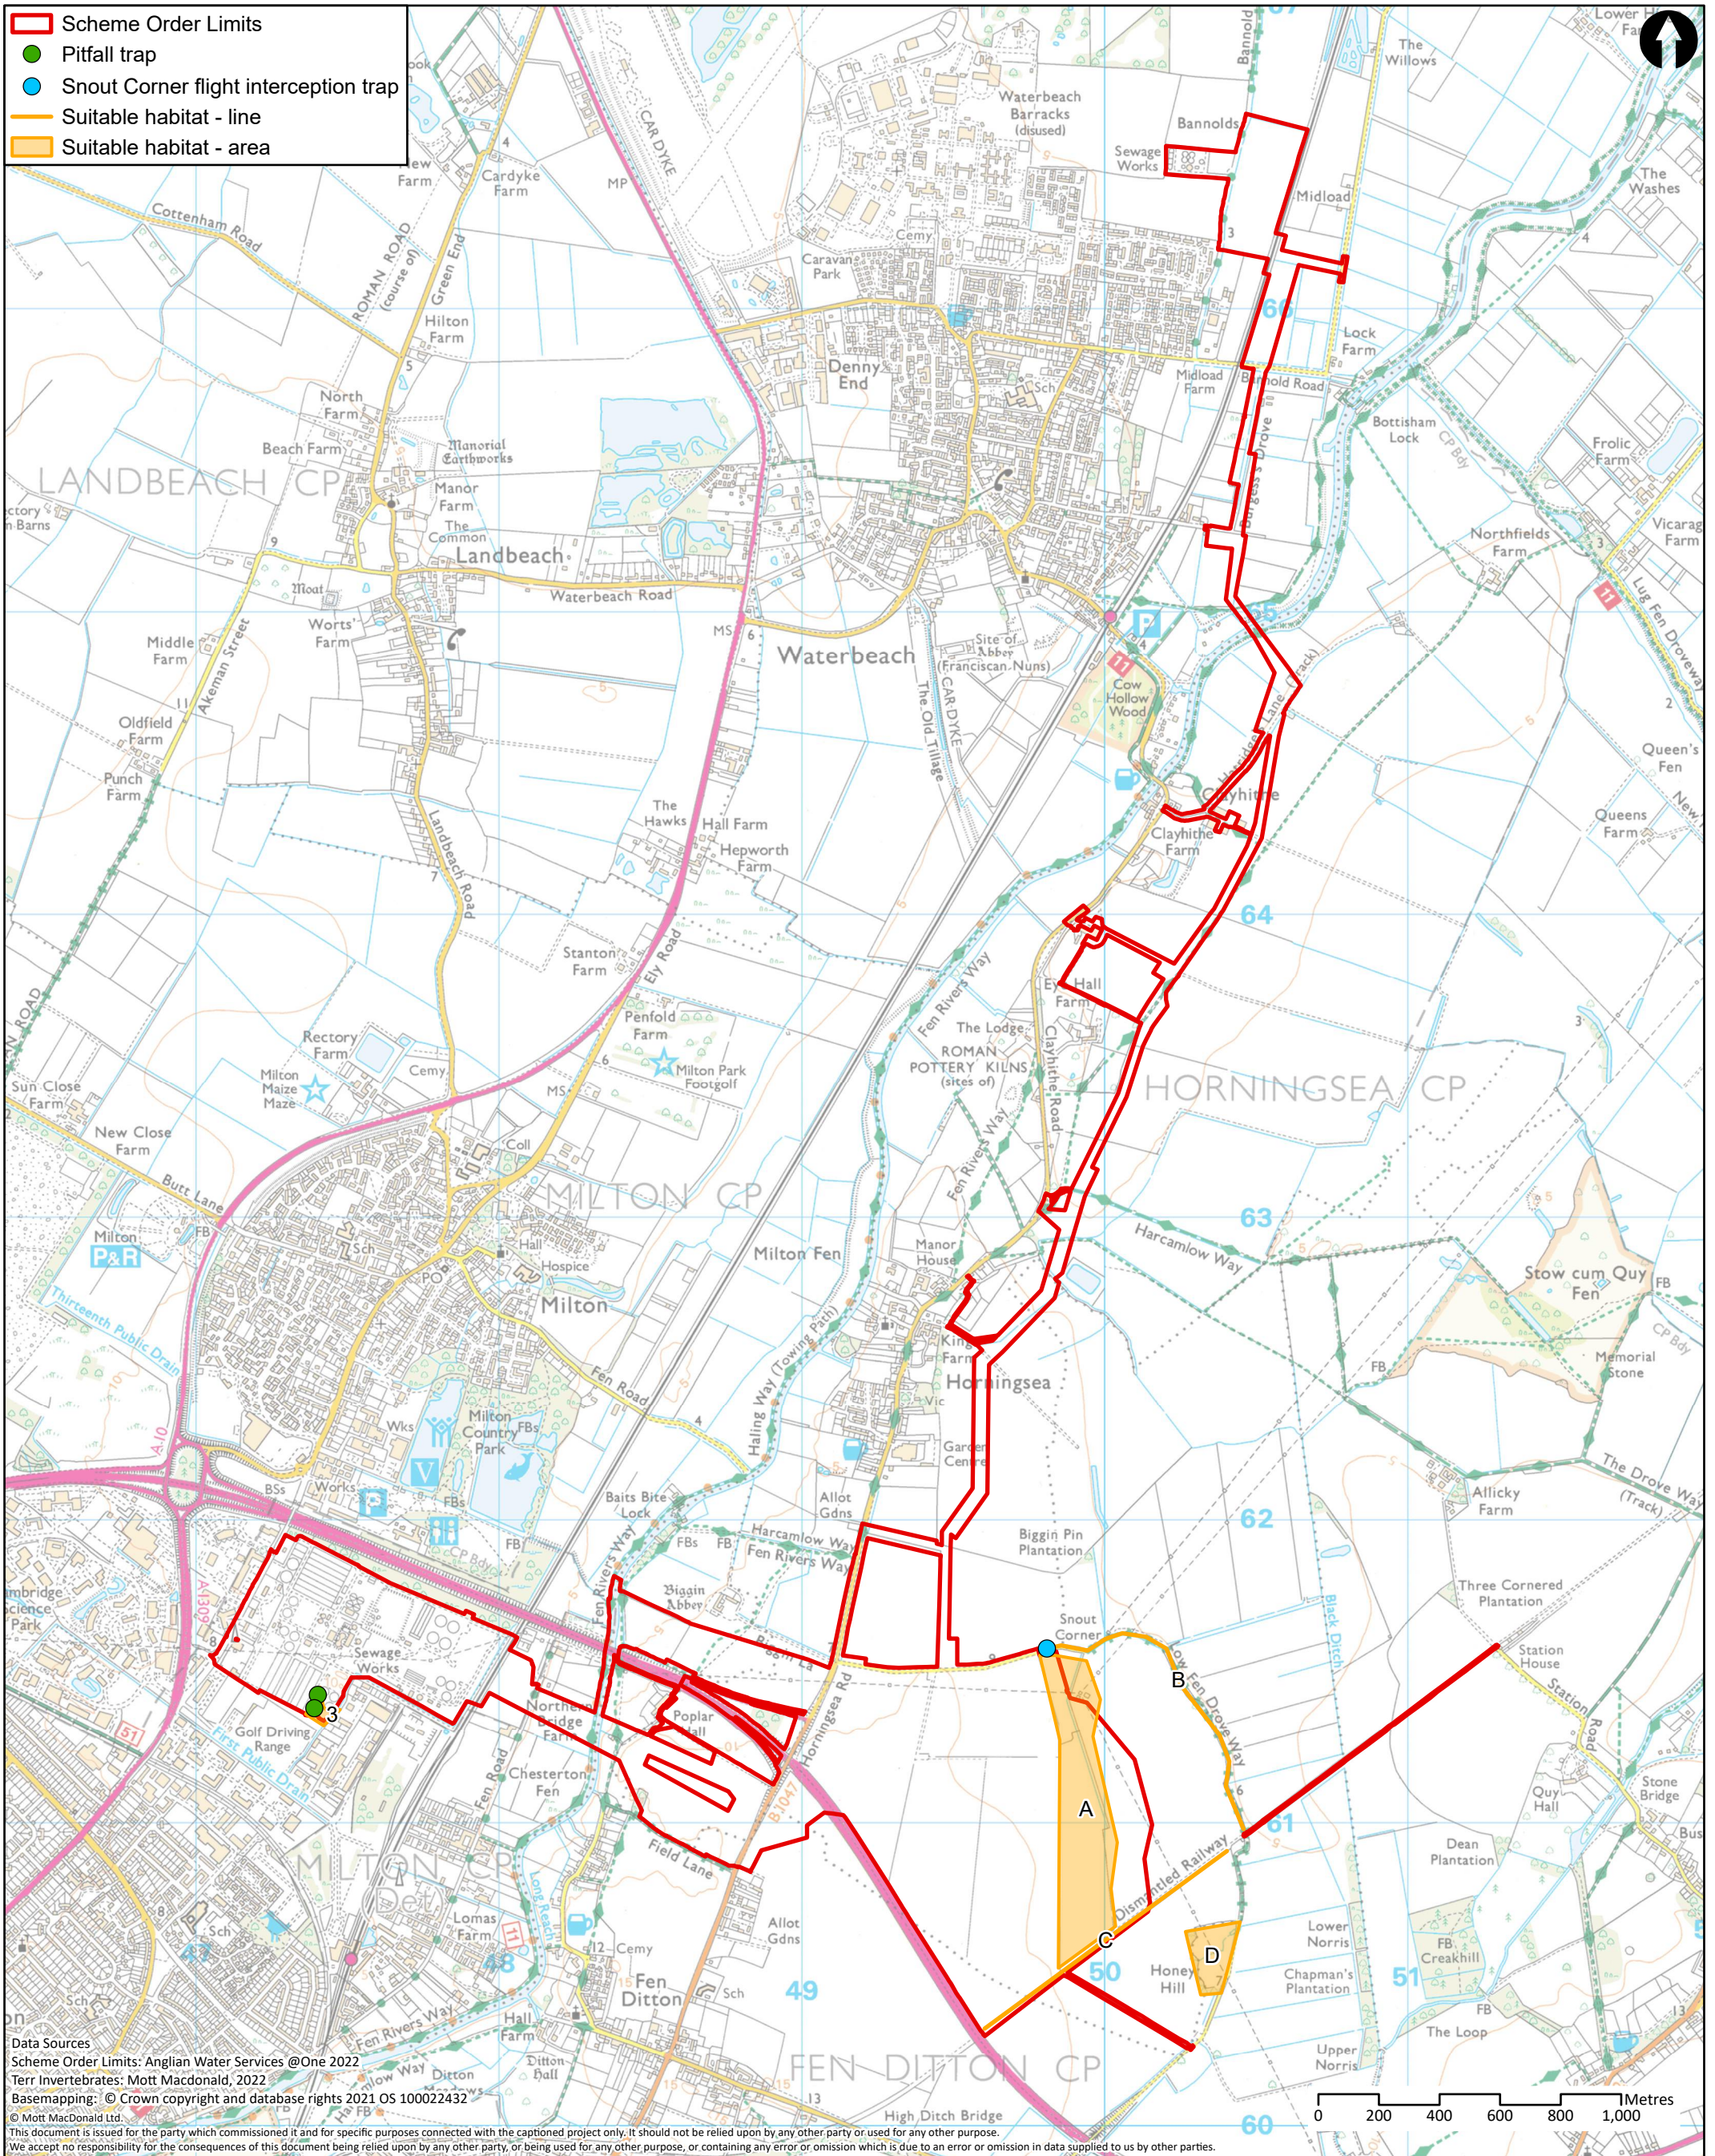

<p><b>MOTT MACDONALD</b></p> <p>22 Station Road Cambridge CB1 2JD United Kingdom</p> <p>T +44 (0)20 8774 2000 F +44 (0)20 8681 5706 W mottmac.com</p>	<p>Client</p>					<p>Title</p> <p>Cambridge Waste Water Treatment Plant Relocation Project - Terrestrial Invertebrates - Targeted survey sites within the existing WWTP and suitable areas adjacent to the proposed WWTP</p>			Drawn	KL												
	<table border="1"> <thead> <tr> <th>Rev</th> <th>Date</th> <th>Drawn</th> <th>Description</th> <th>Ch'k'd</th> <th>App'd</th> </tr> </thead> <tbody> <tr> <td>P1</td> <td>31/10/22</td> <td>KL</td> <td>First Draft</td> <td>AW</td> <td>CS</td> </tr> </tbody> </table>					Rev	Date	Drawn	Description	Ch'k'd	App'd	P1	31/10/22	KL	First Draft	AW	CS	<p>Drawing Number</p> <p>Figure 8.39</p>			Checked	AW
	Rev	Date	Drawn	Description	Ch'k'd	App'd																
P1	31/10/22	KL	First Draft	AW	CS																	
					<p>Approved</p> <p>CS</p>			Scale at A3	1:20,000													
								Security	Status	Rev												
								STD	PRE	P1												





22 Station Road  
Cambridge CB1 2JD  
United Kingdom

T +44 (0)20 8774 2000  
F +44 (0)20 8681 5706  
W mottmac.com

Client



Title

Cambridge Waste Water Treatment Plant  
Relocation Project

Bats

All trees from the study area (Scheme Order  
Limits + 100m) with moderate or high potential  
to have roosting bats


Drawn	AW	
Checked	AW	
Approved	CS	
Scale at A3 1:20,000		
Security	Status	Rev
STD	PRE	P3

Rev	Date	Drawn	Description	Ch'k'd	App'd
P2	18/01/23	AW	For Information	AW	JM
P3	21/09/23	JC	For Information	AW	CS

Drawing Number

Figure 8.40



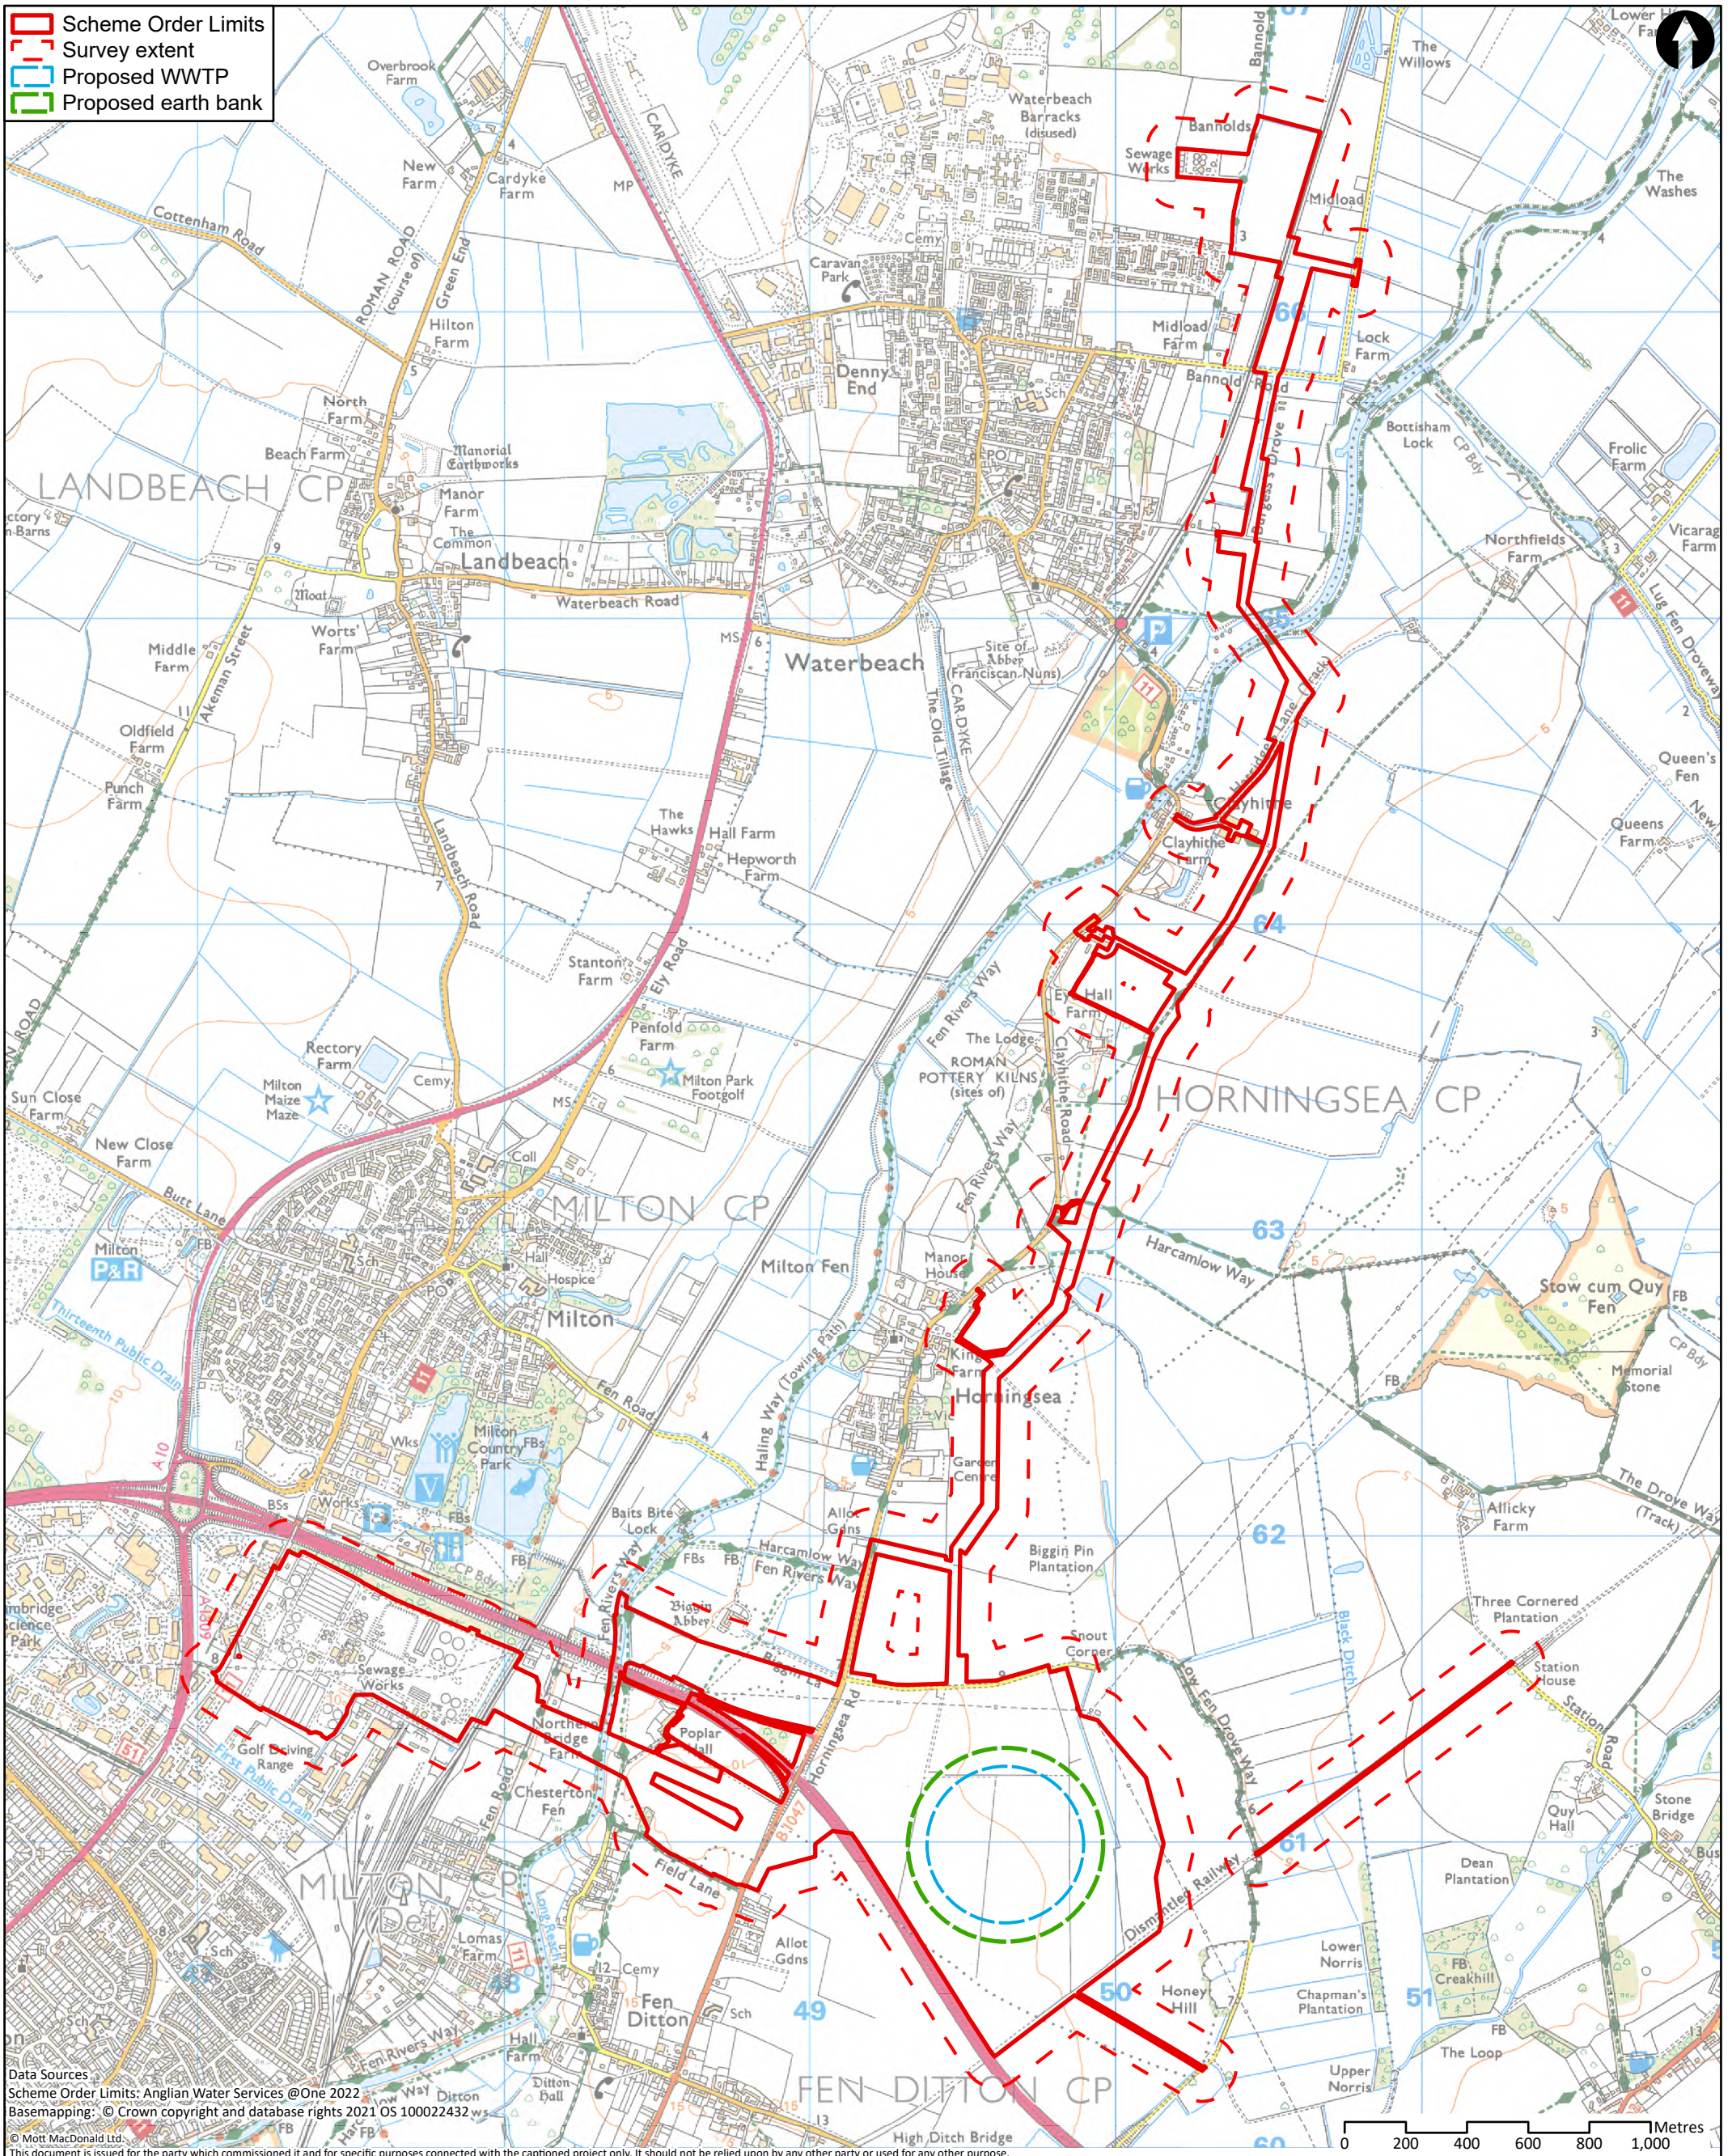

Data Sources  
 Scheme Order Limits: Anglian Water Services @One 2022  
 Basemapping: © Crown copyright and database rights 2021 OS 100022432  
 © Mott MacDonald Ltd.  
 This document is issued for the party which commissioned it and for specific purposes connected with the captioned project only. It should not be relied upon by any other party or used for any other purpose.  
 We accept no responsibility for the consequences of this document being relied upon by any other party, or being used for any other purpose, or containing any error or omission which is due to an error or omission in data supplied to us by other parties.

**M M**  
**MOTT MACDONALD**

22 Station Road  
 Cambridge CB1 2JD  
 United Kingdom

T +44 (0)20 8774 2000  
 F +44 (0)20 8681 5706  
 W mottmac.com

Client					
Rev	Date	Drawn	Description	Ch'k'd	App'd
P2	21/11/22	AW	For Information	AW	JM
P3	20/09/23	JC	For Information	AW	CS

Title  
 Cambridge Waste Water Treatment Plant  
 Relocation Project  
 Bats  
 Survey area for bats

Drawing Number  
 Figure 8.41

Drawn	AW	
Checked	AW	
Approved	CS	
Scale at A3 1:20,000		
Security	Status	Rev
STD	PRE	P3





22 Station Road  
Cambridge CB1 2JD  
United Kingdom

T +44 (0)20 8774 2000  
F +44 (0)20 8681 5706  
W mottmac.com

Client



Title


Cambridge Waste Water Treatment Plant  
Relocation Project  
Bats  
Confirmed roosts within survey area

Drawn	AW	
Checked	AW	
Approved	CS	
Scale at A3 1:20,000		
Security	Status	Rev
STD	PRE	P3

Rev	Date	Drawn	Description	Ch'k'd	App'd
P2	21/11/22	AW	Second Draft	AW	JM
P3	20/09/23	JC	First Revision	AW	CS

Drawing Number	Figure 8.42
----------------	-------------



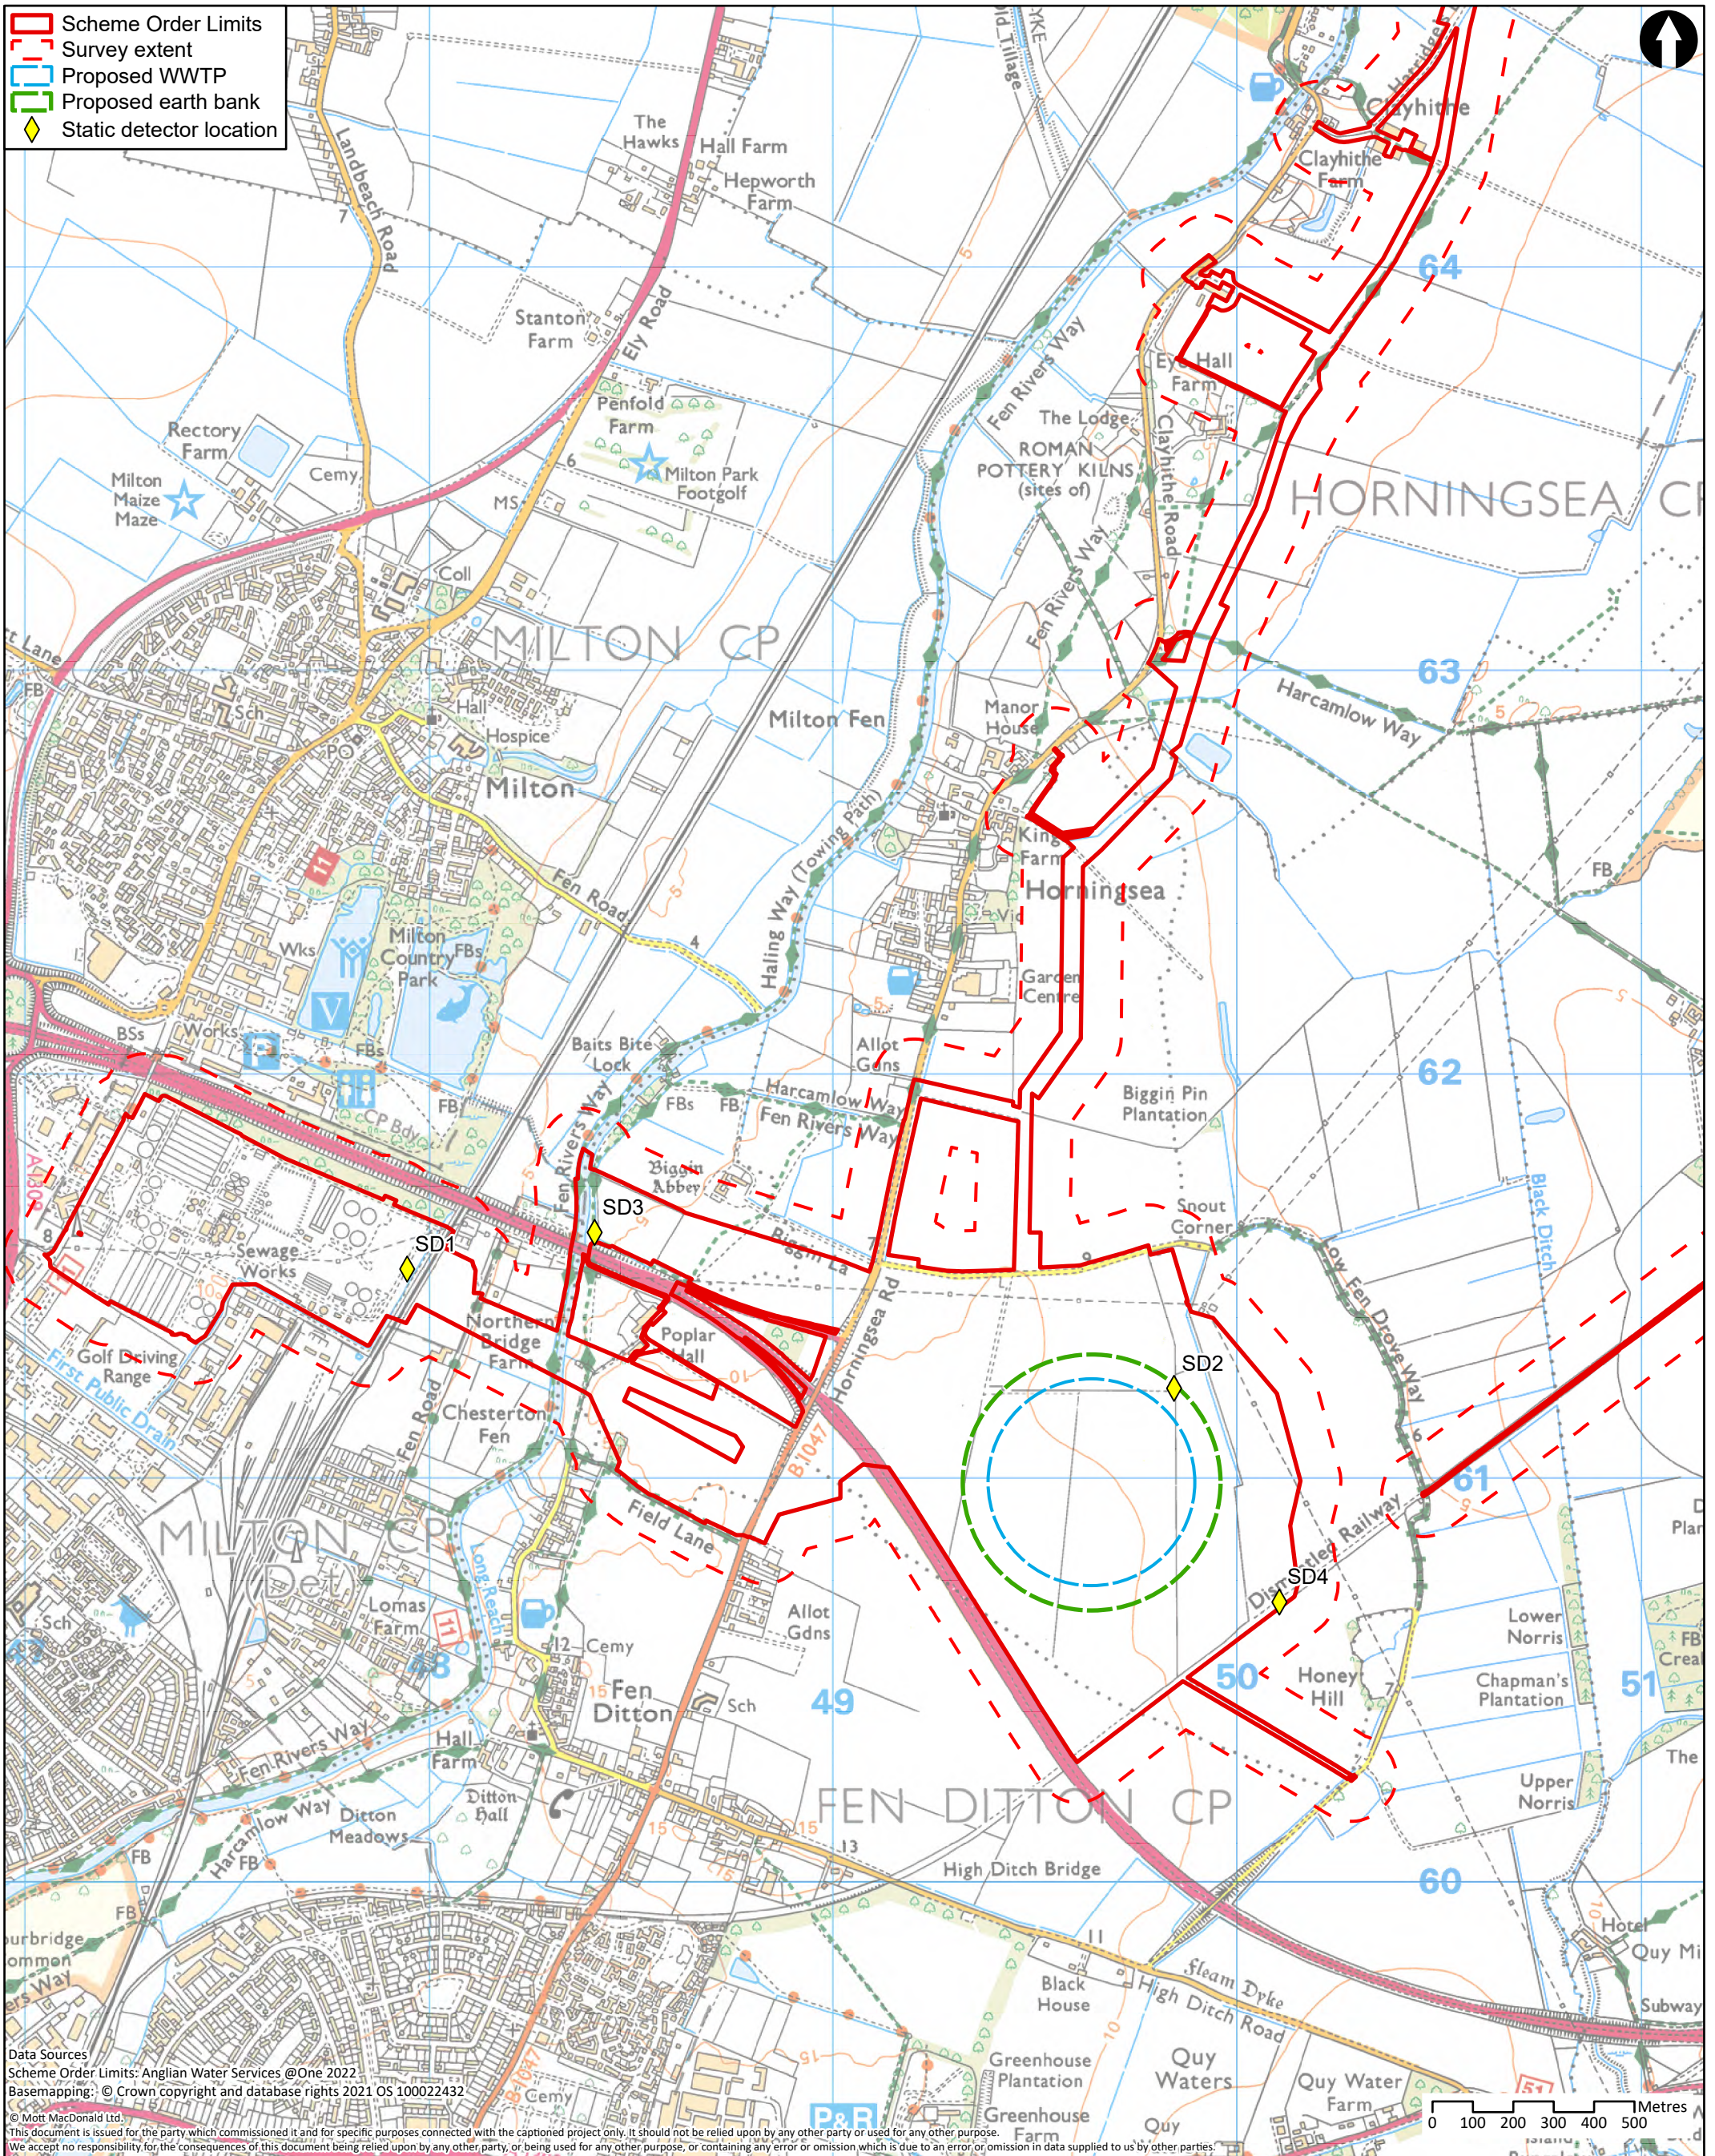

Data Sources  
 Scheme Order Limits: Anglian Water Services @One 2022  
 Basemapping: © Crown copyright and database rights 2021 OS 10002432  
 © Mott MacDonald Ltd.  
 This document is issued for the party which commissioned it and for specific purposes connected with the captioned project only. It should not be relied upon by any other party or used for any other purpose.  
 We accept no responsibility for the consequences of this document being relied upon by any other party, or being used for any other purpose, or containing any error or omission which is due to an error or omission in data supplied to us by other parties.

**M**  
**MOTT**  
**MACDONALD**

22 Station Road  
 Cambridge CB1 2JD  
 United Kingdom

T +44 (0)20 8774 2000  
 F +44 (0)20 8681 5706  
 W mottmac.com


Client					
Rev	Date	Drawn	Description	Ch'k'd	App'd
P1	21/11/22	AW	First Draft	AW	JM
P2	20/09/23	JC	For Information	AW	CS

Title  
 Cambridge Waste Water Treatment Plant  
 Relocation Project  
 Bats  
 Static detector locations

Drawing Number  
 Figure 8.43

Drawn	AW	
Checked	AW	
Approved	CS	
Scale at A3	1:15,000	
Security	Status	Rev
STD	PRE	P2



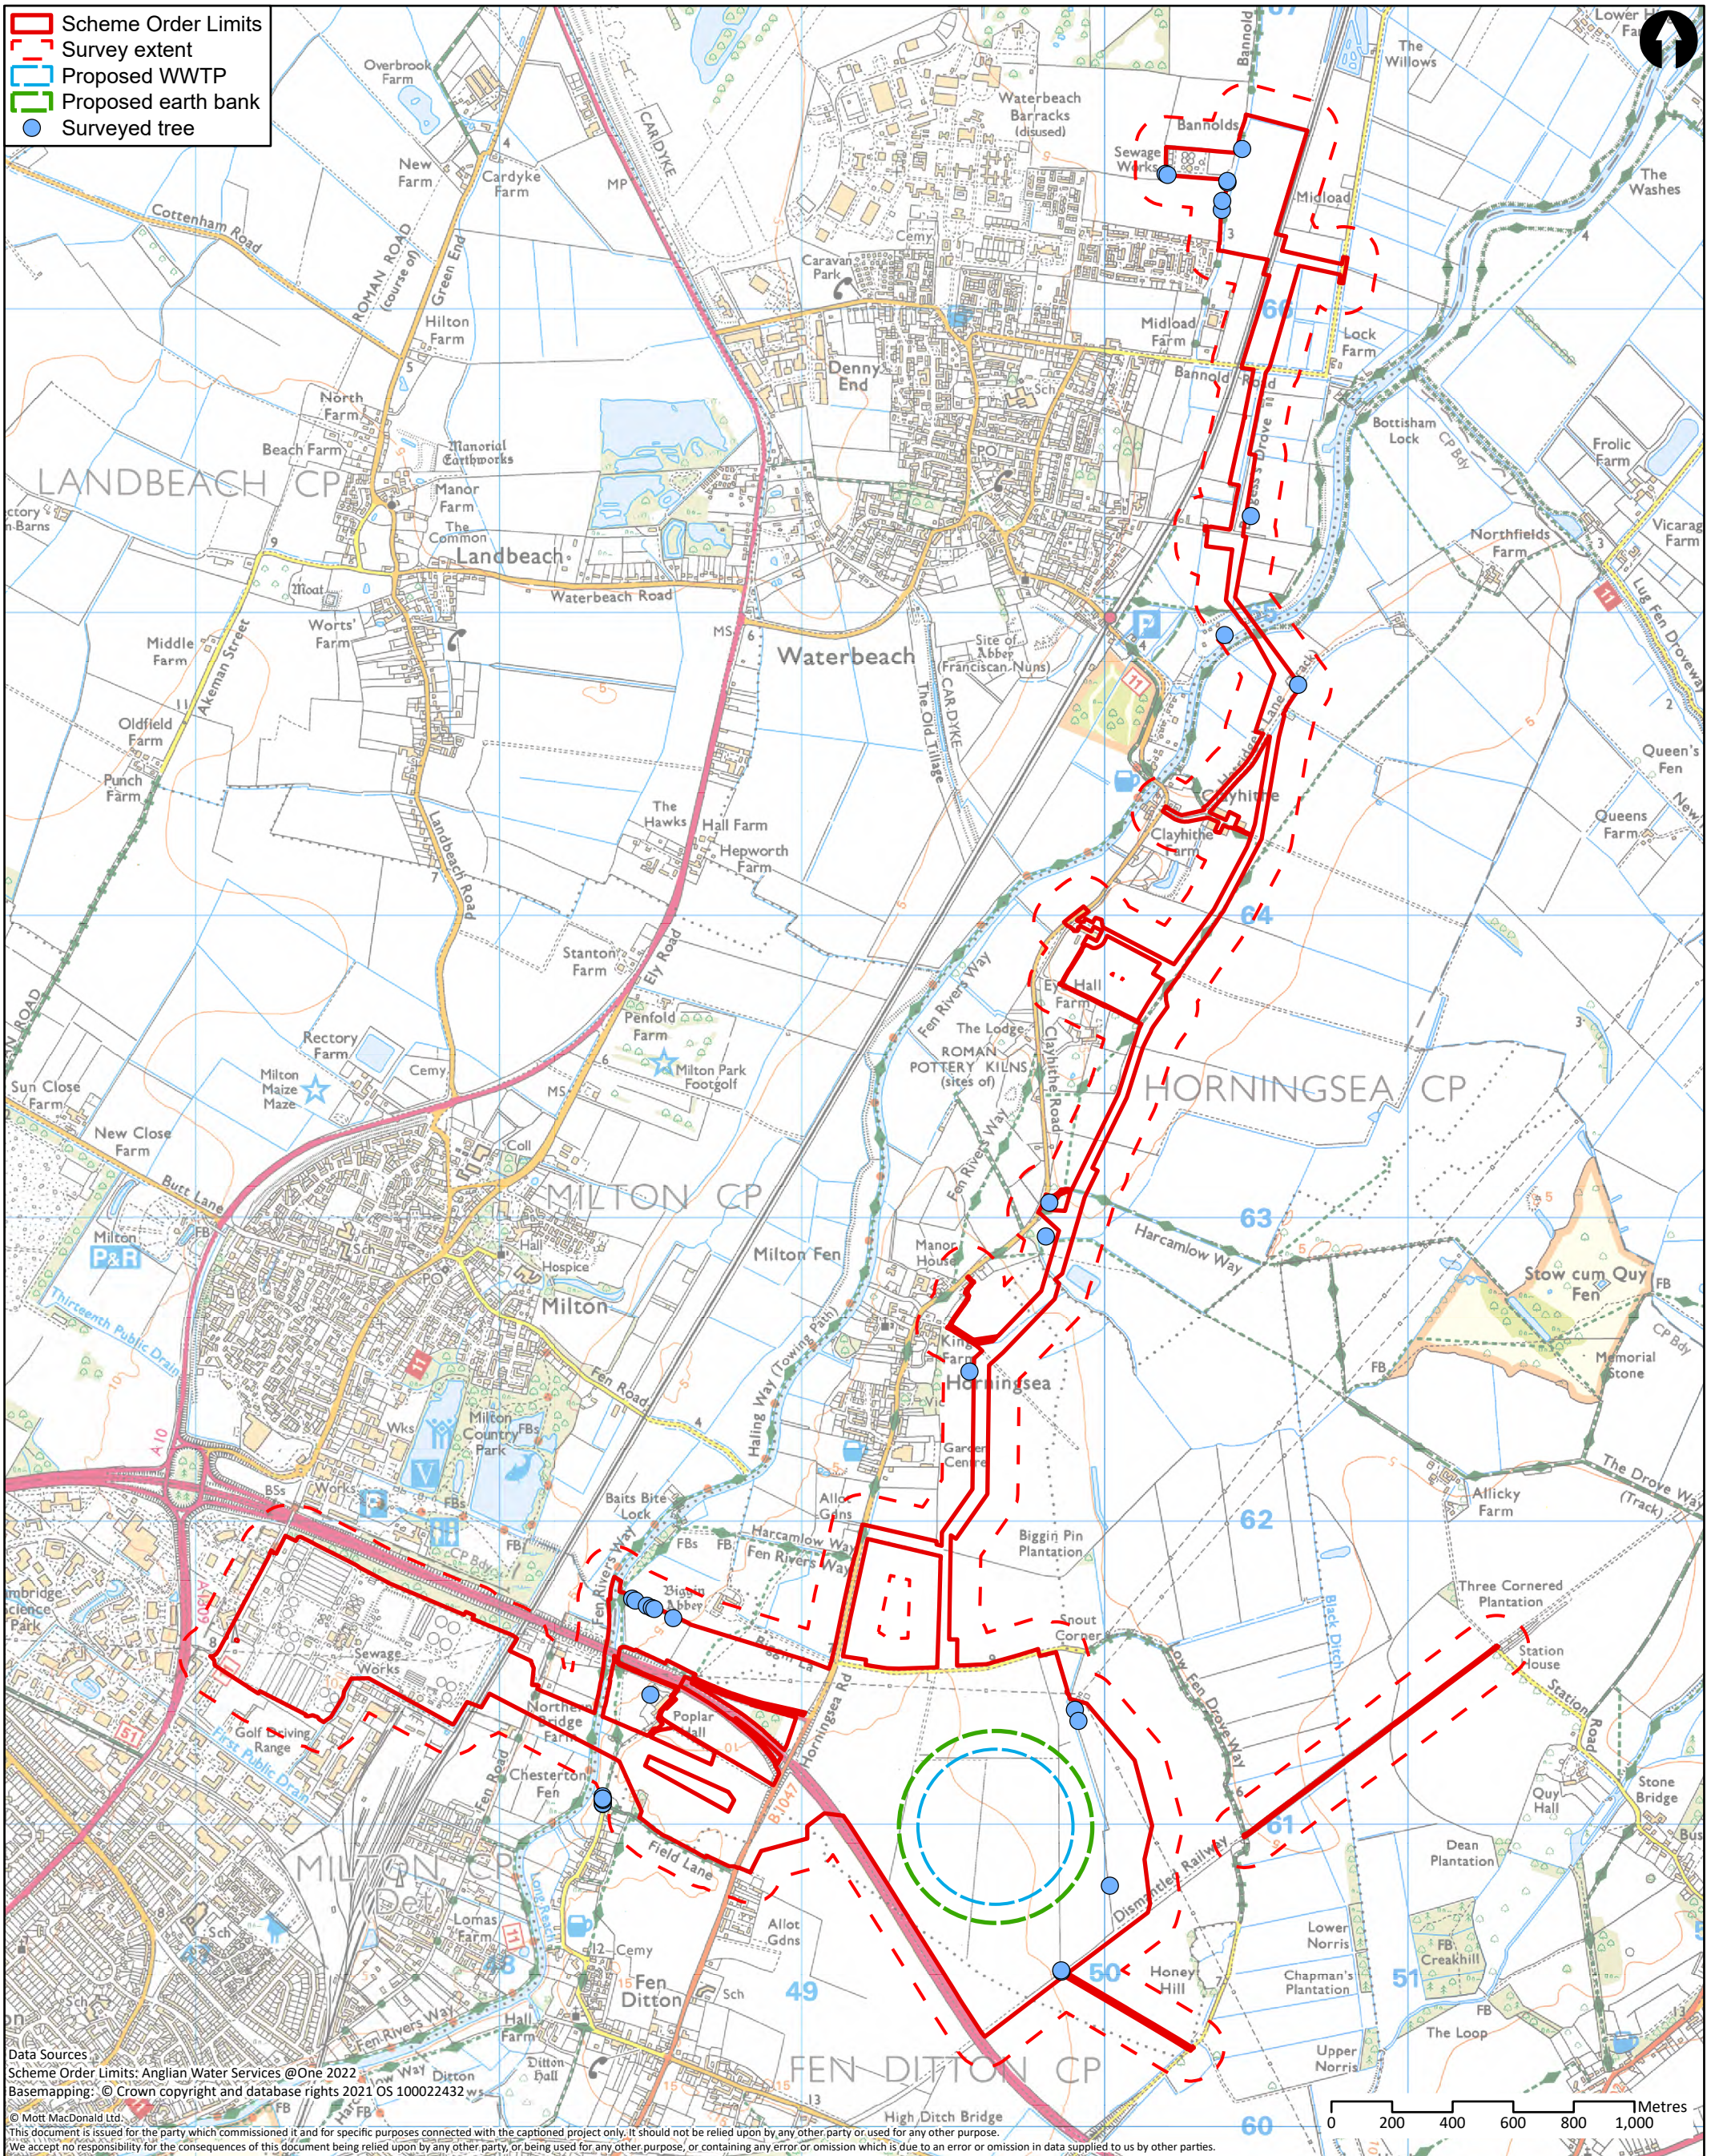

Data Sources  
 Scheme Order Limits: Anglian Water Services @One 2022  
 Basemapping: © Crown copyright and database rights 2021 OS 100022432  
 © Mott MacDonald Ltd.  
 This document is issued for the party which commissioned it and for specific purposes connected with the captioned project only. It should not be relied upon by any other party or used for any other purpose.  
 We accept no responsibility for the consequences of this document being relied upon by any other party, or being used for any other purpose, or containing any error or omission which is due to an error or omission in data supplied to us by other parties.

**M M**  
**MOTT MACDONALD**

22 Station Road  
 Cambridge CB1 2JD  
 United Kingdom

T +44 (0)20 8774 2000  
 F +44 (0)20 8681 5706  
 W mottmac.com


Client					
Rev	Date	Drawn	Description	Ch'k'd	App'd
P2	21/11/22	AW	For Information	AW	JM
P3	21/09/23	JC	For Information	AW	CS

Title  
 Cambridge Waste Water Treatment Plant  
 Relocation Project  
 Bats  
 All of the trees subject to emergence  
 and/or re-entry surveys

Drawing Number  
 Figure 8.44

Drawn	AW	
Checked	AW	
Approved	CS	
Scale at A3	1:20,000	
Security	Status	Rev
STD	PRE	P3




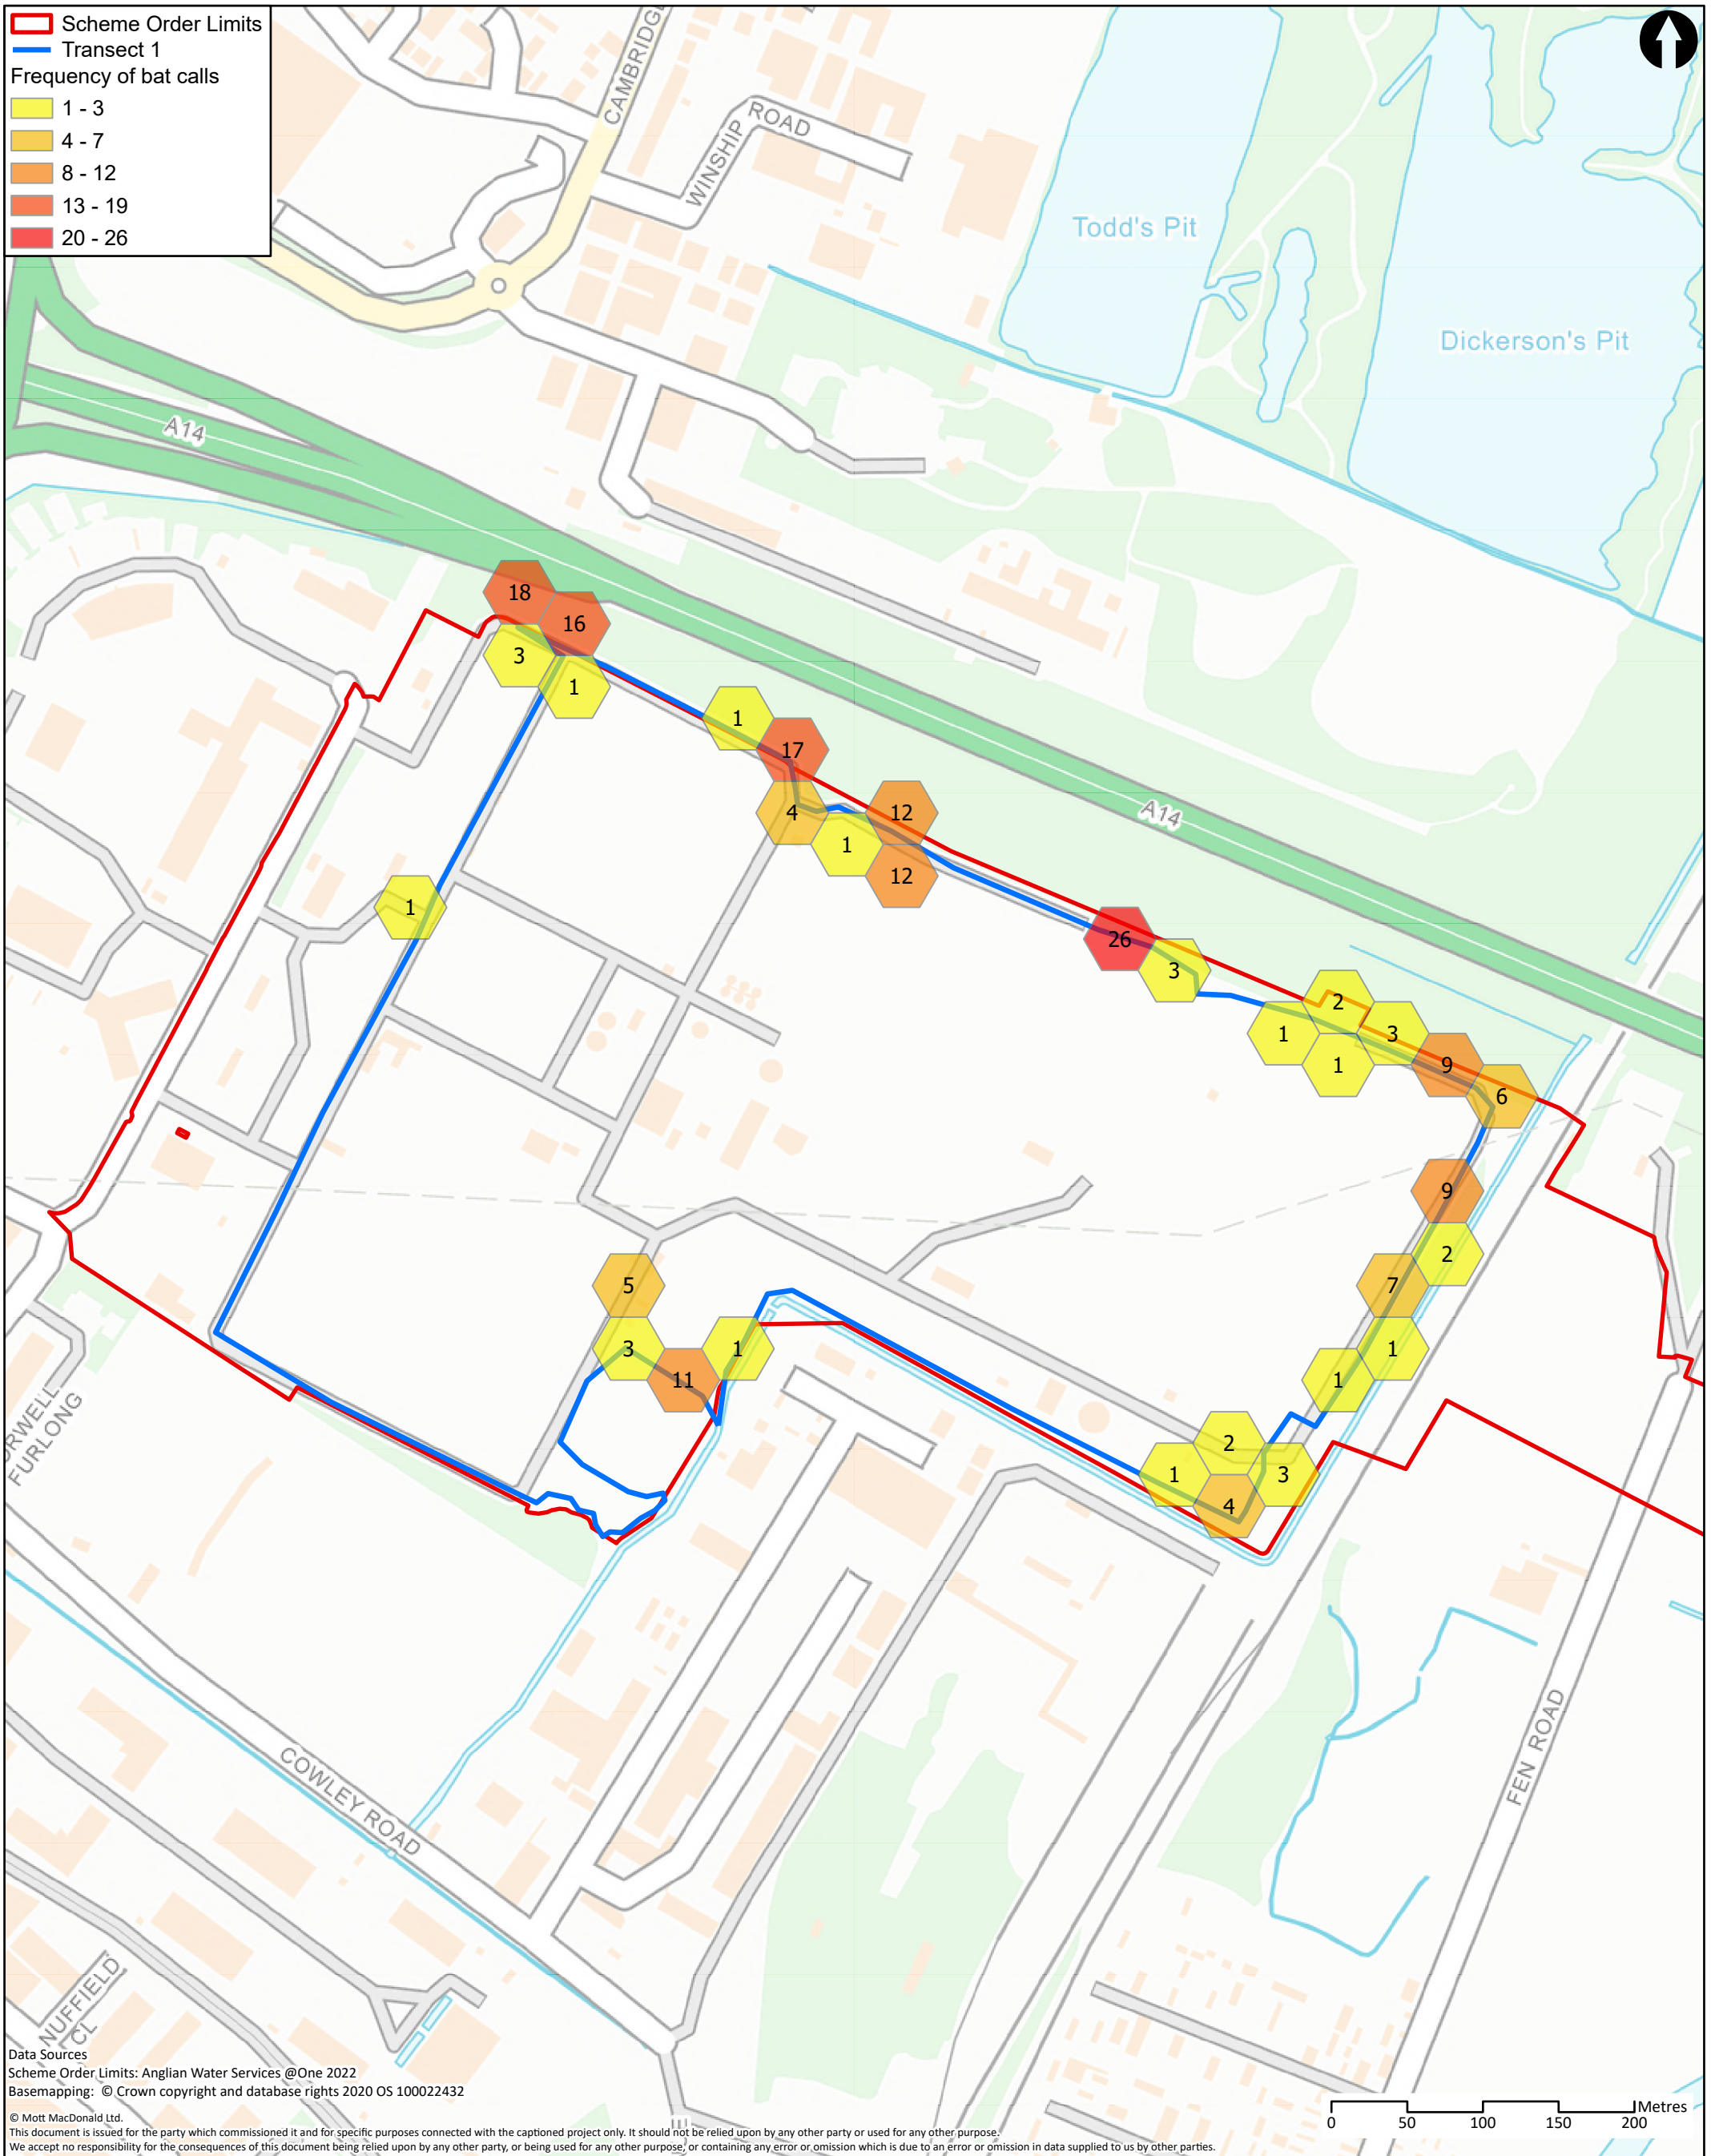

Data Sources  
 Scheme Order Limits: Anglian Water Services @One 2022  
 Basemapping: © Crown copyright and database rights 2020 OS 100022432  
 © Mott MacDonald Ltd.  
 This document is issued for the party which commissioned it and for specific purposes connected with the captioned project only. It should not be relied upon by any other party or used for any other purpose.  
 We accept no responsibility for the consequences of this document being relied upon by any other party, or being used for any other purpose, or containing any error or omission which is due to an error or omission in data supplied to us by other parties.

<p>22 Station Road Cambridge CB1 2JD United Kingdom</p> <p>T +44 (0)20 8774 2000 F +44 (0)20 8681 5706 W mottmac.com</p>	<p>Client</p>					<p>Title</p> <p>Cambridge Waste Water Treatment Plant Relocation Project</p> <p>Bats</p> <p>Route of Transect 1 and call density</p>			Drawn	AW																		
	<table border="1"> <thead> <tr> <th>Rev</th> <th>Date</th> <th>Drawn</th> <th>Description</th> <th>Ch'k'd</th> <th>App'd</th> </tr> </thead> <tbody> <tr> <td>P2</td> <td>28/10/22</td> <td>AW</td> <td>For Information</td> <td>AW</td> <td>JM</td> </tr> <tr> <td>P3</td> <td>20/09/23</td> <td>JC</td> <td>For Information</td> <td>AW</td> <td>CS</td> </tr> </tbody> </table>					Rev	Date	Drawn	Description	Ch'k'd	App'd	P2	28/10/22	AW	For Information	AW	JM	P3	20/09/23	JC	For Information	AW	CS	<p>Drawing Number</p> <p>Figure 8.45</p>			Checked	AW
	Rev	Date	Drawn	Description	Ch'k'd	App'd																						
P2	28/10/22	AW	For Information	AW	JM																							
P3	20/09/23	JC	For Information	AW	CS																							
								Approved	CS																			
								<p>Scale at A3</p> <p>1:4,000</p>																				
								Security	Status	Rev																		
								STD	PRE	P3																		



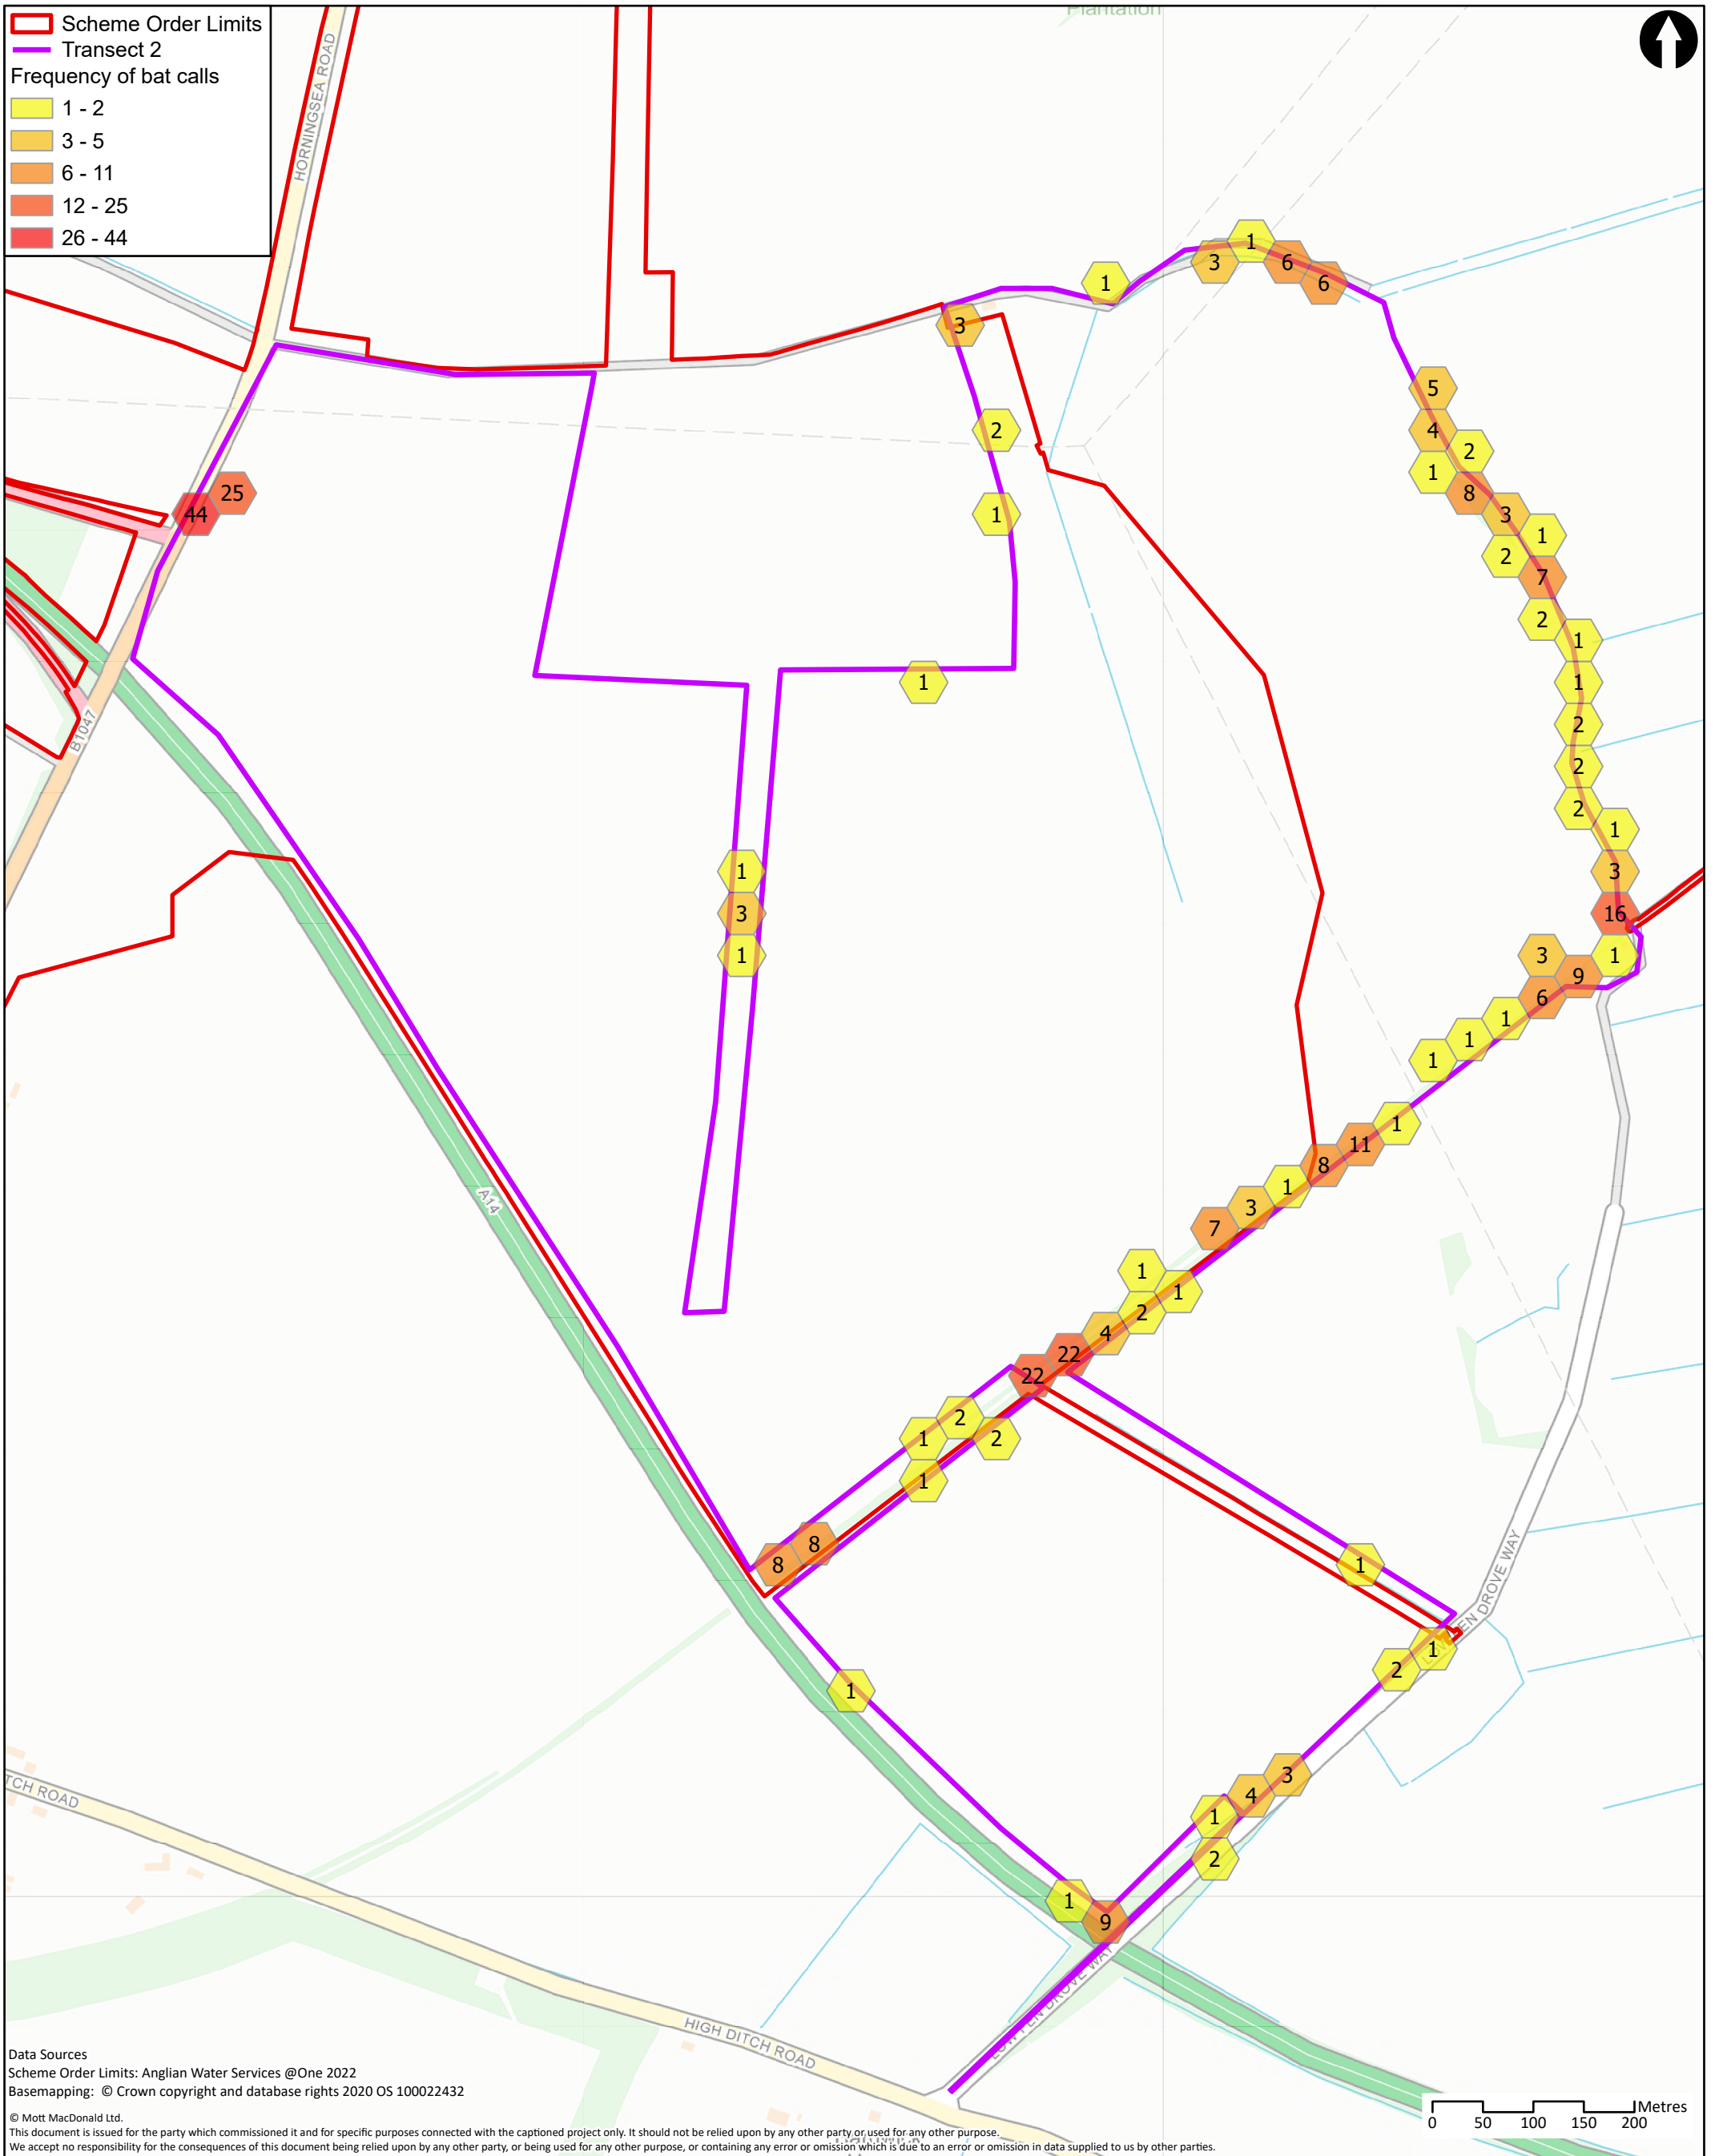


Data Sources  
 Scheme Order Limits: Anglian Water Services @One 2022  
 Basemapping: © Crown copyright and database rights 2020 OS 100022432

© Mott MacDonald Ltd.  
 This document is issued for the party which commissioned it and for specific purposes connected with the captioned project only. It should not be relied upon by any other party, or used for any other purpose.  
 We accept no responsibility for the consequences of this document being relied upon by any other party, or being used for any other purpose, or containing any error or omission which is due to an error or omission in data supplied to us by other parties.

	22 Station Road Cambridge CB1 2JD United Kingdom  T +44 (0)20 8774 2000 F +44 (0)20 8681 5706 W mottmac.com		Client 			Title Cambridge Waste Water Treatment Plant Relocation Project Bats Route of Transect 2 and call density			Drawn	AW
									Checked	AW
									Approved	CS
								Scale at A3 1:6,000		
								Drawing Number Figure 8.46		
								Security	Status	Rev
								STD	PRE	P3




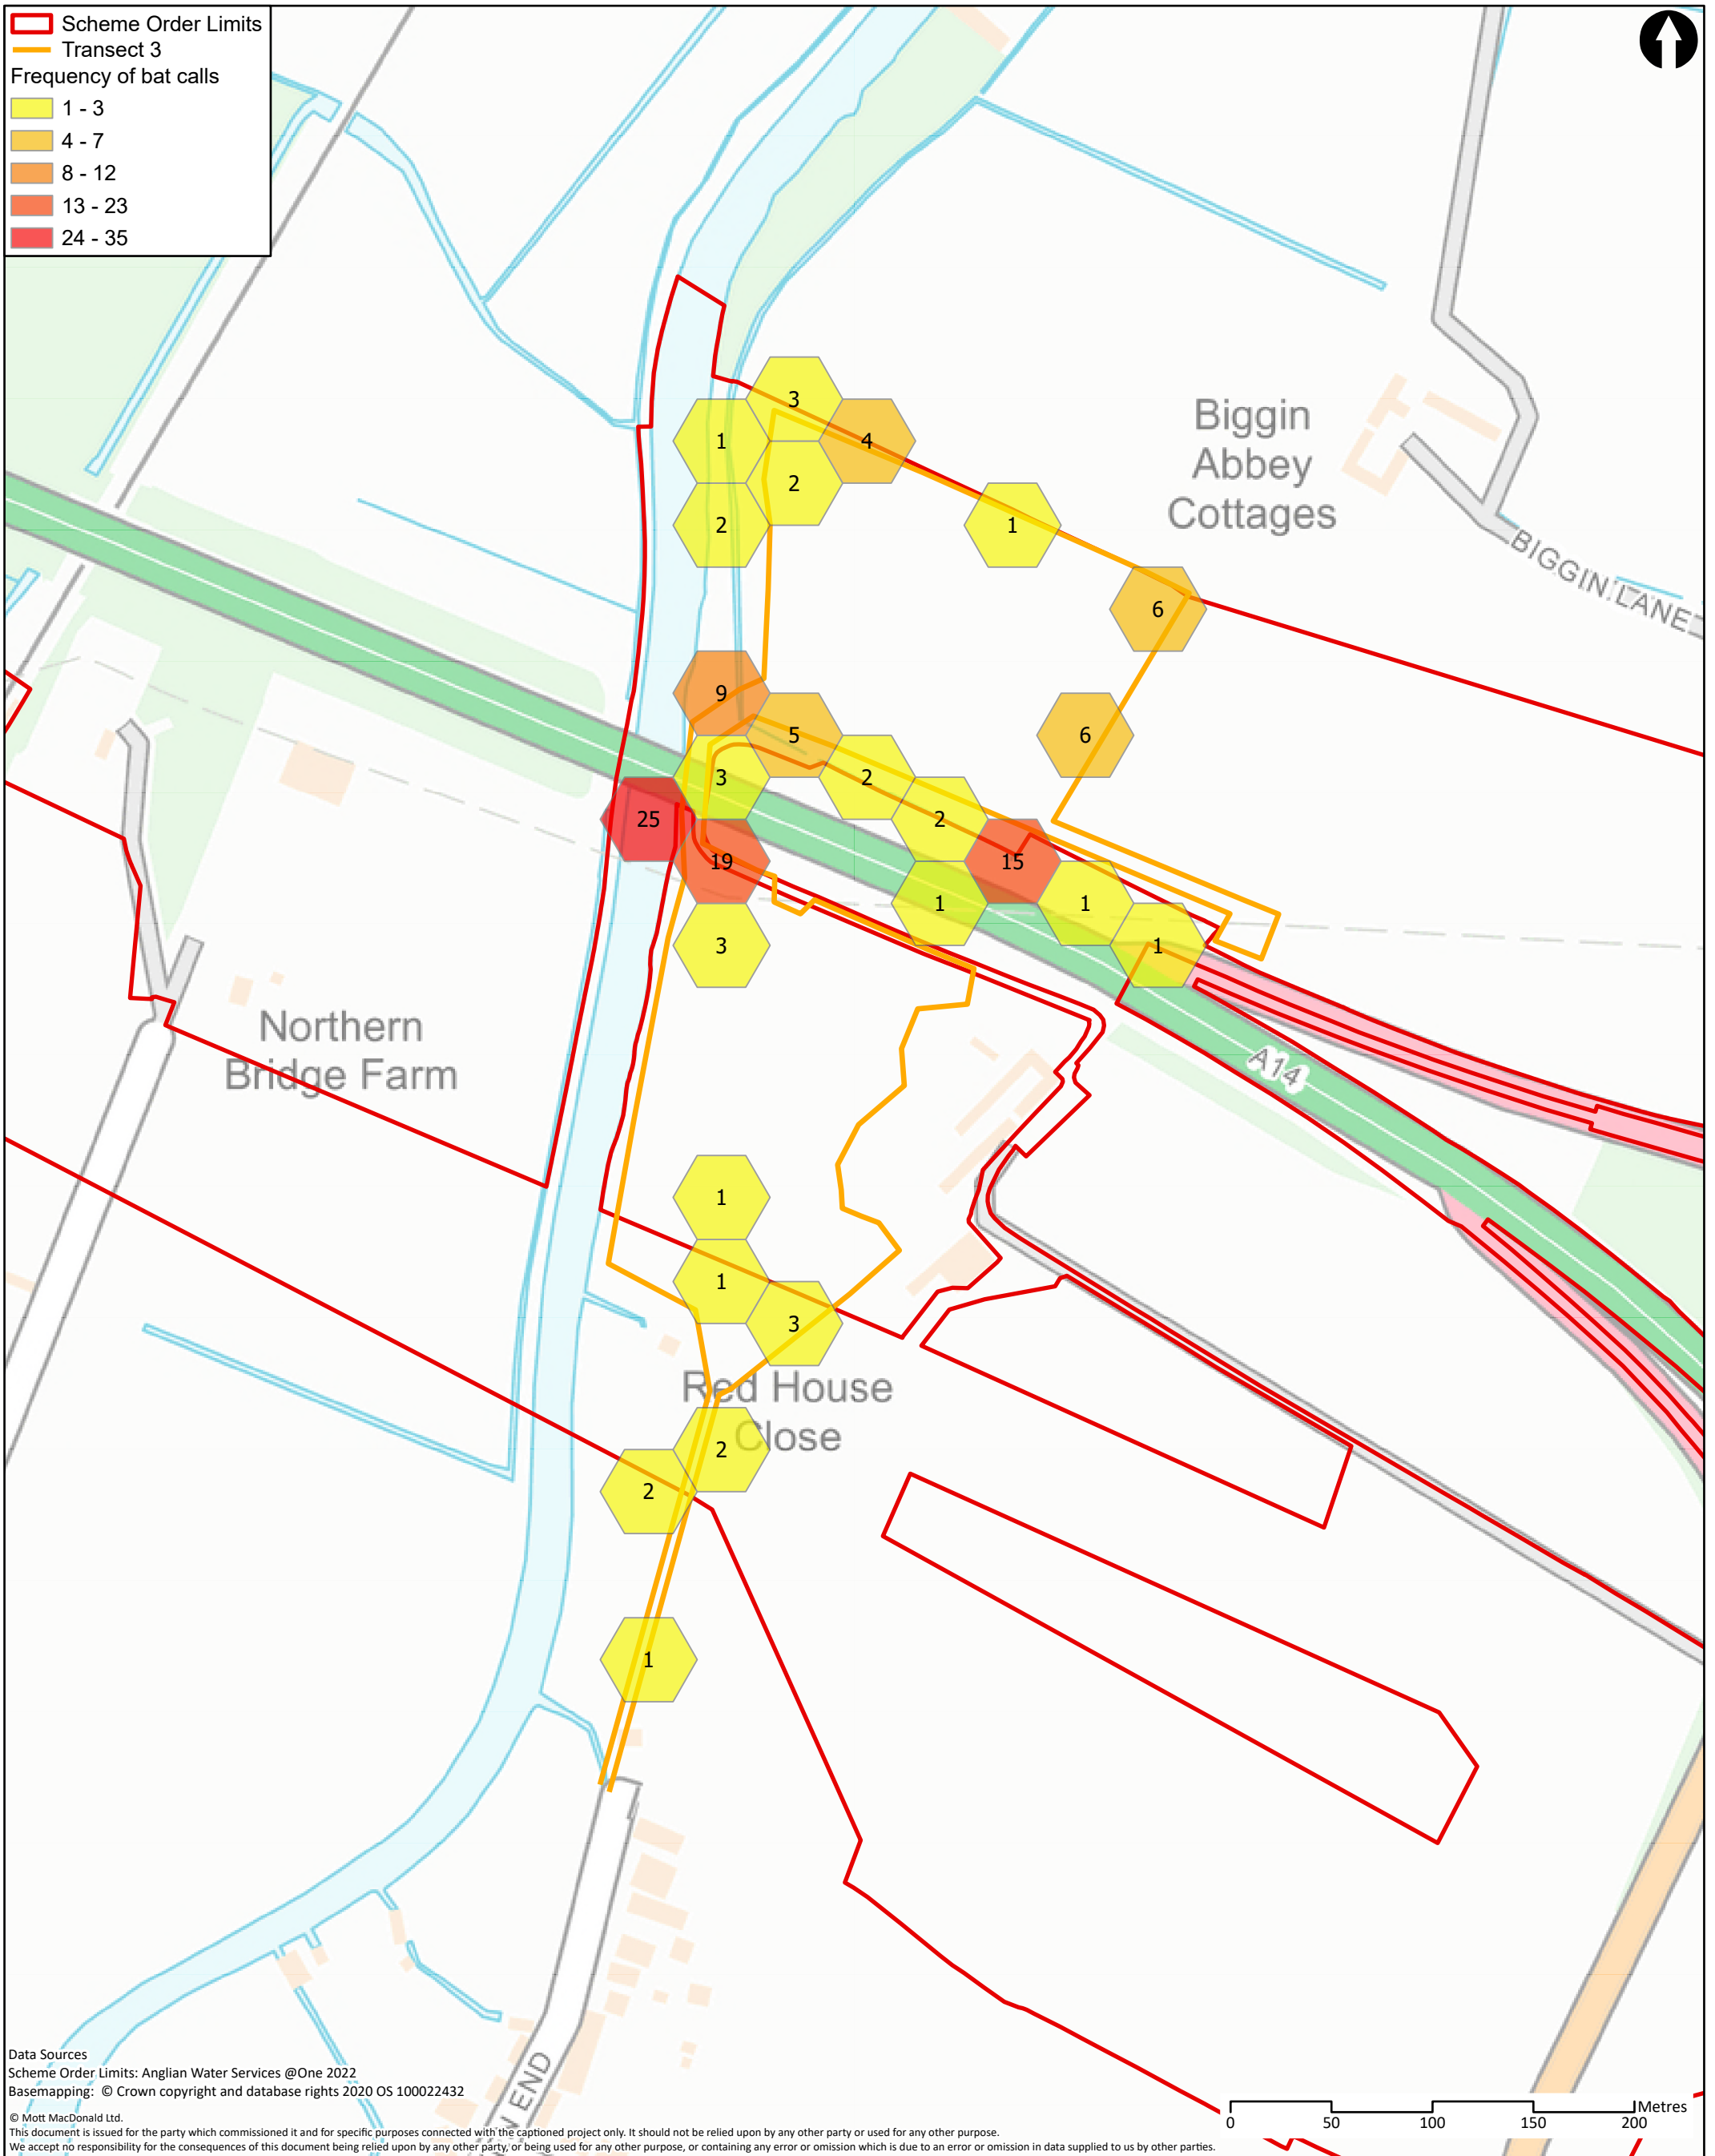

Data Sources  
 Scheme Order Limits: Anglian Water Services @One 2022  
 Basemapping: © Crown copyright and database rights 2020 OS 100022432  
 © Mott MacDonald Ltd.  
 This document is issued for the party which commissioned it and for specific purposes connected with the captioned project only. It should not be relied upon by any other party or used for any other purpose.  
 We accept no responsibility for the consequences of this document being relied upon by any other party, or being used for any other purpose, or containing any error or omission which is due to an error or omission in data supplied to us by other parties.

<p>22 Station Road Cambridge CB1 2JD United Kingdom</p> <p>T +44 (0)20 8774 2000 F +44 (0)20 8681 5706 W mottmac.com</p>	<p>Client</p>					<p>Title</p> <p>Cambridge Waste Water Treatment Plant Relocation Project</p> <p>Bats</p> <p>Route of Transect 3 and call density</p>			Drawn	AW																		
	<table border="1"> <thead> <tr> <th>Rev</th> <th>Date</th> <th>Drawn</th> <th>Description</th> <th>Ch'k'd</th> <th>App'd</th> </tr> </thead> <tbody> <tr> <td>P2</td> <td>28/10/22</td> <td>AW</td> <td>For Information</td> <td>AW</td> <td>JM</td> </tr> <tr> <td>P3</td> <td>20/09/23</td> <td>JC</td> <td>For Information</td> <td>AW</td> <td>CS</td> </tr> </tbody> </table>					Rev	Date	Drawn	Description	Ch'k'd	App'd	P2	28/10/22	AW	For Information	AW	JM	P3	20/09/23	JC	For Information	AW	CS	<p>Drawing Number</p> <p>Figure 8.47</p>			Checked	AW
	Rev	Date	Drawn	Description	Ch'k'd	App'd																						
P2	28/10/22	AW	For Information	AW	JM																							
P3	20/09/23	JC	For Information	AW	CS																							
					<p>Approved</p> <p>CS</p>			<p>Scale at A3</p> <p>1:3,000</p>																				
								Security	Status	Rev																		
								STD	PRE	P3																		




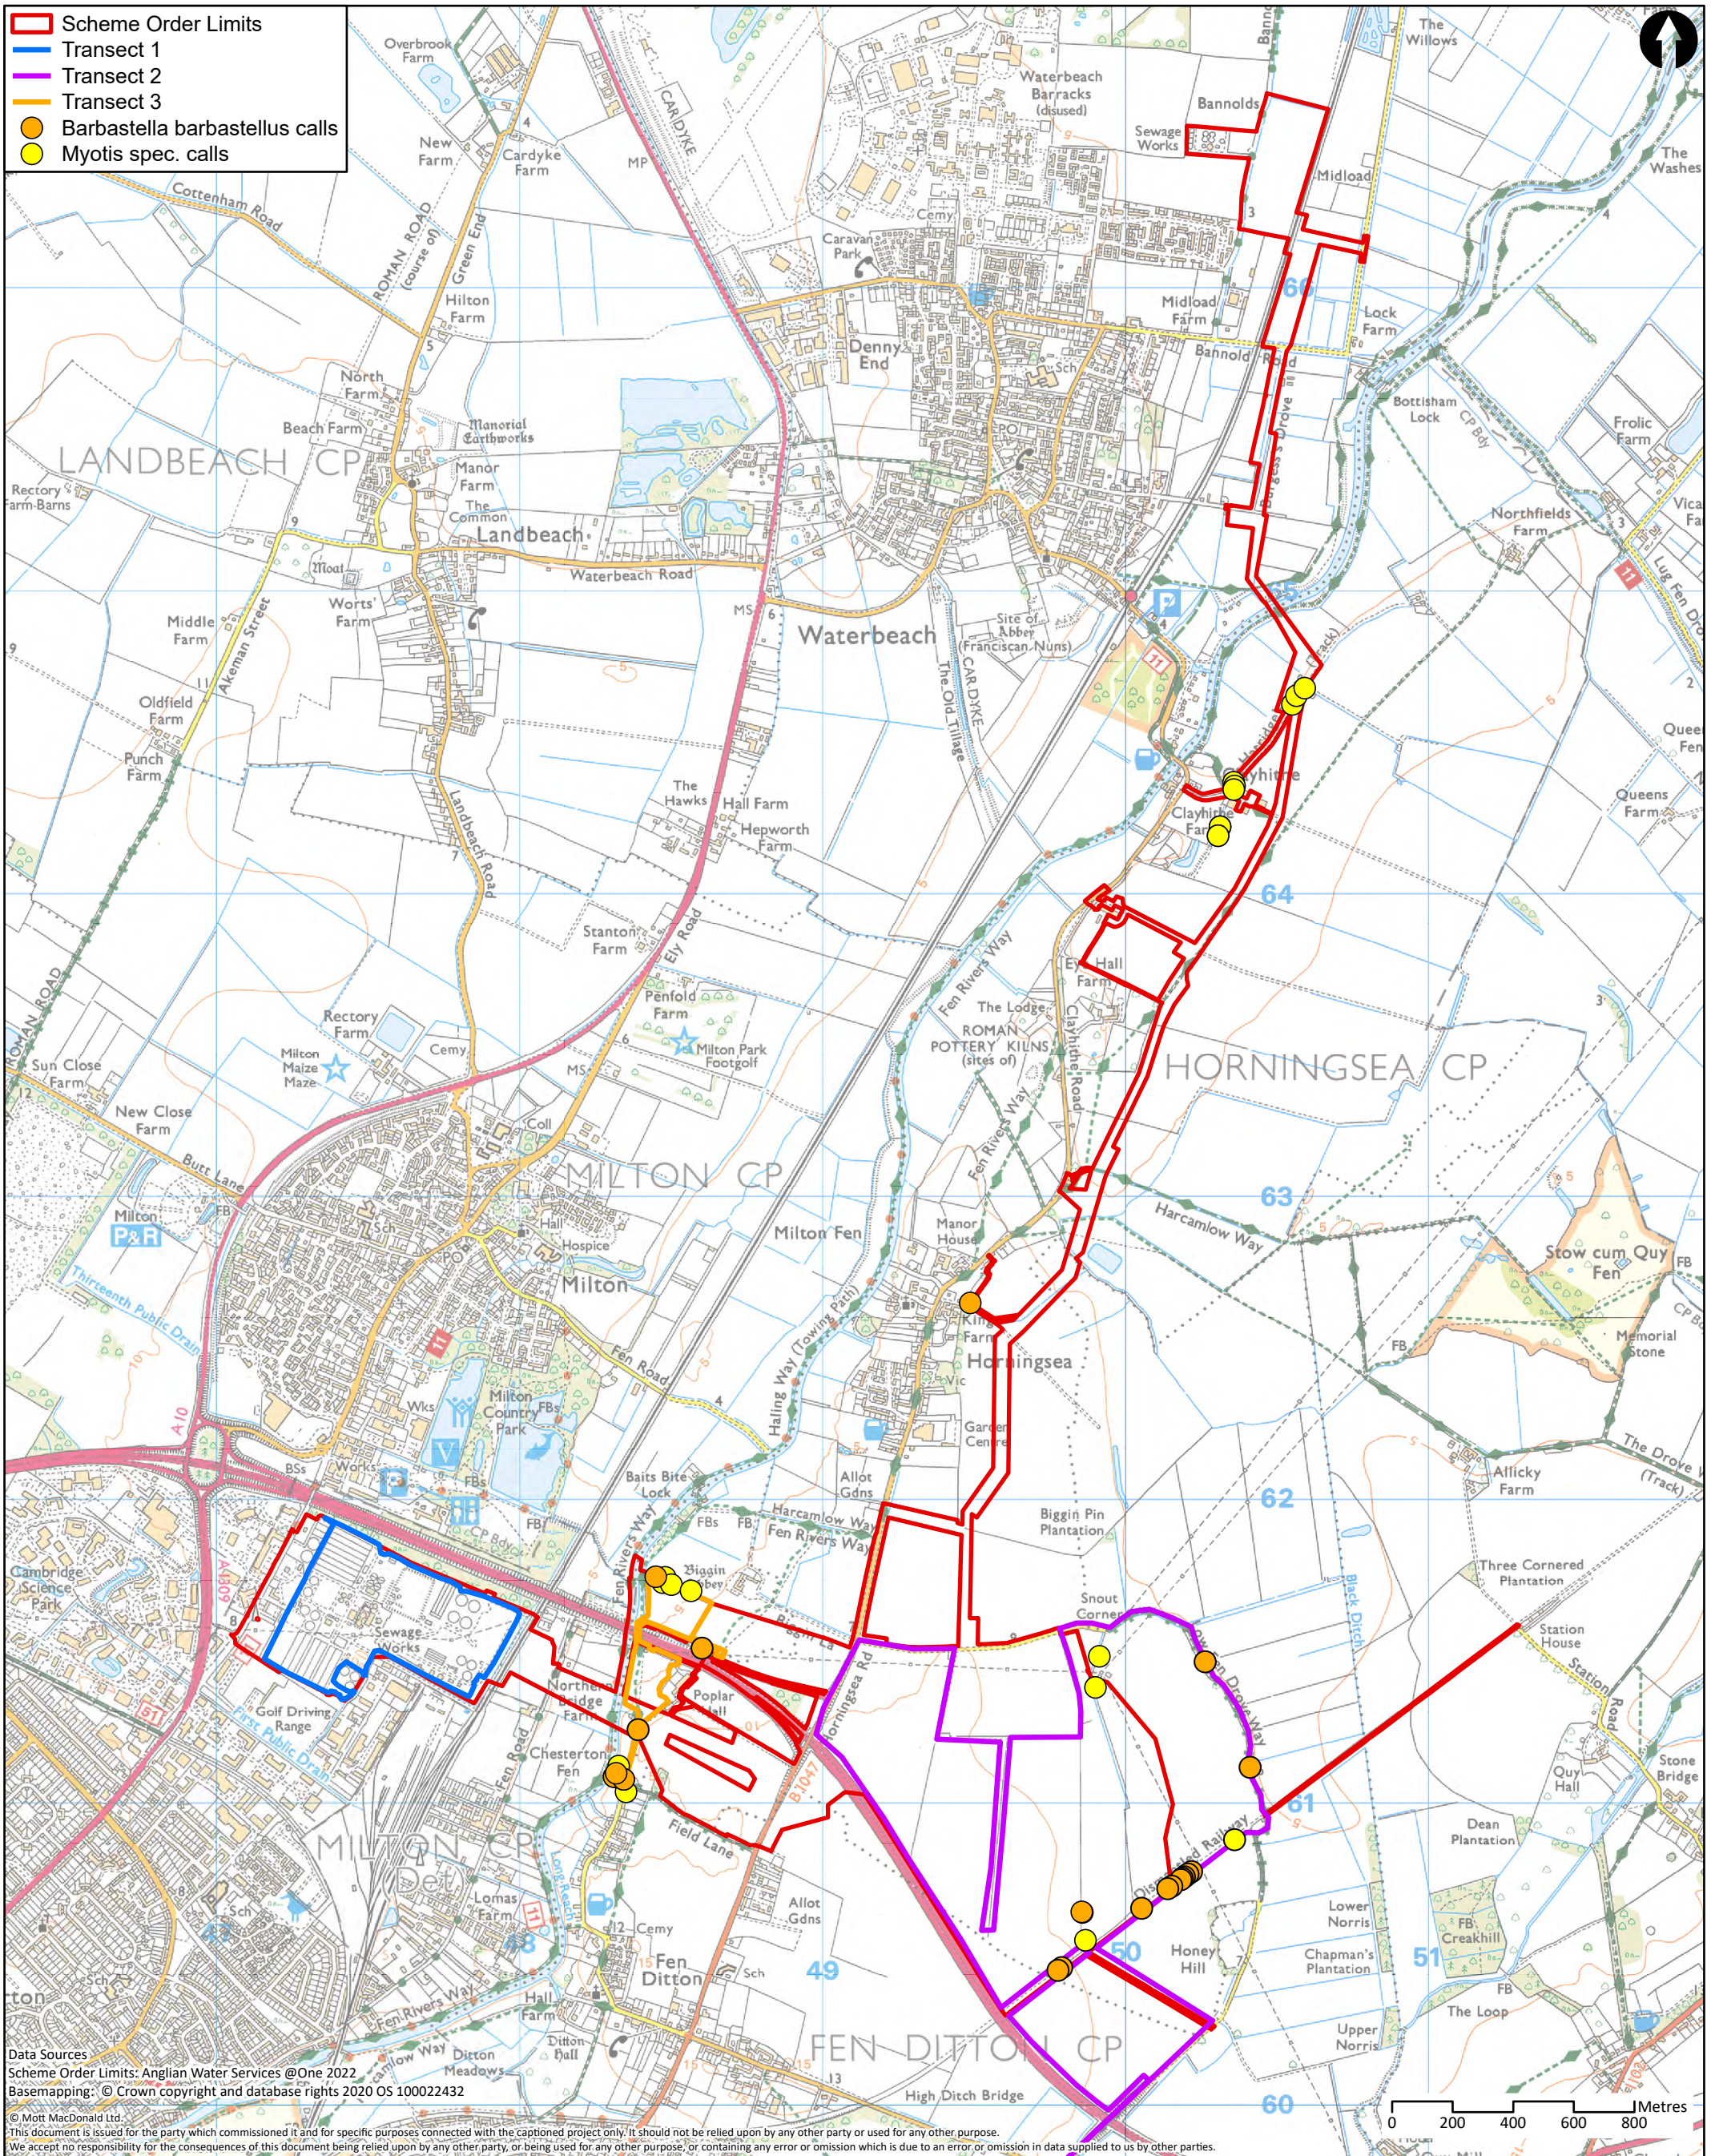

Data Sources  
 Scheme Order Limits: Anglian Water Services @One 2022  
 Basemapping: © Crown copyright and database rights 2020 OS 100022432  
 © Mott MacDonald Ltd.  
 This document is issued for the party which commissioned it and for specific purposes connected with the captioned project only. It should not be relied upon by any other party or used for any other purpose.  
 We accept no responsibility for the consequences of this document being relied upon by any other party, or being used for any other purpose, or containing any error or omission which is due to an error or omission in data supplied to us by other parties.

	Client 		Title Cambridge Waste Water Treatment Plant Relocation Project Bats Barbastelle and Myotis species calls recorded during all surveys			Drawn AW																	
	22 Station Road Cambridge CB1 2JD United Kingdom T +44 (0)20 8774 2000 F +44 (0)20 8681 5706 W mottmac.com		Drawing Number Figure 8.48			Checked AW Approved CS																	
	<table border="1"> <thead> <tr> <th>Rev</th> <th>Date</th> <th>Drawn</th> <th>Description</th> <th>Ch'k'd</th> <th>App'd</th> </tr> </thead> <tbody> <tr> <td>P2</td> <td>28/10/22</td> <td>AW</td> <td>For Information</td> <td>AW</td> <td>JM</td> </tr> <tr> <td>P3</td> <td>20/09/23</td> <td>JC</td> <td>For Information</td> <td>AW</td> <td>CS</td> </tr> </tbody> </table>		Rev	Date	Drawn	Description	Ch'k'd	App'd	P2	28/10/22	AW	For Information	AW	JM	P3	20/09/23	JC	For Information	AW	CS	Scale at A3 1:20,000		
Rev	Date	Drawn	Description	Ch'k'd	App'd																		
P2	28/10/22	AW	For Information	AW	JM																		
P3	20/09/23	JC	For Information	AW	CS																		



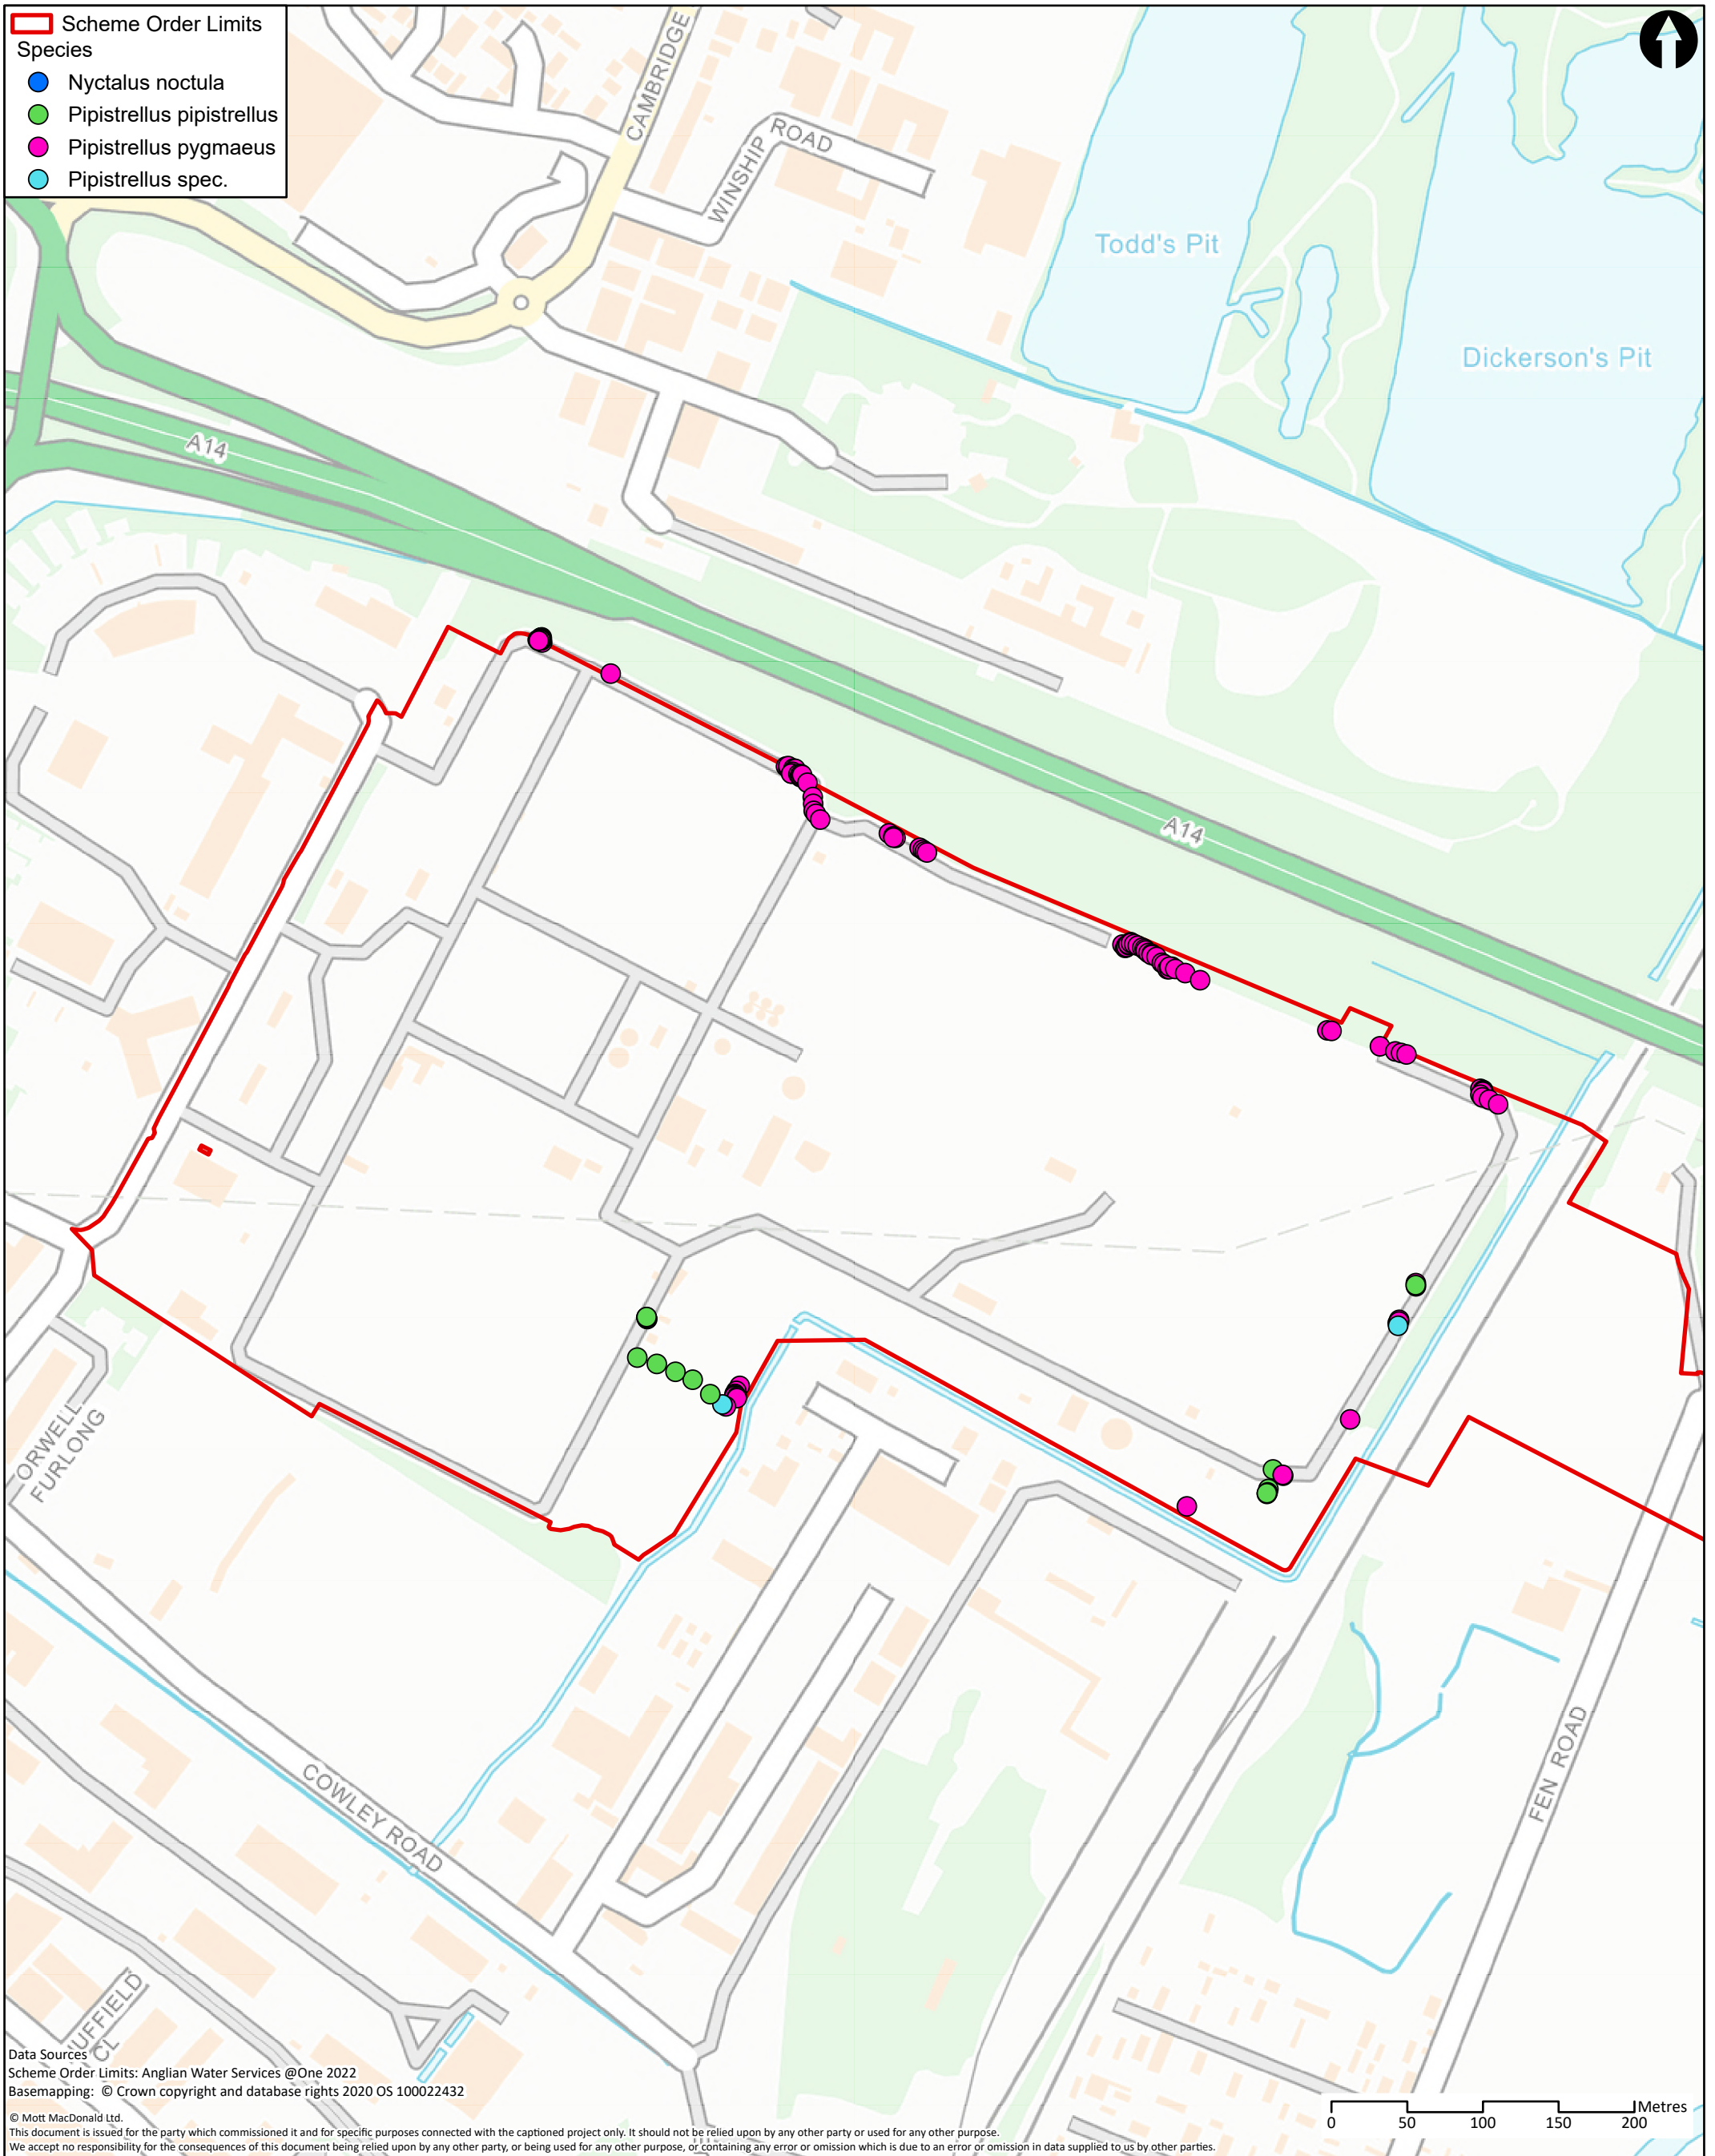


Data Sources  
 Scheme Order Limits: Anglian Water Services @One 2022  
 Basemapping: © Crown copyright and database rights 2020 OS 100022432

© Mott MacDonald Ltd.  
 This document is issued for the party which commissioned it and for specific purposes connected with the captioned project only. It should not be relied upon by any other party or used for any other purpose.  
 We accept no responsibility for the consequences of this document being relied upon by any other party, or being used for any other purpose, or containing any error or omission which is due to an error or omission in data supplied to us by other parties.

<p>22 Station Road Cambridge CB1 2JD United Kingdom</p> <p>T +44 (0)20 8774 2000 F +44 (0)20 8681 5706 W mottmac.com</p>	Client 					Title Cambridge Waste Water Treatment Plant Relocation Project Bats Existing Cambridge WWTP (Transect 1) - Visit 1			Drawn	AW																		
	<table border="1"> <thead> <tr> <th>Rev</th> <th>Date</th> <th>Drawn</th> <th>Description</th> <th>Ch'k'd</th> <th>App'd</th> </tr> </thead> <tbody> <tr> <td>P2</td> <td>31/10/22</td> <td>AW</td> <td>For Information</td> <td>AW</td> <td>JM</td> </tr> <tr> <td>P3</td> <td>20/09/23</td> <td>JC</td> <td>For Information</td> <td>AW</td> <td>CS</td> </tr> </tbody> </table>					Rev	Date	Drawn	Description	Ch'k'd	App'd	P2	31/10/22	AW	For Information	AW	JM	P3	20/09/23	JC	For Information	AW	CS	Drawing Number Figure 8.49			Checked	AW
	Rev	Date	Drawn	Description	Ch'k'd	App'd																						
P2	31/10/22	AW	For Information	AW	JM																							
P3	20/09/23	JC	For Information	AW	CS																							
								Approved	CS																			
								Scale at A3 1:4,000																				
								Security	Status	Rev																		
								STD	PRE	P3																		




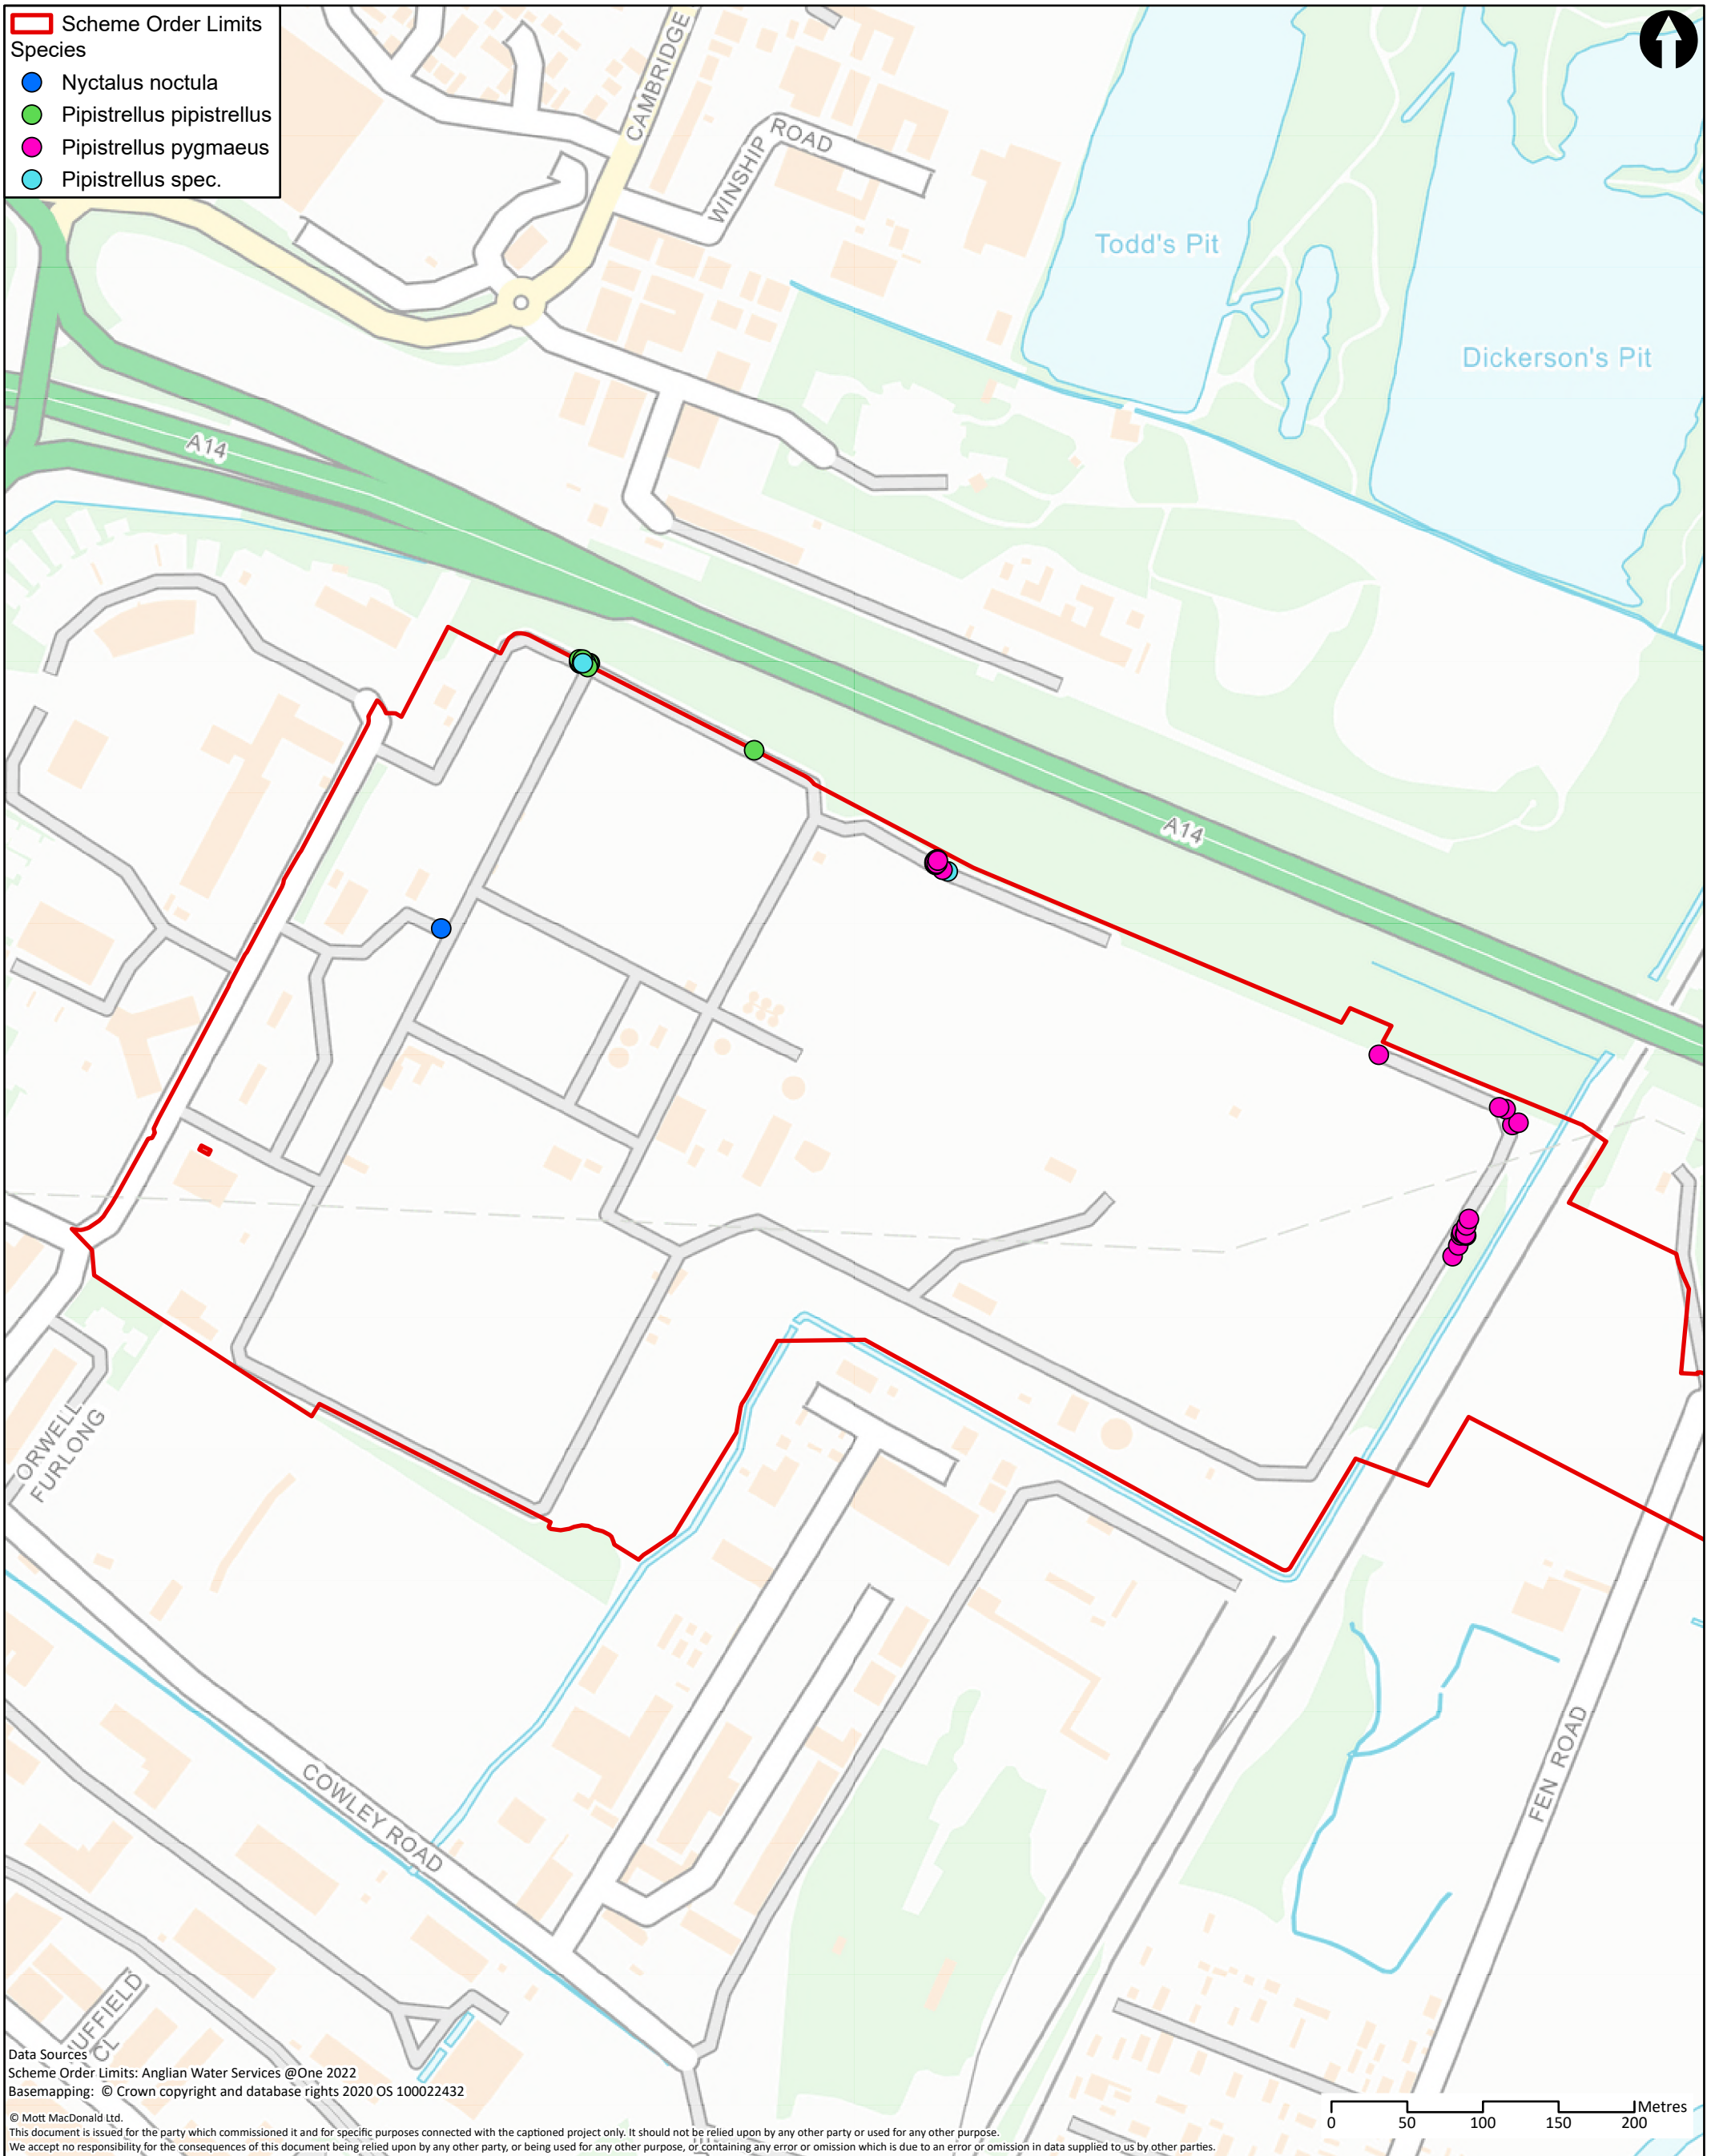

Data Sources  
 Scheme Order Limits: Anglian Water Services @One 2022  
 Basemapping: © Crown copyright and database rights 2020 OS 100022432  
 © Mott MacDonald Ltd.  
 This document is issued for the party which commissioned it and for specific purposes connected with the captioned project only. It should not be relied upon by any other party or used for any other purpose.  
 We accept no responsibility for the consequences of this document being relied upon by any other party, or being used for any other purpose, or containing any error or omission which is due to an error or omission in data supplied to us by other parties.


<p>22 Station Road Cambridge CB1 2JD United Kingdom</p> <p>T +44 (0)20 8774 2000 F +44 (0)20 8681 5706 W mottmac.com</p>	Client 					Title Cambridge Waste Water Treatment Plant Relocation Project Bats Existing Cambridge WWTP (Transect 1) - Visit 2			Drawn	AW																		
	<table border="1"> <thead> <tr> <th>Rev</th> <th>Date</th> <th>Drawn</th> <th>Description</th> <th>Ch'k'd</th> <th>App'd</th> </tr> </thead> <tbody> <tr> <td>P2</td> <td>31/10/22</td> <td>AW</td> <td>For Information</td> <td>AW</td> <td>JM</td> </tr> <tr> <td>P3</td> <td>20/09/23</td> <td>JC</td> <td>For Information</td> <td>AW</td> <td>CS</td> </tr> </tbody> </table>					Rev	Date	Drawn	Description	Ch'k'd	App'd	P2	31/10/22	AW	For Information	AW	JM	P3	20/09/23	JC	For Information	AW	CS	Drawing Number Figure 8.50			Checked	AW
	Rev	Date	Drawn	Description	Ch'k'd	App'd																						
P2	31/10/22	AW	For Information	AW	JM																							
P3	20/09/23	JC	For Information	AW	CS																							
								Approved	CS																			
								Scale at A3 1:4,000																				
								Security	Status	Rev																		
								STD	PRE	P3																		



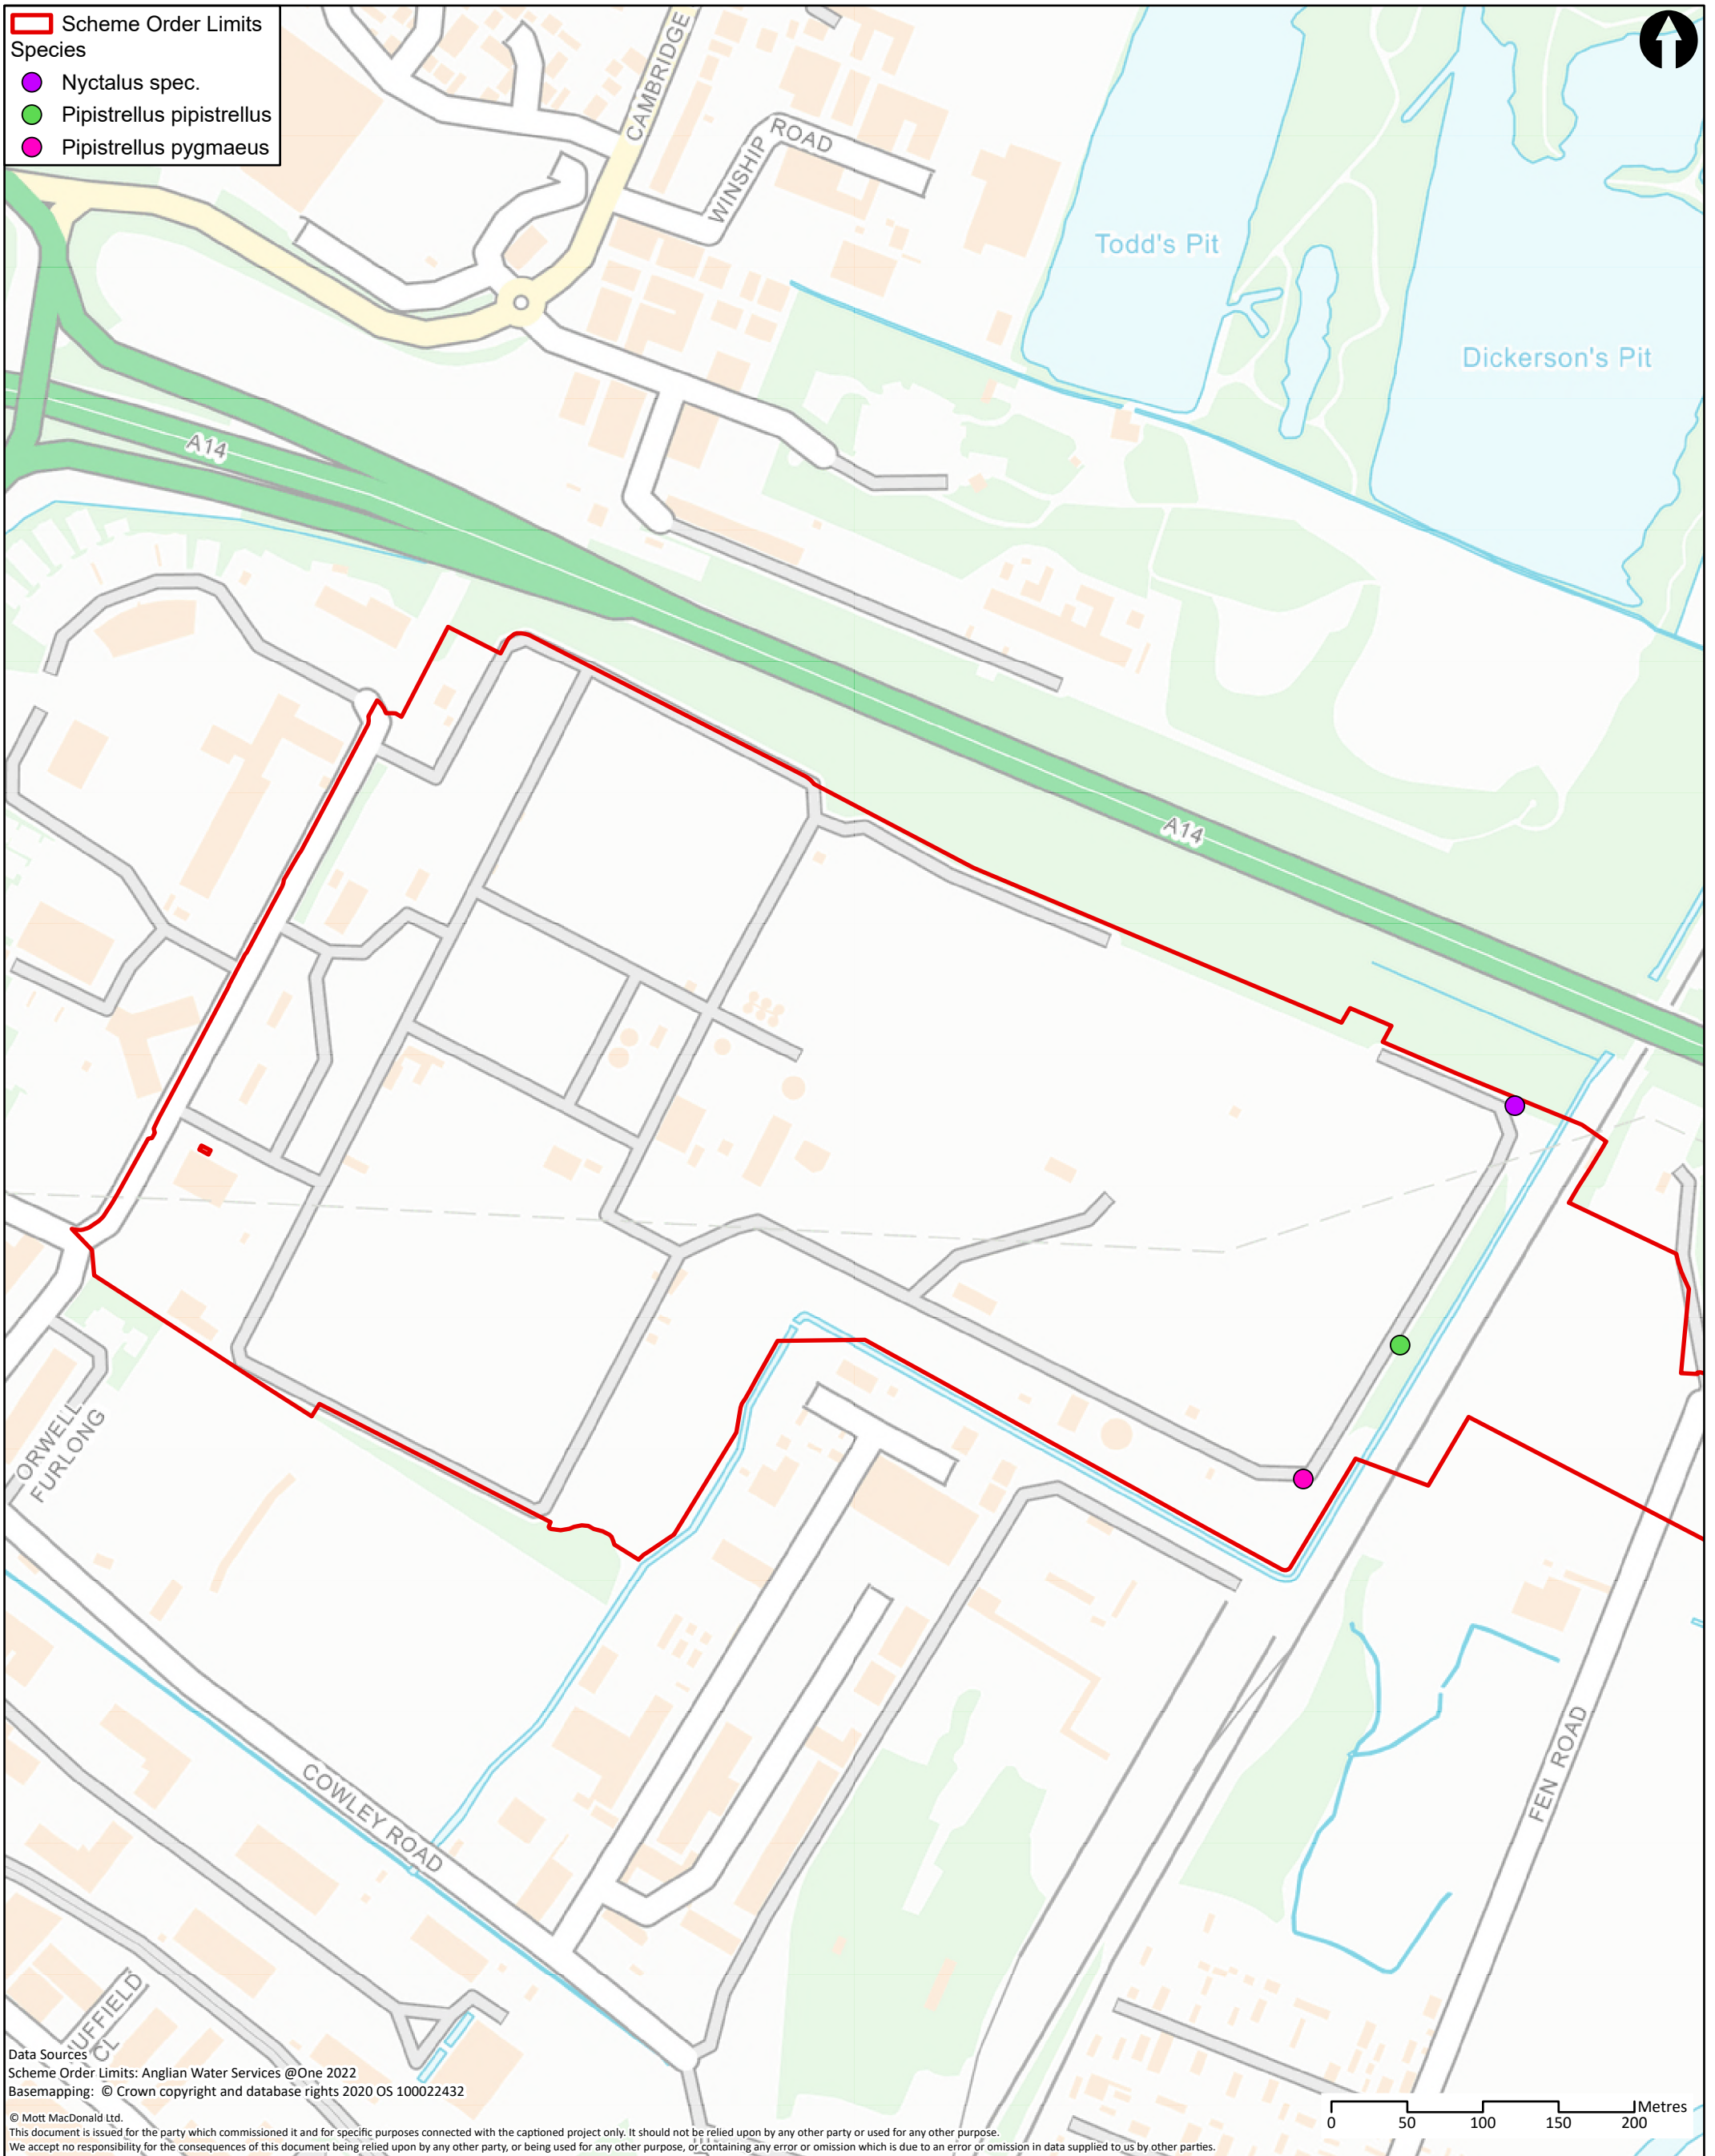

<p><b>MOTT MACDONALD</b></p> <p>22 Station Road Cambridge CB1 2JD United Kingdom</p> <p>T +44 (0)20 8774 2000 F +44 (0)20 8681 5706 W mottmac.com</p>	<p>Client</p>					<p>Title</p> <p>Cambridge Waste Water Treatment Plant Relocation Project</p> <p>Bats</p> <p>Existing Cambridge WWTP (Transect 1) - Visit 3</p>			Drawn	AW																		
	<table border="1"> <thead> <tr> <th>Rev</th> <th>Date</th> <th>Drawn</th> <th>Description</th> <th>Ch'k'd</th> <th>App'd</th> </tr> </thead> <tbody> <tr> <td>P2</td> <td>31/10/22</td> <td>AW</td> <td>For Information</td> <td>AW</td> <td>JM</td> </tr> <tr> <td>P3</td> <td>20/09/23</td> <td>JC</td> <td>For Information</td> <td>AW</td> <td>CS</td> </tr> </tbody> </table>					Rev	Date	Drawn	Description	Ch'k'd	App'd	P2	31/10/22	AW	For Information	AW	JM	P3	20/09/23	JC	For Information	AW	CS	<p>Drawing Number</p> <p>Figure 8.51</p>			Checked	AW
	Rev	Date	Drawn	Description	Ch'k'd	App'd																						
P2	31/10/22	AW	For Information	AW	JM																							
P3	20/09/23	JC	For Information	AW	CS																							
					<p>Approved</p> <p>CS</p>			<p>Scale at A3</p> <p>1:4,000</p>																				
								Security	Status	Rev																		
								STD	PRE	P3																		




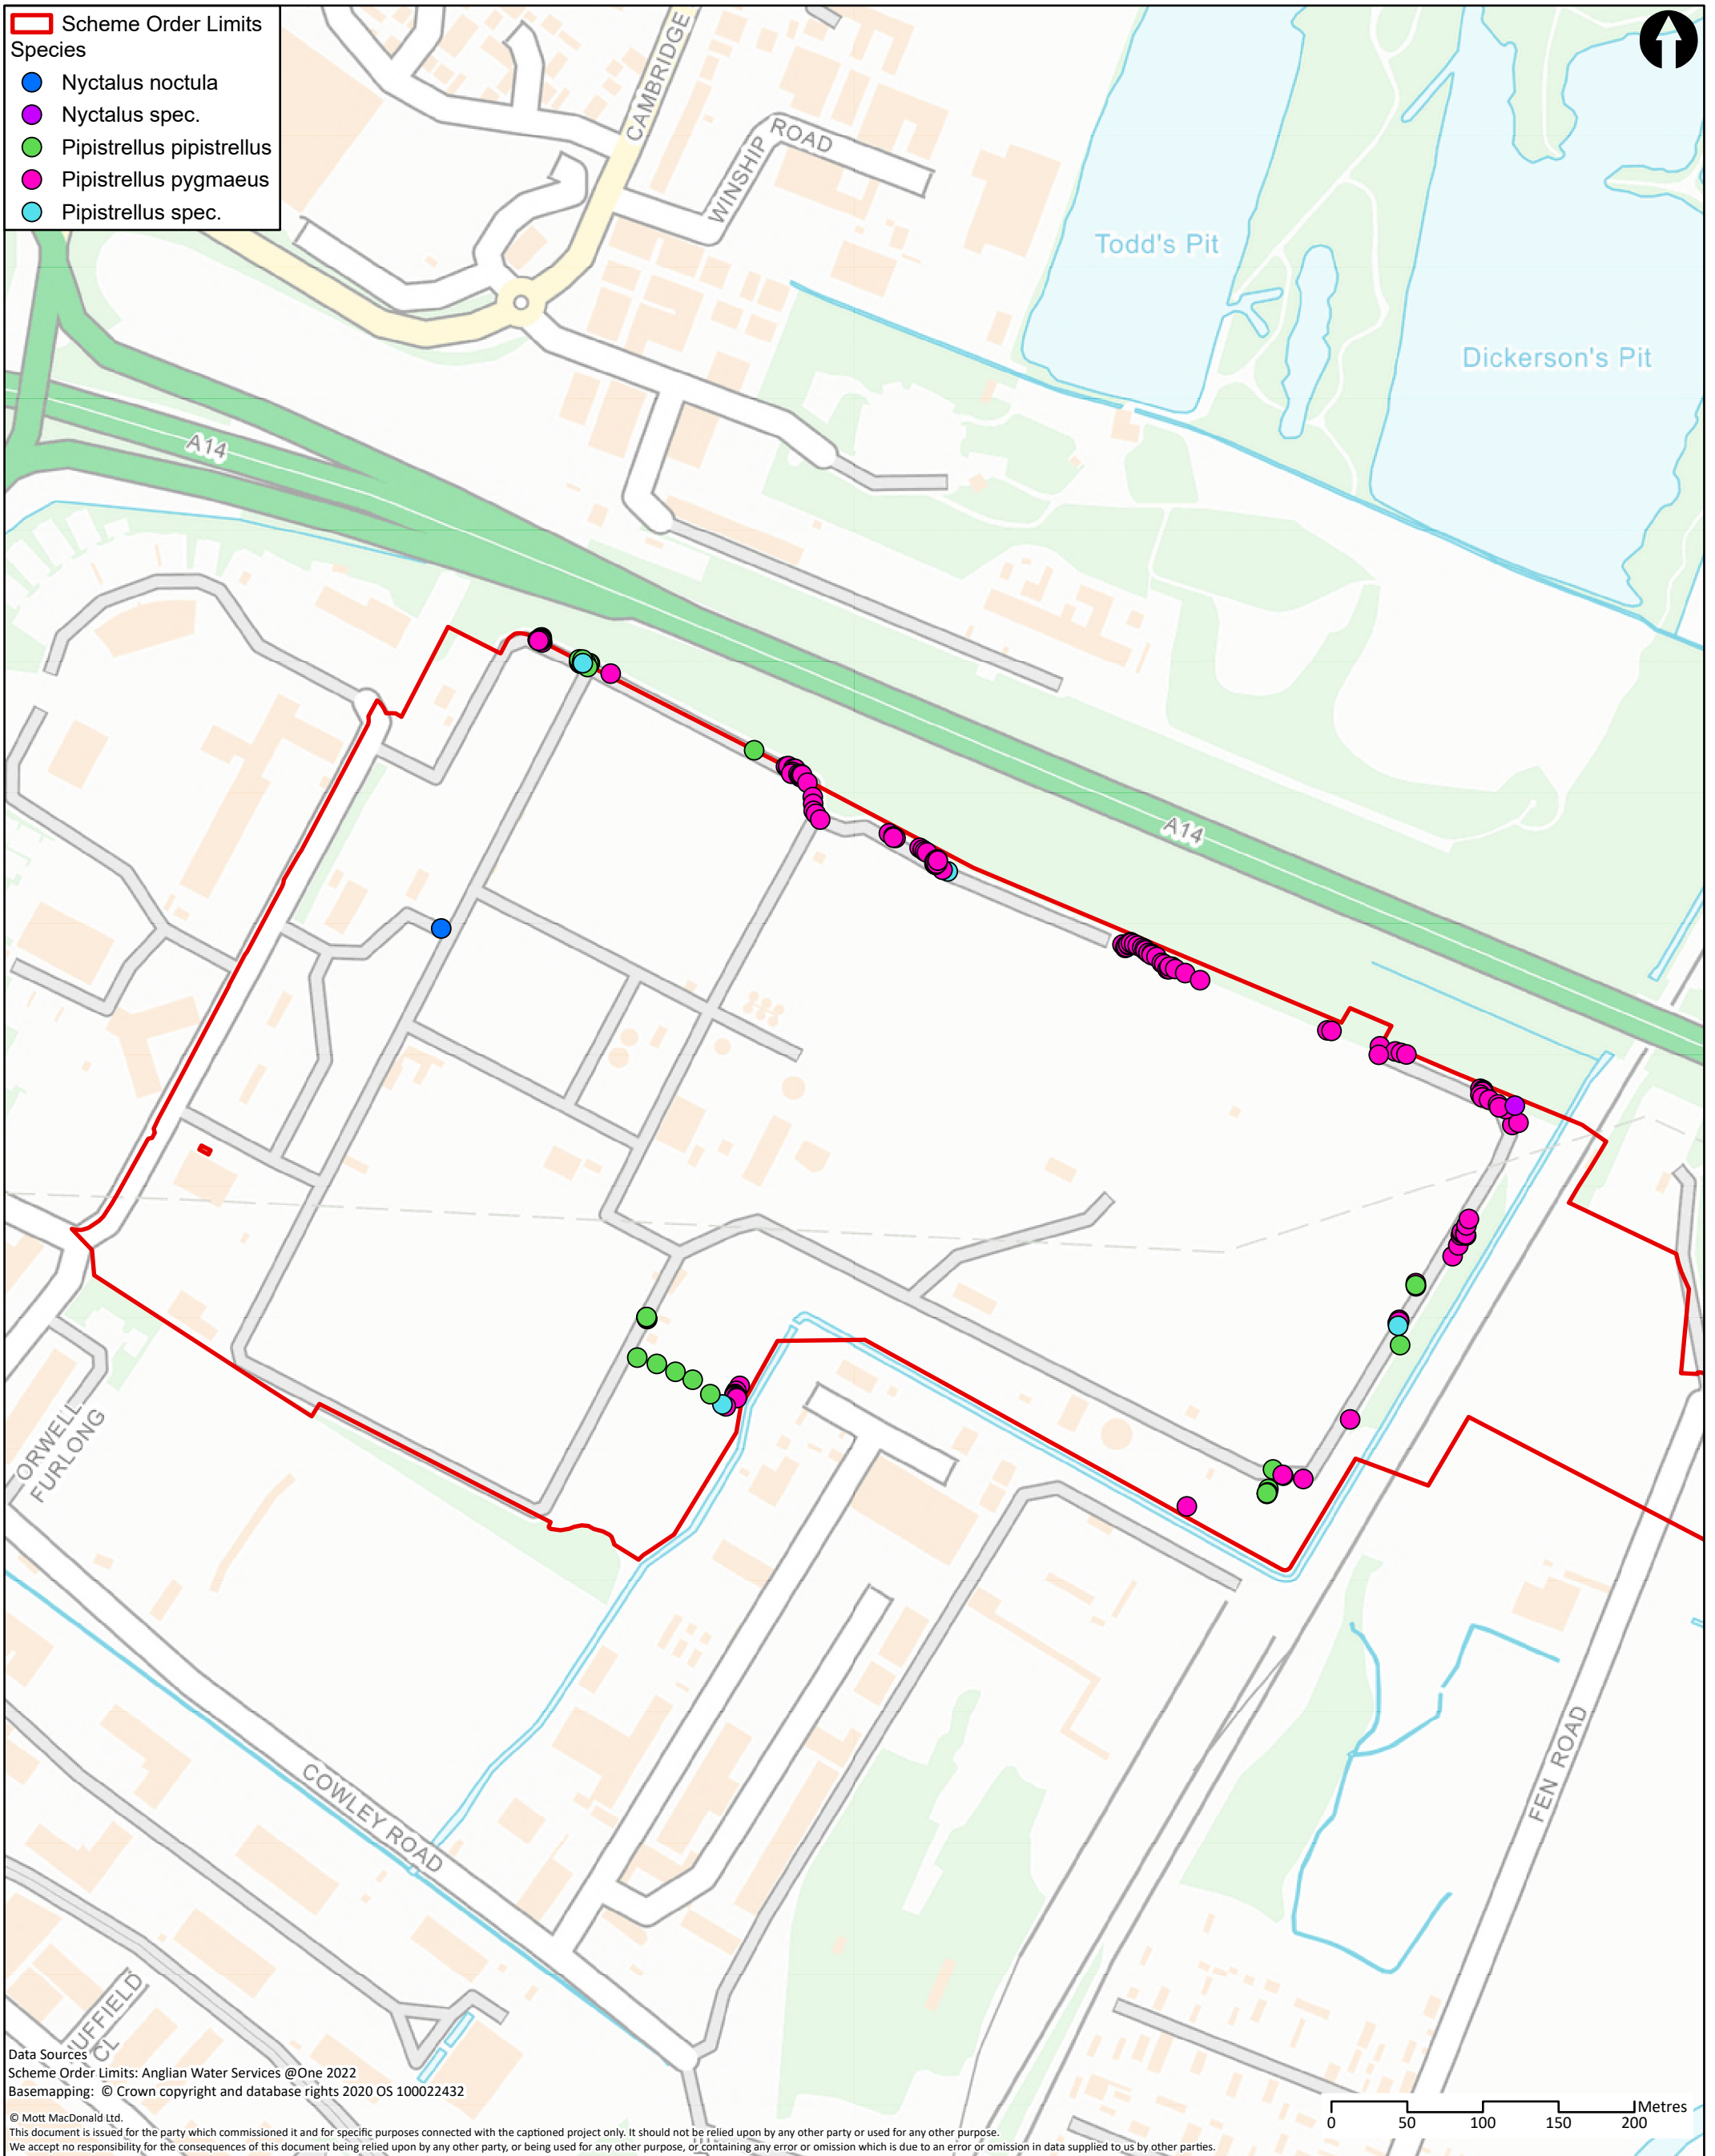

Data Sources  
 Scheme Order Limits: Anglian Water Services @One 2022  
 Basemapping: © Crown copyright and database rights 2020 OS 100022432  
 © Mott MacDonald Ltd.  
 This document is issued for the party which commissioned it and for specific purposes connected with the captioned project only. It should not be relied upon by any other party or used for any other purpose.  
 We accept no responsibility for the consequences of this document being relied upon by any other party, or being used for any other purpose, or containing any error or omission which is due to an error or omission in data supplied to us by other parties.


<p>22 Station Road Cambridge CB1 2JD United Kingdom</p> <p>T +44 (0)20 8774 2000 F +44 (0)20 8681 5706 W mottmac.com</p>	Client 					Title Cambridge Waste Water Treatment Plant Relocation Project Bats Existing Cambridge WWTP (Transect 1) - visits combined			Drawn	AW																		
	<table border="1"> <thead> <tr> <th>Rev</th> <th>Date</th> <th>Drawn</th> <th>Description</th> <th>Ch'k'd</th> <th>App'd</th> </tr> </thead> <tbody> <tr> <td>P2</td> <td>31/10/22</td> <td>AW</td> <td>For Information</td> <td>AW</td> <td>JM</td> </tr> <tr> <td>P3</td> <td>20/09/23</td> <td>JC</td> <td>For Information</td> <td>AW</td> <td>CS</td> </tr> </tbody> </table>					Rev	Date	Drawn	Description	Ch'k'd	App'd	P2	31/10/22	AW	For Information	AW	JM	P3	20/09/23	JC	For Information	AW	CS	Drawing Number Figure 8.52			Checked	AW
	Rev	Date	Drawn	Description	Ch'k'd	App'd																						
P2	31/10/22	AW	For Information	AW	JM																							
P3	20/09/23	JC	For Information	AW	CS																							
								Approved	CS																			
								Scale at A3 1:4,000																				
								Security	Status	Rev																		
								STD	PRE	P3																		



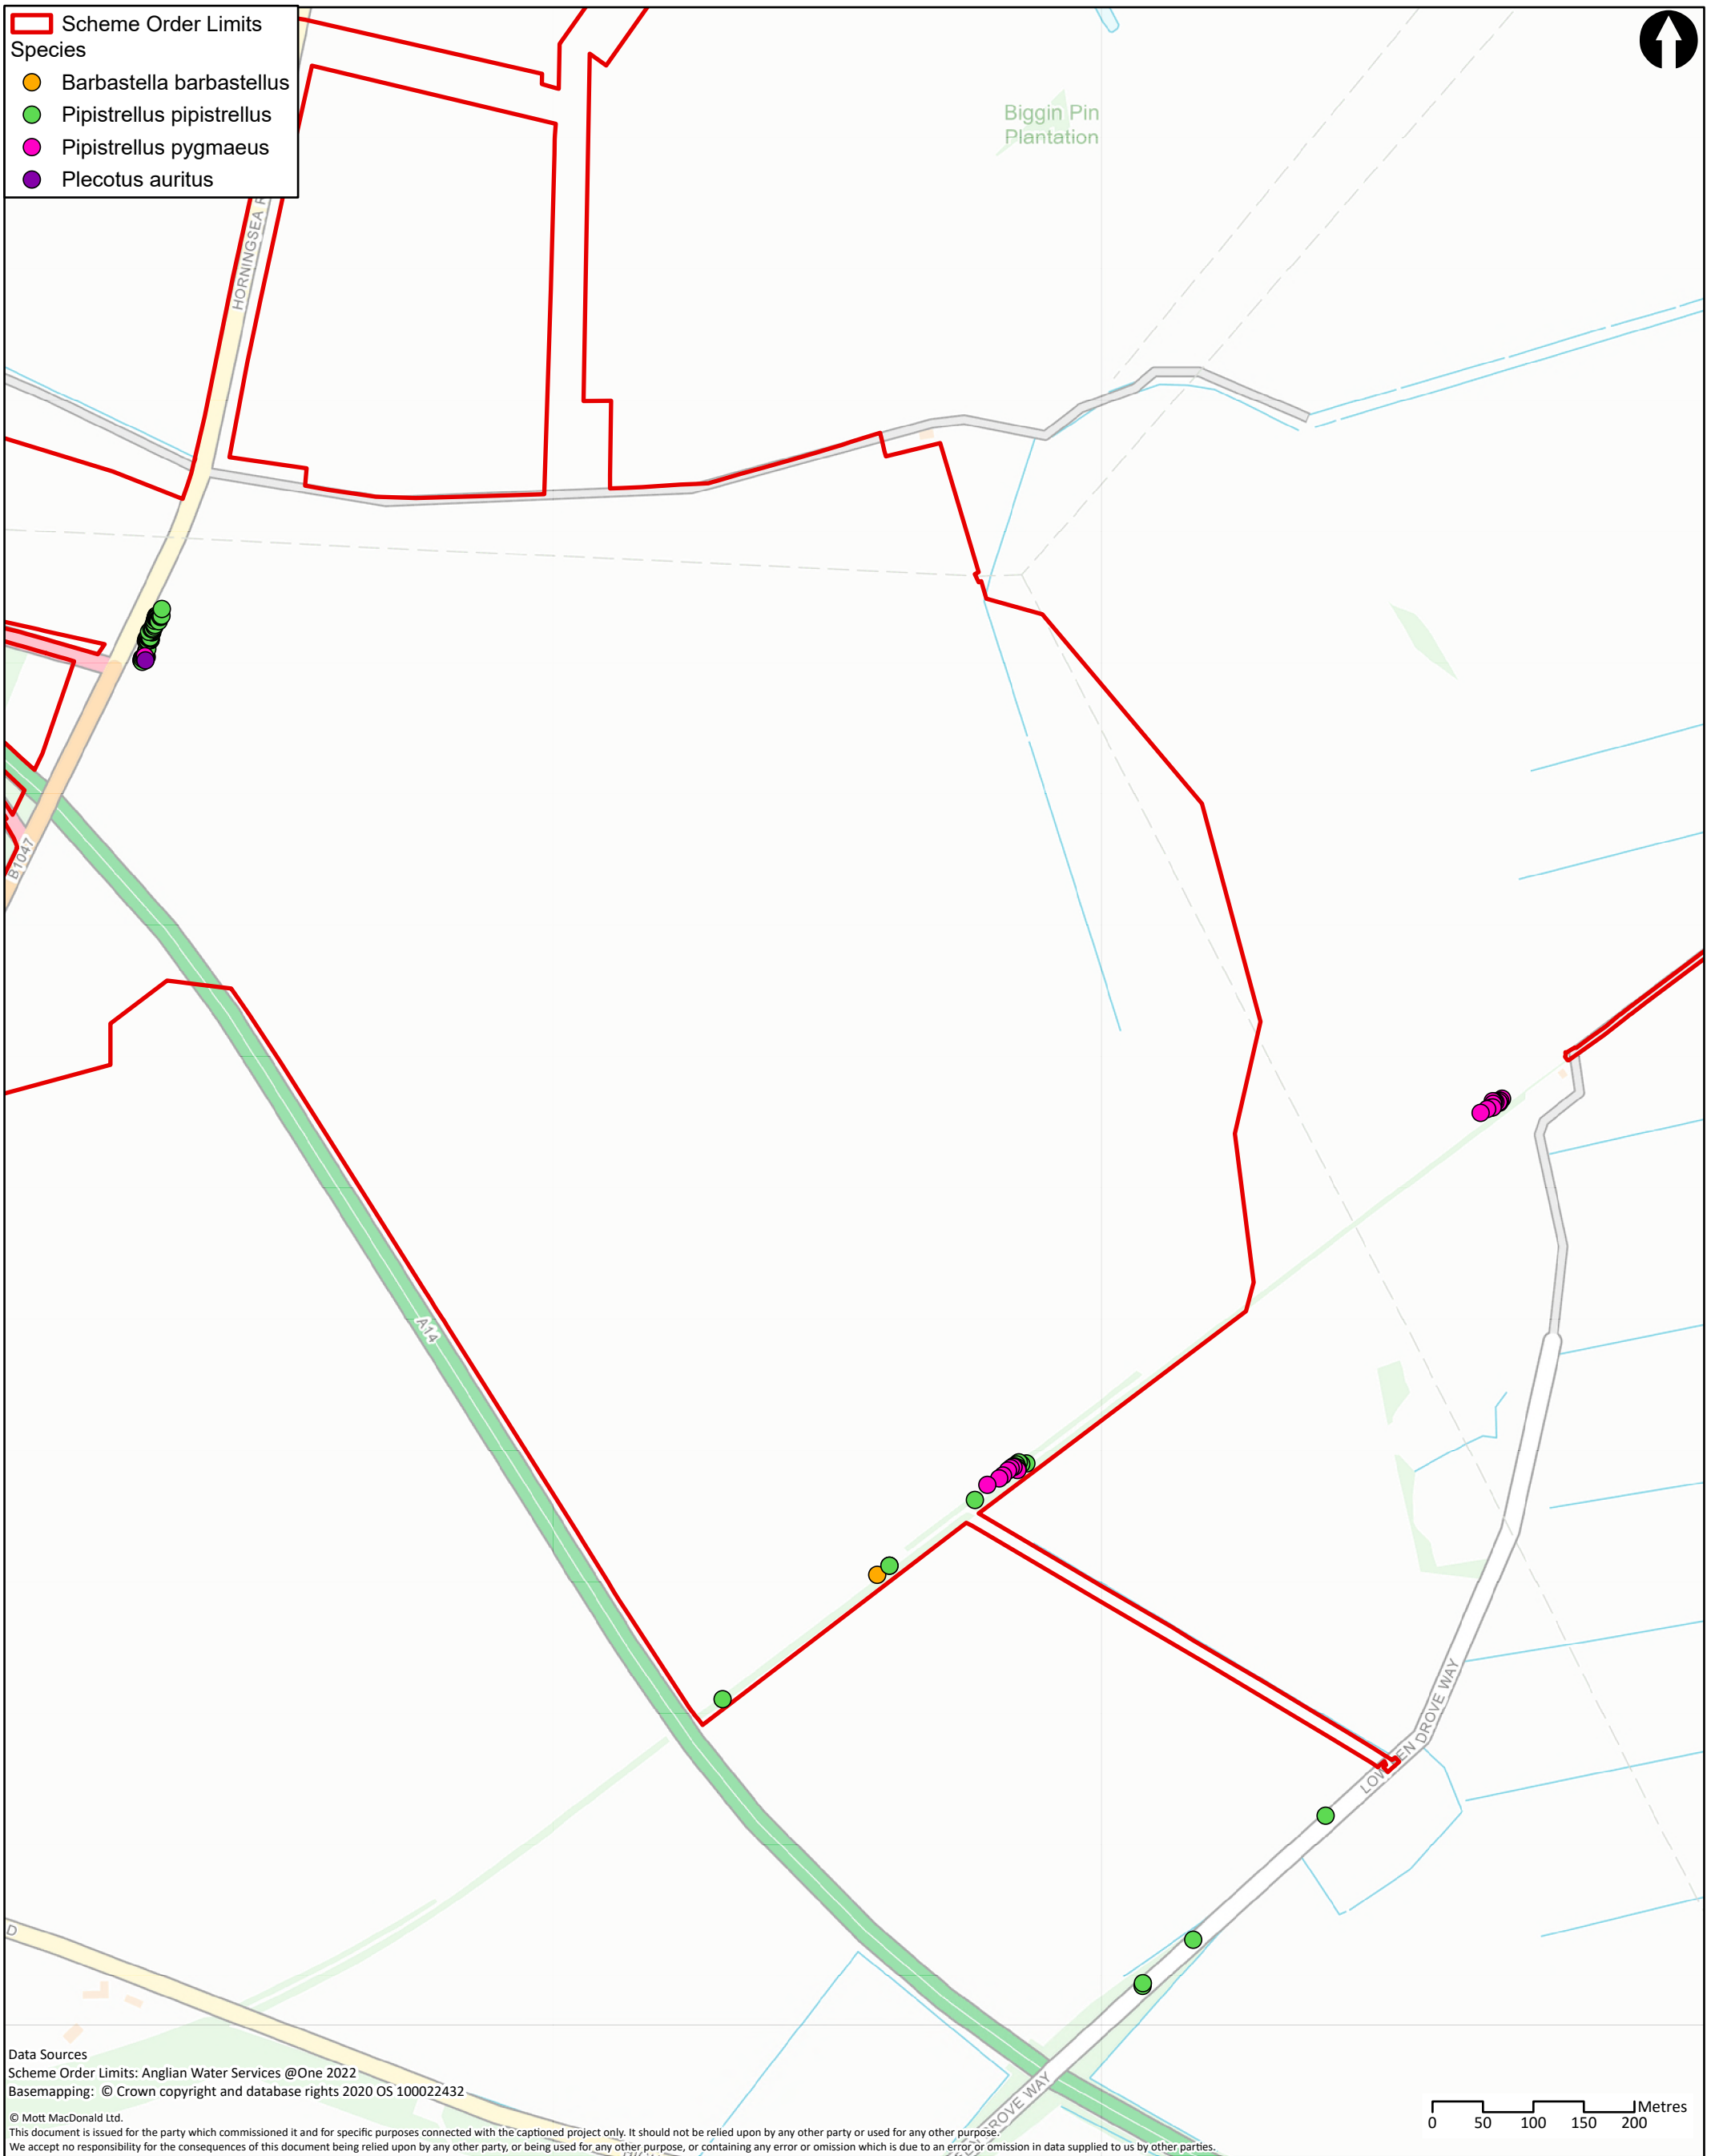


<p><b>MOTT MACDONALD</b></p> <p>22 Station Road Cambridge CB1 2JD United Kingdom</p> <p>T +44 (0)20 8774 2000 F +44 (0)20 8681 5706 W mottmac.com</p>	<p>Client</p>					<p>Title</p> <p>Cambridge Waste Water Treatment Plant Relocation Project</p> <p>Bats</p> <p>Proposed Development (Transect 2) - Visit 1</p>			Drawn	AW																		
	<table border="1"> <thead> <tr> <th>Rev</th> <th>Date</th> <th>Drawn</th> <th>Description</th> <th>Ch'k'd</th> <th>App'd</th> </tr> </thead> <tbody> <tr> <td>P2</td> <td>31/10/22</td> <td>AW</td> <td>For Information</td> <td>AW</td> <td>JM</td> </tr> <tr> <td>P3</td> <td>20/09/23</td> <td>JC</td> <td>For Information</td> <td>AW</td> <td>CS</td> </tr> </tbody> </table>					Rev	Date	Drawn	Description	Ch'k'd	App'd	P2	31/10/22	AW	For Information	AW	JM	P3	20/09/23	JC	For Information	AW	CS	<p>Drawing Number</p> <p>Figure 8.53</p>			Checked	AW
	Rev	Date	Drawn	Description	Ch'k'd	App'd																						
P2	31/10/22	AW	For Information	AW	JM																							
P3	20/09/23	JC	For Information	AW	CS																							
					<p>Approved</p> <p>CS</p>			<p>Scale at A3</p> <p>1:6,000</p>																				
								Security	Status	Rev																		
								STD	PRE	P3																		



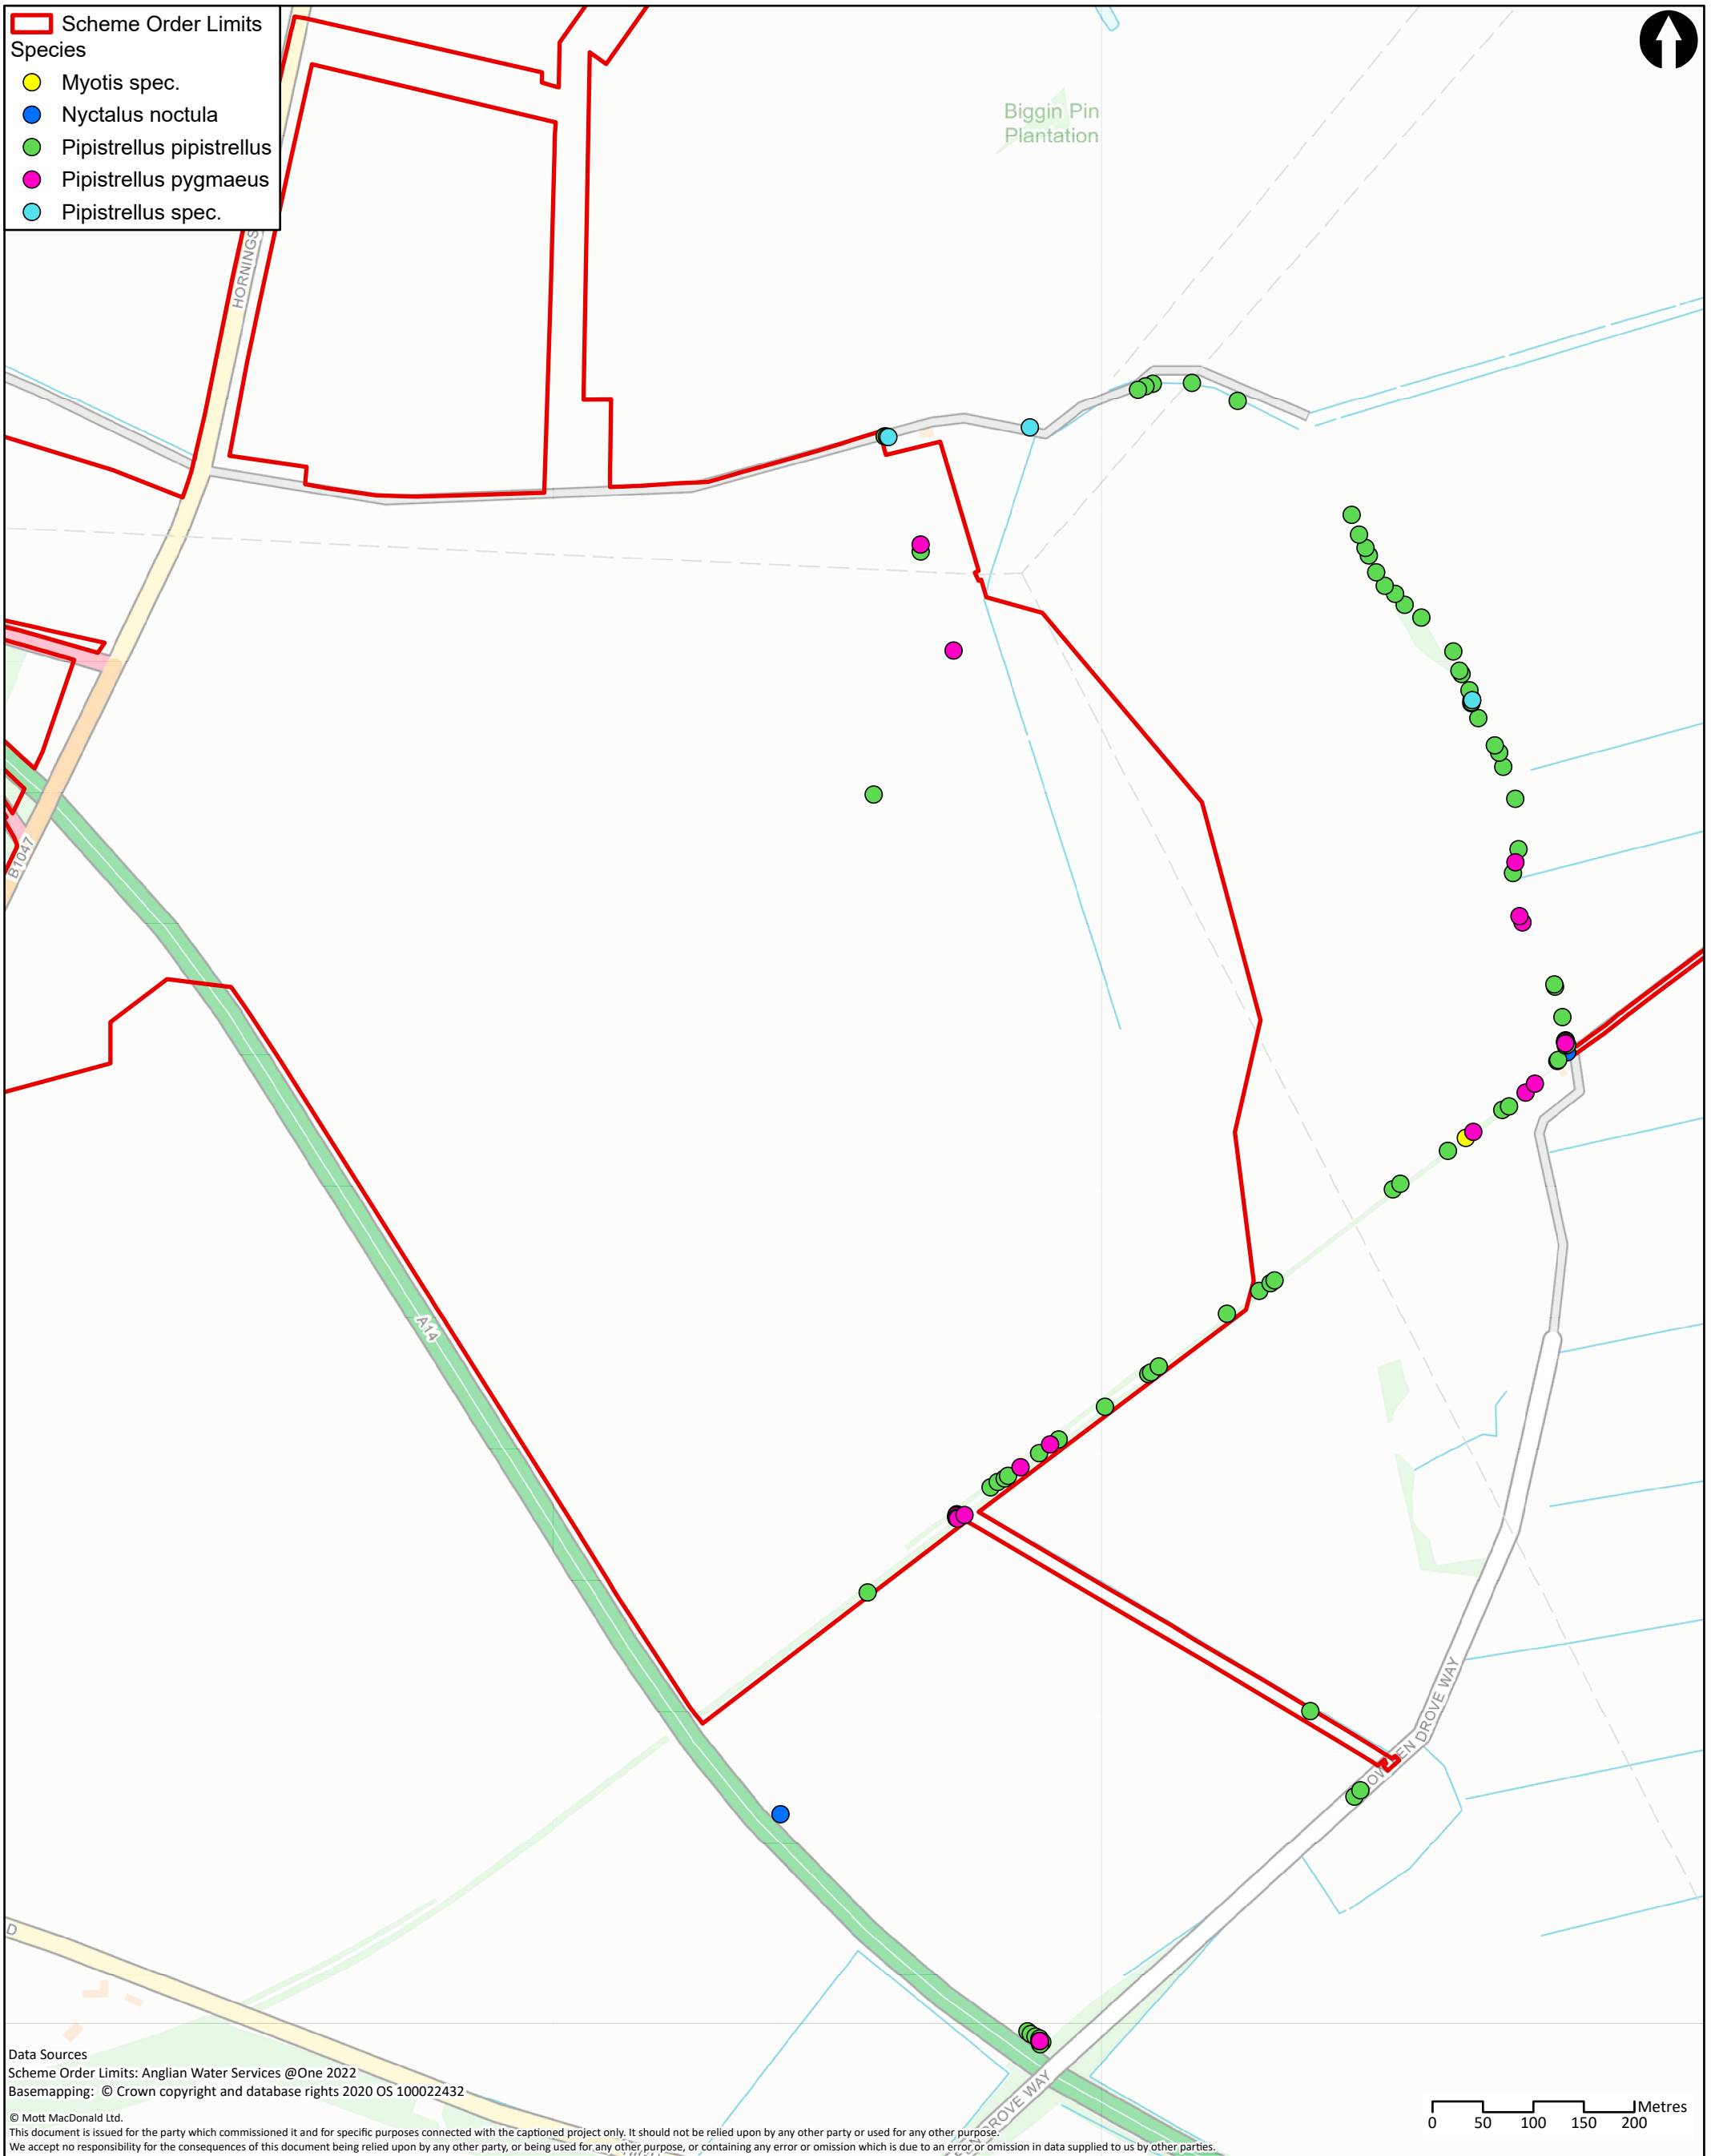

<p>22 Station Road Cambridge CB1 2JD United Kingdom</p> <p>T +44 (0)20 8774 2000 F +44 (0)20 8681 5706 W mottmac.com</p>	Client					Title <b>Cambridge Waste Water Treatment Plant Relocation Project</b> <b>Bats</b> <b>Proposed Development (Transect 2) - Visit 2</b> Drawing Number <b>Figure 8.54</b>	Drawn	AW																	
							Checked	AW																	
							Approved	CS																	
<table border="1"> <thead> <tr> <th>Rev</th> <th>Date</th> <th>Drawn</th> <th>Description</th> <th>Ch'k'd</th> <th>App'd</th> </tr> </thead> <tbody> <tr> <td>P2</td> <td>31/10/22</td> <td>AW</td> <td>For Information</td> <td>AW</td> <td>JM</td> </tr> <tr> <td>P3</td> <td>20/09/23</td> <td>JC</td> <td>For Information</td> <td>AW</td> <td>CS</td> </tr> </tbody> </table>						Rev	Date	Drawn	Description	Ch'k'd	App'd	P2	31/10/22	AW	For Information	AW	JM	P3	20/09/23	JC	For Information	AW	CS	Scale at A3 1:6,000	
Rev	Date	Drawn	Description	Ch'k'd	App'd																				
P2	31/10/22	AW	For Information	AW	JM																				
P3	20/09/23	JC	For Information	AW	CS																				
						Security	Status	Rev																	
						STD	PRE	P3																	



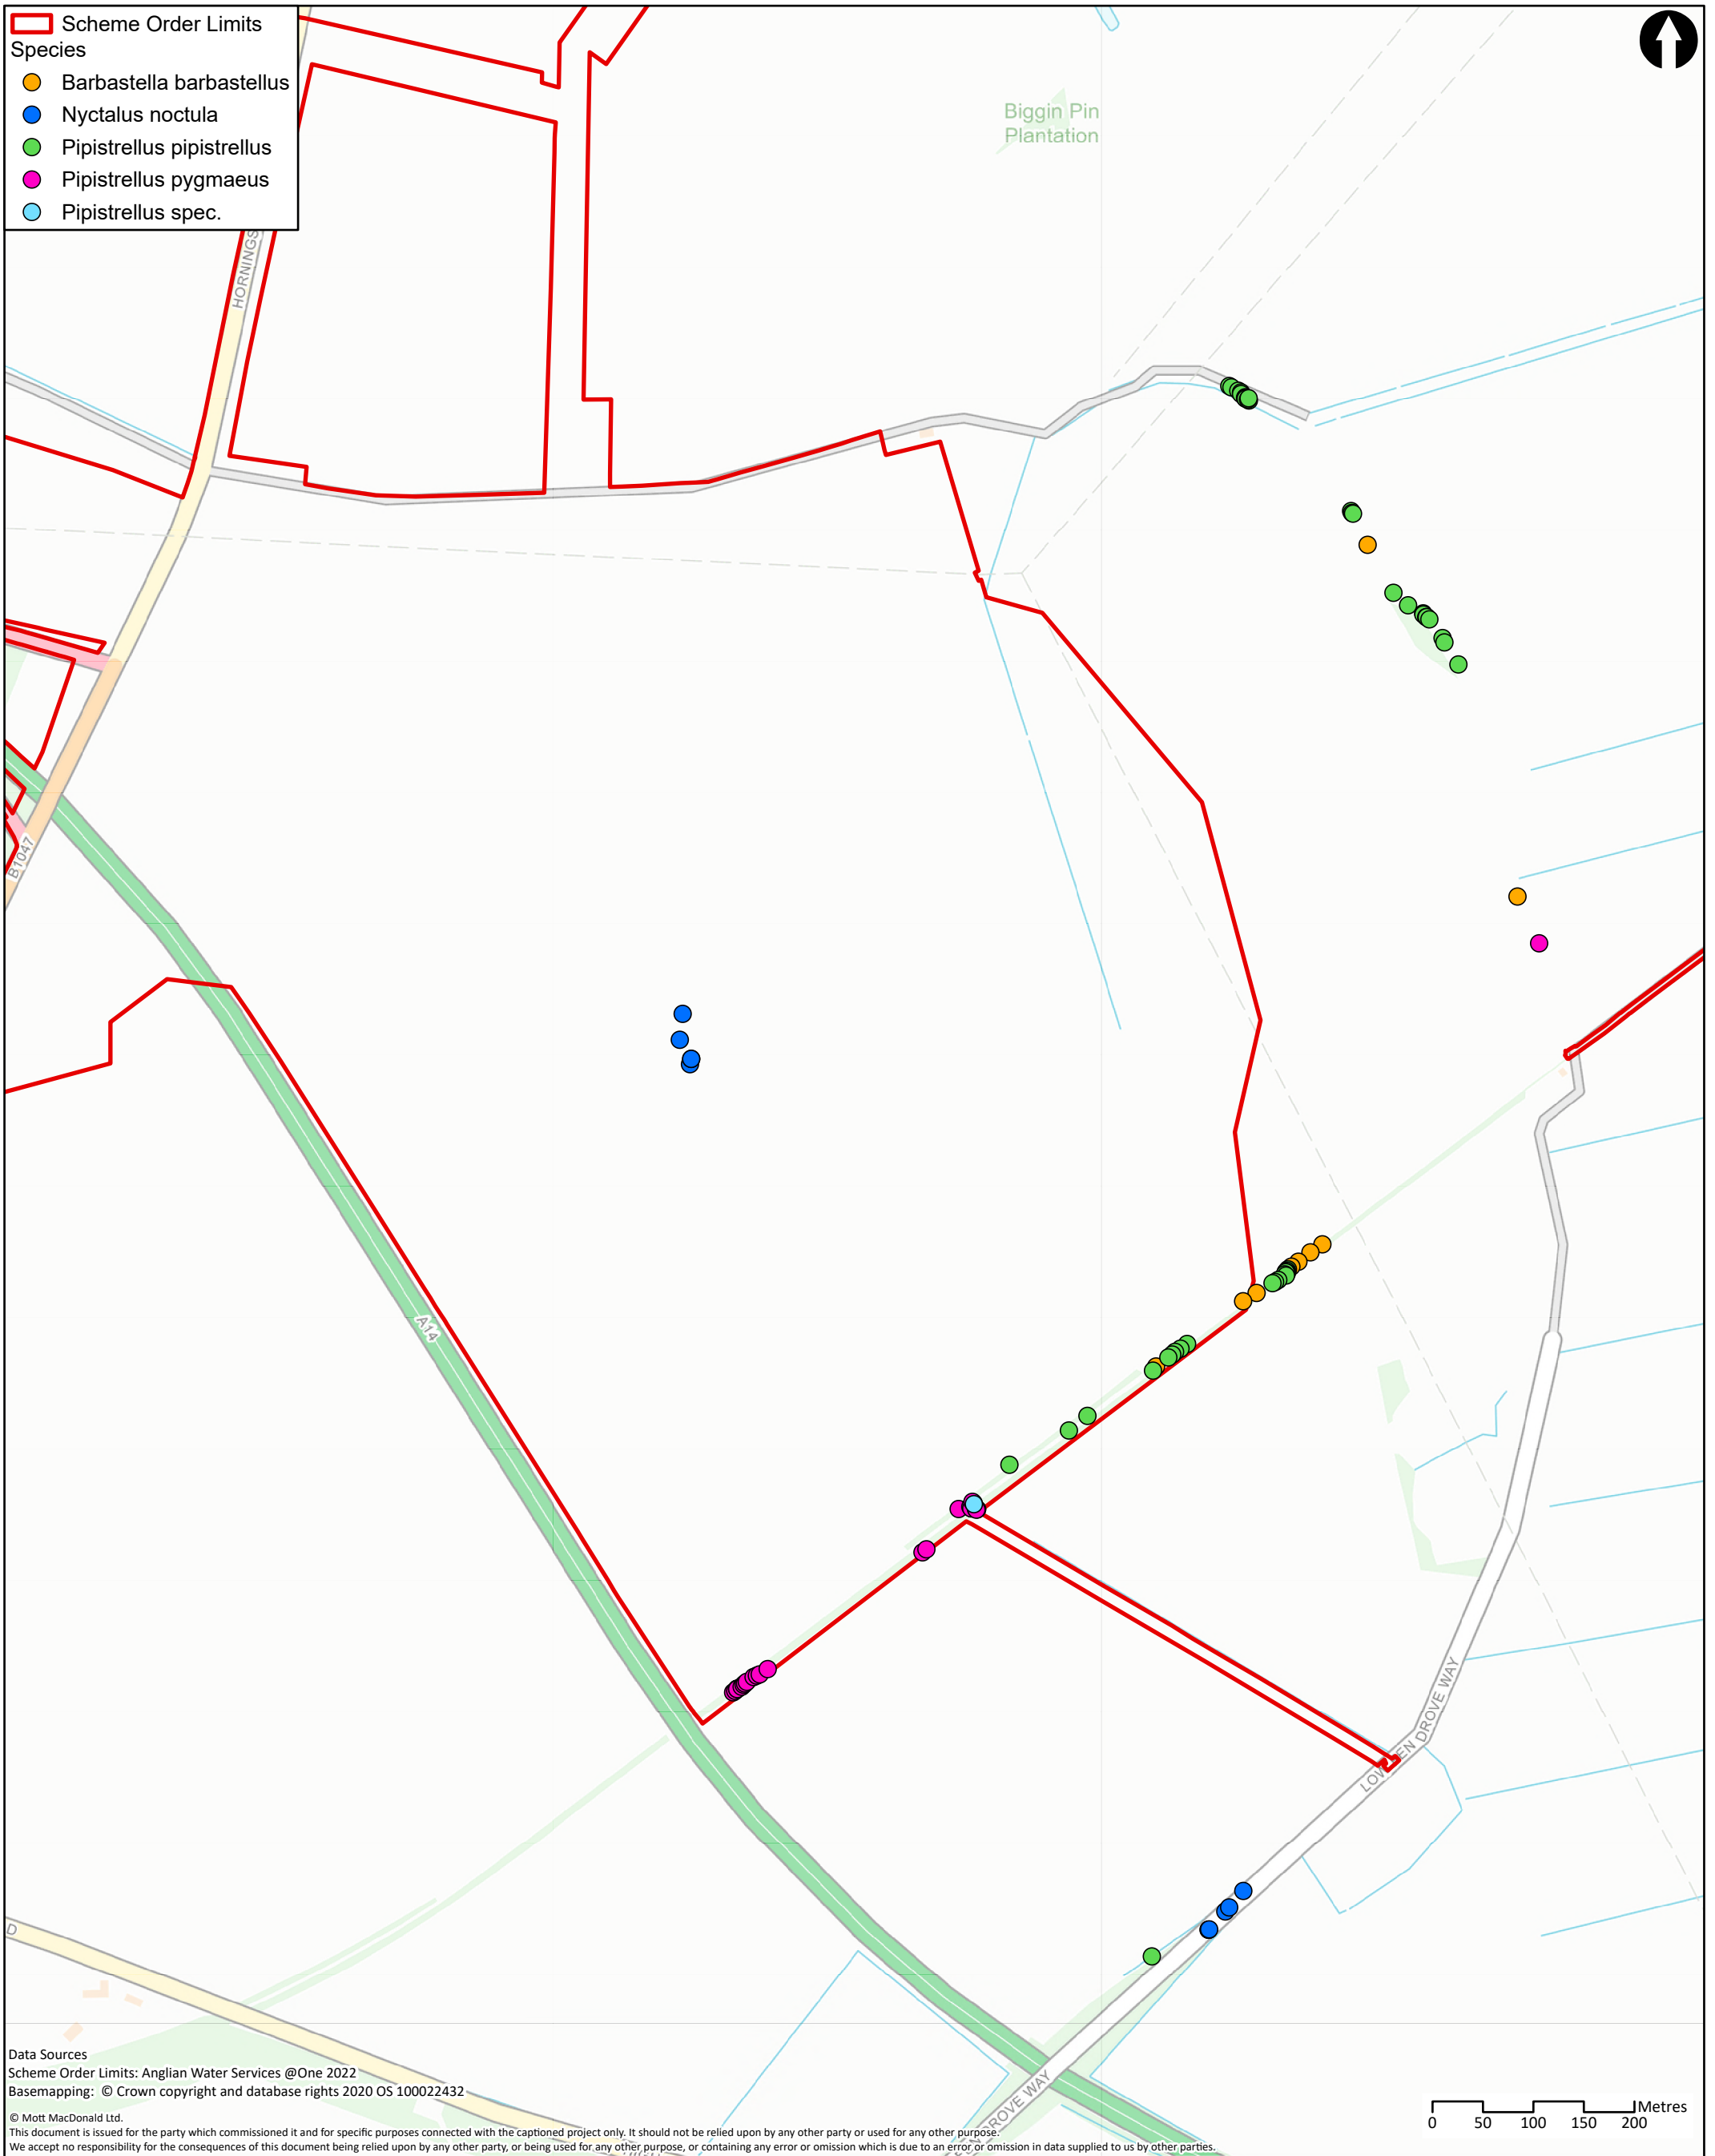


Data Sources  
 Scheme Order Limits: Anglian Water Services @One 2022  
 Basemapping: © Crown copyright and database rights 2020 OS 100022432

© Mott MacDonald Ltd.  
 This document is issued for the party which commissioned it and for specific purposes connected with the captioned project only. It should not be relied upon by any other party or used for any other purpose.  
 We accept no responsibility for the consequences of this document being relied upon by any other party, or being used for any other purpose, or containing any error or omission which is due to an error or omission in data supplied to us by other parties.


<p>22 Station Road Cambridge CB1 2JD United Kingdom</p> <p>T +44 (0)20 8774 2000 F +44 (0)20 8681 5706 W mottmac.com</p>	Client 					Title Cambridge Waste Water Treatment Plant Relocation Project Bats Proposed Development (Transect 2) - Visit 3			Drawn	AW																		
	<table border="1"> <thead> <tr> <th>Rev</th> <th>Date</th> <th>Drawn</th> <th>Description</th> <th>Ch'k'd</th> <th>App'd</th> </tr> </thead> <tbody> <tr> <td>P2</td> <td>31/10/22</td> <td>AW</td> <td>For Information</td> <td>AW</td> <td>JM</td> </tr> <tr> <td>P3</td> <td>20/09/23</td> <td>JC</td> <td>For Information</td> <td>AW</td> <td>CS</td> </tr> </tbody> </table>					Rev	Date	Drawn	Description	Ch'k'd	App'd	P2	31/10/22	AW	For Information	AW	JM	P3	20/09/23	JC	For Information	AW	CS	Drawing Number <p style="text-align: center;">Figure 8.55</p>			Checked	AW
	Rev	Date	Drawn	Description	Ch'k'd	App'd																						
P2	31/10/22	AW	For Information	AW	JM																							
P3	20/09/23	JC	For Information	AW	CS																							
					Approved Scale at A3 1:6,000			Approved	CS																			
								Security	Status	Rev																		
								STD	PRE	P3																		



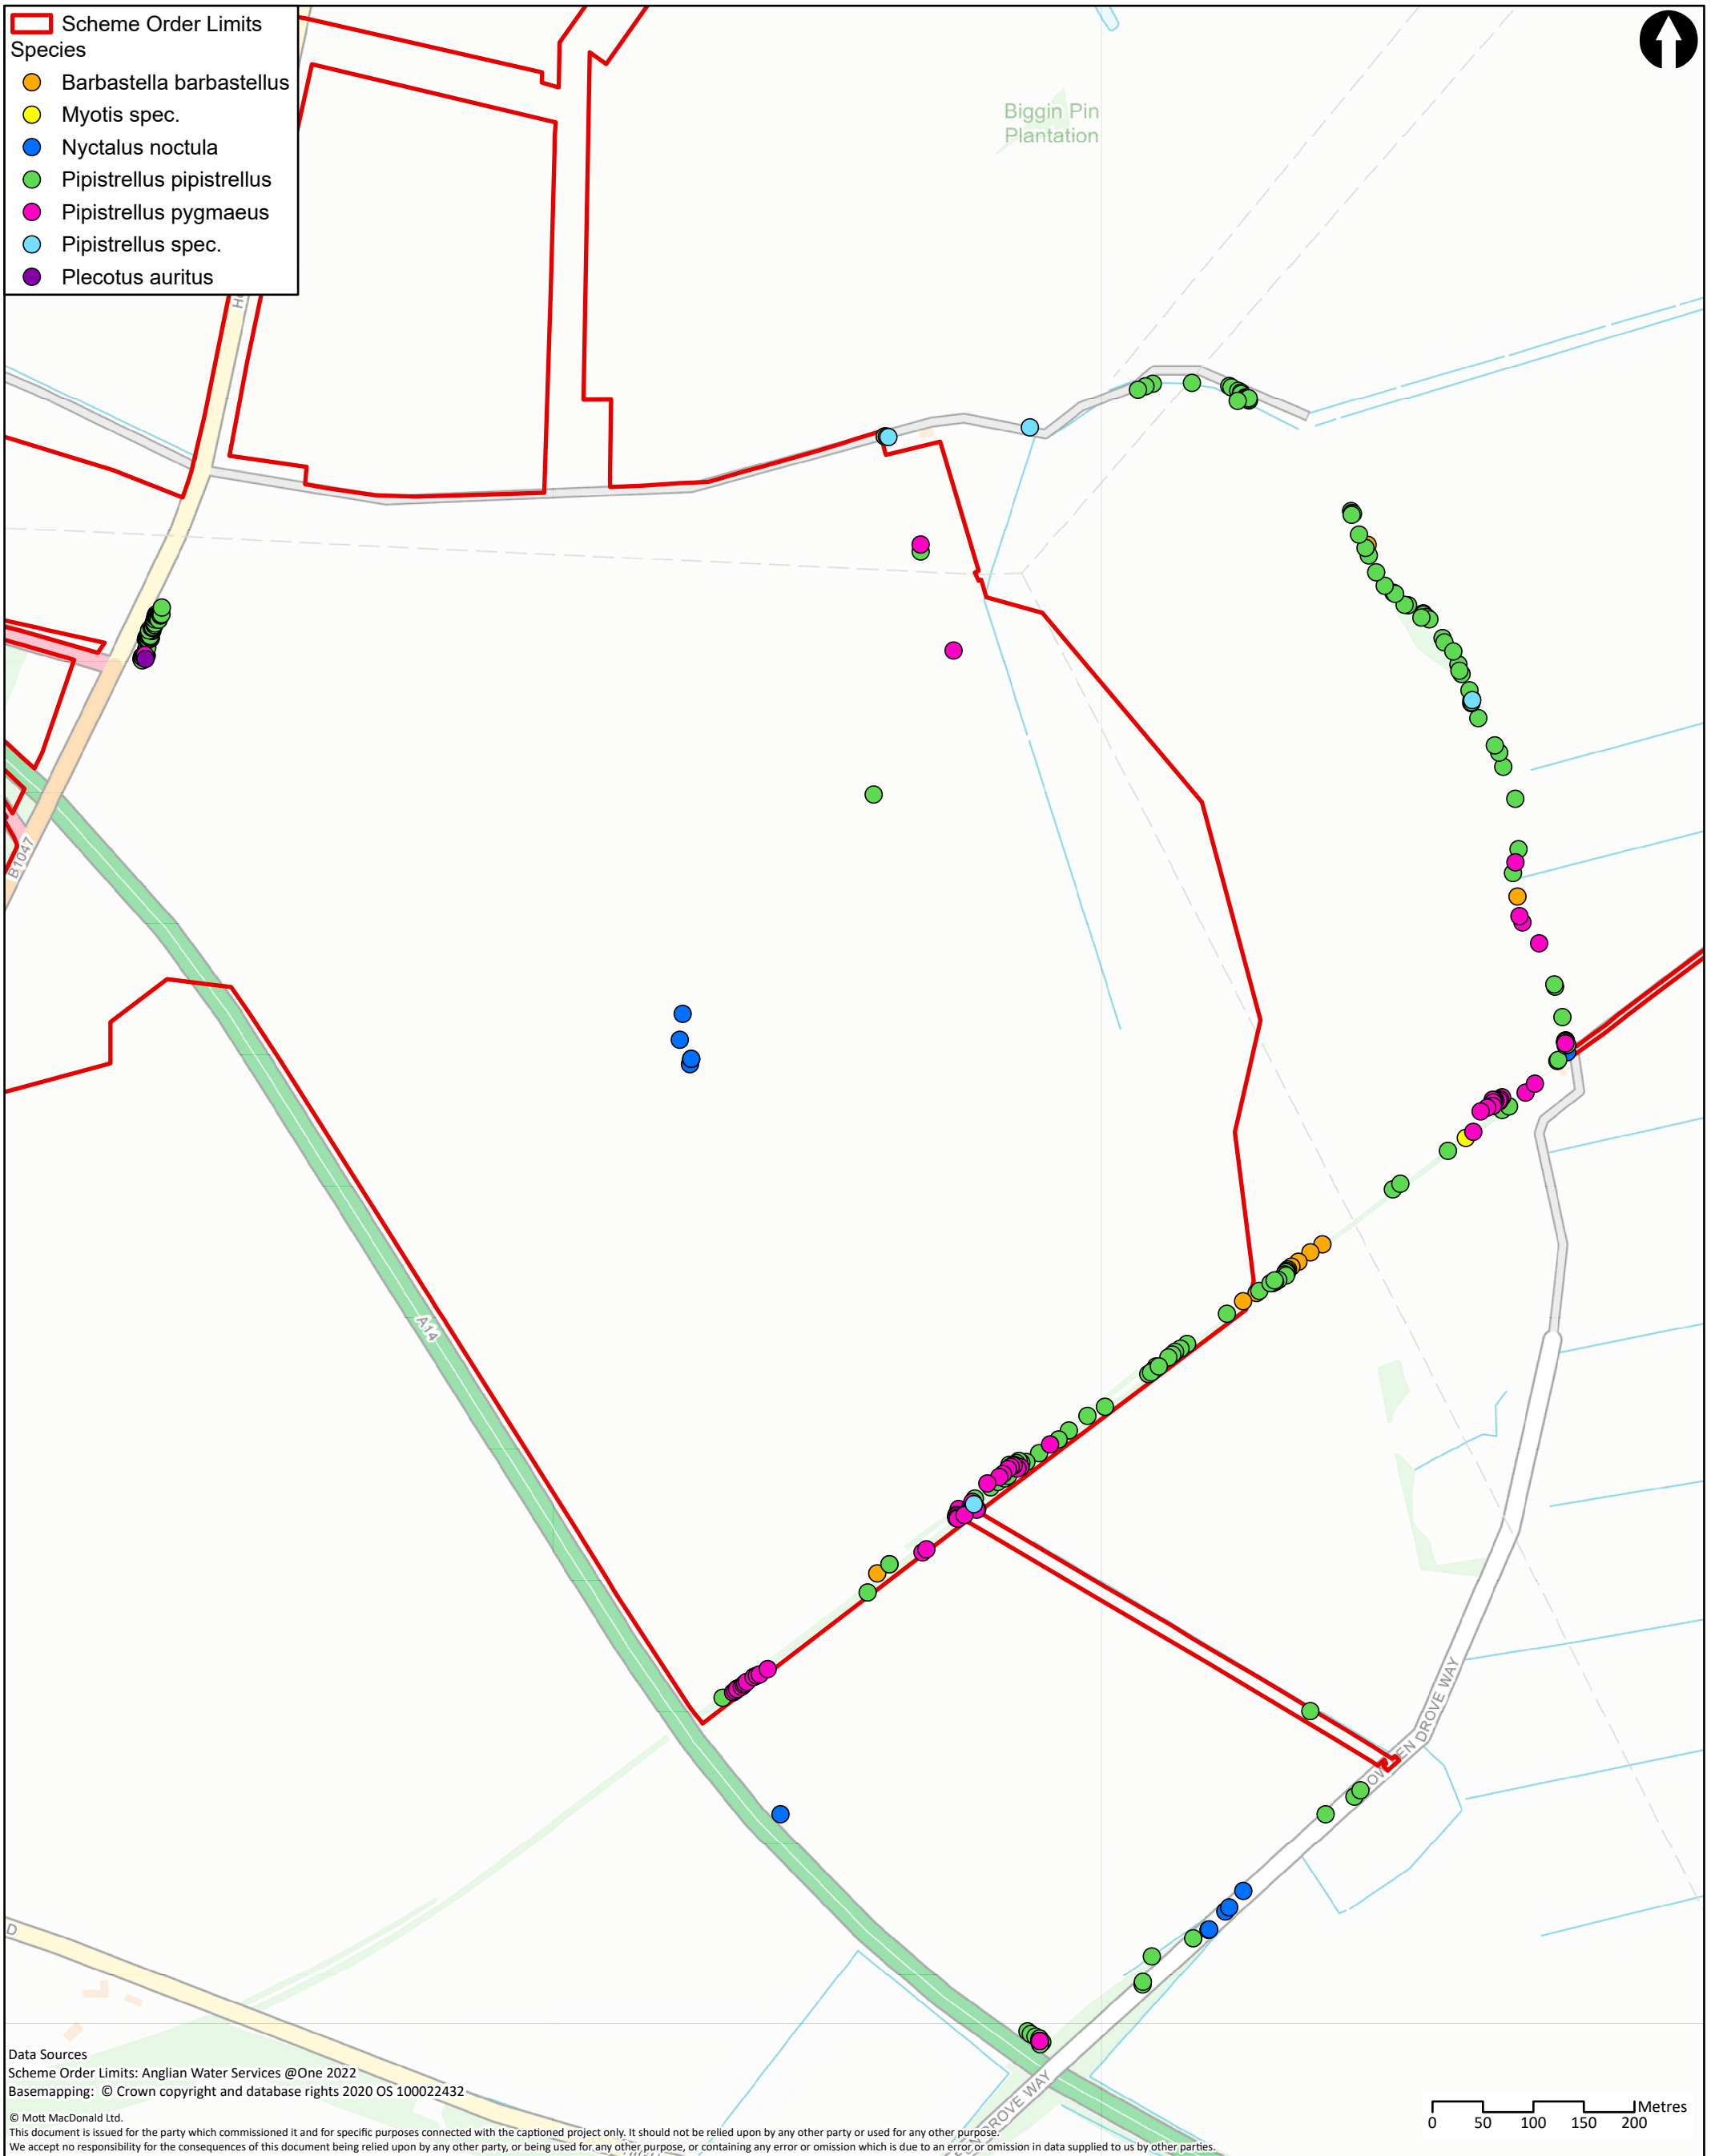

<p>22 Station Road Cambridge CB1 2JD United Kingdom</p> <p>T +44 (0)20 8774 2000 F +44 (0)20 8681 5706 W mottmac.com</p>	<p>Client</p>					<p>Title</p> <p>Cambridge Waste Water Treatment Plant Relocation Project</p> <p>Bats</p> <p>Proposed Development (Transect 2) – visits combined</p>			Drawn	AW																		
	<table border="1"> <thead> <tr> <th>Rev</th> <th>Date</th> <th>Drawn</th> <th>Description</th> <th>Ch'k'd</th> <th>App'd</th> </tr> </thead> <tbody> <tr> <td>P2</td> <td>31/10/22</td> <td>AW</td> <td>For Information</td> <td>AW</td> <td>JM</td> </tr> <tr> <td>P3</td> <td>20/09/23</td> <td>JC</td> <td>For Information</td> <td>AW</td> <td>CS</td> </tr> </tbody> </table>					Rev	Date	Drawn	Description	Ch'k'd	App'd	P2	31/10/22	AW	For Information	AW	JM	P3	20/09/23	JC	For Information	AW	CS	<p>Drawing Number</p> <p>Figure 8.56</p>			Checked	AW
	Rev	Date	Drawn	Description	Ch'k'd	App'd																						
P2	31/10/22	AW	For Information	AW	JM																							
P3	20/09/23	JC	For Information	AW	CS																							
								Approved	CS																			
								<p>Scale at A3</p> <p>1:6,000</p>																				
								Security	Status	Rev																		
								STD	PRE	P3																		



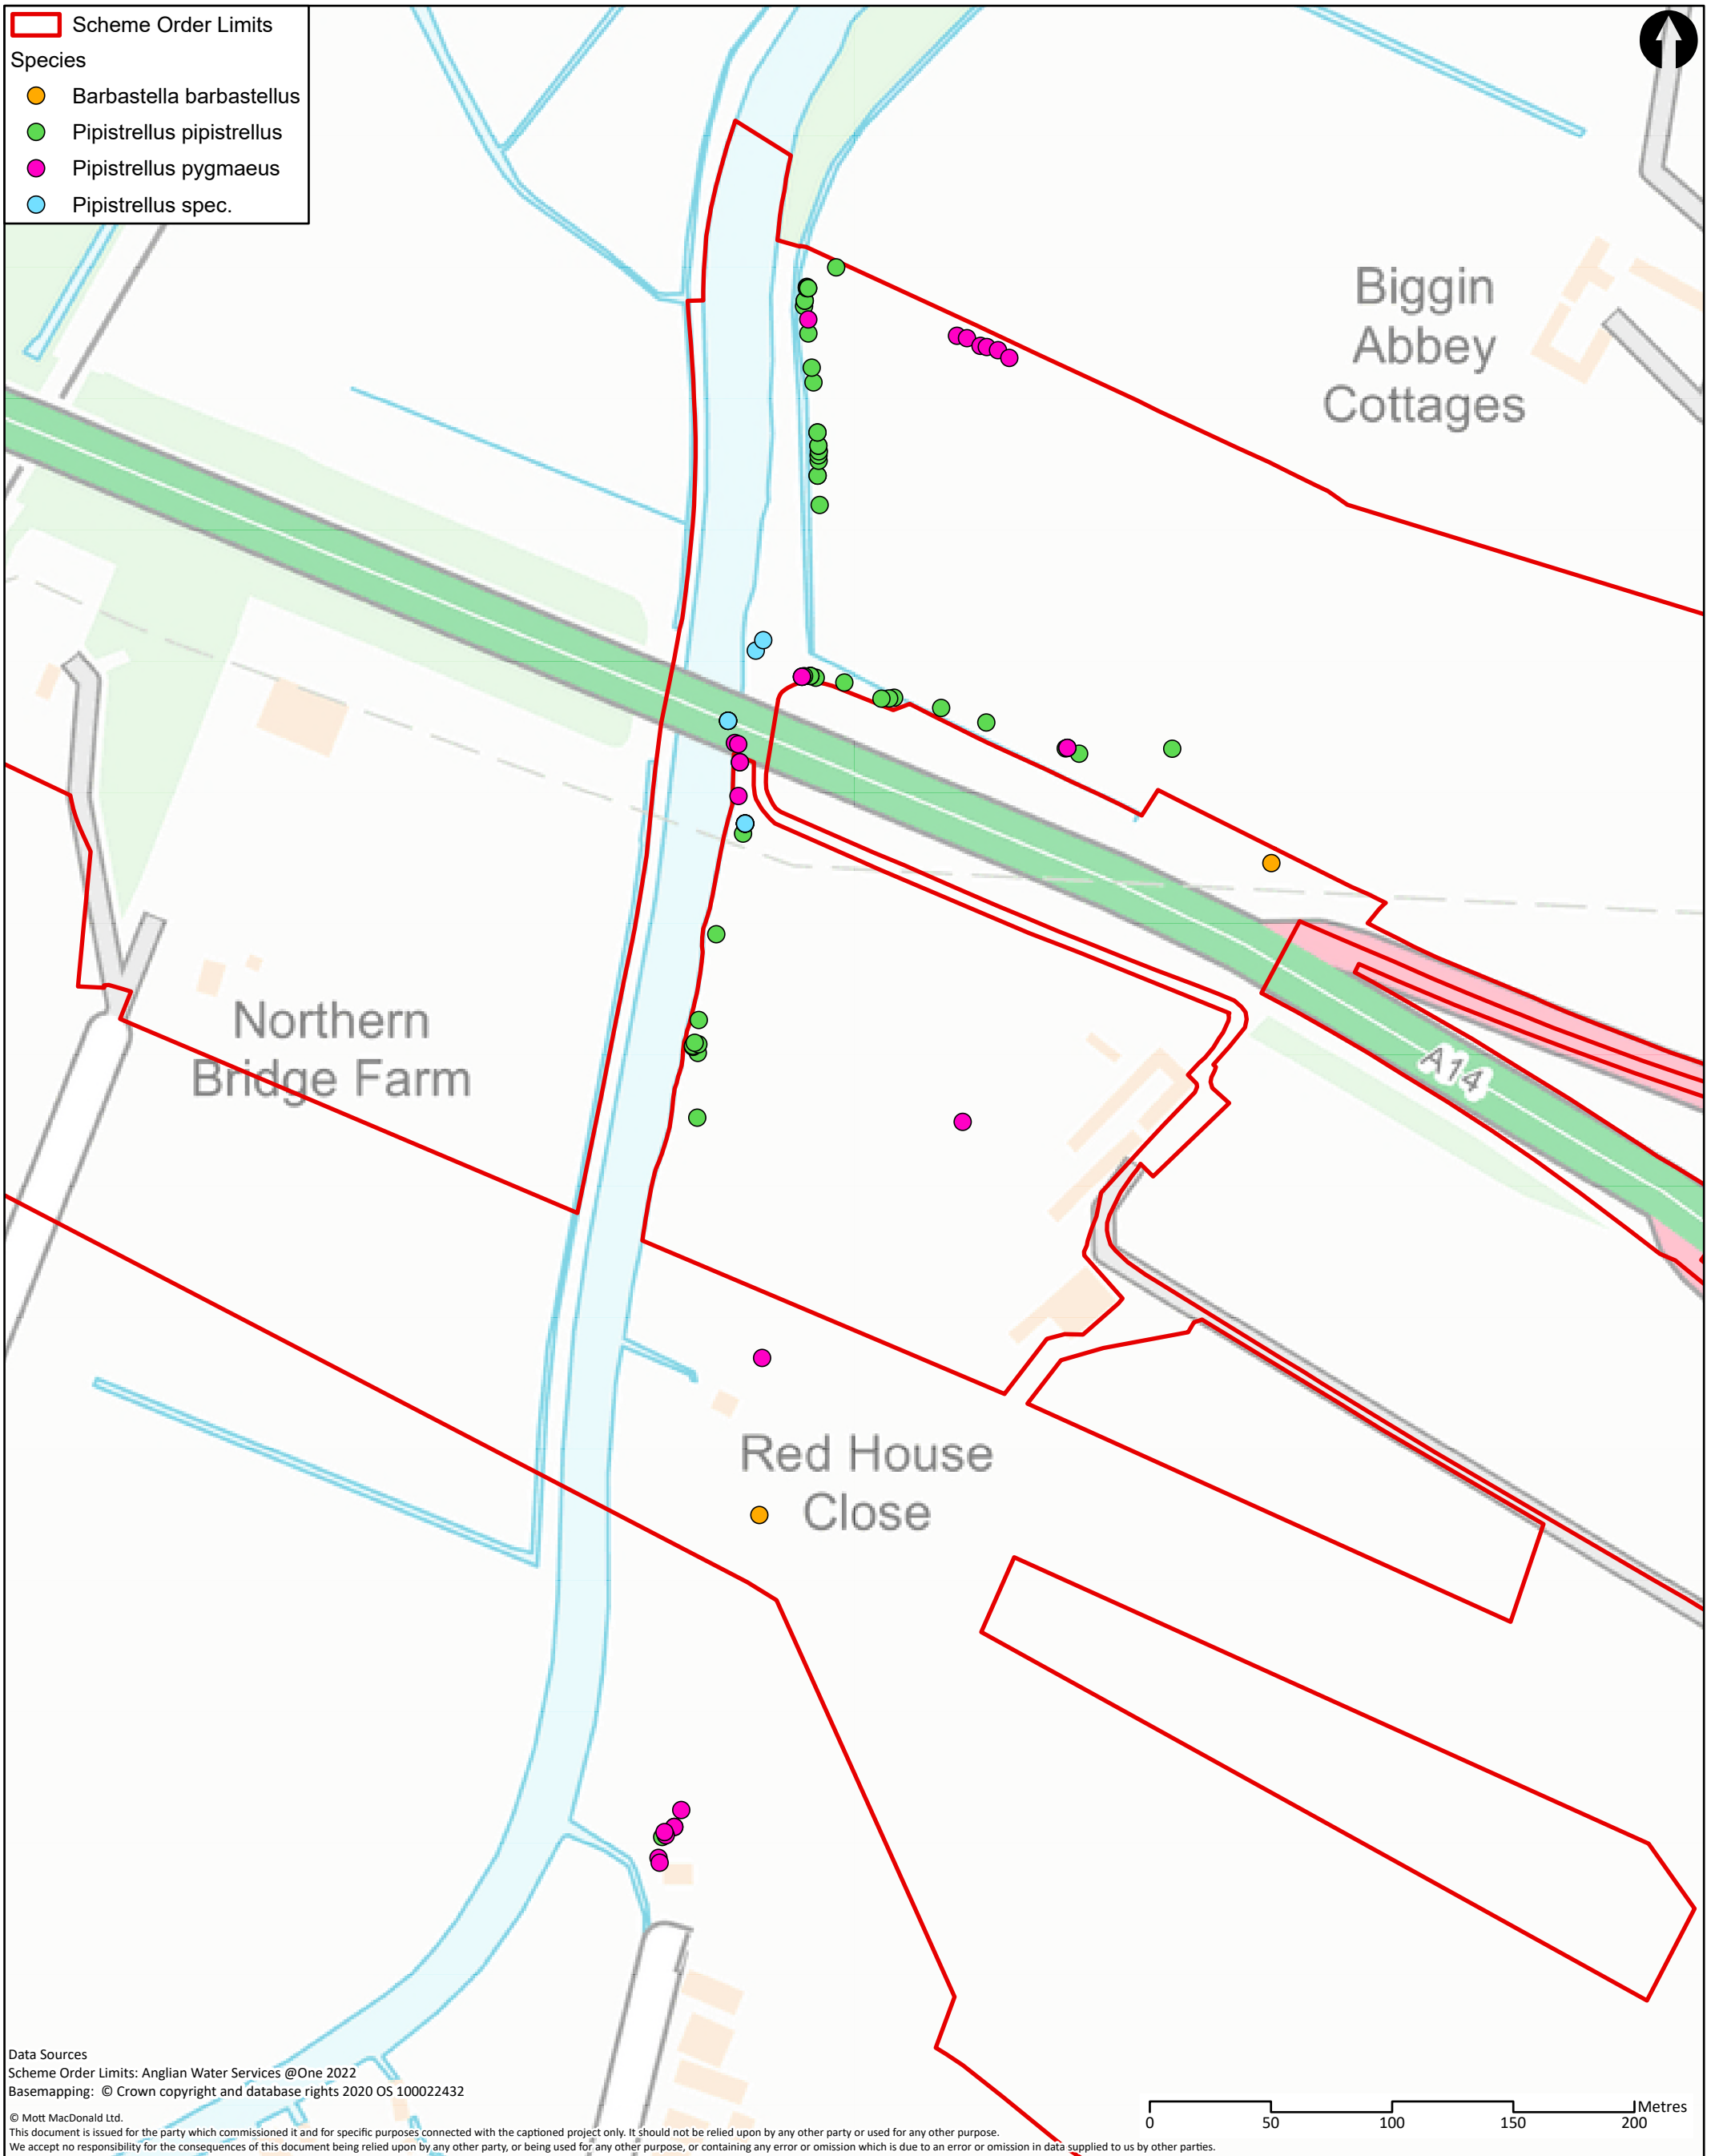


Data Sources  
 Scheme Order Limits: Anglian Water Services @One 2022  
 Basemapping: © Crown copyright and database rights 2020 OS 100022432

© Mott MacDonald Ltd.  
 This document is issued for the party which commissioned it and for specific purposes connected with the captioned project only. It should not be relied upon by any other party or used for any other purpose.  
 We accept no responsibility for the consequences of this document being relied upon by any other party, or being used for any other purpose, or containing any error or omission which is due to an error or omission in data supplied to us by other parties.

	22 Station Road Cambridge CB1 2JD United Kingdom					Title Cambridge Waste Water Treatment Plant Relocation Project Bats PRow, G040 and R037 (Transect 3) - Visit 1			Drawn	AW	
	T +44 (0)20 8774 2000 F +44 (0)20 8681 5706 W mottmac.com		Rev	Date	Drawn	Description	Ch'k'd	App'd	Checked	AW	
			P2	31/10/22	AW	For Information	AW	JM	Approved	CS	
		P3	20/09/23	JC	For Information	AW	CS	Scale at A3 1:2,500			
						Drawing Number Figure 8.57			Security	Status	Rev
									STD	PRE	P3



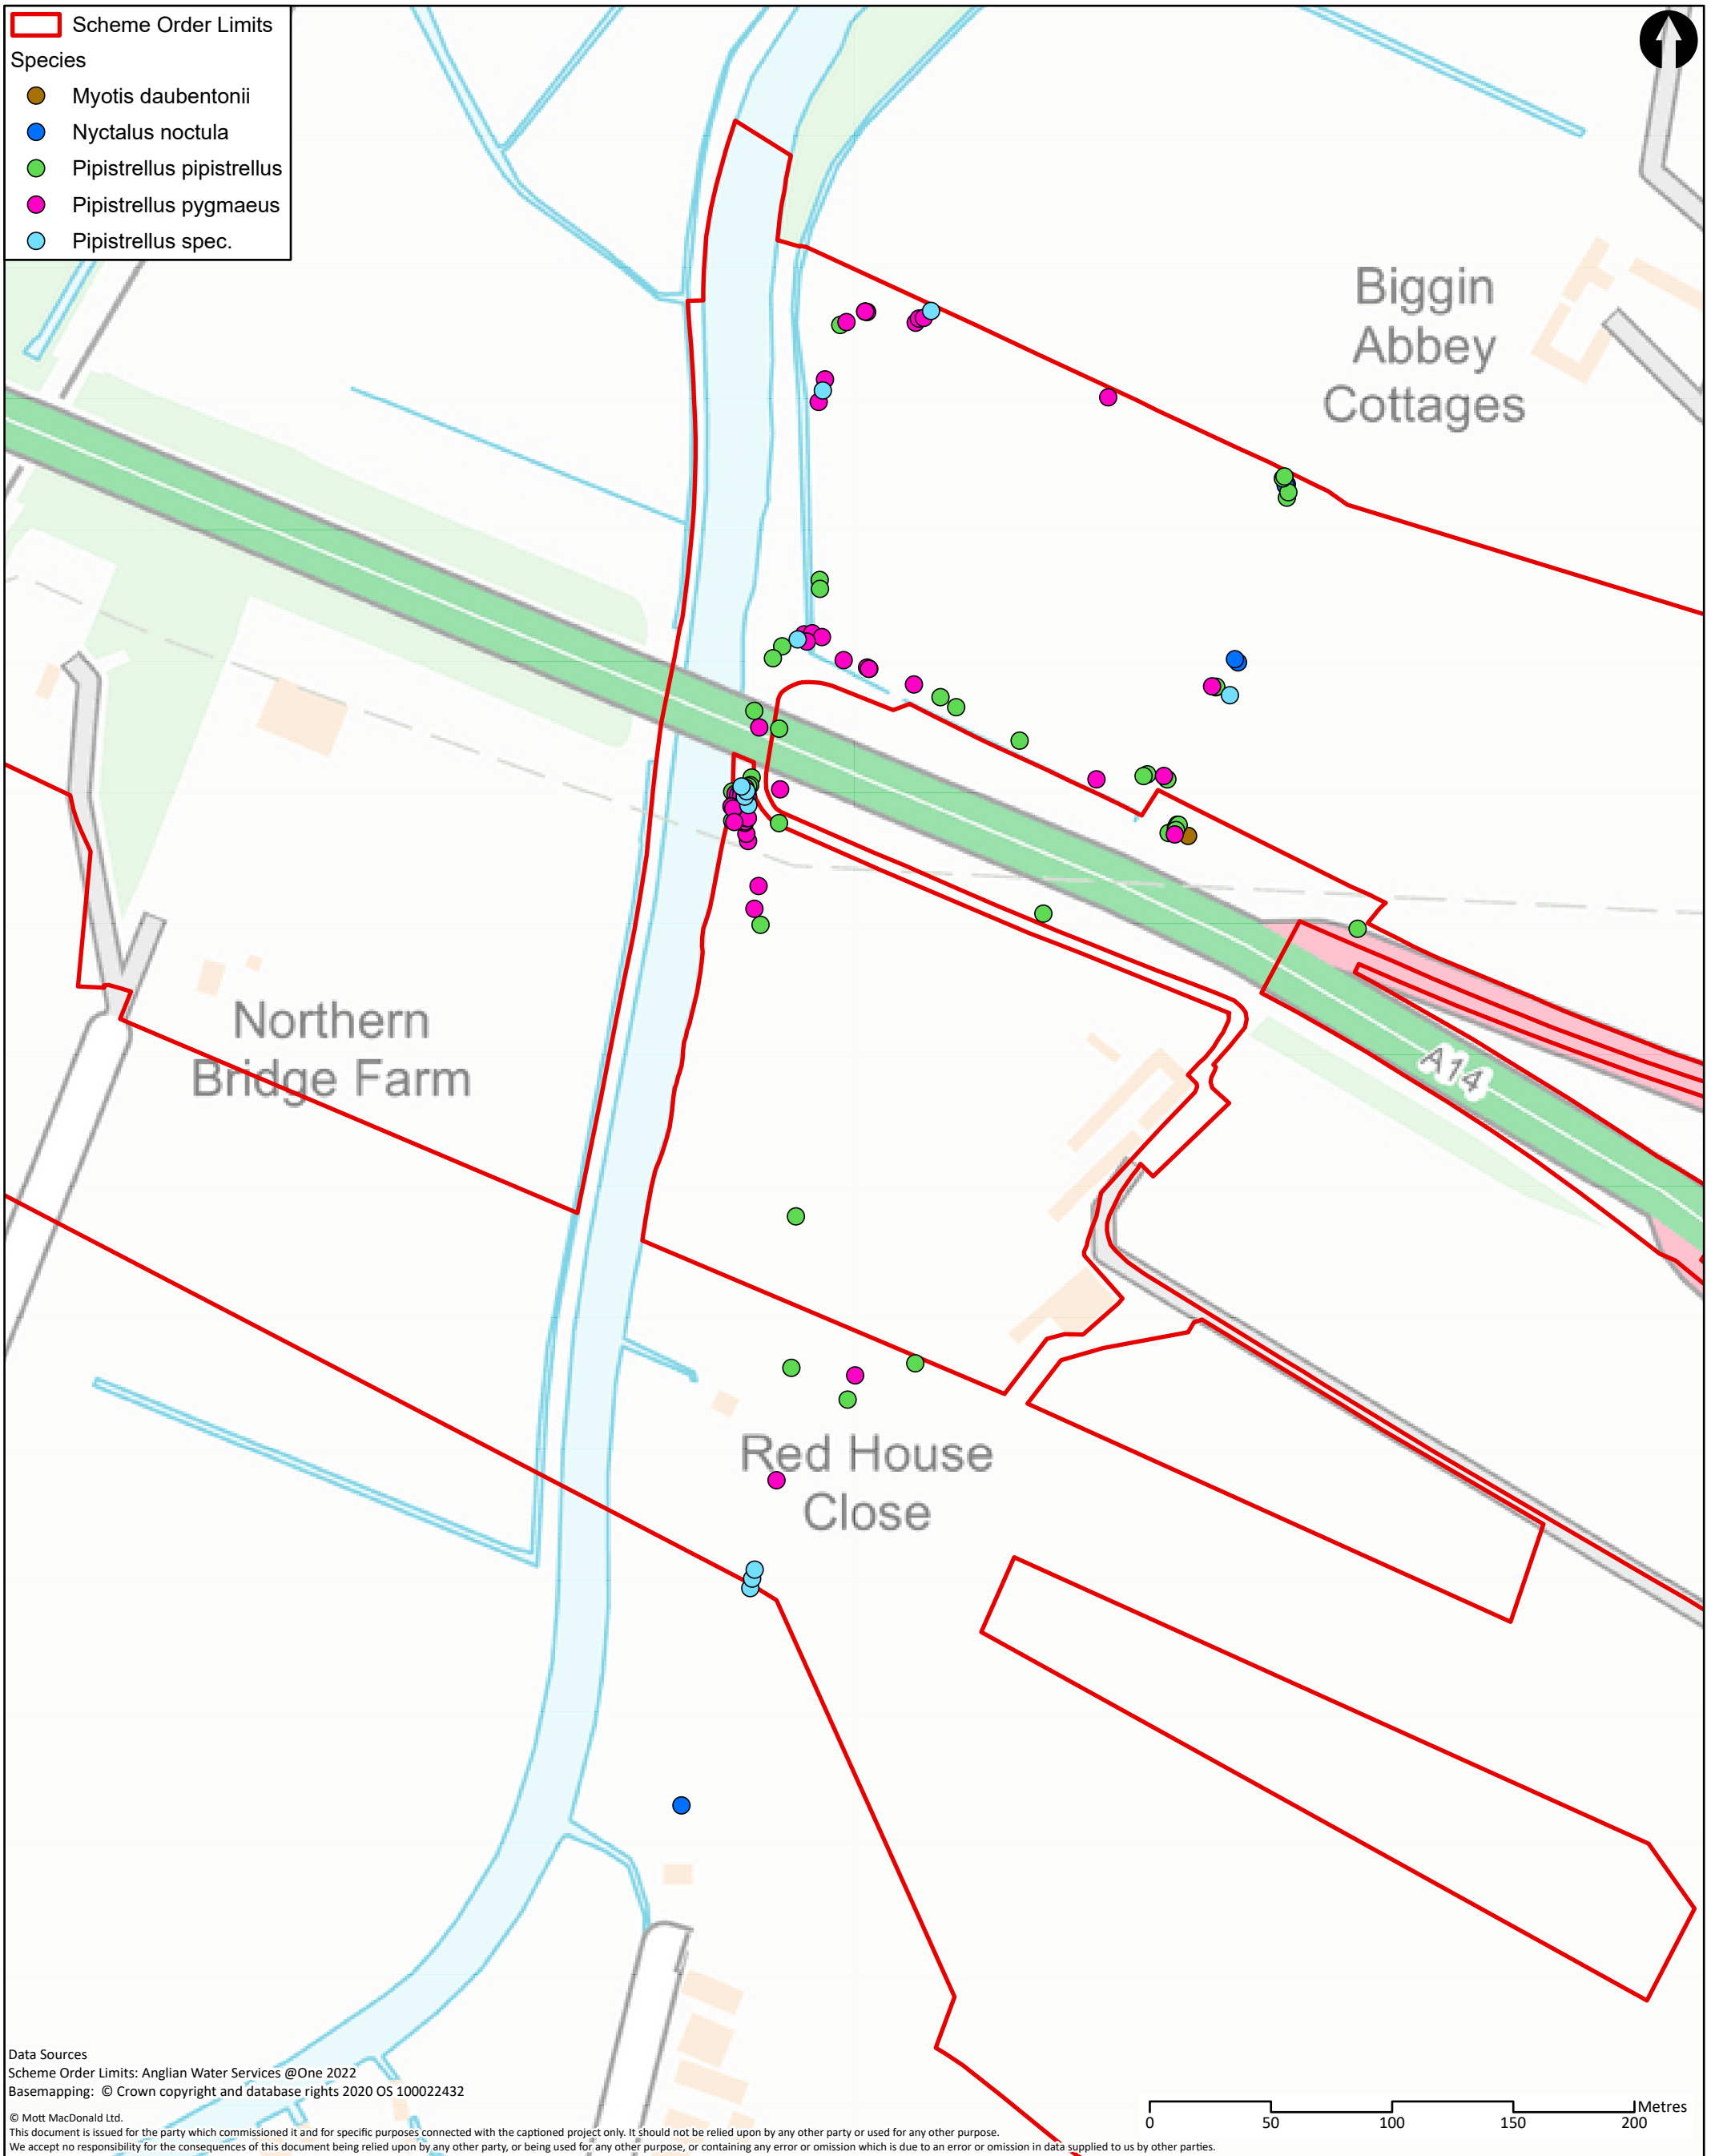


Data Sources  
 Scheme Order Limits: Anglian Water Services @One 2022  
 Basemapping: © Crown copyright and database rights 2020 OS 100022432

© Mott MacDonald Ltd.  
 This document is issued for the party which commissioned it and for specific purposes connected with the captioned project only. It should not be relied upon by any other party or used for any other purpose.  
 We accept no responsibility for the consequences of this document being relied upon by any other party, or being used for any other purpose, or containing any error or omission which is due to an error or omission in data supplied to us by other parties.


	22 Station Road Cambridge CB1 2JD United Kingdom		Client 			Title Cambridge Waste Water Treatment Plant Relocation Project Bats PRow, G040 and R037 (Transect 3) - Visit 2			Drawn	AW																		
	T +44 (0)20 8774 2000 F +44 (0)20 8681 5706 W mottmac.com		<table border="1"> <thead> <tr> <th>Rev</th> <th>Date</th> <th>Drawn</th> <th>Description</th> <th>Ch'k'd</th> <th>App'd</th> </tr> </thead> <tbody> <tr> <td>P1</td> <td>31/10/22</td> <td>AW</td> <td>First Draft</td> <td>AW</td> <td>JM</td> </tr> <tr> <td>P2</td> <td>20/09/23</td> <td>JC</td> <td>For Information</td> <td>AW</td> <td>CS</td> </tr> </tbody> </table>			Rev	Date	Drawn	Description	Ch'k'd	App'd	P1	31/10/22	AW	First Draft	AW	JM	P2	20/09/23	JC	For Information	AW	CS	Drawing Number Figure 8.58			Checked	AW
	Rev	Date	Drawn	Description	Ch'k'd	App'd																						
P1	31/10/22	AW	First Draft	AW	JM																							
P2	20/09/23	JC	For Information	AW	CS																							
						Approved CS			Scale at A3 1:2,500																			
									Security	Status	Rev																	
									STD	PRE	P2																	



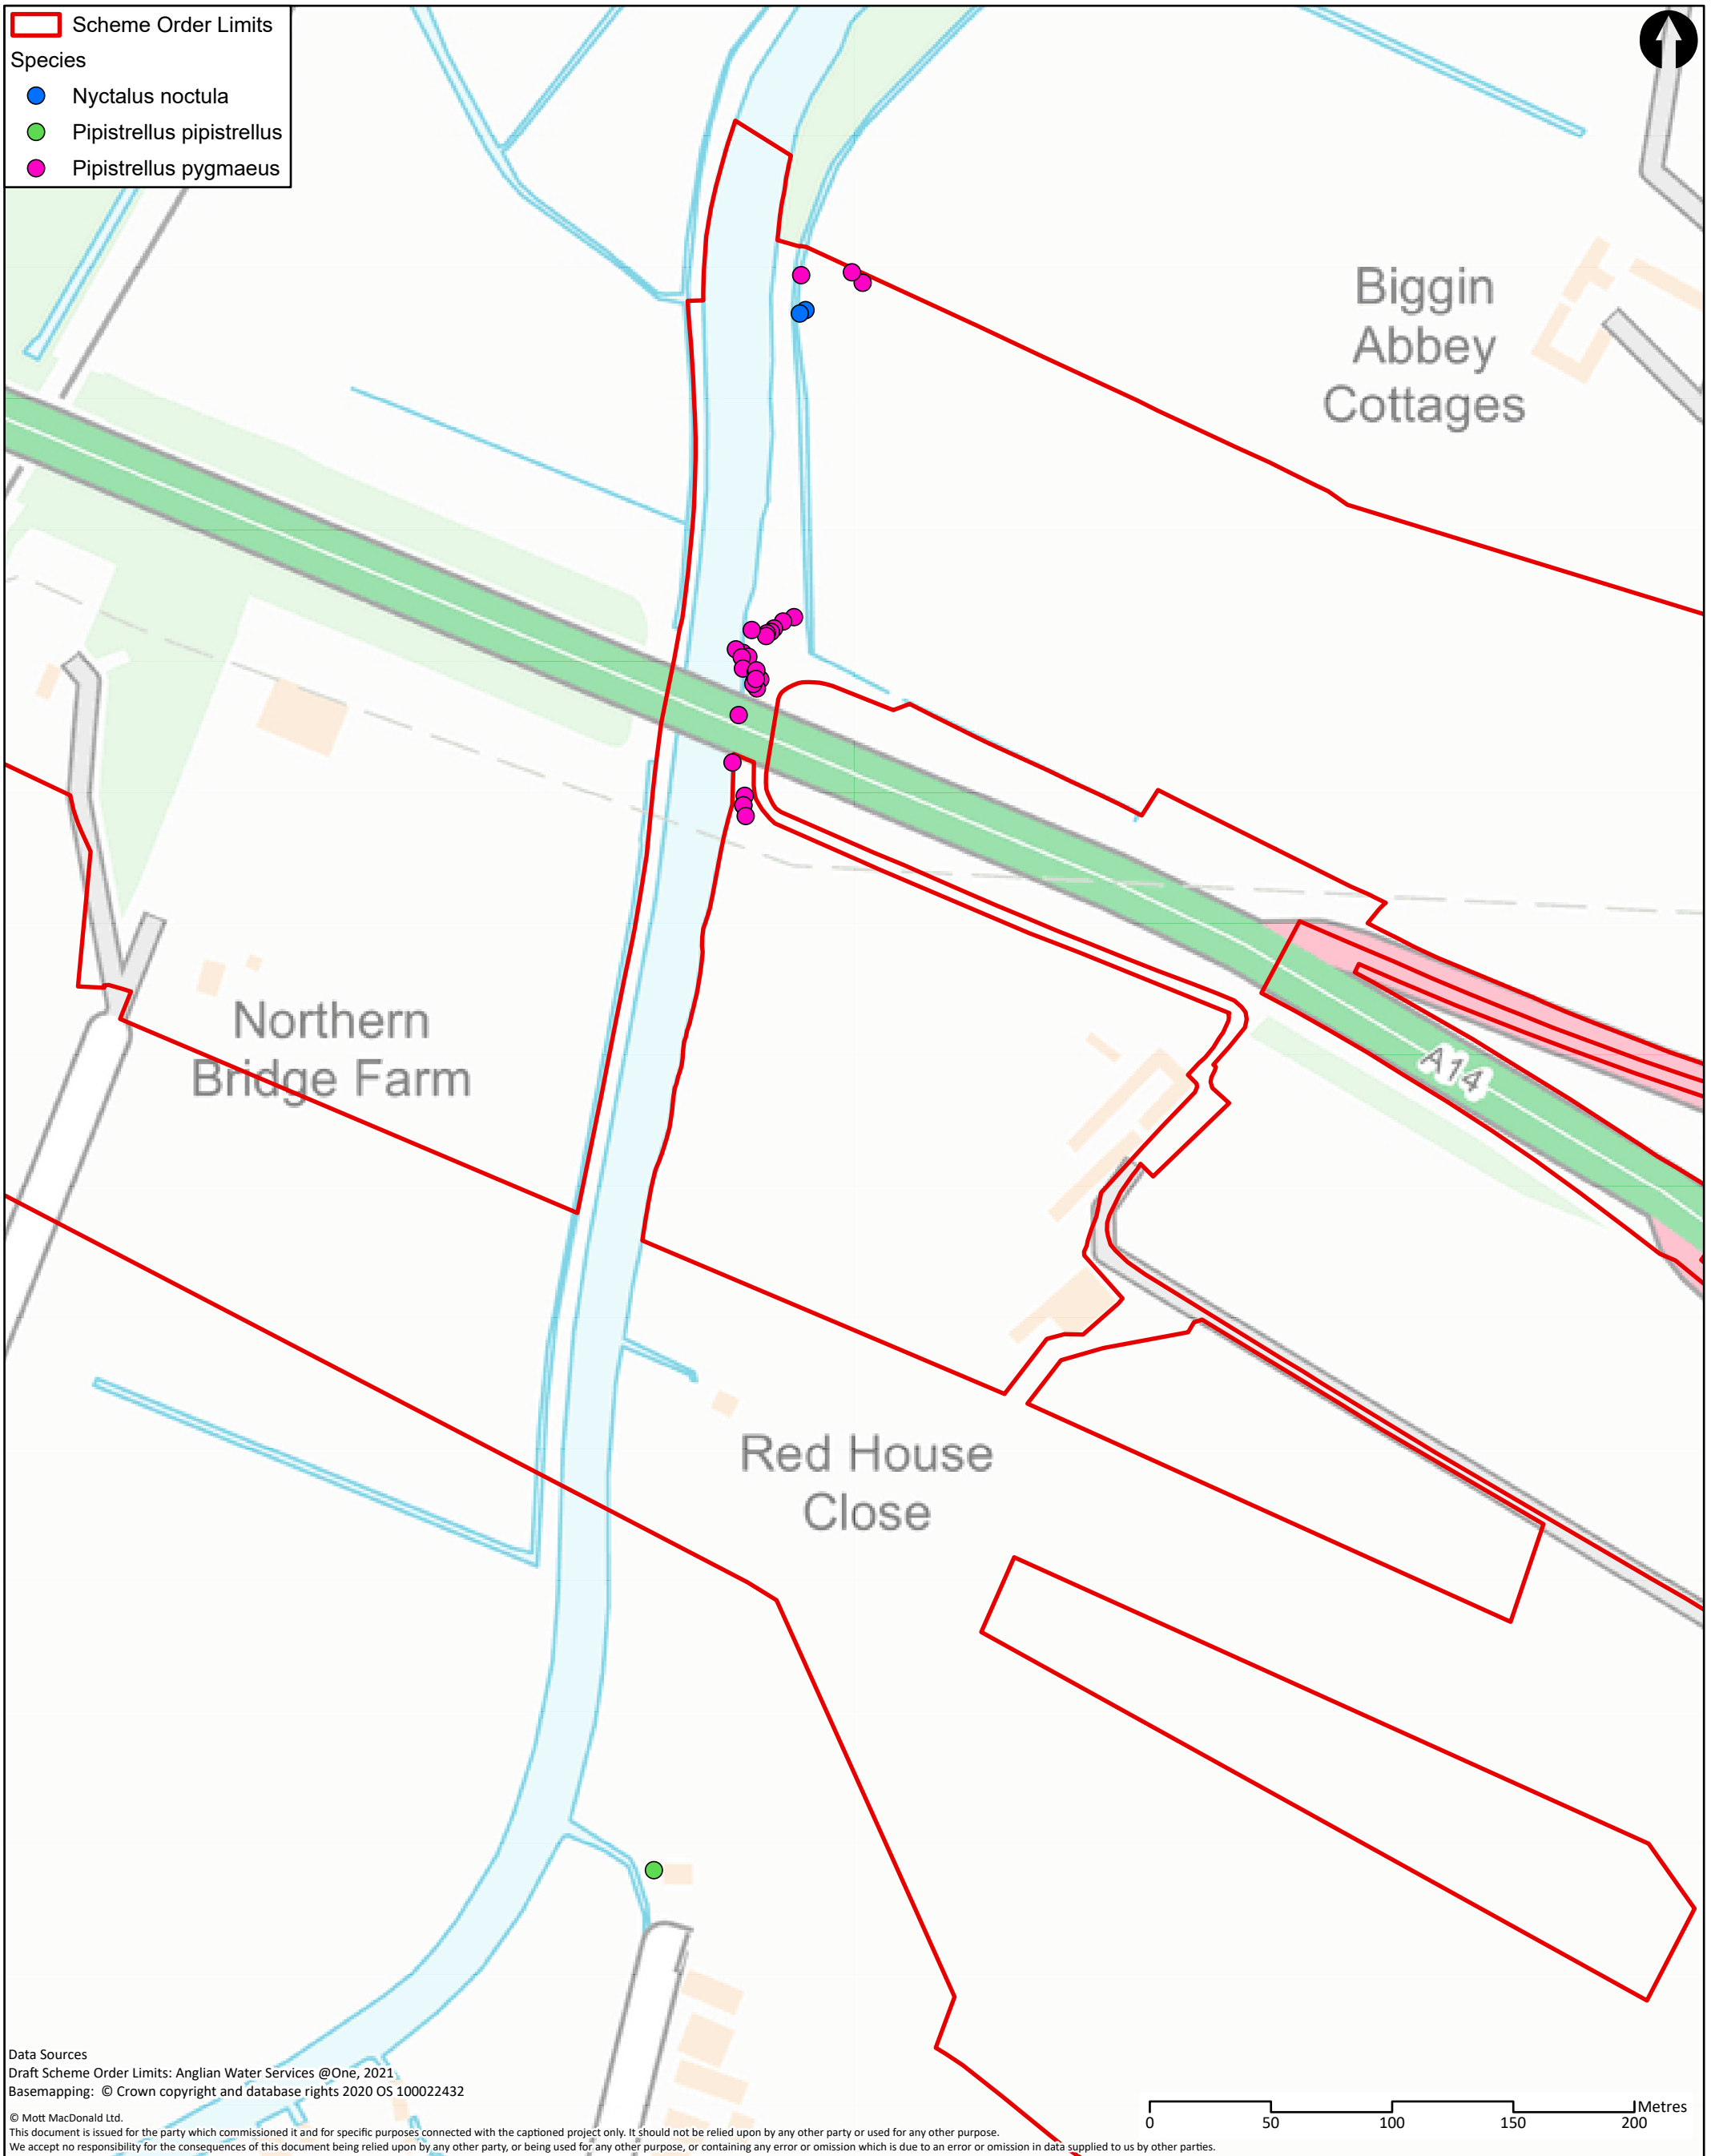

<p>22 Station Road Cambridge CB1 2JD United Kingdom</p> <p>T +44 (0)20 8774 2000 F +44 (0)20 8681 5706 W mottmac.com</p>	<p>Client</p>					<p>Title</p> <p>Cambridge Waste Water Treatment Plant Relocation Project Bats PRoW, G040 and R037 (Transect 3) - Visit 3</p>			Drawn	AW																		
	<table border="1"> <thead> <tr> <th>Rev</th> <th>Date</th> <th>Drawn</th> <th>Description</th> <th>Ch'k'd</th> <th>App'd</th> </tr> </thead> <tbody> <tr> <td>P1</td> <td>31/10/22</td> <td>AW</td> <td>First Draft</td> <td>AW</td> <td>JM</td> </tr> <tr> <td>P2</td> <td>20/09/23</td> <td>JC</td> <td>For Information</td> <td>AW</td> <td>CS</td> </tr> </tbody> </table>					Rev	Date	Drawn	Description	Ch'k'd	App'd	P1	31/10/22	AW	First Draft	AW	JM	P2	20/09/23	JC	For Information	AW	CS	<p>Drawing Number</p> <p>Figure 8.59</p>			Checked	AW
	Rev	Date	Drawn	Description	Ch'k'd	App'd																						
P1	31/10/22	AW	First Draft	AW	JM																							
P2	20/09/23	JC	For Information	AW	CS																							
					<p>Scale at A3</p> <p>1:2,500</p>			Approved	CS																			
								Security	Status	Rev																		
								STD	PRE	P2																		



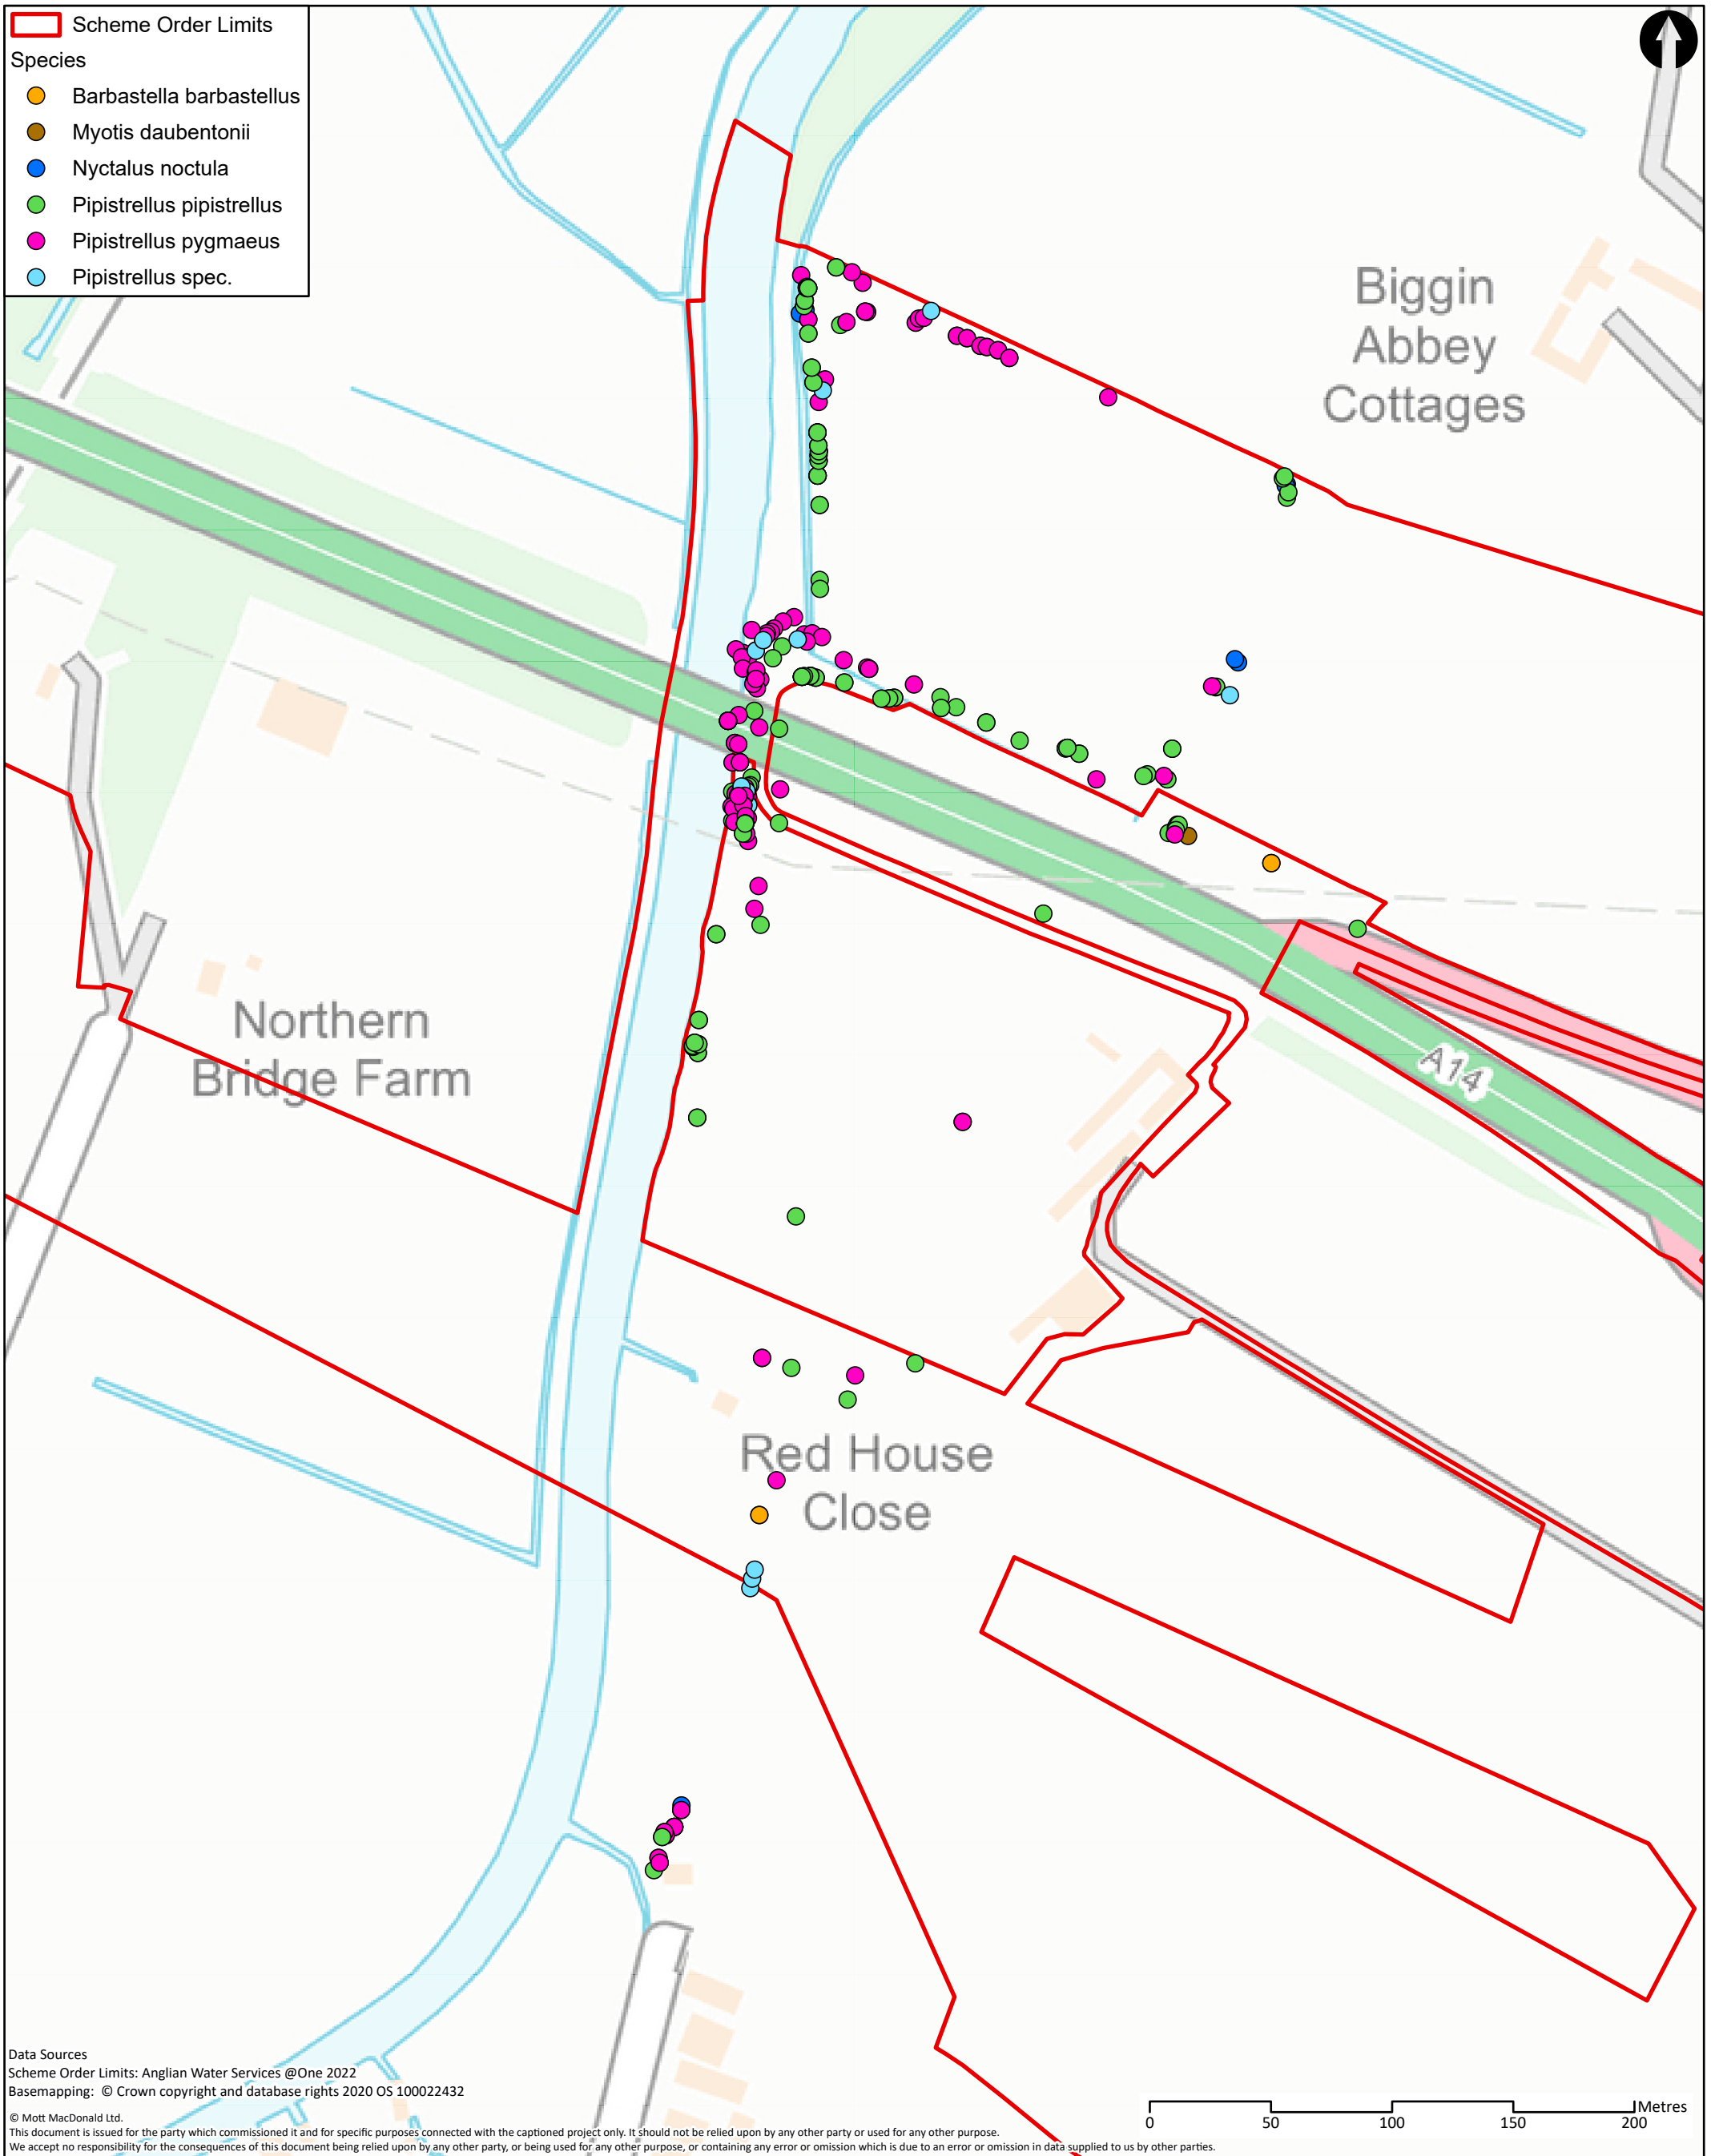


Data Sources  
 Scheme Order Limits: Anglian Water Services @One 2022  
 Basemapping: © Crown copyright and database rights 2020 OS 100022432

© Mott MacDonald Ltd.  
 This document is issued for the party which commissioned it and for specific purposes connected with the captioned project only. It should not be relied upon by any other party or used for any other purpose.  
 We accept no responsibility for the consequences of this document being relied upon by any other party, or being used for any other purpose, or containing any error or omission which is due to an error or omission in data supplied to us by other parties.

<p>22 Station Road Cambridge CB1 2JD United Kingdom</p> <p>T +44 (0)20 8774 2000 F +44 (0)20 8681 5706 W mottmac.com</p>	Client 					Title Cambridge Waste Water Treatment Plant Relocation Project Bats PRow, G040 and R037 (Transect 3) – visits combined			Drawn	AW																		
	<table border="1"> <thead> <tr> <th>Rev</th> <th>Date</th> <th>Drawn</th> <th>Description</th> <th>Ch'k'd</th> <th>App'd</th> </tr> </thead> <tbody> <tr> <td>P2</td> <td>31/10/22</td> <td>AW</td> <td>First Draft</td> <td>AW</td> <td>JM</td> </tr> <tr> <td>P3</td> <td>20/09/23</td> <td>JC</td> <td>For Information</td> <td>AW</td> <td>CS</td> </tr> </tbody> </table>					Rev	Date	Drawn	Description	Ch'k'd	App'd	P2	31/10/22	AW	First Draft	AW	JM	P3	20/09/23	JC	For Information	AW	CS	Drawing Number Figure 8.60			Checked	AW
						Rev	Date	Drawn	Description	Ch'k'd	App'd																	
	P2	31/10/22	AW	First Draft	AW	JM																						
P3	20/09/23	JC	For Information	AW	CS																							
Approved CS			Scale at A3 1:2,500																									
								Security	Status	Rev																		
								STD	PRE	P3																		



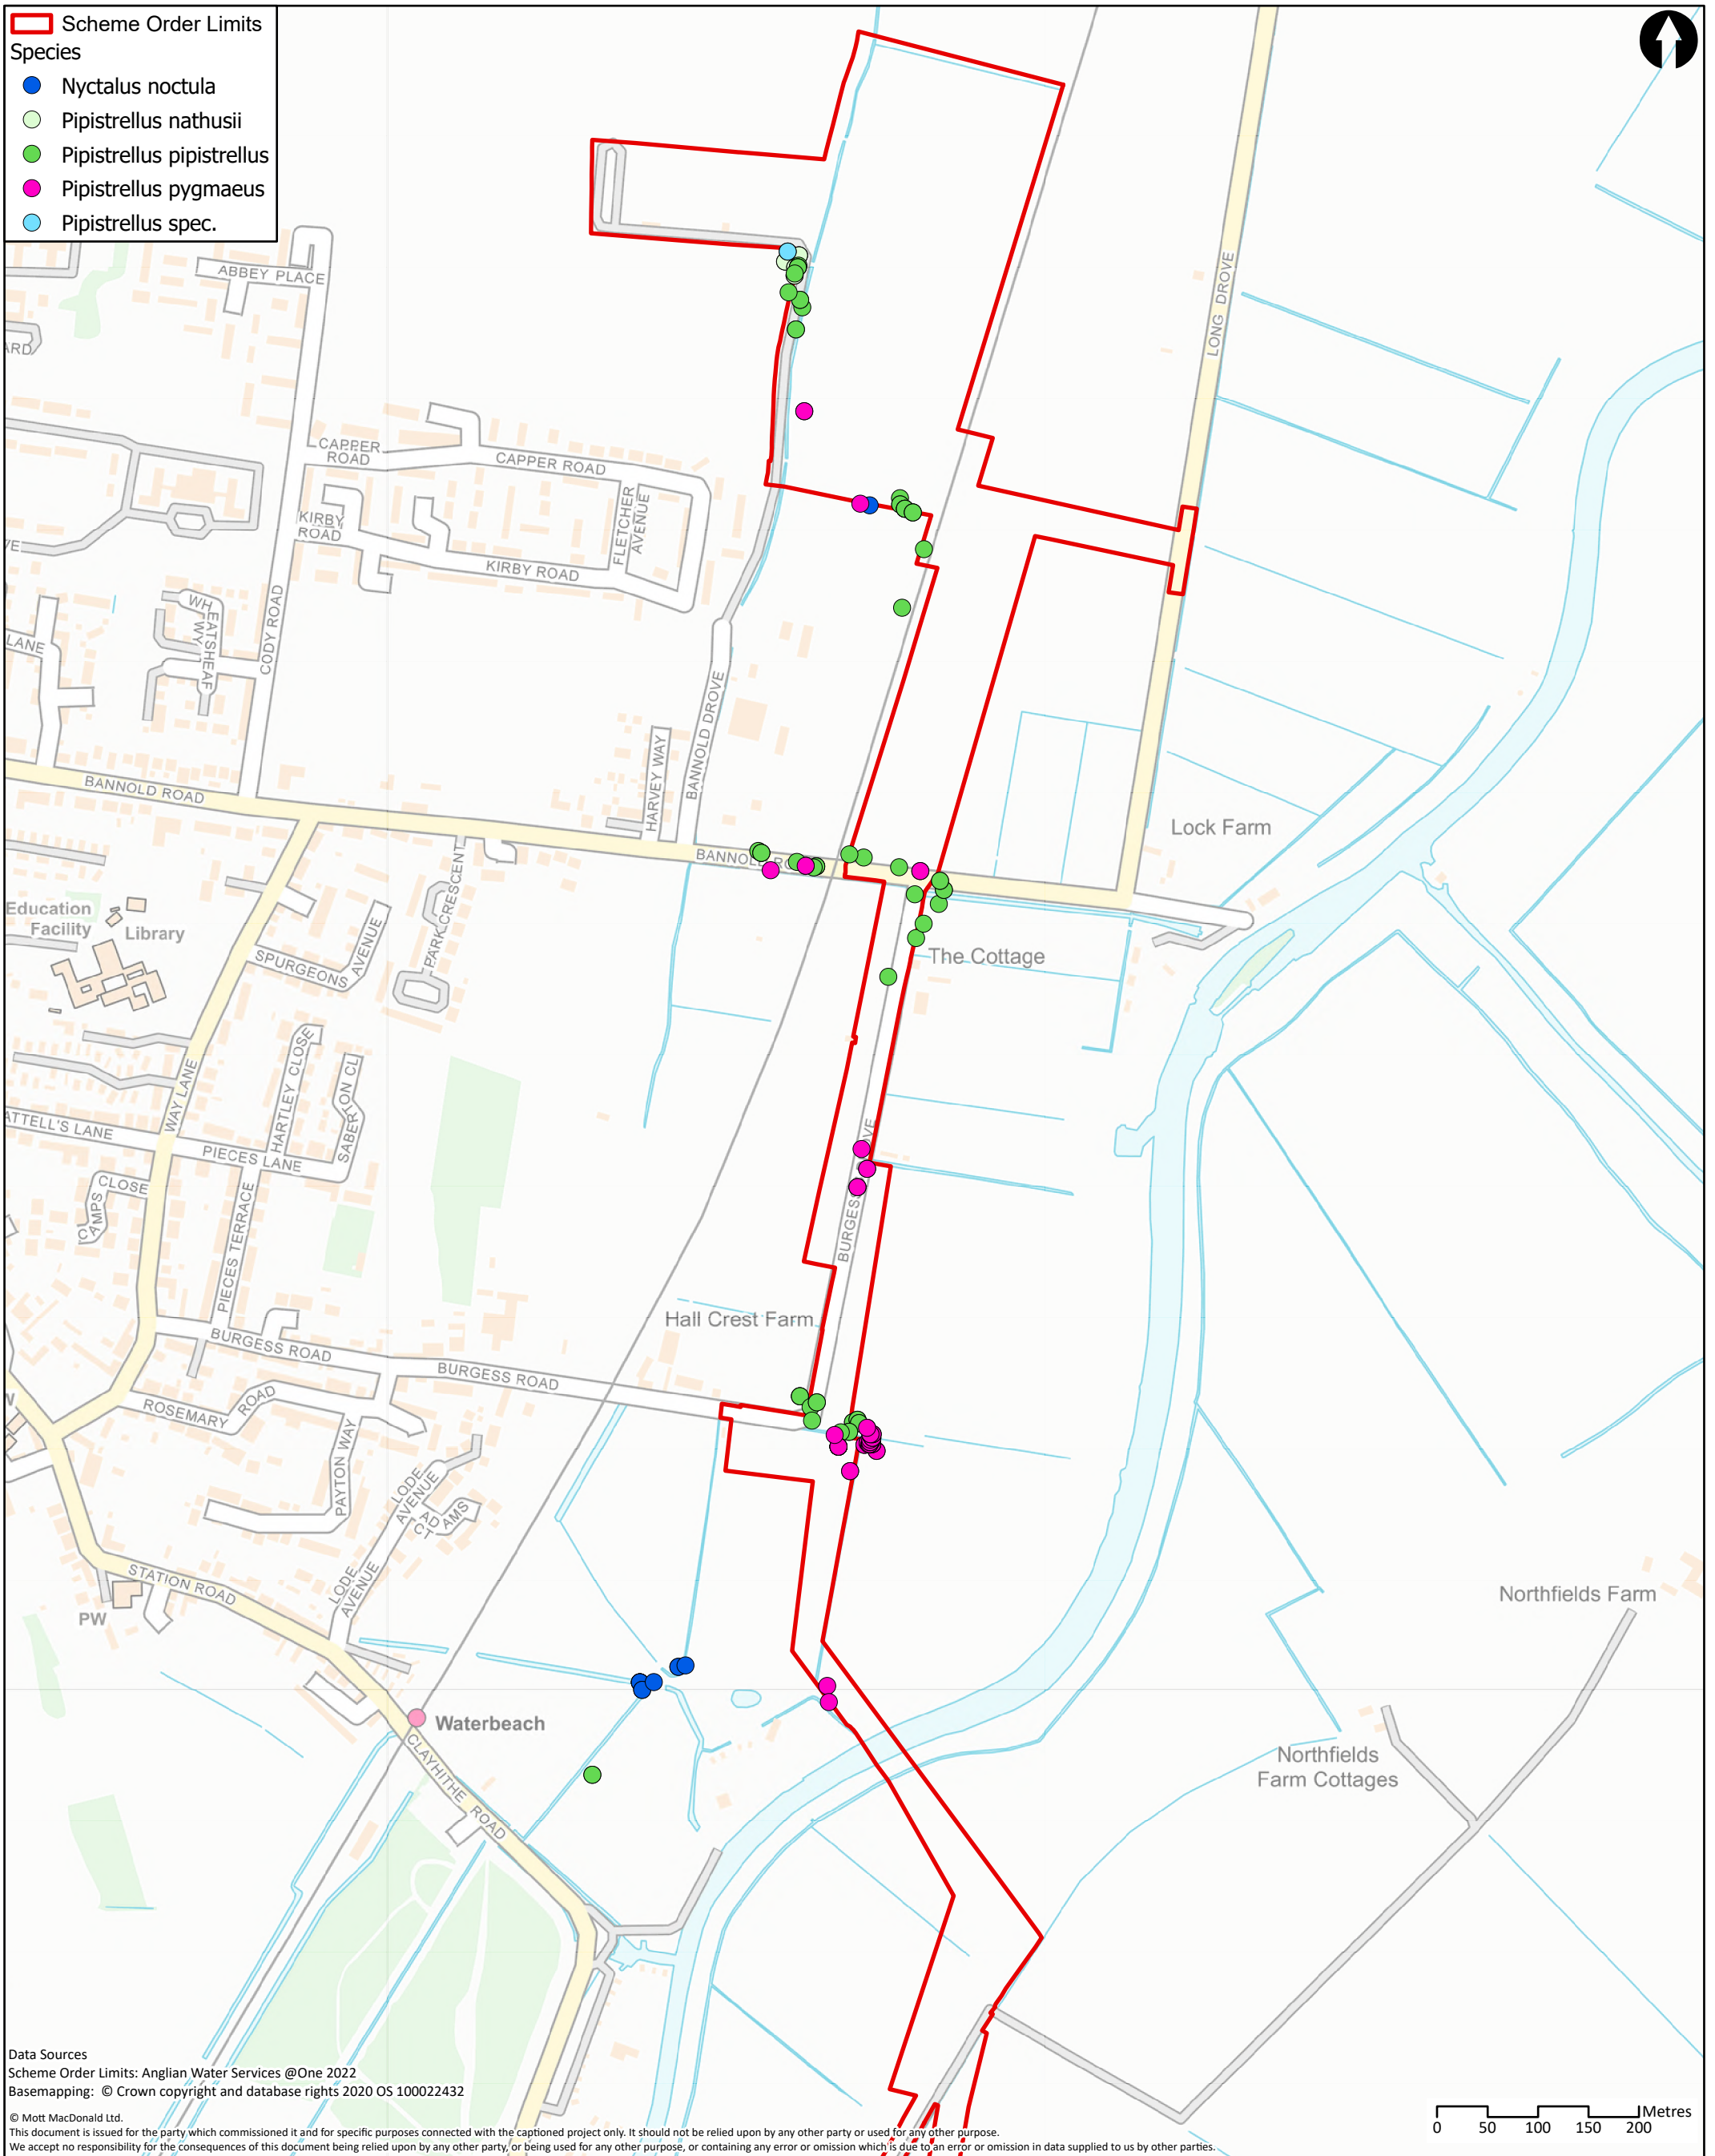


Data Sources  
 Scheme Order Limits: Anglian Water Services @One 2022  
 Basemapping: © Crown copyright and database rights 2020 OS 100022432  
 © Mott MacDonald Ltd.  
 This document is issued for the party which commissioned it and for specific purposes connected with the captioned project only. It should not be relied upon by any other party or used for any other purpose.  
 We accept no responsibility for the consequences of this document being relied upon by any other party, or being used for any other purpose, or containing any error or omission which is due to an error or omission in data supplied to us by other parties.

<p>22 Station Road Cambridge CB1 2JD United Kingdom</p> <p>T +44 (0)20 8774 2000 F +44 (0)20 8681 5706 W mottmac.com</p>	Client 					Title Cambridge Waste Water Treatment Plant Relocation Project Bats Waterbeach pipeline transect data from June – north transect			Drawn	AW																		
	<table border="1"> <thead> <tr> <th>Rev</th> <th>Date</th> <th>Drawn</th> <th>Description</th> <th>Ch'k'd</th> <th>App'd</th> </tr> </thead> <tbody> <tr> <td>P2</td> <td>31/10/22</td> <td>AW</td> <td>For Information</td> <td>AW</td> <td>JM</td> </tr> <tr> <td>P3</td> <td>20/09/23</td> <td>JC</td> <td>For Information</td> <td>AW</td> <td>CS</td> </tr> </tbody> </table>					Rev	Date	Drawn	Description	Ch'k'd	App'd	P2	31/10/22	AW	For Information	AW	JM	P3	20/09/23	JC	For Information	AW	CS	Drawing Number <b>Figure 8.61</b>			Checked	AW
	Rev	Date	Drawn	Description	Ch'k'd	App'd																						
P2	31/10/22	AW	For Information	AW	JM																							
P3	20/09/23	JC	For Information	AW	CS																							
								Approved	CS																			
								Scale at A3 1:6,000																				
								Security	Status	Rev																		
								STD	PRE	P3																		



- Scheme Order Limits**
- Species**
- Nyctalus noctula
  - Pipistrellus pipistrellus
  - Pipistrellus pygmaeus

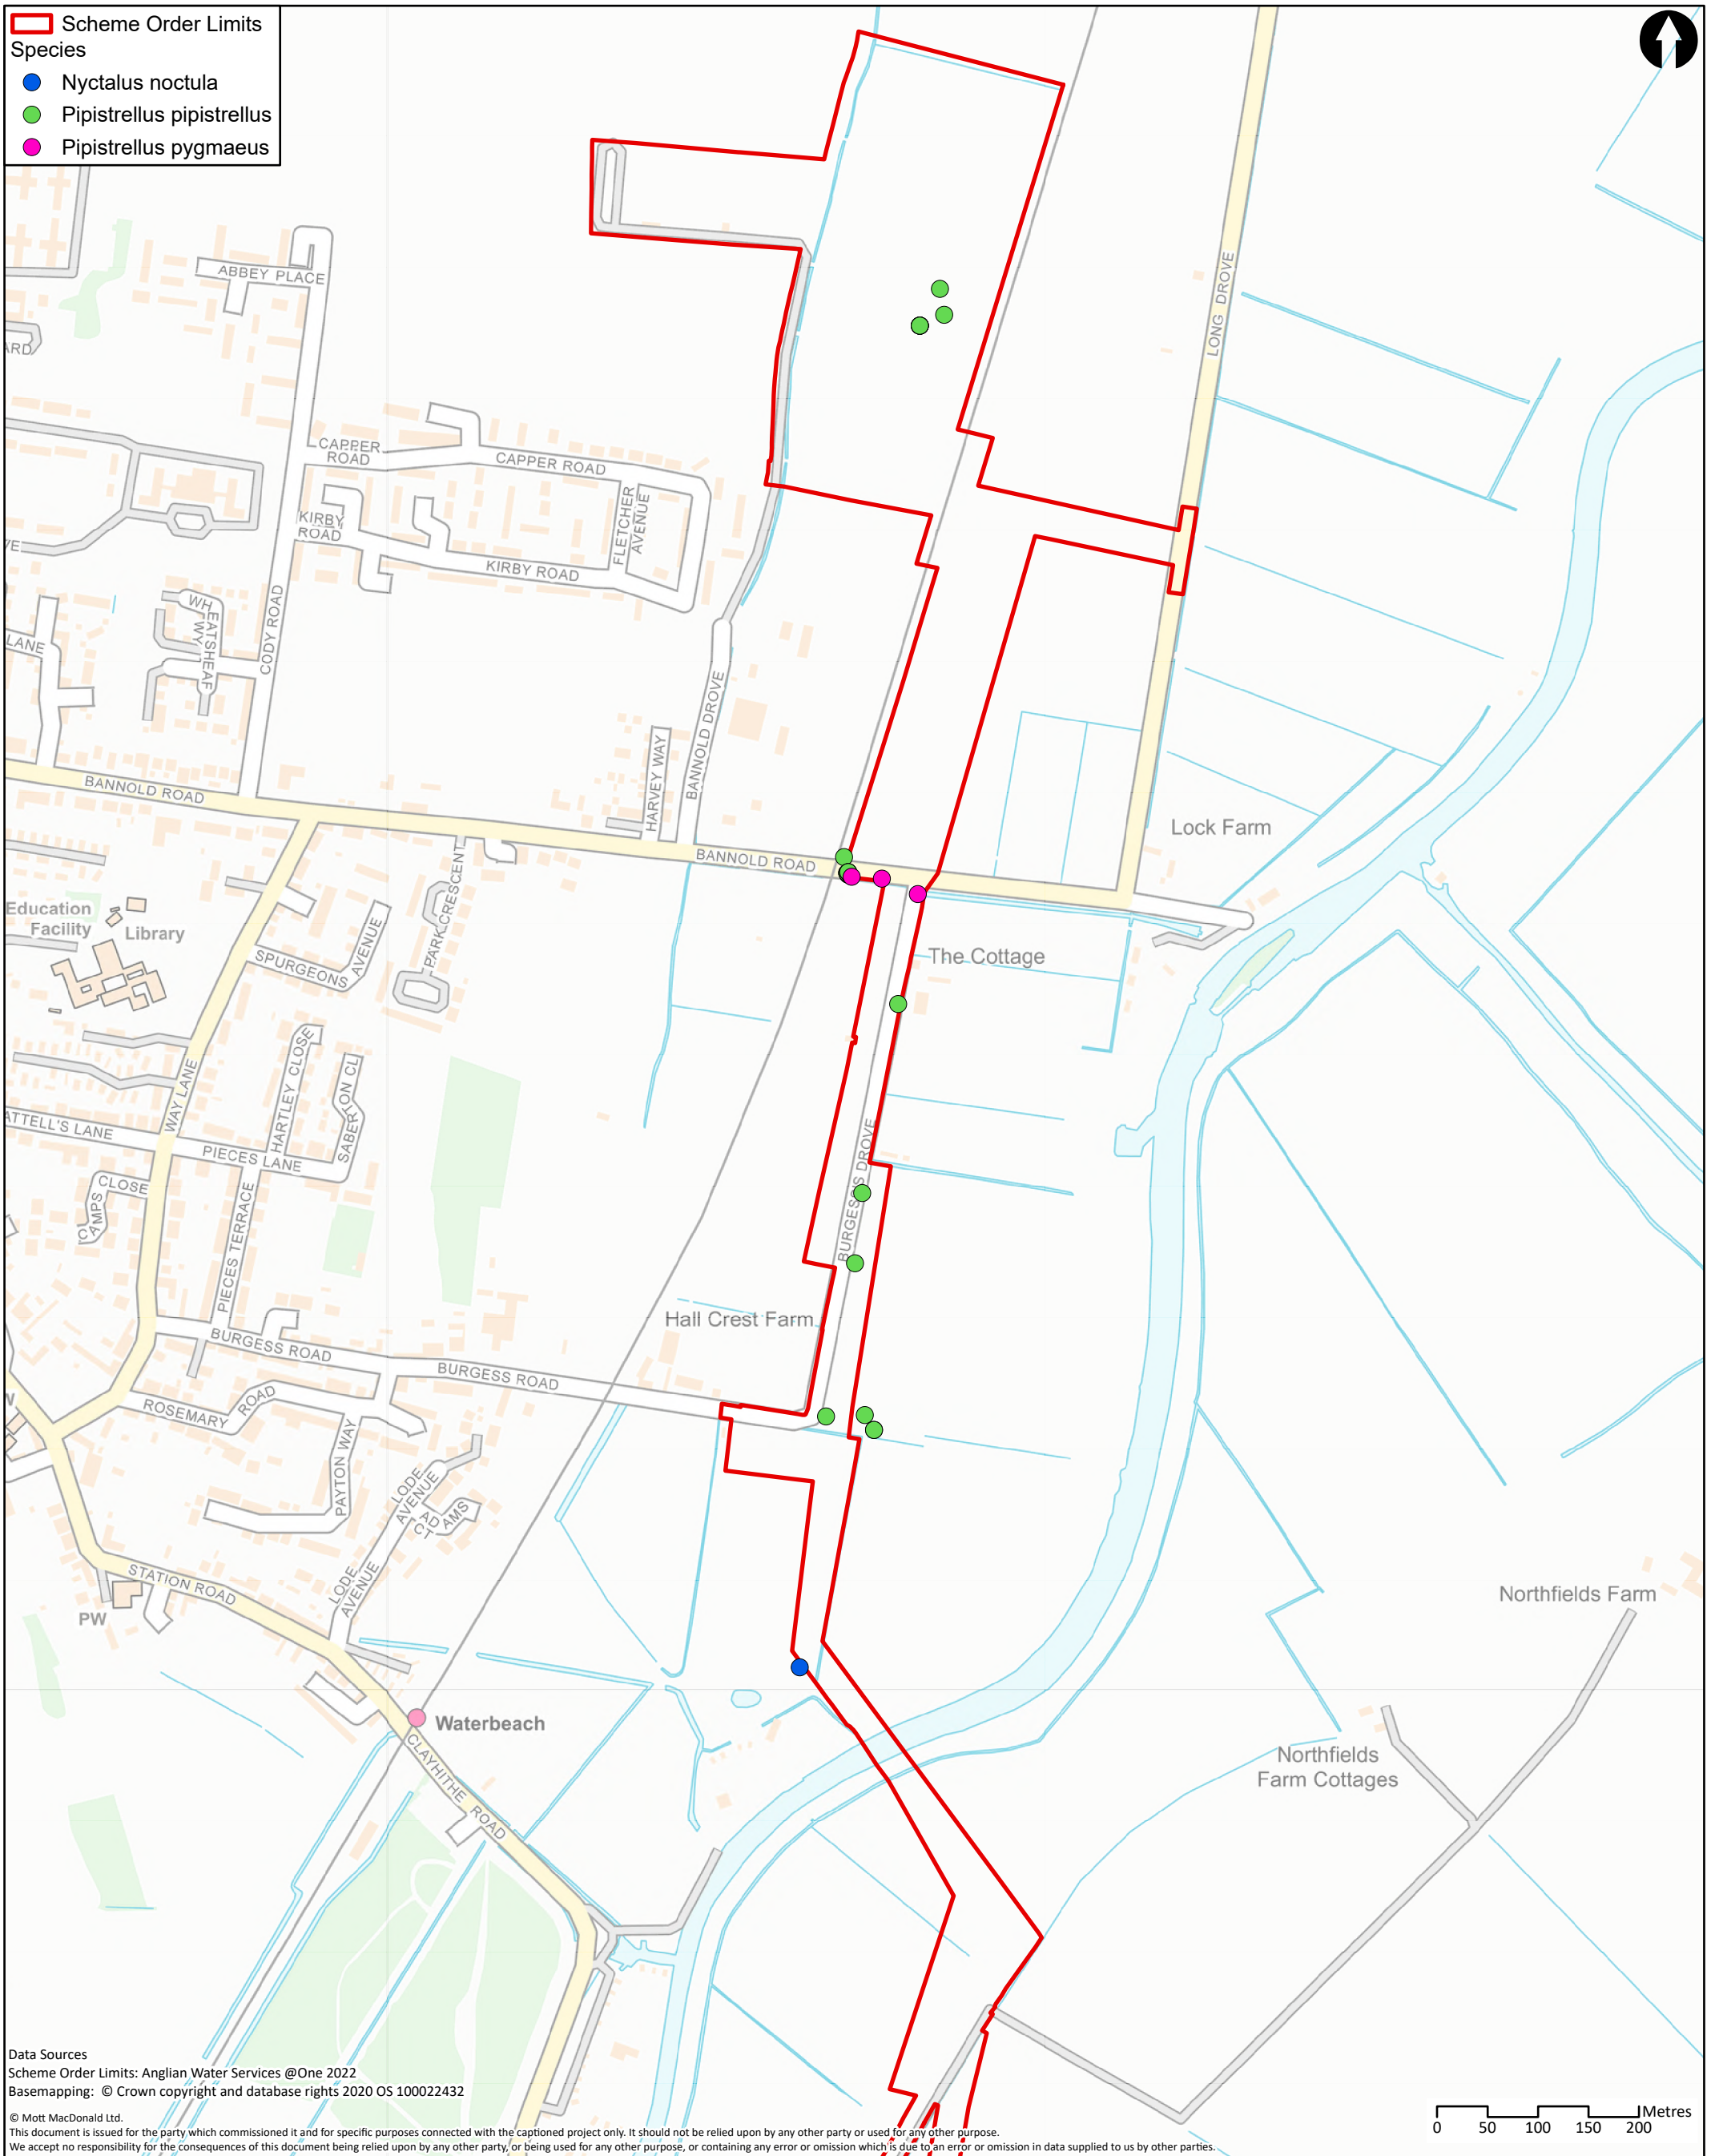

Data Sources  
 Scheme Order Limits: Anglian Water Services @One 2022  
 Basemapping: © Crown copyright and database rights 2020 OS 100022432


© Mott MacDonald Ltd.  
 This document is issued for the party which commissioned it and for specific purposes connected with the captioned project only. It should not be relied upon by any other party or used for any other purpose.  
 We accept no responsibility for the consequences of this document being relied upon by any other party, or being used for any other purpose, or containing any error or omission which is due to an error or omission in data supplied to us by other parties.

0 50 100 150 200 Metres

<p>22 Station Road Cambridge CB1 2JD United Kingdom</p> <p>T +44 (0)20 8774 2000 F +44 (0)20 8681 5706 W mottmac.com</p>	<p>Client</p>					<p>Title</p> <p>Cambridge Waste Water Treatment Plant Relocation Project</p> <p>Bats</p> <p>Waterbeach pipeline transect data from July – north transect</p>			Drawn	AW																		
	<table border="1"> <thead> <tr> <th>Rev</th> <th>Date</th> <th>Drawn</th> <th>Description</th> <th>Ch'k'd</th> <th>App'd</th> </tr> </thead> <tbody> <tr> <td>P2</td> <td>31/10/22</td> <td>AW</td> <td>For Information</td> <td>AW</td> <td>JM</td> </tr> <tr> <td>P3</td> <td>20/09/23</td> <td>JC</td> <td>For Information</td> <td>AW</td> <td>CS</td> </tr> </tbody> </table>					Rev	Date	Drawn	Description	Ch'k'd	App'd	P2	31/10/22	AW	For Information	AW	JM	P3	20/09/23	JC	For Information	AW	CS	<p>Drawing Number</p> <p>Figure 8.62</p>			Checked	AW
	Rev	Date	Drawn	Description	Ch'k'd	App'd																						
P2	31/10/22	AW	For Information	AW	JM																							
P3	20/09/23	JC	For Information	AW	CS																							
					<p>Approved</p> <p>CS</p>			<p>Scale at A3</p> <p>1:6,000</p>																				
					<p>Security</p> <p>STD</p>			Status <p>PRE</p>	Rev <p>P3</p>																			




- Scheme Order Limits**
- Species**
- Pipistrellus pipistrellus
  - Pipistrellus pygmaeus
  - Pipistrellus spec.
  - Plecotus auritus

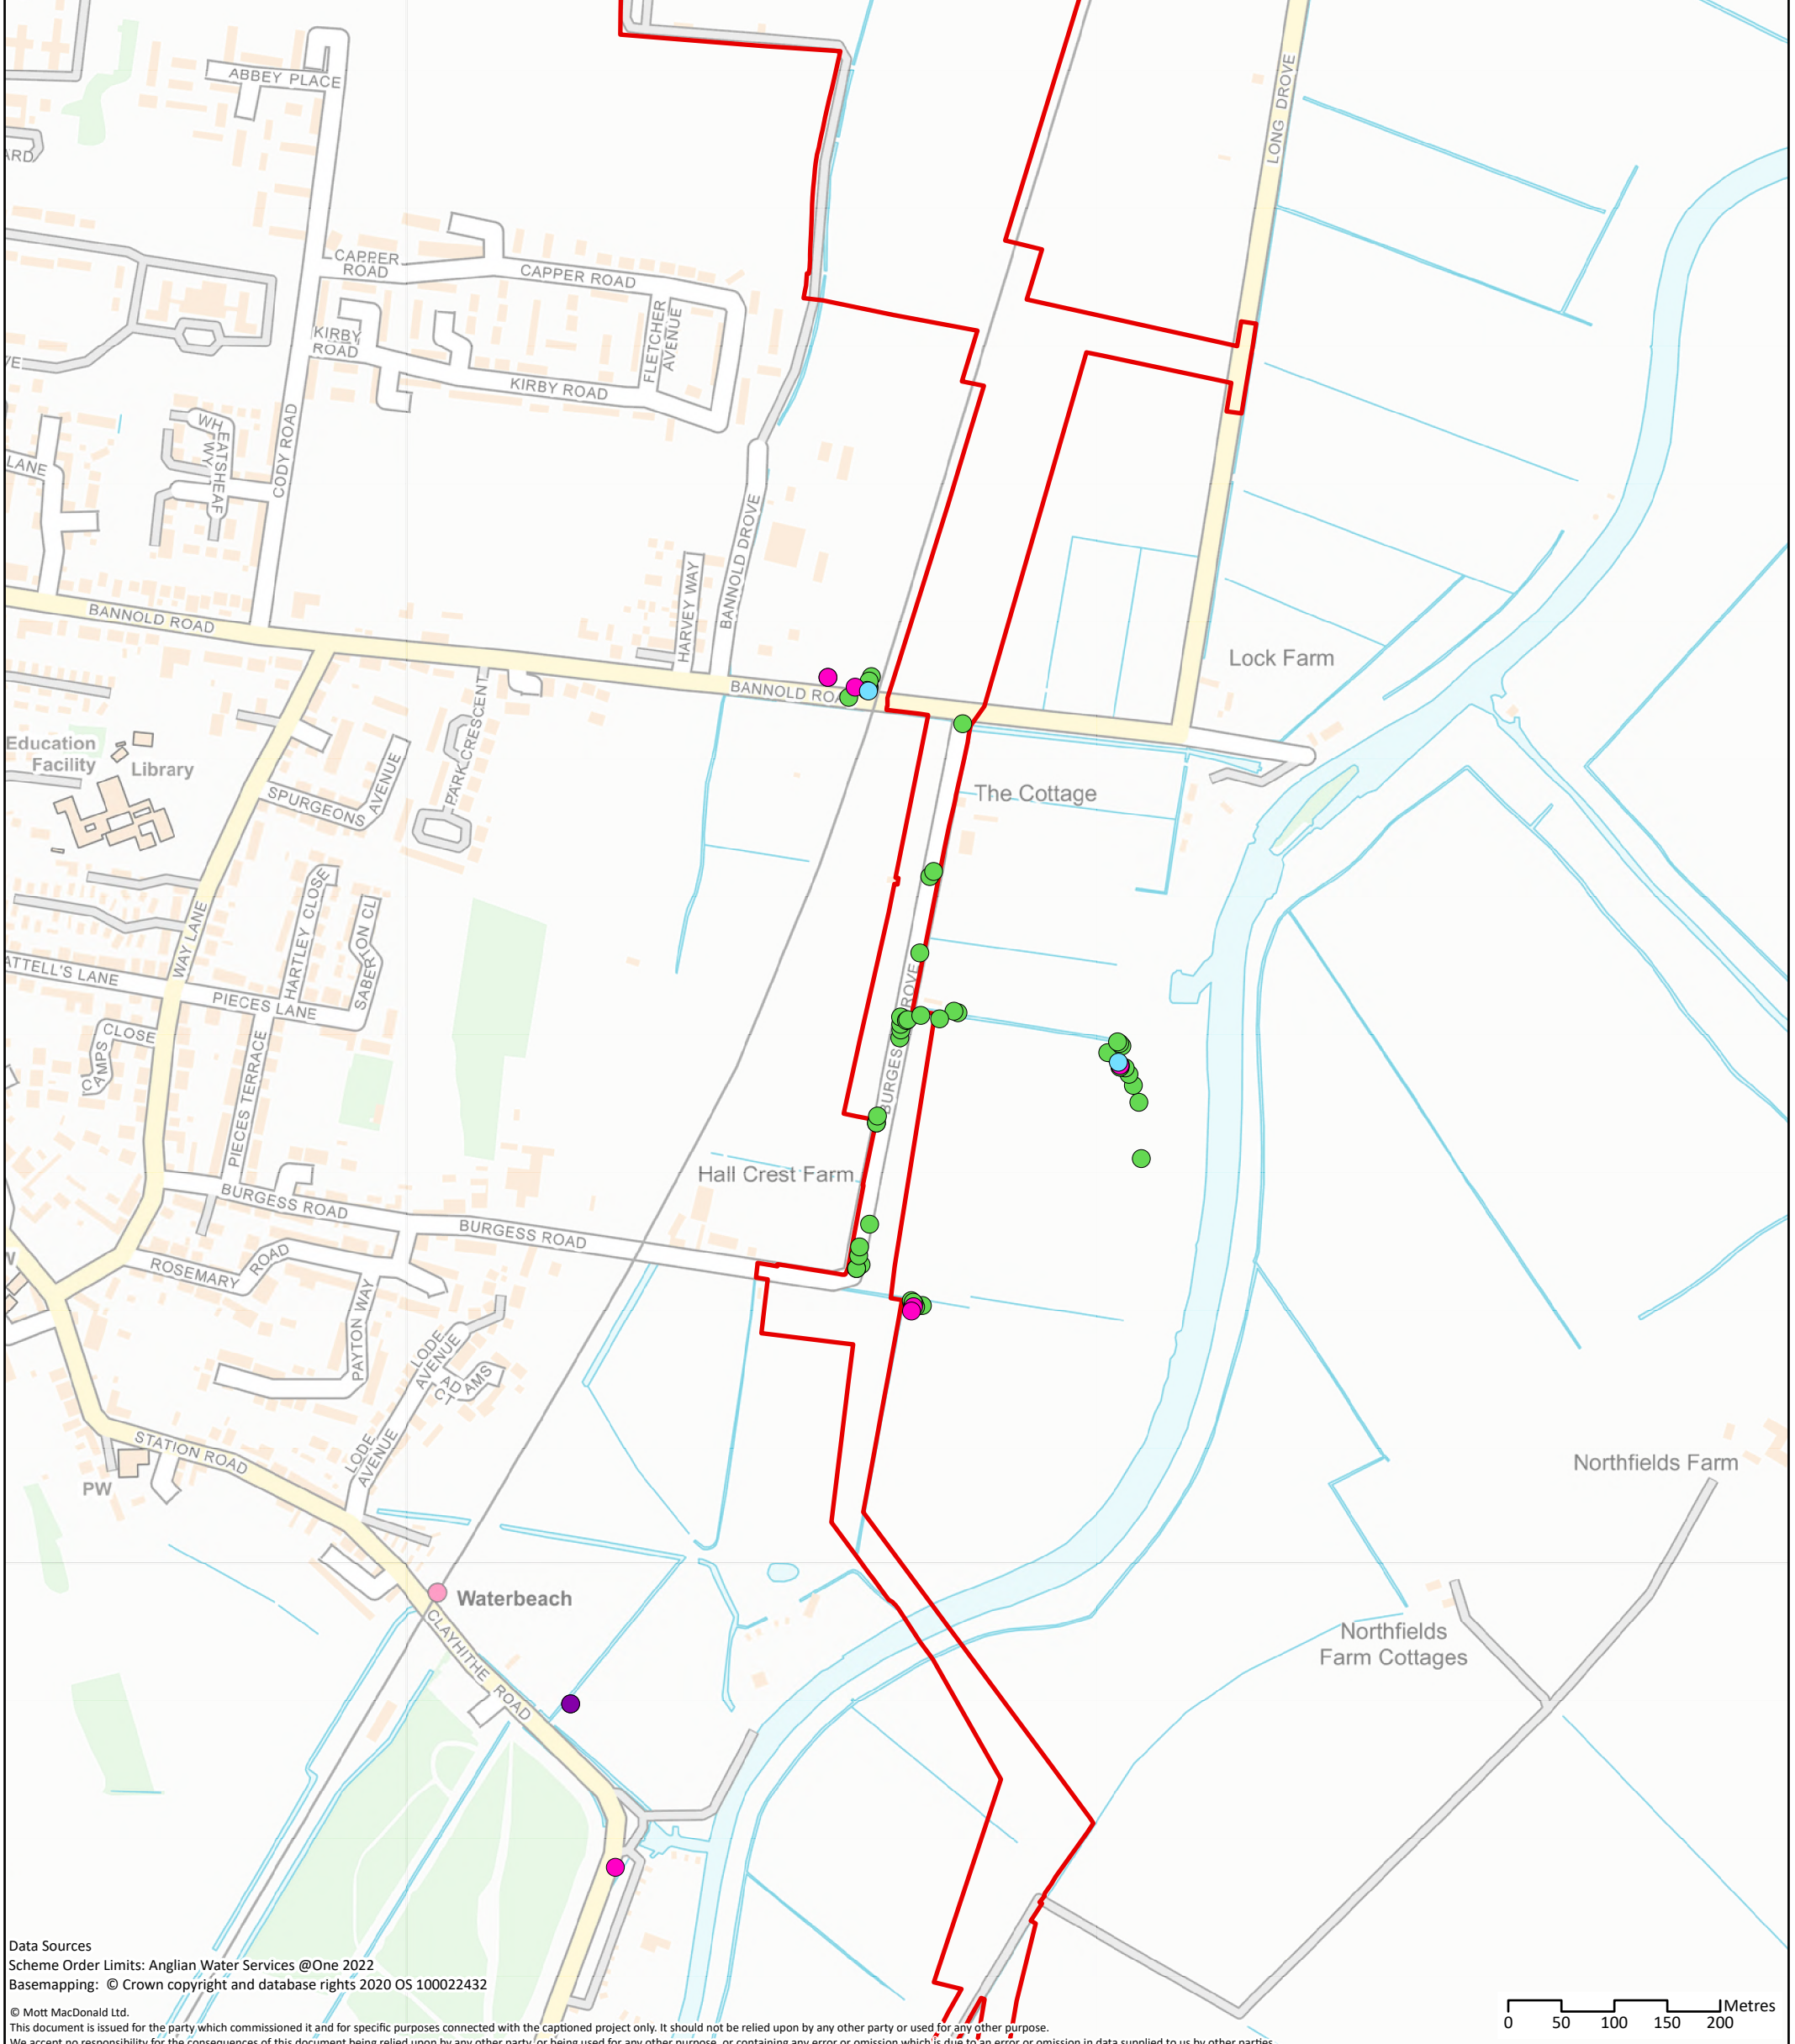

Data Sources  
 Scheme Order Limits: Anglian Water Services @One 2022  
 Basemapping: © Crown copyright and database rights 2020 OS 100022432  
 © Mott MacDonald Ltd.  
 This document is issued for the party which commissioned it and for specific purposes connected with the captioned project only. It should not be relied upon by any other party or used for any other purpose.  
 We accept no responsibility for the consequences of this document being relied upon by any other party, or being used for any other purpose, or containing any error or omission which is due to an error or omission in data supplied to us by other parties.

<p><b>MOTT MACDONALD</b></p> <p>22 Station Road Cambridge CB1 2JD United Kingdom</p> <p>T +44 (0)20 8774 2000 F +44 (0)20 8681 5706 W mottmac.com</p>	<p>Client</p>					<p>Title</p> <p>Cambridge Waste Water Treatment Plant Relocation Project Bats Waterbeach pipeline transect data from August – north transect</p>			Drawn	AW																		
	<table border="1"> <thead> <tr> <th>Rev</th> <th>Date</th> <th>Drawn</th> <th>Description</th> <th>Ch'k'd</th> <th>App'd</th> </tr> </thead> <tbody> <tr> <td>P2</td> <td>31/10/22</td> <td>AW</td> <td>For Information</td> <td>AW</td> <td>JM</td> </tr> <tr> <td>P3</td> <td>20/09/23</td> <td>JC</td> <td>For Information</td> <td>AW</td> <td>CS</td> </tr> </tbody> </table>					Rev	Date	Drawn	Description	Ch'k'd	App'd	P2	31/10/22	AW	For Information	AW	JM	P3	20/09/23	JC	For Information	AW	CS	<p>Drawing Number</p> <p style="text-align: center;">Figure 8.63</p>			Checked	AW
	Rev	Date	Drawn	Description	Ch'k'd	App'd																						
P2	31/10/22	AW	For Information	AW	JM																							
P3	20/09/23	JC	For Information	AW	CS																							
					<p>Approved</p> <p>CS</p>			<p>Scale at A3</p> <p>1:6,000</p>																				
					<p>Security</p> <p>STD</p>			Status <p>PRE</p>	Rev <p>P3</p>																			




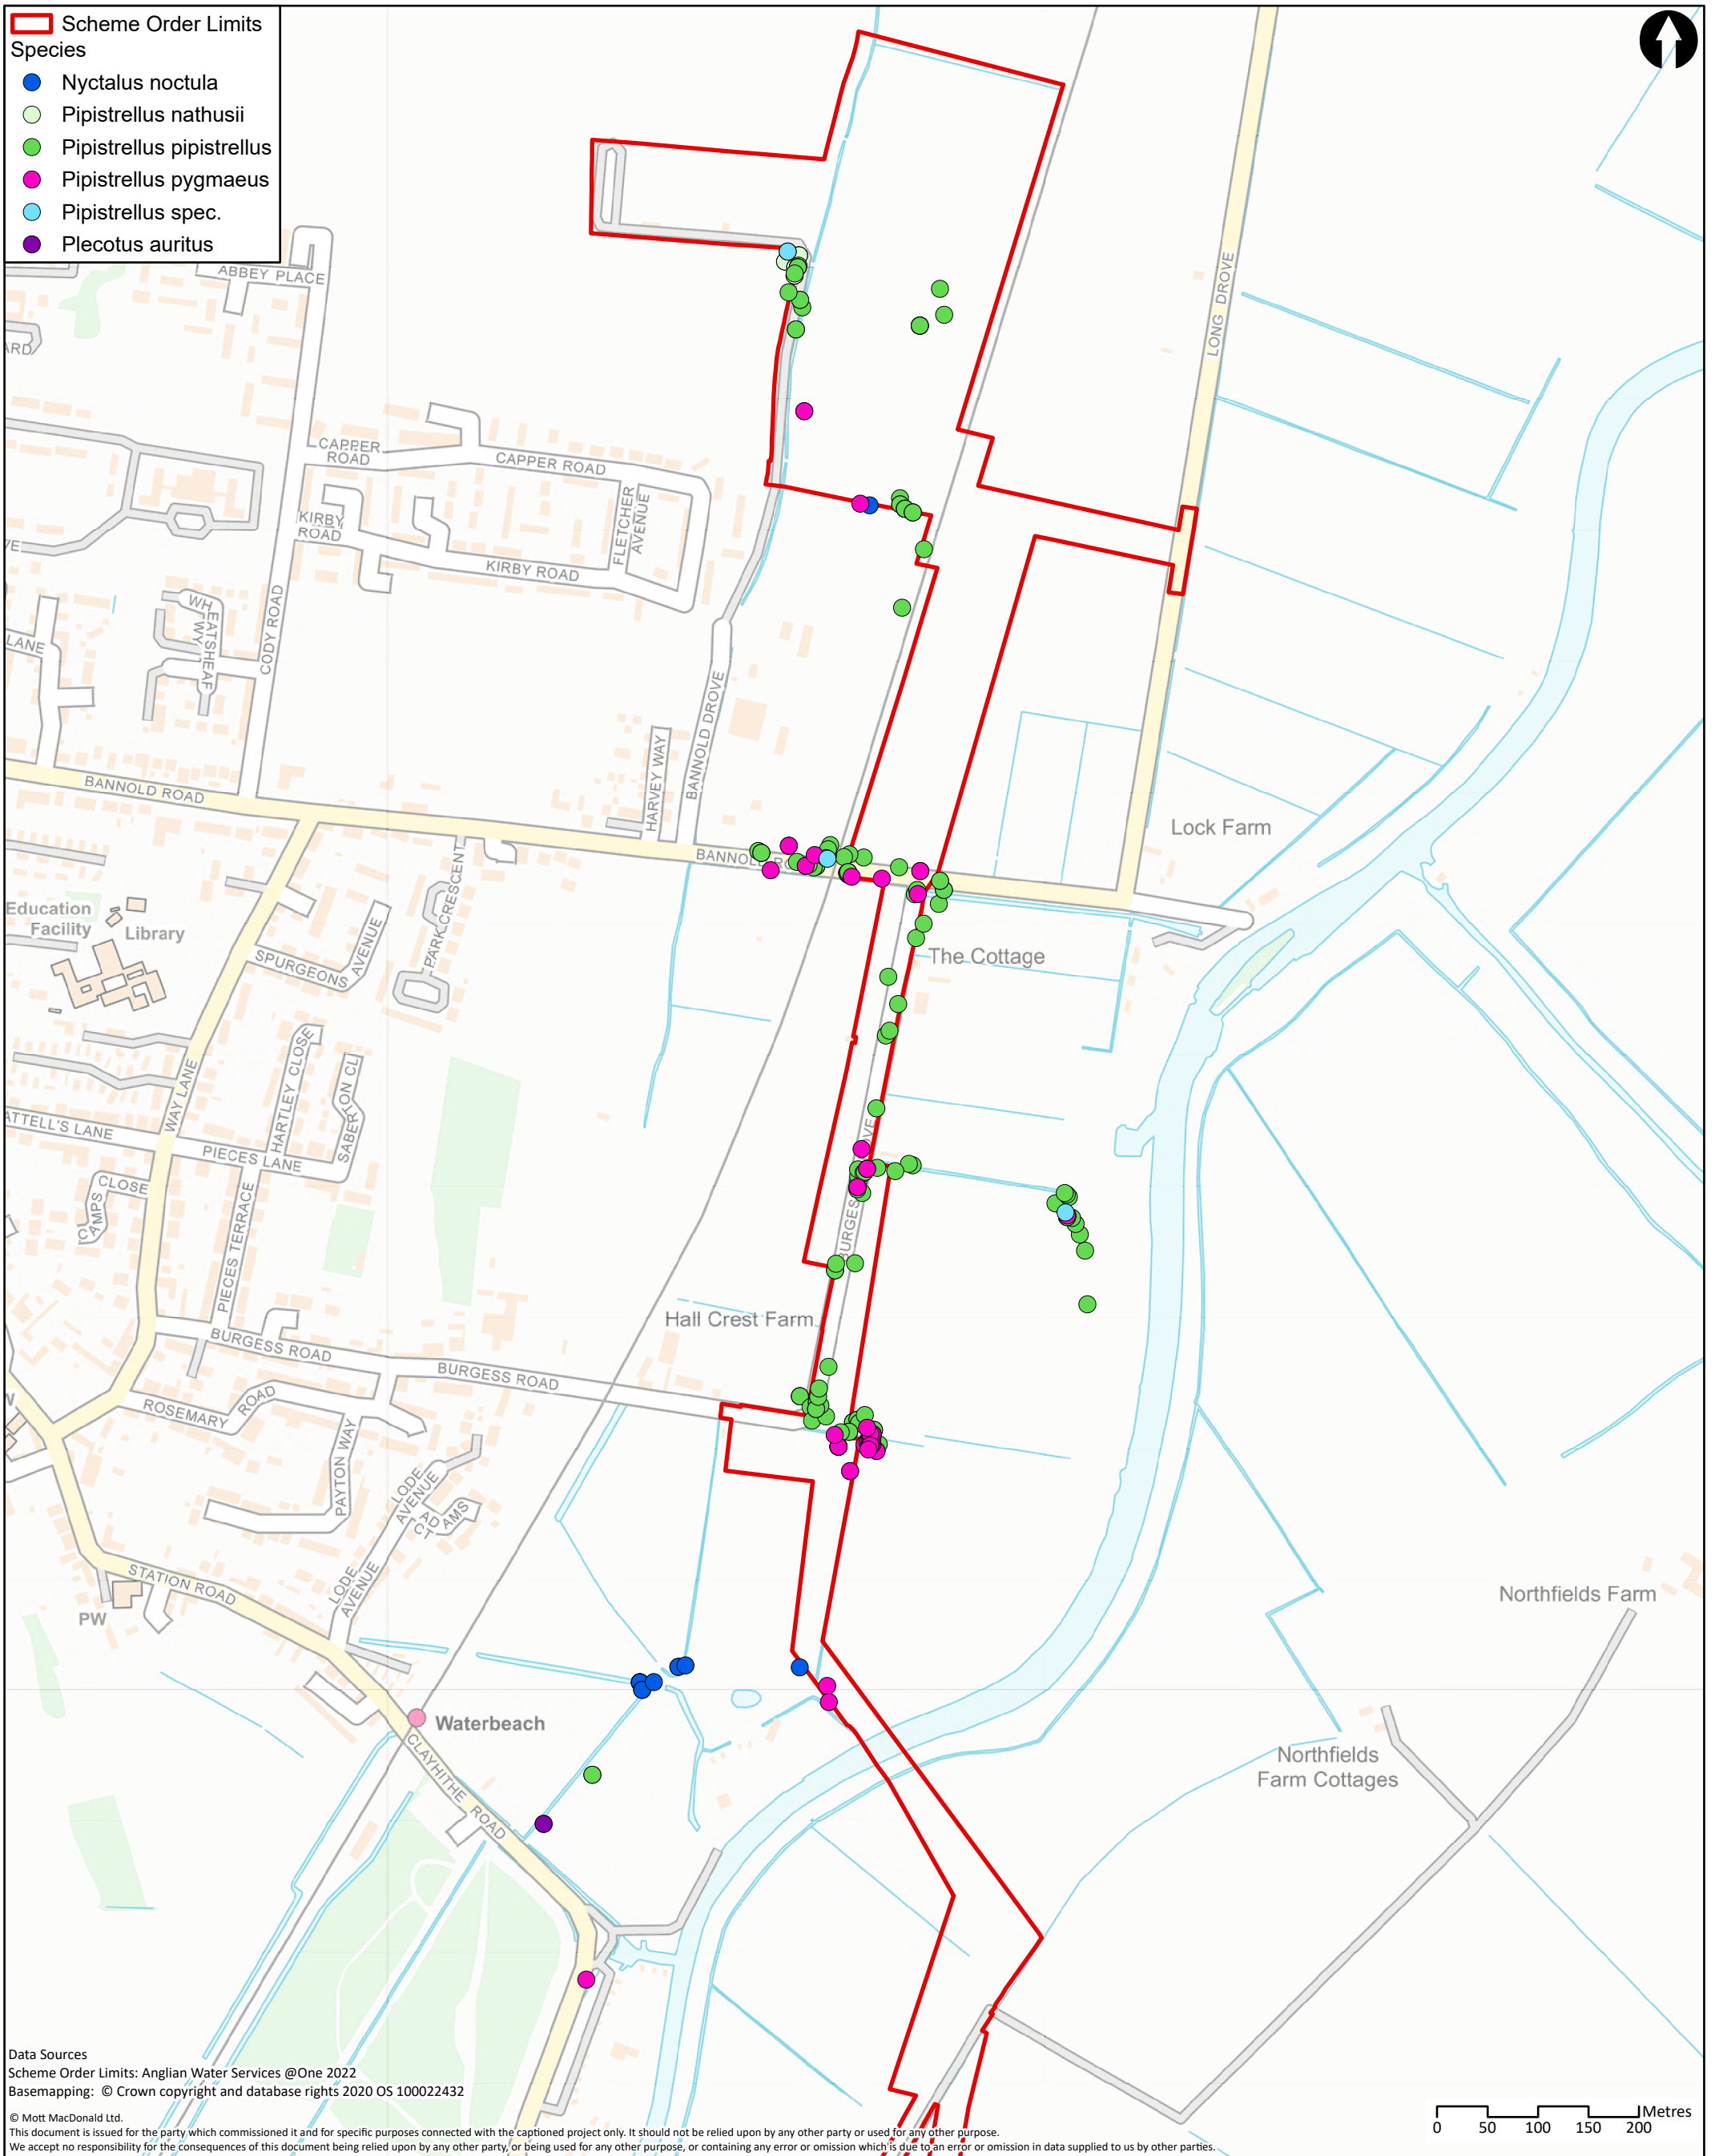

Data Sources  
 Scheme Order Limits: Anglian Water Services @One 2022  
 Basemapping: © Crown copyright and database rights 2020 OS 100022432  
 © Mott MacDonald Ltd.  
 This document is issued for the party which commissioned it and for specific purposes connected with the captioned project only. It should not be relied upon by any other party or used for any other purpose.  
 We accept no responsibility for the consequences of this document being relied upon by any other party, or being used for any other purpose, or containing any error or omission which is due to an error or omission in data supplied to us by other parties.

<p>22 Station Road Cambridge CB1 2JD United Kingdom</p> <p>T +44 (0)20 8774 2000 F +44 (0)20 8681 5706 W mottmac.com</p>	Client 					Title Cambridge Waste Water Treatment Plant Relocation Project Bats Waterbeach pipeline north transect data – combined visits Drawing Number <b>Figure 8.64</b>			Drawn AW																		
	<table border="1"> <thead> <tr> <th>Rev</th> <th>Date</th> <th>Drawn</th> <th>Description</th> <th>Ch'k'd</th> <th>App'd</th> </tr> </thead> <tbody> <tr> <td>P2</td> <td>31/10/22</td> <td>AW</td> <td>For Information</td> <td>AW</td> <td>JM</td> </tr> <tr> <td>P3</td> <td>20/09/23</td> <td>JC</td> <td>For Information</td> <td>AW</td> <td>CS</td> </tr> </tbody> </table>					Rev	Date	Drawn	Description	Ch'k'd	App'd	P2	31/10/22	AW	For Information	AW	JM	P3	20/09/23	JC	For Information	AW	CS	Checked AW Approved CS Scale at A3 <b>1:6,000</b>			Security STD
	Rev	Date	Drawn	Description	Ch'k'd	App'd																					
P2	31/10/22	AW	For Information	AW	JM																						
P3	20/09/23	JC	For Information	AW	CS																						
					Status PRE Rev P3																						



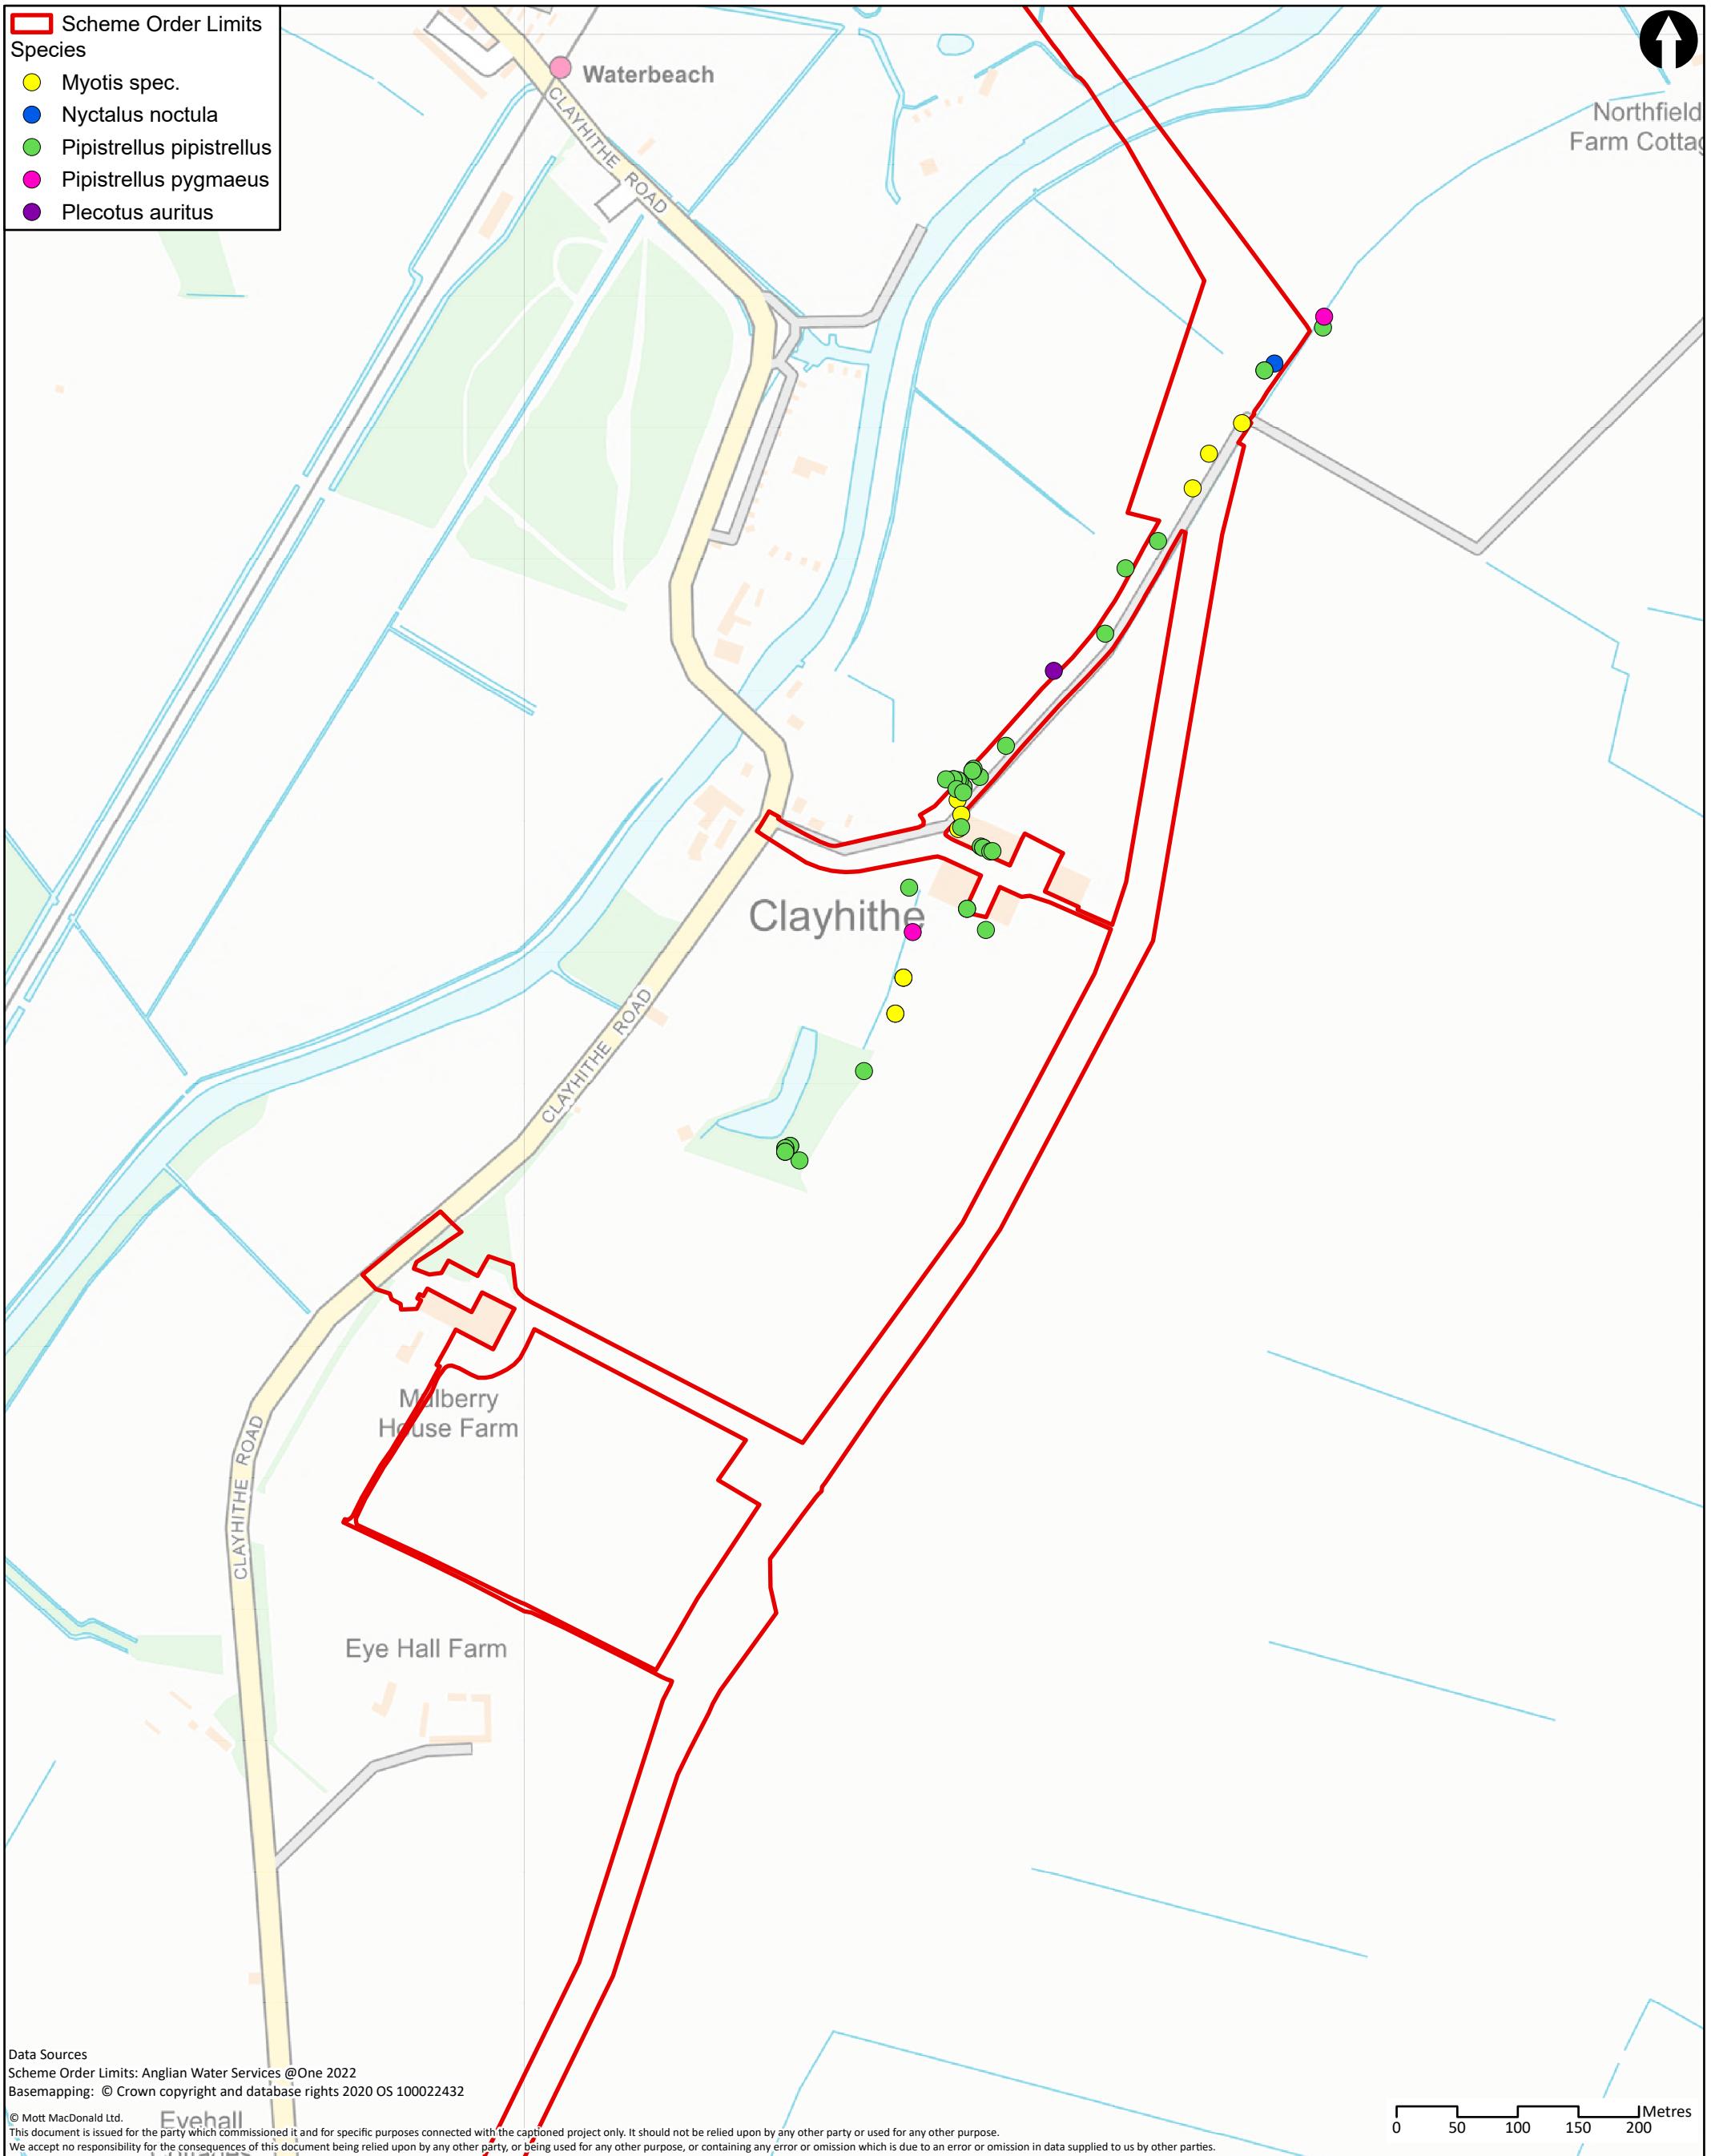


Data Sources  
 Scheme Order Limits: Anglian Water Services @One 2022  
 Basemapping: © Crown copyright and database rights 2020 OS 100022432

© Mott MacDonald Ltd.  
 This document is issued for the party which commissioned it and for specific purposes connected with the captioned project only. It should not be relied upon by any other party or used for any other purpose.  
 We accept no responsibility for the consequences of this document being relied upon by any other party, or being used for any other purpose, or containing any error or omission which is due to an error or omission in data supplied to us by other parties.


	22 Station Road Cambridge CB1 2JD United Kingdom		Client 			Title Cambridge Waste Water Treatment Plant Relocation Project Bats Waterbeach pipeline transect data from June – middle transect			Drawn AW																		
	T +44 (0)20 8774 2000 F +44 (0)20 8681 5706 W mottmac.com		<table border="1"> <thead> <tr> <th>Rev</th> <th>Date</th> <th>Drawn</th> <th>Description</th> <th>Ch'k'd</th> <th>App'd</th> </tr> </thead> <tbody> <tr> <td>P2</td> <td>31/10/22</td> <td>AW</td> <td>For Information</td> <td>AW</td> <td>JM</td> </tr> <tr> <td>P3</td> <td>20/09/23</td> <td>JC</td> <td>For Information</td> <td>AW</td> <td>CS</td> </tr> </tbody> </table>			Rev	Date	Drawn	Description	Ch'k'd	App'd	P2	31/10/22	AW	For Information	AW	JM	P3	20/09/23	JC	For Information	AW	CS	Drawing Number Figure 8.65			Checked AW
	Rev	Date	Drawn	Description	Ch'k'd	App'd																					
P2	31/10/22	AW	For Information	AW	JM																						
P3	20/09/23	JC	For Information	AW	CS																						
						Approved CS			Scale at A3 1:5,000																		
									Security STD	Status PRE	Rev P3																



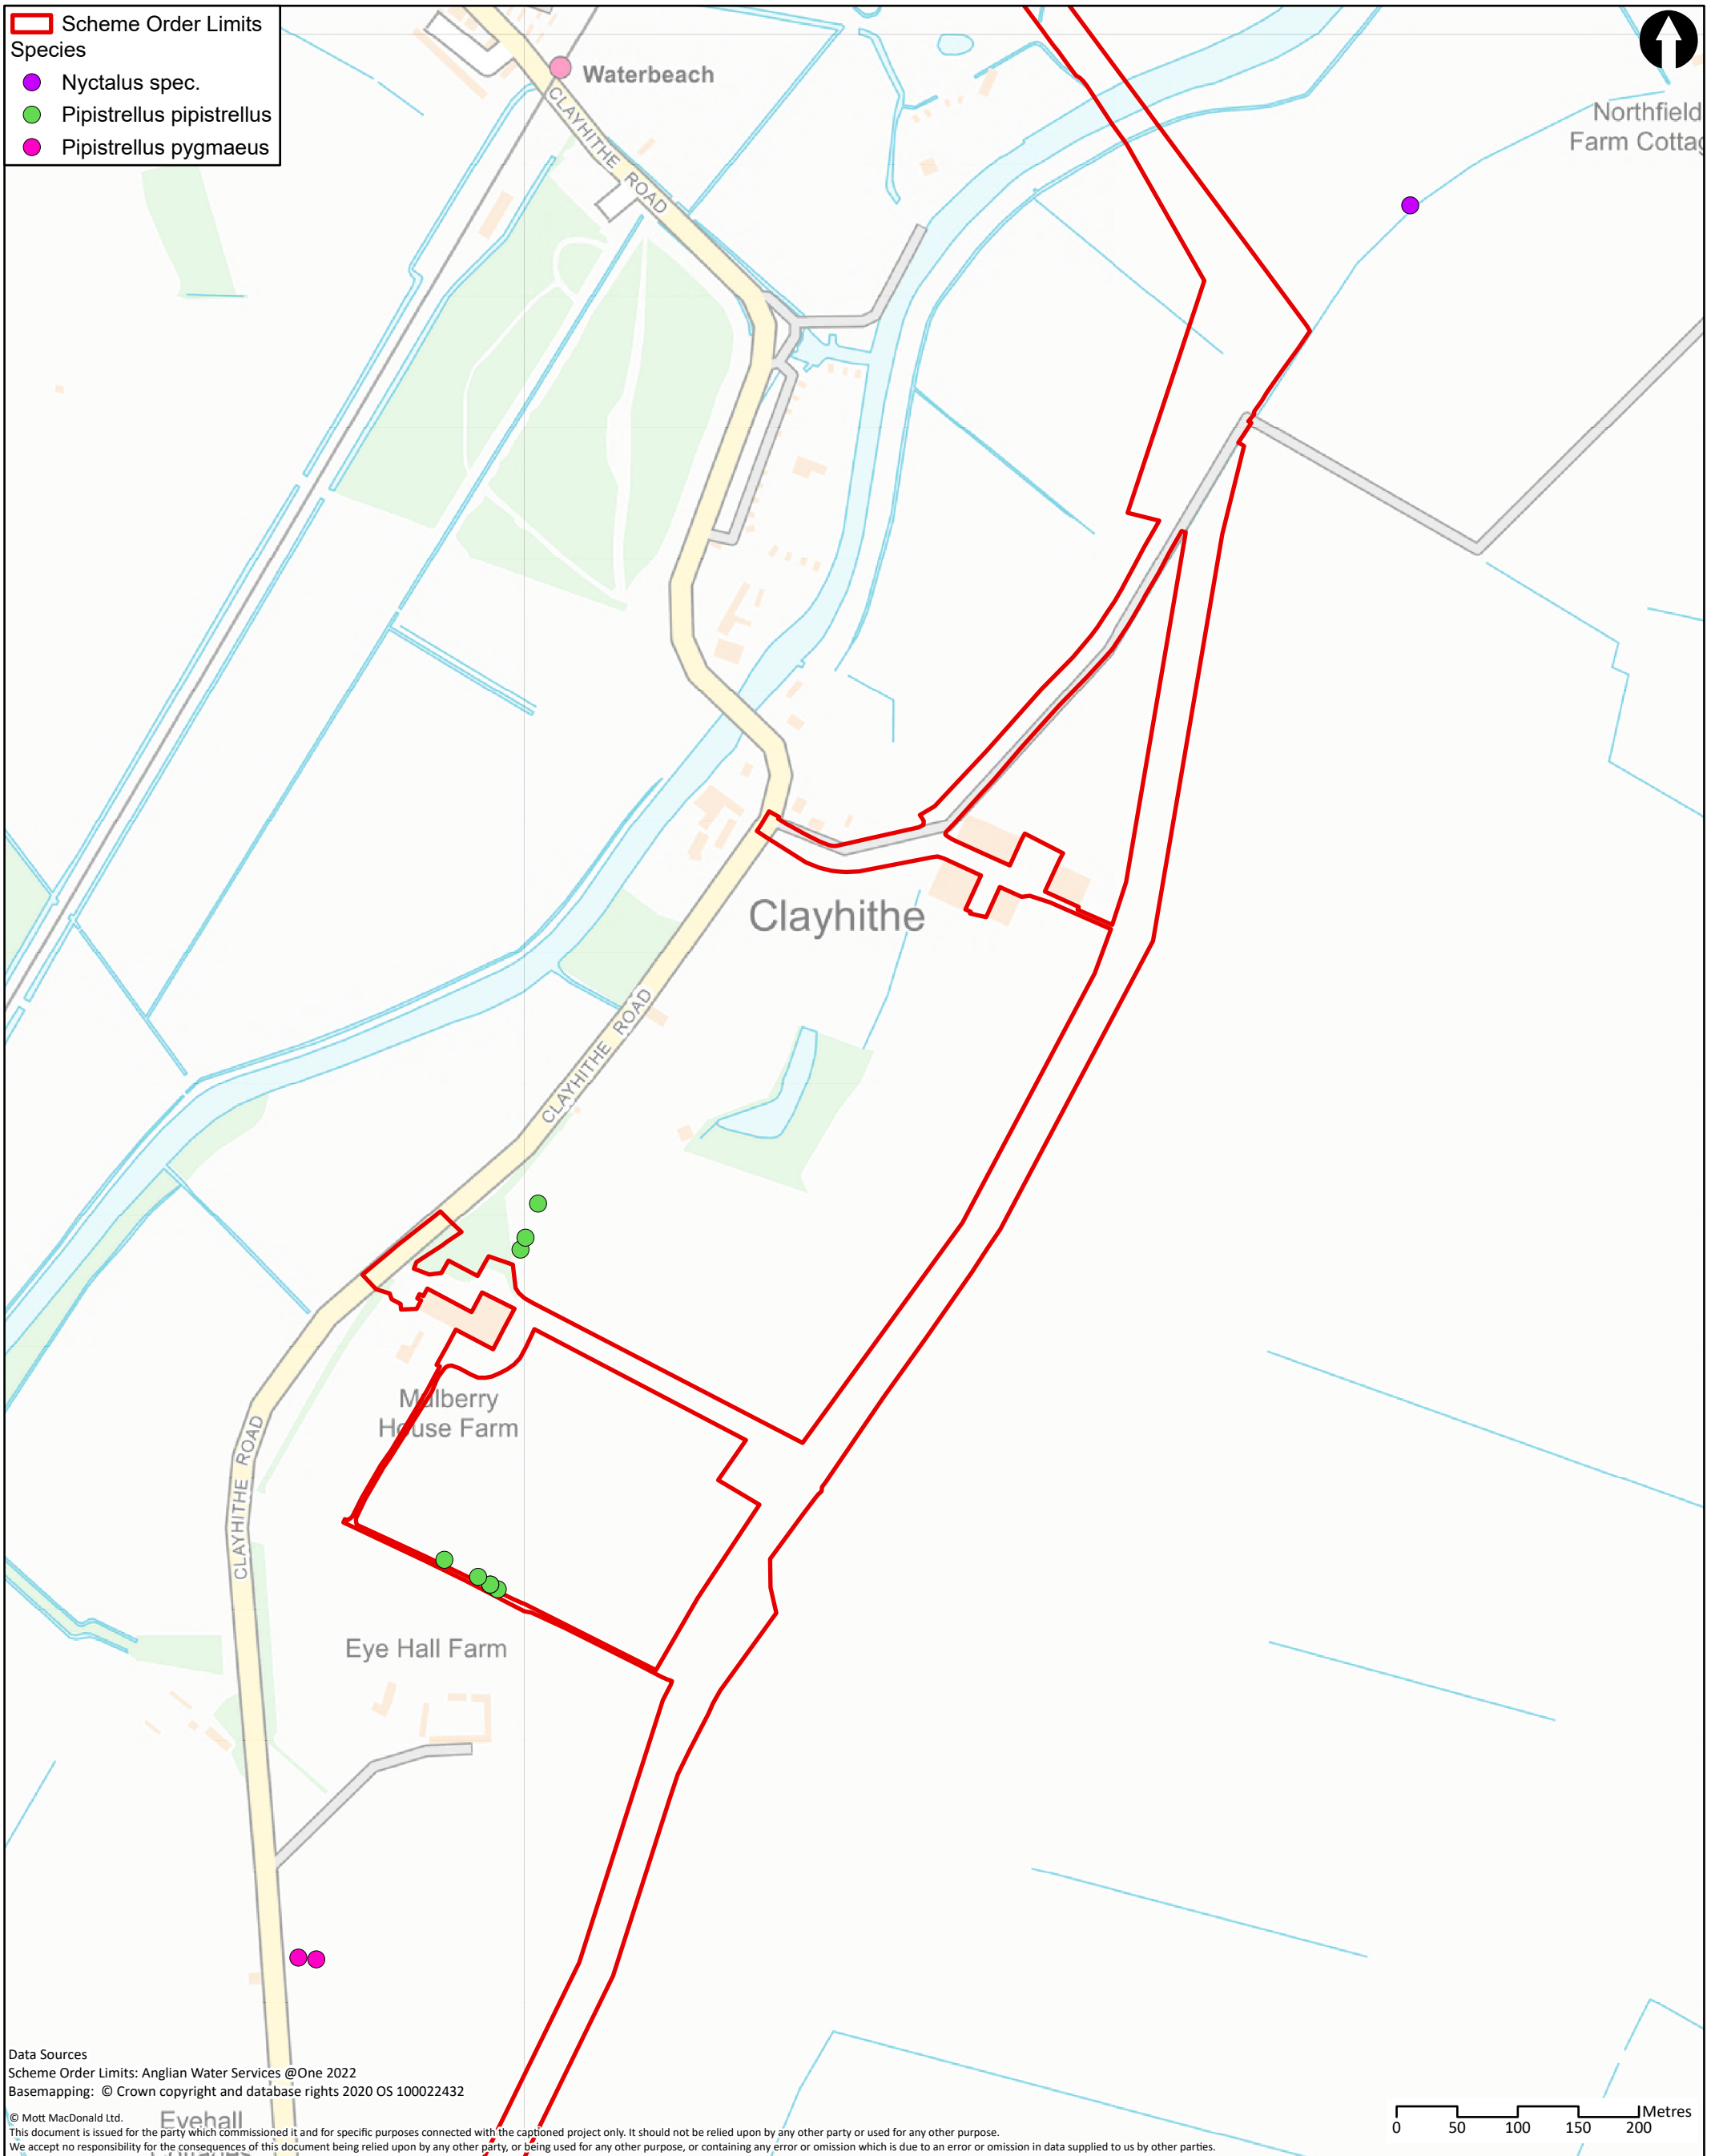


Data Sources  
 Scheme Order Limits: Anglian Water Services @One 2022  
 Basemapping: © Crown copyright and database rights 2020 OS 100022432

© Mott MacDonald Ltd.  
 This document is issued for the party which commissioned it and for specific purposes connected with the captioned project only. It should not be relied upon by any other party or used for any other purpose.  
 We accept no responsibility for the consequences of this document being relied upon by any other party, or being used for any other purpose, or containing any error or omission which is due to an error or omission in data supplied to us by other parties.



<p>22 Station Road Cambridge CB1 2JD United Kingdom</p> <p>T +44 (0)20 8774 2000 F +44 (0)20 8681 5706 W mottmac.com</p>	Client 					Title Cambridge Waste Water Treatment Plant Relocation Project Bats Waterbeach pipeline transect data from August – middle transect Drawing Number <p style="text-align: center;">Figure 8.66</p>	Drawn	AW		
	Rev	Date	Drawn	Description	Ch'k'd		App'd	Checked	AW	
	P2	31/10/22	AW	For Information	AW		JM	Approved	CS	
							Scale at A3 1:5,000			
P3	20/09/23	JC	For Information	AW	CS		Security	Status	Rev	
							STD	PRE	P3	



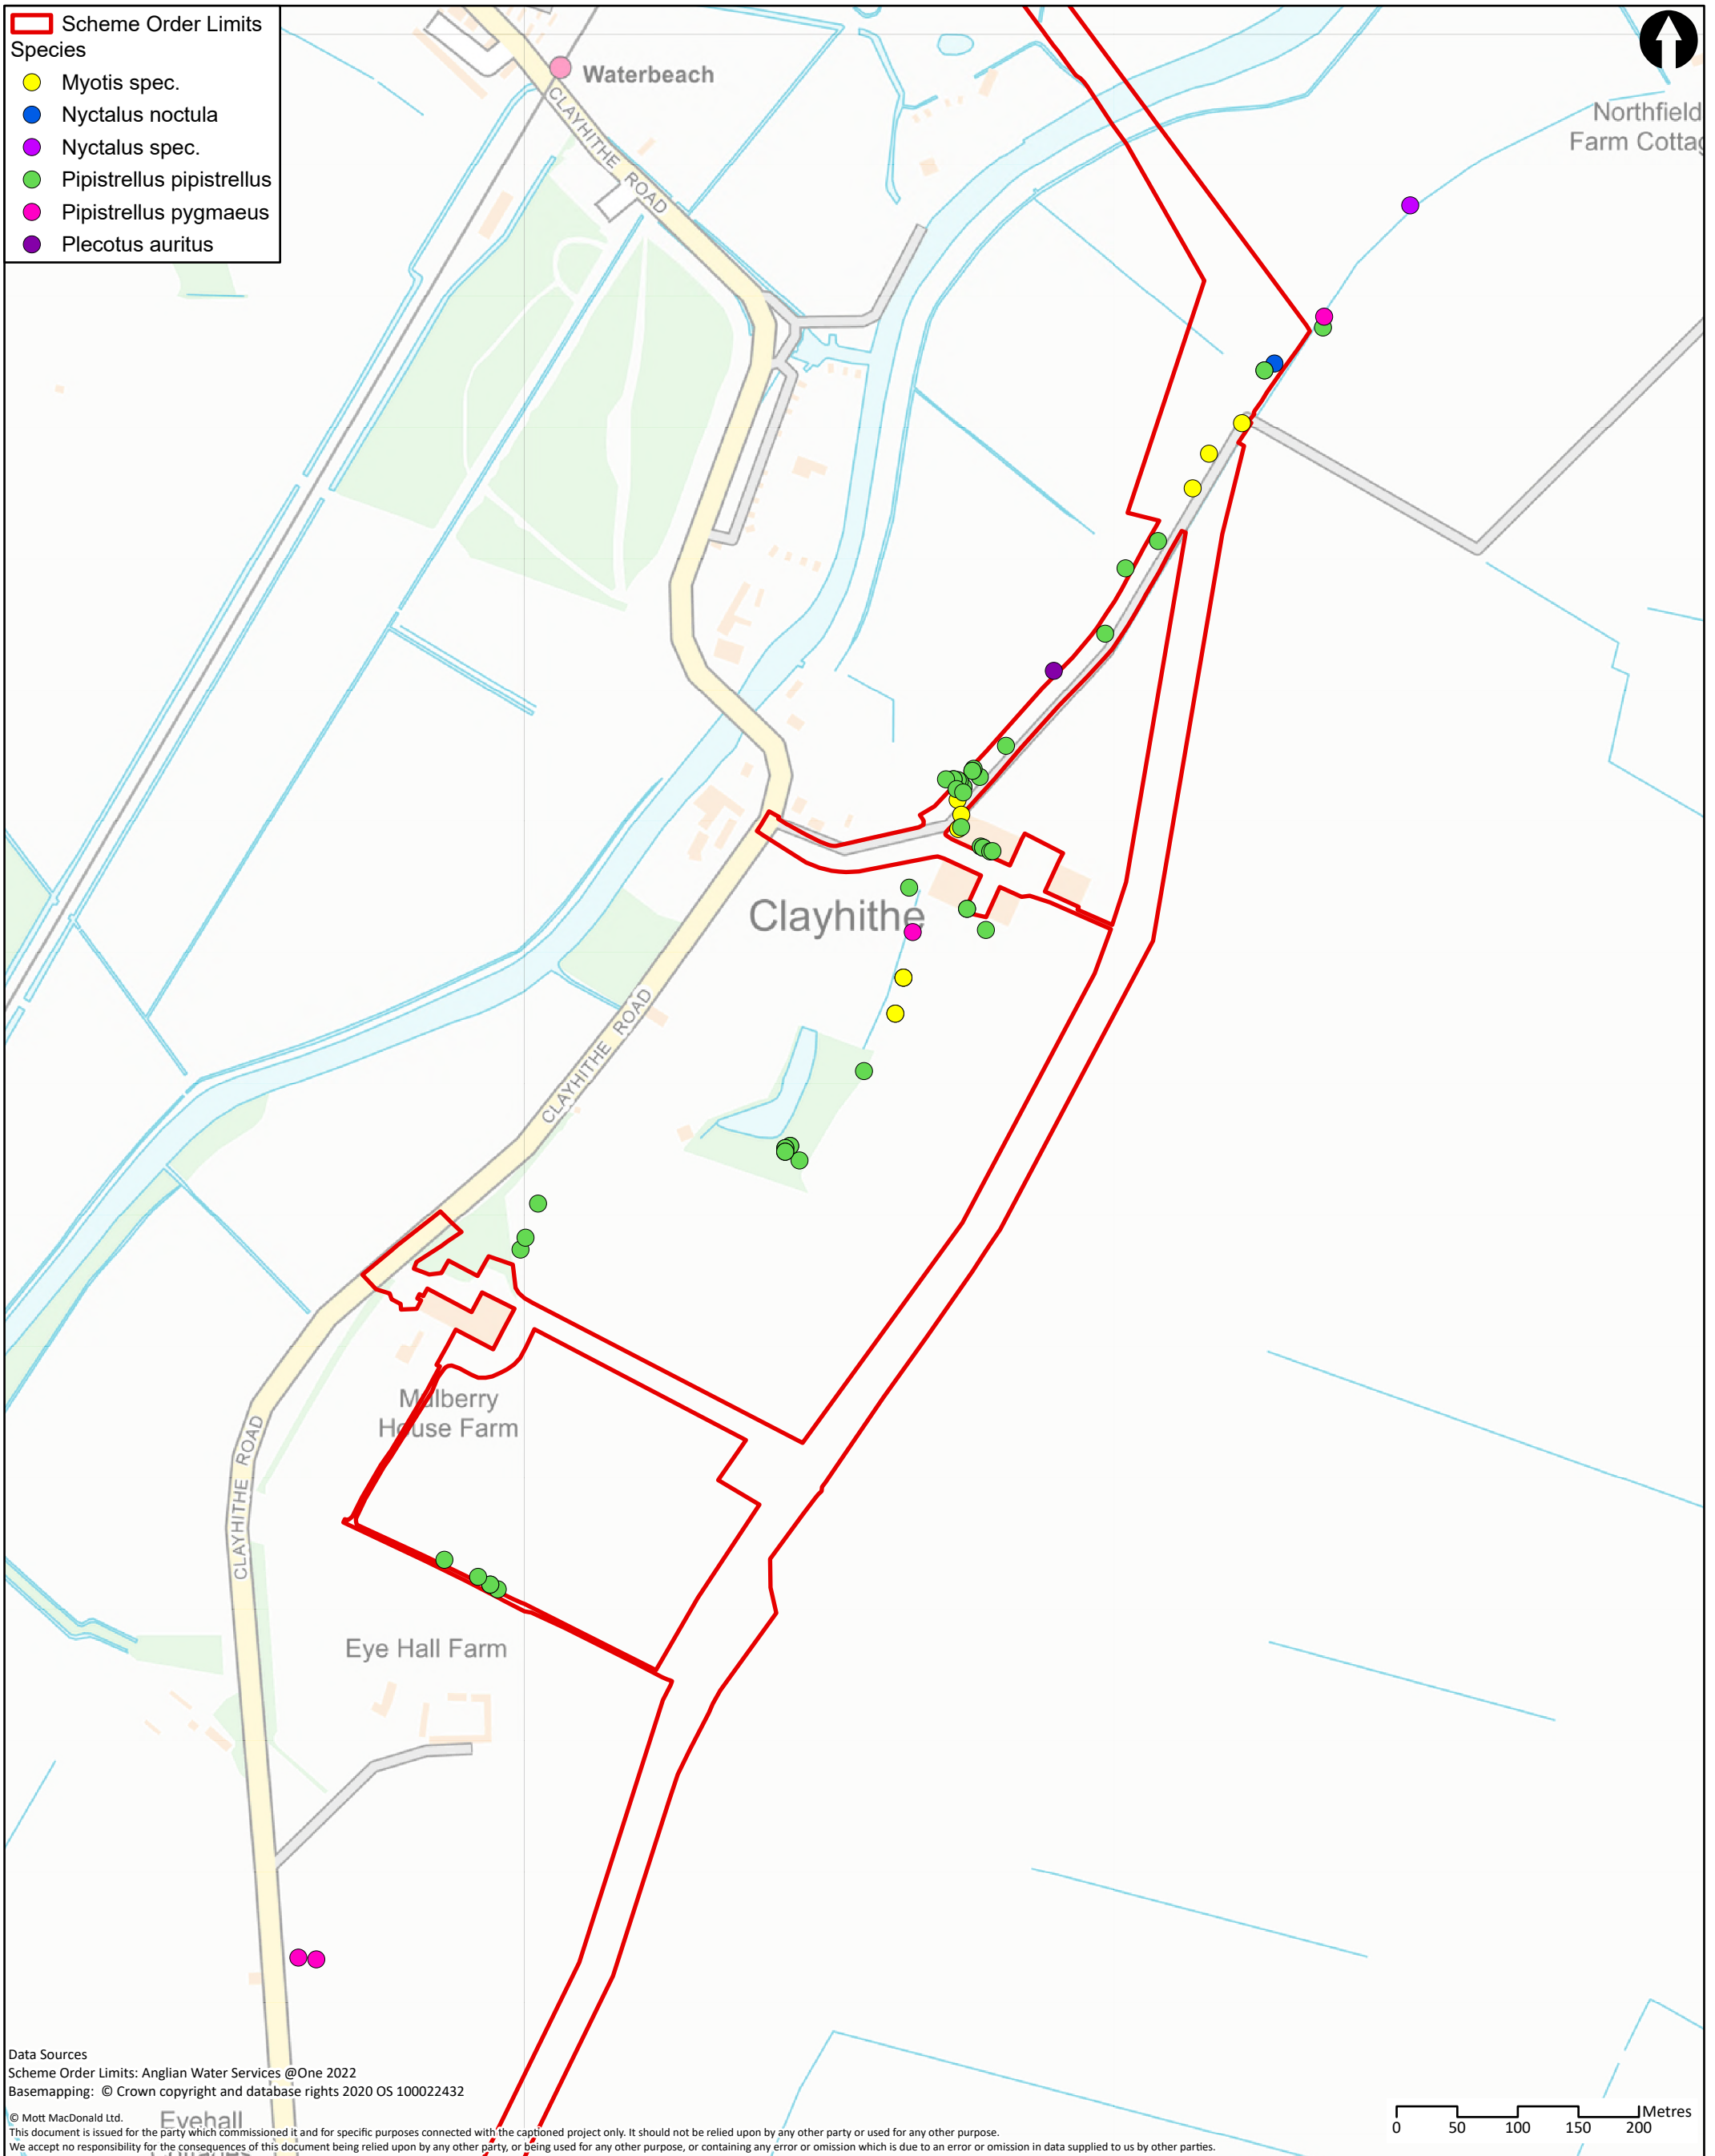


Data Sources  
 Scheme Order Limits: Anglian Water Services @One 2022  
 Basemapping: © Crown copyright and database rights 2020 OS 100022432

© Mott MacDonald Ltd.  
 This document is issued for the party which commissioned it and for specific purposes connected with the captioned project only. It should not be relied upon by any other party or used for any other purpose.  
 We accept no responsibility for the consequences of this document being relied upon by any other party, or being used for any other purpose, or containing any error or omission which is due to an error or omission in data supplied to us by other parties.

	22 Station Road Cambridge CB1 2JD United Kingdom		Client 			Title Cambridge Waste Water Treatment Plant Relocation Project Bats Waterbeach pipeline middle transect data – combined visits			Drawn AW																		
	T +44 (0)20 8774 2000 F +44 (0)20 8681 5706 W mottmac.com		<table border="1"> <thead> <tr> <th>Rev</th> <th>Date</th> <th>Drawn</th> <th>Description</th> <th>Ch'k'd</th> <th>App'd</th> </tr> </thead> <tbody> <tr> <td>P2</td> <td>31/10/22</td> <td>AW</td> <td>For Information</td> <td>AW</td> <td>JM</td> </tr> <tr> <td>P3</td> <td>20/09/23</td> <td>JC</td> <td>For Information</td> <td>AW</td> <td>CS</td> </tr> </tbody> </table>			Rev	Date	Drawn	Description	Ch'k'd	App'd	P2	31/10/22	AW	For Information	AW	JM	P3	20/09/23	JC	For Information	AW	CS	Drawing Number Figure 8.67			Checked AW
	Rev	Date	Drawn	Description	Ch'k'd	App'd																					
P2	31/10/22	AW	For Information	AW	JM																						
P3	20/09/23	JC	For Information	AW	CS																						
						Approved CS			Scale at A3 1:5,000																		
									Security STD	Status PRE	Rev P3																



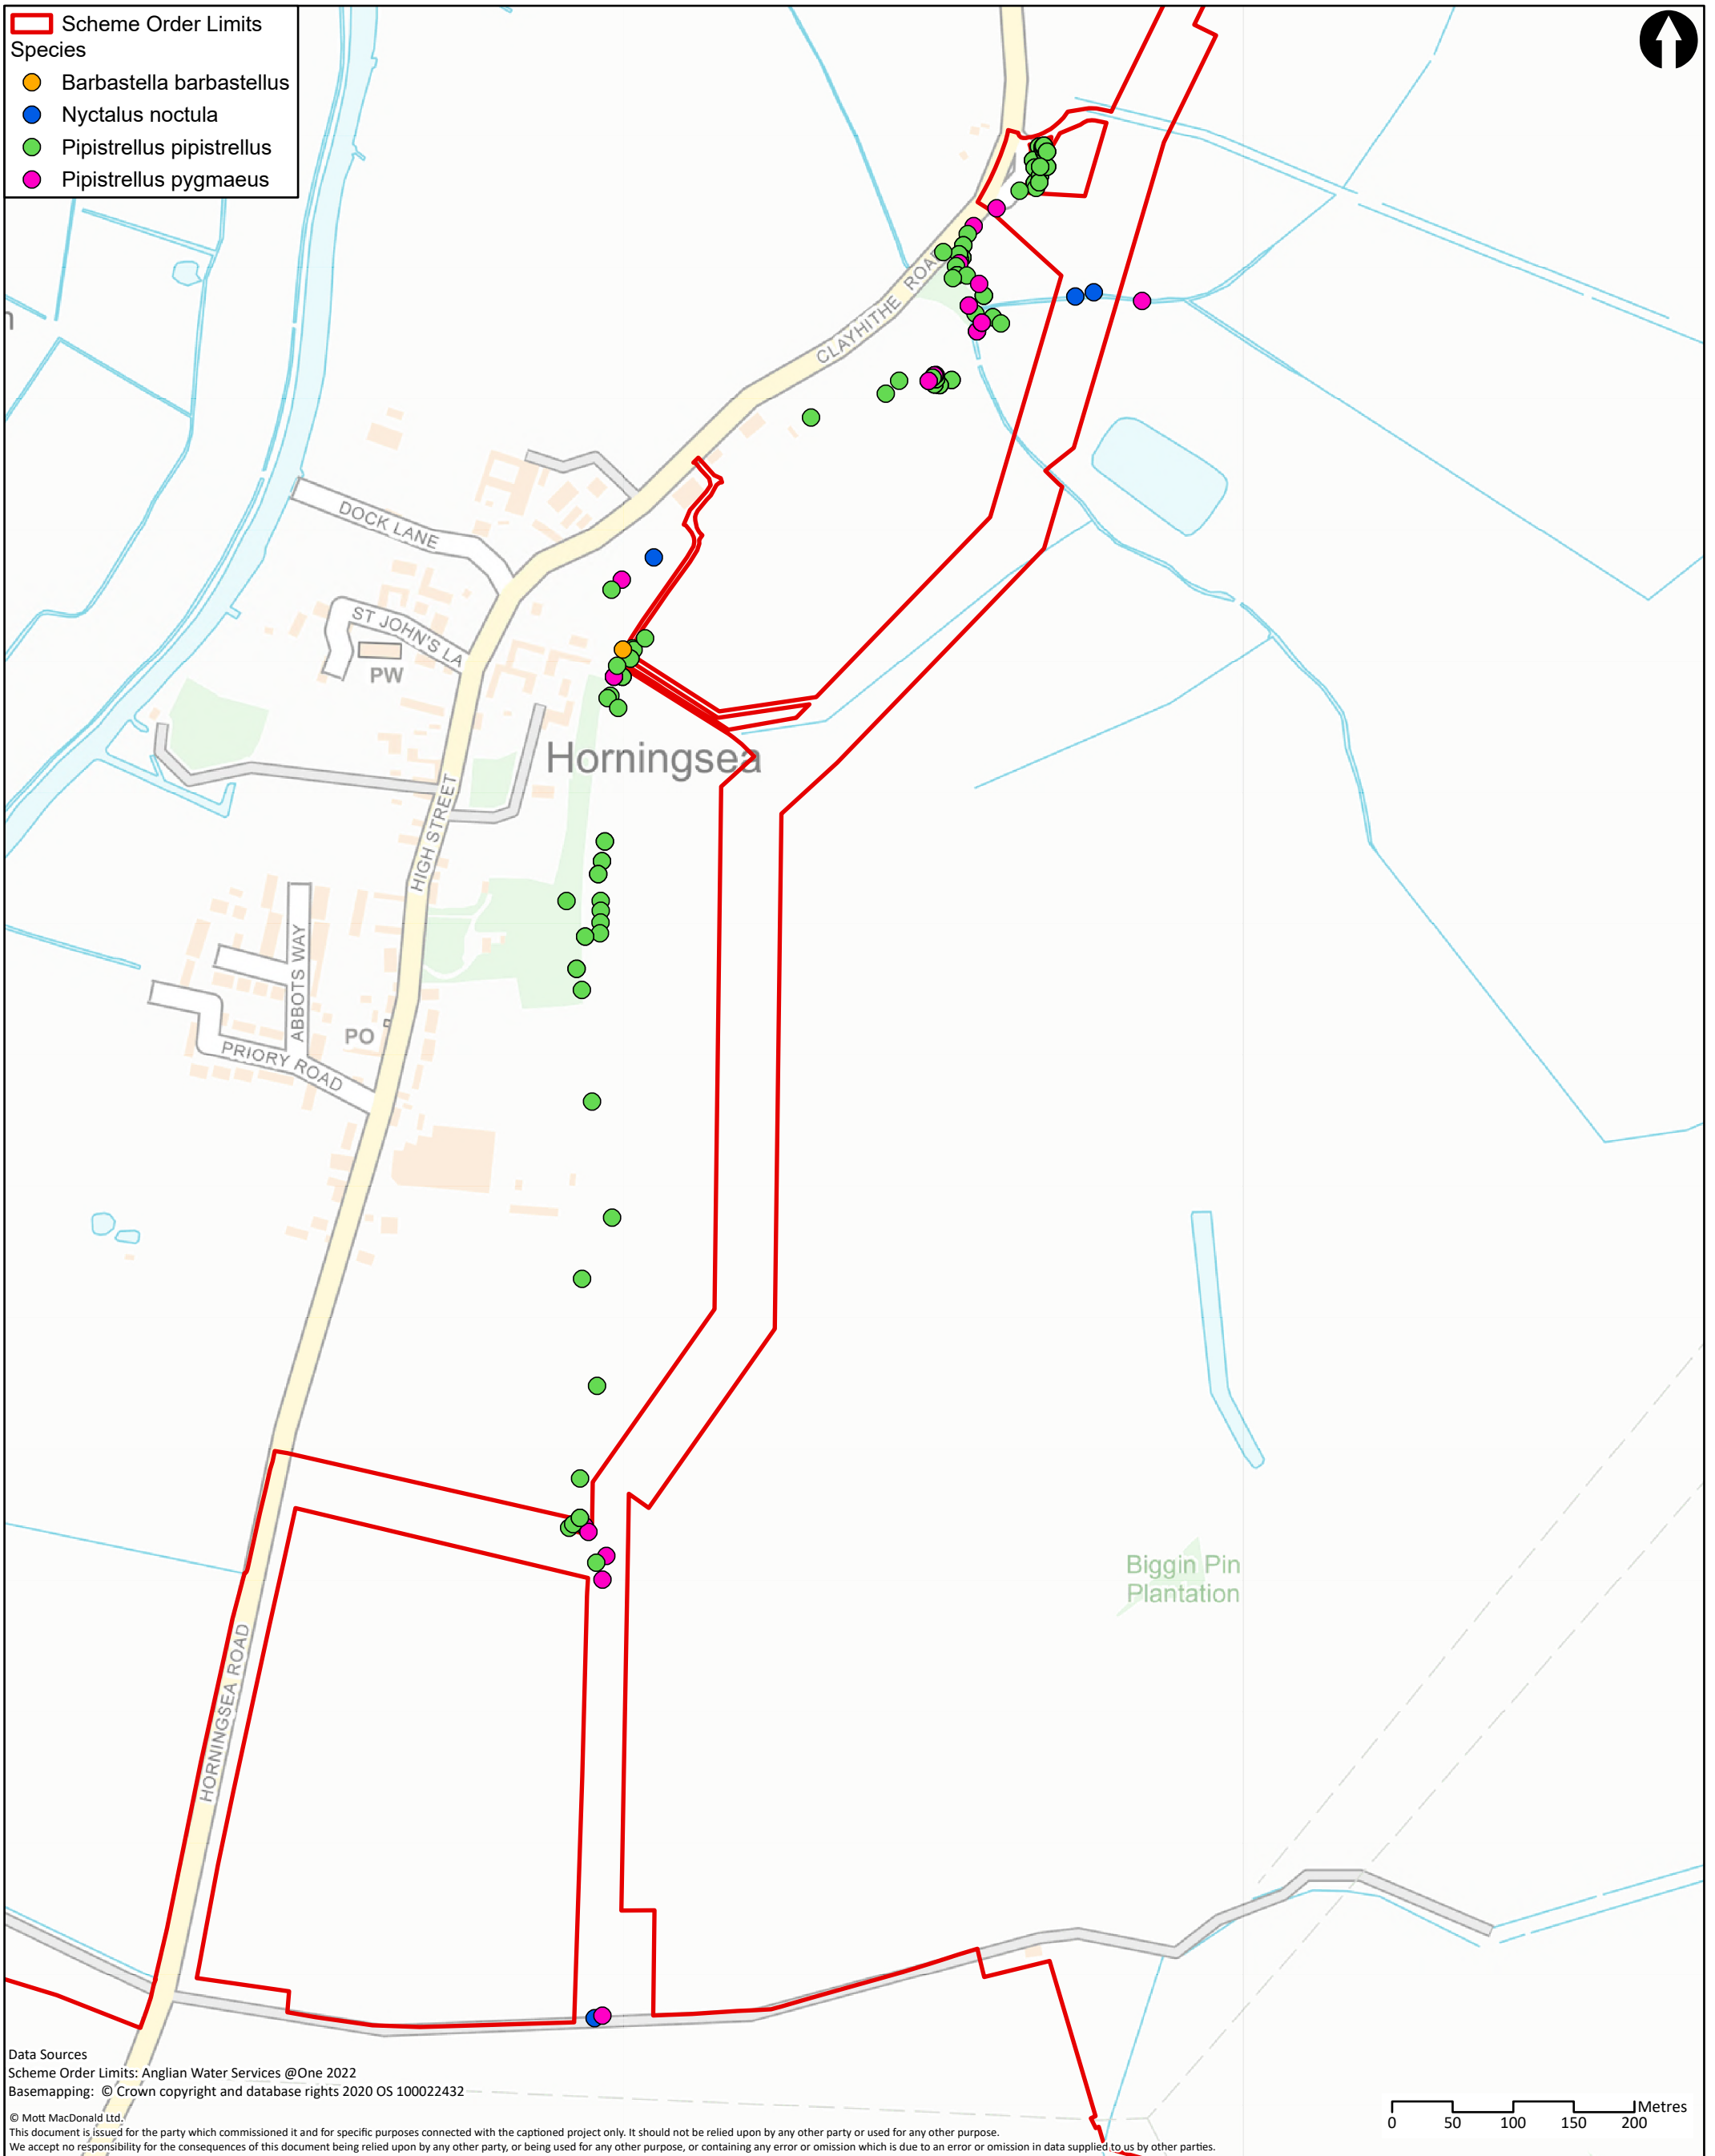


Data Sources  
 Scheme Order Limits: Anglian Water Services @One 2022  
 Basemapping: © Crown copyright and database rights 2020 OS 100022432

© Mott MacDonald Ltd.  
 This document is issued for the party which commissioned it and for specific purposes connected with the captioned project only. It should not be relied upon by any other party or used for any other purpose.  
 We accept no responsibility for the consequences of this document being relied upon by any other party, or being used for any other purpose, or containing any error or omission which is due to an error or omission in data supplied to us by other parties.

	22 Station Road Cambridge CB1 2JD United Kingdom		Client 			Title Cambridge Waste Water Treatment Plant Relocation Project Bats Waterbeach pipeline transect data from June – south transect			Drawn AW																		
	T +44 (0)20 8774 2000 F +44 (0)20 8681 5706 W mottmac.com		<table border="1"> <thead> <tr> <th>Rev</th> <th>Date</th> <th>Drawn</th> <th>Description</th> <th>Ch'k'd</th> <th>App'd</th> </tr> </thead> <tbody> <tr> <td>P2</td> <td>31/10/22</td> <td>AW</td> <td>For Information</td> <td>AW</td> <td>JM</td> </tr> <tr> <td>P3</td> <td>21/09/23</td> <td>JC</td> <td>For Information</td> <td>AW</td> <td>CS</td> </tr> </tbody> </table>			Rev	Date	Drawn	Description	Ch'k'd	App'd	P2	31/10/22	AW	For Information	AW	JM	P3	21/09/23	JC	For Information	AW	CS	Drawing Number Figure 8.68			Checked AW
	Rev	Date	Drawn	Description	Ch'k'd	App'd																					
P2	31/10/22	AW	For Information	AW	JM																						
P3	21/09/23	JC	For Information	AW	CS																						
						Approved CS			Scale at A3 1:5,000																		
									Security STD	Status PRE	Rev P3																



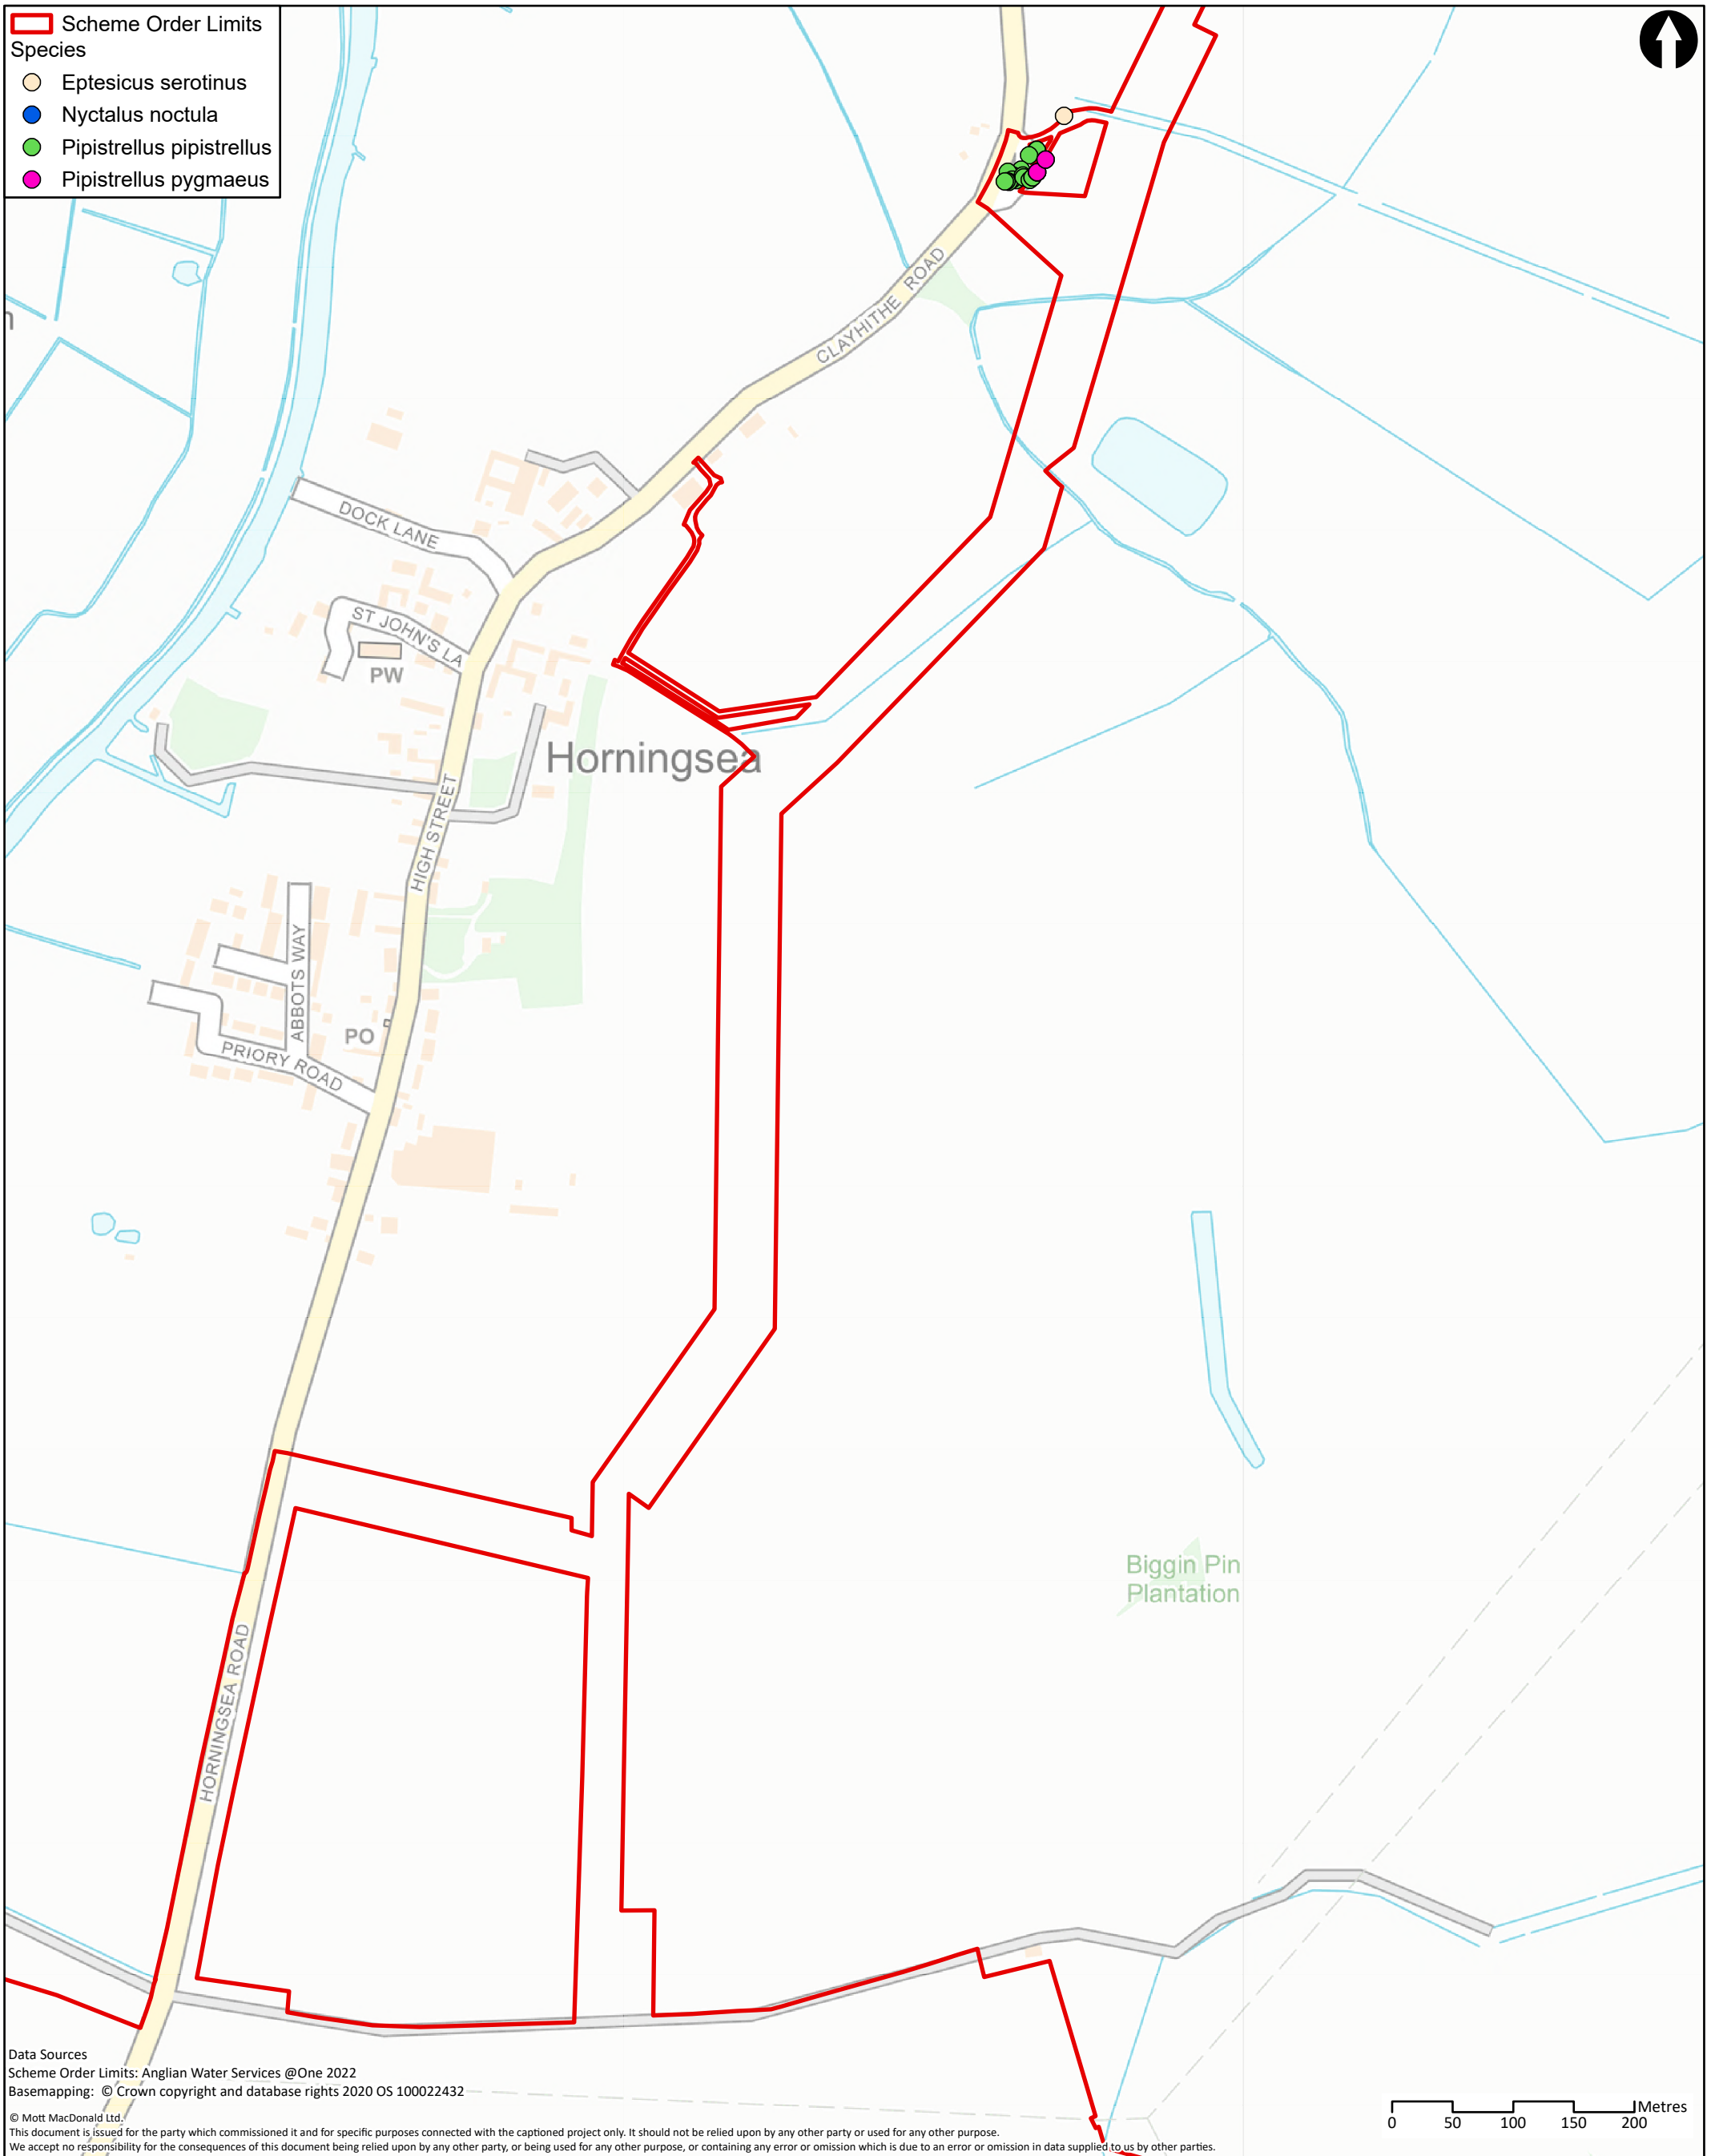


Data Sources  
 Scheme Order Limits: Anglian Water Services @One 2022  
 Basemapping: © Crown copyright and database rights 2020 OS 100022432

© Mott MacDonald Ltd.  
 This document is issued for the party which commissioned it and for specific purposes connected with the captioned project only. It should not be relied upon by any other party or used for any other purpose.  
 We accept no responsibility for the consequences of this document being relied upon by any other party, or being used for any other purpose, or containing any error or omission which is due to an error or omission in data supplied to us by other parties.

<p>22 Station Road Cambridge CB1 2JD United Kingdom</p> <p>T +44 (0)20 8774 2000 F +44 (0)20 8681 5706 W mottmac.com</p>	Client 					Title Cambridge Waste Water Treatment Plant Relocation Project Bats Waterbeach pipeline transect data from August – south transect Drawing Number <p style="text-align: center;">Figure 8.69</p>			Drawn	AW																
									Checked	AW																
									Approved	CS																
								Scale at A3 1:5,000																		
<table border="1"> <thead> <tr> <th>Rev</th> <th>Date</th> <th>Drawn</th> <th>Description</th> <th>Ch'k'd</th> <th>App'd</th> </tr> </thead> <tbody> <tr> <td>P2</td> <td>31/10/22</td> <td>AW</td> <td>For Information</td> <td>AW</td> <td>JM</td> </tr> <tr> <td>P3</td> <td>21/09/23</td> <td>JC</td> <td>For Information</td> <td>AW</td> <td>CS</td> </tr> </tbody> </table>						Rev	Date	Drawn	Description	Ch'k'd	App'd	P2	31/10/22	AW	For Information	AW	JM	P3	21/09/23	JC	For Information	AW	CS	Security	Status	Rev
Rev	Date	Drawn	Description	Ch'k'd	App'd																					
P2	31/10/22	AW	For Information	AW	JM																					
P3	21/09/23	JC	For Information	AW	CS																					
								STD	PRE	P3																



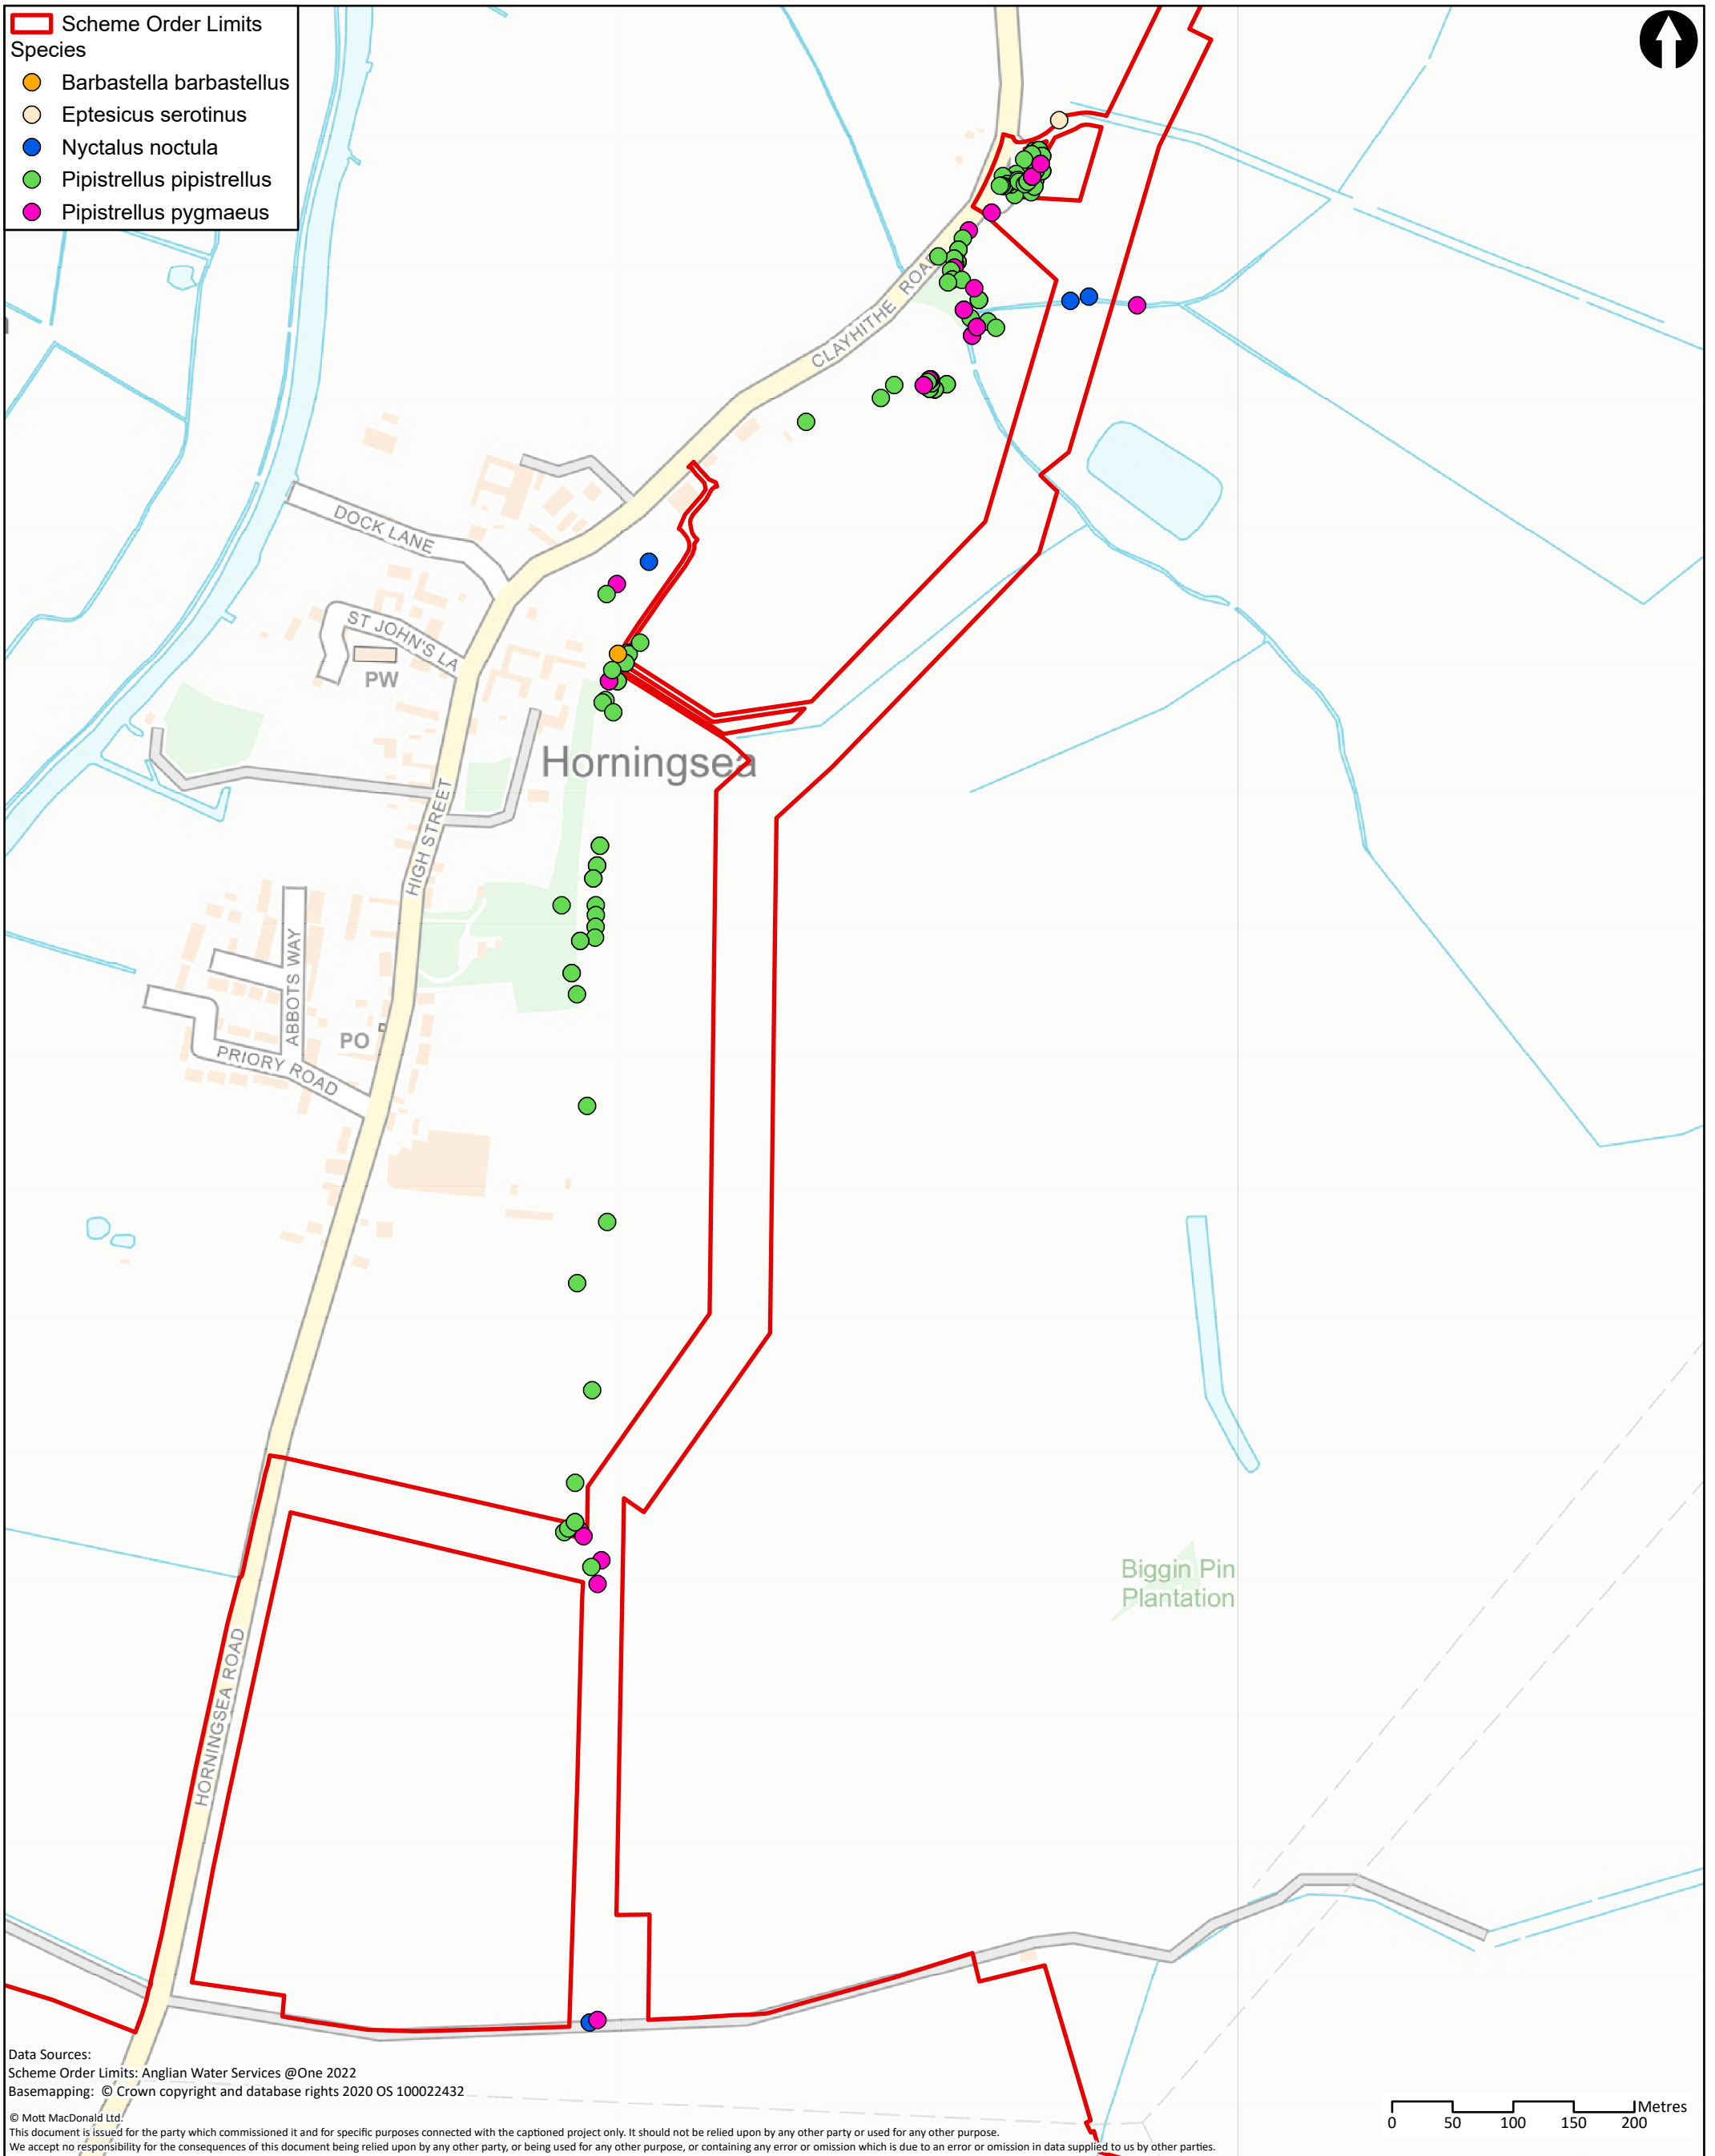


Data Sources:  
 Scheme Order Limits: Anglian Water Services @One 2022  
 Basemapping: © Crown copyright and database rights 2020 OS 100022432

© Mott MacDonald Ltd.  
 This document is issued for the party which commissioned it and for specific purposes connected with the captioned project only. It should not be relied upon by any other party or used for any other purpose.  
 We accept no responsibility for the consequences of this document being relied upon by any other party, or being used for any other purpose, or containing any error or omission which is due to an error or omission in data supplied to us by other parties.


<p>22 Station Road Cambridge CB1 2JD United Kingdom</p> <p>T +44 (0)20 8774 2000 F +44 (0)20 8681 5706 W mottmac.com</p>	<p>Client</p>					<p>Title</p> <p>Cambridge Waste Water Treatment Plant Relocation Project</p> <p>Bats</p> <p>Waterbeach pipeline south transect data – combined visits</p>			Drawn	AW																		
	<table border="1"> <thead> <tr> <th>Rev</th> <th>Date</th> <th>Drawn</th> <th>Description</th> <th>Ch'k'd</th> <th>App'd</th> </tr> </thead> <tbody> <tr> <td>P2</td> <td>31/10/22</td> <td>AW</td> <td>For Information</td> <td>AW</td> <td>JM</td> </tr> <tr> <td>P3</td> <td>21/09/23</td> <td>JC</td> <td>For Information</td> <td>AW</td> <td>CS</td> </tr> </tbody> </table>					Rev	Date	Drawn	Description	Ch'k'd	App'd	P2	31/10/22	AW	For Information	AW	JM	P3	21/09/23	JC	For Information	AW	CS	<p>Drawing Number</p> <p>Figure 8.70</p>			Checked	AW
	Rev	Date	Drawn	Description	Ch'k'd	App'd																						
P2	31/10/22	AW	For Information	AW	JM																							
P3	21/09/23	JC	For Information	AW	CS																							
								Approved	CS																			
								Scale at A3 1:5,000																				
								Security	Status	Rev																		
								STD	PRE	P3																		



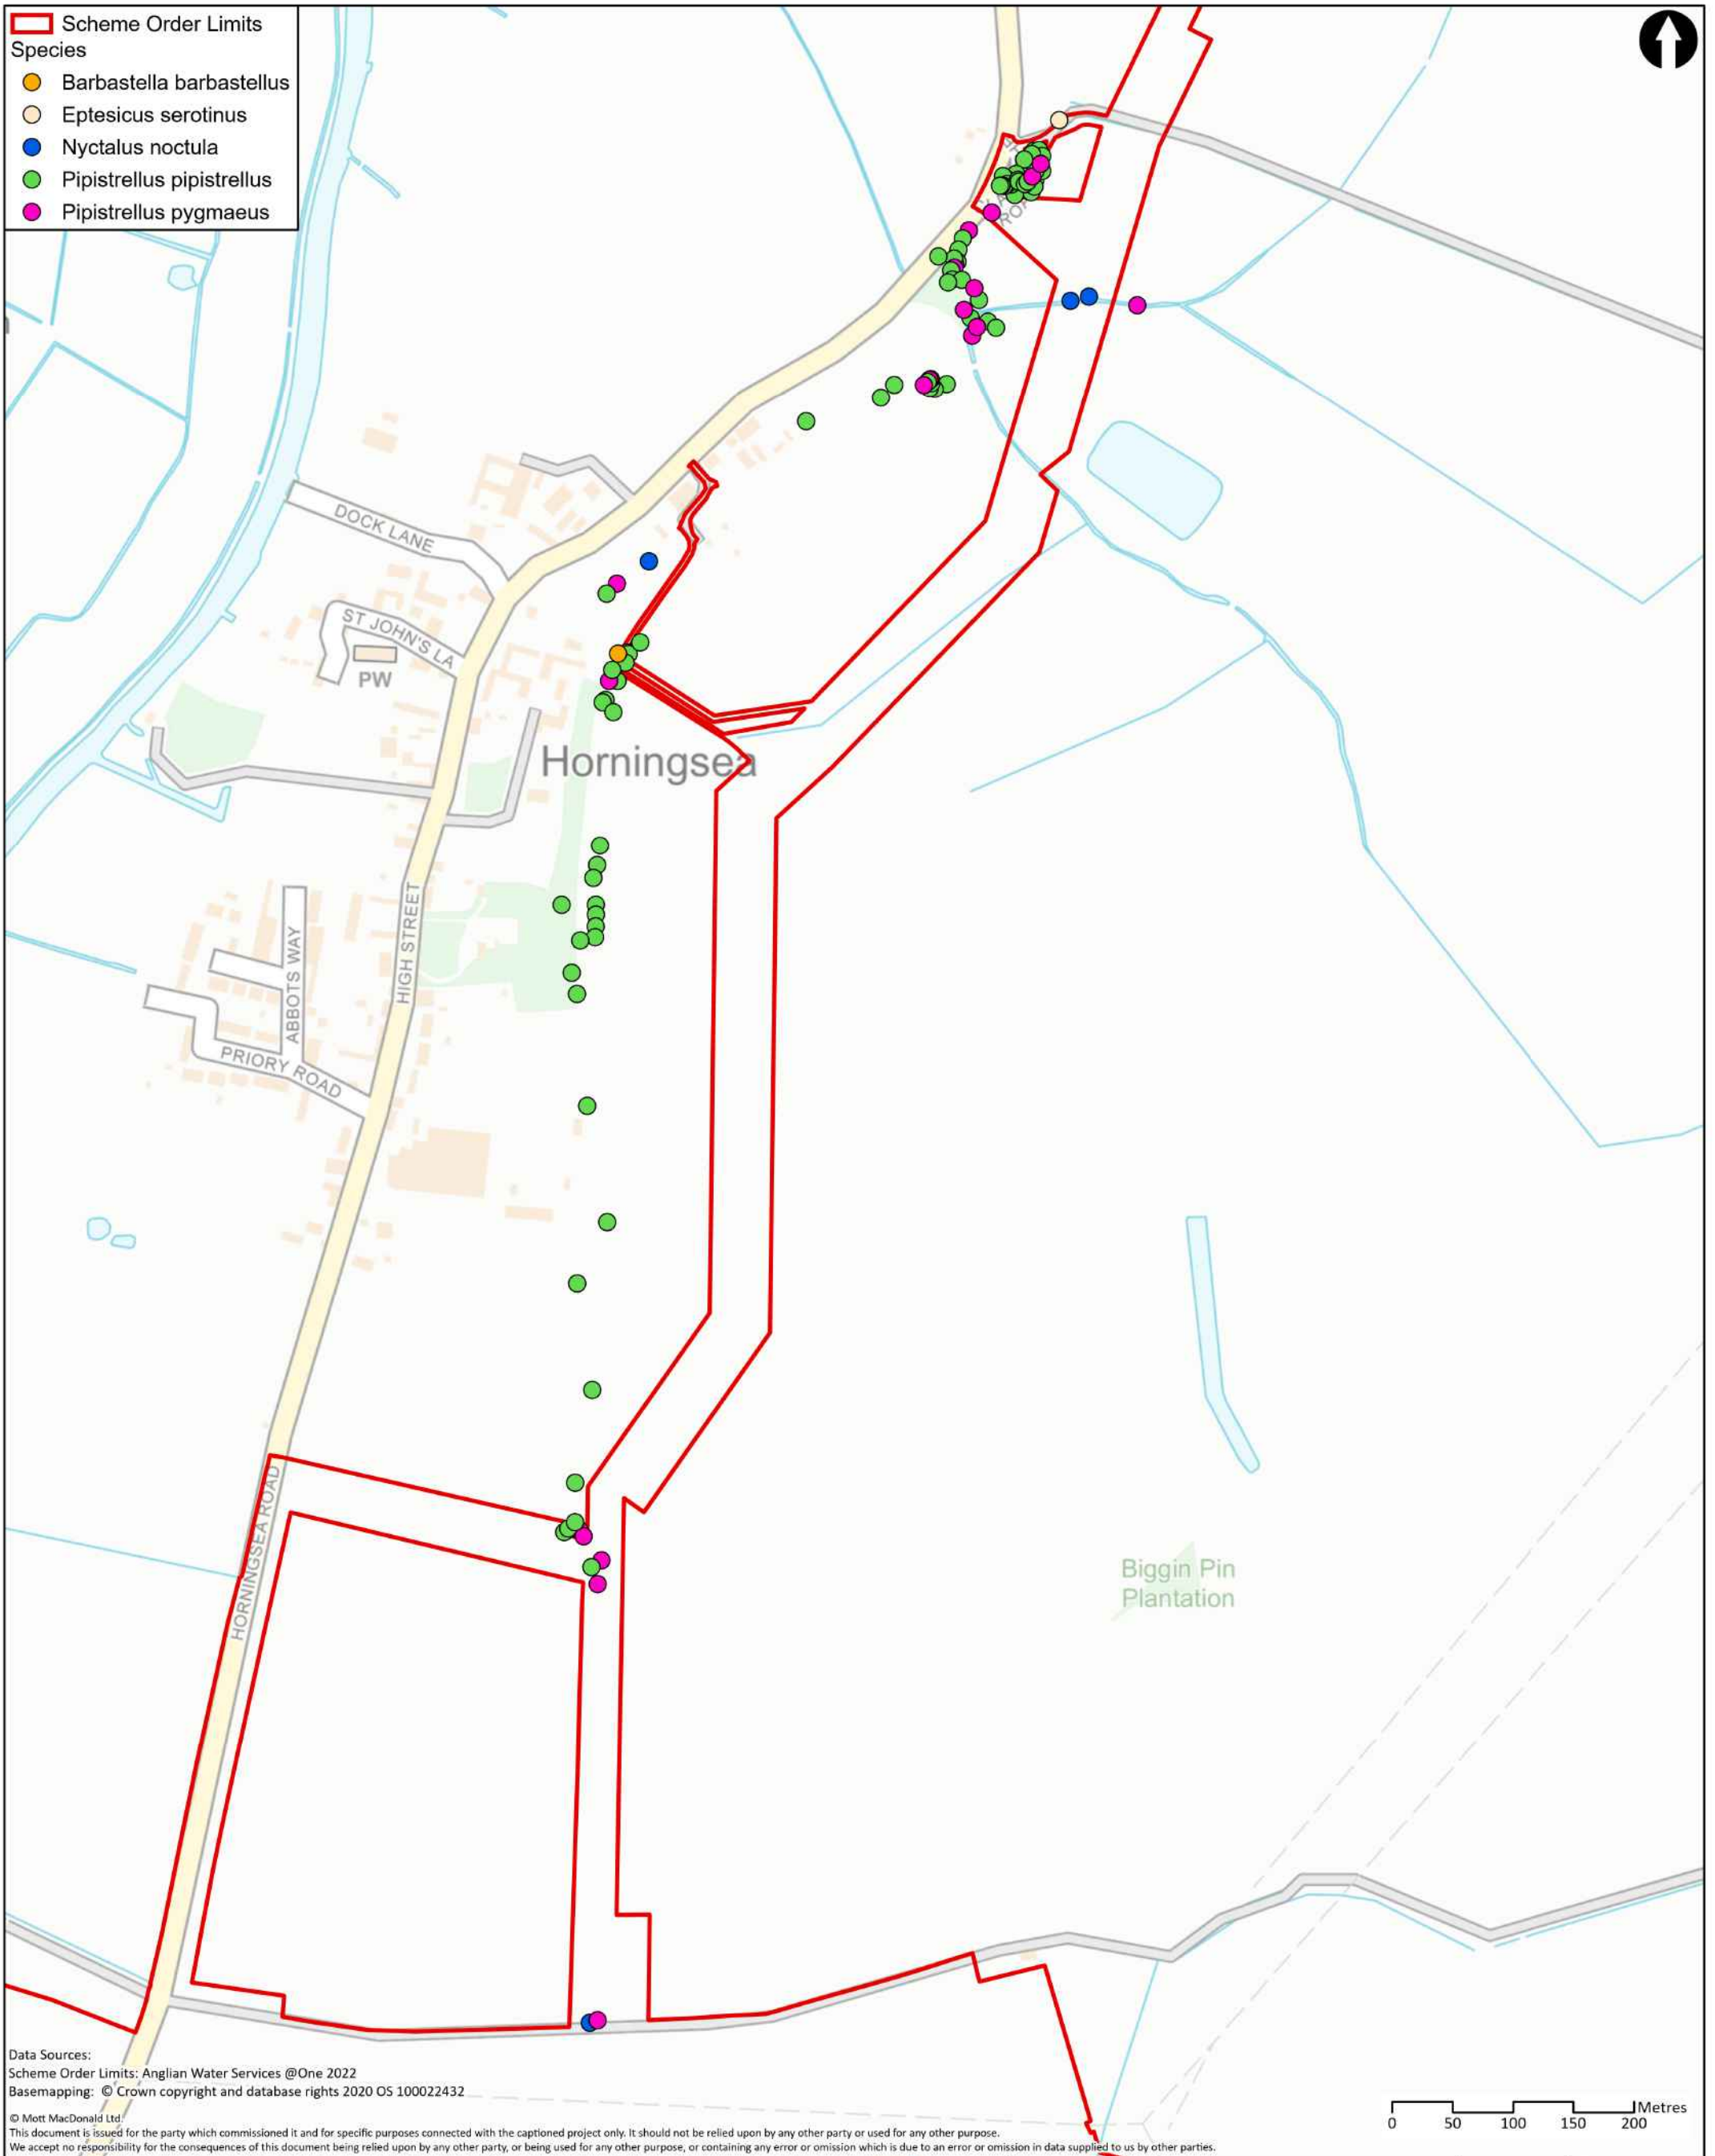


Data Sources:  
 Scheme Order Limits: Anglian Water Services @One 2022  
 Basemapping: © Crown copyright and database rights 2020 OS 100022432

© Mott MacDonald Ltd.  
 This document is issued for the party which commissioned it and for specific purposes connected with the captioned project only. It should not be relied upon by any other party or used for any other purpose.  
 We accept no responsibility for the consequences of this document being relied upon by any other party, or being used for any other purpose, or containing any error or omission which is due to an error or omission in data supplied to us by other parties.



	22 Station Road Cambridge CB1 2JD United Kingdom		Client 			Title Cambridge Waste Water Treatment Plant Relocation Project Bats Waterbeach pipeline south transect data – combined visits			Drawn	AW																		
	T +44 (0)20 8774 2000 F +44 (0)20 8681 5706 W mottmac.com		<table border="1"> <thead> <tr> <th>Rev</th> <th>Date</th> <th>Drawn</th> <th>Description</th> <th>Ch'k'd</th> <th>App'd</th> </tr> </thead> <tbody> <tr> <td>P1</td> <td>31/10/22</td> <td>AW</td> <td>First Draft</td> <td>AW</td> <td>JM</td> </tr> <tr> <td>P2</td> <td>24/01/23</td> <td>AW</td> <td>First Revision</td> <td>AW</td> <td>JM</td> </tr> </tbody> </table>			Rev	Date	Drawn	Description	Ch'k'd	App'd	P1	31/10/22	AW	First Draft	AW	JM	P2	24/01/23	AW	First Revision	AW	JM	Drawing Number Figure 8.71			Checked	AW
	Rev	Date	Drawn	Description	Ch'k'd	App'd																						
P1	31/10/22	AW	First Draft	AW	JM																							
P2	24/01/23	AW	First Revision	AW	JM																							
					Approved JM			Scale at A3 1:5,000																				
								Security	Status	Rev																		
								STD	PRE	P2																		




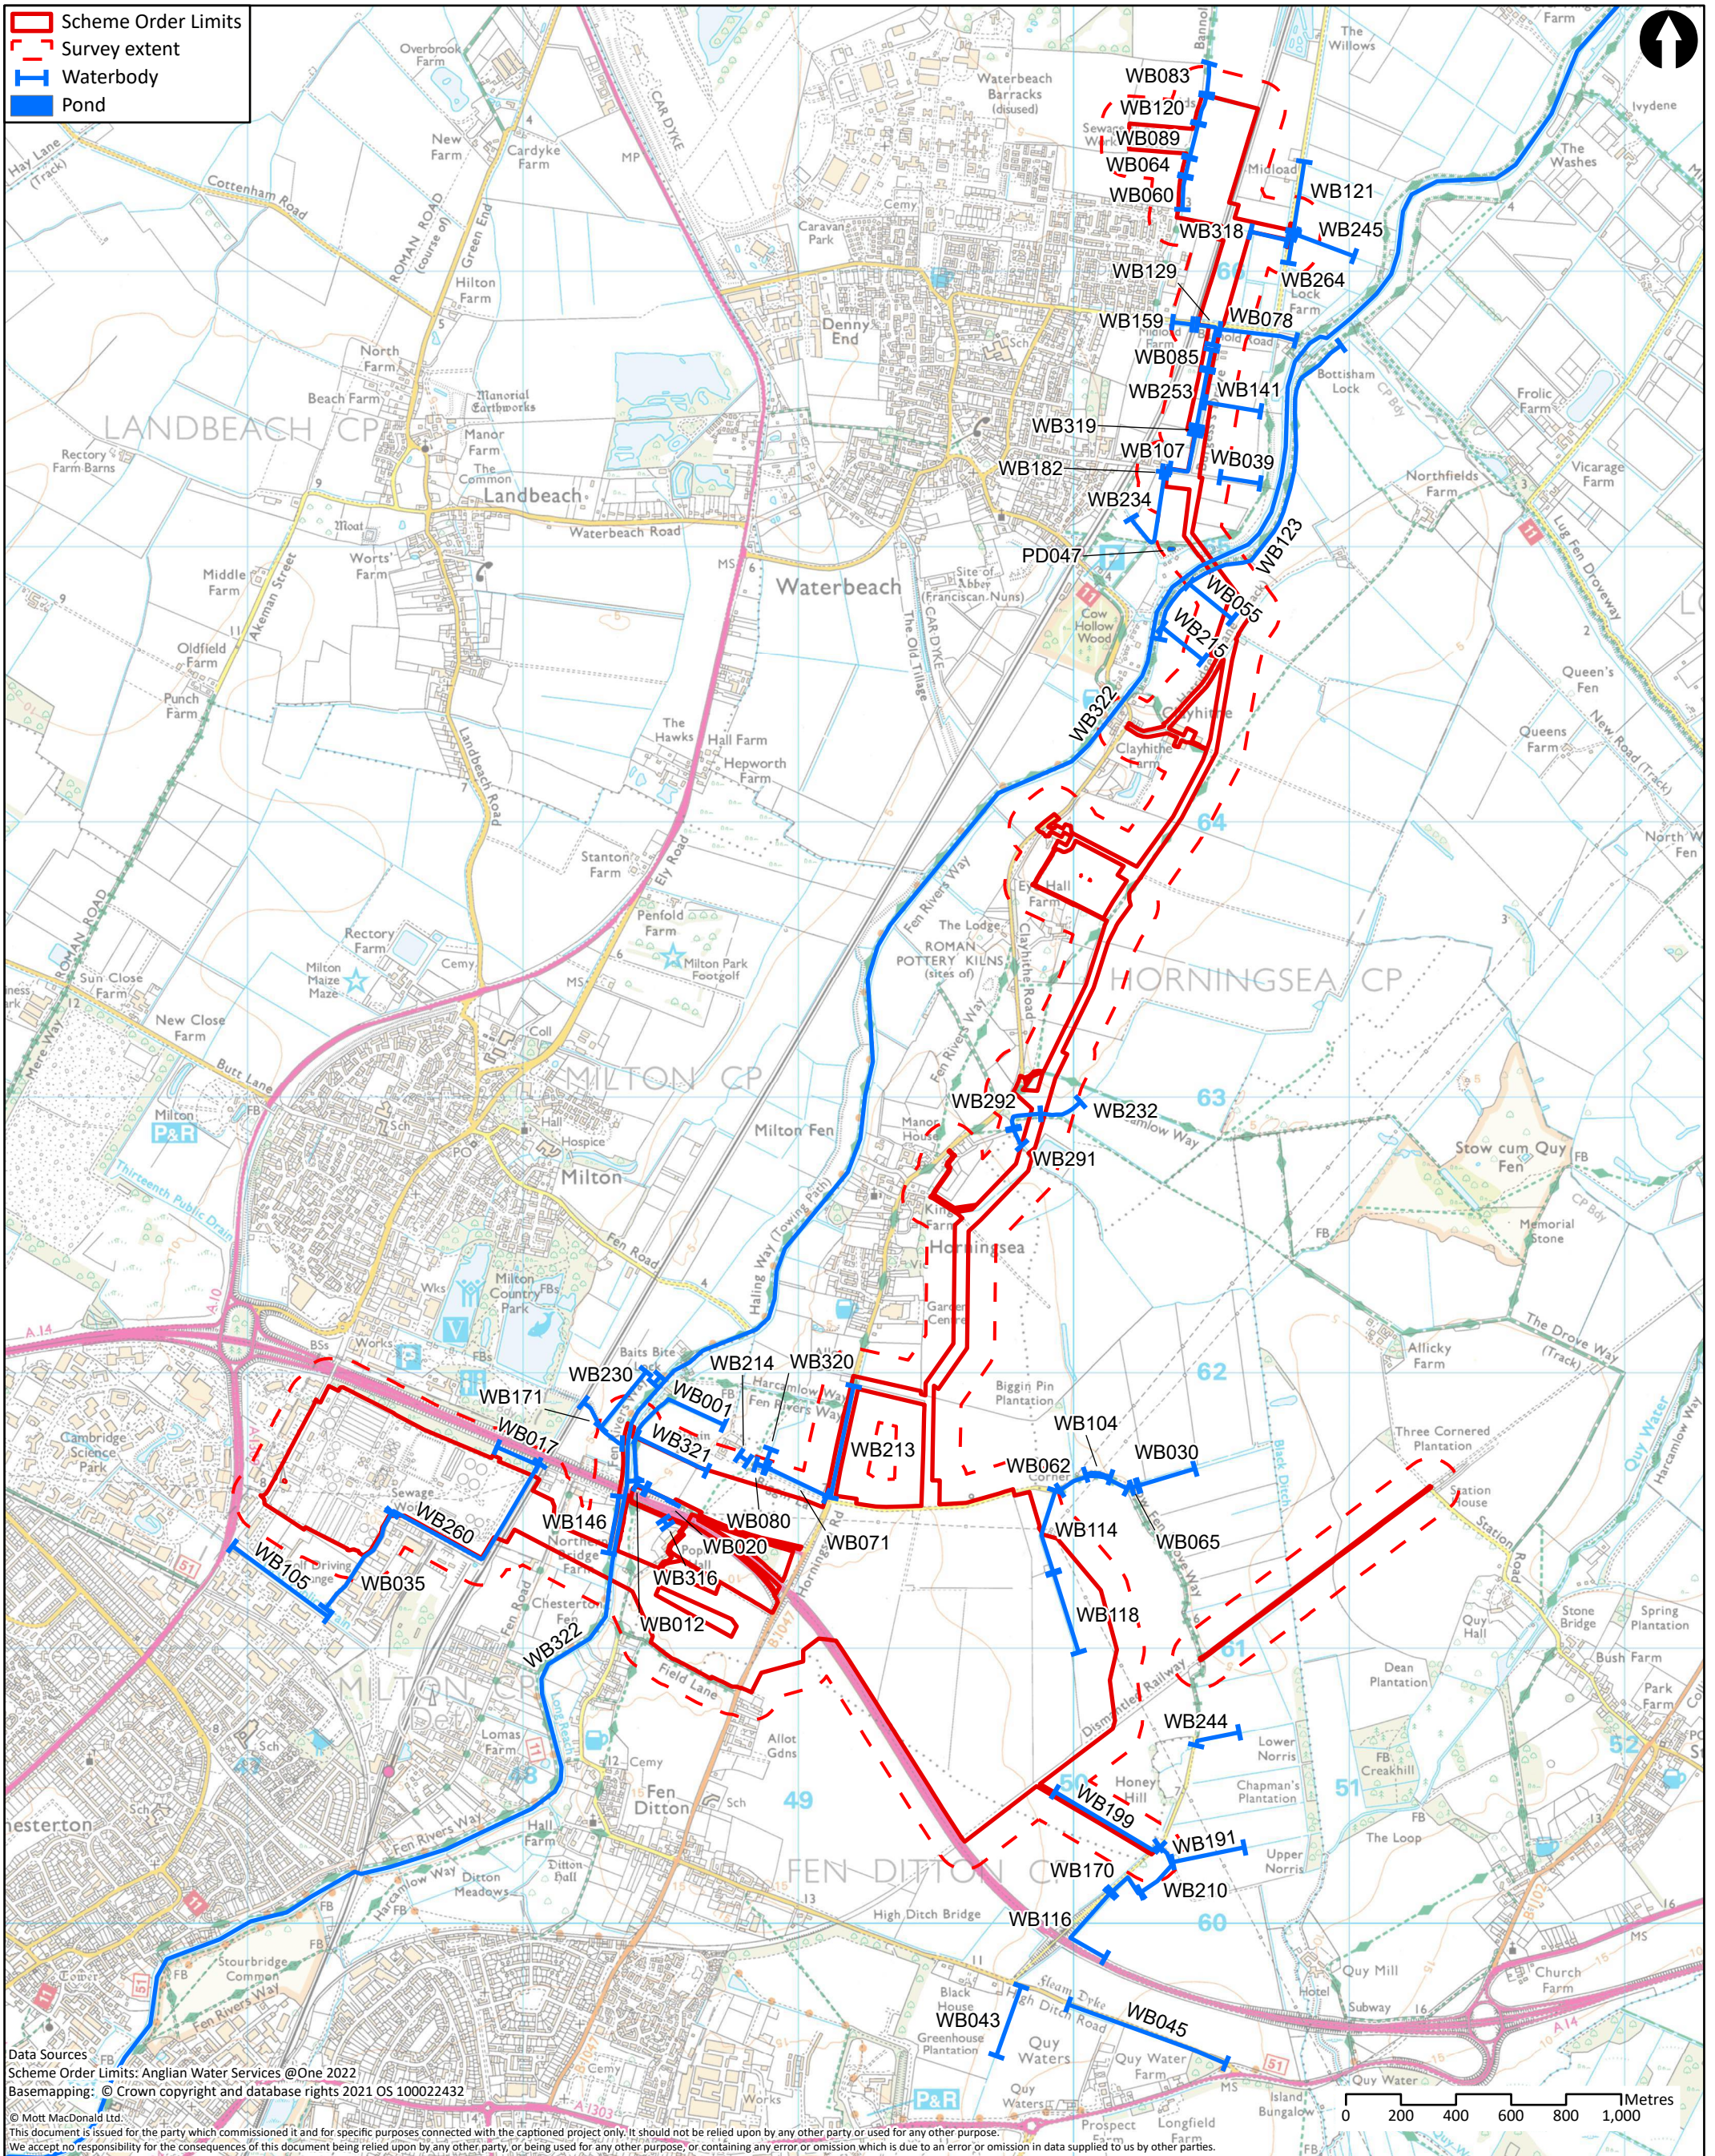

Data Sources  
 Scheme Order Limits: Anglian Water Services @One 2022  
 Basemapping: © Crown copyright and database rights 2021 OS 100022432  
 © Mott MacDonald Ltd.  
 This document is issued for the party which commissioned it and for specific purposes connected with the captioned project only. It should not be relied upon by any other party, or used for any other purpose.  
 We accept no responsibility for the consequences of this document being relied upon by any other party, or being used for any other purpose, or containing any error or omission which is due to an error or omission in data supplied to us by other parties.

<p>MOTT MACDONALD</p> <p>22 Station Road Cambridge CB1 2JD United Kingdom</p> <p>T +44 (0)20 8774 2000 F +44 (0)20 8681 5706 W mottmac.com</p>	Client								Title			Drawn	KL	
									Cambridge Waste Water Treatment Plant Relocation Project Otters Scoped in waterbodies			Checked	AW	
											Approved	CS		
											Scale at A3	1:22,000		
											Security	Status	Rev	
								Drawing Number			STD	PRE	P1	
								Figure 8.74						



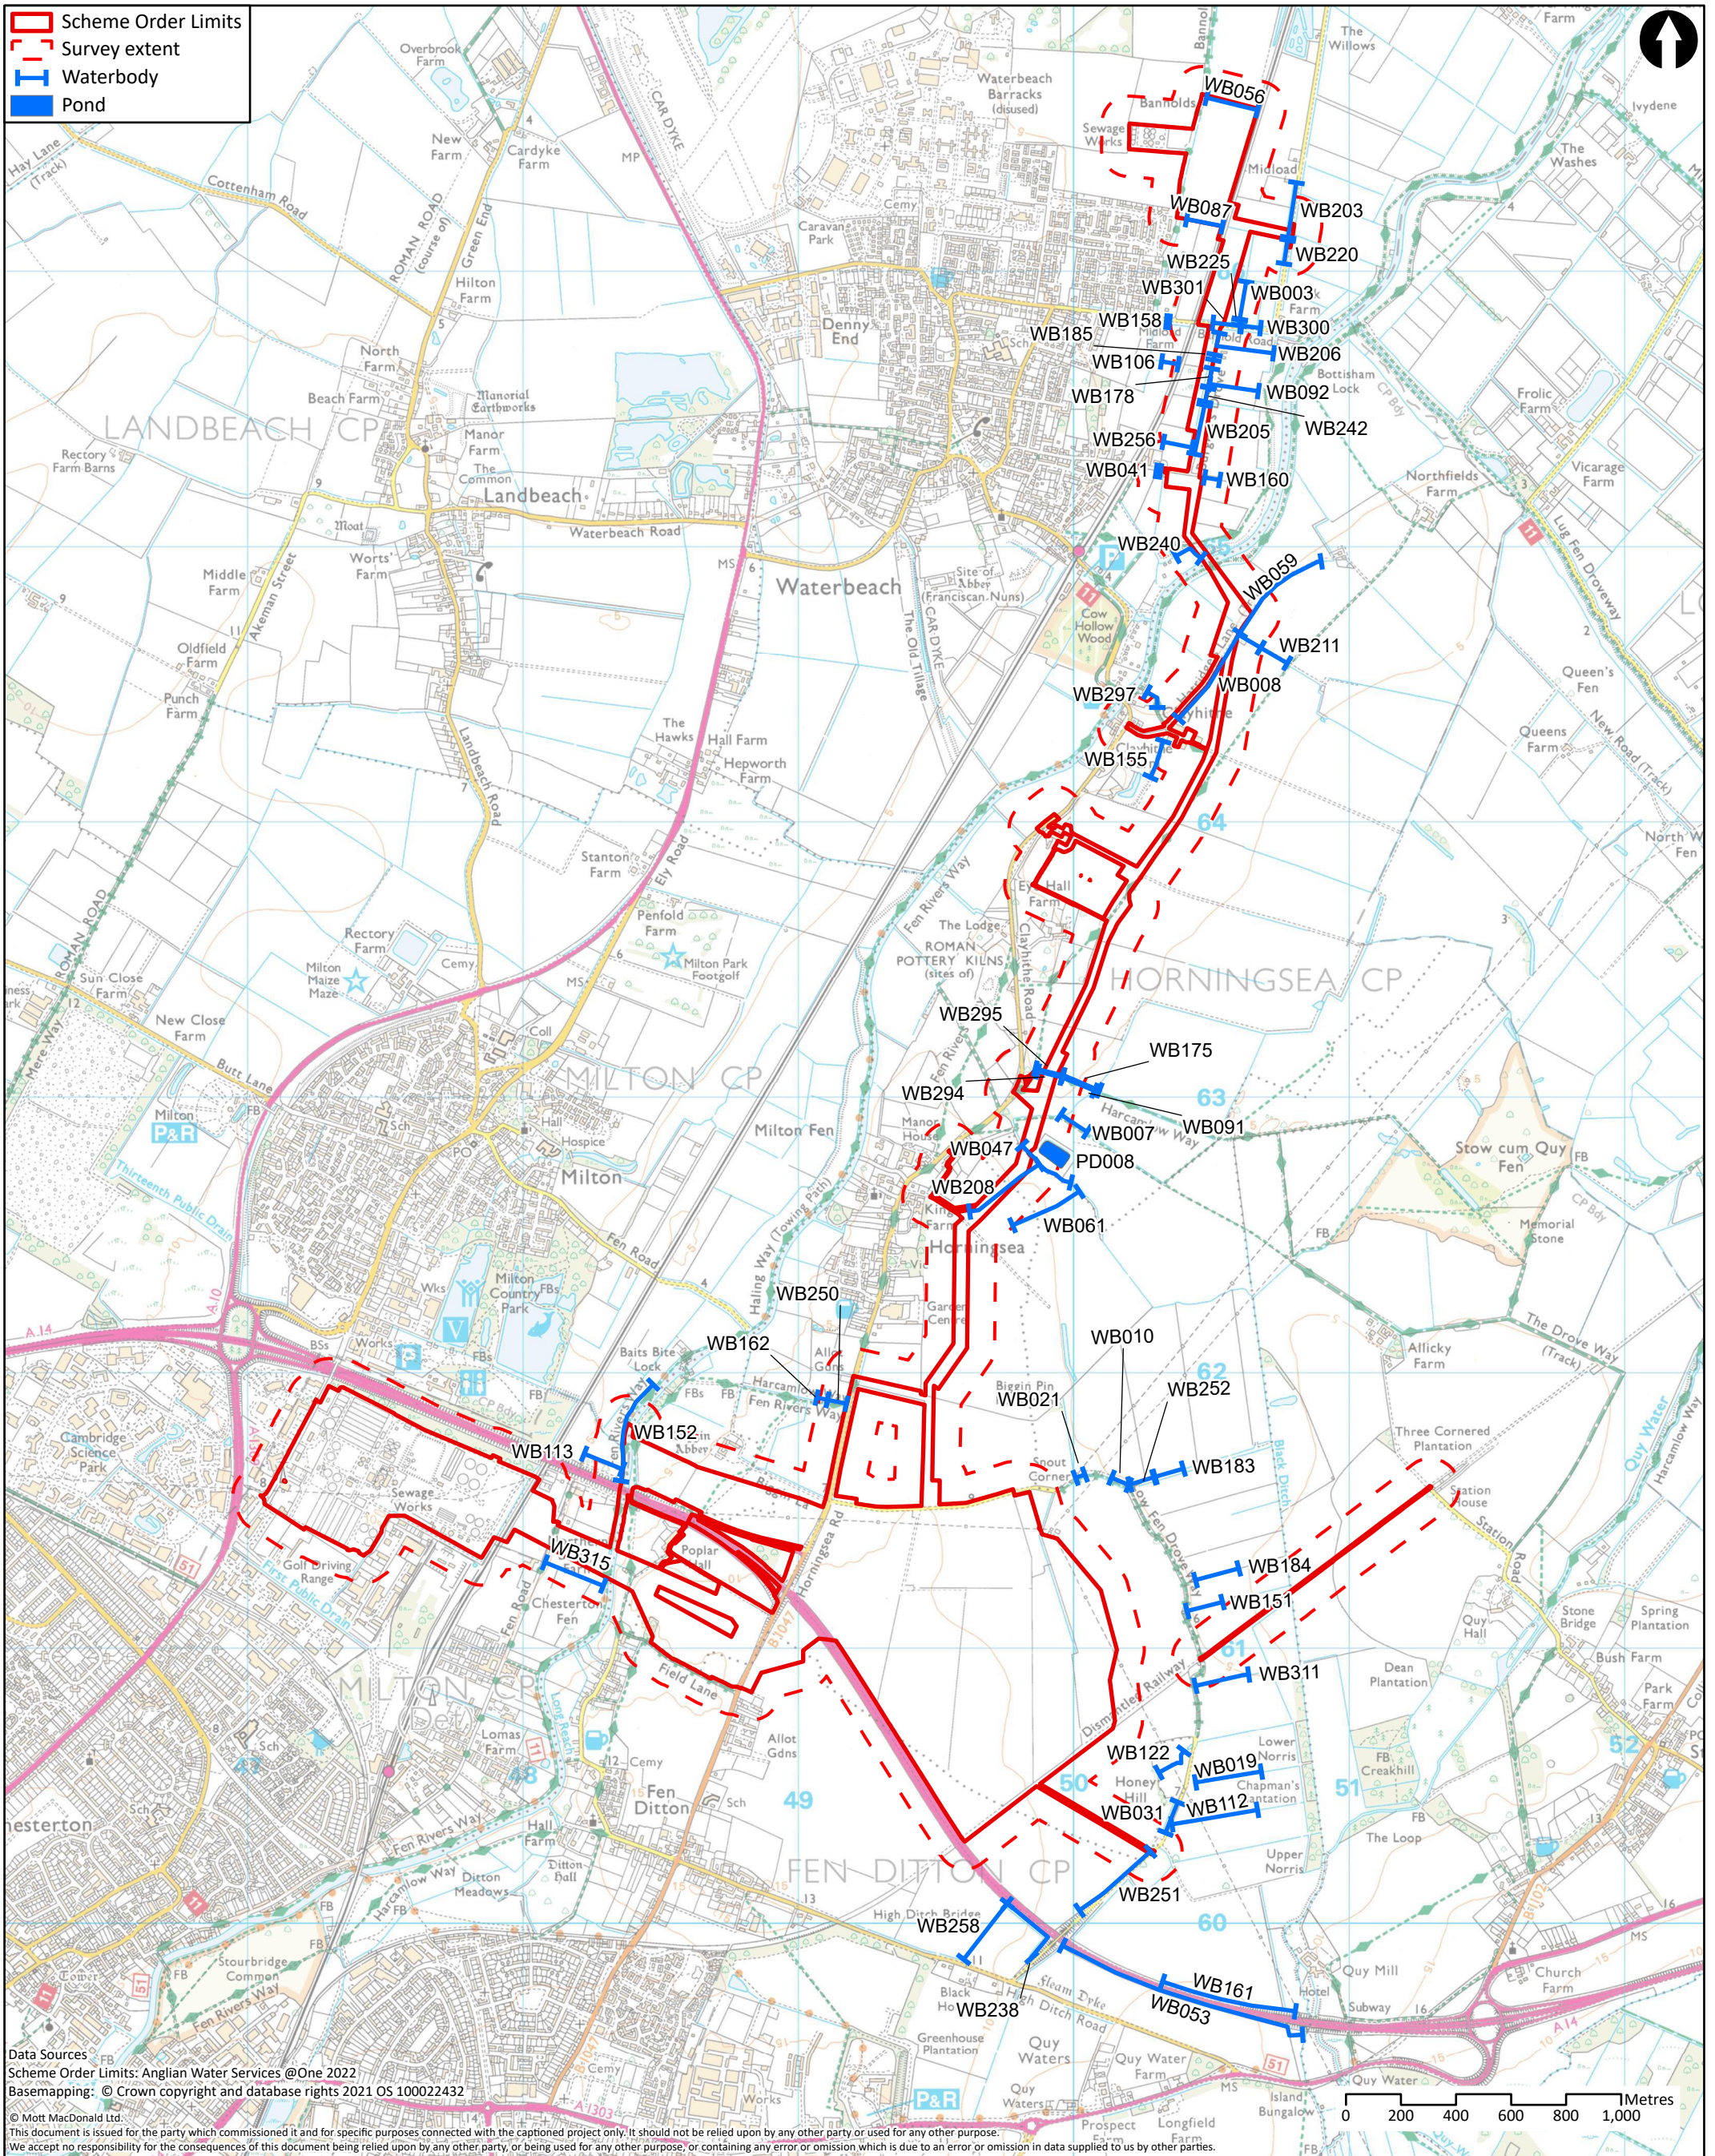

Data Sources  
 Scheme Order Limits: Anglian Water Services @One 2022  
 Basemapping: © Crown copyright and database rights 2021 OS 100022432  
 © Mott MacDonald Ltd.  
 This document is issued for the party which commissioned it and for specific purposes connected with the captioned project only. It should not be relied upon by any other party, or used for any other purpose.  
 We accept no responsibility for the consequences of this document being relied upon by any other party, or being used for any other purpose, or containing any error or omission which is due to an error or omission in data supplied to us by other parties.

**M**  
**M**  
**MOTT**  
**MACDONALD**

22 Station Road  
 Cambridge CB1 2JD  
 United Kingdom


T +44 (0)20 8774 2000  
 F +44 (0)20 8681 5706  
 W mottmac.com

Client					
Rev	Date	Drawn	Description	Ch'k'd	App'd
P1	10/11/22	KL	First Draft	AW	CS

Title	
Cambridge Waste Water Treatment Plant Relocation Project	
Otters	
Scoped out waterbodies	
Drawing Number	
Figure 8.75	

Drawn	KL
Checked	AW
Approved	CS
Scale at A3	
1:22,000	
Security	Status
STD	PRE
Rev	P1




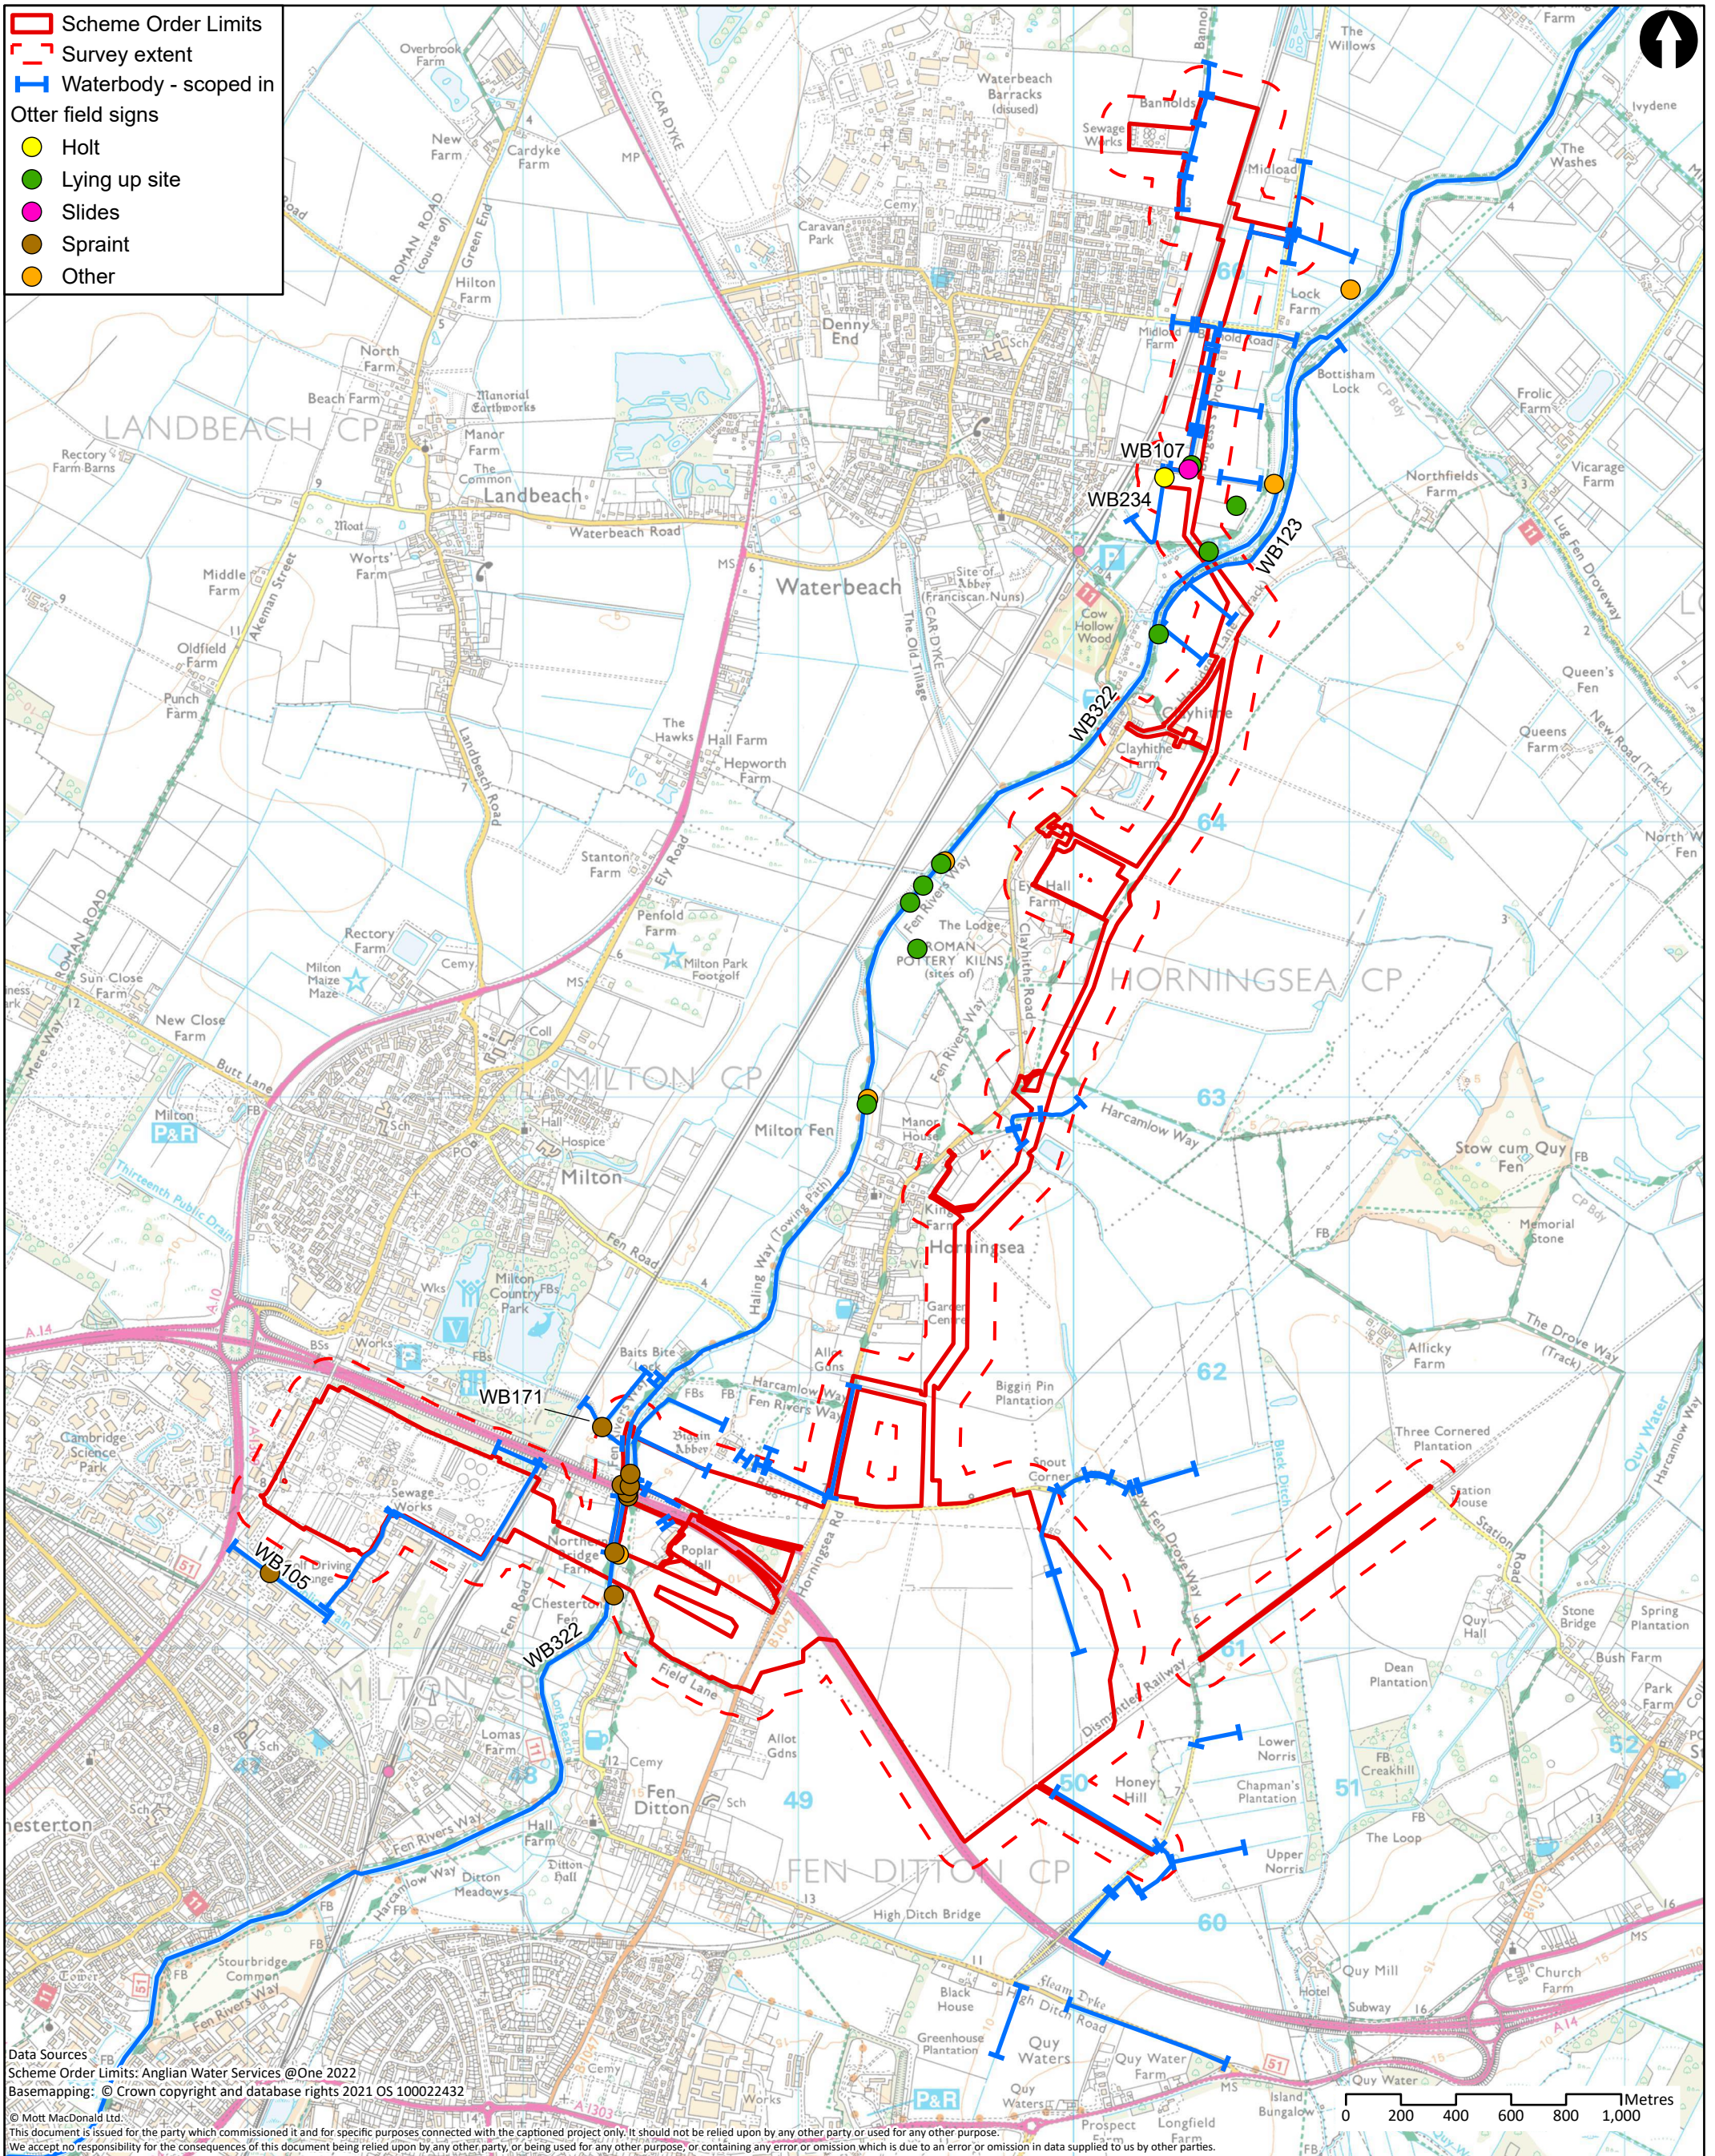

Data Sources  
 Scheme Order Limits: Anglian Water Services @One 2022  
 Basemapping: © Crown copyright and database rights 2021 OS 100022432  
 © Mott MacDonald Ltd.  
 This document is issued for the party which commissioned it and for specific purposes connected with the captioned project only. It should not be relied upon by any other party, or used for any other purpose.  
 We accept no responsibility for the consequences of this document being relied upon by any other party, or being used for any other purpose, or containing any error or omission which is due to an error or omission in data supplied to us by other parties.

	22 Station Road Cambridge CB1 2JD United Kingdom  T +44 (0)20 8774 2000 F +44 (0)20 8681 5706 W mottmac.com		Client 				Title Cambridge Waste Water Treatment Plant Relocation Project Otters Field signs			Drawn KL											
							Checked AW			Approved CS											
							Scale at A3 1:22,000			Security STD											
		<table border="1"> <thead> <tr> <th>Rev</th> <th>Date</th> <th>Drawn</th> <th>Description</th> <th>Ch'k'd</th> <th>App'd</th> </tr> </thead> <tbody> <tr> <td>P1</td> <td>10/11/22</td> <td>KL</td> <td>First Draft</td> <td>AW</td> <td>CS</td> </tr> </tbody> </table>		Rev	Date	Drawn	Description	Ch'k'd	App'd	P1	10/11/22	KL	First Draft	AW	CS	Drawing Number Figure 8.76			Status PRE		Rev P1
Rev	Date	Drawn	Description	Ch'k'd	App'd																
P1	10/11/22	KL	First Draft	AW	CS																



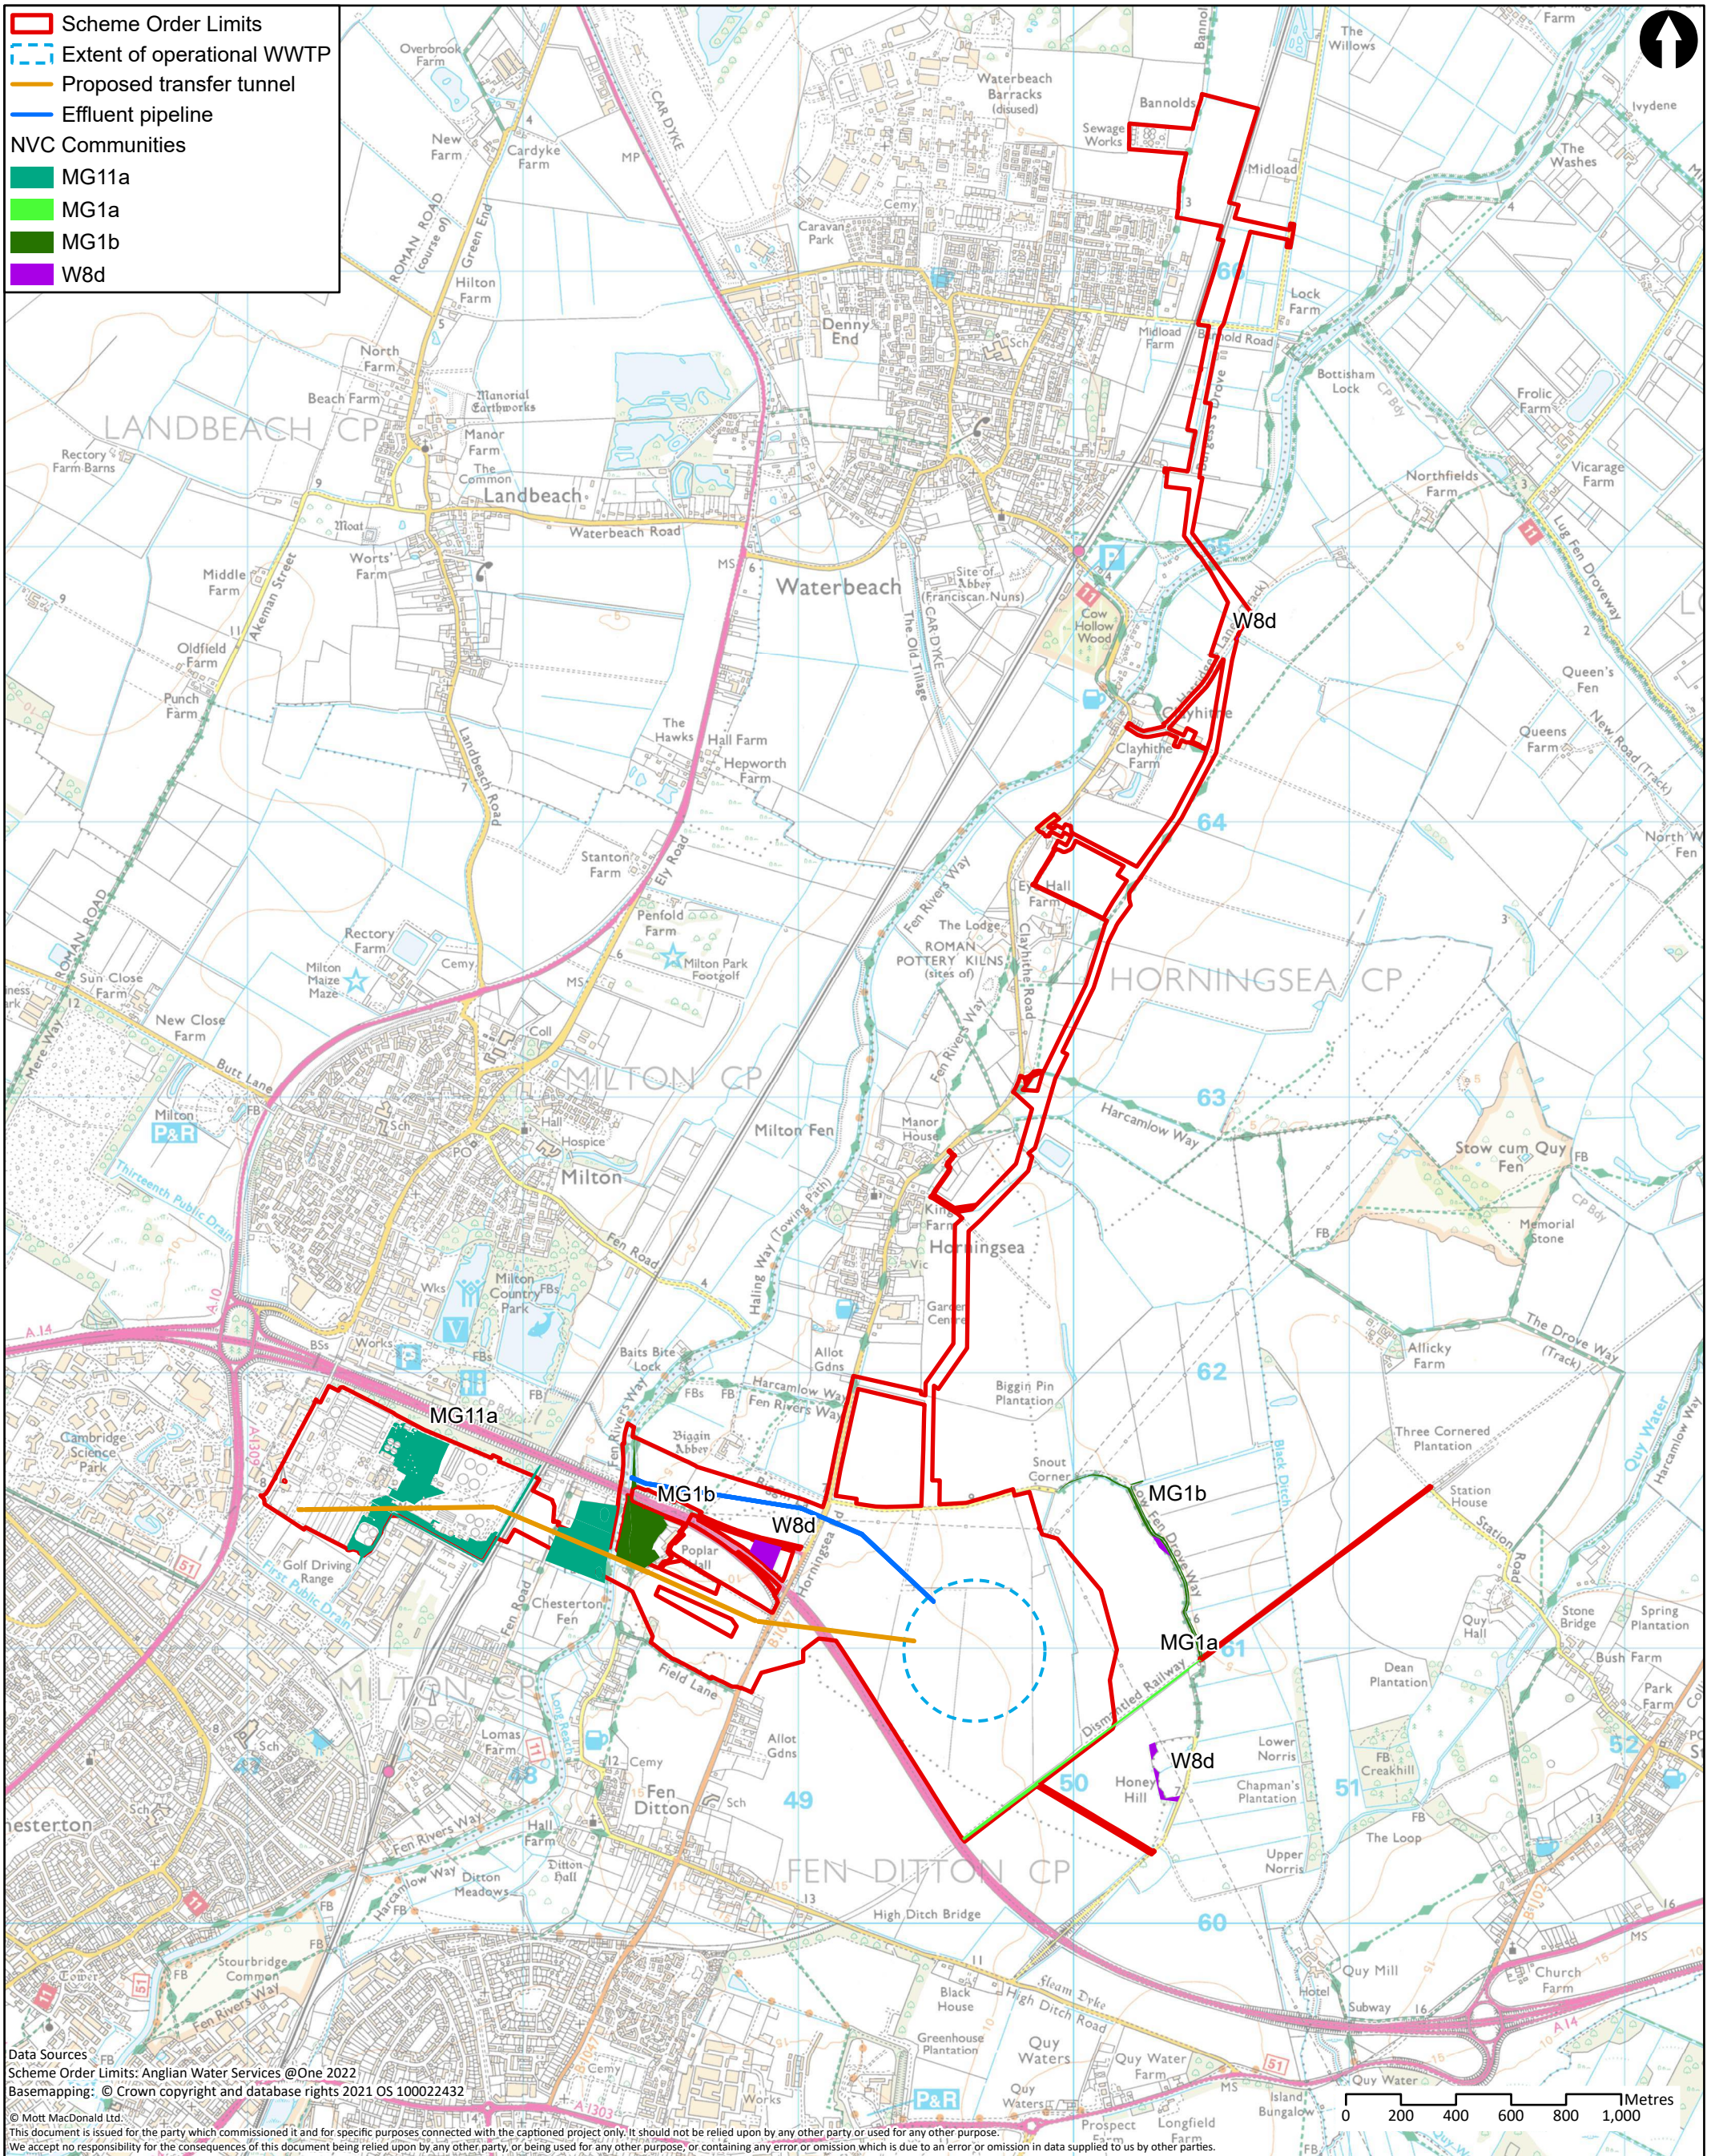

<p><b>MOTT MACDONALD</b></p> <p>22 Station Road Cambridge CB1 2JD United Kingdom</p> <p>T +44 (0)20 8774 2000 F +44 (0)20 8681 5706 W mottmac.com</p>	<p>Client</p>					<p>Title</p> <p>Cambridge Waste Water Treatment Plant Relocation Project NVC NVC communities</p>			Drawn	KL							
	<table border="1"> <thead> <tr> <th>Rev</th> <th>Date</th> <th>Drawn</th> <th>Description</th> <th>Ch'k'd</th> <th>App'd</th> </tr> </thead> <tbody> <tr> <td>P1</td> <td>10/11/22</td> <td>KL</td> <td>First Draft</td> <td>AW</td> <td>CS</td> </tr> </tbody> </table>	Rev	Date	Drawn	Description	Ch'k'd	App'd	P1	10/11/22	KL	First Draft	AW	CS	<p>Drawing Number</p> <p>Figure 8.77</p>			Checked
Rev	Date	Drawn	Description	Ch'k'd	App'd												
P1	10/11/22	KL	First Draft	AW	CS												
						Approved	CS	Scale at A3									
						1:22,000			Security	Status	Rev						
									STD	PRE	P1						





22 Station Road  
Cambridge CB1 2JD  
United Kingdom

T +44 (0)20 8774 2000  
F +44 (0)20 8681 5706  
W mottmac.com

Client



Title


Cambridge Waste Water Treatment Plant  
Relocation Project  
NVC  
NVC rare species

Drawn	KL
Checked	AW
Approved	CS
Scale at A3 1:22,000	
Security STD	Status PRE
Rev P1	

Rev	Date	Drawn	Description	Ch'k'd	App'd
P1	10/11/22	KL	First Draft	AW	CS

Drawing Number	Figure 8.78
----------------	-------------



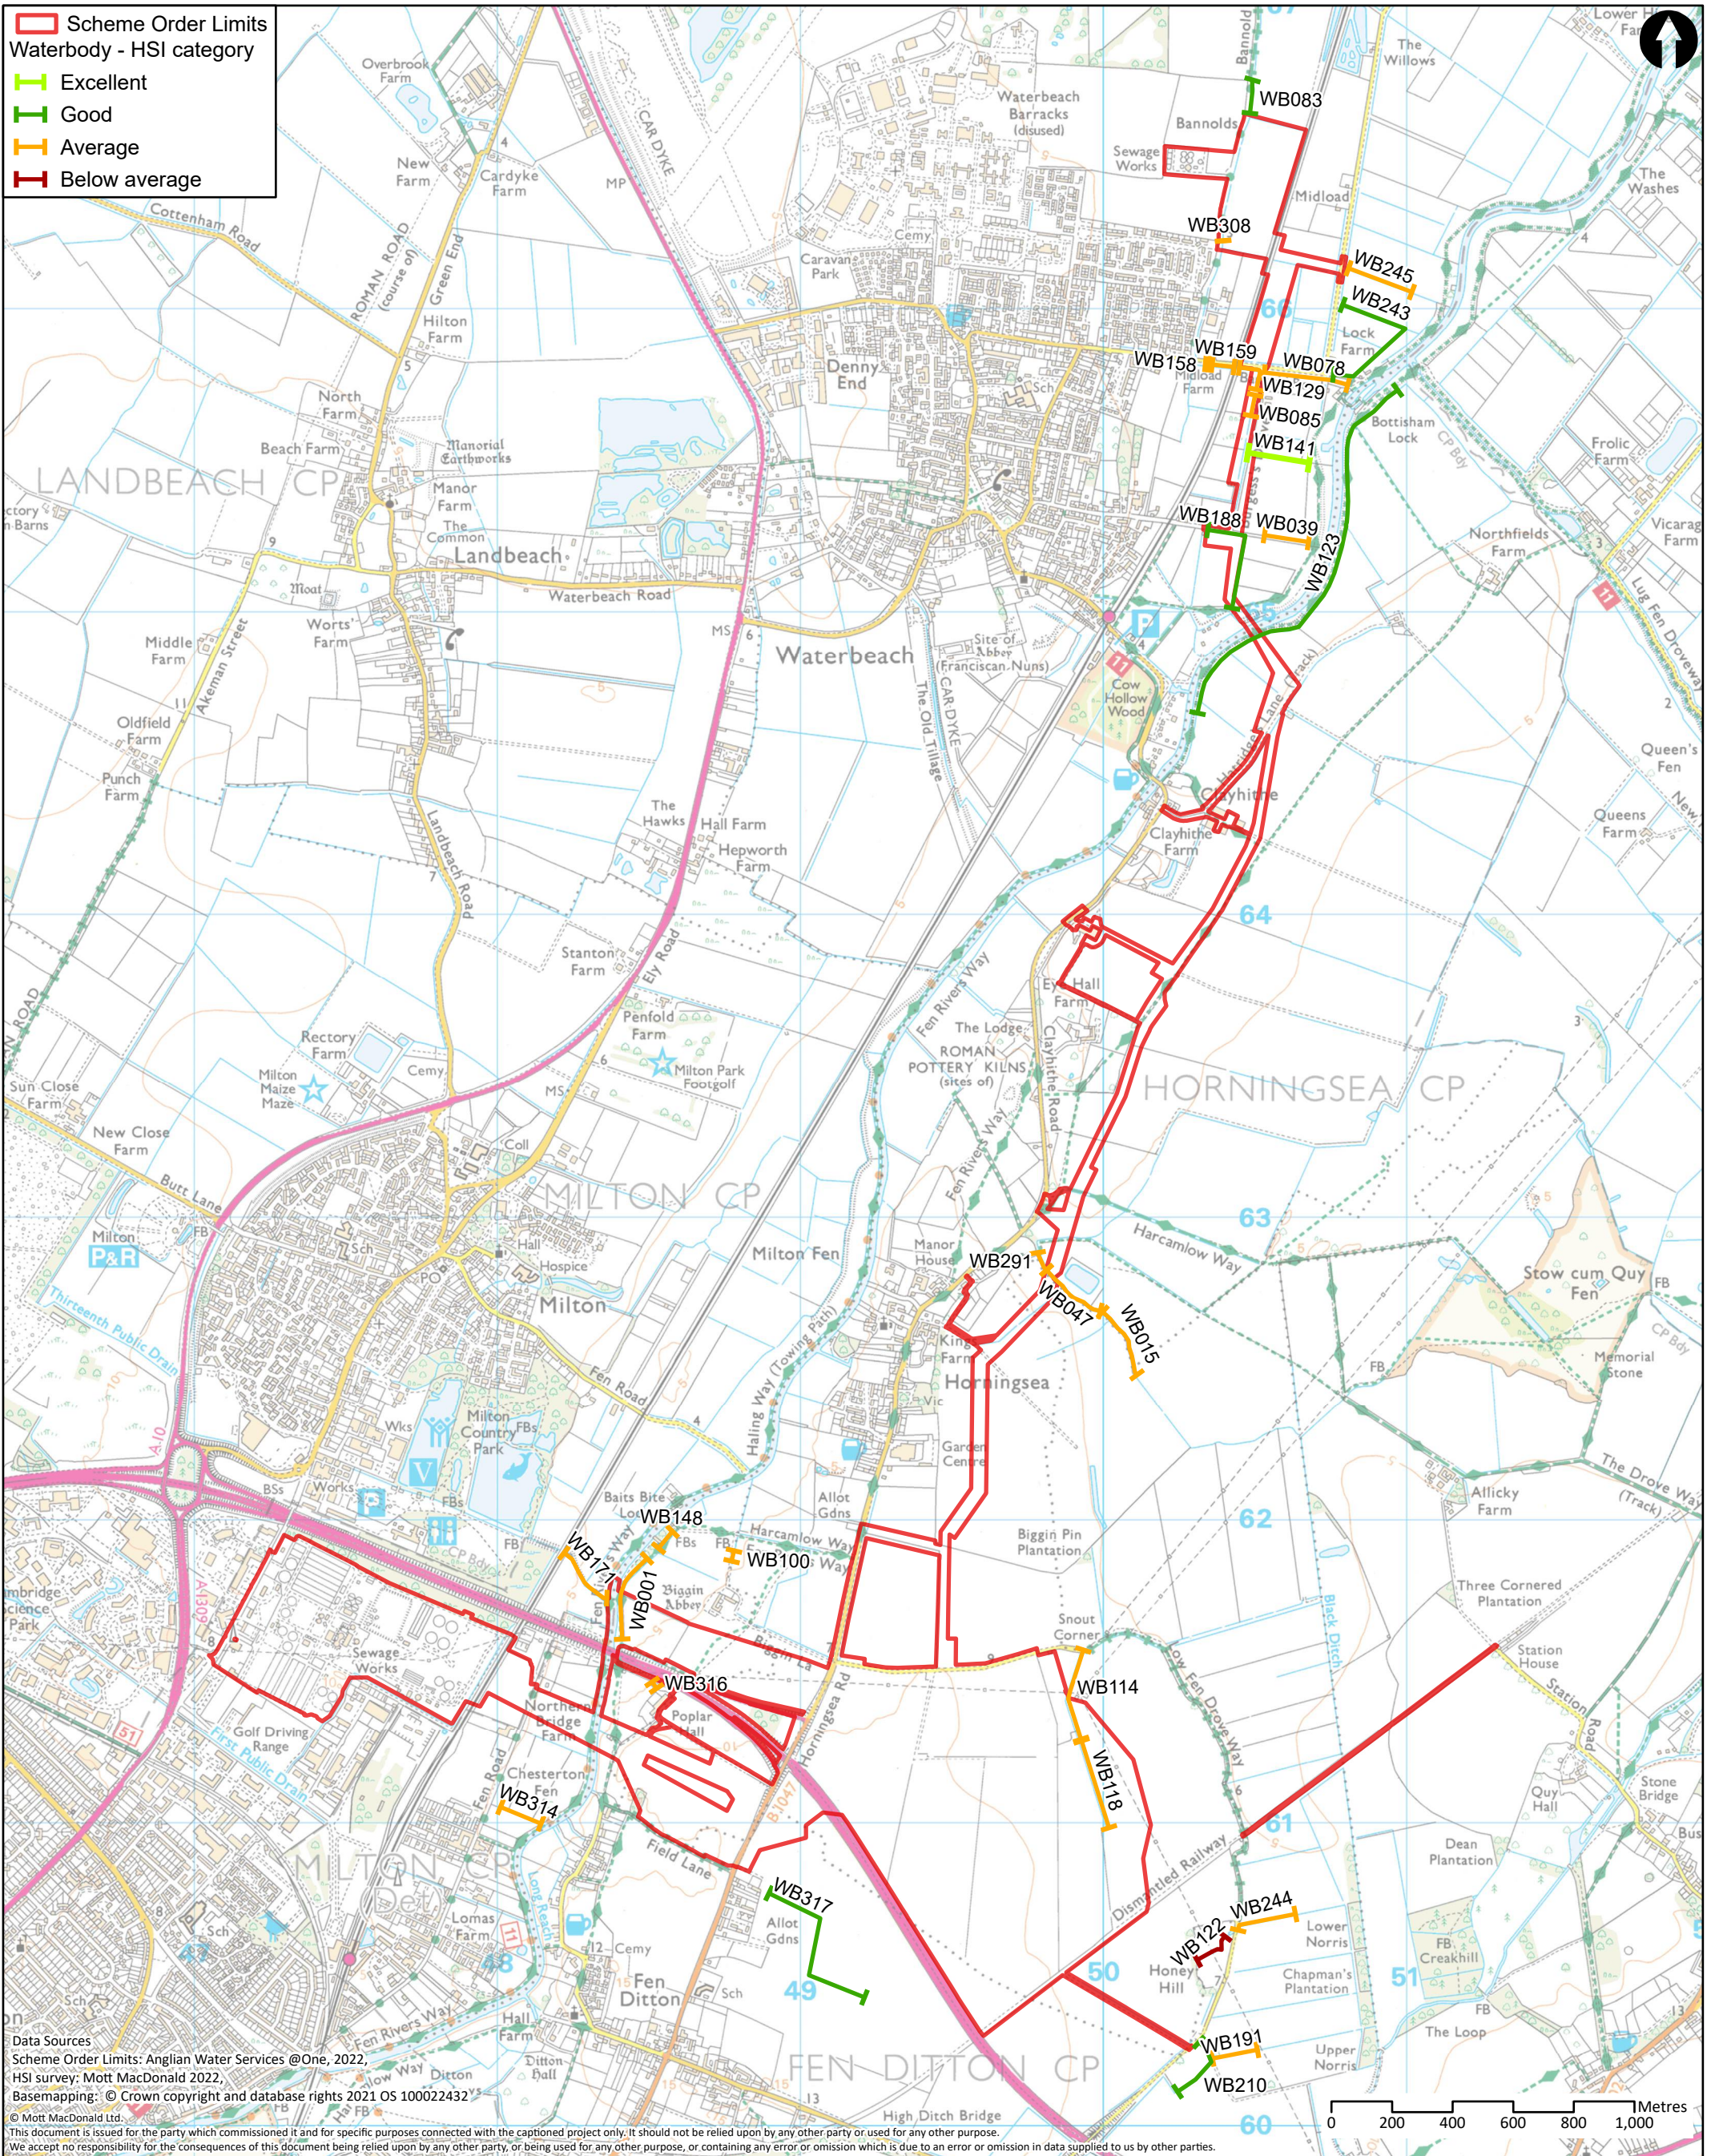

**M**  
**MOTT MACDONALD**

22 Station Road  
Cambridge CB1 2JD  
United Kingdom

T +44 (0)20 8774 2000  
F +44 (0)20 8681 5706  
W mottmac.com


Client					
Rev	Date	Drawn	Description	Ch'k'd	App'd
P1	11/11/22	AW	First Draft	AW	CS

Title  
Cambridge Waste Water Treatment Plant  
Relocation Project  
Great Crested Newts  
HSI category

Drawing Number  
Figure 8.79

Drawn	AW	
Checked	AW	
Approved	JM	
Scale at A3	1:20,000	
Security	Status	Rev
STD	PRE	P1



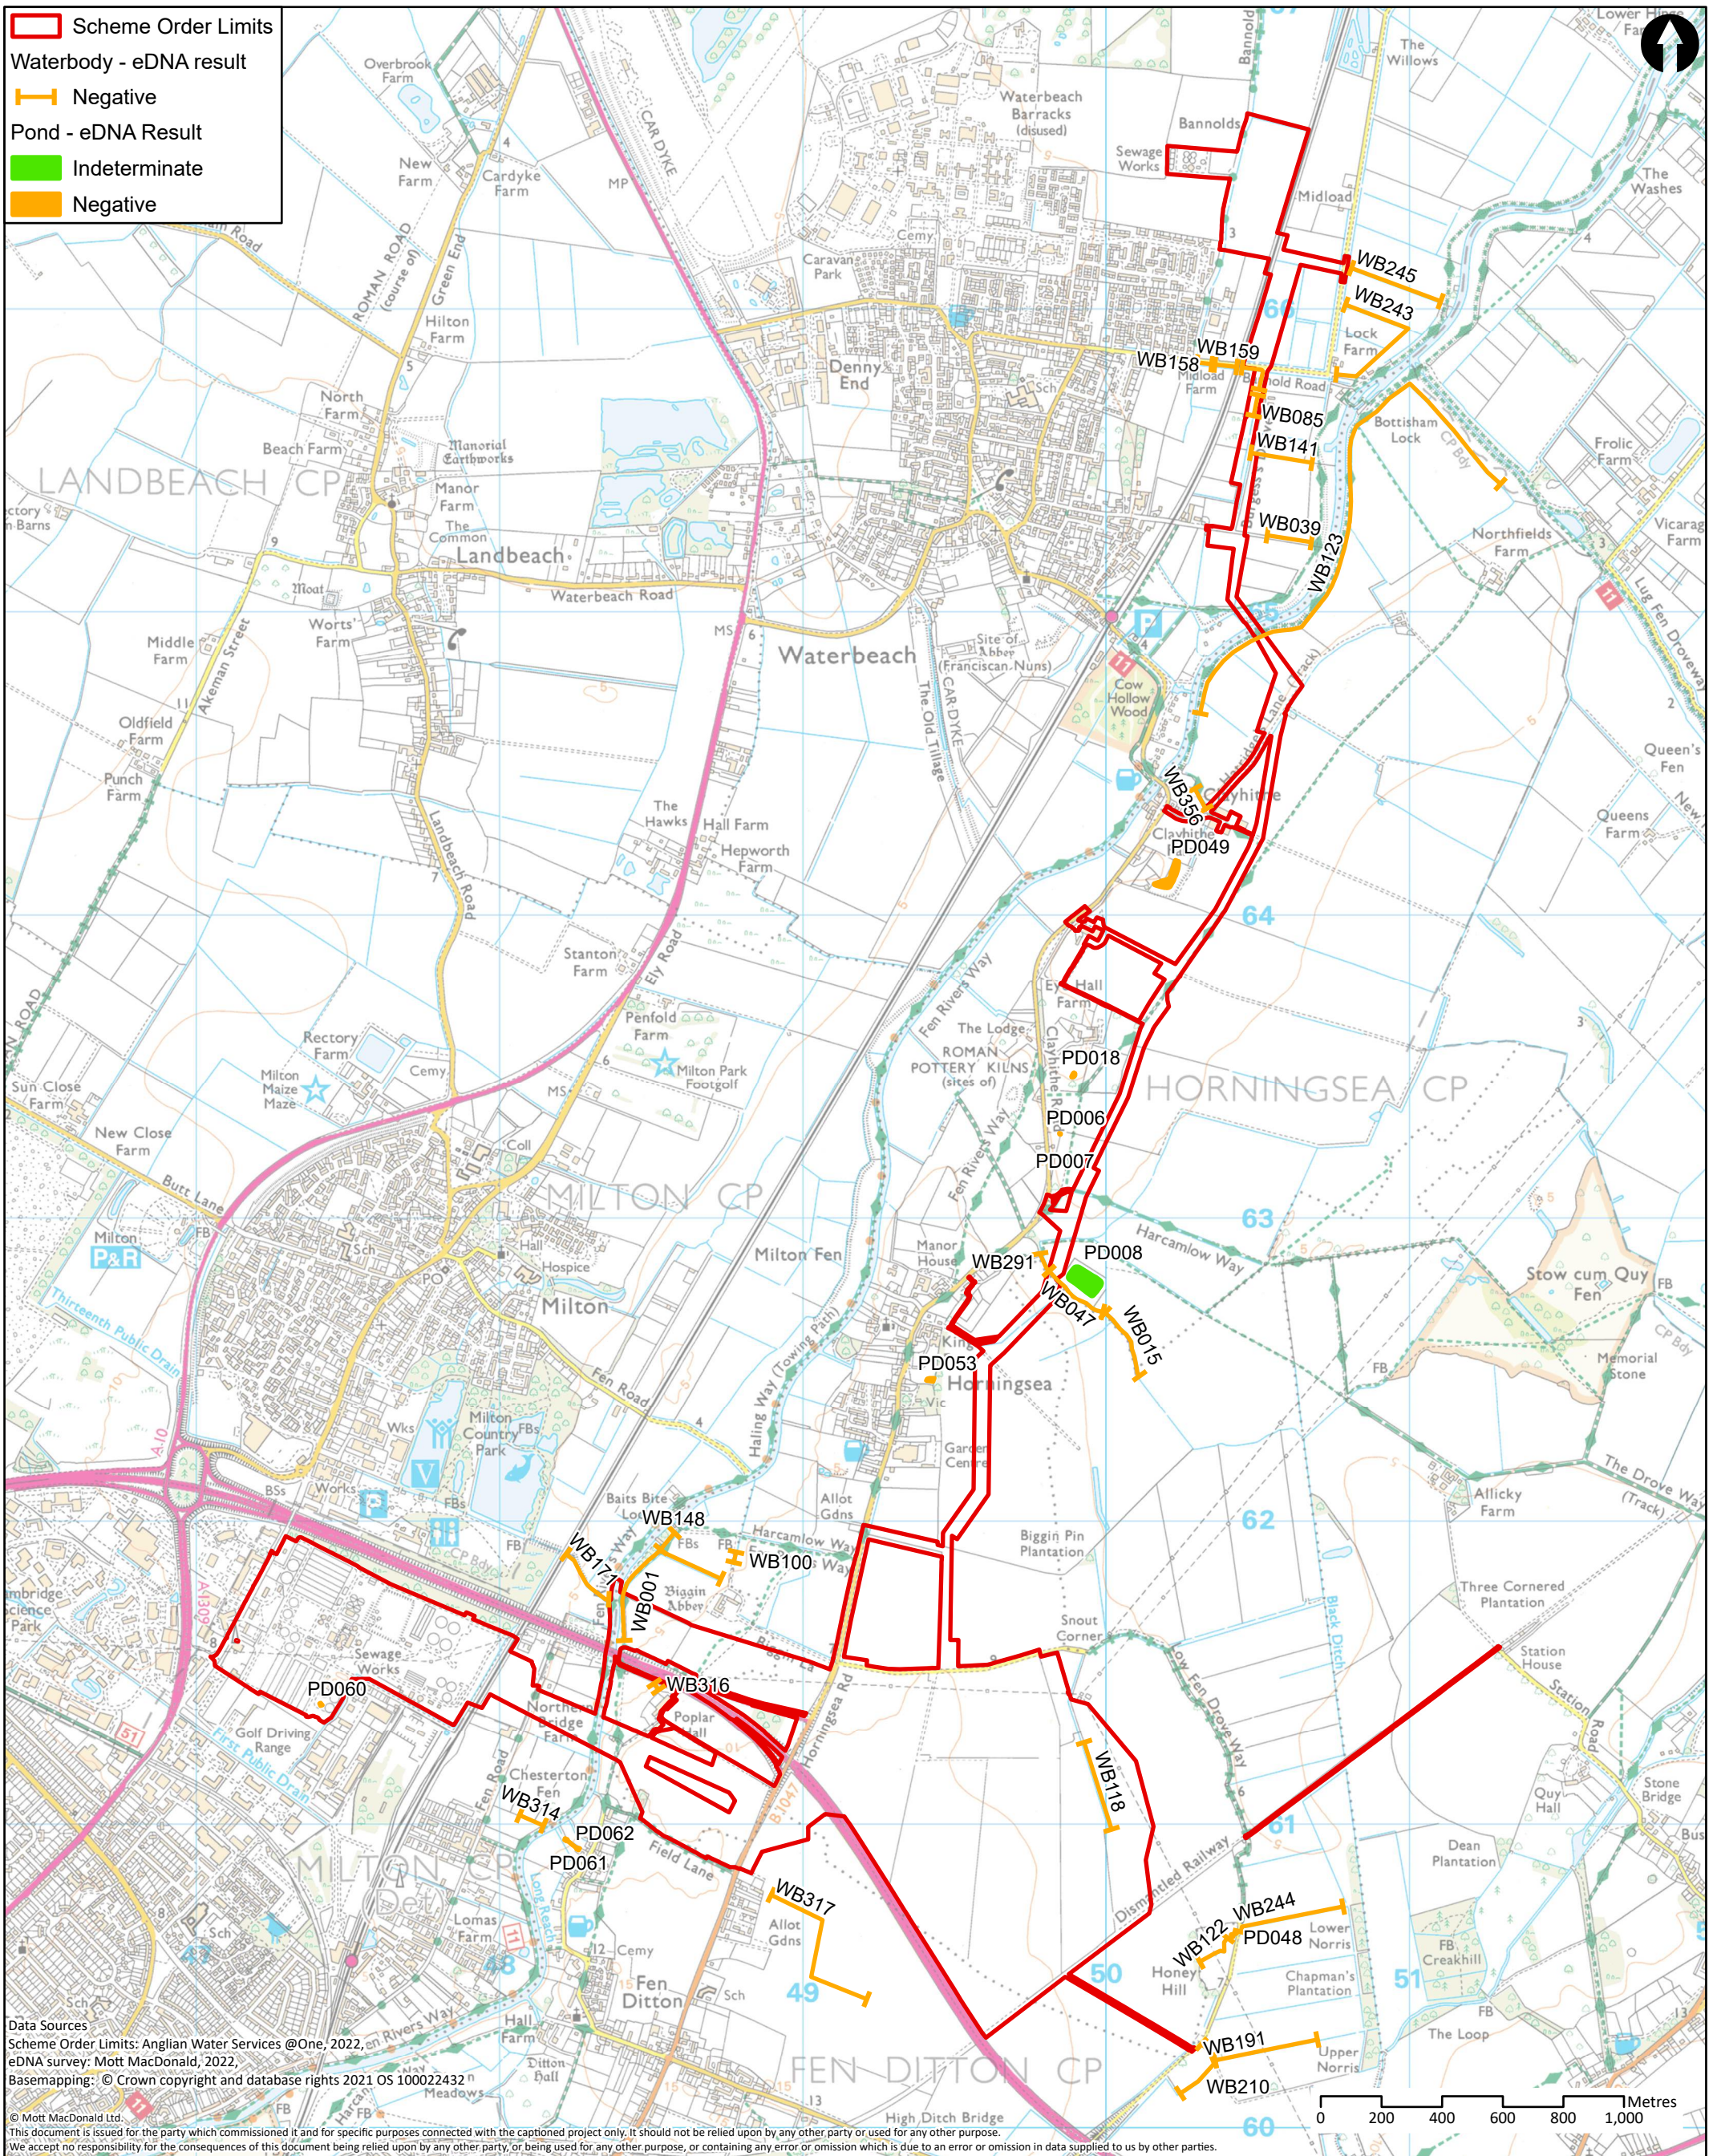

Data Sources  
 Scheme Order Limits: Anglian Water Services @One, 2022,  
 eDNA survey: Mott MacDonald, 2022,  
 Basemapping: © Crown copyright and database rights 2021 OS 100022432  
 © Mott MacDonald Ltd.  
 This document is issued for the party which commissioned it and for specific purposes connected with the captioned project only. It should not be relied upon by any other party or used for any other purpose.  
 We accept no responsibility for the consequences of this document being relied upon by any other party, or being used for any other purpose, or containing any error or omission which is due to an error or omission in data supplied to us by other parties.

**M**  
**MOTT**  
**MACDONALD**

22 Station Road  
 Cambridge CB1 2JD  
 United Kingdom

T +44 (0)20 8774 2000  
 F +44 (0)20 8681 5706  
 W mottmac.com

Client					
Rev	Date	Drawn	Description	Ch'k'd	App'd
P1	11/11/22	AW	First Draft	AW	JM

Title		
Cambridge Waste Water Treatment Plant Relocation Project		
Great Crested Newts eDNA results		
Drawing Number		
Figure 8.80		

Drawn	AW
Checked	AW
Approved	JM
Scale at A3	
1:20,000	
Security	Status
STD	PRE
Rev	P1



## Get in touch

You can contact us by:



Emailing at [info@cwwtpr.com](mailto:info@cwwtpr.com)



Calling our Freephone information line on **0808 196 1661**



Writing to us at **Freepost: CWWTPR**

You can view all our DCO application documents and updates on the application on The Planning Inspectorate website:

<https://infrastructure.planninginspectorate.gov.uk/projects/eastern/cambridge-waste-water-treatment-plant-relocation/>