



Cambridge Waste Water Treatment Plant Relocation Project
Anglian Water Services Limited

Appendix 10.1: GHG Calculations

Application Document Reference: 5.4.10.1
PINS Project Reference: WW010003
APFP Regulation No. 5(2)a

Document Control

Document title GHG Calculations

Version No. 0102

Date Approved 26.12.2023

Date 1st Issued 30.12.2023

Style Definition: TOC 2

Version History

Version	Date	Author	Description of change
01	30.01.23	-	DCO Submission
02	<u>15.12.23</u>	<u>-</u>	<u>Updated to reflect Examination Responses</u>

This document is issued for the party which commissioned it and for specific purposes connected with the above-captioned project only. It should not be relied upon by any other party or used for any other purpose.

We accept no responsibility for the consequences of this document being relied upon by any other party, or being used for any other purpose, or containing any error or omission which is due to an error or omission in data supplied to us by other parties.

This document contains confidential information and proprietary intellectual property. It should not be shown to other parties without consent from us and from the party which commissioned it.

Contents

1	Introduction	1
1.1	Overview	1
1.2	Aims and Objectives.....	1
2	Greenhouse Gas Emissions	2
2.1	Construction	2
2.2	Land Use Change	<u>13</u> <u>12</u>
2.3	Operational Carbon – Baseline DMO.....	<u>16</u> <u>15</u>
2.4	Operational Carbon – Biomethane production (DCO preferred option).....	<u>18</u> <u>17</u>
2.5	Operational Carbon – comparison of DMO and DCO models.....	<u>22</u> <u>21</u>
2.6	Decommissioning	<u>25</u> <u>24</u>
2.7	Assessment lifetime – Primary and Tertiary Mitigation	<u>28</u> <u>27</u>
2.8	Assessment lifetime – Secondary mitigation	<u>43</u> <u>41</u>
3	References	<u>66</u><u>55</u>

Tables

Table 2-1: Carbon footprint by site area	3
Table 2-2: Changes between DMO and DCO design	6
Table 2-3: Summary table	6
Table 2-4: Carbon sequestration change in Proposed Development opening year.....	13
Table 2-5: Carbon sequestration rates for broad habitat types	13
Table 2-6: Management plan lifetime sequestration	15
Table 2-7: Baseline DMO operation Applicant's model outputs (Year 1)	16
Table 2-8: Summary of construction inputs (Year 1)	17
Table 2-9: DCO Preferred Option operation Applicant's model outputs (Year 1)	18
Table 2-10: Summary of construction inputs (Year 1)	19
Table 2-11: Operational Carbon emissions in tCO ₂ e (Year 1)	22
Table 2-12: Carbon emissions associated with decommissioning activities	25
Table 2-13: Summary of decommissioning footprint	27
Table 2-14: BEIS Grid electricity emissions factors	28
Table 2-15: Assessment lifetime emissions by design option	29

Table 2-16: Primary and tertiary mitigation assessment lifetime: DCO Design - preferred option	<u>3130</u>
Table 2-17: Primary and tertiary mitigation assessment lifetime: DCO Design - CHP option	<u>3534</u>
Table 2-18: Primary and tertiary mitigation assessment lifetime: Baseline DM0	<u>3938</u>
Table 2-19: Assessment lifetime emissions by design option	<u>4342</u>
Table 2-20: Secondary mitigation assessment lifetime: DCO Design - preferred option	<u>4443</u>
Table 2-21: Primary and tertiary mitigation assessment lifetime: DCO Design - CHP option	<u>4847</u>

Figures

Figure 2.1: Applicant model outputs.....	<u>8</u>
Figure 2.2: Comparison by site area.....	<u>9</u>
Figure 2.3: Breakdown of total construction footprint by site area	<u>11</u>
Figure 2.4: Gross emissions breakdown in year 1.....	<u>1716</u>
Figure 2.5: Gross emissions breakdown in year 1.....	<u>2019</u>
Figure 2.6: Comparison of gross and net emissions in year 1	<u>2120</u>
Figure 2.7: Comparison of total gross emissions for different models in year 1	<u>2322</u>
Figure 2.8: Comparison of total net emissions for different models in year 1	<u>2423</u>
Figure 2.9: Gross cumulative comparison.....	<u>5250</u>
Figure 2.10: Net cumulative comparison	<u>5451</u>
Figure 2.11: Emissions by source for the preferred option model	<u>5752</u>
Figure 2.12: Emissions by source – CHP option	<u>6053</u>
Figure 2.13: Emissions by type – baseline.....	<u>6354</u>

1 Introduction

1.1 Overview

- 1.1.1 This Appendix presents the supporting calculations for the carbon assessment of the Proposed Development. The assessment is split into construction, land use change, operation, decommissioning of the Existing WWTP, and carbon over the lifetime of the assessment.
- 1.1.2 The assessment of the carbon emissions from the construction and operation of the Proposed Development has been based on the Applicant's asset level carbon models.
- 1.1.3 Any carbon emissions assessment at design stage is an estimate based on best available data and using industry standard emissions factors. There is an inherent limitation in carbon assessments as the assessment is based on the scheme design at the time. The final constructed asset will not have the same carbon emissions as estimated due to differences in the final materials' procurement specification and construction practices on site.

1.2 Aims and Objectives

- 1.2.1 This appendix sets out the carbon footprint calculations support the assessment of effects and should be read in conjunction with Chapter 10: Carbon (Application Document Ref 5.2.10)
- 1.2.2 A detailed description of the Proposed Development is included in Chapter 2: Project Description (App Doc Ref 5.2.2) of the Environmental Statement.

2 Greenhouse Gas Emissions

2.1 Construction

- 2.1.1 The assessment of the carbon emissions from the construction of the Proposed Development has been based on the Applicant's asset level carbon models.
- 2.1.2 Mitigation options to reduce the impact have been identified and implemented throughout the development of the design, in line with the methodology set out in PAS 2080 and the Applicant's carbon reduction targets. Carbon is a primary metric of the options evaluation process during design development, previous model iterations are presented in Table 2-1 demonstrating this process.
- 2.1.3 Note that all carbon estimates are rounded to the nearest 10 tonnes.

Table 2-1: Carbon footprint by site area

Data source	Site Area	Baseline model			Previous model iterations as part of design process			DCO application model		
		DM0 - tCO2e	DM1 - tCO2e	October Post ROV - tCO2e	November Post ROV - tCO2e	December Post ROV - tCO2e	January Post ROV - tCO2e	April Post ROV - tCO2e	June - tCO2e	DCO - tCO2e
Applicant Model	Tunnel & Final Effluent Discharge	39,960	17,780	17,780	17,780	17,780	13,660	13,660	13,660	13,660
	Final Settlement Tank	5,060	5,870	4,850	4,850	4,850	4,890	4,890	5,020	5,820
	Aeration Tank	7,850	4,850	5,870	5,870	5,870	3,480	3,480	3,480	5,280
	Primary Settlement Tank	3,890	3,430	3,090	3,090	3,090	3,090	3,090	3,090	3,550
	Storm Tank	10,720	3,310	2,810	2,810	2,810	2,480	2,480	2,480	2,100
	Import Area (Screening and Thickening)	1,640	3,090	1,930	1,930	1,930	1,930	1,930	2,020	2,020
	Buildings	1,480	2,810	1,740	1,740	1,740	1,740	1,740	1,740	800
	TPS	1,290	1,930	2,440	2,440	1,730	1,730	1,730	1,730	1,710
	Roads	5,970	1,740	3,310	3,310	3,310	3,310	1,670	1,670	3,140
	Inter process Pumping	1,380	1,480	1,320	1,320	1,320	1,320	1,320	1,320	1,320
	Inlet Works	2,660	1,320	1,240	1,240	1,240	1,240	1,240	1,240	1,220
	Sand Filtration	4,210	1,240	850	850	850	850	850	1,130	1,130
	Electrical Distribution	440	1,010	1,010	1,010	1,010	1,010	1,010	1,010	1,010
	Digestion	1,940	980	910	890	890	890	890	890	1,080
	LTP	960	630	630	630	630	630	630	630	630

Data source	Site Area	Baseline model			Previous model iterations as part of design process			DCO application model		
		DM0 - tCO2e	DM1 - tCO2e	October Post ROV - tCO2e	November Post ROV - tCO2e	December Post ROV - tCO2e	January Post ROV - tCO2e	April Post ROV - tCO2e	June - tCO2e	DCO - tCO2e
	Boundary Fencing	400	600	600	600	600	600	600	600	600
	Biogas Area - Storage + CHP/BUP	720	380	310	420	420	420	420	420	420
	Common Control (MCC)	490	310	380	380	380	380	380	380	380
	Dewatering	250	310	380	380	380	380	380	380	380
	HPH	1,100	280	310	310	310	310	310	310	310
	FE Discharge Pipework	-	260	280	280	280	280	280	280	280
	Odour Control	490	240	220	220	220	220	220	220	220
	Landscaping	1,080	220	210	210	210	210	210	210	1,080
	Ferric Dosing	700	210	190	190	190	190	190	190	190
	Pressure Water System	20	190	260	260	180	180	180	180	180
	Site Services	-	140	140	140	140	140	140	140	140
	Additional Items	2,050	-	-	-	-	-	-	-	-
Built-up from EPDs (see Table 2-2)	Solar Panels	-	-	-	-	-	-	-	-	2,1504,370
TOTAL		96,750	54,610	53,060	53,150	52,360	45,560	43,920	45,560	50,80053,000
% Change	Change from DM0		43.6%	45.2%	45.1%	45.9%	52.9%	54.6%	52.9%	47.545.2%

Field Code Changed

Data source	Site Area	Baseline model			Previous model iterations as part of design process			DCO application model	
		DM0 - tCO2e	DM1 - tCO2e	October Post ROV - tCO2e	Novemb er Post ROV - tCO2e	Decemb er Post ROV - tCO2e	January Post ROV - tCO2e	April Post ROV - tCO2e	June - tCO2e
									DCO - tCO2e
	Distance from 70% target	26.4%	24.8%	24.9%	24.1%	17.1%	15.4%	17.1%	22.5 24.8%

2.1.4 The embodied carbon associated with the solar panels has been estimated based on technical datasheets and EPDs of individual components ~~for similar capacity panels, scaled to a 5.6MWp capacity. For this calculation is has been assumed that 2 x 3600 kW panels will be required. Using a broad estimate of 780 kgCO₂e/kWp (Willmott Dixon, 2022), the overall solar installation would be approximately 4,370 tCO₂e.~~

Formatted: Subscript

Table 2-2: Solar panel capital carbon estimate

Component Type (3600 kW panel)	tCO ₂ e/unit including 1% uplift allowing for unmodelled components
Solar Panels (monofacial)	670
Inverters	620
Mounting structure (fixed)	390
DC Cable	10
TOTAL	1080

2.1.5 [Table 2-2](#)[Table 2-2](#)[Table 2-3](#) shows the change achieved between DMO and DCO designs.

Table 2-23: Changes between DMO and DCO design

Site Area	% of DCO	Reduction from DMO to DCO (tCO2e)
Tunnel & Final Effluent Discharge	26.9%	26,300
Final Settlement Tank	11.4%	-760
Aeration Tank	10.4%	2,570
Primary Settlement Tank	7.0%	330
Storm Tank	4.1%	8,620
Import Area (Screening and Thickening)	4.0%	-380
Buildings	1.6%	680
TPS	3.4%	-410
Roads	6.2%	2,830
Inter process Pumping	2.6%	60
Inlet Works	2.4%	1,440
Sand Filtration	2.2%	3,080
Electrical Distribution	2.0%	-570
Digestion	2.1%	860
LTP	1.2%	320
Boundary Fencing	1.2%	-210
Biogas Area - Storage + CHP/BUP	0.8%	300
Common Control (MCC)	0.8%	110
Dewatering	0.7%	-130
HPH	0.6%	780
FE Discharge Pipework	0.5%	-280
Odour Control	0.4%	260
Landscaping	2.1%	-
Ferric Dosing	0.4%	520
Pressure Water System	0.3%	-160
Site Services	0.3%	-130
Additional Items	0.0%	2,050

[Table 2-3](#)[Table 2-3](#)[Table 2-4](#) summarises the estimated emissions by site area and shows the change between DMO baseline model and the DCO Proposed Development design.


Table 2-324: Summary table

Site Area	DMO Baseline Design (tCO2e)	DCO Proposed Development Design (tCO2e)	% Change
Tunnel & Final Effluent Discharge	39,960	13,660	-27%
Final Settlement Tank	5,060	5,820	1%
Aeration Tank	7,850	5,280	-3%
Primary Settlement Tank	3,890	3,550	0%

Site Area	DM0 Baseline Design (tCO2e)	DCO Proposed Development Design (tCO2e)	% Change
Storm Tank	10,720	2,100	-9%
Import Area (Screening and Thickening)	1,640	2,020	0%
Buildings	1,480	800	-1%
TPS	1,290	1,710	0%
Roads	5,970	3,140	-3%
Inter process Pumping	1,380	1,320	0%
Inlet Works	2,660	1,220	-1%
Sand Filtration	4,210	1,130	-3%
Electrical Distribution	440	1,010	1%
Digestion	1,940	1,080	-1%
LTP	960	630	0%
Boundary Fencing	400	600	0%
Biogas Area - Storage + CHP/BUP	720	420	0%
Common Control (MCC)	490	380	0%
Dewatering	250	380	0%
HPH	1,100	310	-1%
FE Discharge Pipework	-	280	0%
Odour Control	490	220	0%
Landscaping	1,080	1,080	0%
Ferric Dosing	700	190	-1%
Pressure Water System	20	180	0%
Site Services	-	140	0%
Additional Items	2,050	-	-2%
Solar Panels	-	2,150 4,370	25%
TOTAL	96,750	50,79053,000	-4845%


2.1.6 Figure 2.1 below shows the outputs from the Applicant's models, with commentary for the key reductions achieved.

Figure 2.1: Applicant model outputs

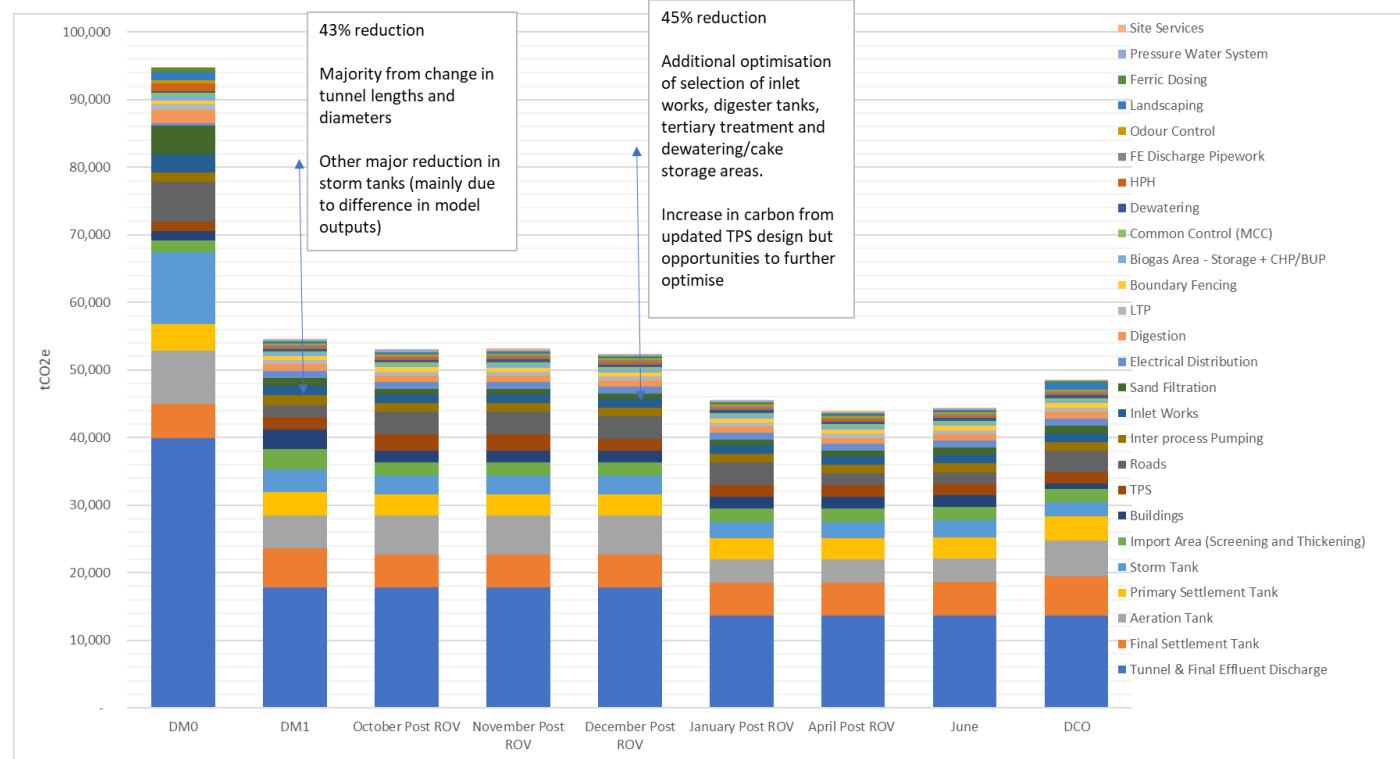


2.1.7 Figure 2.2 below shows the outputs from the Applicant's models, comparing DMO baseline and DCO design outputs.

Figure 2.2: Comparison by site area

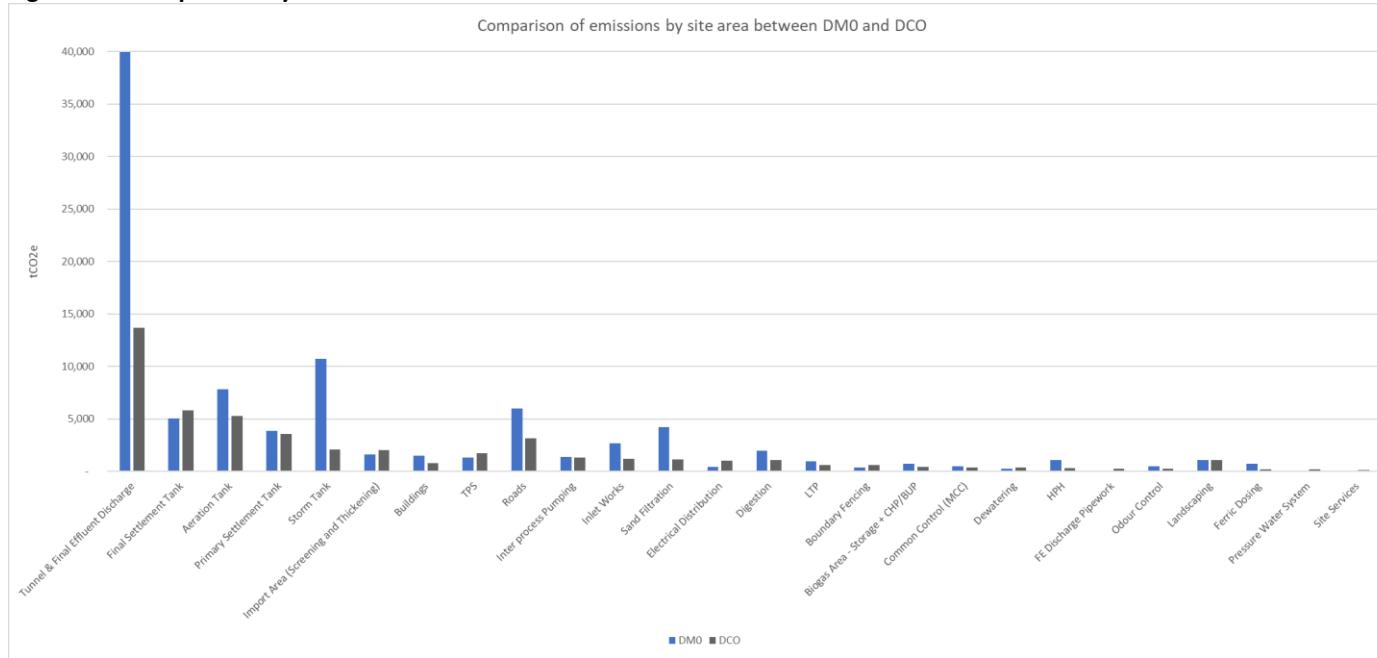

2.1.8 Figure 2.3 below shows the outputs from the Applicant's models, comparing the total construction footprint for DMO baseline and DCO design outputs, broken down by the different site areas.

Figure 2.3: Breakdown of total construction footprint by site area

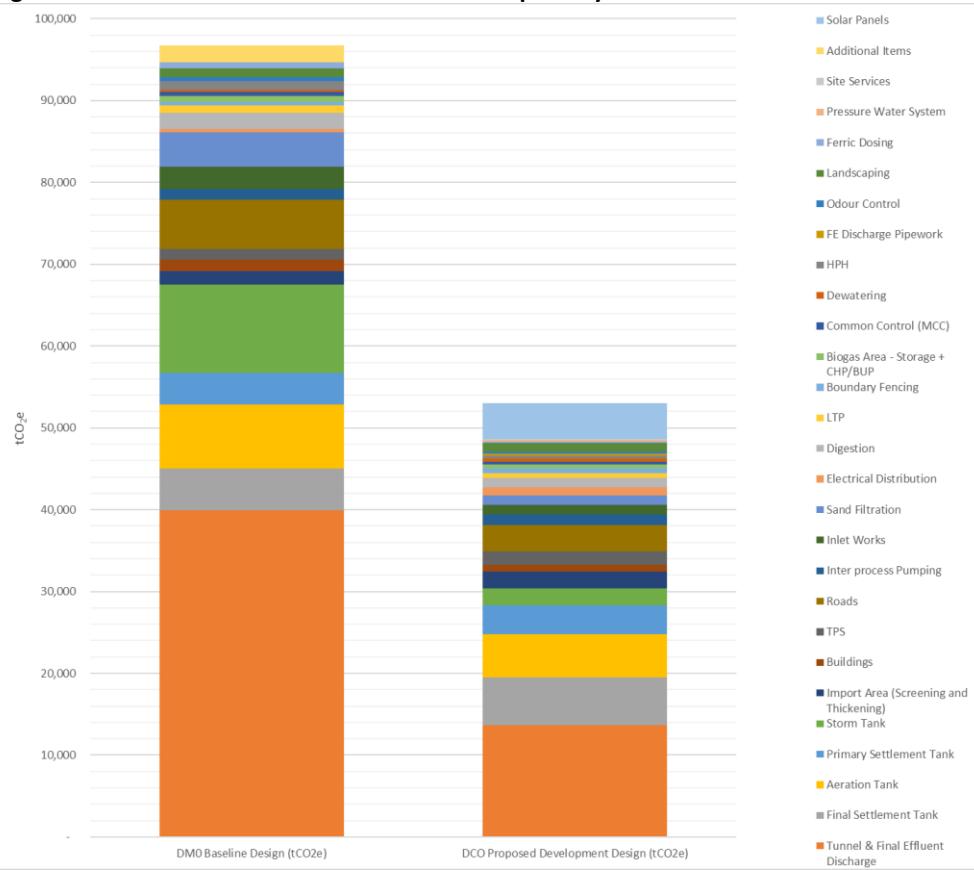

Cambridge Waste Water Treatment Plant Relocation Project
GHG Calculations



2.2 Land Use Change

- 2.2.1 The impact of the Proposed Development on carbon sequestration within the study area was assessed using the areas and types of landscaping identified from the proposed landscape plan within the Landscape Ecology and Recreation Management Plan (LERMP) (Appendix 8.14, App Doc Ref 5.4.8.14). The baseline for the land use change assessment is the current land use of the site.
- 2.2.2 Note that negative numbers in [Table 2-4](#)[Table 2-4](#)[Table 2-5](#) are carbon sequestration.

Table 2-445: Carbon sequestration change in Proposed Development opening year.

Land use	C seq. rates for habitats	Baseline		Proposed Scheme		Overall change
		Area (Ha)	C Seq. (tCO ₂ e/yr)	Area (Ha)	C Seq. (tCO ₂ e/yr)	C Seq. (tCO ₂ e/yr)
Woodland – (deciduous)	-5	1	-6	22	-109	-103
Woodland – (coniferous)	-13	0	-1	0	-1	0
Grassland	0	29	-12	39	-15	-4
Arable land	0	145	-16	93	-10	6
Shrub	-1	5	-3	5	-3	0
Total			-38		-139	-102
						-2015

* NOTE - this value accounts for the 10 year estimated period that it takes for trees to mature enough to sequester carbon. 20 years to end of management plan period

- 2.2.3 Carbon sequestration rates shown in [Table 2-5](#)[Table 2-5](#)[Table 2-6](#) are taken from the Committee on Climate Change (JBA Consulting, 2018).

Table 2-556: Carbon sequestration rates for broad habitat types

Land use type	C Seq rate (tCO ₂ e/ha/yr)
Woodland - (deciduous)	4.97
Woodland – (coniferous)	12.66
Arable Land	0.107
Pastoral land	0.397
Peatland - Undamaged	4.11
Peatland - Overgrazed	-0.1
Peatland - Rotationally burnt	-3.66
Peatland - Extracted	-4.87
Grassland	0.397
Heathland	0.7
Shrub	0.7
Saltmarsh	5.188

Land use type	C Seq rate (tCO2e/ha/yr)
Urban	0
Green Urban	0.397

- 2.2.4 Whole life carbon sequestration has also been assessed over the lifetime of ~~assessment, assuming a 30-year management plan (see Table 2-6Table 2-6Table 2-7), this assumes no further sequestration for the remainder of the assessment lifetime.~~
- 2.2.5 ~~Table 2-6Table 2-6Table 2-7~~ shows the sequestration over the management plan lifetime. The change at 2038 accounts for the 10-year estimated period that it takes for trees to mature enough to sequester carbon.

Table 2-667: Management plan lifetime sequestration

Year	2025	2026	2027	2028	2029	2030	2031	2032	2033	2034	2035	2036	2037	2038	2039	2040	
Relative year	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	
DCO Design	construction	construction	construction	-30	-30	-30	-30	-30	-30	-30	-30	-30	-30	-139	-139	-139	
Baseline	-38	-38	-38	-38	-38	-38	-38	-38	-38	-38	-38	-38	-38	-38	-38	-38	
Year	2041	2042	2043	2044	2045	2046	2047	2048	2049	2050	2051	2052	2053	2054	2055	2056	2057
Relative year	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31	32
DCO Design	-139	-139	-139	-139	-139	-139	-139	-139	-139	-139	-139	-139	-139	-139	-139	-139	
Baseline	-38	-38	-38	-38	-38	-38	-38	-38	-38	-38	-38	-38	-38	-38	-38	-38	

2.3 Operational Carbon – Baseline DMO

- 2.3.1 The operation phase assessment includes annual emissions from year 1 of operation. This section covers the DMO (baseline) model which uses biogas in CHP engines on-site. Data is sourced from the Applicant's models.
- 2.3.2 Using CHP reduces the grid electricity demand of the development. Avoided grid electricity emissions are presented in the net emissions, shown as negative numbers. UK average grid electricity emissions factor forecast to 2028 (0.069 kgCO₂e/kWh) has been used to calculate the emissions avoided (Department for Business Energy & Industrial Strategy, 2021).
- 2.3.3 Note that all carbon estimates in [Table 2-7](#)[Table 2-7](#)[Table 2-8](#) and [Table 2-8](#)[Table 2-9](#) are rounded to the nearest 10 tonnes, totals may not sum due to rounding.

Table 2-7²⁸: Baseline DMO operation Applicant's model outputs (Year 1)

Water Recycling Centre (WRC)		
Process Units	Annual Power Consumption (kWh)	Carbon emission (tCO ₂ e)
Preliminary Treatment	960,517	70
Primary	254,752	20
Secondary ASP	3,628,667	250
Secondary FST	904,210	60
Tertiary Treatment	3,247,988	230
Liquor Treatment Plant	951,314	70
TOTAL	9,947,448	690
Infrastructure		
Process Units	Annual Power Consumption (kWh)	Carbon emission (tCO ₂ e)
Terminal Pumping Station (TPS)	6,676,835	460
FE Main and Outfall	1,855,295	130
TOTAL	8,532,130	590
Sludge Treatment Centre (STC)		
Process Units	Annual Power Consumption (kWh)	Carbon emission (tCO ₂ e)
Sludge and Import Screening	2,220,764	150
Sludge Thickening	2,777,515	190
HPH	2,893,548	200
Digestion	1,463,016	100
Dewatering	1,648,664	110
Biogas CHP power gen	-14,826,962	-1,030
-TOTAL	-3,823,455	-270
Use of chemicals		
Chemicals	Carbon emission (tCO ₂ e)	
Chemicals (Ferric)	10	

Water Recycling Centre (WRC)


Chemicals (Poly)	<10
TOTAL	20
Other Items	
Item	Carbon emission (tCO₂e)
Propane	<i>no propane use - all biogas used in CHPs</i>
Transport	70

Table 2-889: Summary of construction inputs (Year 1)

Summary	Gross tCO ₂ e	Net tCO ₂ e
WRC	690	690
STC	760	-270
Infra	590	590
Chemicals	20	20
Propane	<i>no propane use - all biogas used in CHPs</i>	
Transport	70	70
TOTAL	2,130	1,110

2.3.4 Figure 2.4 below shows the breakdown of operations emissions in year one by emissions source.

Figure 2.4: Gross emissions breakdown in year 1

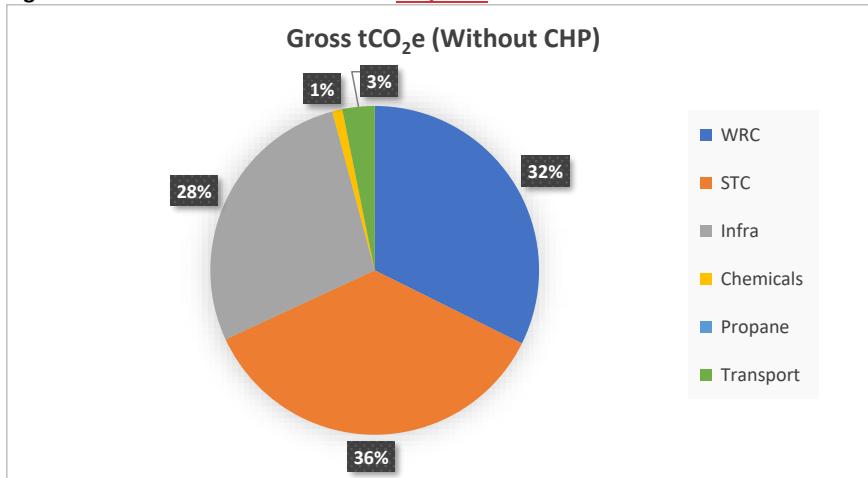

2.4 Operational Carbon – Biomethane production (DCO preferred option)

- 2.4.1 The operation phase assessment includes annual emissions from year 1 of operation. This section covers the DCO preferred option model which exports biomethane to the grid. Data is sourced from the Applicant's models.
- 2.4.2 Biomethane supply to the gas grid replaces other sources of gas, and so avoids emissions from gas generated (wholly or partially) from other more carbon intensive sources. Avoided emissions are presented in the net emissions, shown as negative numbers. The UK average natural gas emissions factor has been used to calculate the emissions avoided (Department for Business Energy & Industrial Strategy, 2021).
- 2.4.3 Note that all carbon estimates in [Table 2-9](#)[Table 2-10](#)[Table 2-10](#) and [Table 2-10](#)[Table 2-11](#) are rounded to the nearest 10 tonnes, totals may not sum due to rounding.

Table 2-9¹⁰: DCO Preferred Option operation Applicant's model outputs ([Year 1](#))
Water Recycling Centre (WRC)

Process Units	Annual Power	Carbon emission (tCO ₂ e)
Process Units	Consumption (kWh)	
Preliminary Treatment	960,517	70
Primary	254,752	20
Secondary ASP	3,628,667	250
Secondary FST	904,210	60
Tertiary Treatment (updated to washwater system option)	2,725,212	190
Liquor Treatment Plant	951,314	70
TOTAL	Total	650
		9,424,672

Formatted: Font: (Default) Calibri, 11 pt

Formatted: Font color: Black

Formatted: Normal

Infrastructure

Process Units	Annual Power	Carbon emission (tCO ₂ e)
Process Units	Consumption (kWh)	
Terminal Pumping Station (TPS)	3,144,849	220
FE Main and Outfall	706,909	50
TOTAL	Total	270
		3,851,758

Sludge Treatment Centre (STC)

Process Units	Annual Power	Carbon emission (tCO ₂ e)
Process Units	Consumption (kWh)	

Water Recycling Centre (WRC)

Sludge and Import Screening (Combined Import tanks with No RO3)	2,519,458	180
Sludge Thickening (Volute Duo RVP 802)	1,939,165	140
HPH	2,893,548	200
Digestion	1,463,016	100
Dewatering	1,616,910	110
G2G power demand	1,415,266	100
-TOTAL	Total	820
		<u>11,847,363</u>

Formatted: Indent: Left: 0 cm

Use of chemicals

Chemicals	Carbon emission (tCO2e)
Chemicals (Ferric)	10
Chemicals (Poly)	30
Sand (TPP)	10
TOTAL	Total
	50

Other Items

Item	Carbon emission (tCO2e)
Propane	860
Transport	70

Table 2-101011: Summary of construction inputs (Year 1)

Summary	Gross tCO2e	Net tCO2e
WRC	650	650
STC	820	820
Infra	270	270
Chemicals	50	50
Propane	860	860
Export of biomethane		-6,210
Transport	70	70
TOTAL	2,730	-3,490

2.4.4 Figure 2.5 below shows the breakdown of gross operations emissions in year one by emissions source. Figure 2.6 below shows a comparison of gross and net emissions.

Figure 2.5: Gross emissions breakdown in year 1


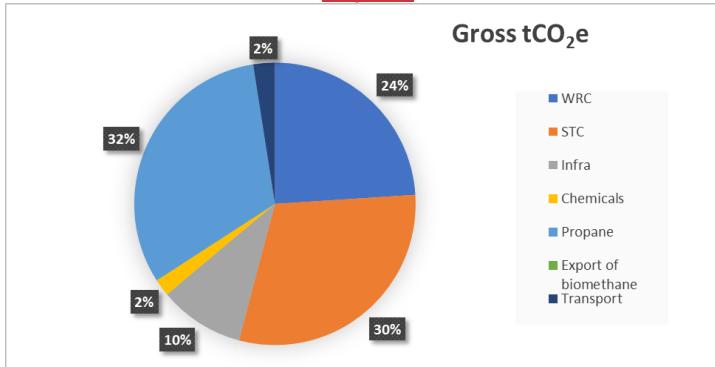


Figure 2.6: Comparison of gross and net emissions in year 1

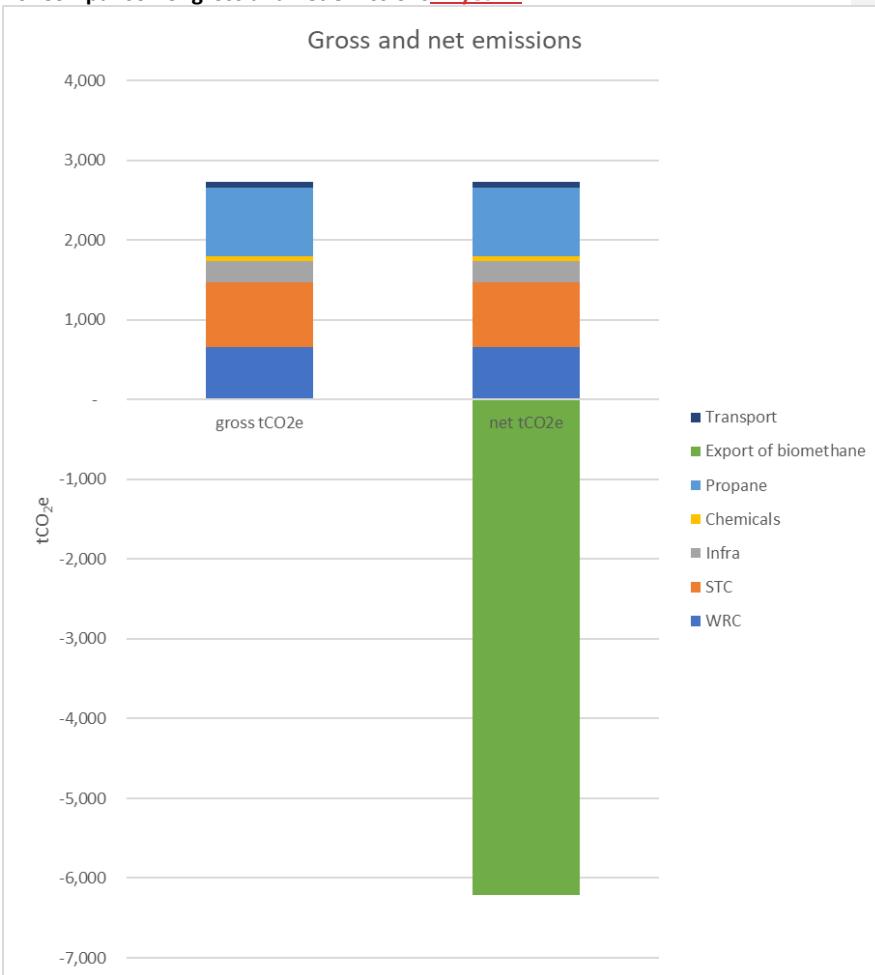

2.5 Operational Carbon – comparison of DM0 and DCO models


- 2.5.1 The operational carbon assessment includes annual emissions from year 1 of operation. This section covers the DM0 (baseline) which uses biogas in CHP engines on-site, and the DM1 through to DCO model which take into account biomethane production. Table 10 compares different models and captures the net and gross total emissions. Data is sourced from the Applicant's models.
- 2.5.2 In 2019, UK net greenhouse gas emissions were estimated at 455 MtCO₂e (million tonnes of carbon dioxide equivalent) (Department for Business, Energy & Industrial Strategy, 2021). The water supply and sewage services sector accounted for 0.8% of UK GHG emissions in 2019 (~3,640,000 tCO₂e). The DCO model operation is approximately 0.08% of this sector baseline.
- 2.5.3 Note that all carbon estimates in [Table 2-11](#)[Table 2-11](#)[Table 2-12](#) are rounded to the nearest 10 tonnes, totals may not sum due to rounding.

Table 2-11112: Operational Carbon emissions in tCO₂e (Year 1)

Summary	DM0	DM1	October	November	December	DCO
WRC	690	910	900	900	860	650
STC	760	1,130	1,080	1,080	1,080	820
Infra	590	670	350	350	380	270
Chemicals	20	20	50	50	50	50
Propane	-	860	860	860	860	860
Transport	70	70	70	70	70	70
Gross Total (exc gas to grid or CHP exports) (tCO₂e)	2,130	3,660	3,320	3,320	3,300	2,730
Grid electricity saving from CHP	- 1,030	-	-	-	-	-
Natural gas emissions saved (due to biomethane)	-	- 6,180	- 6,180	- 6,210	- 6,210	- 6,210
Net Total (tCO₂e)	1,110	-2,520	-2,860	-2,900	-2,920	-3,490
MI capacity (l/s)	2000				2000	
MI per year (MI/y)	63072				63072	
Gross tCO ₂ e/MI	0.034				0.043	
Net tCO ₂ e/MI	0.018				-0.055	


2.5.4 Figure 2.7 below shows the breakdown of gross operations emissions in year one by emissions source for DM0 and DCO models.

Figure 2.7: Comparison of total gross emissions for different models in year 1

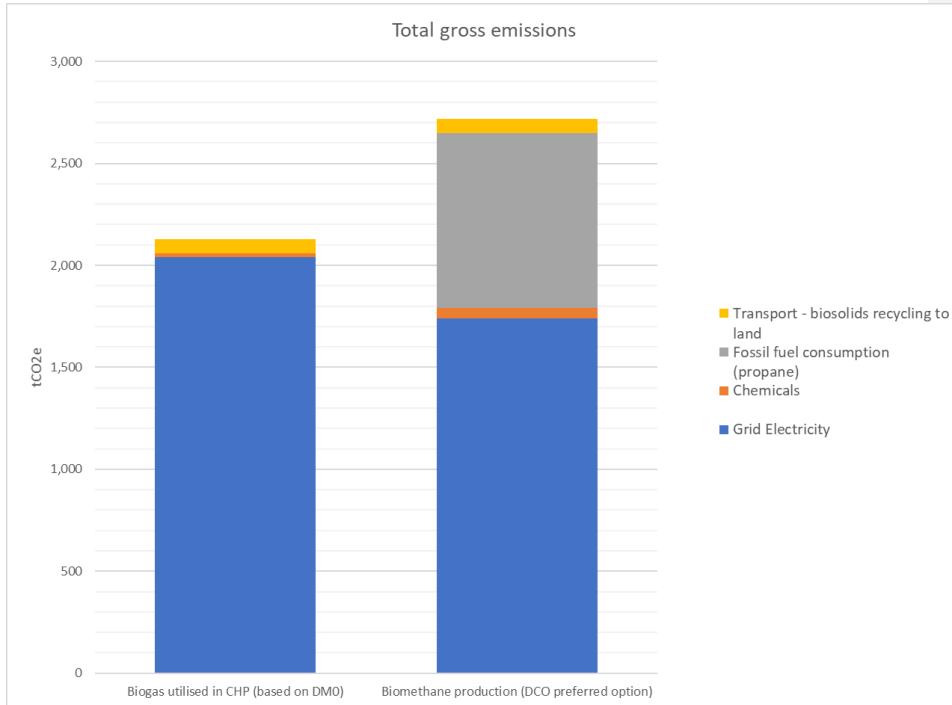

2.5.5 Figure 2.8 below shows a comparison of total net emissions. The DCO model shows that the biomethane export avoids more emissions than it emits and its total net emissions is lower than the DM0 model using CHP.

Figure 2.8: Comparison of total net emissions for different models in year 1

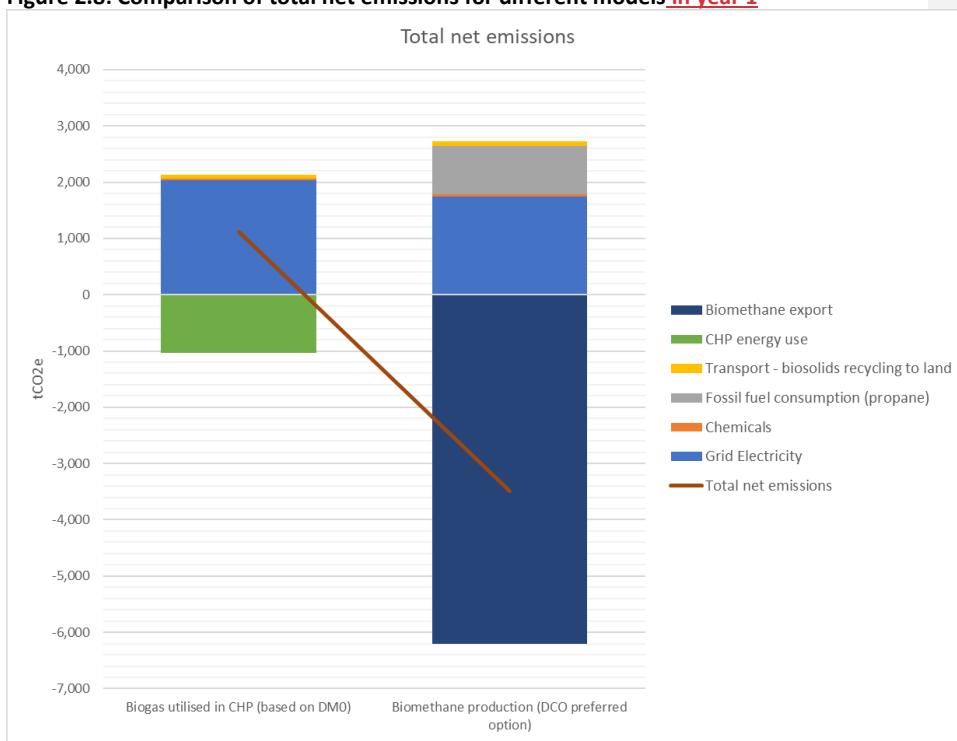

2.6 Decommissioning

- 2.6.1 [Table 2-12](#)[Table 2-12](#)[Table 2-13](#) shows activity data and emissions factor to calculate the carbon emissions associated with decommissioning activities. This was calculated based on estimated vehicle numbers and movements and results are summarised in [Table 2-13](#)[Table 2-13](#)[Table 2-14](#).
- 2.6.2 Total on site vehicle movements was assumed at 1 movement per day for 7 days per week. Distance across site ('on-site movement') was agreed at 1 mile with contractors.
- 2.6.3 Total off site vehicle movements was assumed 30 miles travel to and from site (60 miles total)
- 2.6.4 Emission factors are sourced from the UK Government GHG Conversion Factors for Company Reporting (Department for Business Energy & Industrial Strategy, 2021). Emissions factor used are: Medium Van (Diesel Class II (1.305 to 1.74 tonnes)), Transit Truck (Diesel Class III (1.74 to 3.5 tonnes)), Tanker (All HGVs (Diesel)).

Table 2-12[Table 2-12](#)[Table 2-13](#): Carbon emissions associated with decommissioning activities

Activity / Area	Medium Vans (No.)	Transit Trucks (No.)	Tanker (No.)	Duration (weeks) estimate	Duration (days) estimate	Medium Van Movements	Transit Trucks Movements	Tanker Movements
TPS	3	1	2	2	14	42	14	28
Inlet Screen Structure	3	1	2	2	14	42	14	28
Washwater	3	1	2	2	14	42	14	28
General Site Utilities	2	0	0	3	21	28	0	0
PSTs	3	1	8	2	14	42	14	112
Stream D forward feed pumping station	3	1	2	2	14	42	14	28
Stream C Distribution Chamber	3	1	2	2	14	42	14	28
ASP structures	3	1	8	4	28	42	14	112
FSTs	3	1	6	2	14	42	14	84

Activity / Area	Medium Vans (No.)	Transit Trucks (No.)	Tanker (No.)	Duration (weeks) estimate	Duration (days) estimate	Medium Van Movements	Transit Trucks Movement s	Tanker Movements
FE Outfall Pipework	1	1	0	1	7	14	14	0
SAS	3	1	1	1	7	42	14	14
STC, Monsal, Digestion and CHP area	3	1	3	2	14	42	14	42
Sludge Import Area	3	1	6	3	21	42	14	84
Sludge Blending Tanks & Drum Thickeners	3	1	3	2	14	42	14	42
Redundant Sand Filter	3	1	6	2	14	42	14	84
Storm Tanks and Storm	3	1	2	2	14	42	14	28
Iron Salt Dosing	3	1	1	1	7	42	14	14
Innovation's centre	3	1	0	2	14	42	14	0
Total vehicles	51	17	54		Total on site vehicle movements	714	238	756
Distance units	miles	miles	miles		Distance units	miles	miles	miles
Distance travelled off site	60	60	60		Distance travelled per on site movement	1	1	5
Total distance travelled off site	3060	1020	3240		Total distance travelled on site	714	238	3780

Table 2-131314: Summary of decommissioning footprint

	Medium Van Movements	Transit Trucks Movements	Tanker Movements
Total distance travelled (miles)	3774	1258	7020
Emissions factors (kgCO2e/mile)	0.29476	0.42695	1.6114
kgCO2e	1,112	537	11,312
Total tCO2e (rounded to nearest 10 tonnes)	10		

2.7 Assessment lifetime – Primary and Tertiary Mitigation

2.7.1 Electricity data to calculate assessment lifetime emissions was sourced from UK Government projections (Department for Business Energy & Industrial Strategy, 2021). This provides forecast emissions factors for grid electricity. For reference the factors are presented below in [Table 2-14](#)[Table 2-14](#)[Table 2-15](#).

Table 2-14[Table 2-14](#)[Table 2-15](#): BEIS Grid electricity emissions factors

kgCO ₂ e/kWh	Year	Relative year
0.12299741	2025	0
0.090669463	2026	1
0.075037163	2027	2
0.069386204	2028	3
0.064966458	2029	4
0.051561568	2030	5
0.040833192	2031	6
0.035292957	2032	7
0.030649461	2033	8
0.02782403	2034	9
0.024821674	2035	10
0.020533091	2036	11
0.018263413	2037	12
0.017839912	2038	13
0.016891475	2039	14
0.015306375	2040	15
0.012706409	2041	16
0.012058575	2042	17
0.01181238	2043	18
0.011102443	2044	19
0.009428549	2045	20
0.008560331	2046	21
0.007892985	2047	22
0.007491263	2048	23
0.006970927	2049	24
0.006851249	2050	25
0.006851249	2051	26
0.006851249	2052	27
0.006851249	2053	28
0.006851249	2054	29
0.006851249	2055	30
0.006851249	2056	31
0.006851249	2057	32

2.7.2 Data is set out per year of assessment in [Table 2-16](#)[Table 2-16](#)[Table 2-17](#), [Table 2-17](#)[Table 2-17](#)[Table 2-18](#), and [Table 2-18](#)[Table 2-18](#)[Table 2-19](#). Totals over the assessment lifetime for each option are summarised below [Table 2-15](#)[Table 2-15](#)[Table 2-16](#). This includes emissions associated with the primary and tertiary processes over ~~33-65~~ years, this accounts for three years of construction, then operation ~~over a 30 year to 2090 period (covering the extent of the landscape management plan period)~~[design lifetime](#).

Table 2-15[Table 2-16](#): Assessment lifetime emissions by design option

Design Option	Emissions Source	Total tCO2e
DCO Design - preferred option		
DCO Design	Capital Carbon	<u>50,790</u> <u>53,000</u>
DCO Design	Capital Replacements	<u>9,600</u> <u>19,210</u>
DCO Design - preferred option	Operational Carbon - Power	<u>14,500</u> <u>20,180</u>
DCO Design - preferred option	Operational Carbon - Non-power	<u>29,520</u> <u>27,480</u>
DCO Design - preferred option	Gross Lifetime Annual Emissions	<u>104,410</u> <u>119,860</u>
DCO Design - preferred option	Biomethane Export	-136,710
DCO Design	Sequestration	-30
DCO Design - preferred option	Net Lifetime Annual Emissions	<u>-32,330</u> <u>-16,880</u>
DCO Design	Cumulative sequestration	-30
DCO Design - CHP		
DCO Design	Capital Carbon	<u>50,790</u> <u>53,000</u>
DCO Design	Capital Replacements	<u>9,600</u> <u>19,210</u>
DMO Design	Operational Carbon - Power	<u>17,010</u> <u>23,680</u>
DMO Design	Operational Carbon - Non-power	<u>2,660</u> <u>5,590</u>
DCO Design - CHP	Total Gross Lifetime Annual Emissions	<u>80,070</u> <u>101,470</u>
DMO Design	CHP Power Generation	<u>-8,560</u> <u>-11,910</u>
DCO Design	Sequestration	-30
DCO Design - CHP	Total Net Lifetime Annual Emissions	<u>71,480</u> <u>89,530</u>
DCO Design	Cumulative sequestration	-30
Baseline		
DMO Design	Capital Carbon	96,750
DMO Design	Capital Replacements	<u>16,270</u> <u>32,550</u>
DMO Design	Operational Carbon - Power	<u>17,010</u> <u>23,680</u>
DMO Design	Operational Carbon - Non-power	<u>2,660</u> <u>5,590</u>

Design Option	Emissions Source	Total tCO2e
DM0 Design	Total Gross <u>Lifetime Annual</u> Emissions	<u>132,700</u> <u>158,560</u>
DM0 Design	CHP Power Generation	<u>-8,560</u> <u>-11,910</u>
Current site	Sequestration	<u>-1,240</u> <u>-2,480</u>
DM0 Design	Total Net <u>Lifetime Annual</u> Emissions	<u>122,900</u> <u>144,1180</u>
Current site	Cumulative sequestration	-21,070

Table 2-161617: Primary and tertiary mitigation assessment lifetime: DCO Design - preferred option

Relative year	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16
Capital Carbon	<u>17,667</u> 16,930	<u>17,667</u> 16,930	<u>17,667</u> 16,930	-	-	-	-	-	-	-	-	-	-	-	-	-	
Capital Replacements	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
Operational Carbon - Power	-	-	-	1,743	1,632	1,295	1,026	887	770	699	624	516	459	448	424	385	319
Operational Carbon - Non-power	-	-	-	984	984	984	984	984	984	984	984	984	984	984	984	984	984
Gross Annual Emissions	<u>17,667</u> 16,930	<u>17,667</u> 16,930	<u>17,667</u> 16,930	2,727	2,616	2,279	2,010	1,871	1,754	1,683	1,608	1,500	1,443	1,432	1,408	1,369	1,303
Biomethane Export	-	-	-	-6,214	-6,214	-6,214	-6,214	-6,214	-6,214	-6,214	-6,214	-6,214	-6,214	-6,214	-6,214	-6,214	
Sequestration	-	-	-	-30	Only 1 year sequestration due to management plan being secondary mitigation												
Net Annual Emissions	<u>17,667</u> 16,930	<u>17,667</u> 16,930	<u>17,667</u> 16,930	-3,517	-3,598	-3,935	-4,204	-4,343	-4,460	-4,531	-4,607	-4,714	-4,771	-4,782	-4,806	-4,846	-4,911

Formatted Table

Relative year	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31	32	33
Capital Carbon	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
Capital Replacements	-	1	-	-	-	-	8,962	-	-	-	-	640	-	-	-	-	-
Operational Carbon - Power	303	297	279	237	215	198	188	175	172	172	172	172	172	172	172	172	172
Operational Carbon - Non-power	984	984	984	984	984	984	984	984	984	984	984	984	984	984	984	984	121
Gross Annual Emissions	1,287	1,282	1,263	1,221	1,199	1,182	10,134	1,159	1,156	1,156	293	1,156	1,796	1,156	1,156	1,156	293
Biomethane Export	-6,214	-6,214	-6,214	-6,214	-6,214	-6,214	-6,214	-6,214	-	-	-	-	-	-	-	-	-
Sequestration	Only 1 year sequestration due to management plan being secondary mitigation																
Net Annual Emissions	-4,927	-4,933	-4,951	-4,993	-5,015	-5,032	3,920	-5,055	1,156	293	293	933	293	293	293	293	293

Relative year	34	35	36	37	38	39	40	41	42	43	44	45	46	47	48	49	50
<u>Capital Carbon</u>																	
Capital Replacements	-	-	1	-	-	-	-	-	-	-	-	-	8,962	-	-	-	-
Operational Carbon - Power	172	172	172	172	172	172	172	172	172	172	172	172	172	172	172	172	172
Operational Carbon - Non-power	121	121	121	121	121	121	121	121	121	121	121	121	121	121	121	121	121
Gross Annual Emissions	293	293	294	293	293	293	293	293	293	293	293	293	9,255	293	293	293	293
<u>Biomethane Export</u>																	
Sequestration																	
Net Annual Emissions	293	293	294	293	293	293	293	293	293	293	293	293	9,255	293	293	293	293

Relative year	51	52	53	54	55	56	57	58	59	60	61	62	63	64	65
<u>Capital Carbon</u>															
<u>Capital Replacements</u>															
Operational Carbon - Power	172	172	172	172	172	172	172	172	172	172	172	172	172	172	172
Operational Carbon - Non-power	121	121	121	121	121	121	121	121	121	121	121	121	121	121	121
Gross Annual Emissions	293	293	293	294	293	933	293	293	293	293	293	293	293	293	293
<u>Biomethane Export</u>															
Sequestration															
Net Annual Emissions	293	293	293	294	293	933	293	293	293	293	293	293	293	293	293

Table 2-171718: Primary and tertiary mitigation assessment lifetime: DCO Design - CHP option

Relative year	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16
Capital Carbon	<u>17,667</u> 16,930	<u>17,667</u> 16,930	<u>17,667</u> 16,930	-	-	-	-	-	-	-	-	-	-	-	-	-	
Capital Replacements	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
Operational Carbon - Power	-	-	-	2,046	1,915	1,520	1,204	1,041	904	820	732	605	538	526	498	451	375
Operational Carbon - Non-power	-	-	-	89	89	89	89	89	89	89	89	89	89	89	89	89	89
Gross Annual Emissions	<u>17,667</u> 16,930	<u>17,667</u> 16,930	<u>17,667</u> 16,930	2,134	2,004	1,609	1,293	1,129	992	909	821	694	627	615	587	540	463
CHP Power Generation	-	-	-	-1,029	-963	-765	-605	-523	-454	-413	-368	-304	-271	-265	-250	-227	-188
Sequestration	-	-	-	-30	Only 1 year sequestration due to management plan being secondary mitigation												
Net Annual Emissions	<u>17,667</u> 16,930	<u>17,667</u> 16,930	<u>17,667</u> 16,930	1,076	1,041	844	687	606	538	496	452	390	356	350	336	313	275

Relative year	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31	32	33
Capital Carbon	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
Capital Replacements	-	1	-	-	-	-	8,962	-	-	-	-	640	-	-	-	-	-
Operational Carbon - Power	356	348	327	278	252	233	221	206	202	202	202	202	202	202	202	202	<u>202</u>
Operational Carbon - Non-power	89	89	89	89	89	89	89	89	89	89	89	89	89	89	89	89	<u>89</u>
Gross Annual Emissions	444	438	416	367	341	321	9,272	294	291	291	291	931	291	291	291	291	<u>291</u>
CHP Power Generation	-179	-175	-165	-140	-127	-117	-111	-103	-102	-102	-102	-102	-102	-102	-102	-102	<u>-102</u>
Sequestration	Only 1 year sequestration due to management plan being secondary mitigation																
Net Annual Emissions	265	262	251	227	214	204	9,160	191	189	189	189	829	189	189	189	189	<u>189</u>

<u>Relative year</u>	<u>34</u>	<u>35</u>	<u>36</u>	<u>37</u>	<u>38</u>	<u>39</u>	<u>40</u>	<u>41</u>	<u>42</u>	<u>43</u>	<u>44</u>	<u>45</u>	<u>46</u>	<u>47</u>	<u>48</u>	<u>49</u>	<u>50</u>
<u>Capital Carbon</u>	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
<u>Capital Replacements</u>	-	-	1	-	-	-	-	-	-	-	-	-	8.962	-	-	-	-
<u>Operational Carbon - Power</u>	<u>202</u>	<u>202</u>	<u>202</u>	<u>202</u>													
<u>Operational Carbon - Non-power</u>	<u>89</u>	<u>89</u>	<u>89</u>	<u>89</u>													
<u>Gross Annual Emissions</u>	<u>291</u>	<u>291</u>	<u>292</u>	<u>291</u>	<u>9,253</u>	<u>291</u>	<u>291</u>	<u>291</u>									
<u>CHP Power Generation</u>	<u>-102</u>	<u>-102</u>	<u>-102</u>	<u>-102</u>													
<u>Sequestration</u>																	
<u>Net Annual Emissions</u>	<u>189</u>	<u>189</u>	<u>190</u>	<u>189</u>	<u>9,151</u>	<u>189</u>	<u>189</u>	<u>189</u>									

<u>Relative year</u>	<u>51</u>	<u>52</u>	<u>53</u>	<u>54</u>	<u>55</u>	<u>56</u>	<u>57</u>	<u>58</u>	<u>59</u>	<u>60</u>	<u>61</u>	<u>62</u>	<u>63</u>	<u>64</u>	<u>65</u>
<u>Capital Carbon</u>	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
<u>Capital Replacements</u>	-	-	-	<u>1</u>	-	<u>640</u>	-	-	-	-	-	-	-	-	-
<u>Operational Carbon - Power</u>	<u>202</u>														
<u>Operational Carbon - Non-power</u>	<u>89</u>														
<u>Gross Annual Emissions</u>	<u>291</u>	<u>291</u>	<u>291</u>	<u>292</u>	<u>291</u>	<u>931</u>	<u>291</u>								
<u>CHP Power Generation</u>	<u>-102</u>														
<u>Sequestration</u>															
<u>Net Annual Emissions</u>	<u>189</u>	<u>189</u>	<u>189</u>	<u>190</u>	<u>189</u>	<u>829</u>	<u>189</u>								

Table 2-181819: Primary and tertiary mitigation assessment lifetime: Baseline DMO

Relative year	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16
Capital Carbon	32,250	32,250	32,250														
Capital Replacements	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
Operational Carbon - Power	-	-	-	2,046	1,915	1,520	1,204	1,041	904	820	732	605	538	526	498	451	375
Operational Carbon - Non-power	-	-	-	89	89	89	89	89	89	89	89	89	89	89	89	89	89
Gross Annual Emissions	32,250	32,250	32,250	2,134	2,004	1,609	1,293	1,129	992	909	821	694	627	615	587	540	463
CHP Power Generation	-	-	-	-	-1,029	-963	-765	-605	-523	-454	-413	-368	-304	-271	-265	-250	-227
Sequestration	-38	-38	-38	-38	-38	-38	-38	-38	-38	-38	-38	-38	-38	-38	-38	-38	-38
Net Annual Emissions	32,212	32,212	32,212	1,068	1,003	807	650	568	500	459	415	352	319	313	299	275	237

Relative year	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31	32	33
<hr/>																	
Capital Carbon																	
Capital Replacements	-	2	-	-	-	-	15,873	-	-	-	-	398	-	-	-	-	-
Operational Carbon - Power	356	348	327	278	252	233	221	206	202	202	202	202	202	202	202	202	<u>202</u>
Operational Carbon - Non-power	89	89	89	89	89	89	89	89	89	89	89	89	89	89	89	89	<u>89</u>
Gross Annual Emissions	444	439	416	367	341	321	16,182	294	291	291	291	689	291	291	291	291	<u>291</u>
CHP Power Generation	-179	-175	-165	-140	-127	-117	-111	-103	-102	-102	-102	-102	-102	-102	-102	-102	<u>-102</u>
Sequestration	-38	-38	-38	-38	-38	-38	-38	-38	-38	-38	-38	-38	-38	-38	-38	-38	<u>-38</u>
Net Annual Emissions	228	226	214	189	177	167	16,034	153	152	152	152	549	152	152	152	152	<u>152</u>

<u>Relative year</u>	<u>34</u>	<u>35</u>	<u>36</u>	<u>37</u>	<u>38</u>	<u>39</u>	<u>40</u>	<u>41</u>	<u>42</u>	<u>43</u>	<u>44</u>	<u>45</u>	<u>46</u>	<u>47</u>	<u>48</u>	<u>49</u>	<u>50</u>
<u>Capital Carbon</u>																	
<u>Capital Replacements</u>	-	-	-	-	2	-	-	-	-	-	-	-	-	-	15,873	-	-
<u>Operational Carbon - Power</u>	<u>202</u>	<u>202</u>	<u>202</u>														
<u>Operational Carbon - Non-power</u>	<u>.89</u>	<u>.89</u>	<u>.89</u>														
<u>Gross Annual Emissions</u>	<u>291</u>	<u>291</u>	<u>291</u>	<u>291</u>	<u>293</u>	<u>291</u>	<u>16,163</u>	<u>291</u>	<u>291</u>								
<u>CHP Power Generation</u>	<u>-102</u>	<u>-102</u>	<u>-102</u>														
<u>Sequestration</u>	<u>-38</u>	<u>-38</u>	<u>-38</u>														
<u>Net Annual Emissions</u>	<u>152</u>	<u>152</u>	<u>152</u>	<u>152</u>	<u>154</u>	<u>152</u>	<u>16,024</u>	<u>152</u>	<u>152</u>								

<u>Relative year</u>	<u>51</u>	<u>52</u>	<u>53</u>	<u>54</u>	<u>55</u>	<u>56</u>	<u>57</u>	<u>58</u>	<u>59</u>	<u>60</u>	<u>61</u>	<u>62</u>	<u>63</u>	<u>64</u>	<u>65</u>
<hr/>															
<u>Capital Carbon</u>															
<u>Capital Replacements</u>	-	-	398	-	-	-	-	2	-	-	-	-	-	-	-
<u>Operational Carbon - Power</u>	202	202	202	202	202	202	202	202	202	202	202	202	202	202	202
<u>Operational Carbon - Non-power</u>	89	89	89	89	89	89	89	89	89	89	89	89	89	89	89
<u>Gross Annual Emissions</u>	291	291	689	291	291	291	291	293	291	291	291	291	291	291	291
<u>CHP Power Generation</u>	-102	-102	-102	-102	-102	-102	-102	-102	-102	-102	-102	-102	-102	-102	-102
<u>Sequestration</u>	-38	-38	-38	-38	-38	-38	-38	-38	-38	-38	-38	-38	-38	-38	-38
<u>Net Annual Emissions</u>	152	152	549	152	152	152	152	154	152	152	152	152	152	152	152

2.8 Assessment lifetime – Secondary mitigation

- 2.8.1 Data is set out per year of assessment in [Table 2-20](#)[Table 2-20](#)[Table 2-21](#) and [Table 2-21](#)[Table 2-21](#)[Table 2-22](#). Totals over the assessment lifetime for each option are summarised below in [Table 2-19](#)[Table 2-19](#)[Table 2-20](#). This includes emissions associated with all mitigation measures (including secondary mitigation) over 33 years, this accounts for three years of construction, then operation over a ~~30-65~~ year period (covering the ~~30~~ year extent of the landscape management plan period, and beyond to 2090). Note that the baseline is shown in [Table 2-15](#)[Table 2-15](#)[Table 2-16](#).
- 2.8.2 The same assumptions were used for electricity emissions factors as shown in [Table 2-14](#)[Table 2-14](#)[Table 2-15](#).

Table 2-19[Table 2-19](#)[Table 2-20](#): Assessment lifetime emissions by design option

Design Option	Emissions Source	Total tCO2e
DCO Design - preferred option		
DCO Design	Capital Carbon	<u>50,790</u> <u>53,000</u>
DCO Design	Capital Replacements	<u>9,600</u> <u>19,210</u>
DCO Design - preferred option	Operational Carbon - Power	<u>14,500</u> <u>19,840</u>
DCO Design - preferred option	Operational Carbon - Non-power	<u>29,520</u> <u>27,476</u>
DCO Design - preferred option	Gross Annual Emissions	<u>104,410</u> <u>119,520</u>
DCO Design - preferred option	Biomethane Export	-136,710
DCO Design	Sequestration	<u>-720</u> <u>-3,080</u>
DCO Design - preferred option	Net Annual Emissions	<u>-32,020</u> <u>20,270</u>
DCO Design	Cumulative sequestration	-15,550
DCO Design - CHP		
DCO Design	Capital Carbon	<u>50,790</u> <u>53,000</u>
DCO Design	Capital Replacements	<u>9,600</u> <u>19,210</u>
DM0 Design	Operational Carbon - Power	<u>17,010</u> <u>23,680</u>
DM0 Design	Operational Carbon - Non-power	<u>2,660</u> <u>5,590</u>
DCO Design - CHP	Total Gross Annual Emissions	<u>80,070</u> <u>101,470</u>
DM0 Design	CHP Power Generation	<u>-8,560</u> <u>-11,910</u>
DCO Design	Sequestration	<u>-720</u> <u>-3,080</u>
DCO Design - CHP	Total Net Annual Emissions	<u>71,480</u> <u>86,480</u>
DCO Design	Cumulative sequestration	-15,550

Table 2-202024: Secondary mitigation assessment lifetime: DCO Design - preferred option

Relative year	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16
Capital Carbon	<u>17,667</u> 16,930	<u>17,667</u> 16,930	<u>17,667</u> 16,930	-	-	-	-	-	-	-	-	-	-	-	-	-	
Capital Replacements	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
Operational Carbon - Power	-	-	-	1,743	1,632	1,295	1,026	887	770	699	624	516	459	448	424	385	319
Operational Carbon - Non-power	-	-	-	984	984	984	984	984	984	984	984	984	984	984	984	984	984
Gross Annual Emissions	<u>17,667</u> 16,930	<u>17,667</u> 16,930	<u>17,667</u> 16,930	2,727	2,616	2,279	2,010	1,871	1,754	1,683	1,608	1,500	1,443	1,432	1,408	1,369	1,303
Biomethane Export	-	-	-	-6,214	-6,214	-6,214	-6,214	-6,214	-6,214	-6,214	-6,214	-6,214	-6,214	-6,214	-6,214	-6,214	
Sequestration	-	-	-	-30	-30	-30	-30	-30	-30	-30	-30	-30	-30	-139	-139	-139	
Net Annual Emissions	<u>17,667</u> 16,930	<u>17,667</u> 16,930	<u>17,667</u> 16,930	-3,517	-3,628	-3,965	-4,234	-4,373	-4,490	-4,561	-4,636	-4,744	-4,801	-4,921	-4,945	-4,985	-5,050

Relative year	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31	32	33
Capital Carbon	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
Capital Replacements	-	1	-	-	-	-	8,962	-	-	-	-	640	-	-	-	-	-
Operational Carbon - Power	303	297	279	237	215	198	188	175	172	172	172	172	172	172	172	172	172
Operational Carbon - Non-power	984	984	984	984	984	984	984	984	984	984	984	984	984	984	984	984	121
Gross Annual Emissions	1,287	1,282	1,263	1,221	1,199	1,182	10,134	1,159	1,156	293	293	933	293	293	293	293	293
Biomethane Export	-6,214	-6,214	-6,214	-6,214	-6,214	-6,214	-6,214	-6,214	-	-	-	-	-	-	-	-	-
Sequestration	-139	-139	-139	-139	-139	-139	-139	-139	-139	-139	-139	-139	-139	-139	-139	-139	-139
Net Annual Emissions	-5,066	-5,072	-5,090	-5,132	-5,154	-5,171	3,781	-5,194	1,017	154	154	794	154	154	154	154	293

<u>Relative year</u>	<u>34</u>	<u>35</u>	<u>36</u>	<u>37</u>	<u>38</u>	<u>39</u>	<u>40</u>	<u>41</u>	<u>42</u>	<u>43</u>	<u>44</u>	<u>45</u>	<u>46</u>	<u>47</u>	<u>48</u>	<u>49</u>	<u>50</u>
<u>Capital Carbon</u>																	
<u>Capital Replacements</u>	-	-	1	-	-	-	-	-	-	-	-	-	8,962	-	-	-	-
<u>Operational Carbon - Power</u>	172	172	172	172	172	172	172	172	172	172	172	172	172	172	172	172	172
<u>Operational Carbon - Non-power</u>	121	121	121	121	121	121	121	121	121	121	121	121	121	121	121	121	121
<u>Gross Annual Emissions</u>	293	293	294	293	293	293	293	293	293	293	293	293	9,255	293	293	293	293
<u>Biomethane Export</u>	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
<u>Sequestration</u>	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
<u>Net Annual Emissions</u>	293	293	294	293	293	293	293	293	293	293	293	293	9,255	293	293	293	293

<u>Relative year</u>	<u>51</u>	<u>52</u>	<u>53</u>	<u>54</u>	<u>55</u>	<u>56</u>	<u>57</u>	<u>58</u>	<u>59</u>	<u>60</u>	<u>61</u>	<u>62</u>	<u>63</u>	<u>64</u>	<u>65</u>
<u>Capital Carbon</u>															
<u>Capital Replacements</u>	-	-	-	1	-	640	-	-	-	-	-	-	-	-	-
<u>Operational Carbon - Power</u>	172	172	172	172	172	172	172	172	172	172	172	172	172	172	172
<u>Operational Carbon - Non-power</u>	121	121	121	121	121	121	121	121	121	121	121	121	121	121	121
<u>Gross Annual Emissions</u>	293	293	293	294	293	933	293	293	293	293	293	293	293	293	293
<u>Biomethane Export</u>	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
<u>Sequestration</u>	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
<u>Net Annual Emissions</u>	293	293	293	294	293	933	293	293	293	293	293	293	293	293	293

Table 2-212122: Primary and tertiary mitigation assessment lifetime: DCO Design - CHP option

Relative year	0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16
Capital Carbon	<u>17,667</u> 16,930	<u>17,667</u> 16,930	<u>17,667</u> 16,930	-	-	-	-	-	-	-	-	-	-	-	-	-	
Capital Replacements	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	
Operational Carbon - Power	-	-	-	2,046	1,915	1,520	1,204	1,041	904	820	732	605	538	526	498	451	375
Operational Carbon - Non-power	-	-	-	89	89	89	89	89	89	89	89	89	89	89	89	89	89
Gross Annual Emissions	<u>17,667</u> 16,930	<u>17,667</u> 16,930	<u>17,667</u> 16,930	2,134	2,004	1,609	1,293	1,129	992	909	821	694	627	615	587	540	463
CHP Power Generation	-	-	-	-1,029	-963	-765	-605	-523	-454	-413	-368	-304	-271	-265	-250	-227	-188
Sequestration	-	-	-	-30	-30	-30	-30	-30	-30	-30	-30	-30	-30	-139	-139	-139	-139
Net Annual Emissions	<u>17,667</u> 16,930	<u>17,667</u> 16,930	<u>17,667</u> 16,930	1,076	1,011	815	657	576	508	467	423	360	327	211	197	174	136

Relative year	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31	32	33
Capital Carbon	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
Capital Replacements	-	1	-	-	-	-	8,962	-	-	-	-	640	-	-	-	-	-
Operational Carbon - Power	356	348	327	278	252	233	221	206	202	202	202	202	202	202	202	202	<u>202</u>
Operational Carbon - Non-power	89	89	89	89	89	89	89	89	89	89	89	89	89	89	89	89	<u>89</u>
Gross Annual Emissions	444	438	416	367	341	321	9,272	294	291	291	291	931	291	291	291	291	<u>291</u>
CHP Power Generation	-179	-175	-165	-140	-127	-117	-111	-103	-102	-102	-102	-102	-102	-102	-102	-102	<u>-102</u>
Sequestration	-139	-139	-139	-139	-139	-139	-139	-139	-139	-139	-139	-139	-139	-139	-139	-139	<u>-139</u>
Net Annual Emissions	126	123	112	88	75	65	9,021	52	50	50	50	690	50	50	50	50	<u>189</u>

<u>Relative year</u>	<u>34</u>	<u>35</u>	<u>36</u>	<u>37</u>	<u>38</u>	<u>39</u>	<u>40</u>	<u>41</u>	<u>42</u>	<u>43</u>	<u>44</u>	<u>45</u>	<u>46</u>	<u>47</u>	<u>48</u>	<u>49</u>	<u>50</u>
<u>Capital Carbon</u>	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
<u>Capital Replacements</u>	-	-	1	-	-	-	-	-	-	-	-	-	-	8,962	-	-	-
<u>Operational Carbon - Power</u>	202	202	202	202	202	202	202	202	202	202	202	202	202	202	202	202	202
<u>Operational Carbon - Non-power</u>	89	89	89	89	89	89	89	89	89	89	89	89	89	89	89	89	89
<u>Gross Annual Emissions</u>	291	291	292	291	291	291	291	291	291	291	291	291	291	9,253	291	291	291
<u>CHP Power Generation</u>	-102	-102	-102	-102	-102	-102	-102	-102	-102	-102	-102	-102	-102	-102	-102	-102	-102
<u>Sequestration</u>	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
<u>Net Annual Emissions</u>	189	189	190	189	189	189	189	189	189	189	189	189	189	9,151	189	189	189

<u>Relative year</u>	<u>51</u>	<u>52</u>	<u>53</u>	<u>54</u>	<u>55</u>	<u>56</u>	<u>57</u>	<u>58</u>	<u>59</u>	<u>60</u>	<u>61</u>	<u>62</u>	<u>63</u>	<u>64</u>	<u>65</u>
<u>Capital Carbon</u>	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
<u>Capital Replacements</u>	-	-	-	1	-	640	-	-	-	-	-	-	-	-	-
<u>Operational Carbon - Power</u>	<u>202</u>														
<u>Operational Carbon - Non-power</u>	<u>89</u>														
<u>Gross Annual Emissions</u>	<u>291</u>	<u>291</u>	<u>291</u>	<u>292</u>	<u>291</u>	<u>931</u>	<u>291</u>								
<u>CHP Power Generation</u>	-102	-102	-102	-102	-102	-102	-102	-102	-102	-102	-102	-102	-102	-102	-102
<u>Sequestration</u>	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
<u>Net Annual Emissions</u>	<u>189</u>	<u>189</u>	<u>189</u>	<u>190</u>	<u>189</u>	<u>829</u>	<u>189</u>								


2.8.3


2.8.4 [Figure 2.9: Gross cumulative comparison](#)

← **Formatted:** AW body text

2.8.32.8.5 [Figure 2.9](#) below shows the comparison of gross cumulative carbon emissions for the DCO (preferred option and CHP option) and DM0 design models.


Figure 2.9: Gross cumulative comparison

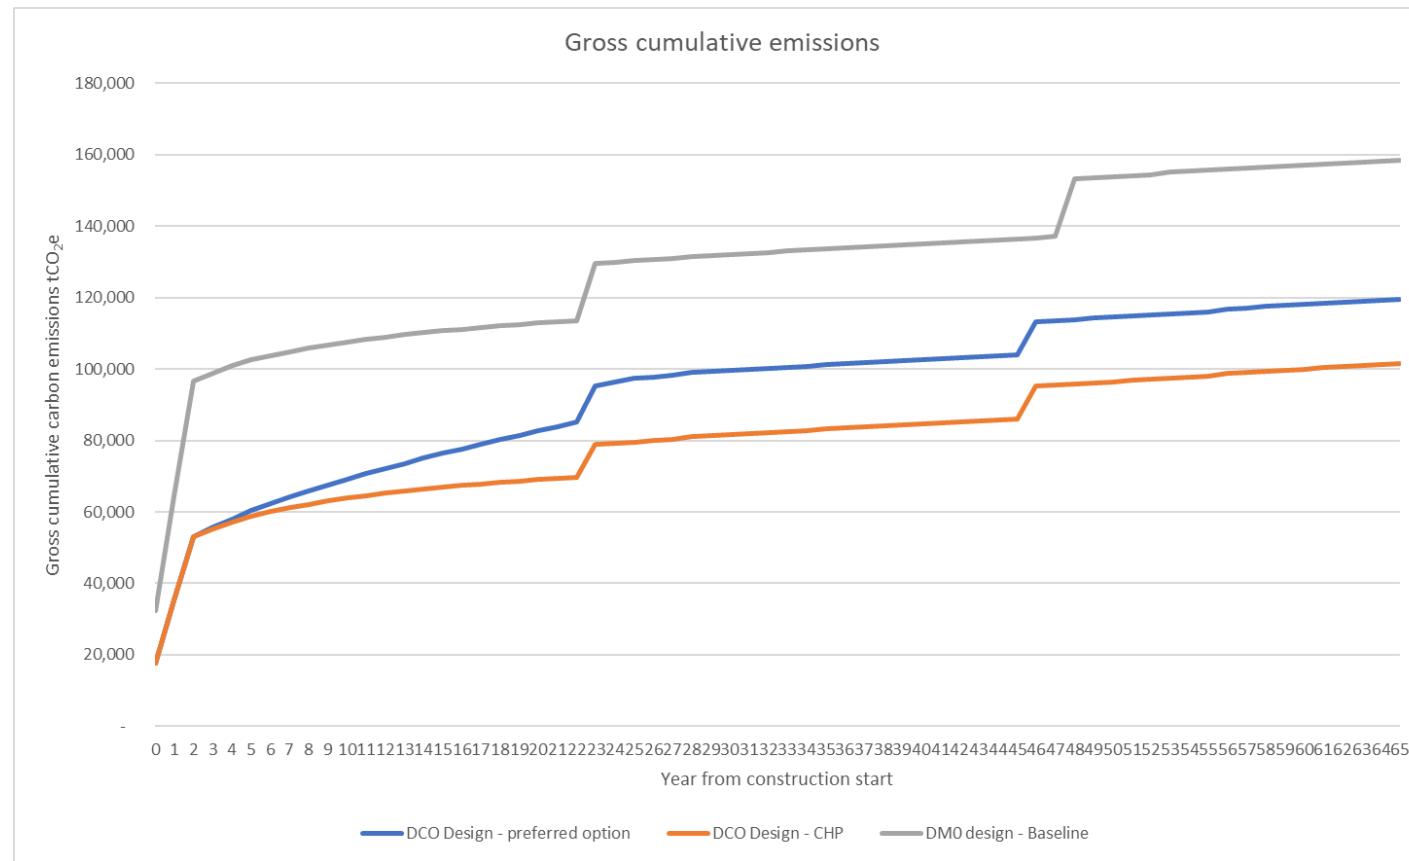


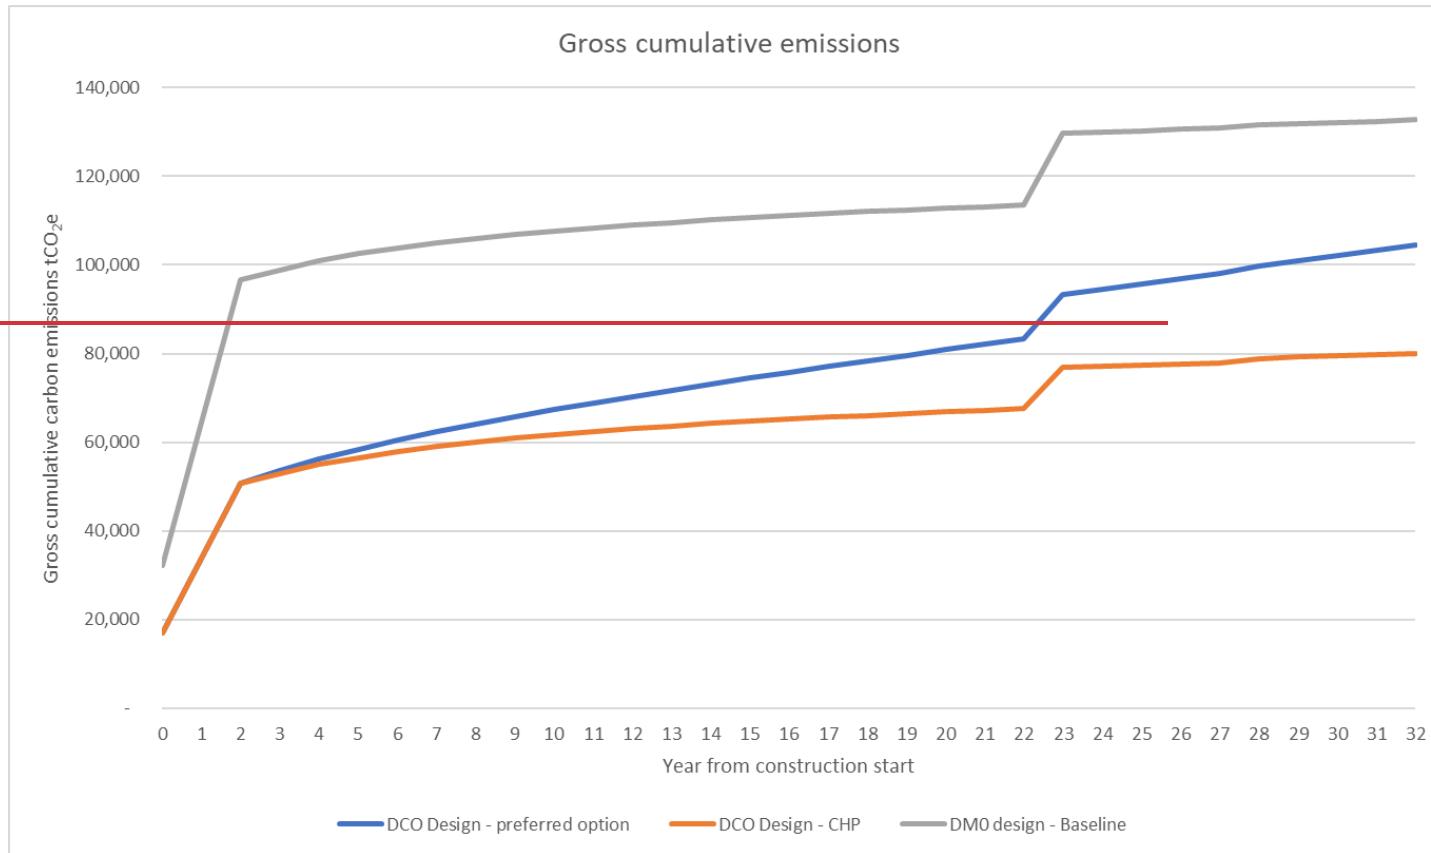

2.8.1 Figure 2.10 below shows the comparison of net cumulative carbon emissions for the DCO (preferred option and CHP option) and DMO design models. The preferred option is the only option to reach negative net cumulative carbon emissions.


Figure 2.10: Net cumulative comparison

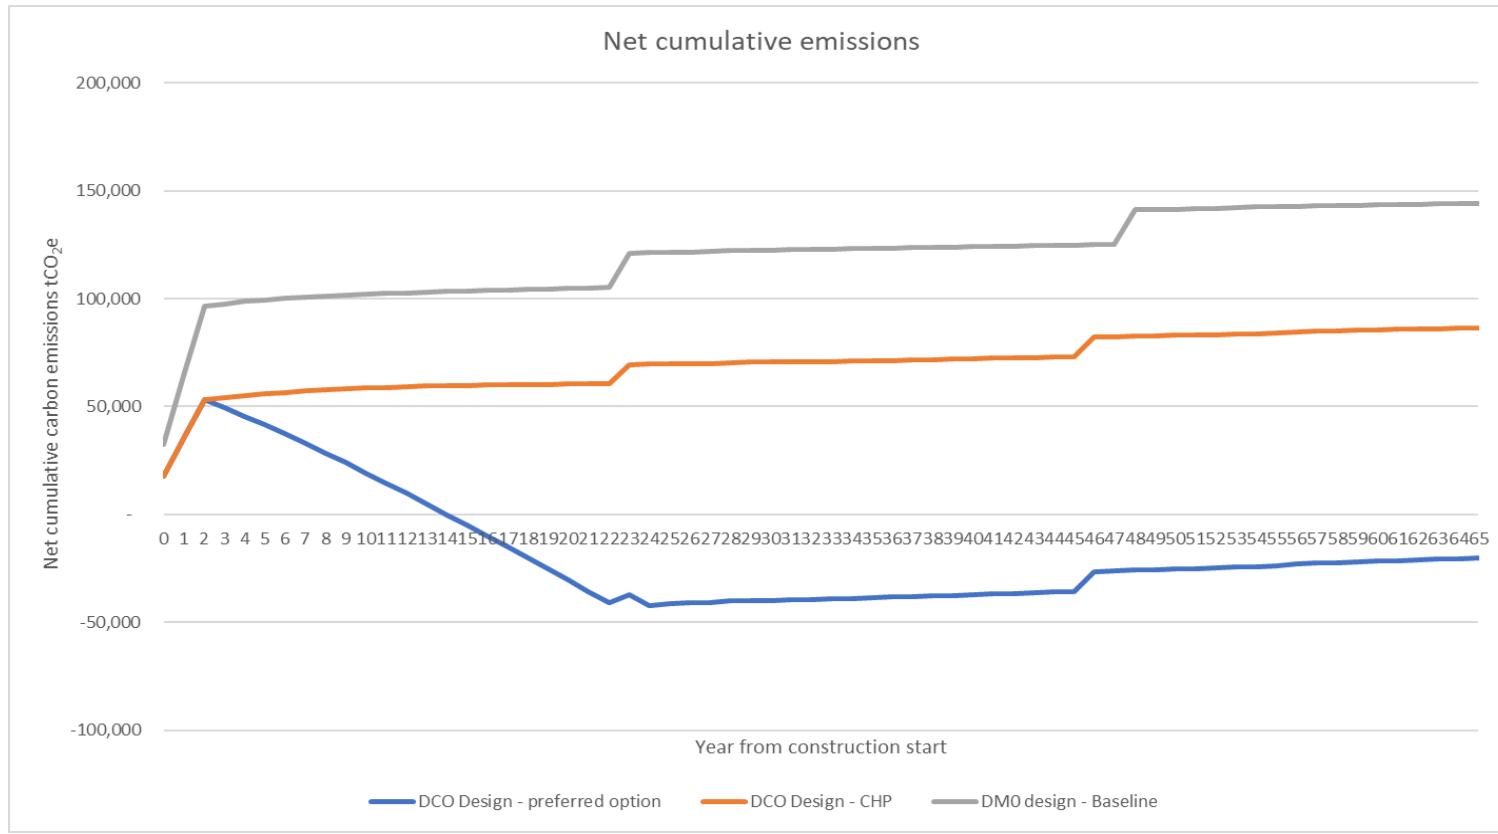


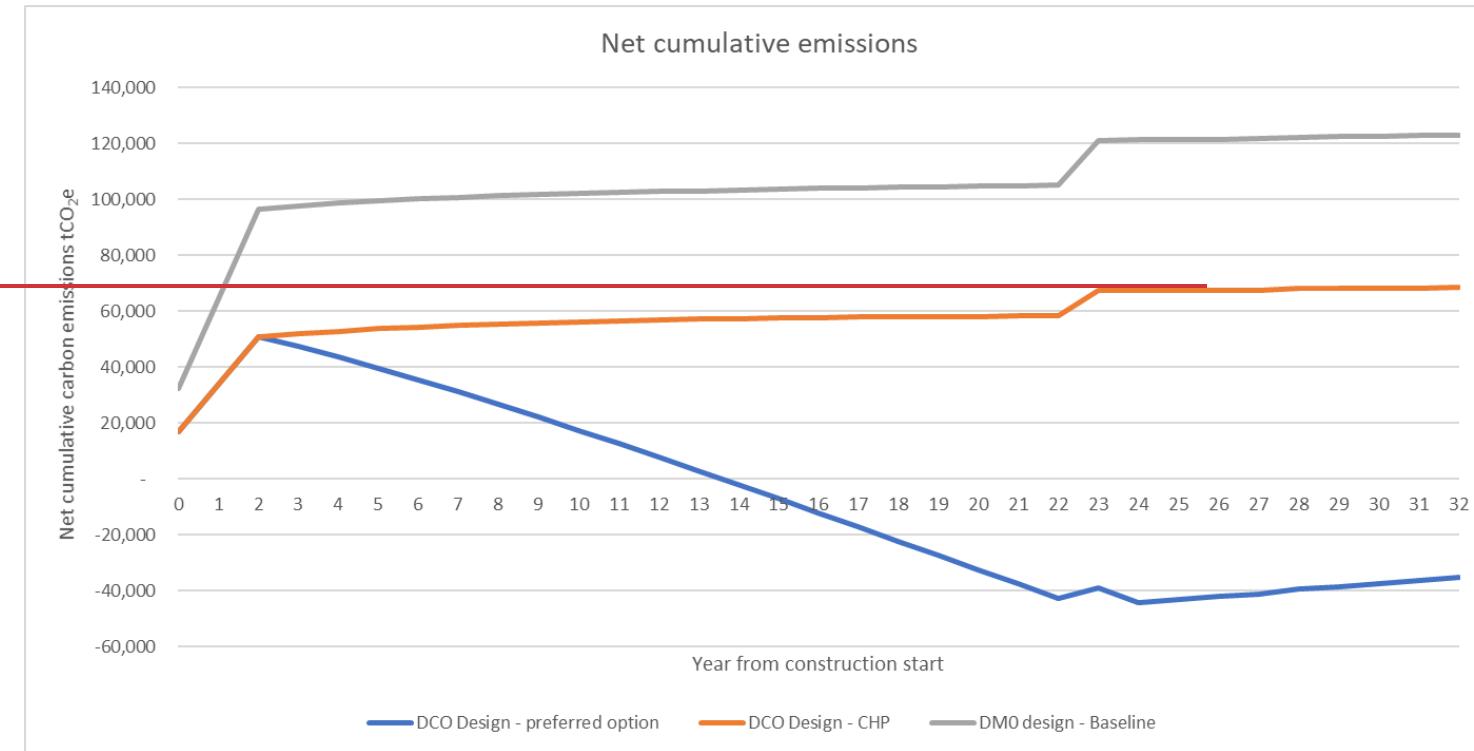

2.8.2 Figure 2.11 below shows that the emissions for the preferred option is relatively low beyond year 2 with a spike in year 23 due to capital replacement. It is assumed that export of biomethane cannot be claimed as avoided emissions post 2050. The overall cumulative outlook shows that more carbon is avoided than emitted.


Figure 2.11: Emissions by source for the preferred option model

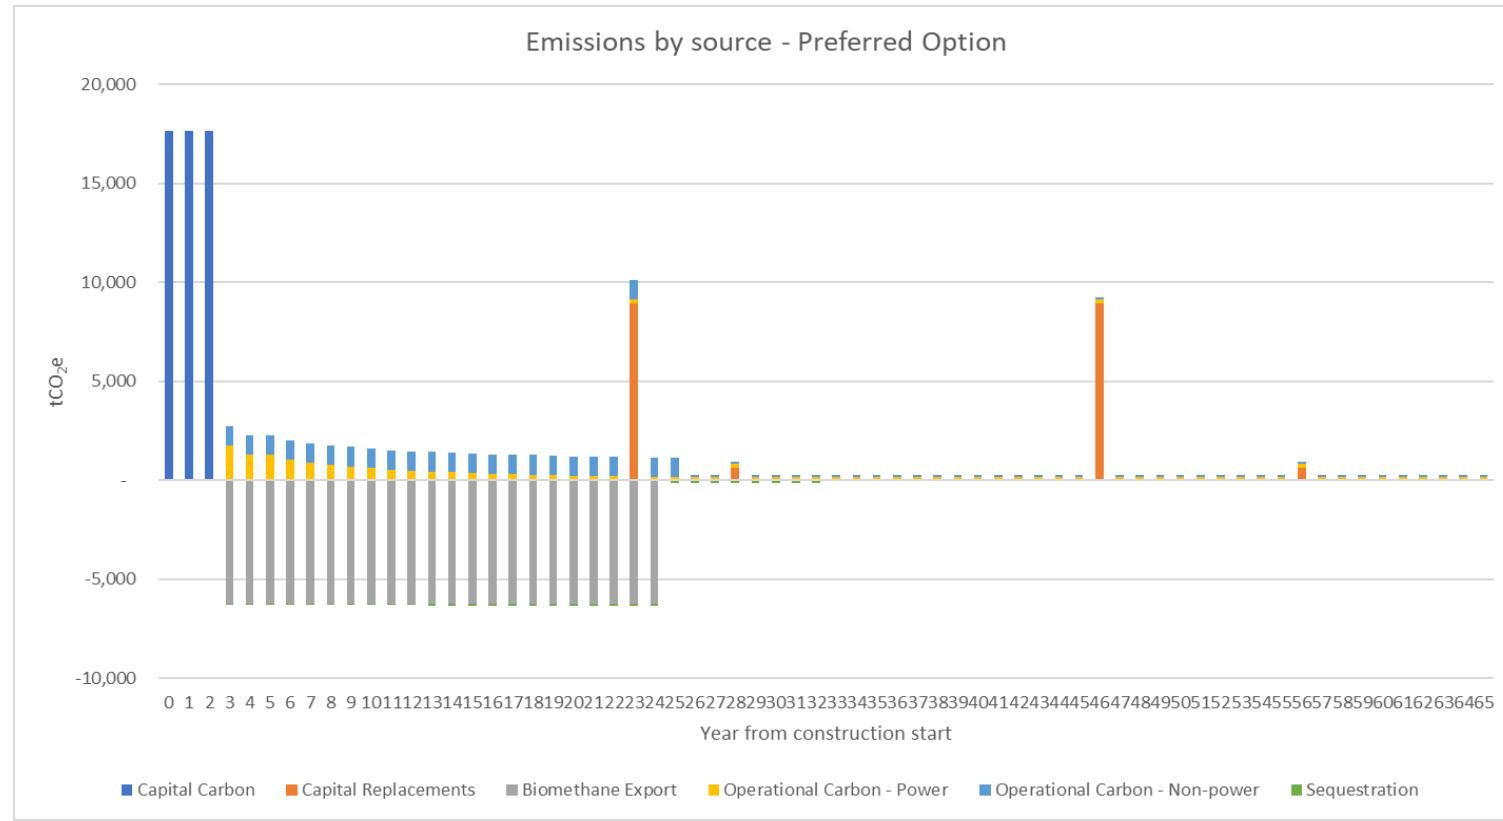


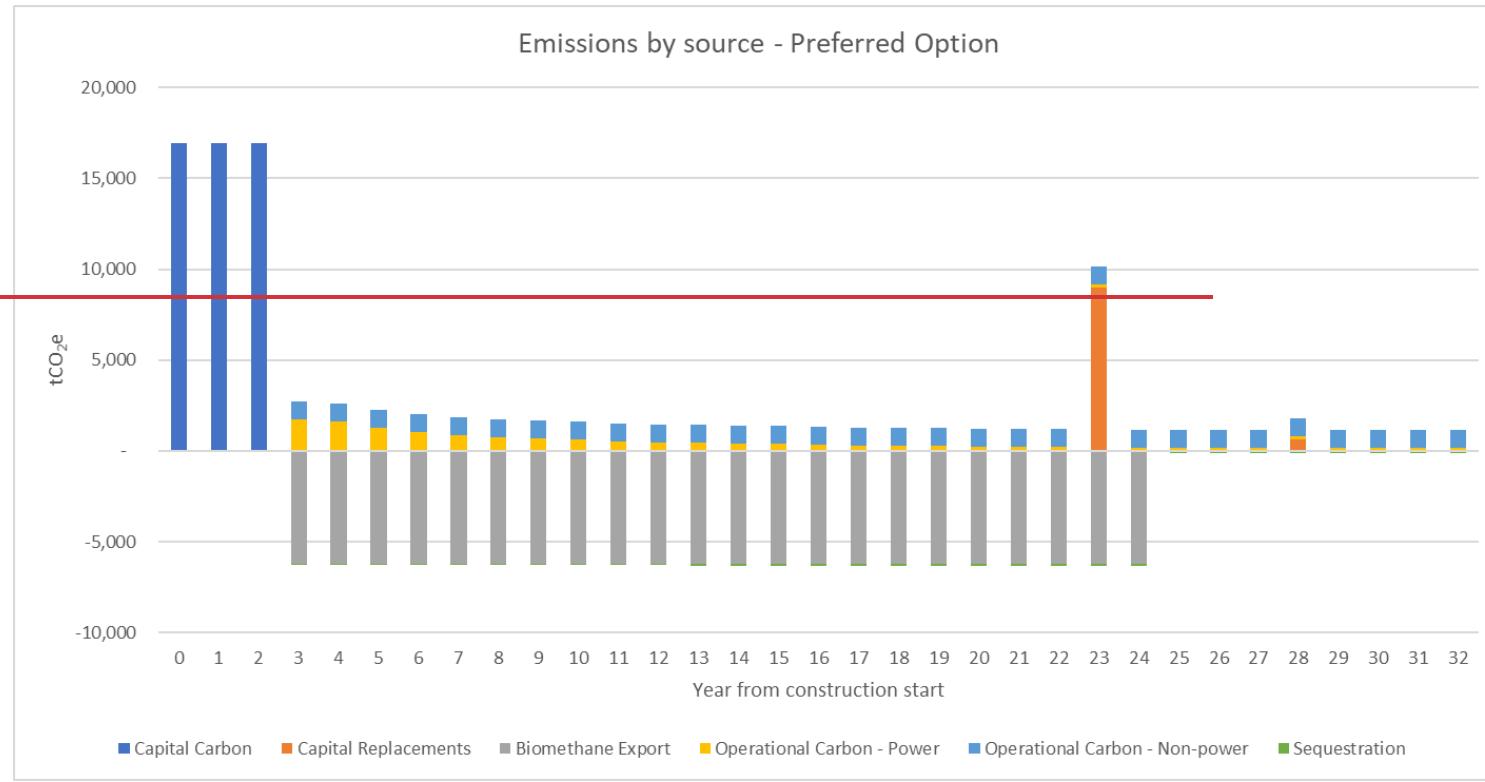

2.8.3 Figure 2.12 below shows the emissions by source for the assessment lifetime. The emissions for the CHP option are relatively low in operation, with lower avoided emissions than the preferred option, and with a spike in year 23 due to capital replacement.


Figure 2.12: Emissions by source – CHP option

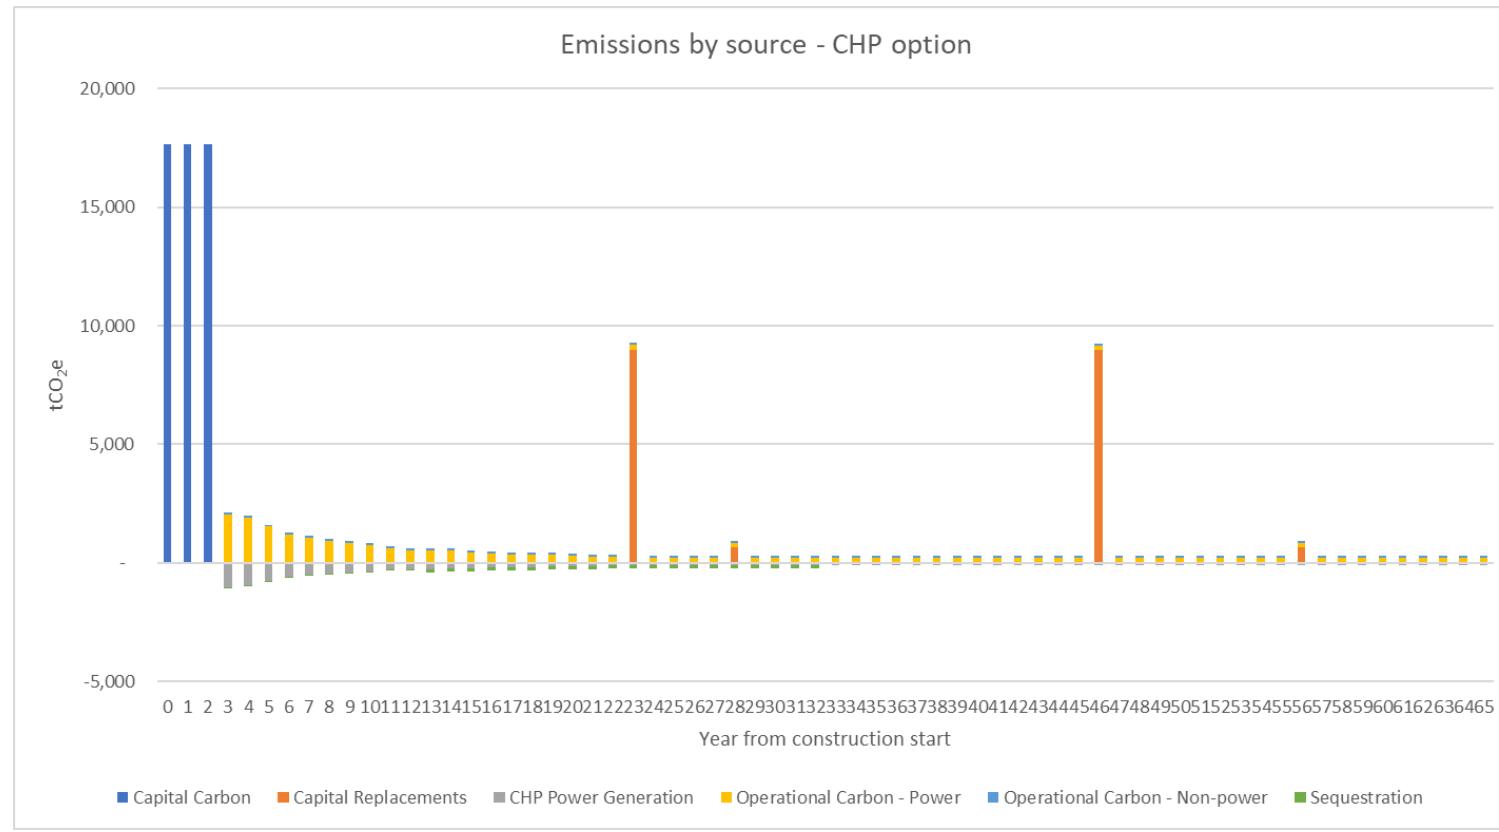


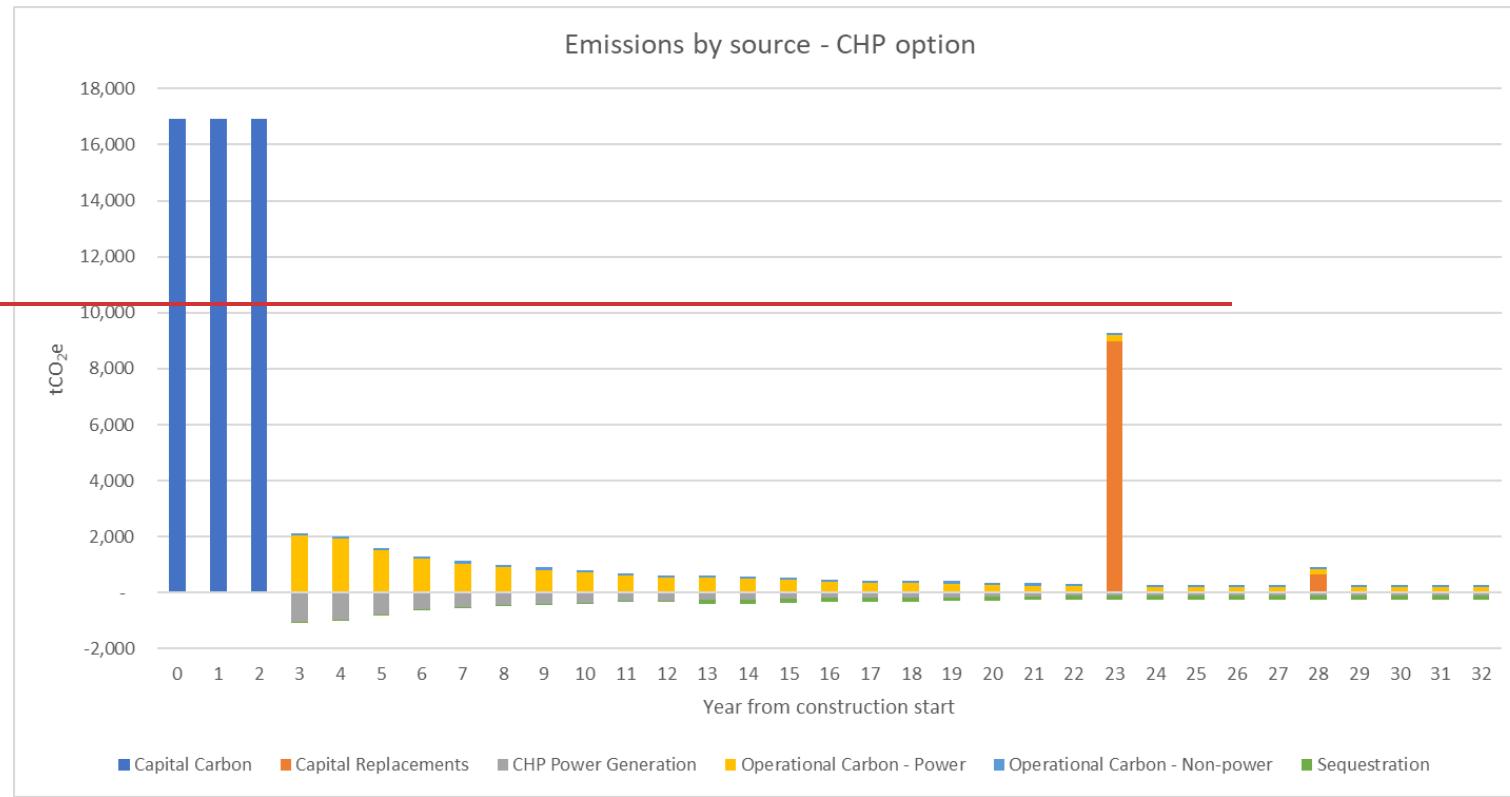

2.8.4 Figure 2.13 below shows the emissions by source for the assessment lifetime. The emissions for the baseline option are high for construction, with relatively low operational emissions (although lower avoided emissions than the preferred option), with a spike in year 23 due to capital replacement.

Figure 2.13: Emissions by type – baseline

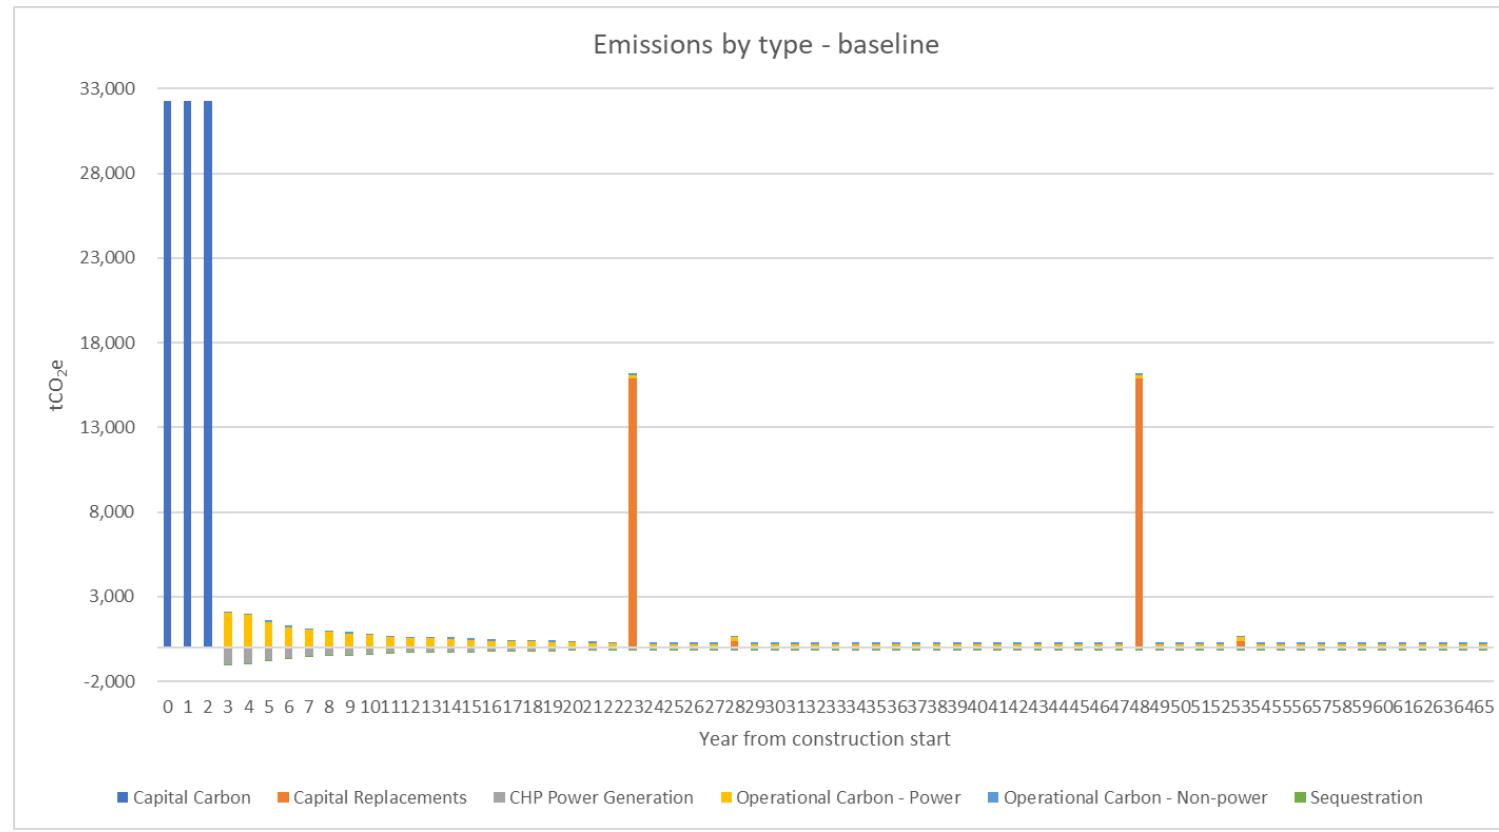

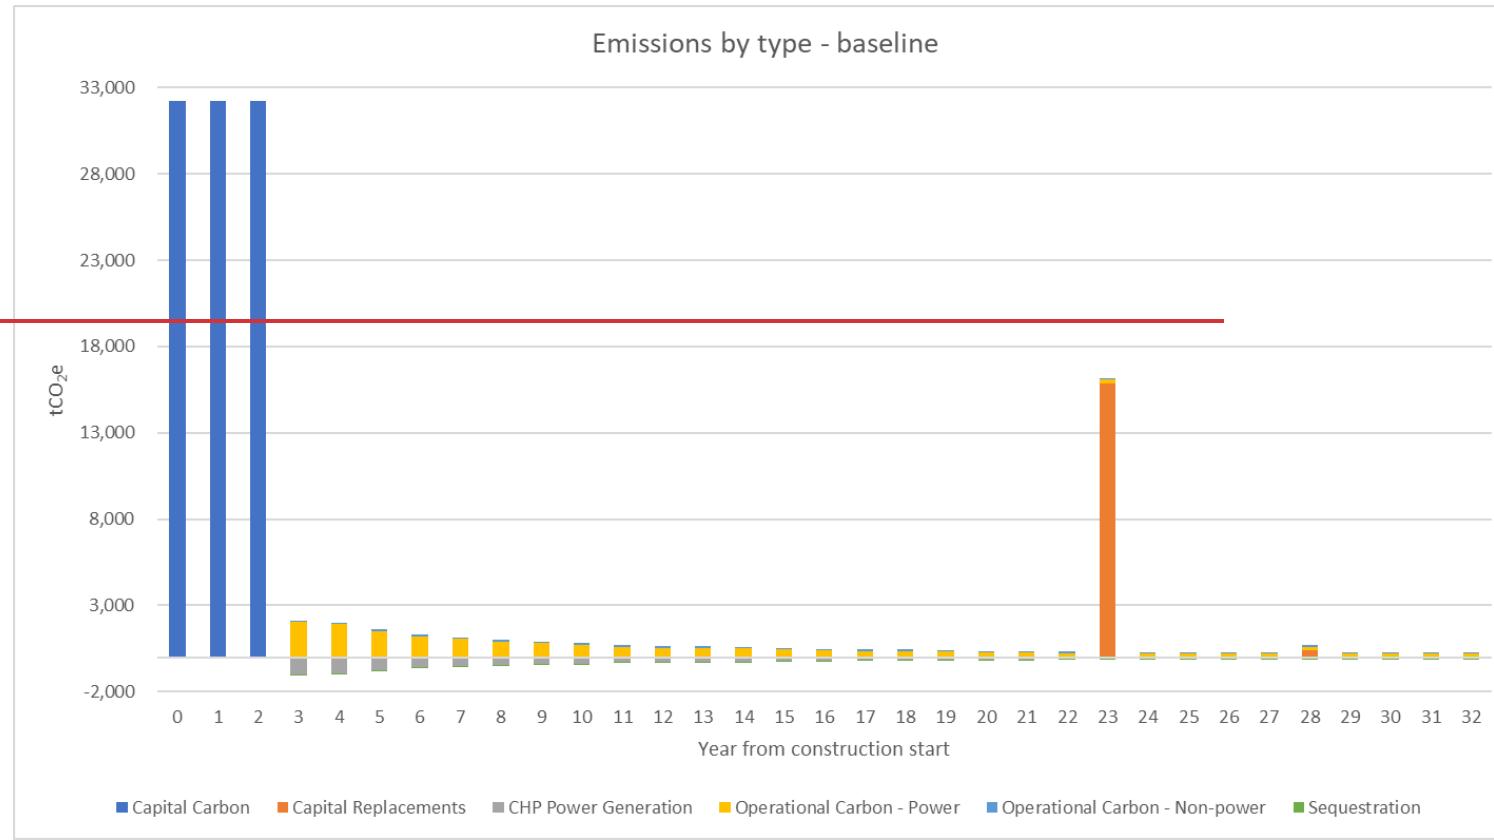

3 References

- Department for Business Energy & Industrial Strategy. (2021). *Green Book supplementary guidance: valuation of energy use and greenhouse gas emissions for appraisal*. Retrieved from <https://www.gov.uk/government/publications/valuation-of-energy-use-and-greenhouse-gas-emissions-for-appraisal>
- Department for Business Energy & Industrial Strategy. (2021). *Greenhouse gas reporting: conversion factors*.
- Department for Business, Energy & Industrial Strategy. (2021). *2019 UK Greenhouse Gas Emissions*. Retrieved from https://assets.publishing.service.gov.uk/government/uploads/system/uploads/attachment_data/file/957687/2019_Final_emissions_statistics_one_page_summary.pdf
- Department for Business, Energy & Industrial Strategy. (2021). *Annex 2: 2019 UK Greenhouse Gas Emissions, final figures by Standard Industrial Classification*. Retrieved from https://assets.publishing.service.gov.uk/government/uploads/system/uploads/attachment_data/file/995865/annex-2-1990-2019-uk-ghg-emissions-final-figures-by-sic.pdf
- JBA Consulting. (2018, December). *Exploring the economics of land use change for increasing resilience to climate change in England*. Retrieved from The Committee on Climate Change: <https://www.theccc.org.uk/wp-content/uploads/2018/12/JBA-Consulting-Exploring-the-economics-of-land-use-change-for-increasing-resilience-to-climate-change-in-England.pdf>
- Willmott Dixon (2022) Whole life carbon of photovoltaic installations TECHNICAL REPORT - FEBRUARY 2022. Retrieved from <https://www.willmottdixon.co.uk/asset/17094>

Get in touch

You can contact us by:



Emailing at info@cwwtpr.com



Calling our Freephone information line on **0808 196 1661**



Writing to us at **Freepost: CWWTPR**

You can view all our DCO application documents and updates on the application on The Planning Inspectorate website:

<https://infrastructure.planninginspectorate.gov.uk/projects/eastern/cambri-dge-waste-water-treatment-plant-relocation/>