

Cambridge Waste Water Treatment Plant Relocation Project  
Anglian Water Services Limited

# Appendix 20.5 Fluvial Model Report

Application Document Reference: 5.4.20.5

PINS Project Reference: WW010003

APFP Regulation No. 5(2)a

**Submission No. 02**  
**Revision No. 05**  
2<sup>nd</sup> April 2024

**DRAFT**

# **CAMBRIDGE WWTP RIVER MODELLING**

**Project no. 123239**

Prepared for:

Anglian Water

March 2024



## Table of contents

<b>1.</b>	<b>Executive Summary .....</b>	<b>1</b>
1.1	Modelling approach .....	1
1.2	Model assumptions .....	1
1.3	Results .....	2
<b>2.</b>	<b>Introduction.....</b>	<b>3</b>
2.1	Background.....	3
2.2	Flood Risk Assessment .....	3
2.3	Outfall flows .....	4
<b>3.</b>	<b>Scope .....</b>	<b>5</b>
<b>4.</b>	<b>Environment Agency January 2024 review .....</b>	<b>5</b>
<b>5.</b>	<b>Implementation.....</b>	<b>6</b>
5.1	Overview .....	6
5.2	2023 Cam Urban model.....	6
5.3	Cambridge sewer model .....	7
5.4	Modifications to the river model.....	10
5.5	River model inflows.....	11
5.6	Climate change .....	15
5.7	Model scenarios .....	16
<b>6.</b>	<b>Model results .....</b>	<b>19</b>
6.1	General.....	19
6.2	Existing outfall (no growth) compared to New Outfall (with growth) – 55-hour storm	19
6.3	Existing outfall (no growth) compared to New Outfall (with growth) – 4-hour storm	26
6.4	Existing outfall (no growth) compared to New Outfall (with growth) – other flood magnitudes.....	31
6.5	Existing outfall (with Future Growth) compared to New Outfall (with growth).....	31
6.6	Existing outfall (no growth) compared to New Outfall Phase 1 .....	37
6.7	Non-flood conditions .....	40
<b>7.</b>	<b>Conclusions.....</b>	<b>42</b>
Appendix A:	River model review record .....	44
Appendix B:	Results tables for other flood magnitudes 55-hour - comparing Existing (no growth) to New Outfall (with growth).....	45
Appendix C:	Flood difference for other flood magnitudes 55-hour – comparing Existing (no growth) to New Outfall (with growth).....	56
Appendix D:	Flood difference for 4-hour storm – comparing Existing (no growth) to New Outfall (with growth).....	67
Appendix E:	Results tables for Existing Future vs New Outfall – comparing Existing Future (with growth) to New Outfall (with growth) .....	72
Appendix F:	Flood difference Existing Future vs New Outfall 55 hour – comparing Existing Future (with growth) to New Outfall (with growth) .....	83
Appendix G:	Flood difference Existing Future vs New Outfall 4 hour – comparing Existing Future (with growth) to New Outfall (with growth) .....	94

**Details of document preparation and issue:**

Version no.	Prepared	Checked	Reviewed	Approved	Issue date	Issue status
P01	Rob Fraser / Laura Moyle	Patrick West	Emay Toha	Rob Fraser	15/11/21	Draft
P02	Rob Fraser	Patrick West	Emay Toha	Rob Fraser	22/4/22	Final
P03	Patrick West	Rob Fraser	Emay Toha	Rob Fraser	12/12/23	Draft
P04	Patrick West	Rob Fraser	Emay Toha	Rob Fraser	29/01/24	Draft
P05	Patrick West	Emay Toha	Rob Fraser	Rob Fraser	12/03/24	Draft

Project no. 123239

Client's reference no.

File name: 123239-BUK-ZZ-00-RP-HY-00001.docx

**Notice:**

*This report was prepared by Binnies UK Limited (BUKL) solely for use by Anglian Water. This report is not addressed to and may not be relied upon by any person or entity other than Anglian Water for any purpose without the prior written permission of BUKL. BUKL, its directors, employees and affiliated companies accept no responsibility or liability for reliance upon or use of this report (whether or not permitted) other than by Anglian Water for the purposes for which it was originally commissioned and prepared.*

*In producing this report, BUKL has relied upon information provided by others. The completeness or accuracy of this information is not guaranteed by BUKL.*

# 1. Executive Summary

## 1.1 Modelling approach

This report assesses the potential impact on flood risk from the New Outfall of the relocated Cambridge Wastewater Treatment Plant (WWTP). To make this assessment:

1. Outflows into the River Cam were calculated using Anglian Water's sewer model of the catchment.
2. The sewer model was simulated for three scenarios:
  - a. Existing outfall without growth in the catchment ('Existing');
  - b. Existing outfall with growth in the catchment ('Existing Future'); and
  - c. New outfall with growth for the new works ('New Outfall').
3. Outfall flows for the three scenarios were applied as additional inflow hydrographs to the Environment Agency's latest model of the River Cam ('2023 Cam Urban').
4. The river model was simulated for a range of flood events:
  - a. Nine flood magnitudes (from 1 in 2 year to 1 in 1000 year);
  - b. Critical storm duration for the River Cam (55 hour) and the critical storm for the sewer catchment (4 hours); and
  - c. Three climate change scenarios for the 1 in 100 year flood (9%, 19%, and 45% increases in flows).

## 1.2 Model assumptions

The following assumptions should be understood when interpreting the model results presented in this report:

1. The sewer model for future growth scenarios (Existing Future and New Outfall) includes a 5m<sup>2</sup> allowance for uncontrolled runoff entering the sewer network from each additional property in the catchment. This follows Anglian Water's design standards for sewer modelling to ensure the storm water management has sufficient capacity to deal with the runoff that will reach it. This allowance is not included in the Existing (no growth) case.
2. There is potentially some double counting of runoff in the model.
  - a. The Cam Urban river model does not explicitly or separately represent WWTP discharges so these have been added to the model for this assessment. However, the river model should already implicitly account for discharges to the river as the hydrological assessment is based on defining the model inflows to give the correct flows at different points in the river.
  - b. For the future growth scenarios, no reduction is made for the river catchment inflows to account for the additional 5m<sup>2</sup> runoff area for each new property entering the sewer system.

In both cases, there is no straightforward way to accurately and fairly remove this double-counting within the river model.

As such, the model results in terms of the impact of the new WWTP are likely to be conservative.

## 1.3 Results

The river model results show that:

- **The new WWTP is located outside of the River Cam floodplain and is not at risk of fluvial flooding.**
- **The new outfall / WWTP does not change flood risk in the catchment for all tested flood magnitudes.** This is based on the comparison between Existing Future and New Outfall scenarios, with both scenarios including future growth within the catchment. The results from those two scenarios are almost identical. **This confirms that moving the WWTP facilities does not change the flood risk.**
- When comparing present flood risk to future scenarios, there is a small increase in flood risk predicted in some locations. This small increase in flood risk is caused by the assumed future development and population growth within the catchment. For the future growth cases, there are increased flows entering the sewer network. The same small increase in flood risk compared to the existing catchment (no growth) is shown for the existing WWTP and the new WWTP outfalls – this confirms that it is not the new outfall / WWTP causing the increase in flood risk.
- The increase in flood risk in the River Cam due to future growth in the catchment is extremely small, with flood level increases of only 0.01m or less. There are small areas with larger changes in flood levels predicted at the edges of the flooded extent, which relate to the slightly larger flood volume spreading further within the floodplain. However, given that the predicted river level changes are less than or equal to the convergence tolerance of the model simulations (0.01m) and considerably less than the model calibration tolerance (0.15m), it would not be unreasonable to conclude there is no genuine change in flood risk, even for the future growth scenarios.

## 2. Introduction

### 2.1 Background

The Cambridge Wastewater Treatment Plant (WWTP) Relocation project, also known as CWWTPRP, includes the relocation of the existing WWTP. The project scope also includes an extension of the existing Riverside Sewer Tunnel to convey flows to the proposed new WWTP location and a new outfall to discharge effluent from the WWTP into the River Cam.

This report describes the river modelling to assess the impact of outfall discharges on fluvial flooding.

Since the production of the first version of this report (April 2022) the Environment Agency have updated their river model of the Cam<sup>1</sup> (the '2023 Cam Urban' model). This report was revised to use this updated model and therefore supersedes the first version. The 2023 Cam Urban hydraulic model has been reviewed which is discussed in section 5.2. There have been further subsequent revisions to this report in response to review by, and discussions with, the Environment Agency.

### 2.2 Flood Risk Assessment

The project falls into the category of being 1 hectare or greater in Flood Zone 1 or a proposal located in Flood Zones 2 and 3 and therefore must be accompanied by a Flood Risk Assessment (FRA). This report is not an FRA. However, the scenarios and results in this report have been tested and presented to assist in the assessment and understanding of the potential impacts on flood risk. As such, an FRA has been written in conjunction with this report (Application Document Ref 5.4.20.1: Flood Risk Assessment report) that:

- Identifies and assesses the risks of all sources of flooding to and from the project.
- Demonstrates how these flood risks will be managed.
- Takes climate change into account.

To assist the FRA three stages of modelling were carried out to understand the impact of the new WWTP and associated outfall on the local fluvial and land environment:

- Stage 1: river modelling of the River Cam using an existing one-dimensional (1D) – two-dimensional (2D) hydraulic model of the River Cam. This is to assess fluvial flood levels throughout the River Cam and the relative impact of the new outfall compared to existing conditions.
- Stage 2: river and outfall modelling using a new local hydrodynamic model of the River Cam in the vicinity of the new outfall (in 2D or 3D). This is to assess velocities and mixing of the effluent as it enters the River Cam.

---

<sup>1</sup> Cam Urban Flood Modelling, Environment Agency 2023 ENV0002539C-JBA-XX-CA-RP-MO-L0116\_3-A6-C01-L0116\_3-EA0-LOD0-CAM\_URBAN\_MAIN\_REPORT.pdf

- Stage 3: outfall modelling using Computational Fluid Dynamics (CFD). This is to inform the design of the outfall, for example to prevent scour of the river bed and opposite bank.

There is also potential for a further consideration of fluvial-geomorphology modelling. Detailed design of the relevant parts of the project will link into and be informed by the modelling results.

This report only covers the Stage 1 modelling.

## 2.3 Outfall flows

This report describes the river modelling undertaken to assess flood risk in the River Cam for three cases:

- With the existing WWTP and its existing outfall, for the catchment as it is now.
- With the new WWTP and its new outfall, including runoff from future growth<sup>2</sup> in the catchment.
- Following review by the Environment Agency, a further sensitivity case was recommended for the existing WWTP including runoff from future growth in the catchment (assuming that the new WWTP and outfall would not be constructed).

In effect, this is to:

- Confirm that the new WWTP is not at risk of river flooding; and
- Assess the relative impact on flood risk elsewhere of the flows from the new outfall compared to existing conditions.

**It is really important to note that the new WWTP and outfall will not create water or increase catchment runoff.** Whilst the modelling results show increased flow and volume through the new outfall when compared to the existing WWTP with the catchment as it is now, this is primarily due to inclusion of future growth within the catchment in the new outfall scenario. The existing outfall with future growth sensitivity test has been conducted to assess the impact of this change. The modelling approach for the two core scenarios is conservative in assessing the new WWTP and outfall's impact for several reasons:

- There is potentially some double counting of runoff in the model. The Cam Urban river model does not explicitly or separately represent WWTP discharges so these have been added to the model for this assessment. However, the river model should already implicitly account for discharges to the river as the hydrological assessment is based on defining the model inflows to give the correct flows at different points in the river, through comparison with estimates derived from observed flow records. The other model inflows could be adjusted to account for the added outfall discharge, to maintain the same peak river flows and volumes. However, it is not clear cut how that should be applied for the new outfall case. With additional treatment capacity and more flow passing to the WWTP, logically the runoff from the rest of the catchment would reduce to less than the existing outfall case. Implementing a closed water balance in the model

---

<sup>2</sup> Including runoff from 266 future growth (up to 2050) sites in the Cambridge and Waterbeach area.



would mean no change in river flows or volume at all. This may be the case but would make the modelling exercise redundant. To fully assess this would require an integrated river and surface water model of the whole catchment, which is a disproportionately large task for the needs in this study.

- The reason for the new WWTP is that the existing WWTP could not cope with the future demand. There would be more frequent spills to the outfall from the existing plant in the future growth case. As recommended by the Environment Agency, this case has also now been sensitivity tested for comparison to the new outfall.

In summary, our approach is conservative and overstates the relative impact of the new WWTP. Much of the small impact shown is due to the allowance for future growth within the catchment for the new outfall case, rather than the WWTP or outfall design itself. **When future growth is also considered in the model for the existing outfall, the new outfall shows no detrimental impact on flood risk.**

### 3. Scope

The scope provided for this work in the Project Brief is:

*“Carry out hydraulic modelling of the River Cam to determine the baseline flows and water levels along the river. Modelling is also required across a range of return periods to determine the impact on water levels, flows, etc. and determine the likely impacts from flooding along the watercourse.*

*It is understood that, based on the location of the outfall and the surrounding area, the design flood standard should be 1 in 100 years (typical design standard for “Built-up Areas”) in Table 10.1/pg133 of CIRIA 786 (Culvert, Screen and Outfall Manual, 2019).*

*The model should include appropriate allowances for the potential effects of climate change.*

*The model of the River Cam is required (based on the EA ISIS data and Lidar sets) to assist with the design development of the proposed outfall for the new Cambridge Waste Water Treatment Plant at the location shown on Drawing No. 00000-100006-CAMEST-FED-GAR-C-3110. The modelling is to assess the impact of discharging Final Effluent and Storm Flows from the proposed outfall.”*

### 4. Environment Agency January 2024 review

A previous version of this report and the associated model (P03) were reviewed by the Environment Agency in January 2024. The Environment Agency review proposed as a way forward:

*“We consider that either another baseline scenario should be run with predicted future growth included or another post-development scenario should be run without planned future growth included. This would allow the baseline and post-development results to be directly compared and would allow the impact of the new WWTP and outfall on local flood risk to be determined. If possible, existing discharges from the Waterbeach outfall should be included in the baseline scenario.”*

As described in Section 2.3, we have taken the first option – an additional baseline scenario representing the existing WWTP and outfall with future growth in the catchment included. As requested, discharges from the Waterbeach outfall are also now included for the two baseline scenarios (in earlier versions the Waterbeach discharge was not represented for the Existing case). This additional sensitivity test helps to understand what impact the future growth in the catchment has on the assessment of the proposed new outfall. As such, the report now (P04 onwards) includes this additional sensitivity testing by comparing the new outfall to the existing outfall **with** the inclusion of future growth in the catchment, along with the previous results comparisons. The additional scenario is referred to as the ‘Existing Future’ case below.

## 5. Implementation

### 5.1 Overview

The modelling assessment for the new outfall was conducted in two stages:

1. Calculate flows from the WWTP for the Existing, Existing Future, and New Outfall cases using the ‘sewer model’.
2. Implement these outfall flows in the ‘river model’ to assess the impact on flood risk.

### 5.2 2023 Cam Urban model

We were provided the 2023 Cam Urban Flood Modeller–Tuflow model (‘the river model’) by the Environment Agency. This model supersedes the 2011 Cam Phase 2 – Cam Urban model that was used as part of the first version of this report. The 2023 Cam Urban model was finalised by the Environment Agency in September 2023 so represents the latest understanding of flood risk in the study area.

On receipt we (Binnies) reviewed the model’s suitability for the purposes of the project scope. The full details of the river model review are provided in Appendix A; however, the following summarises the conclusion of the model review:

- (a) **Type** – The model is a linked one-dimensional (1D) – two-dimensional (2D) Flood Modeller-Tuflow hydraulic model of the River Cam and its floodplain through Cambridge, from Sawston to its confluence with the Great Ouse. This choice of software and model extent is suitable for the project scope.
- (b) **Survey** – The model employs more recent channel topographic survey collected in 2018 of the River Cam, from Haxton to Baits Bite Lock. This survey is only 5 years old and there is confidence that it is still representative of the River Cam.
- (c) **Software** – The model used the latest available version of the software at the time of production, which were:
  - (i) Flood Modeller (FM) version 5.0; and
  - (ii) Tuflow version 2020-10-AD-iSP-w64.

These versions of the software are now superseded by more recent releases, although for this study Flood Modeller 6.1 and TUFLOW 2020-10-AD-iSP-w64 were used to run the model due to compatibility issues linking Flood Modeller 6.1 to the latest version of TUFLOW (2023-03-AB). However, upgrading the software to the latest versions is very unlikely to have a significant impact on the model results.

- (d) **Hydrology** – the model employs updated hydrological inflows for the River Cam and its tributaries which are the product of rating reviews of the gauging stations in the catchment (Dernford, Stapleford, and Burnt Mill) and fresh Flood Estimation Handbook

(FEH) calculations. The final choice of model inflows uses the FEH Statistical method combined with ReFH2 hydrographs. The FEH calculation record was reviewed as part of this study. The approach used follows industry standard methods and is appropriate for this study. We were able to closely reproduce the derived model inflows by repeating the calculations with the input data contained in the calculation record.

- (e) **Storm duration** – the storm duration used for the design flood simulations is 55 hours. This was assessed to be the critical storm duration for the River Cam in Cambridge. However, this duration is significantly longer than the critical storm duration for the proposed outfall (4 hours) and therefore additional hydrological calculations will be necessary to obtain compatible River Cam flows for a 4-hour storm.
- (f) **Climate Change** – the model has been simulated using the latest Environment Agency climate change allowances; these are 9%, 19%, and 45% increases to peak flow, which represent the Central, Higher Central, and Upper estimates for the 2080s.
- (g) **Model Health** – the model is generally stable with only short occurrences of non-convergence that are unlikely to affect the results. The model reports unsatisfactory mass balance which the developers attribute to incorrect simulation monitoring rather than an inherent numerical or physical issue with the model. The model convergence and mass balance for the updated existing and new outfall scenarios have been reviewed and are also stable and satisfactory.

### 5.3 Cambridge sewer model

A model of the sewer catchment which drains to the existing WWTP was provided by Anglian Water ('the sewer model', "CAMBSC\_Master\_ICM\_9.0"). As part of the work to design the new treatment plant the sewer model was verified to information recorded during 2019. The level of verification was discussed with Anglian Water and it was agreed that it represents the most up to date representation of the sewer system which drains to the existing WWTP. The sewer model was built within InfoWorks ICM (version 9) which is the industry standard for undertaking network modelling to understand the operation of a sewer system.

A modified version of the sewer model was first used to test and size the proposed new tunnel from the existing treatment plant to the new site to ensure that there was no impact on the flooding in the upstream system. The model was also used to calculate the operation of the new pumping station to empty the tunnel ensuring that the levels through the upstream catchment were not increased. Table 5-1 shows the proposed pump rates and start / stop levels used within the model. The model was then further modified to include the new WWTP itself and calculate the outfall flows.

Figure 5-1 compares the sewer model outfall hydrographs for the 55-hour storm case between the Existing, Existing Future, and New Outfall scenarios. The two stages of the new works, Phase 1 and Phase 2, for the New Outfall scenario have been separated here to show the similarity between phasing – where the noticeable difference is the increase in flow to full treatment (FFT) from 1.79 to 1.84m<sup>3</sup>/s, respectively. Throughout this report 'New Outfall' is used to refer to Phase 2 of the new works, unless explicitly stated as 'New Outfall Phase 1'.

A separate Anglian Water InfoWorks ICM sewer model ("WATBSC\_Master\_ICM\_9.0") was used to derive the Waterbeach outfall discharges to be used in the Existing and Existing Future sensitivity scenarios. There is no Waterbeach discharge for the New Outfall scenario as the flows from Waterbeach will be diverted to the new WWTP, the existing Waterbeach outfall will cease to operate and the Waterbeach runoff is accounted for within the New Outfall sewer model

Table 5-1 – Proposed pump operation at the new WWTP

	Pump rates, start and stop level to utilise the tunnel									
	CBARSM.1	CBARSM.2	CBARSM.3	CBARSM.4	CBARSM.5	CBARSM.6	CBARSM.7	CBARSM.8	CBARSM.9	CBARSM.A
	FFT				STORM					
<b>On Level (mAOD)</b>	-13.64	-13.44	-13.24	-13.22	-11.7	-11.6	-11.3	-11.3	-11	-10.7
<b>Off Level (mAOD)</b>	-13.94	-13.94	-13.64	-13.52	-12	-12	-11.6	-11.6	-11.3	-11
<b>Pump Rate (m<sup>3</sup>/s)</b>	0.49	0.49	0.49	0.49	1.08	1.08	1.08	1.08	0.26	0.53

The sewer model results were converted to inflow timeseries in a spreadsheet to be applied to the river model for the WWTP outfall flows as follows:

- Existing and Existing Future outfalls:
  - Taking the sum of the flows from three sewer model conduit units – “Flow\_to\_Treatment”, “TL47616700.1” and “outfall1.1”. These units represent the treated flow from the existing plant and discharge from the existing lagoon respectively.
- New outfall:
  - Taking the sum of the flows from two sewer model conduit units – “Orifice Inlet\_3.1” and “Conduit ST1-MH4.1”.

An example for the 1 in 100 year 55-hour storm is shown in Figure 5-1.

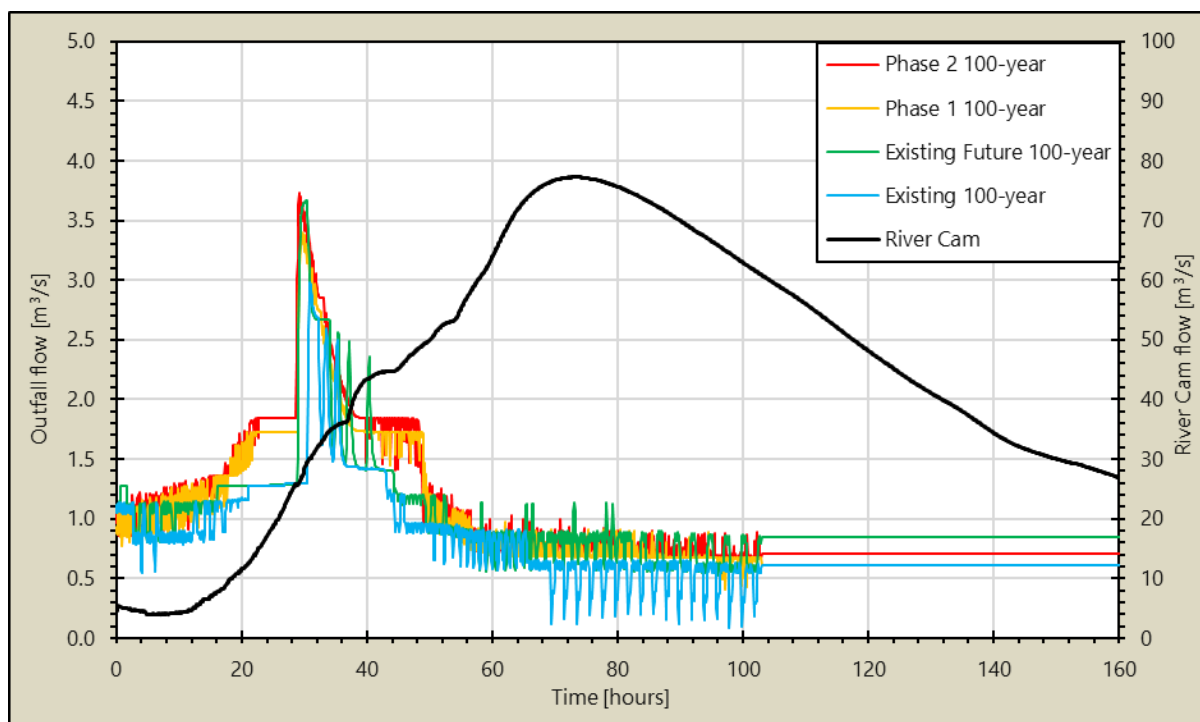


Figure 5-1. Example of new outfall discharge – 1 in 100 year, 55-hour storm

Table 5-2 compares the peak outfall flows as applied in the river model for the Existing outfall, the Existing Future, and New Outfall cases. It should be noted that in the New Outfall case the Cambridge WWTP would also receive flows from the Waterbeach catchment which are accounted for in the peak flows for this case in Table 5-2.

The peak flows in Table 5-2 shows that:

- Allowing for future growth in the catchment considerably increases the flows through the existing Cambridge WWTP outfall. This future growth accounts for much of the difference between the existing (no future growth in catchment) and new outfall (including growth in catchment) peak flows.
- It should be noted that the new outfall case includes a future growth design allowance of 5m<sup>2</sup> per dwelling of misconnected surface area to the foul system, in accordance with Anglian Water’ design standards for sewer modelling. This allowance is applied to ensure the design of the new works could accommodate incorrectly connected areas should this occur over time. However, Anglian Water are not responsible for preventing such connections from happening although flows derived from such areas are included for consistency between the sewer modelling (also used for storm water management design) and the river modelling.
- The peak Waterbeach outfall discharge is 0.2m<sup>3</sup>/s across the whole range of flood magnitudes and durations.

There is not a direct relationship between changes in peak outfall flow to changes in peak flows in the River Cam as the peaks do not coincide. The river model considers the whole hydrograph shape so accounts for this in the results within section 6.

Table 5-2. Peak outfall flows used in the river model

Case	Peak flow [m <sup>3</sup> /s]										
	1 in 2	1 in 10	1 in 20	1 in 30	1 in 50	1 in 75	1 in 100	1 in 200	1 in 1000	1 in 100 (CC20)	1 in 100 (CC40)
<b>Existing outfall – existing Cambridge WWTP</b>											
4-hour storm	2.4	2.8	2.9	3.2	3.7	3.9	4.0	4.1	4.1	4.1	4.1
55-hour storm	1.3	1.3	1.3	1.3	2.5	2.7	3.0	3.7	4.1	3.7	4.1
<b>Existing outfall (Future Growth) – existing Cambridge WWTP</b>											
4-hour storm	2.4	2.7	2.9	3.2	3.6	3.8	4.0	4.1	4.1	4.1	4.1
55-hour storm	1.3	1.3	2.4	2.7	3.0	3.6	3.7	3.7	4.1	4.1	4.1
<b>Existing Waterbeach outfall (Existing / Future Growth) – existing Waterbeach outfall</b>											
4-hour storm	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
55-hour storm	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
<b>New Outfall – new Cambridge WWTP</b>											
4-hour storm	2.8	4.8	5.0	5.5	5.7	5.8	5.8	5.9	5.9	5.9	5.9
55-hour storm	1.8	1.8	2.4	2.8	3.2	3.5	3.7	4.2	4.9	4.3	4.8

### 5.4 Modifications to the river model

No changes have been made to the 2023 Cam Urban river model except:

- Adding inflow locations for the existing and new WWTP outfall discharges, which were not represented explicitly in the 2023 Cam Urban model provided (see Figure 5-2).
  - Existing WWTP outfall – immediately upstream of the A14 bridge, left bank.
  - New WWTP outfall – immediately downstream of the A14 bridge right bank.
- For the Existing and Existing Future scenarios: adding the outfall at Waterbeach (around 4km downstream of the site), which currently discharges but will cease when the new WWTP is in place.

Note that the 'existing WWTP outfall' refers only to the existing outfall at Milton. There is also the Riverside CSO (Combined Sewer Overflow), upstream within Cambridge itself. We were informed by the project team that this CSO "never flows". This has not been added to the river model.

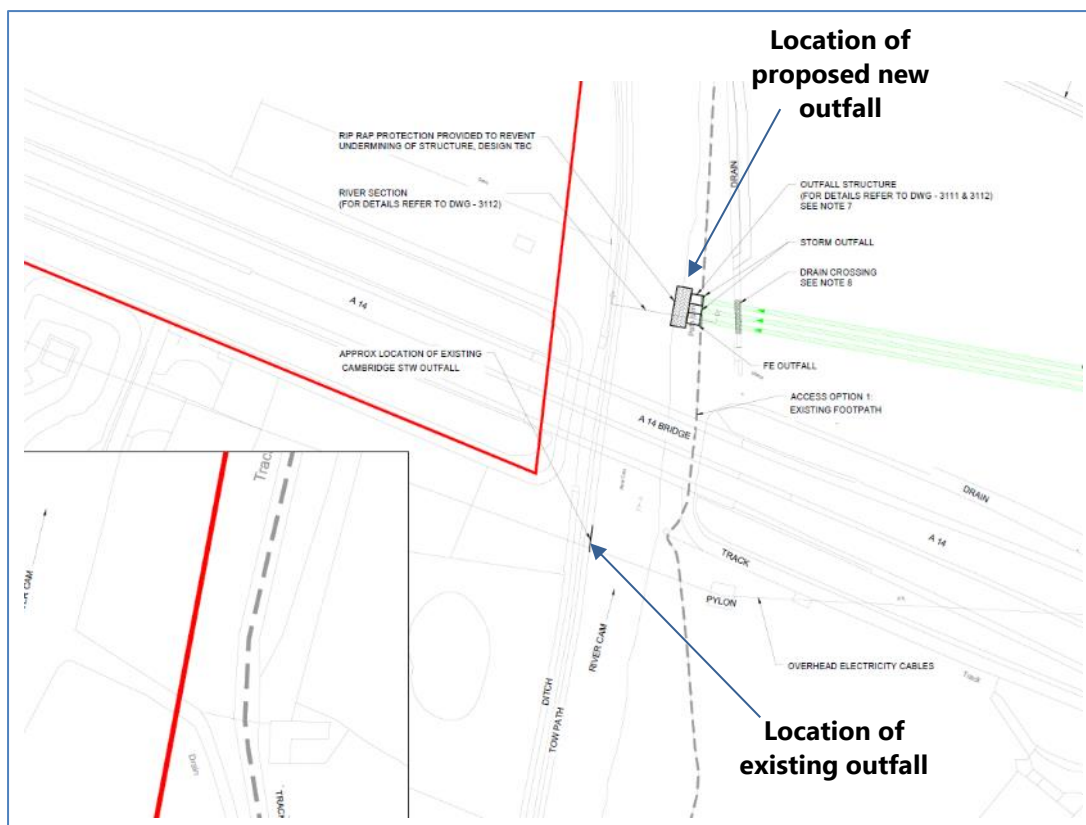


Figure 5-2. Locations of existing and new outfall (drawing 00000-100006-CAMEST-FED-GAR-C-3110)

## 5.5 River model inflows

### (a) Storm duration

The critical storm duration used in the Cam Urban river model is 55 hours. This was selected by JBA in their hydrological analysis considering the catchment area and other descriptors, the duration recommended for the whole catchments within the ReFH2 software, the permeability of the catchment, and comparisons to observed data. This is similar to the 61-hour storm duration used in the previous 2011 Cam Urban model. This approach is reasonable and is a duration expected for a catchment of this size.

We have retained the 55-hour storm as the critical case for flooding from the River Cam. However, the critical case for the treatment plant is the 4-hour storm. To examine the sensitivity of the results to storm duration we have tested both cases.

### (b) 55-hour storm duration

Design floods were implemented by JBA in the River Cam model as 20 inflows representing a 55-hour storm over the whole 1076km<sup>2</sup> River Cam catchment.

Inflow files were provided for the 1 in 2, 10, 20, 30, 50, 75, 100, 200 and 1000 year floods, along with the 1 in 100 year flood plus climate change for 9%, 19%, and 45% uplifts. Details of these fluvial inflows are provided in Table 5-3 for the 1 in 100 year plus climate change (9% uplift)

flood and their locations are shown in Figure 5-3. Peak inflows for the remaining flood magnitudes (present day) are shown in Table 5-4.

### (c) 4-hour storm duration

Alternative peak inflows for the 1 in 100 year, and 1 in 100 year plus climate change (9%, 19% and 45% uplift) floods were calculated as part of this study. Peak flows for the 4-hour 1 in 100 year plus 9% climate change uplift are shown in Table 5-3, alongside the 55-hour storm values.

The 55-hour storm inflows are implemented in the 2023 Cam Urban model boundary files (\*.IED) as flow-time (QT) units as, presumably, the calculations were done by JBA directly using the ReFH2 software rather than within Flood Modeller. This meant that it was not completely straightforward to test alternative storm durations. The approach used to generate 4-hour fluvial inflows was:

- Recreate the default ReFH2 model inflows for the 55-hour storm, using the catchment descriptors given in JBA's Cam Flood Estimation Report. These were checked against JBA's reported results and almost identical results were achieved.
- Calculate and apply scaling factors to the ReFH2 hydrograph to give the FEH statistical flood peak required for each model inflow. Again, these were checked against the actual model inflows and a very close match was achieved.
- Generate ReFH2 model inflow for a 4-hour storm.
- Apply the same scaling factors to the 4-hour storm inflows, as for the 55-hour storm and use these inflows in the model.

The flows in Table 5-3 show that:

- The 55-hour storm gives noticeably higher peak inflows for the larger sub-catchments, such as the upstream Cam, Granta, Rhee, Bourn Brook and Fidwell Fen. This is as expected. These sub-catchments comprise a large proportion of the total model inflow.
- The 4-hour storm gives higher inflows for the smaller sub-catchments, such as the lateral inflows, Coldham's Brook, Bin Brook and Hobson's Brook. Again, this is as expected as a shorter storm duration will be critical for smaller catchments.
- Overall, the 55-hour storm will give higher river flows and flood levels than the 4-hour storm.



Table 5-3. Fluvial flood inflows within river model (1 in 100 year plus 9% climate change)

Model inflow name	Description	Catchment area (km <sup>2</sup> )	1 in 100 year plus 9% CC peak flow (m <sup>3</sup> /s)	
			55 hour storm	4 hour storm
CAM_01	River Cam at Sawston	197.1	31.9	18.5
CAM_02*	Lateral to Byron's Pool	11.8	0.0	0.0
CAM_03*	Lateral to M11 bridge	4.9	0.0	0.0
CAM_04*	Lateral to Bourn Brook inflow	5.8	0.0	0.0
CAM_06	Lateral to Hobson's Brook	6.0	0.9	1.2
CAM_08	Lateral to Elizabeth Way bridge	5.4	2.2	4.2
CAM_09	Lateral to Coldham's Brook	3.1	1.4	2.6
CAM_10	Lateral to Baits Bite Lock	8.9	2.5	3.4
CAM_11	Lateral to Swaffham Lodge	7.4	1.5	1.9
CAM_13	Lateral to Great Ouse	8.3	1.6	2.0
COLDH_01	Coldham's Brook	10.9	1.6	2.1
GRNT_01	River Granta	111.3	14.6	8.4
RHEE_01	River Rhee	307.9	26.9	14.5
BIN_05	Bin Brook	17.2	8.3	11.2
BOUR_01	Bourn Brook	86.2	26.1	21.3
FID_FEN	Fidwell Fen	19.5	6.1	4.1
HOBS_03	Hobson's Brook	12.0	1.3	4.1
Bottisham_PS	Pumped inflow Bottisham Lode	-	2.5	2.5
Swaffham_PS	Pumped inflow Swaffham Lode	-	1.7	1.7
Upware_PS	Pumped inflow Reach Lode	-	2.5	2.5

\*Note: CAM\_02, CAM\_03 and CAM\_04 lateral inflows scaled to zero by JBA, as described in their reporting. This approach was retained.

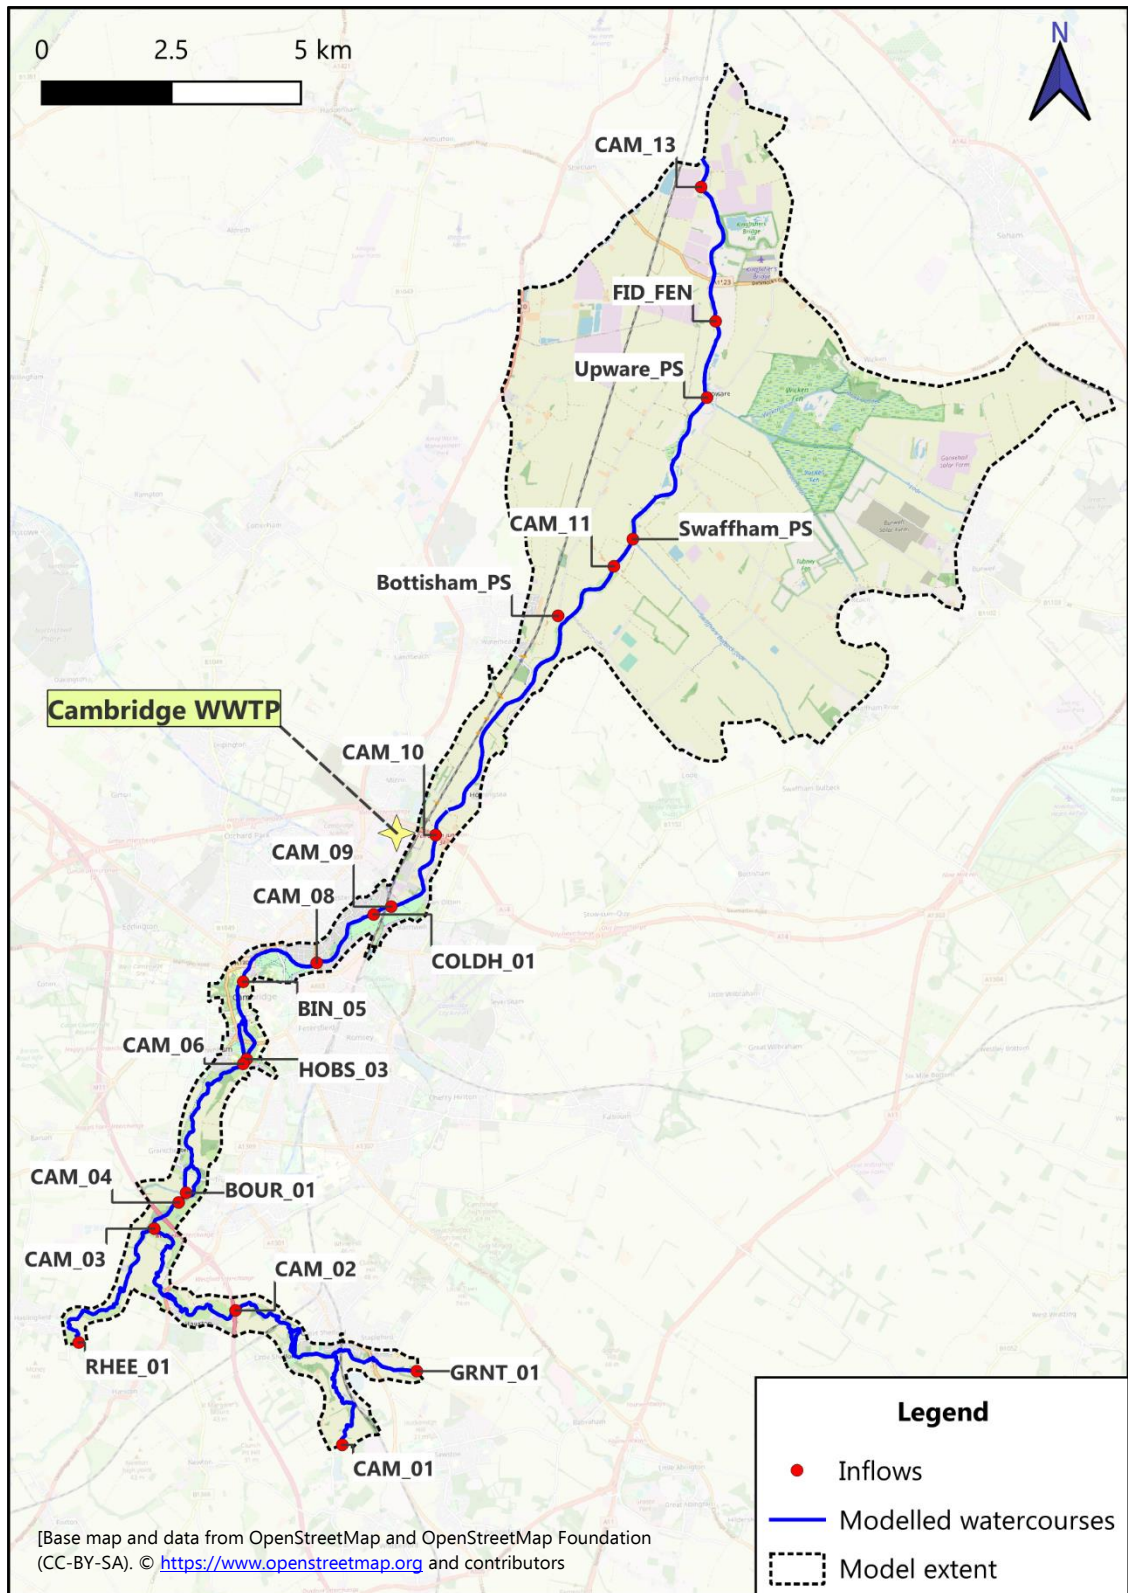


Figure 5-3. Location of inflow nodes from the model

Table 5-4. Fluvial flood inflows within river model 55-hour storm (other flood magnitudes)

Model inflow name	Peak flow [m <sup>3</sup> /s]								
	1 in 2	1 in 10	1 in 20	1 in 30	1 in 50	1 in 75	1 in 100	1 in 200	1 in 1000
CAM_01	7.6	14.1	19.1	20.9	23.3	27.2	29.3	34.0	57.5
CAM_02	0.0	0.0	0.6	0.7	0.0	0.0	0.0	0.0	0.0
CAM_03	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
CAM_04	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
CAM_06	0.3	0.5	0.6	0.6	0.7	0.8	0.8	1.0	1.5
CAM_08	0.8	1.3	1.4	1.6	1.7	1.9	2.0	2.4	3.5
CAM_09	0.5	0.8	0.9	1.0	1.1	1.2	1.3	1.6	2.3
CAM_10	0.8	1.3	1.6	1.7	1.9	2.1	2.3	2.8	4.2
CAM_11	0.5	0.8	1.0	1.1	1.2	1.3	1.4	1.7	2.5
CAM_13	0.5	0.9	1.0	1.1	1.3	1.4	1.5	1.8	2.7
COLDH_01	0.5	0.9	1.0	1.1	1.3	1.4	1.5	1.8	2.5
GRNT_01	4.6	7.8	9.1	10.0	11.3	12.5	13.4	16.3	25.4
RHEE_01	8.5	14.2	16.6	18.3	20.6	22.8	24.6	30.3	47.3
BIN_05	2.9	4.6	5.4	5.9	6.5	7.1	7.6	8.9	12.3
BOUR_01	9.5	14.6	16.9	18.4	20.5	22.4	23.9	28.2	39.4
FID_FEN	2.0	3.2	3.8	4.2	4.7	5.2	5.6	6.5	8.7
HOBS_03	0.4	0.7	0.8	0.9	1.0	1.1	1.2	1.4	2.1
Bottisham_PS	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5
Swaffham_PS	1.7	1.7	1.7	1.7	1.7	1.7	1.7	1.7	1.7
Upware_PS	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5

## 5.6 Climate change

The scope requires that the model should include appropriate allowances for the potential effects of climate change. In the 2023 Cam Urban river model, the 100-year plus climate change flood has been simulated for a range of uplifts (9%, 19%, and 45%). These uplifts correspond to the 2080s epoch in the EA's latest climate change allowances (released in July 2021<sup>3</sup>). Table 5-5 shows the values for the River Cam catchment.

<sup>3</sup> <https://www.gov.uk/guidance/flood-risk-assessments-climate-change-allowances>

We have retained these river flow climate change allowances in our model runs. However, it should be stressed that the climate change allowance in focus is the 9% uplift, as reported for the flows in Table 5-3 and Table 5-4.

Climate change was applied in the Cambridge and Waterbeach sewer models using uplifts to the storm rainfall, rather than to runoff. The sewer models were run for the 100-year flood with two climate change cases – 20% and 40% increases to rainfall. This corresponds to the 2050s epoch in the EA climate change guidance (Table 5-6).

There is not a direct link between the river flow and rainfall climate change guidance, due to different epochs and named allowances being used. Acknowledging the mismatch in epochs, we elected to retain the same climate change factors for consistency with other work and used the following combinations:

- 9% uplift for river flows with 20% uplift in rainfall for outfall flows;
- 19% uplift for river flows with 20% uplift in rainfall for outfall flows; and
- 45% uplift for river flows with 40% uplift in rainfall for outfall flows.

*Table 5-5. Climate change allowances for river flows in the Cam and Ely Ouse Management Catchment*

Epoch	Central	Higher Central	Upper
2020s	2%	7%	21%
2050s	-2%	5%	22%
2080s	<b>9%</b>	<b>19%</b>	<b>45%</b>

*Table 5-6. Climate change allowances for rainfall in the 100-year event in the Cam and Ely Ouse Management Catchment*

Epoch	Central	Upper End
2050s	<b>20%</b>	<b>40%</b>
2070s	25%	<b>40%</b>

## 5.7 Model scenarios

The scenarios that were simulated are listed in Table 5-7. As noted above, initially for the first version of this report only the 1 in 100 year plus climate change case was tested (run 11). However, at the project team’s request, this was then expanded to include a range of other

flood magnitudes as shown in the table. Runs 35-51 have also been included in version P04 onwards of this report to consider future growth in the catchment for the existing works ('Existing Future'), while runs and 52-53 have been included to demonstrate the potential impact for Phase 1 of the New Outfall.

Table 5-7. Modelling scenarios

Run no.	Scenario	Flood magnitude (fluvial and outfall flow)	Storm duration (hours)
1	Existing Outfall	1 in 2	55
2	Existing Outfall	1 in 5	55
3	Existing Outfall	1 in 10	55
4	Existing Outfall	1 in 20	55
5	Existing Outfall	1 in 30	55
6	Existing Outfall	1 in 50	55
7	Existing Outfall	1 in 75	55
8	Existing Outfall	1 in 100	55
9	Existing Outfall	1 in 200	55
10	Existing Outfall	1 in 1000	55
11	Existing Outfall	1 in 100 +9% climate change	55
12	Existing Outfall	1 in 100 +19% climate change	55
13	Existing Outfall	1 in 100 +45% climate change	55
14	Existing Outfall (Sensitivity)	1 in 100	4
15	Existing Outfall (Sensitivity)	1 in 100 +9% climate change	4
16	Existing Outfall (Sensitivity)	1 in 100 +19% climate change	4
17	Existing Outfall (Sensitivity)	1 in 100 +45% climate change	4
18	New Outfall	1 in 2	55
19	New Outfall	1 in 5	55
20	New Outfall	1 in 10	55
21	New Outfall	1 in 20	55
22	New Outfall	1 in 30	55
23	New Outfall	1 in 50	55
24	New Outfall	1 in 75	55
25	New Outfall	1 in 100	55
26	New Outfall	1 in 200	55
27	New Outfall	1 in 1000	55
28	New Outfall	1 in 100 +9% climate change	55
29	New Outfall	1 in 100 +19% climate change	55

Run no.	Scenario	Flood magnitude (fluvial and outfall flow)	Storm duration (hours)
30	New Outfall	1 in 100 +45% climate change	55
31	New Outfall (Sensitivity)	1 in 100	4
32	New Outfall (Sensitivity)	1 in 100 +9% climate change	4
33	New Outfall (Sensitivity)	1 in 100 +19% climate change	4
34	New Outfall (Sensitivity)	1 in 100 +45% climate change	4
35	Existing Future	1 in 2	55
36	Existing Future	1 in 5	55
37	Existing Future	1 in 10	55
38	Existing Future	1 in 20	55
39	Existing Future	1 in 30	55
40	Existing Future	1 in 50	55
41	Existing Future	1 in 75	55
42	Existing Future	1 in 100	55
43	Existing Future	1 in 200	55
44	Existing Future	1 in 1000	55
45	Existing Future	1 in 100 +9% climate change	55
46	Existing Future	1 in 100 +19% climate change	55
47	Existing Future	1 in 100 +45% climate change	55
48	Existing Future	1 in 100	4
49	Existing Future	1 in 100 +9% climate change	4
50	Existing Future	1 in 100 +19% climate change	4
51	Existing Future	1 in 100 +45% climate change	4
<b>52</b>	New Outfall Phase 1	1 in 75	55
<b>53</b>	New Outfall Phase 1	1 in 100	55

## 6. Model results

### 6.1 General

The river modelling results are presented as:

- Tables of peak water levels and flows (Table 6-1 to Table 6-6; Appendix B and Appendix E) in the River Cam. Note that the flows are based on the 1D FM results only so do not include bypassing alongside the river in the floodplain. The node locations for these comparison points (shown in Figure 6-1) have been selected at identifiable points of interest (as described in the first column in Table 6-1) to assist in comprehension.
- Flood extent and depth difference maps (Figure 6-2 to Figure 6-7; Appendices C, D, F, and G).
  - These maps simultaneously show the change in flood extents and maximum water depth for the same flood magnitude between the Existing / Existing Future and New Outfall model scenarios.
  - The Existing (and Existing Future) flood extent (black-outlined polygon) is compared to additional areas that flood in the New Outfall case ('Now Flooded' pink-outlined polygon).
  - Areas within the Existing (and Existing Future) flood extent where depths change by less than 0.01m are defined as 'No Change' areas and are denoted by the blue shaded polygon.
  - Changes in maximum flood depth were calculated by subtracting the New Outfall water depth results from the Existing (and the Existing Future) results, such that positive values represent an increase in depth for the New Outfall scenario.
  - The additional flooded areas where depths are less than 0.01m **are** included inside the 'Now Flooded' pink polygon.

### 6.2 Existing outfall (no growth) compared to New Outfall (with growth) – 55-hour storm

This base case compares results between the Existing (no growth) and the New Outfall (with growth) scenarios for the 55 hour storm (the design storm). A comparison of results for the 1 in 100 year present day and 1 in 100 year plus 9% climate change floods are shown in Table 6-1, Table 6-2, Figure 6-2 and Figure 6-3 (Appendix B and Appendix C provide the results tables and flood maps for other flood magnitudes). These results indicate that:

- The new WWTP lies well outside the River Cam flood extents.
- There is almost no change in peak water levels or flows in the River Cam for the New Outfall case compared to Existing.
- The maximum predicted increase in peak in-channel water level is 0.002m (2mm) at Baits Bite Lock.

- There is no change in flood depths throughout Cambridge (upstream of the A14 / the WWTP outfalls).
- There are some changes in flood depths and extents in the downstream floodplain. Flood depths increase further downstream of the outfall for locations near Waterbeach and beyond:
  - For the majority of the inundated area, there is no change in flood depth (blue shading in Figure 6-2 and Figure 6-3).
  - There are areas where depths increase by a small amount (up to 0.10m – red shading in the figures). There are also small areas where flooding is predicted to occur in the New Outfall scenario that is not predicted in the Existing (no growth) scenario. This leads to larger depth changes as the differences are between initial flooding and zero depth. These areas are predicted to flood due to the floodwater spreading further in the floodplain. **These flooding changes are a consequence of the larger flood volume in the New Outfall scenario compared to the no future growth Existing scenario. This is directly caused by allowing for future growth in the New Outfall scenario since the new outfall and WWTP will not increase flood volume themselves.** In any case, the affected areas are generally low impact farmland, except for a few properties near to Bottisham Lock.
- The changes in in-channel peak flow are 0.1m<sup>3</sup>/s or smaller (which is a very small proportion of the total flow in the River Cam, which is generally 70-90m<sup>3</sup>/s). This is because the peak WWTP discharge occurs well before the river peak flow.

Note that, with changes this small, to some extent they may be due to minor differences in the iterative numerical solution produced by FM-Tuflow rather than genuine physically based differences. For example, the water level convergence tolerance for each model iteration is 0.01m. Normally we would only present water level results to two decimal places (to the nearest centimetre), reflecting the accuracy possible with a hydraulic model of this type. But in this case, as the differences are so small, we have shown three decimal places to avoid rounding effects. This could create a misleading impression of the accuracy of the model predictions. For comparison, the 2023 Cam Urban peak river level calibration tolerance target was  $\pm 0.15\text{m}$ .



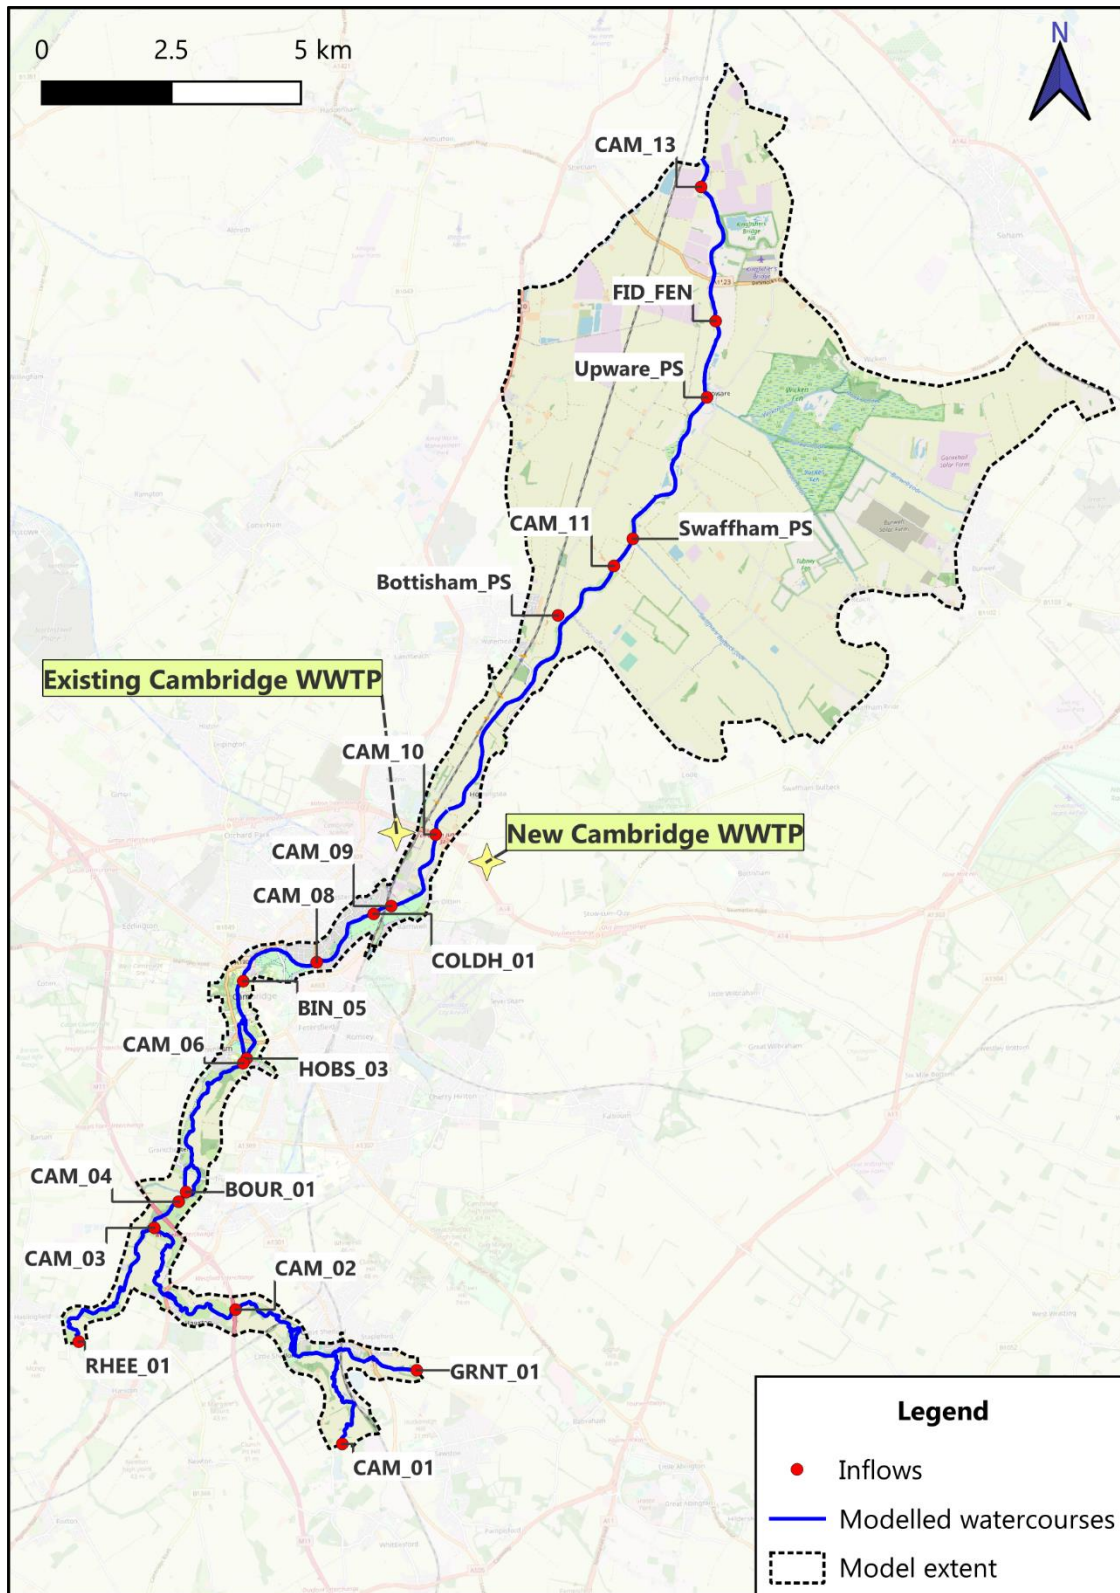


Figure 6-1 1D model nodes where results are compared (note that this is a reduced selection of the overall 1D model nodes)

Table 6-1 Base case – 1 in 100 year, 55-hour storm 1D model results

Location	Node	Existing outfall (no growth)	New outfall (with growth)	Increase
		<b>Peak water level (mAOD)</b>		<b>Level (m)</b>
M11	CAM01_4253	9.460	9.460	0.000
A1134 Fen Causeway	CAM02_7723d	7.509	7.509	0.000
Silver Street	CAM02_7160	7.397	7.397	0.000
Trinity Bridge	CAM02_6603	7.017	7.017	0.000
Bridge Street	CAM02_6177	6.506	6.506	0.000
Victoria Avenue	CAM02_5371	5.837	5.837	0.000
A1134 Elizabeth Way	CAM02_4494	5.590	5.590	0.000
Railway	CAM02_2638	5.204	5.204	0.000
A14	CAM02_0636	4.641	4.641	0.000
Baits Bite Lock US	CAM02_0200	4.507	4.508	0.001
Baits Bite Lock DS	CAM02_0000	4.299	4.301	0.002
Horningsea	CA14400	4.203	4.204	0.001
Waterbeach	CA12080J	4.104	4.106	0.002
Bottisham Lock US	CA10600J	3.959	3.960	0.001
Bottisham Lock DS	CA10560	3.875	3.876	0.001
Shrubbs Marina	Cam8794	3.774	3.774	0.000
Upware	Cam5007	3.683	3.684	0.001
A1123	Cam2651u	3.623	3.624	0.001
Great Ouse confluence	Cam0000	3.574	3.575	0.001
		<b>Peak flow (m<sup>3</sup>/s)</b>		<b>Flow (m<sup>3</sup>/s)</b>
M11	CAM01_4253	60.9	60.9	0.0
A1134 Fen Causeway	CAM02_7723d	36.5	36.5	0.0
Silver Street	CAM02_7160	65.7	65.8	0.0
Trinity Bridge	CAM02_6603	76.5	76.5	0.0
Bridge Street	CAM02_6177	78.2	78.2	0.0
Victoria Avenue	CAM02_5371	74.2	74.2	0.0
A1134 Elizabeth Way	CAM02_4494	76.7	76.7	0.0
Railway	CAM02_2638	78.7	78.7	0.0
A14	CAM02_0636	77.4	77.3	-0.1
Baits Bite Lock US	CAM02_0200	53.6	53.6	0.0
Baits Bite Lock DS	CAM02_0000	53.6	53.6	0.0
Horningsea	CA14400	40.0	40.0	0.0
Waterbeach	CA12080J	55.1	55.0	-0.1
Bottisham Lock US	CA10600J	70.4	70.5	0.1
Bottisham Lock DS	CA10560	70.4	70.5	0.1
Shrubbs Marina	Cam8794	71.8	71.8	0.0
Upware	Cam5007	70.6	70.6	0.0
A1123	Cam2651u	75.6	75.7	0.1
Great Ouse confluence	Cam0000	65.0	65.0	0.0

Table 6-2. Base case – 1 in 100 year plus 9% climate change, 55-hour storm 1D model results

Location	Node	Existing outfall (no growth)	New outfall (with growth)	Increase
		Peak water level (mAOD)		Level (m)
M11	CAM01_4253	9.557	9.557	0.000
A1134 Fen Causeway	CAM02_7723d	7.779	7.779	0.000
Silver Street	CAM02_7160	7.564	7.564	0.000
Trinity Bridge	CAM02_6603	7.154	7.154	0.000
Bridge Street	CAM02_6177	6.608	6.608	0.000
Victoria Avenue	CAM02_5371	5.913	5.913	0.000
A1134 Elizabeth Way	CAM02_4494	5.657	5.657	0.000
Railway	CAM02_2638	5.265	5.265	0.000
A14	CAM02_0636	4.669	4.669	0.000
Baits Bite Lock US	CAM02_0200	4.539	4.541	0.002
Baits Bite Lock DS	CAM02_0000	4.342	4.343	0.001
Horningsea	CA14400	4.247	4.249	0.002
Waterbeach	CA12080J	4.139	4.141	0.002
Bottisham Lock US	CA10600J	3.987	3.988	0.001
Bottisham Lock DS	CA10560	3.901	3.901	0.000
Shrubbs Marina	Cam8794	3.793	3.794	0.001
Upware	Cam5007	3.698	3.698	0.000
A1123	Cam2651u	3.635	3.635	0.000
Great Ouse confluence	Cam0000	3.585	3.585	0.000
		Peak flow (m <sup>3</sup> /s)		Flow (m <sup>3</sup> /s)
M11	CAM01_4253	65.9	65.9	0.0
A1134 Fen Causeway	CAM02_7723d	41.9	41.9	0.0
Silver Street	CAM02_7160	76.0	76.0	0.0
Trinity Bridge	CAM02_6603	83.2	83.2	0.0
Bridge Street	CAM02_6177	85.1	85.1	0.0
Victoria Avenue	CAM02_5371	76.5	76.5	0.0
A1134 Elizabeth Way	CAM02_4494	82.8	82.8	0.0
Railway	CAM02_2638	85.5	85.5	0.0
A14	CAM02_0636	83.9	83.8	0.0
Baits Bite Lock US	CAM02_0200	54.6	54.6	0.0
Baits Bite Lock DS	CAM02_0000	54.6	54.6	0.0
Horningsea	CA14400	40.2	40.2	0.0
Waterbeach	CA12080J	55.1	55.0	-0.1
Bottisham Lock US	CA10600J	73.4	73.4	0.0
Bottisham Lock DS	CA10560	73.4	73.4	0.0
Shrubbs Marina	Cam8794	74.7	74.6	-0.1
Upware	Cam5007	72.6	72.6	0.0
A1123	Cam2651u	78.0	78.0	0.0
Great Ouse confluence	Cam0000	65.3	65.3	0.0

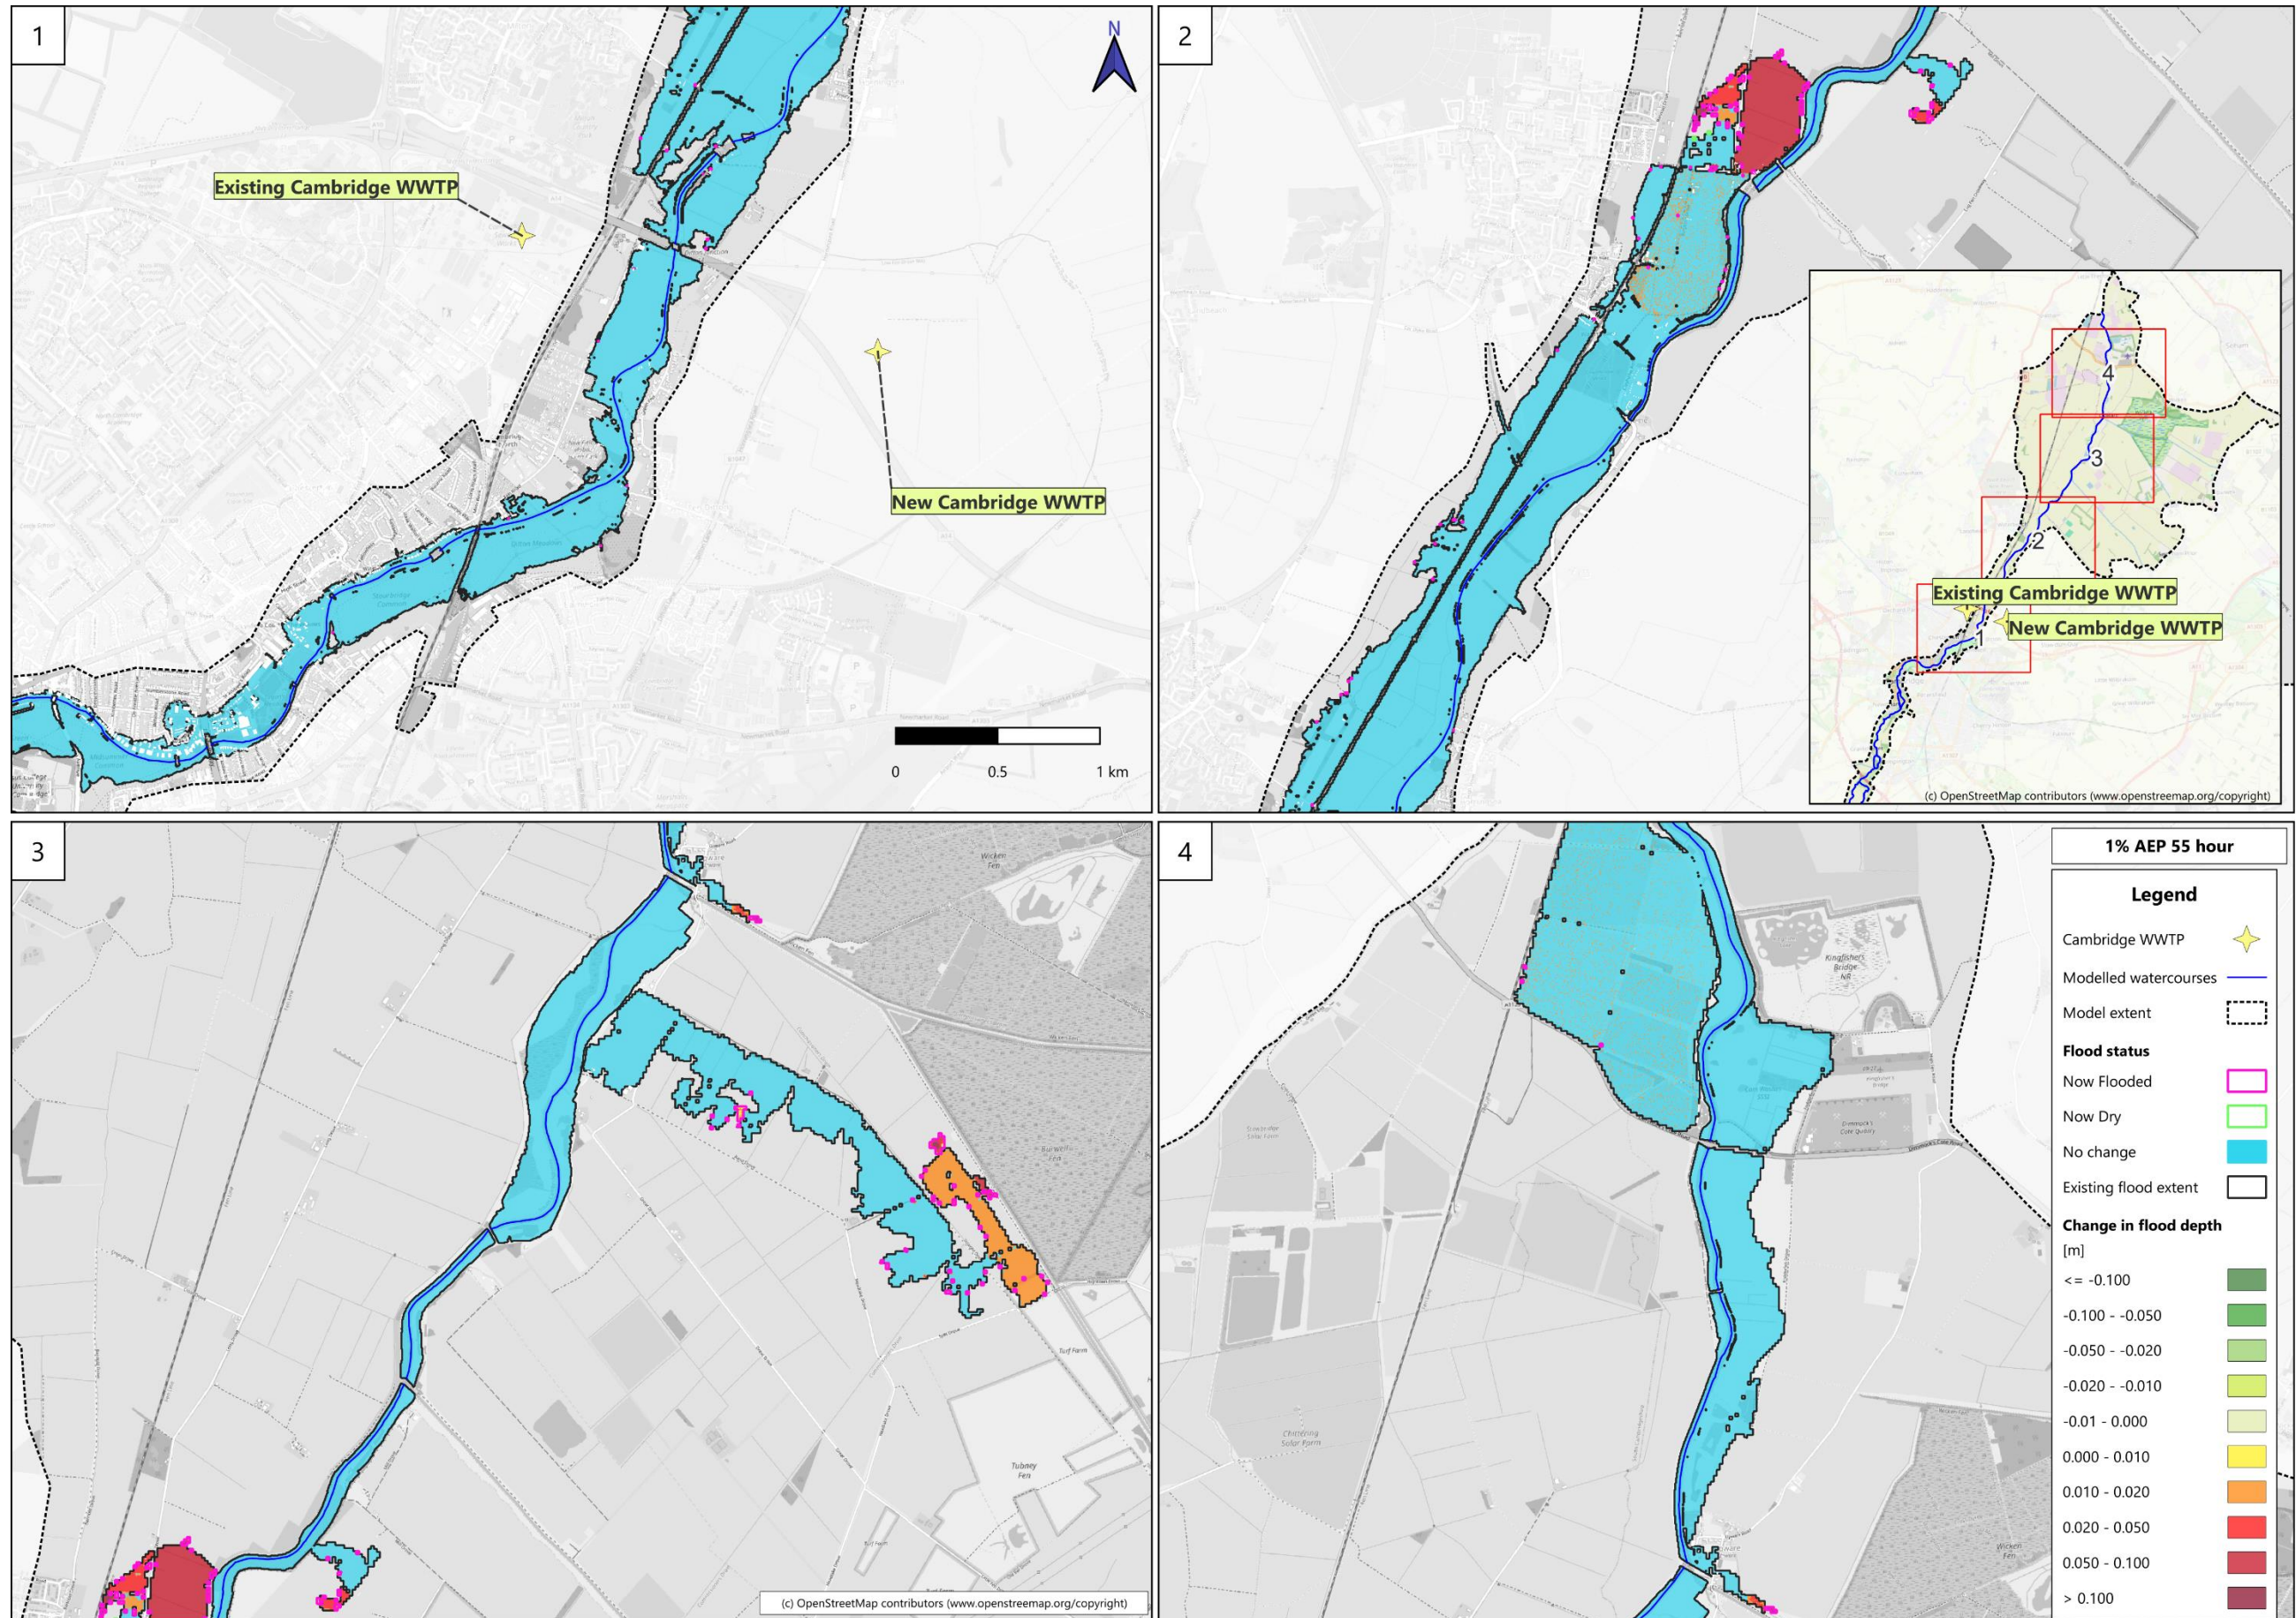


Figure 6-2. Existing (no growth) to New Outfall (with growth) change in flood extent and depth – 1 in 100 year, 55-hour storm

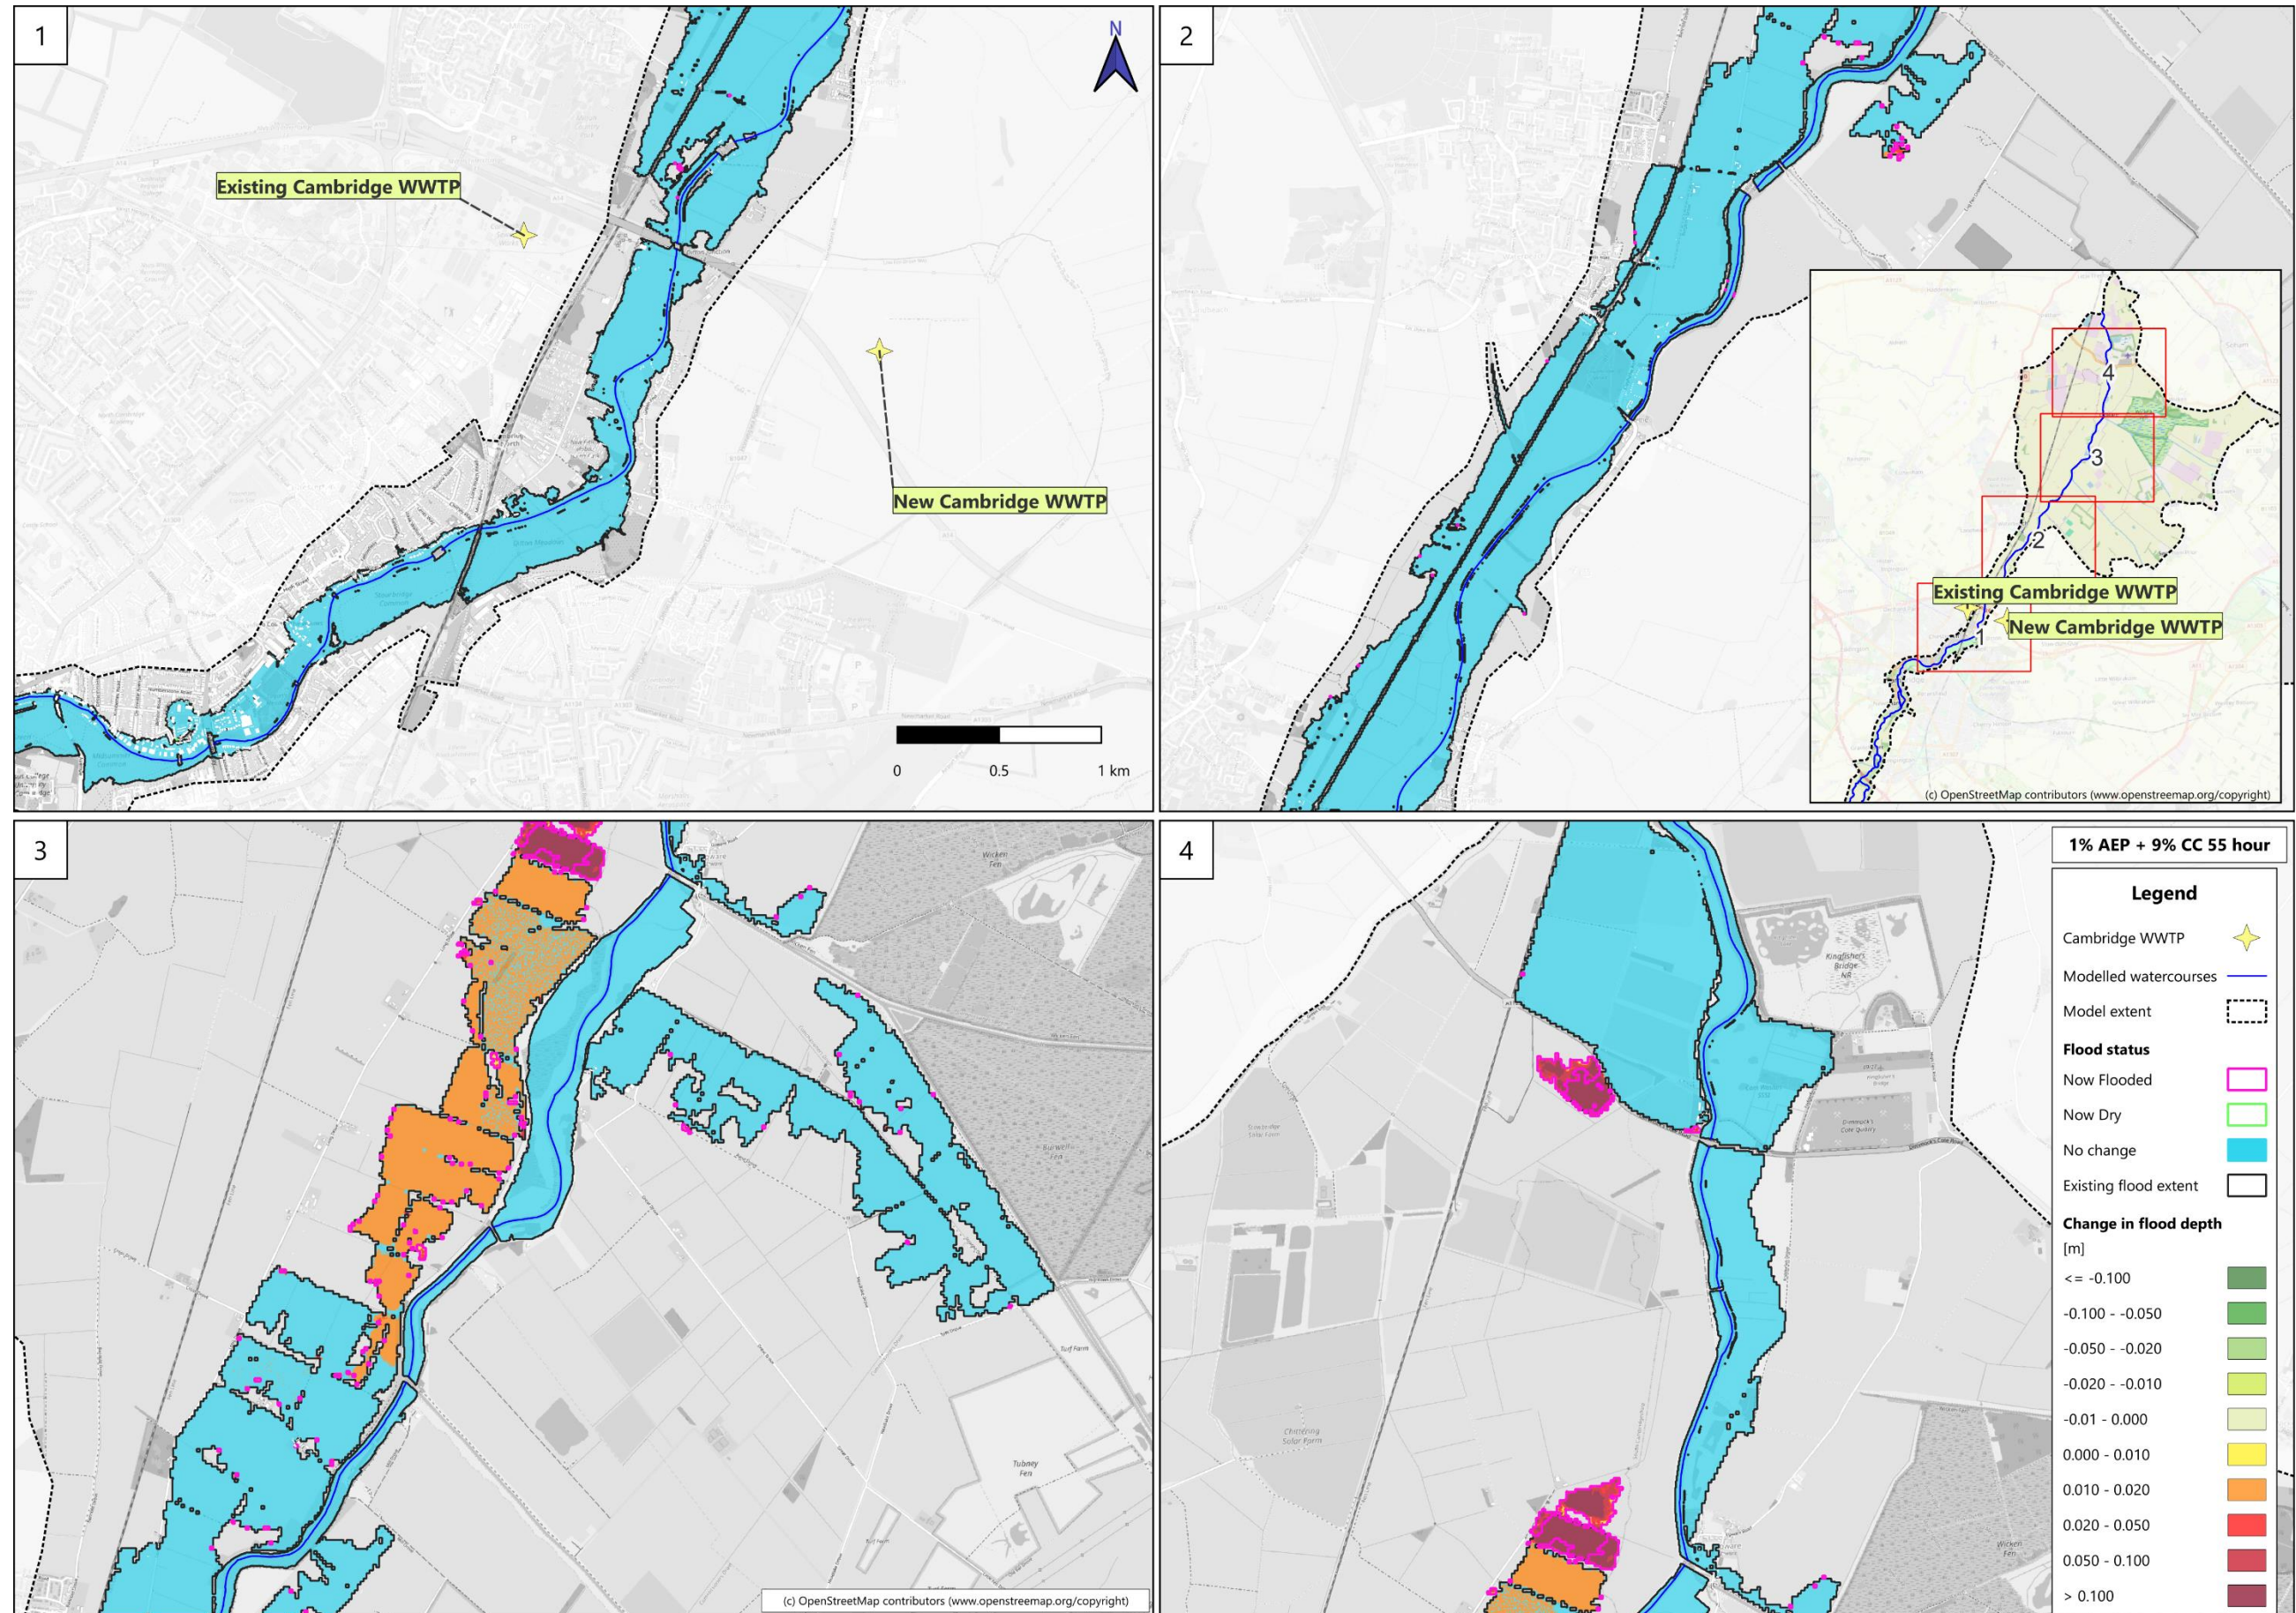


Figure 6-3. Existing (no growth) to New Outfall (with growth) change in flood extent and depth – 1 in 100 year plus 9% climate change, 55-hour storm

### 6.3 Existing outfall (no growth) compared to New Outfall (with growth) – 4-hour storm

Sensitivity test results for the New Outfall (with future growth) 4-hour storm scenario are compared the Existing (no growth) outfall 4-hour storm for the 1 in 100 year present day and 1 in 100 year plus 9% climate change floods in Table 6-3, and Table 6-4, respectively (Appendix D provides the equivalent flood extent and depth differences maps for the four tested flood magnitudes). Figure 6-4 and Figure 6-5 also compare flood extents for the Existing outfall (no growth) for both storm durations for the 1 in 100 year present day and 1 in 100 year plus 9% climate change floods, respectively.

The 4-hour storm sensitivity results indicate that:

- Predicted in-channel flood levels are noticeably lower (by 0.2 to 0.7m) for the 4-hour storm sensitivity test compared to the 55-hour storm base case for both flood magnitudes. Unsurprisingly, predicted flood extents are also noticeably smaller for the 4-hour storm than the 55-hour storm. This confirms that the 55-hour storm remains the appropriate duration to assess flood risk from the River Cam. Using the 4-hour storm would underestimate the existing and post-development flood extent.
- There remains minimal impact in the New Outfall scenario upstream of the outfall / A14 (0.002m or less in the river channel).
- The relative impact from the new outfall (including future growth) downstream of the outfall is larger for the 4-hour storm than the 55-hour storm. This is because, with lower peak flows in the River Cam, the outfall flows make up a bigger proportion of the total river flow. However, the predicted changes in flood depth and extent between the Existing and New Outfall scenarios remain small.

Table 6-3. Sensitivity test – 1 in 100 year, 4-hour storm

Location	Node	Existing outfall (no growth)	New outfall (with growth)	Increase
		<b>Peak water level (mAOD)</b>		<b>Level (m)</b>
M11	CAM01_4253	9.156	9.156	0.000
A1134 Fen Causeway	CAM02_7723d	7.280	7.280	0.000
Silver Street	CAM02_7160	6.756	6.756	0.000
Trinity Bridge	CAM02_6603	6.389	6.389	0.000
Bridge Street	CAM02_6177	6.024	6.025	0.001
Victoria Avenue	CAM02_5371	5.444	5.445	0.001
A1134 Elizabeth Way	CAM02_4494	5.250	5.250	0.000
Railway	CAM02_2638	4.916	4.917	0.001
A14	CAM02_0636	4.474	4.477	0.003
Baits Bite Lock US	CAM02_0200	4.322	4.326	0.004
Baits Bite Lock DS	CAM02_0000	4.056	4.060	0.004
Horningsea	CA14400	3.892	3.897	0.005
Waterbeach	CA12080J	3.458	3.475	0.017
Bottisham Lock US	CA10600J	3.335	3.352	0.017
Bottisham Lock DS	CA10560	3.224	3.240	0.016
Shrubbs Marina	Cam8794	3.139	3.155	0.016
Upware	Cam5007	3.060	3.076	0.016
A1123	Cam2651u	3.004	3.020	0.016
Great Ouse confluence	Cam0000	2.946	2.963	0.017
		<b>Peak flow (m<sup>3</sup>/s)</b>		<b>Flow (m<sup>3</sup>/s)</b>
M11	CAM01_4253	33.6	33.6	0.0
A1134 Fen Causeway	CAM02_7723d	29.1	29.1	0.0
Silver Street	CAM02_7160	53.2	53.2	0.0
Trinity Bridge	CAM02_6603	51.2	51.2	0.0
Bridge Street	CAM02_6177	51.9	51.9	0.0
Victoria Avenue	CAM02_5371	50.7	50.7	0.0
A1134 Elizabeth Way	CAM02_4494	51.3	51.3	0.0
Railway	CAM02_2638	50.8	50.9	0.0
A14	CAM02_0636	49.6	49.6	0.0
Baits Bite Lock US	CAM02_0200	45.3	45.5	0.2
Baits Bite Lock DS	CAM02_0000	45.3	45.5	0.2
Horningsea	CA14400	38.3	38.4	0.1
Waterbeach	CA12080J	46.9	47.8	0.9
Bottisham Lock US	CA10600J	46.6	47.5	0.9
Bottisham Lock DS	CA10560	46.6	47.5	0.9
Shrubbs Marina	Cam8794	48.8	49.5	0.7
Upware	Cam5007	47.3	47.9	0.6
A1123	Cam2651u	49.9	50.4	0.4
Great Ouse confluence	Cam0000	49.1	49.5	0.4

Table 6-4. Sensitivity test – 1 in 100 year plus 9% climate change, 4-hour storm

Location	Node	Existing outfall (no growth)	New outfall (with growth)	Increase
		<b>Peak water level (mAOD)</b>		<b>Level (m)</b>
M11	CAM01_4253	9.234	9.234	0.000
A1134 Fen Causeway	CAM02_7723d	7.469	7.469	0.000
Silver Street	CAM02_7160	6.854	6.854	0.000
Trinity Bridge	CAM02_6603	6.494	6.494	0.000
Bridge Street	CAM02_6177	6.105	6.105	0.000
Victoria Avenue	CAM02_5371	5.516	5.516	0.000
A1134 Elizabeth Way	CAM02_4494	5.310	5.311	0.001
Railway	CAM02_2638	4.967	4.969	0.002
A14	CAM02_0636	4.508	4.511	0.003
Baits Bite Lock US	CAM02_0200	4.357	4.361	0.004
Baits Bite Lock DS	CAM02_0000	4.088	4.092	0.004
Horningsea	CA14400	3.926	3.929	0.003
Waterbeach	CA12080J	3.593	3.605	0.012
Bottisham Lock US	CA10600J	3.474	3.486	0.012
Bottisham Lock DS	CA10560	3.371	3.384	0.013
Shrubbs Marina	Cam8794	3.287	3.300	0.013
Upware	Cam5007	3.211	3.225	0.014
A1123	Cam2651u	3.159	3.173	0.014
Great Ouse confluence	Cam0000	3.107	3.121	0.014
		<b>Peak flow (m<sup>3</sup>/s)</b>		<b>Flow (m<sup>3</sup>/s)</b>
M11	CAM01_4253	36.4	36.4	0.0
A1134 Fen Causeway	CAM02_7723d	34.9	34.9	0.0
Silver Street	CAM02_7160	56.0	56.0	0.0
Trinity Bridge	CAM02_6603	54.6	54.6	0.0
Bridge Street	CAM02_6177	55.7	55.7	0.0
Victoria Avenue	CAM02_5371	54.4	54.3	0.0
A1134 Elizabeth Way	CAM02_4494	55.1	55.1	0.0
Railway	CAM02_2638	55.1	55.1	0.0
A14	CAM02_0636	53.6	53.6	0.0
Baits Bite Lock US	CAM02_0200	46.9	47.1	0.2
Baits Bite Lock DS	CAM02_0000	46.9	47.1	0.2
Horningsea	CA14400	38.7	38.9	0.2
Waterbeach	CA12080J	51.6	51.9	0.3
Bottisham Lock US	CA10600J	52.2	52.7	0.5
Bottisham Lock DS	CA10560	52.2	52.7	0.5
Shrubbs Marina	Cam8794	54.1	54.6	0.5
Upware	Cam5007	51.7	52.0	0.4
A1123	Cam2651u	53.9	54.3	0.4
Great Ouse confluence	Cam0000	52.9	53.3	0.4



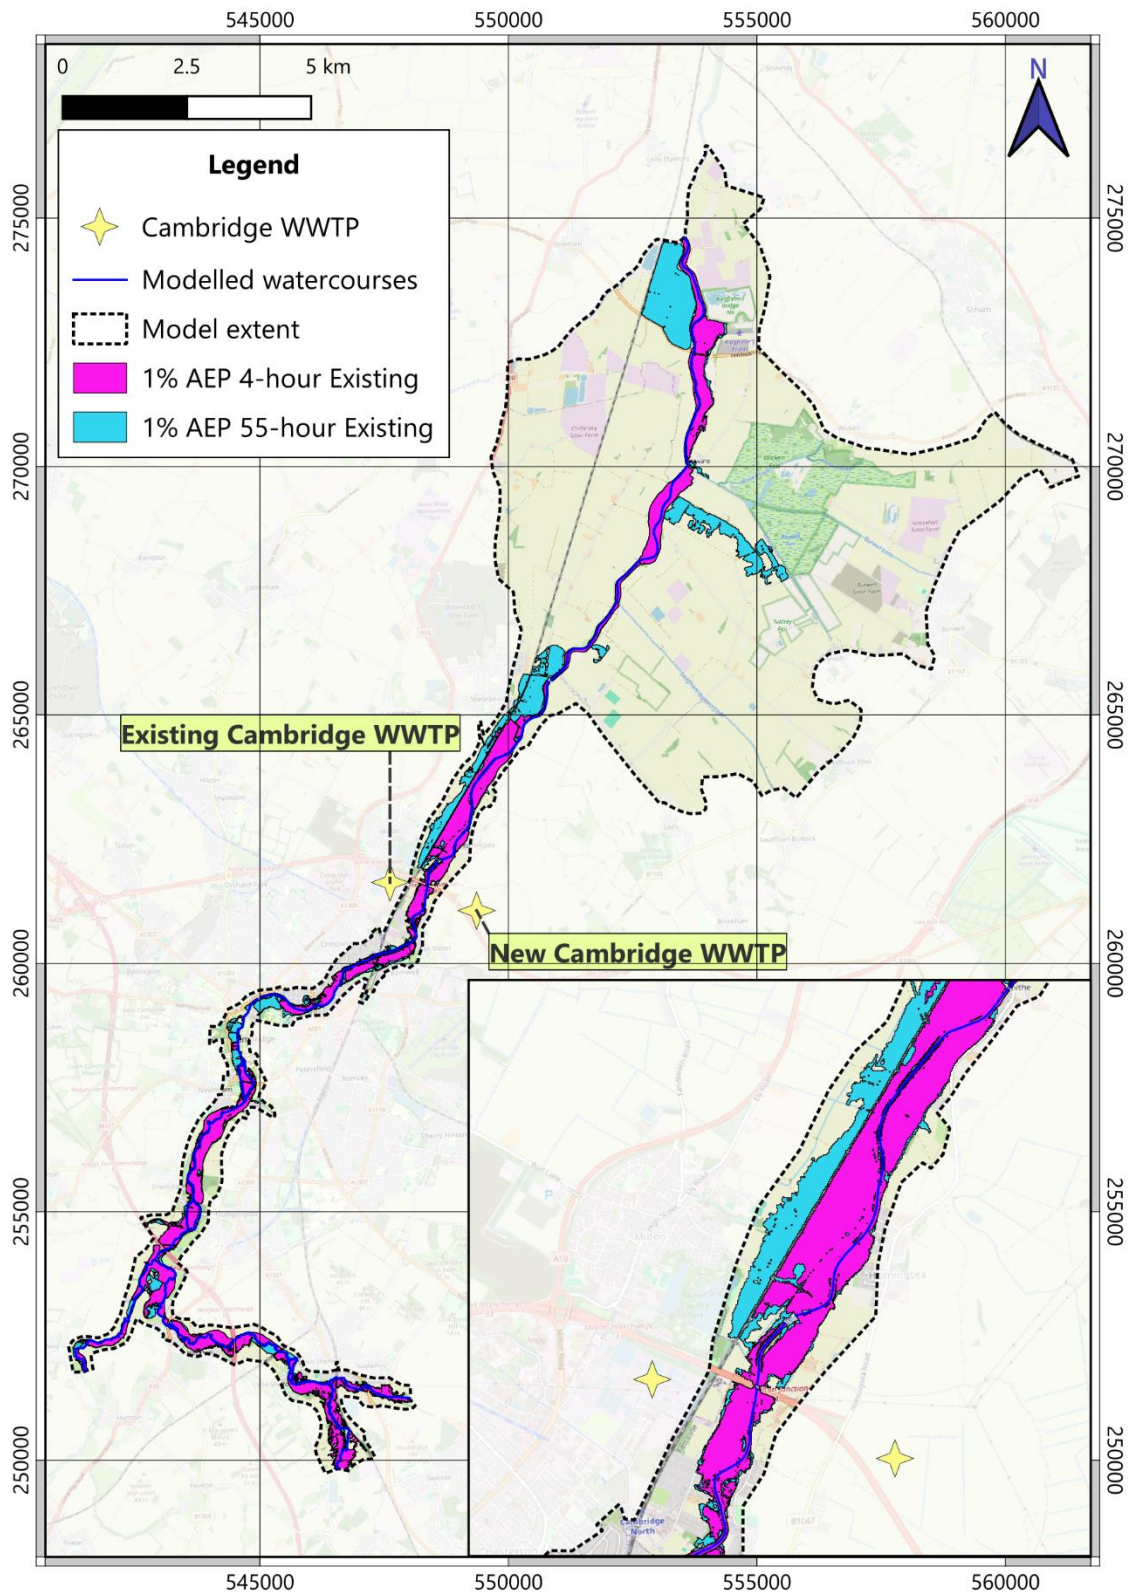


Figure 6-4. 1 in 100 year, 55-and 4-hour storms compared for the Existing Outfall case (no growth)

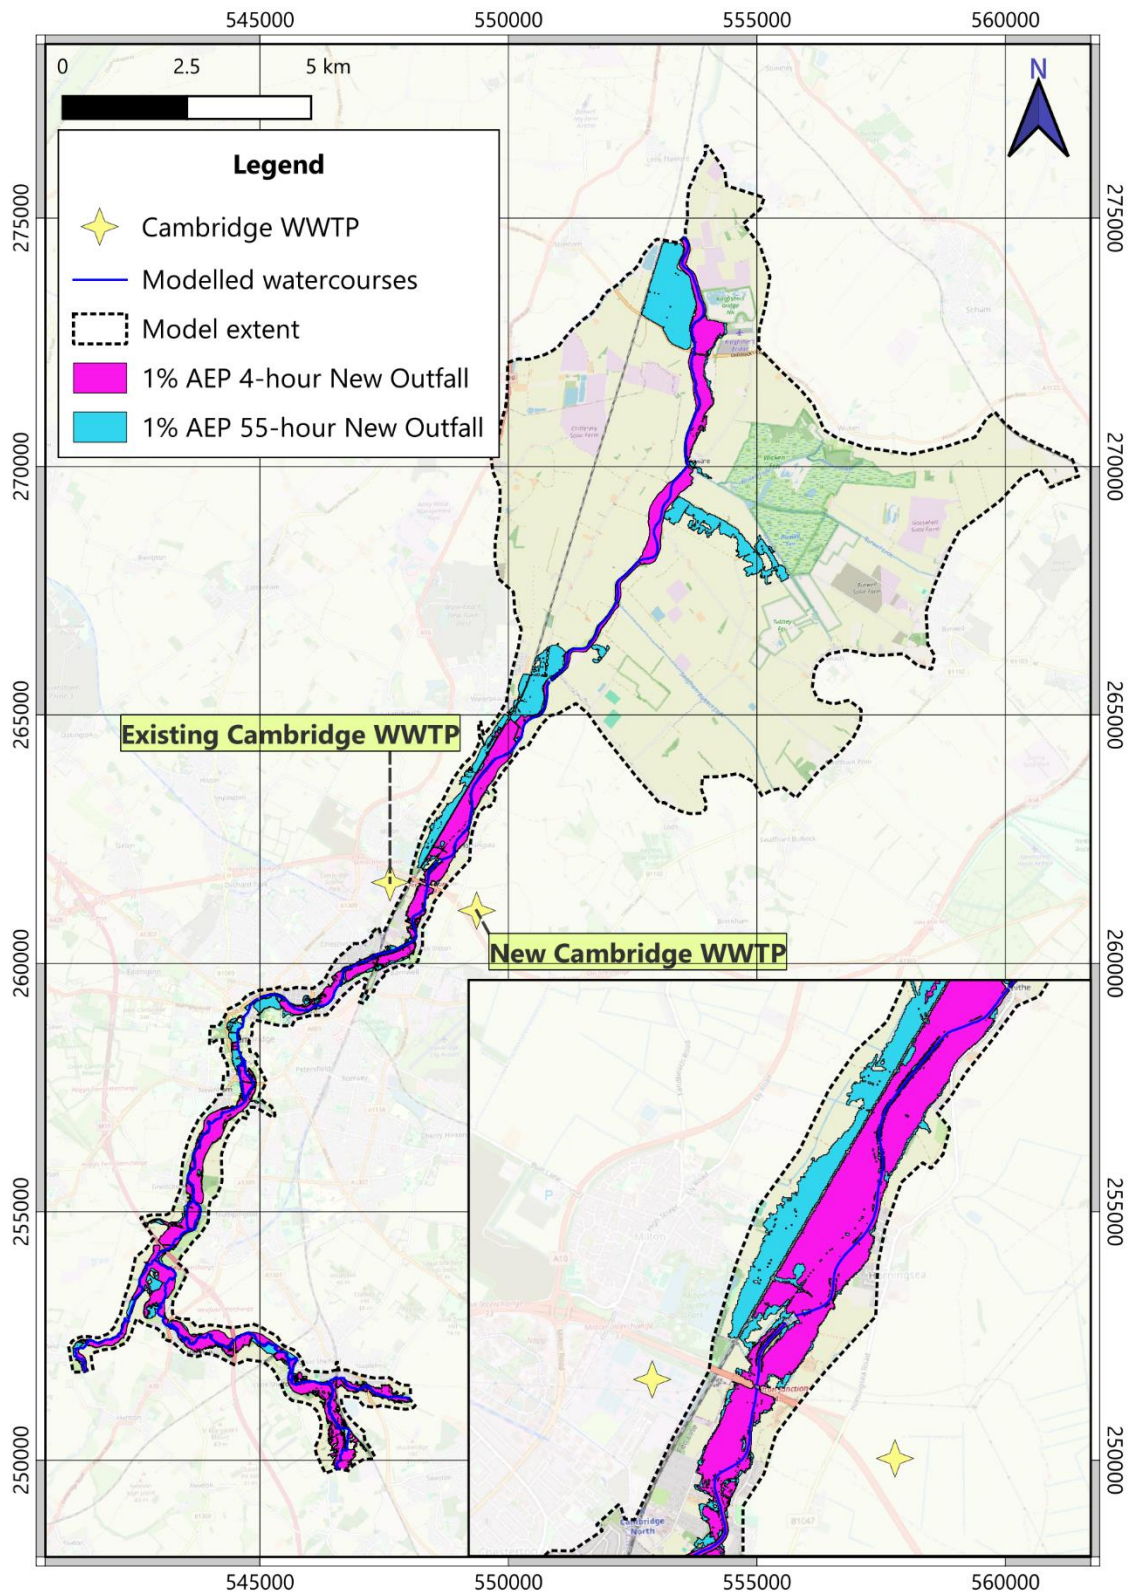


Figure 6-5. Sensitivity test – 1 in 100 year, 55- and 4-hour storms compared for the New Outfall case (with growth)

## 6.4 Existing outfall (no growth) compared to New Outfall (with growth) – other flood magnitudes

The results for other flood magnitudes are shown in Appendix B and C for the 55-hour storm. These results indicate that:

- The new WWTP lies well outside the River Cam flood extents, even in the largest flood magnitudes.
- There is no genuine impact on peak water levels, peak flows or flood extent upstream of the A14. The maximum predicted in-channel increase in water level is 0.007m, with no discernible change in flood extent.
- Small increases in in-channel water level (up to 0.010m) and flow (up to 0.3m<sup>3</sup>/s) are predicted downstream of the A14. The impact is larger for the lower return periods because the WWTP discharge makes up a larger proportion of the total River Cam flow.
- As with the 1 in 100 year flood, there are some small increases in flood depth and extent shown at locations downstream of the outfall. There is not a consistent pattern to where these increases occur as it relates to different parts of the floodplain activating in different flood magnitudes. **Again, these predicted changes, compared to the Existing outfall (with no future growth in the catchment) relate to changes in flood volume between the two scenarios. The increase in flood volume for the New Outfall scenario is due to inclusion of future growth in the catchment, rather than the new WWTP or outfall itself.**

## 6.5 Existing outfall (with Future Growth) compared to New Outfall (with growth)

Sensitivity results comparing the New Outfall (with growth) to the Existing Future (with growth) scenarios for the 55-hour storm are presented in Table 6-5 and Figure 6-6, and in Table 6-6 and Figure 6-7 for the 1 in 100 year present day, and 1 in 100 year plus 9% climate change floods, respectively. The results for the remaining flood magnitudes are provided in Appendix E for the tabulated results, and in Appendices F and G for the comparative flood maps.

The comparative flood maps presented in Figure 6-6 and Figure 6-7 show the change in flood depth and extent between the Existing Future scenario and the New Outfall, such that positive depth changes indicate areas where depths would increase with the New Outfall. Negative depth changes indicate areas where flood depths would reduce with the New Outfall.

These sensitivity results indicate that when future growth in the catchment is considered:

- There is almost no change in peak water levels or flows in the River Cam for the New Outfall case compared to Existing Future.
- The maximum predicted increase in peak in-channel water level is 0.001m (1mm) at Horningsea. More often there is no change or a very small reduction to peak in-channel water levels.
- There is no change in flood depths throughout Cambridge (upstream of the A14 / the WWTP outfalls).

- The New Outfall does not increase floodplain water levels for the design storm (55-hour) anywhere in the study area beyond +0.001m, for the range of flood magnitudes considered, except for the few isolated exceptions discussed below.
- Although the New Outfall would discharge a slightly higher peak flow than the Existing with future growth (see Table 5-2 above), these increases (0.1-0.7m<sup>3</sup>/s) do not coincide with the peak river flow. The maximum change in peak river flow is 0.1m<sup>3</sup>/s and more often there is no change or a small reduction.
- The new outfall does show a few small, isolated areas of minor detriment downstream of Upware. For the 1 in 100 year plus 9% climate change, there is a small region of a field in the left-bank floodplain adjacent to the River Cam at Upware where levels have increased by generally 0.04m (as seen in Figure 6-7) with several model cells increasing to 0.1m; and another region of a field on the south side of Stretham Road in the vicinity of Dimmock's Cote Drain where levels have increase by up to 0.01m. No sensitive receptors appear to be impacted by this increase.
- There are no increases in flood depth during the 4-hour storm case. In general, there are reductions in flood depth in the floodplain around Waterbeach and downstream of Upware, although the reductions are small and isolated, as seen in Appendices G.2 to G.4.

Table 6-5 Existing Future sensitivity – 1 in 100 year, 55-hour storm1D model results

Location	Node	Existing future (with growth)	New outfall (with growth)	Increase
		<b>Peak water level (mAOD)</b>		<b>Level (m)</b>
M11	CAM01_4253	9.460	9.460	0.000
A1134 Fen Causeway	CAM02_7723d	7.509	7.509	0.000
Silver Street	CAM02_7160	7.397	7.397	0.000
Trinity Bridge	CAM02_6603	7.017	7.017	0.000
Bridge Street	CAM02_6177	6.506	6.506	0.000
Victoria Avenue	CAM02_5371	5.837	5.837	0.000
A1134 Elizabeth Way	CAM02_4494	5.590	5.590	0.000
Railway	CAM02_2638	5.205	5.204	-0.001
A14	CAM02_0636	4.642	4.641	-0.001
Baits Bite Lock US	CAM02_0200	4.508	4.508	0.000
Baits Bite Lock DS	CAM02_0000	4.302	4.301	-0.001
Horningsea	CA14400	4.204	4.204	0.000
Waterbeach	CA12080J	4.106	4.106	0.000
Bottisham Lock US	CA10600J	3.960	3.960	0.000
Bottisham Lock DS	CA10560	3.876	3.876	0.000
Shrubbs Marina	Cam8794	3.774	3.774	0.000
Upware	Cam5007	3.684	3.684	0.000
A1123	Cam2651u	3.624	3.624	0.000
Great Ouse confluence	Cam0000	3.575	3.575	0.000
		<b>Peak flow (m<sup>3</sup>/s)</b>		<b>Flow (m<sup>3</sup>/s)</b>
M11	CAM01_4253	60.9	60.9	0.0
A1134 Fen Causeway	CAM02_7723d	36.5	36.5	0.0
Silver Street	CAM02_7160	65.7	65.8	0.0
Trinity Bridge	CAM02_6603	76.5	76.5	0.0
Bridge Street	CAM02_6177	78.2	78.2	0.0
Victoria Avenue	CAM02_5371	74.2	74.2	0.0
A1134 Elizabeth Way	CAM02_4494	76.6	76.7	0.0
Railway	CAM02_2638	78.7	78.7	0.0
A14	CAM02_0636	77.3	77.3	0.0
Baits Bite Lock US	CAM02_0200	53.6	53.6	0.0
Baits Bite Lock DS	CAM02_0000	53.6	53.6	0.0
Horningsea	CA14400	40.0	40.0	0.1
Waterbeach	CA12080J	55.1	55.0	0.0
Bottisham Lock US	CA10600J	70.5	70.5	0.0
Bottisham Lock DS	CA10560	70.5	70.5	0.0
Shrubbs Marina	Cam8794	71.9	71.8	-0.1
Upware	Cam5007	70.6	70.6	0.0
A1123	Cam2651u	75.7	75.7	0.0
Great Ouse confluence	Cam0000	65.0	65.0	0.0

Table 6-6 Existing Future sensitivity – 1 in 100 year plus 9% climate change, 55-hour storm1D model results

Location	Node	Existing future (with growth)	New outfall (with growth)	Increase
		<b>Peak water level (mAOD)</b>		<b>Level (m)</b>
M11	CAM01_4253	9.557	9.557	0.000
A1134 Fen Causeway	CAM02_7723d	7.779	7.779	0.000
Silver Street	CAM02_7160	7.564	7.564	0.000
Trinity Bridge	CAM02_6603	7.154	7.154	0.000
Bridge Street	CAM02_6177	6.608	6.608	0.000
Victoria Avenue	CAM02_5371	5.913	5.913	0.000
A1134 Elizabeth Way	CAM02_4494	5.657	5.657	0.000
Railway	CAM02_2638	5.265	5.265	0.000
A14	CAM02_0636	4.670	4.669	-0.001
Baits Bite Lock US	CAM02_0200	4.540	4.541	0.001
Baits Bite Lock DS	CAM02_0000	4.343	4.343	0.000
Horningsea	CA14400	4.249	4.249	0.000
Waterbeach	CA12080J	4.141	4.141	0.000
Bottisham Lock US	CA10600J	3.988	3.988	0.000
Bottisham Lock DS	CA10560	3.902	3.901	-0.001
Shrubbs Marina	Cam8794	3.794	3.794	0.000
Upware	Cam5007	3.698	3.698	0.000
A1123	Cam2651u	3.635	3.635	0.000
Great Ouse confluence	Cam0000	3.585	3.585	0.000
		<b>Peak flow (m<sup>3</sup>/s)</b>		<b>Flow (m<sup>3</sup>/s)</b>
M11	CAM01_4253	65.9	65.9	0.0
A1134 Fen Causeway	CAM02_7723d	41.9	41.9	0.0
Silver Street	CAM02_7160	76.0	76.0	0.0
Trinity Bridge	CAM02_6603	83.2	83.2	0.0
Bridge Street	CAM02_6177	85.1	85.1	0.0
Victoria Avenue	CAM02_5371	76.5	76.5	0.0
A1134 Elizabeth Way	CAM02_4494	82.8	82.8	0.0
Railway	CAM02_2638	85.5	85.5	0.0
A14	CAM02_0636	83.8	83.8	0.0
Baits Bite Lock US	CAM02_0200	54.6	54.6	0.0
Baits Bite Lock DS	CAM02_0000	54.6	54.6	0.0
Horningsea	CA14400	40.3	40.2	0.0
Waterbeach	CA12080J	55.0	55.0	0.0
Bottisham Lock US	CA10600J	73.4	73.4	0.0
Bottisham Lock DS	CA10560	73.4	73.4	0.0
Shrubbs Marina	Cam8794	74.7	74.6	-0.1
Upware	Cam5007	72.7	72.6	0.0
A1123	Cam2651u	78.1	78.0	0.0
Great Ouse confluence	Cam0000	65.3	65.3	0.0

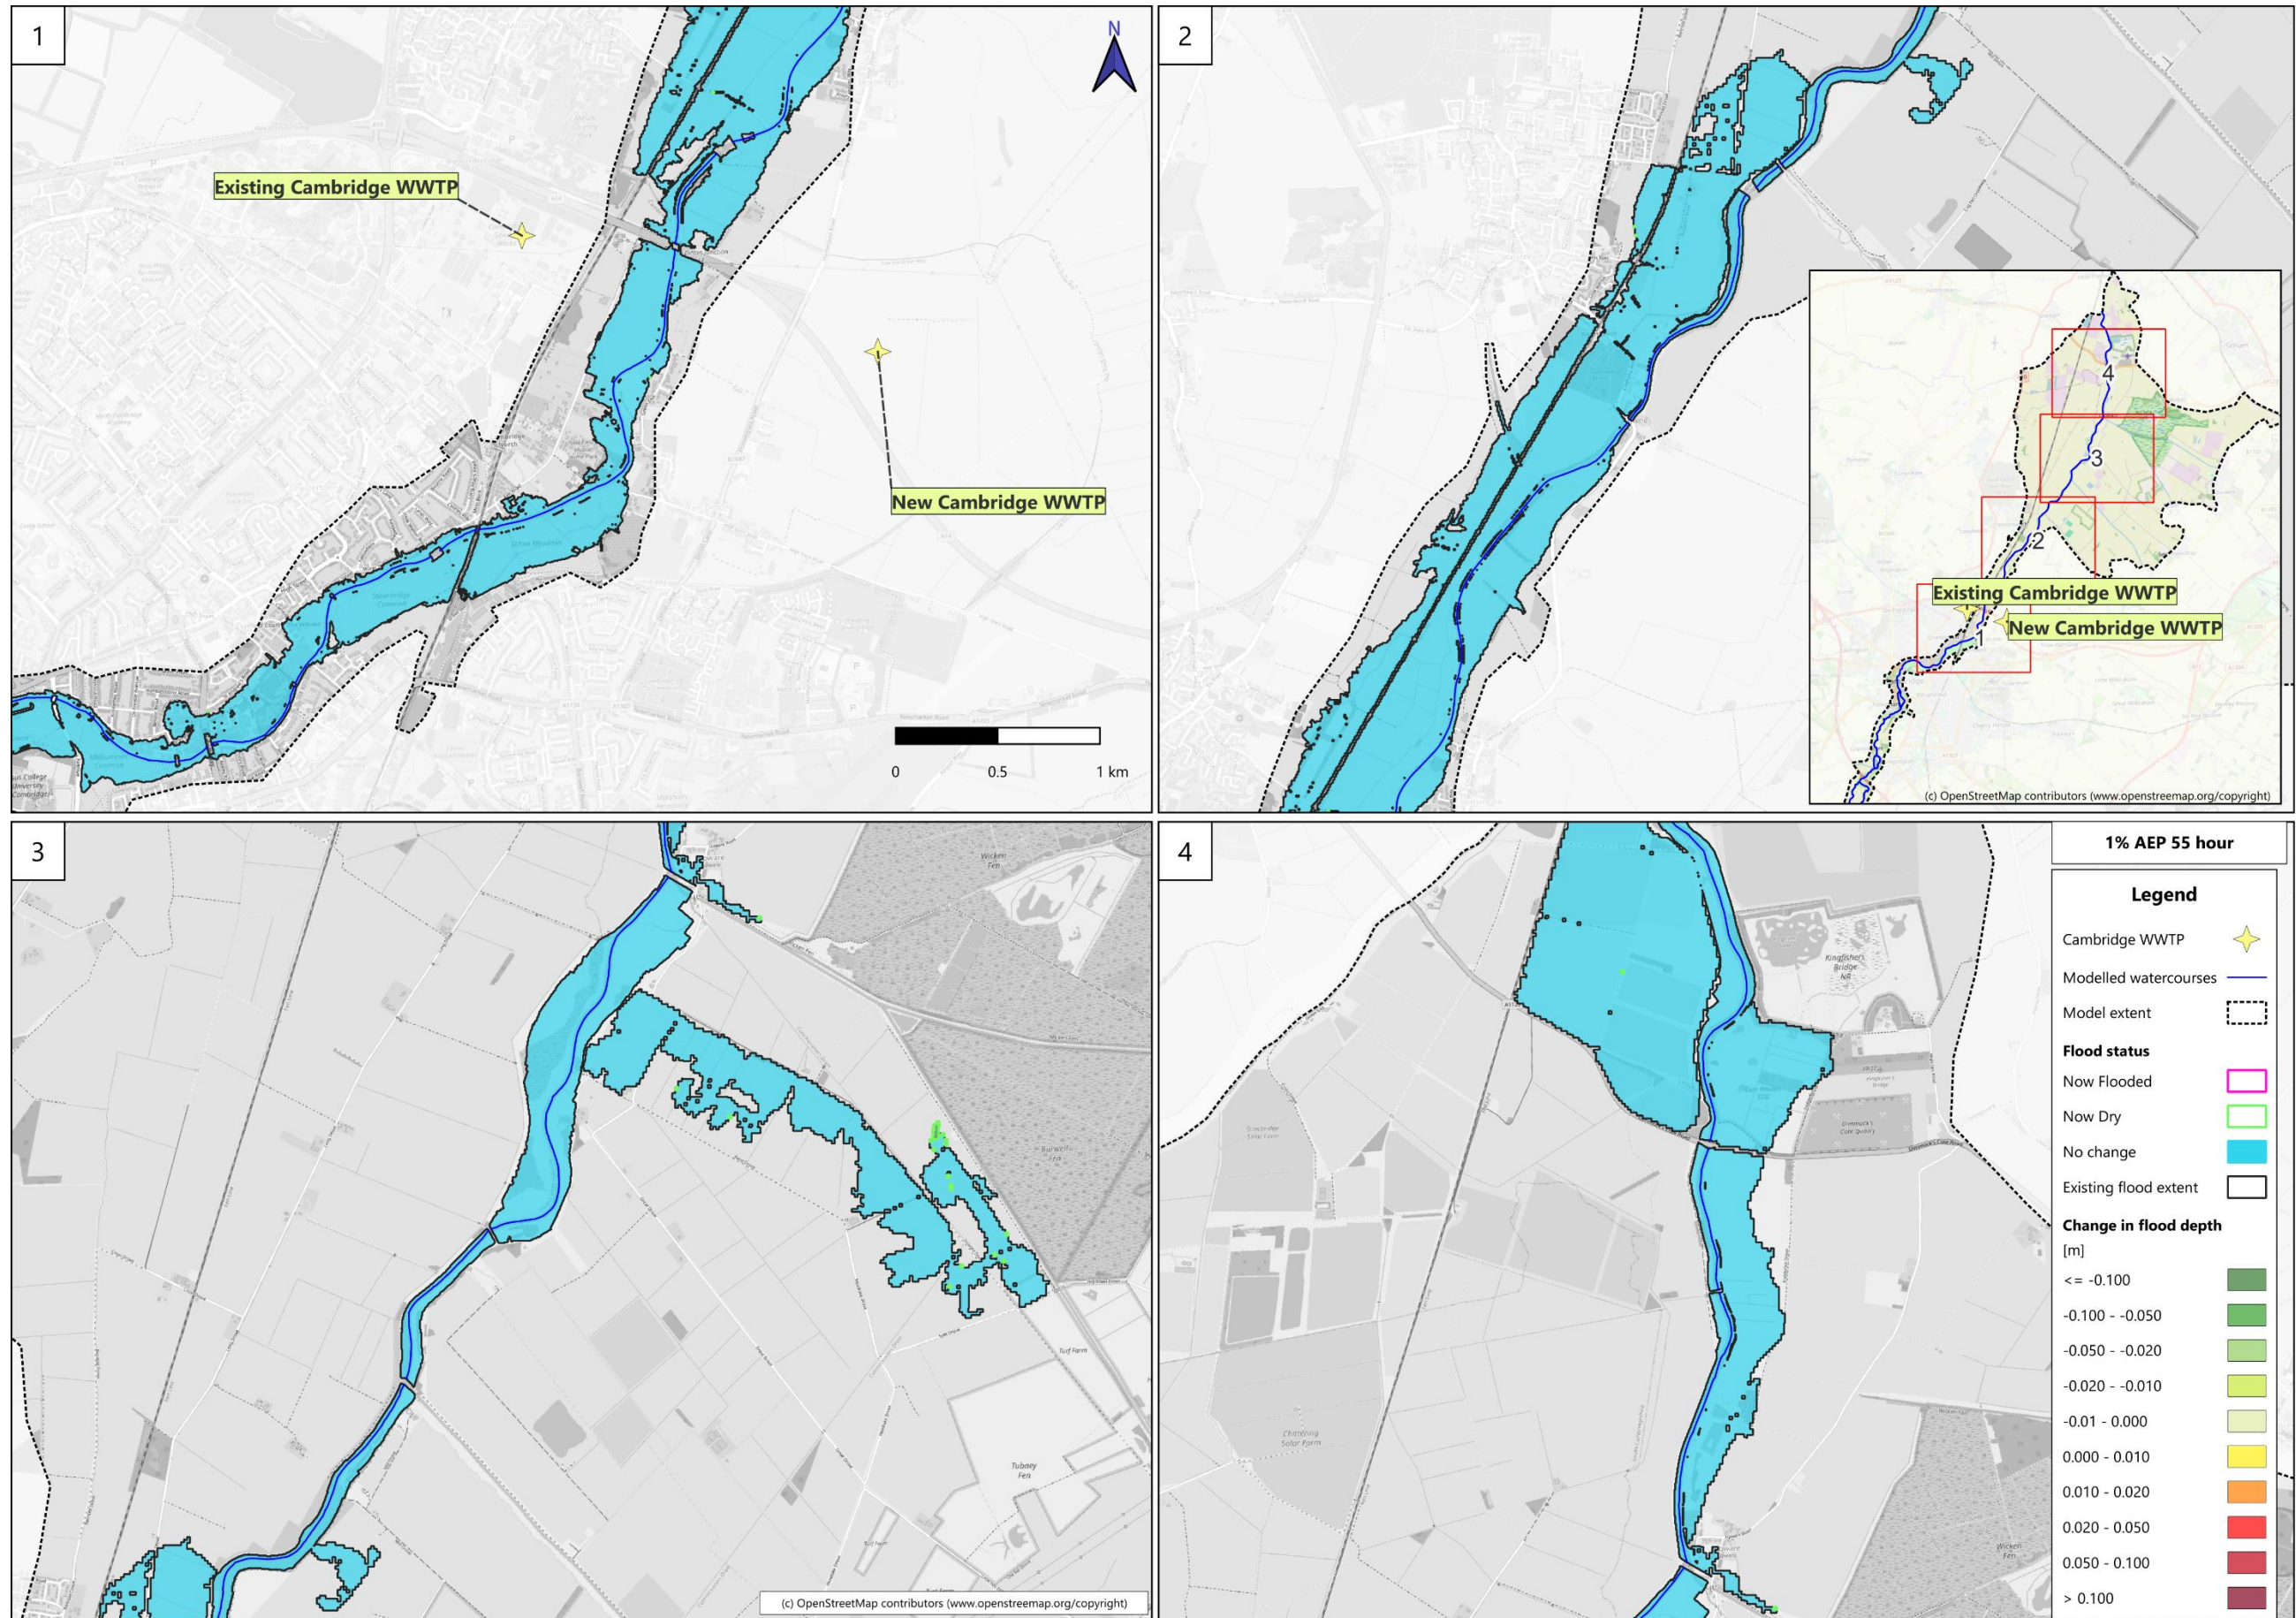


Figure 6-6. Existing Future (with growth) to New Outfall (with growth) change in flood extent and depth – 1 in 100 year, 55-hour storm

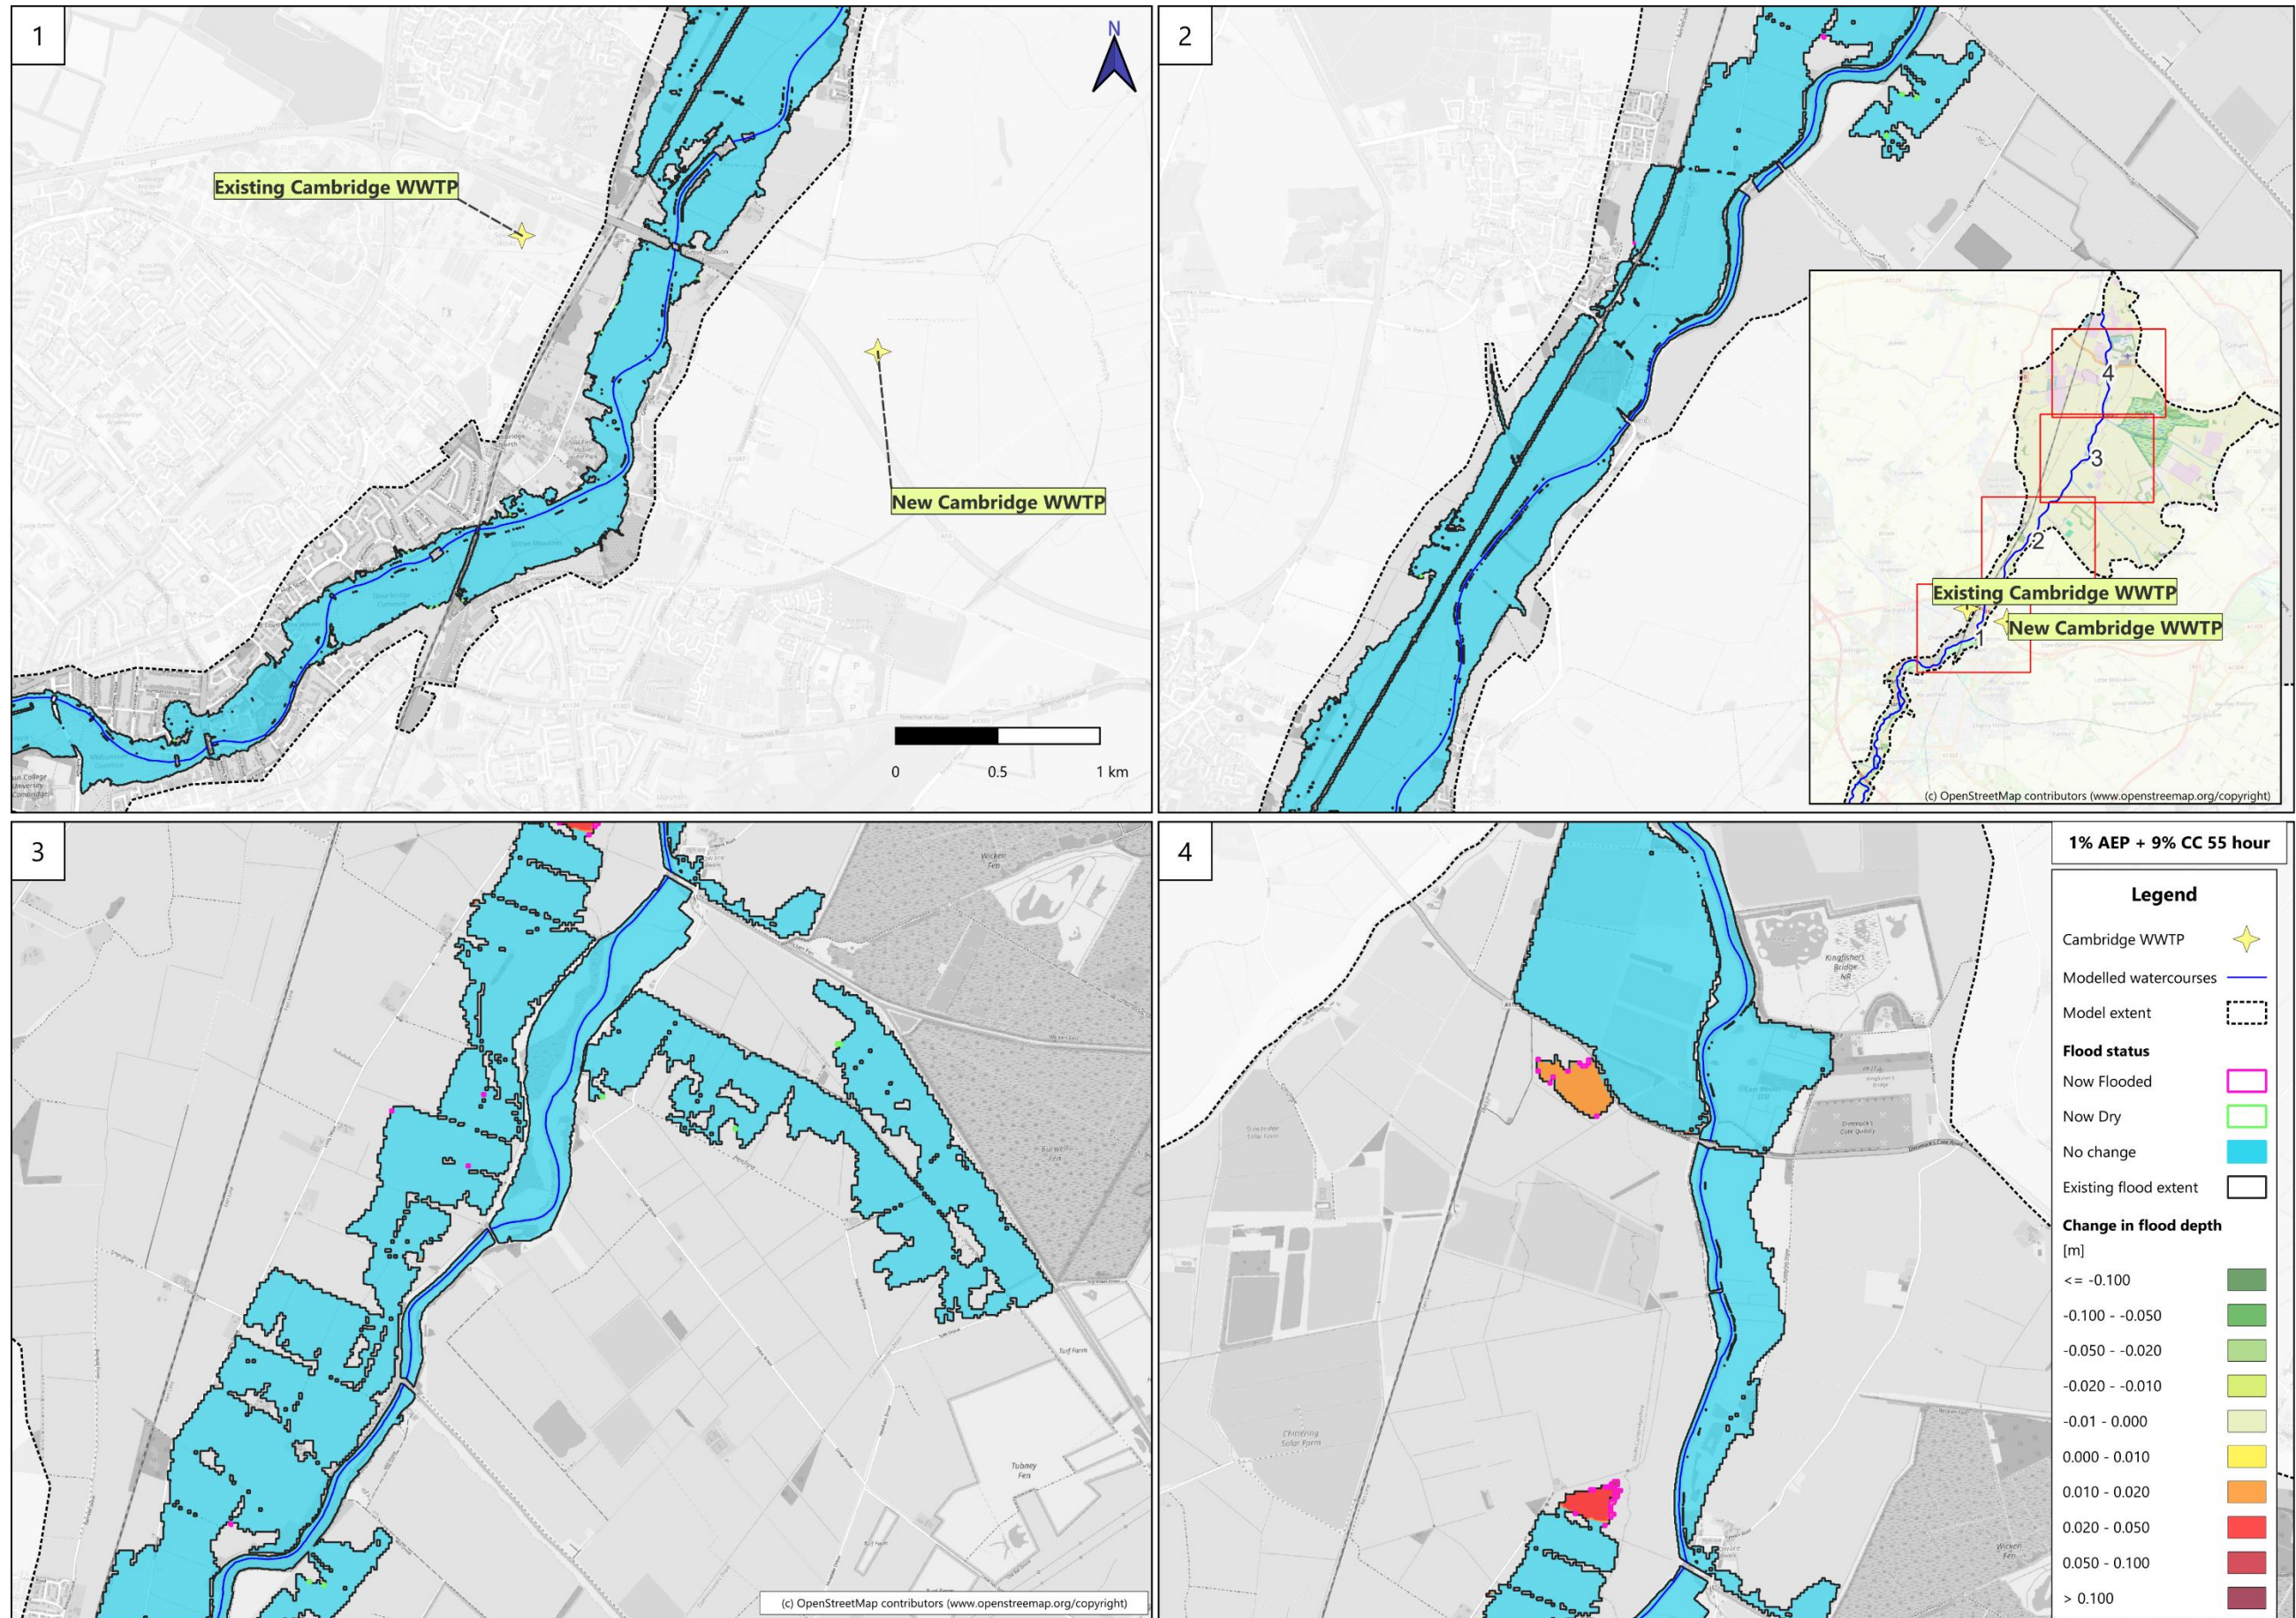


Figure 6-7. Existing Future (with growth) to New Outfall (with growth) change in flood extent and depth – 1 in 100 year plus 9% climate change, 55-hour storm



## 6.6 Existing outfall (no growth) compared to New Outfall Phase 1

The flood difference maps in Figure 6-8 and Figure 6-9 compare depths and extents between for the Existing outfall and New Outfall Phase 1 scenarios for the 1 in 75 and 1 in 100 year floods (55-hour storm), respectively. These flood magnitudes were used as these are the cases with greatest, albeit still small, impacts predicted from future growth in the catchment.

The maps demonstrate that there is minimal difference between the Phase 1 impact (shown here in Figure 6-8 and Figure 6-9) and the Phase 2 impact (shown in section 6.2 and Appendix C) of the New Outfall (with growth) compared to the Existing outfall (no growth). The predicted changes are marginally smaller for Phase 1 (approximately 0.02m lower than Phase 2 in the areas of greatest change) but the extent of areas affected remain very similar.

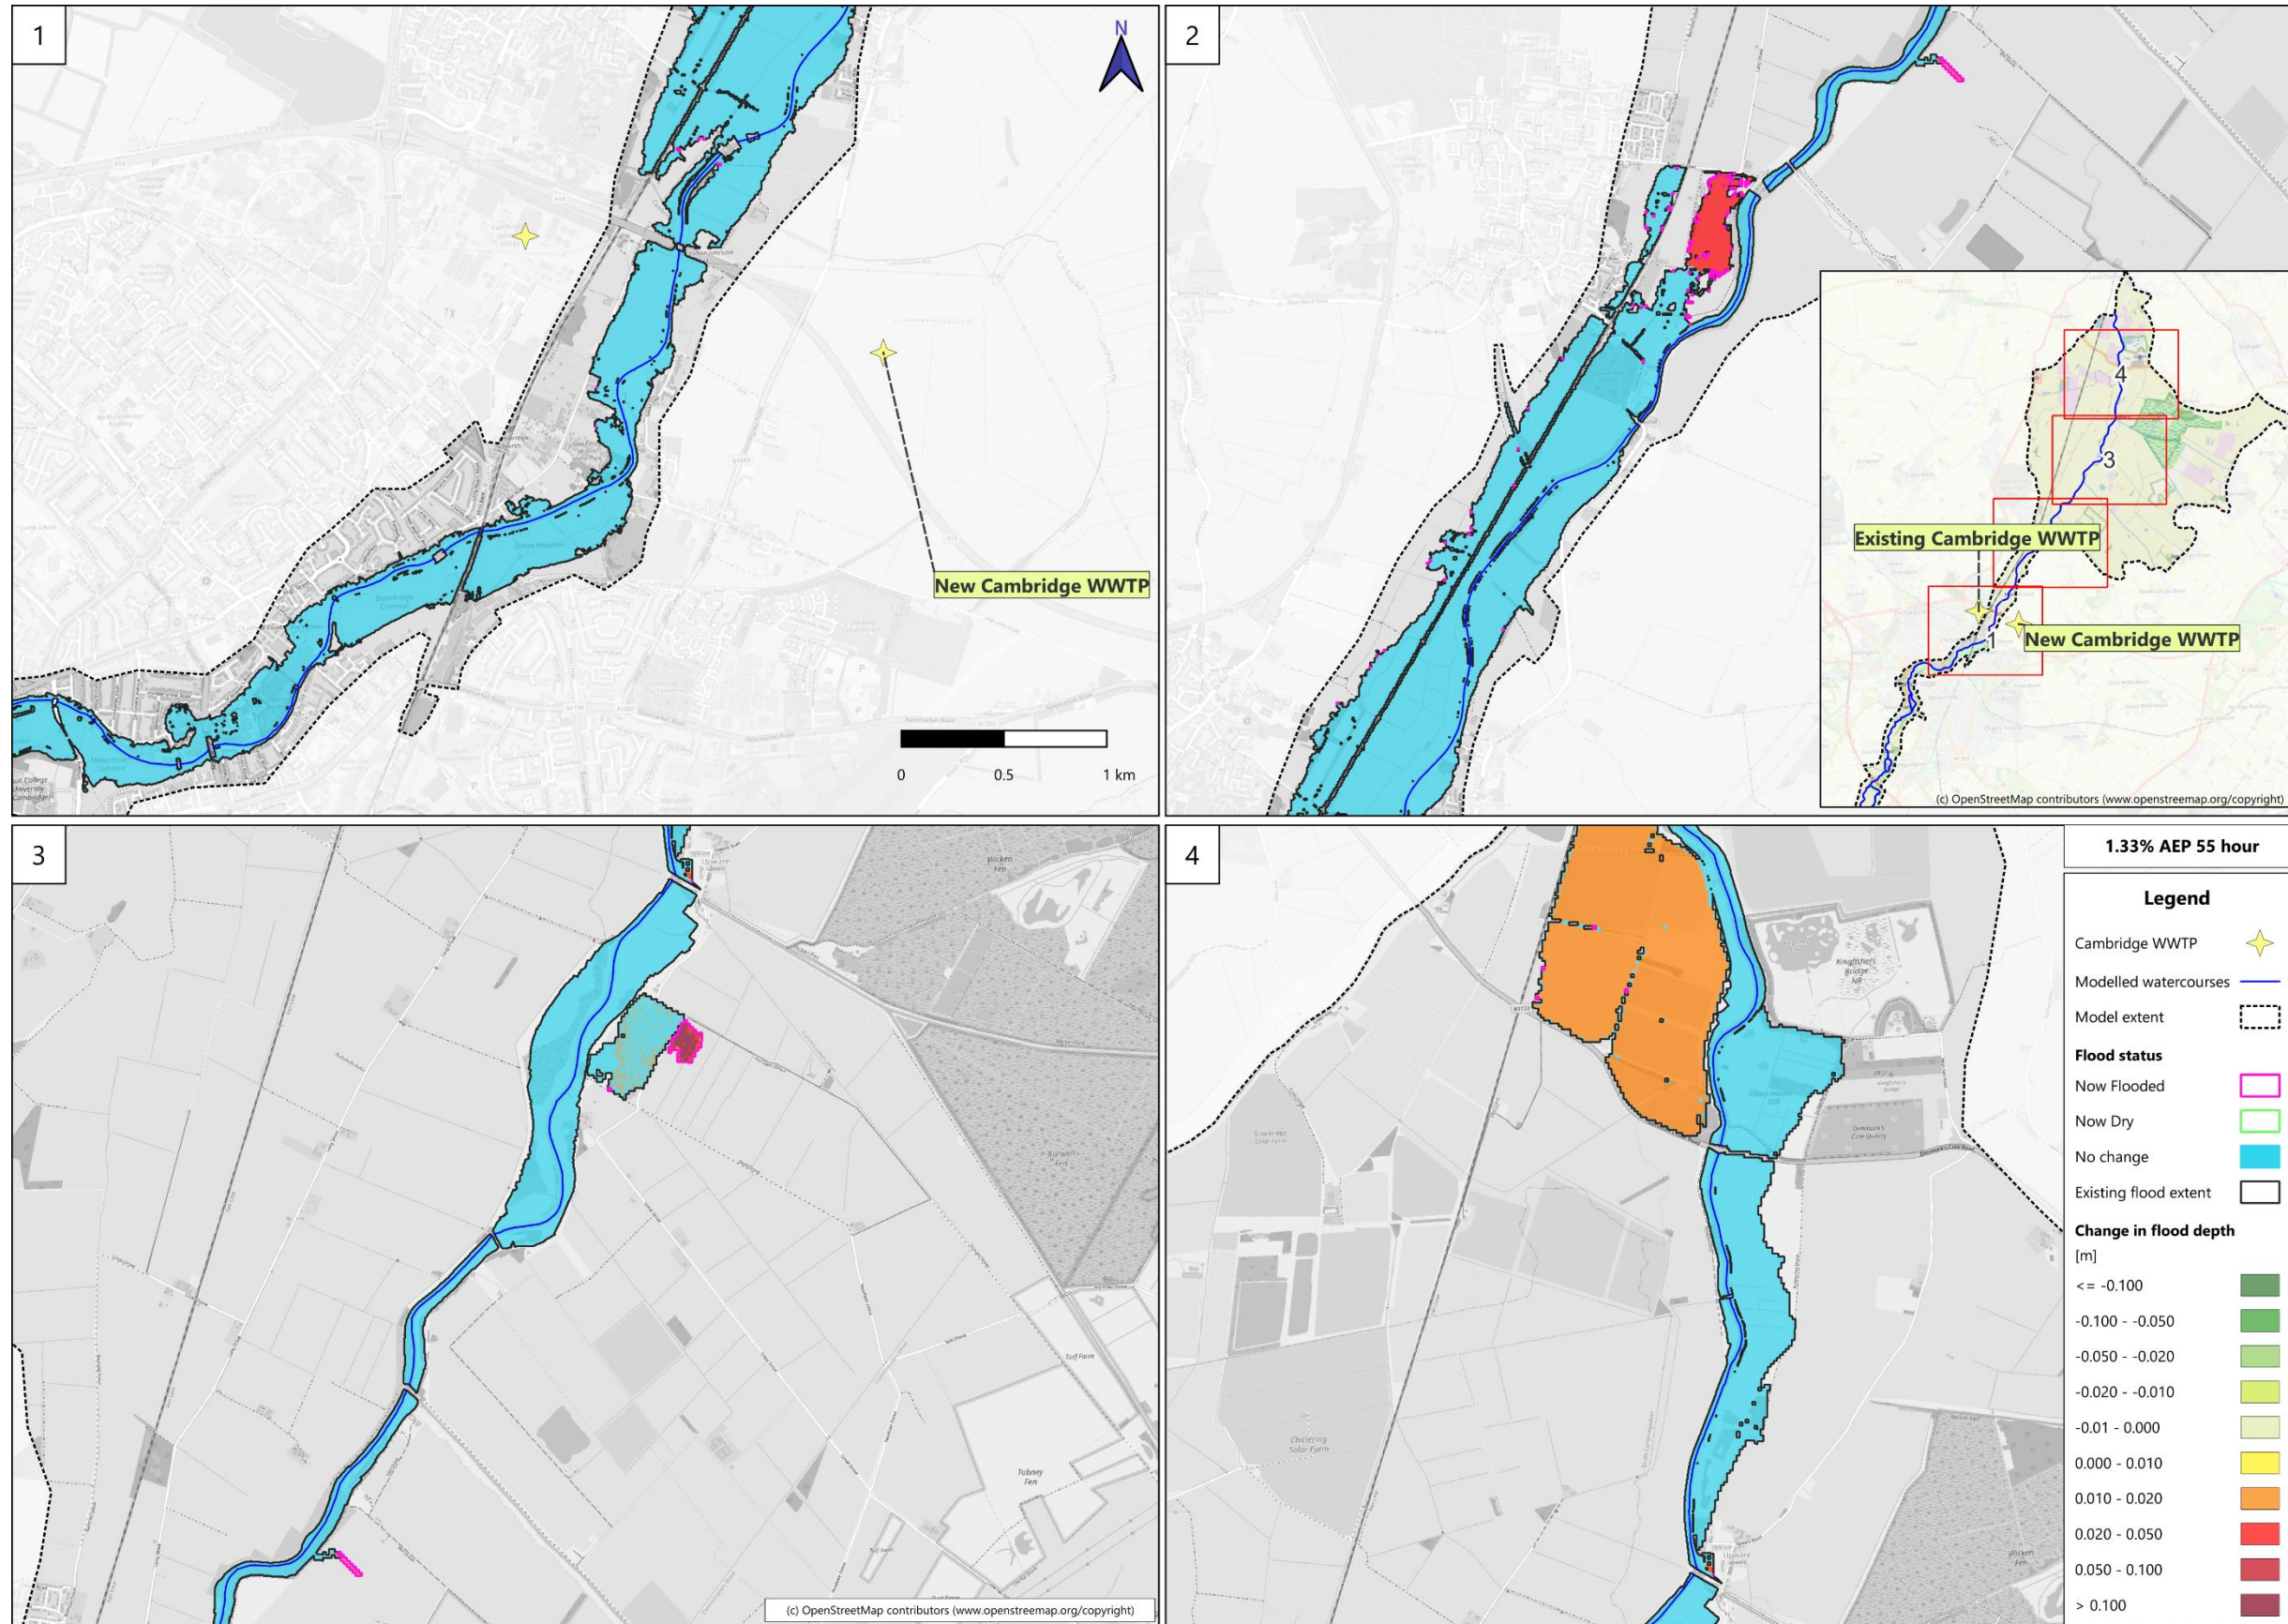


Figure 6-8 Existing (no growth) to Phase 1 New Outfall (with growth) change in flood extent and depth – 1 in 75 year, 55-hour storm

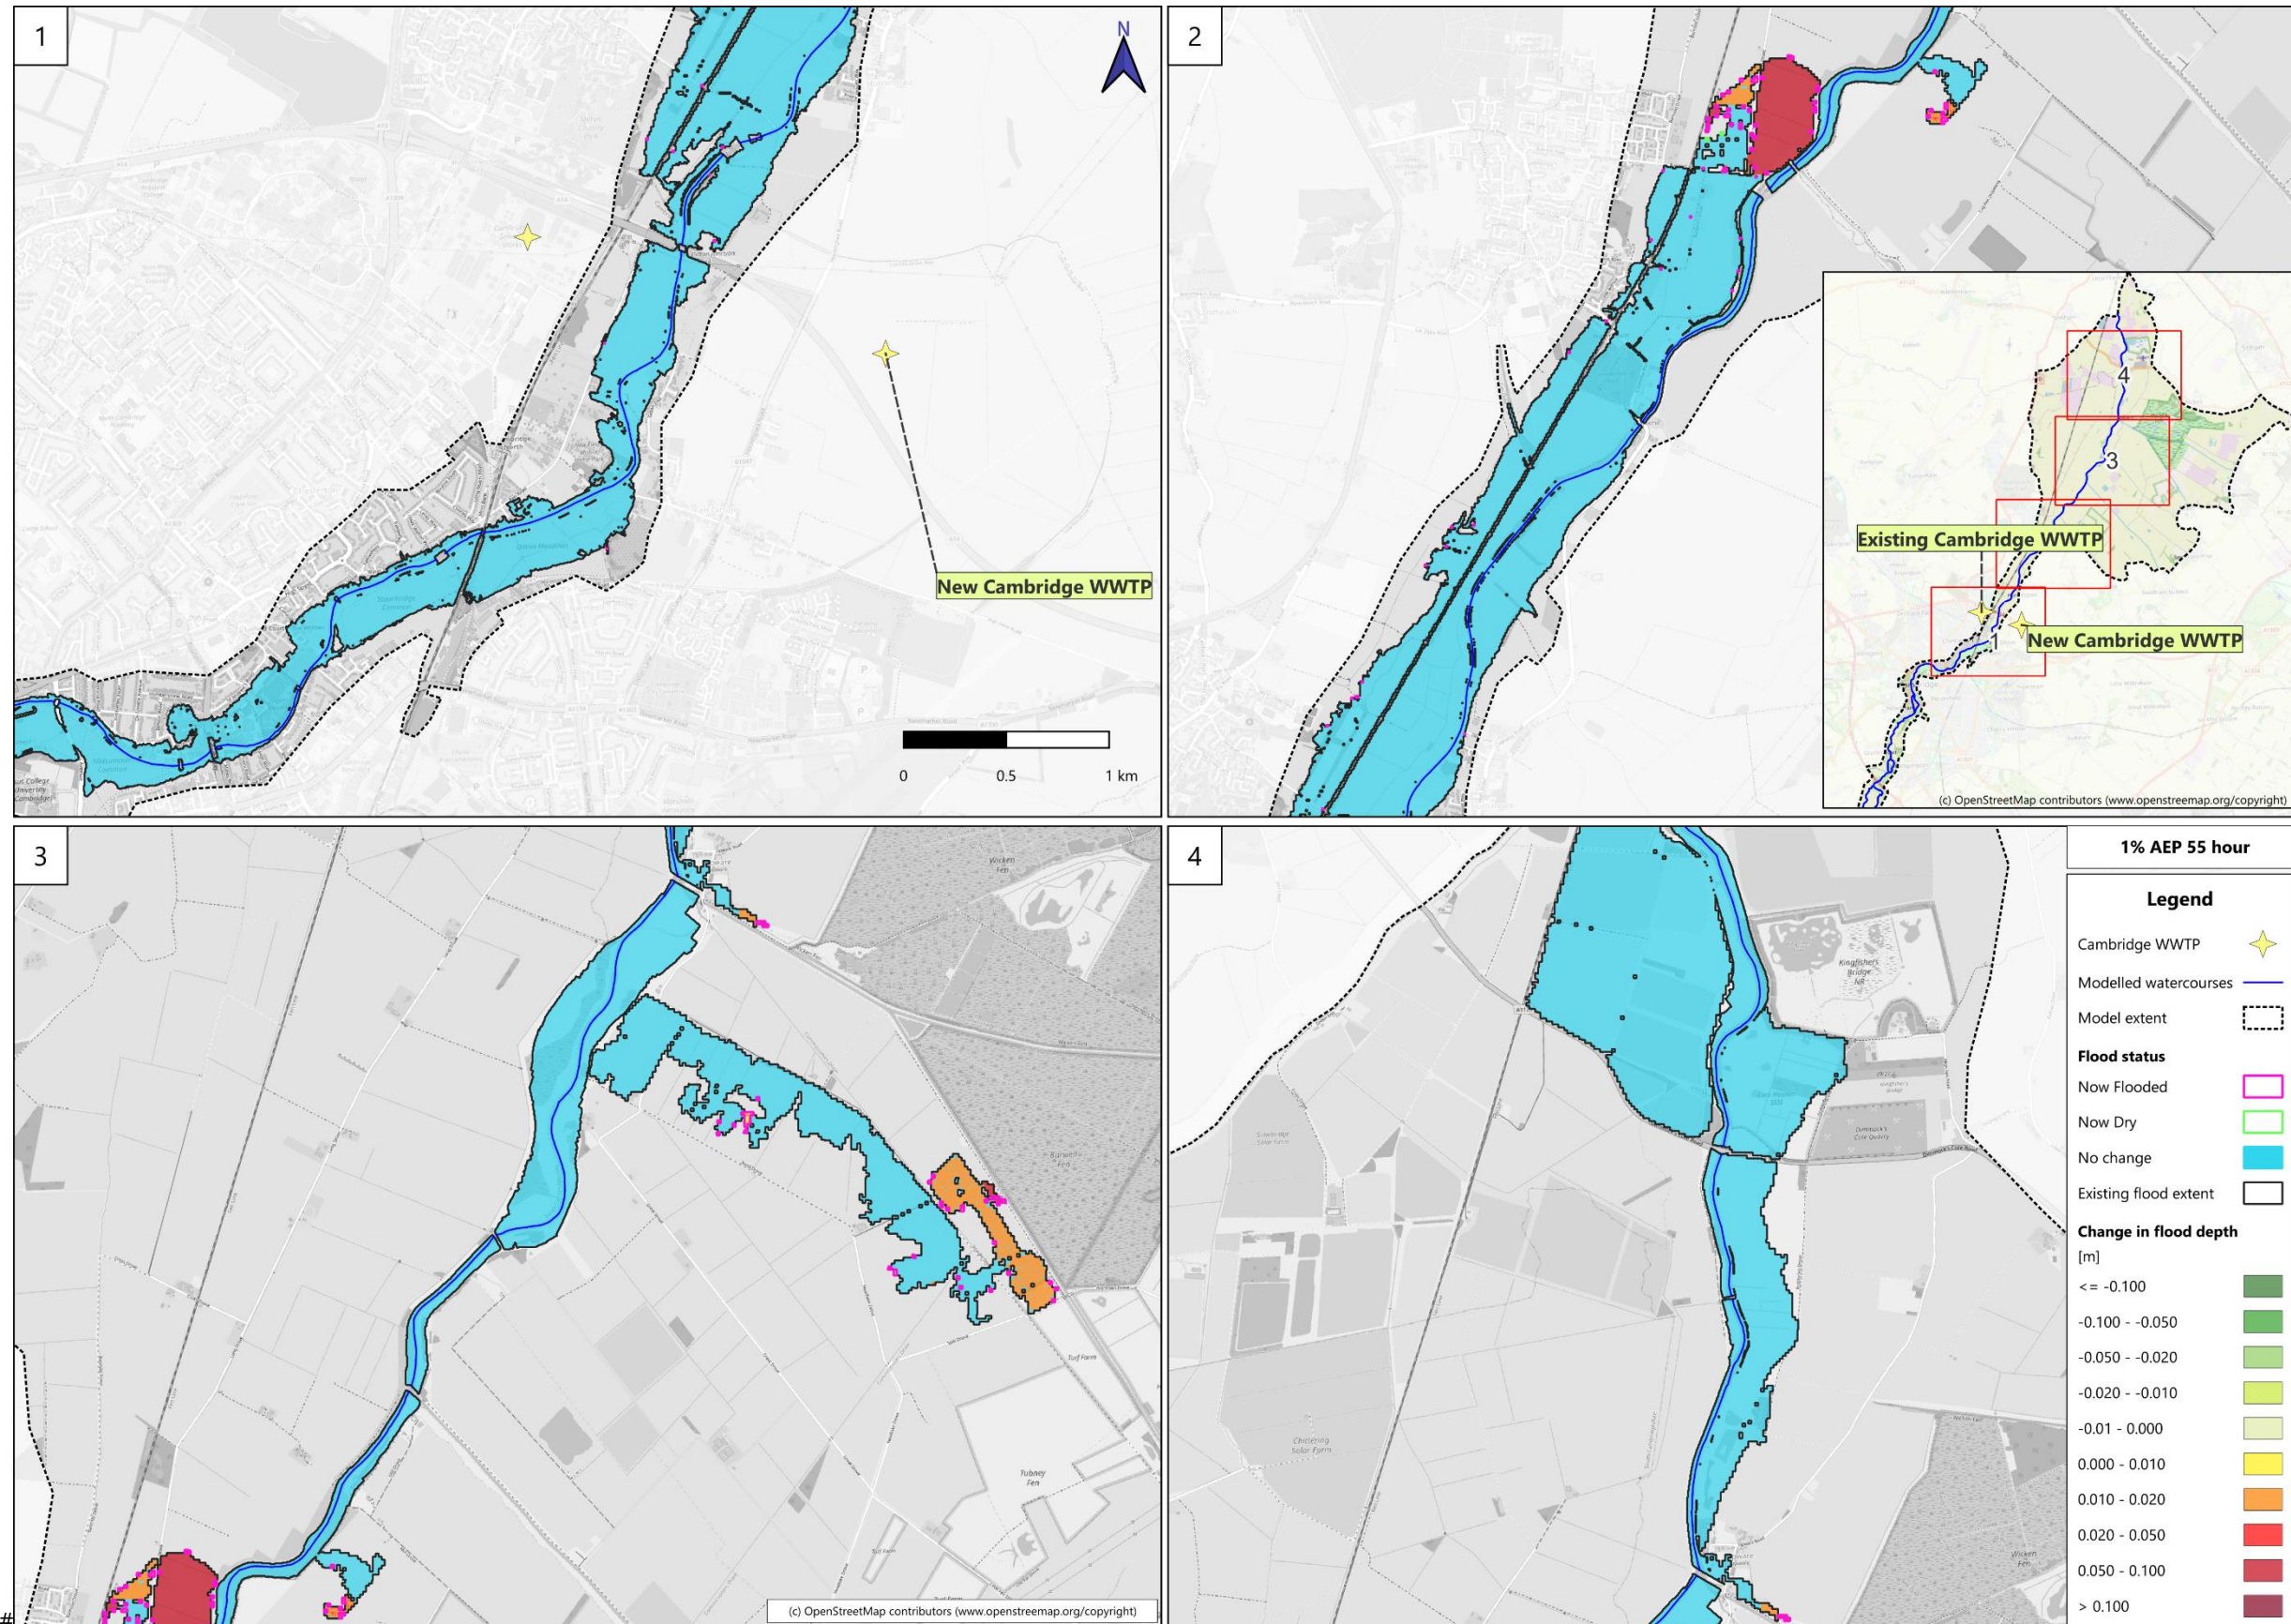


Figure 6-9 Existing (no growth) to Phase 1 New Outfall (with growth) change in flood extent and depth – 1 in 100 year, 55-hour storm

## 6.7 Non-flood conditions

In non-flood conditions (normal and low flows), river levels at the outfall location are controlled by the operation of Bates Bite Lock. Water levels upstream of Bates Bite Lock are maintained at around 3.85mAOD (normally within 3.80 to 3.90mAOD), as shown by both:

- The operating logic within the hydraulic model for the Bates Bite sluice gates (node CAM\_0200Sus).
- Recorded water levels for Bates Bite gauge. For example, as shown on the River Levels website<sup>4</sup>.

Figure 6-10 contains:

- The hydraulic model results for the model node at the A14 bridge (the WWTP outfall site), comparing flow and water levels. Results are presented for both the whole rising limb of the 1 in 2 year flood and the flood peaks for all the design floods considered.
- The nominal 3.85mAOD retention level.
- Flow exceedance statistics for the closest river flow gauging station – the River Cam at Bottisham, a short distance downstream.

These results confirm that even at the peak of the 1 in 2 year flood, water levels at the A14 are only 0.15m above the normal 3.85mAOD retention level at Bates Bite Lock. In normal flows and low flows, we would expect water levels at the outfall to be at, or very close to, 3.85mAOD.

---

<sup>4</sup> <https://riverlevels.uk/river-cam-fen-ditton-cambridge-baits-bite#.YlgtFcjMKUk>

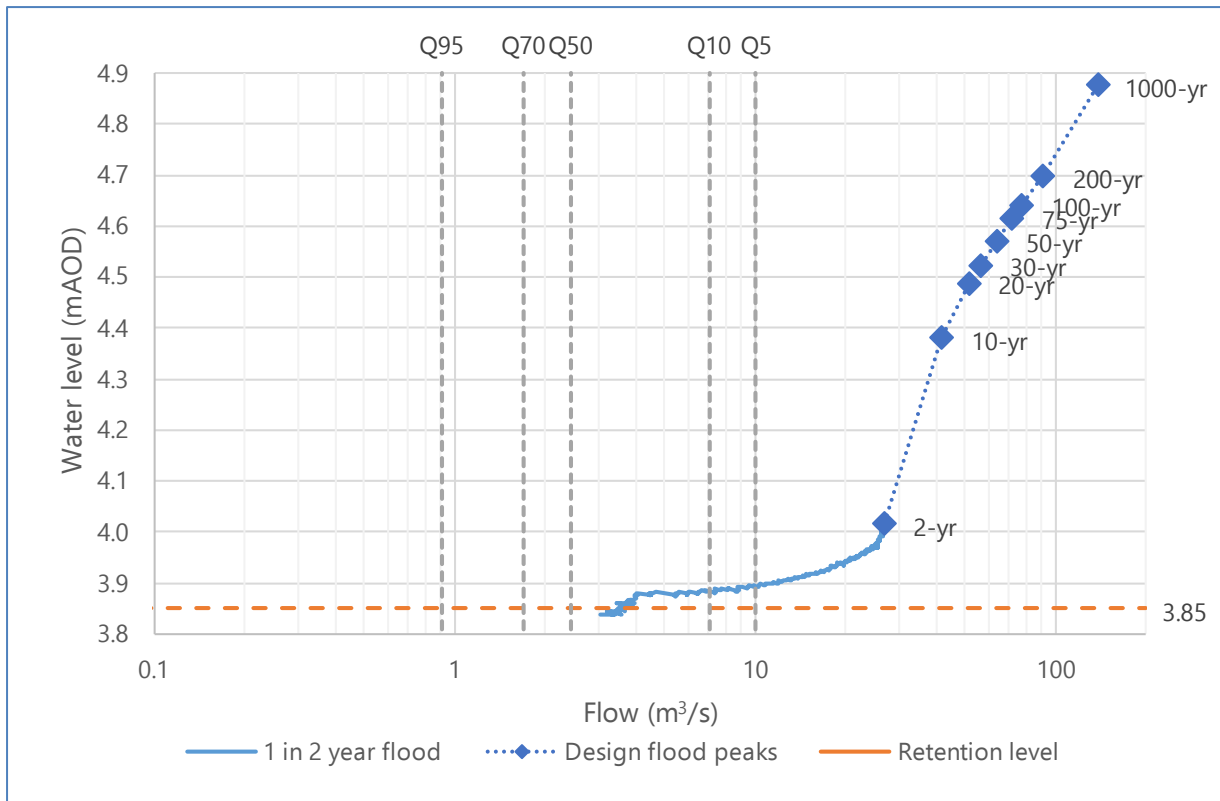


Figure 6-10. Water level – flow relationship at the new outfall (from hydraulic model results)

## 7. Conclusions

This report describes river modelling undertaken to assess the impact of the Cambridge WWTP Relocation project new outfall on fluvial flood risk in the River Cam.

The Environment Agency's 2023 Cam Urban river model was used with only minor modifications (to explicitly include the existing and new WWTP outfall discharge). Outfall discharges (existing and new outfall) were calculated using results from Anglian Water's Cambridge sewer model.

An additional scenario was tested, as recommended by the Environment Agency, to consider the existing outfall **with** future growth in the catchment to provide a more comparable case with which to compare to the new outfall.

It is important to note that:

- **For the Existing Outfall scenario, runoff in the sewer model is for the catchment as it is now.**
- **For the New Outfall scenario, runoff in the sewer model is for the catchment including future growth.** This means that the New Outfall flow volume is larger than for the Existing outfall. The new WWTP and outfall will not increase flow volume, it is only because future growth within the catchment is included for this scenario.
- **The additional Existing Future scenario accounts for future growth in the catchment but for the existing WWTP and outfall.**

The 1 in 100 year flood with and without climate change allowance was used as the primary design case and for sensitivity testing. A range of other fluvial flood magnitudes were also simulated.

There is a large difference in the critical storm durations for the WWTP outfall flows and the River Cam catchment – a 55-hour storm is the critical case for the whole River Cam fluvial catchment; whereas the critical case for the WWTP outfall discharge is a 4 hour storm. We have explored this issue using sensitivity testing for a 4-hour river catchment storm, in addition to the base case of a 55-hour storm.

When comparing the New Outfall (with growth) to the Existing outfall (without growth), the river model results show that:

- The new WWTP lies well outside the River Cam flood extents, even in the largest flood magnitudes.
- The 55-hour storm gives noticeably higher flood levels and larger flood extents than the 4-hour storm. This confirmed that the 55-hour storm is the right case for assessing flood risk from the River Cam.
- There is almost no change in peak water levels or flows in the River Cam for the New Outfall case compared to Existing. The maximum predicted increase in peak in-channel water level is 0.002m (2mm) at Baits Bite Lock in the 1 in 100 year flood (present day or climate change case). Across the range of flood magnitudes tested, the largest increase in in-channel flood levels is 0.010m for the 55-hour storm.

- There are no changes in flood depth and extent throughout Cambridge (upstream of the A14 / the WWTP outfalls) across all the flood magnitudes tested.
- There are some areas downstream of the outfall with small increases in flood depth and extent for the New Outfall (with growth) scenario compared to Existing (without growth). These predicted differences are a result of the increased flow volume through the New Outfall, due to including future growth within the catchment in this scenario. This is not a change due to the new WWTP or new outfall itself.
- The phasing of the new works (Phase 1 and Phase 2) would see a small increase in FFT (from 1.729m<sup>3</sup>/s in Phase 1 to 1.840m<sup>3</sup>/s in Phase 2). The impact of Phase 1 of the New Outfall has been tested for sensitivity and is marginally smaller than Phase 2; although depth increases would only be approximately 0.02m lower in the areas of greatest increase (from 0.07m in Phase 1 to 0.09m in Phase 2).
- In non-flood conditions, water levels at the outfall will be controlled by the operation of Baits Bite Lock, which has a normal retention level of around 3.85m AOD.

However, when the New Outfall (with growth) is compared to the Existing Future scenario (including future growth in the catchment), the river model results show that:

- The new outfall does not increase in-channel or floodplain water levels for the 1 in 100 year design storm (55-hour) anywhere in the study area beyond 0.001m, for the range of flood magnitudes considered.
- The new outfall would slightly increase water levels in a few isolated small areas within fields during the 1 in 100 year plus 9% climate change flood, where levels would increase by up to 0.1m. There are no properties within these areas.
- In other flood magnitudes, there are some very small reductions in flood depths and extent predicted with the new outfall compared to the existing outfall. Again, these are rural locations with no properties so there is no practical difference in flood risk.

In summary, we have found minimal impact from the new WWTP and outfall on fluvial flood risk. Even where small changes are shown, we believe these are due to the modelling assumptions and setup rather than genuine impacts from the new WWTP or outfall itself. The additional sensitivity testing requested by the Environment Agency has confirmed that the differences shown in flood extent and level are almost entirely due to future growth within the catchment, rather than the new WWTP or outfall. **The presence of the new WWTP and outfall does not increase flood risk.**

## Appendix A: River model review record



## **Appendix B: Results tables for other flood magnitudes 55-hour - comparing Existing (no growth) to New Outfall (with growth)**

### B.1 1 in 2 year flood

Location	Node	Existing outfall (no growth)	New outfall (with growth)	Increase
		<b>Peak water level (mAOD)</b>		<b>Level (m)</b>
M11	CAM01_4253	8.719	8.719	0.000
A1134 Fen Causeway	CAM02_7723d	7.145	7.145	0.000
Silver Street	CAM02_7160	5.814	5.814	0.000
Trinity Bridge	CAM02_6603	5.595	5.595	0.000
Bridge Street	CAM02_6177	5.406	5.406	0.000
Victoria Avenue	CAM02_5371	4.739	4.742	0.003
A1134 Elizabeth Way	CAM02_4494	4.614	4.618	0.004
Railway	CAM02_2638	4.349	4.353	0.004
A14	CAM02_0636	4.016	4.023	0.007
Baits Bite Lock US	CAM02_0200	3.911	3.918	0.007
Baits Bite Lock DS	CAM02_0000	3.495	3.503	0.008
Horningsea	CA14400	3.292	3.297	0.005
Waterbeach	CA12080J	2.836	2.838	0.002
Bottisham Lock US	CA10600J	2.725	2.725	0.000
Bottisham Lock DS	CA10560	2.552	2.560	0.008
Shrubbs Marina	Cam8794	2.468	2.475	0.007
Upware	Cam5007	2.365	2.373	0.008
A1123	Cam2651u	2.277	2.287	0.010
Great Ouse confluence	Cam0000	2.183	2.193	0.010
		<b>Peak flow (m<sup>3</sup>/s)</b>		<b>Flow (m<sup>3</sup>/s)</b>
M11	CAM01_4253	20.3	20.3	0.0
A1134 Fen Causeway	CAM02_7723d	22.3	22.3	0.0
Silver Street	CAM02_7160	25.2	25.2	0.0
Trinity Bridge	CAM02_6603	25.2	25.2	0.0
Bridge Street	CAM02_6177	26.5	26.5	0.0
Victoria Avenue	CAM02_5371	26.6	26.6	0.0
A1134 Elizabeth Way	CAM02_4494	26.5	26.5	0.0
Railway	CAM02_2638	26.6	26.6	-0.1
A14	CAM02_0636	26.9	26.7	-0.2
Baits Bite Lock US	CAM02_0200	27.3	27.5	0.2
Baits Bite Lock DS	CAM02_0000	27.3	27.5	0.2
Horningsea	CA14400	27.5	27.7	0.2
Waterbeach	CA12080J	27.6	27.8	0.2
Bottisham Lock US	CA10600J	27.8	28.0	0.3
Bottisham Lock DS	CA10560	27.8	28.0	0.3
Shrubbs Marina	Cam8794	30.1	30.2	0.2
Upware	Cam5007	30.7	30.9	0.2
A1123	Cam2651u	33.2	33.3	0.2
Great Ouse confluence	Cam0000	33.1	33.3	0.2

## B.2 1 in 10 year flood

Location	Node	Existing outfall (no growth)	New outfall (with growth)	Increase
		<b>Peak water level (mAOD)</b>		<b>Level (m)</b>
M11	CAM01_4253	9.131	9.131	0.000
A1134 Fen Causeway	CAM02_7723d	7.241	7.241	0.000
Silver Street	CAM02_7160	6.394	6.394	0.000
Trinity Bridge	CAM02_6603	6.104	6.104	0.000
Bridge Street	CAM02_6177	5.810	5.810	0.000
Victoria Avenue	CAM02_5371	5.245	5.246	0.001
A1134 Elizabeth Way	CAM02_4494	5.079	5.080	0.001
Railway	CAM02_2638	4.780	4.781	0.001
A14	CAM02_0636	4.381	4.383	0.002
Baits Bite Lock US	CAM02_0200	4.233	4.236	0.003
Baits Bite Lock DS	CAM02_0000	3.974	3.977	0.003
Horningsea	CA14400	3.773	3.777	0.004
Waterbeach	CA12080J	3.260	3.268	0.008
Bottisham Lock US	CA10600J	3.145	3.153	0.008
Bottisham Lock DS	CA10560	3.036	3.042	0.006
Shrubbs Marina	Cam8794	2.950	2.956	0.006
Upware	Cam5007	2.865	2.871	0.006
A1123	Cam2651u	2.802	2.809	0.007
Great Ouse confluence	Cam0000	2.732	2.739	0.007
		<b>Peak flow (m<sup>3</sup>/s)</b>		<b>Flow (m<sup>3</sup>/s)</b>
M11	CAM01_4253	32.8	32.8	0.0
A1134 Fen Causeway	CAM02_7723d	27.6	27.6	0.0
Silver Street	CAM02_7160	40.6	40.6	0.0
Trinity Bridge	CAM02_6603	40.6	40.6	0.0
Bridge Street	CAM02_6177	41.6	41.6	0.0
Victoria Avenue	CAM02_5371	41.3	41.3	0.0
A1134 Elizabeth Way	CAM02_4494	41.6	41.6	0.0
Railway	CAM02_2638	41.8	41.8	0.0
A14	CAM02_0636	42.0	41.7	-0.2
Baits Bite Lock US	CAM02_0200	40.8	40.9	0.1
Baits Bite Lock DS	CAM02_0000	40.8	40.9	0.1
Horningsea	CA14400	37.9	37.9	0.0
Waterbeach	CA12080J	38.6	38.7	0.0
Bottisham Lock US	CA10600J	37.9	38.1	0.2
Bottisham Lock DS	CA10560	37.9	38.1	0.2
Shrubbs Marina	Cam8794	40.3	40.5	0.2
Upware	Cam5007	41.2	41.4	0.2
A1123	Cam2651u	45.1	45.1	0.0
Great Ouse confluence	Cam0000	44.2	44.4	0.2

### B.3 1 in 20 year flood

Location	Node	Existing outfall (no growth)	New outfall (with growth)	Increase
		<b>Peak water level (mAOD)</b>		<b>Level (m)</b>
M11	CAM01_4253	9.240	9.240	0.000
A1134 Fen Causeway	CAM02_7723d	7.290	7.290	0.000
Silver Street	CAM02_7160	6.766	6.766	0.000
Trinity Bridge	CAM02_6603	6.432	6.432	0.000
Bridge Street	CAM02_6177	6.062	6.062	0.000
Victoria Avenue	CAM02_5371	5.484	5.484	0.000
A1134 Elizabeth Way	CAM02_4494	5.284	5.284	0.000
Railway	CAM02_2638	4.940	4.940	0.000
A14	CAM02_0636	4.488	4.489	0.001
Baits Bite Lock US	CAM02_0200	4.337	4.339	0.002
Baits Bite Lock DS	CAM02_0000	4.073	4.075	0.002
Horningsea	CA14400	3.915	3.917	0.002
Waterbeach	CA12080J	3.582	3.588	0.006
Bottisham Lock US	CA10600J	3.471	3.477	0.006
Bottisham Lock DS	CA10560	3.371	3.378	0.007
Shrubbs Marina	Cam8794	3.288	3.295	0.007
Upware	Cam5007	3.212	3.218	0.006
A1123	Cam2651u	3.159	3.166	0.007
Great Ouse confluence	Cam0000	3.106	3.113	0.007
		<b>Peak flow (m<sup>3</sup>/s)</b>		<b>Flow (m<sup>3</sup>/s)</b>
M11	CAM01_4253	41.3	41.3	0.0
A1134 Fen Causeway	CAM02_7723d	29.1	29.1	0.0
Silver Street	CAM02_7160	52.4	52.3	-0.2
Trinity Bridge	CAM02_6603	51.9	52.0	0.0
Bridge Street	CAM02_6177	53.3	53.3	0.0
Victoria Avenue	CAM02_5371	52.4	52.4	0.0
A1134 Elizabeth Way	CAM02_4494	53.2	53.2	0.0
Railway	CAM02_2638	53.3	53.3	0.0
A14	CAM02_0636	51.5	51.4	-0.2
Baits Bite Lock US	CAM02_0200	45.7	45.8	0.1
Baits Bite Lock DS	CAM02_0000	45.7	45.8	0.1
Horningsea	CA14400	38.4	38.4	0.0
Waterbeach	CA12080J	50.2	50.3	0.1
Bottisham Lock US	CA10600J	50.5	50.7	0.2
Bottisham Lock DS	CA10560	50.5	50.7	0.2
Shrubbs Marina	Cam8794	52.6	52.7	0.2
Upware	Cam5007	51.0	51.2	0.1
A1123	Cam2651u	53.6	53.7	0.2
Great Ouse confluence	Cam0000	52.9	53.1	0.2

### B.4 1 in 30 year flood

Location	Node	Existing outfall (no growth)	New outfall (with growth)	Increase
		<b>Peak water level (mAOD)</b>		<b>Level (m)</b>
M11	CAM01_4253	9.286	9.286	0.000
A1134 Fen Causeway	CAM02_7723d	7.316	7.316	0.000
Silver Street	CAM02_7160	6.891	6.891	0.000
Trinity Bridge	CAM02_6603	6.539	6.539	0.000
Bridge Street	CAM02_6177	6.141	6.141	0.000
Victoria Avenue	CAM02_5371	5.550	5.550	0.000
A1134 Elizabeth Way	CAM02_4494	5.345	5.345	0.000
Railway	CAM02_2638	4.996	4.996	0.000
A14	CAM02_0636	4.524	4.525	0.001
Baits Bite Lock US	CAM02_0200	4.373	4.375	0.002
Baits Bite Lock DS	CAM02_0000	4.105	4.106	0.001
Horningsea	CA14400	3.953	3.955	0.002
Waterbeach	CA12080J	3.722	3.728	0.006
Bottisham Lock US	CA10600J	3.615	3.620	0.005
Bottisham Lock DS	CA10560	3.523	3.529	0.006
Shrubbs Marina	Cam8794	3.443	3.448	0.005
Upware	Cam5007	3.370	3.376	0.006
A1123	Cam2651u	3.320	3.326	0.006
Great Ouse confluence	Cam0000	3.272	3.278	0.006
		<b>Peak flow (m<sup>3</sup>/s)</b>		<b>Flow (m<sup>3</sup>/s)</b>
M11	CAM01_4253	44.8	44.8	0.0
A1134 Fen Causeway	CAM02_7723d	29.1	29.1	0.0
Silver Street	CAM02_7160	56.2	56.2	0.0
Trinity Bridge	CAM02_6603	56.2	56.2	0.0
Bridge Street	CAM02_6177	57.4	57.4	0.0
Victoria Avenue	CAM02_5371	55.6	55.6	0.0
A1134 Elizabeth Way	CAM02_4494	56.6	56.5	0.0
Railway	CAM02_2638	56.8	56.8	0.0
A14	CAM02_0636	56.3	56.2	-0.1
Baits Bite Lock US	CAM02_0200	47.7	47.8	0.1
Baits Bite Lock DS	CAM02_0000	47.7	47.8	0.1
Horningsea	CA14400	38.8	39.0	0.2
Waterbeach	CA12080J	52.5	52.5	0.1
Bottisham Lock US	CA10600J	55.0	55.2	0.2
Bottisham Lock DS	CA10560	55.0	55.2	0.2
Shrubbs Marina	Cam8794	57.0	57.1	0.1
Upware	Cam5007	54.9	55.0	0.1
A1123	Cam2651u	57.6	57.8	0.2
Great Ouse confluence	Cam0000	57.0	57.2	0.2

### B.5 1 in 50 year flood

Location	Node	Existing outfall (no growth)	New outfall (with growth)	Increase
		Peak water level (mAOD)		Level (m)
M11	CAM01_4253	9.352	9.352	0.000
A1134 Fen Causeway	CAM02_7723d	7.365	7.365	0.000
Silver Street	CAM02_7160	7.087	7.087	0.000
Trinity Bridge	CAM02_6603	6.715	6.715	0.000
Bridge Street	CAM02_6177	6.274	6.274	0.000
Victoria Avenue	CAM02_5371	5.662	5.662	0.000
A1134 Elizabeth Way	CAM02_4494	5.440	5.440	0.000
Railway	CAM02_2638	5.072	5.072	0.000
A14	CAM02_0636	4.572	4.572	0.000
Baits Bite Lock US	CAM02_0200	4.424	4.426	0.002
Baits Bite Lock DS	CAM02_0000	4.164	4.166	0.002
Horningsea	CA14400	4.034	4.037	0.003
Waterbeach	CA12080J	3.898	3.903	0.005
Bottisham Lock US	CA10600J	3.785	3.790	0.005
Bottisham Lock DS	CA10560	3.706	3.711	0.005
Shrubbs Marina	Cam8794	3.627	3.632	0.005
Upware	Cam5007	3.557	3.562	0.005
A1123	Cam2651u	3.510	3.514	0.004
Great Ouse confluence	Cam0000	3.464	3.469	0.005
		Peak flow (m <sup>3</sup> /s)		Flow (m <sup>3</sup> /s)
M11	CAM01_4253	50.2	50.2	0.0
A1134 Fen Causeway	CAM02_7723d	29.1	29.1	0.0
Silver Street	CAM02_7160	60.7	60.7	0.0
Trinity Bridge	CAM02_6603	62.9	62.9	0.0
Bridge Street	CAM02_6177	64.3	64.3	0.0
Victoria Avenue	CAM02_5371	62.7	62.7	0.0
A1134 Elizabeth Way	CAM02_4494	63.7	63.7	0.0
Railway	CAM02_2638	64.5	64.5	0.0
A14	CAM02_0636	63.7	63.6	-0.1
Baits Bite Lock US	CAM02_0200	50.4	50.4	0.1
Baits Bite Lock DS	CAM02_0000	50.4	50.4	0.1
Horningsea	CA14400	39.3	39.5	0.1
Waterbeach	CA12080J	53.7	53.7	0.0
Bottisham Lock US	CA10600J	61.3	61.5	0.1
Bottisham Lock DS	CA10560	61.3	61.5	0.1
Shrubbs Marina	Cam8794	63.0	63.1	0.1
Upware	Cam5007	60.0	60.1	0.1
A1123	Cam2651u	62.8	63.0	0.2
Great Ouse confluence	Cam0000	62.0	62.2	0.1

### B.6 1 in 75 year flood

Location	Node	Existing outfall (no growth)	New outfall (with growth)	Increase
		Peak water level (mAOD)		Level (m)
M11	CAM01_4253	9.420	9.420	0.000
A1134 Fen Causeway	CAM02_7723d	7.436	7.436	0.000
Silver Street	CAM02_7160	7.281	7.281	0.000
Trinity Bridge	CAM02_6603	6.904	6.904	0.000
Bridge Street	CAM02_6177	6.419	6.419	0.000
Victoria Avenue	CAM02_5371	5.772	5.772	0.000
A1134 Elizabeth Way	CAM02_4494	5.534	5.534	0.000
Railway	CAM02_2638	5.154	5.154	0.000
A14	CAM02_0636	4.617	4.617	0.000
Baits Bite Lock US	CAM02_0200	4.477	4.479	0.002
Baits Bite Lock DS	CAM02_0000	4.247	4.250	0.003
Horningsea	CA14400	4.149	4.152	0.003
Waterbeach	CA12080J	4.053	4.055	0.002
Bottisham Lock US	CA10600J	3.921	3.923	0.002
Bottisham Lock DS	CA10560	3.840	3.842	0.002
Shrubbs Marina	Cam8794	3.746	3.747	0.001
Upware	Cam5007	3.662	3.663	0.001
A1123	Cam2651u	3.606	3.607	0.001
Great Ouse confluence	Cam0000	3.558	3.559	0.001
		Peak flow (m <sup>3</sup> /s)		Flow (m <sup>3</sup> /s)
M11	CAM01_4253	56.6	56.6	0.0
A1134 Fen Causeway	CAM02_7723d	34.0	34.0	0.0
Silver Street	CAM02_7160	63.9	63.9	0.0
Trinity Bridge	CAM02_6603	71.1	71.1	0.0
Bridge Street	CAM02_6177	72.8	72.8	0.0
Victoria Avenue	CAM02_5371	70.5	70.5	0.0
A1134 Elizabeth Way	CAM02_4494	71.6	71.6	0.0
Railway	CAM02_2638	73.1	73.1	0.0
A14	CAM02_0636	72.0	71.9	-0.1
Baits Bite Lock US	CAM02_0200	52.6	52.7	0.1
Baits Bite Lock DS	CAM02_0000	52.6	52.7	0.1
Horningsea	CA14400	39.8	39.8	0.0
Waterbeach	CA12080J	54.7	54.6	-0.1
Bottisham Lock US	CA10600J	67.3	67.4	0.1
Bottisham Lock DS	CA10560	67.3	67.4	0.1
Shrubbs Marina	Cam8794	68.8	68.9	0.1
Upware	Cam5007	67.8	67.9	0.1
A1123	Cam2651u	72.4	72.5	0.2
Great Ouse confluence	Cam0000	64.5	64.5	0.0

### B.7 1 in 200 year flood

Location	Node	Existing outfall (no growth)	New outfall (with growth)	Increase
		Peak water level (mAOD)		Level (m)
M11	CAM01_4253	9.562	9.562	0.000
A1134 Fen Causeway	CAM02_7723d	7.755	7.755	0.000
Silver Street	CAM02_7160	7.728	7.728	0.000
Trinity Bridge	CAM02_6603	7.315	7.315	0.000
Bridge Street	CAM02_6177	6.705	6.705	0.000
Victoria Avenue	CAM02_5371	5.996	5.996	0.000
A1134 Elizabeth Way	CAM02_4494	5.736	5.736	0.000
Railway	CAM02_2638	5.332	5.332	0.000
A14	CAM02_0636	4.698	4.698	0.000
Baits Bite Lock US	CAM02_0200	4.570	4.571	0.001
Baits Bite Lock DS	CAM02_0000	4.382	4.384	0.002
Horningsea	CA14400	4.293	4.295	0.002
Waterbeach	CA12080J	4.176	4.177	0.001
Bottisham Lock US	CA10600J	4.012	4.012	0.000
Bottisham Lock DS	CA10560	3.922	3.922	0.000
Shrubbs Marina	Cam8794	3.809	3.809	0.000
Upware	Cam5007	3.708	3.708	0.000
A1123	Cam2651u	3.644	3.644	0.000
Great Ouse confluence	Cam0000	3.593	3.593	0.000
		Peak flow (m <sup>3</sup> /s)		Flow (m <sup>3</sup> /s)
M11	CAM01_4253	72.2	72.2	0.0
A1134 Fen Causeway	CAM02_7723d	40.4	40.4	0.0
Silver Street	CAM02_7160	71.4	71.4	0.0
Trinity Bridge	CAM02_6603	89.9	89.9	0.0
Bridge Street	CAM02_6177	92.6	92.6	0.0
Victoria Avenue	CAM02_5371	77.7	77.7	0.0
A1134 Elizabeth Way	CAM02_4494	90.1	90.1	0.0
Railway	CAM02_2638	93.3	93.3	0.0
A14	CAM02_0636	91.2	91.2	0.0
Baits Bite Lock US	CAM02_0200	55.7	55.7	0.0
Baits Bite Lock DS	CAM02_0000	55.7	55.7	0.0
Horningsea	CA14400	40.5	40.6	0.1
Waterbeach	CA12080J	56.3	56.3	0.0
Bottisham Lock US	CA10600J	76.2	76.1	-0.1
Bottisham Lock DS	CA10560	76.2	76.1	-0.1
Shrubbs Marina	Cam8794	77.3	77.1	-0.2
Upware	Cam5007	74.1	74.1	0.0
A1123	Cam2651u	80.0	80.1	0.0
Great Ouse confluence	Cam0000	65.5	65.5	0.0



### B.8 1 in 1000 year flood

Location	Node	Existing outfall (no growth)	New outfall (with growth)	Increase
		<b>Peak water level (mAOD)</b>		<b>Level (m)</b>
M11	CAM01_4253	9.942	9.942	0.000
A1134 Fen Causeway	CAM02_7723d	8.632	8.632	0.000
Silver Street	CAM02_7160	8.596	8.596	0.000
Trinity Bridge	CAM02_6603	8.199	8.199	0.000
Bridge Street	CAM02_6177	7.157	7.157	0.000
Victoria Avenue	CAM02_5371	6.500	6.500	0.000
A1134 Elizabeth Way	CAM02_4494	6.170	6.170	0.000
Railway	CAM02_2638	5.740	5.740	0.000
A14	CAM02_0636	4.877	4.876	-0.001
Baits Bite Lock US	CAM02_0200	4.724	4.725	0.001
Baits Bite Lock DS	CAM02_0000	4.572	4.573	0.001
Horningsea	CA14400	4.487	4.488	0.001
Waterbeach	CA12080J	4.298	4.298	0.000
Bottisham Lock US	CA10600J	4.086	4.086	0.000
Bottisham Lock DS	CA10560	3.986	3.985	-0.001
Shrubbs Marina	Cam8794	3.851	3.851	0.000
Upware	Cam5007	3.737	3.737	0.000
A1123	Cam2651u	3.667	3.667	0.000
Great Ouse confluence	Cam0000	3.613	3.613	0.000
		<b>Peak flow (m<sup>3</sup>/s)</b>		<b>Flow (m<sup>3</sup>/s)</b>
M11	CAM01_4253	113.0	113.0	0.0
A1134 Fen Causeway	CAM02_7723d	48.4	48.3	0.0
Silver Street	CAM02_7160	96.7	96.7	0.0
Trinity Bridge	CAM02_6603	92.6	92.6	0.0
Bridge Street	CAM02_6177	143.4	143.4	0.0
Victoria Avenue	CAM02_5371	81.0	81.0	0.0
A1134 Elizabeth Way	CAM02_4494	127.5	127.5	0.0
Railway	CAM02_2638	145.1	145.1	0.0
A14	CAM02_0636	138.9	139.0	0.0
Baits Bite Lock US	CAM02_0200	63.6	63.6	0.0
Baits Bite Lock DS	CAM02_0000	63.6	63.6	0.0
Horningsea	CA14400	41.1	41.1	0.0
Waterbeach	CA12080J	58.6	58.6	0.0
Bottisham Lock US	CA10600J	84.6	84.7	0.1
Bottisham Lock DS	CA10560	84.6	84.7	0.1
Shrubbs Marina	Cam8794	85.2	85.2	0.0
Upware	Cam5007	78.9	78.9	0.0
A1123	Cam2651u	86.4	86.4	0.0
Great Ouse confluence	Cam0000	66.0	66.0	0.0

### B.9 1 in 100 year flood + 19% climate change


Location	Node	Existing outfall (no growth)	New outfall (with growth)	Increase
		<b>Peak water level (mAOD)</b>		<b>Level (m)</b>
M11	CAM01_4253	9.609	9.609	0.000
A1134 Fen Causeway	CAM02_7723d	7.892	7.892	0.000
Silver Street	CAM02_7160	7.742	7.742	0.000
Trinity Bridge	CAM02_6603	7.314	7.314	0.000
Bridge Street	CAM02_6177	6.705	6.705	0.000
Victoria Avenue	CAM02_5371	5.996	5.996	0.000
A1134 Elizabeth Way	CAM02_4494	5.736	5.736	0.000
Railway	CAM02_2638	5.331	5.331	0.000
A14	CAM02_0636	4.697	4.697	0.000
Baits Bite Lock US	CAM02_0200	4.569	4.570	0.001
Baits Bite Lock DS	CAM02_0000	4.380	4.381	0.001
Horningsea	CA14400	4.290	4.292	0.002
Waterbeach	CA12080J	4.173	4.173	0.000
Bottisham Lock US	CA10600J	4.011	4.011	0.000
Bottisham Lock DS	CA10560	3.922	3.922	0.000
Shrubbs Marina	Cam8794	3.808	3.809	0.001
Upware	Cam5007	3.708	3.708	0.000
A1123	Cam2651u	3.644	3.644	0.000
Great Ouse confluence	Cam0000	3.593	3.593	0.000
		<b>Peak flow (m<sup>3</sup>/s)</b>		<b>Flow (m<sup>3</sup>/s)</b>
M11	CAM01_4253	71.5	71.5	0.0
A1134 Fen Causeway	CAM02_7723d	43.1	43.1	0.0
Silver Street	CAM02_7160	78.6	78.6	0.0
Trinity Bridge	CAM02_6603	89.8	89.8	0.0
Bridge Street	CAM02_6177	92.6	92.6	0.0
Victoria Avenue	CAM02_5371	77.8	77.8	0.0
A1134 Elizabeth Way	CAM02_4494	90.1	90.1	0.0
Railway	CAM02_2638	93.3	93.3	0.0
A14	CAM02_0636	91.1	91.1	0.0
Baits Bite Lock US	CAM02_0200	55.7	55.7	0.0
Baits Bite Lock DS	CAM02_0000	55.7	55.7	0.0
Horningsea	CA14400	40.5	40.5	0.0
Waterbeach	CA12080J	55.7	55.7	0.0
Bottisham Lock US	CA10600J	75.9	75.8	-0.1
Bottisham Lock DS	CA10560	75.9	75.8	-0.1
Shrubbs Marina	Cam8794	77.1	76.9	-0.1
Upware	Cam5007	74.1	74.1	0.0
A1123	Cam2651u	80.1	80.1	0.0
Great Ouse confluence	Cam0000	65.5	65.5	0.0

### B.10 1 in 100 year flood + 45% climate change


Location	Node	Existing outfall (no growth)	New outfall (with growth)	Increase
		<b>Peak water level (mAOD)</b>		<b>Level (m)</b>
M11	CAM01_4253	9.738	9.738	0.000
A1134 Fen Causeway	CAM02_7723d	8.206	8.206	0.000
Silver Street	CAM02_7160	8.128	8.128	0.000
Trinity Bridge	CAM02_6603	7.703	7.703	0.000
Bridge Street	CAM02_6177	6.900	6.900	0.000
Victoria Avenue	CAM02_5371	6.204	6.204	0.000
A1134 Elizabeth Way	CAM02_4494	5.911	5.911	0.000
Railway	CAM02_2638	5.504	5.504	0.000
A14	CAM02_0636	4.768	4.767	-0.001
Baits Bite Lock US	CAM02_0200	4.637	4.637	0.000
Baits Bite Lock DS	CAM02_0000	4.466	4.467	0.001
Horningsea	CA14400	4.379	4.379	0.000
Waterbeach	CA12080J	4.232	4.232	0.000
Bottisham Lock US	CA10600J	4.050	4.050	0.000
Bottisham Lock DS	CA10560	3.956	3.956	0.000
Shrubbs Marina	Cam8794	3.833	3.833	0.000
Upware	Cam5007	3.725	3.725	0.000
A1123	Cam2651u	3.658	3.658	0.000
Great Ouse confluence	Cam0000	3.606	3.606	0.000
		<b>Peak flow (m<sup>3</sup>/s)</b>		<b>Flow (m<sup>3</sup>/s)</b>
M11	CAM01_4253	86.2	86.2	0.0
A1134 Fen Causeway	CAM02_7723d	44.8	44.8	0.0
Silver Street	CAM02_7160	85.8	85.8	0.0
Trinity Bridge	CAM02_6603	92.0	92.0	0.0
Bridge Street	CAM02_6177	113.2	113.2	0.0
Victoria Avenue	CAM02_5371	79.5	79.5	0.0
A1134 Elizabeth Way	CAM02_4494	105.0	105.0	0.0
Railway	CAM02_2638	113.8	113.8	0.0
A14	CAM02_0636	110.5	110.5	0.0
Baits Bite Lock US	CAM02_0200	58.4	58.5	0.0
Baits Bite Lock DS	CAM02_0000	58.4	58.5	0.0
Horningsea	CA14400	40.9	40.8	0.0
Waterbeach	CA12080J	57.5	57.5	0.0
Bottisham Lock US	CA10600J	79.9	79.7	-0.1
Bottisham Lock DS	CA10560	79.9	79.7	-0.1
Shrubbs Marina	Cam8794	80.7	80.5	-0.2
Upware	Cam5007	76.3	76.3	0.0
A1123	Cam2651u	83.9	83.9	0.0
Great Ouse confluence	Cam0000	65.8	65.8	0.0

## **Appendix C: Flood difference for other flood magnitudes 55-hour – comparing Existing (no growth) to New Outfall (with growth)**


C.1 1 in 2 year flood

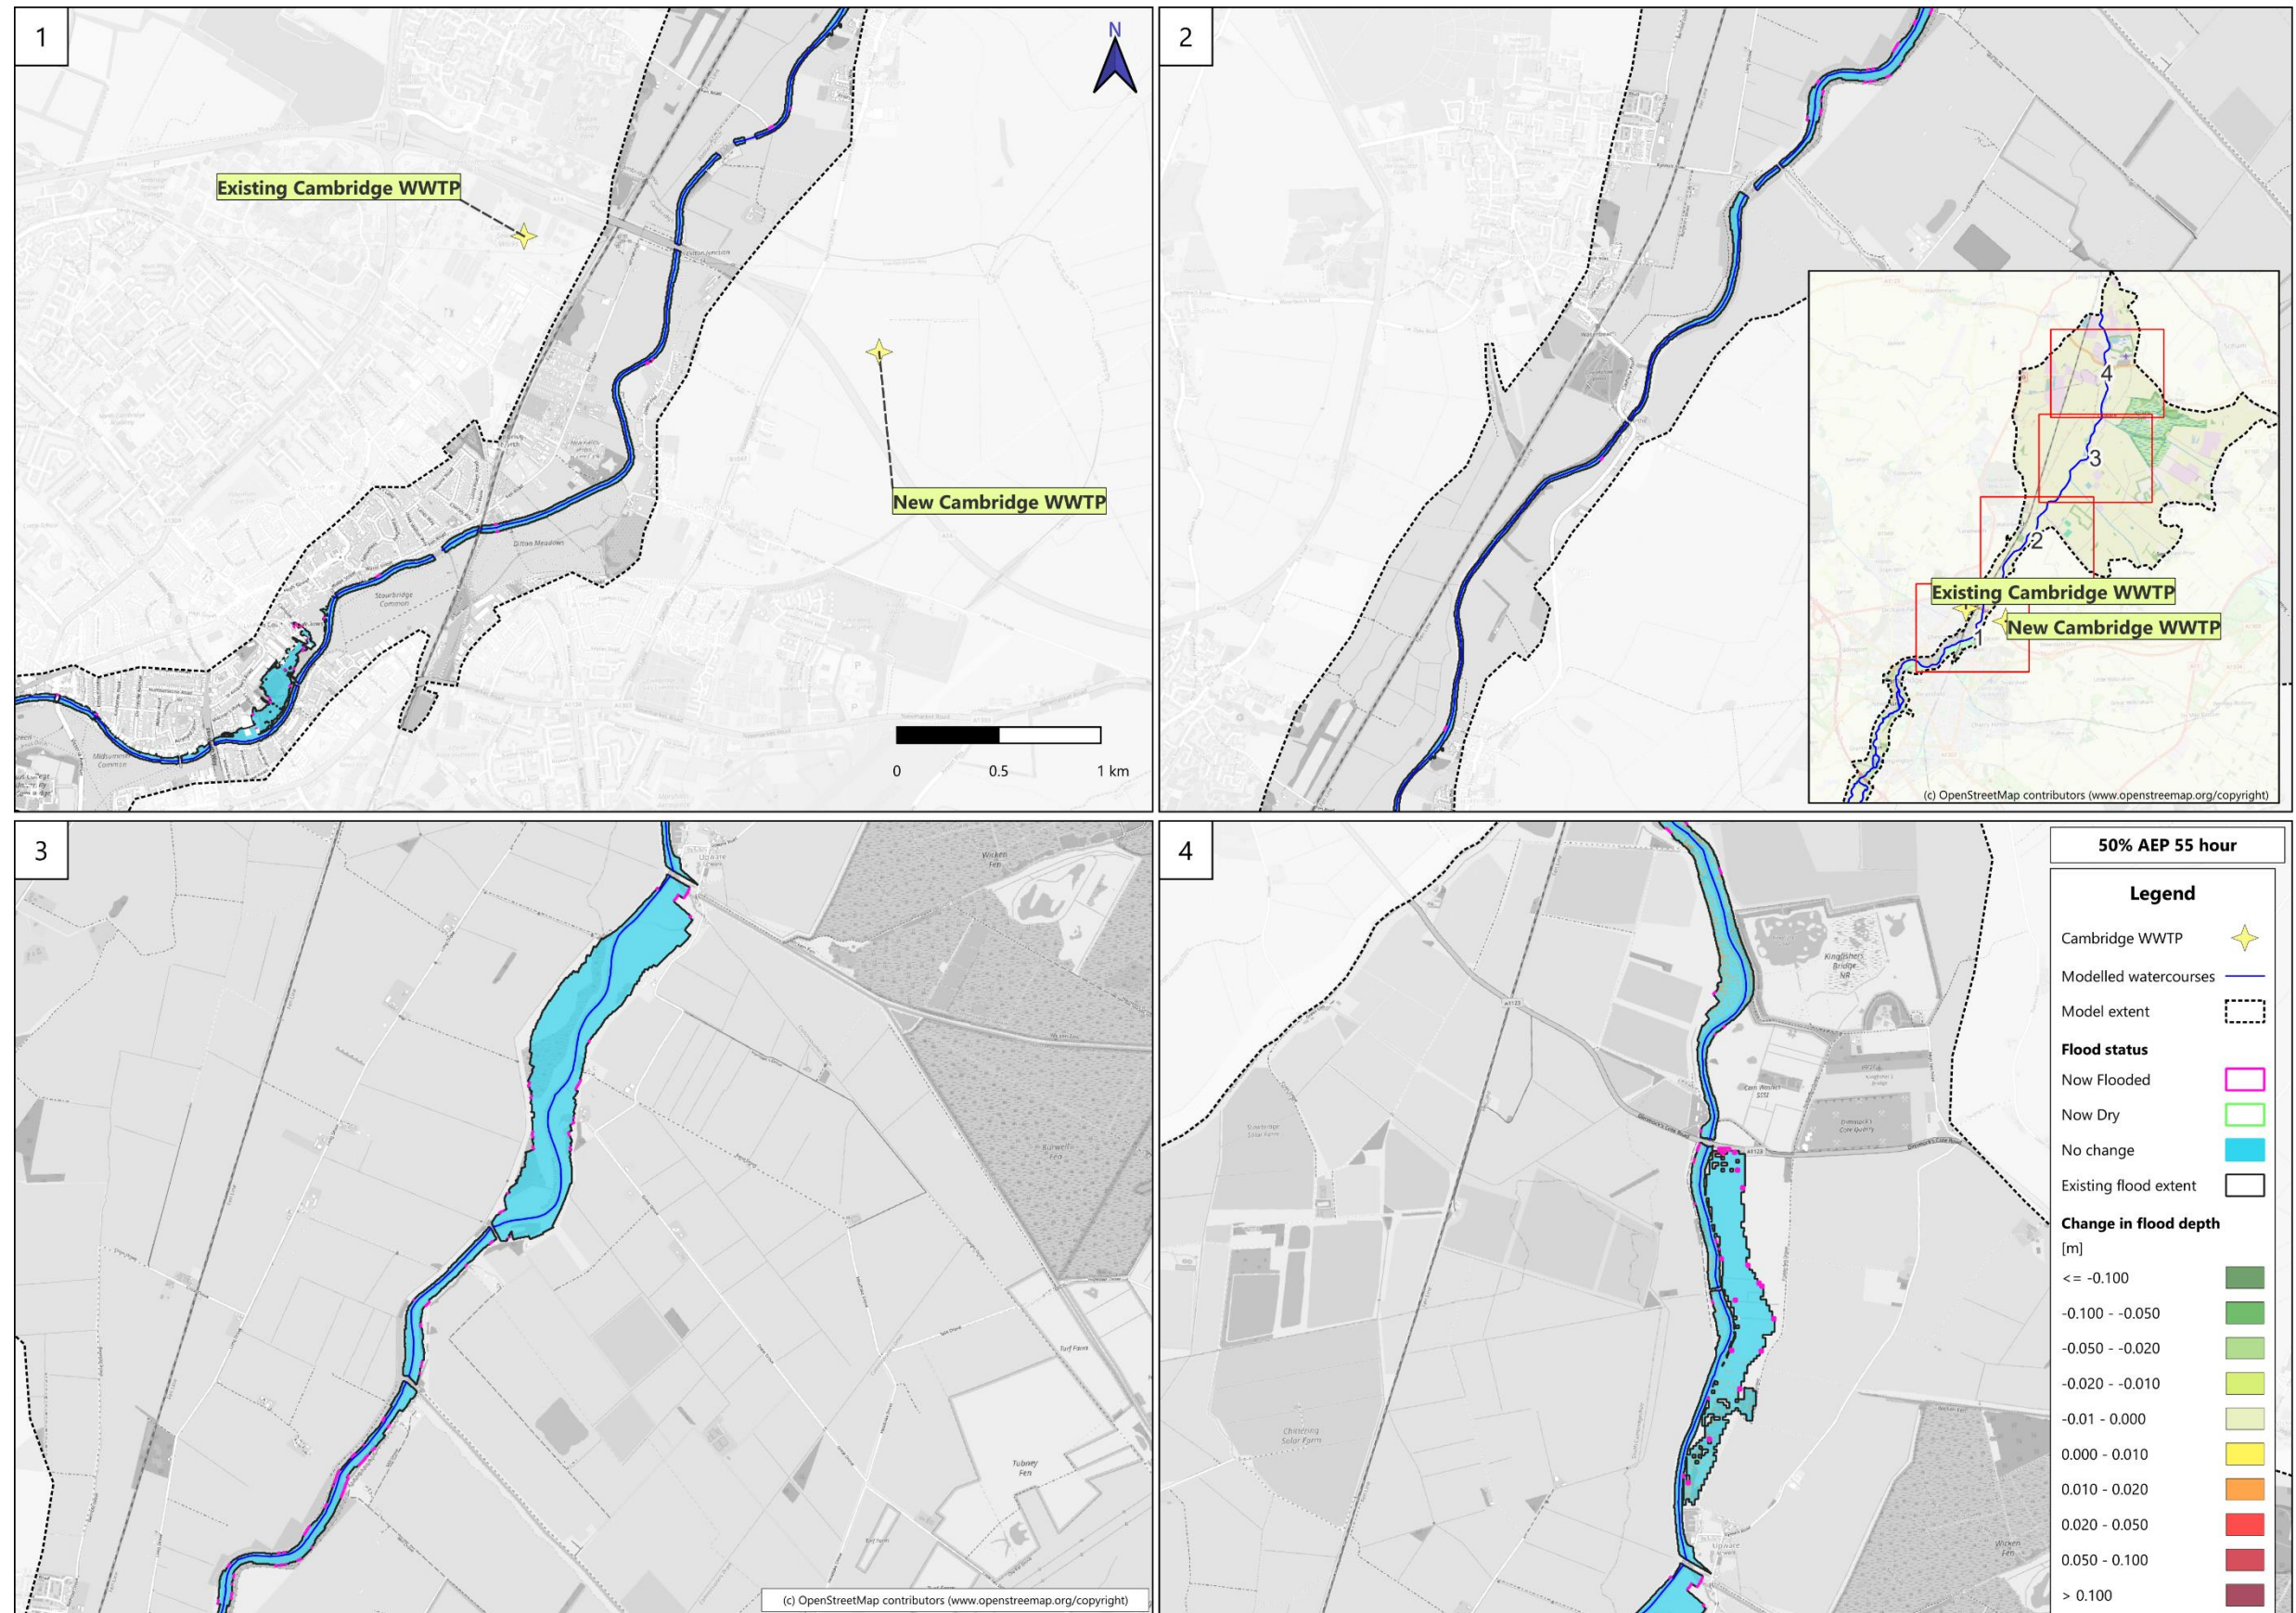


C.2 1 in 10 year flood

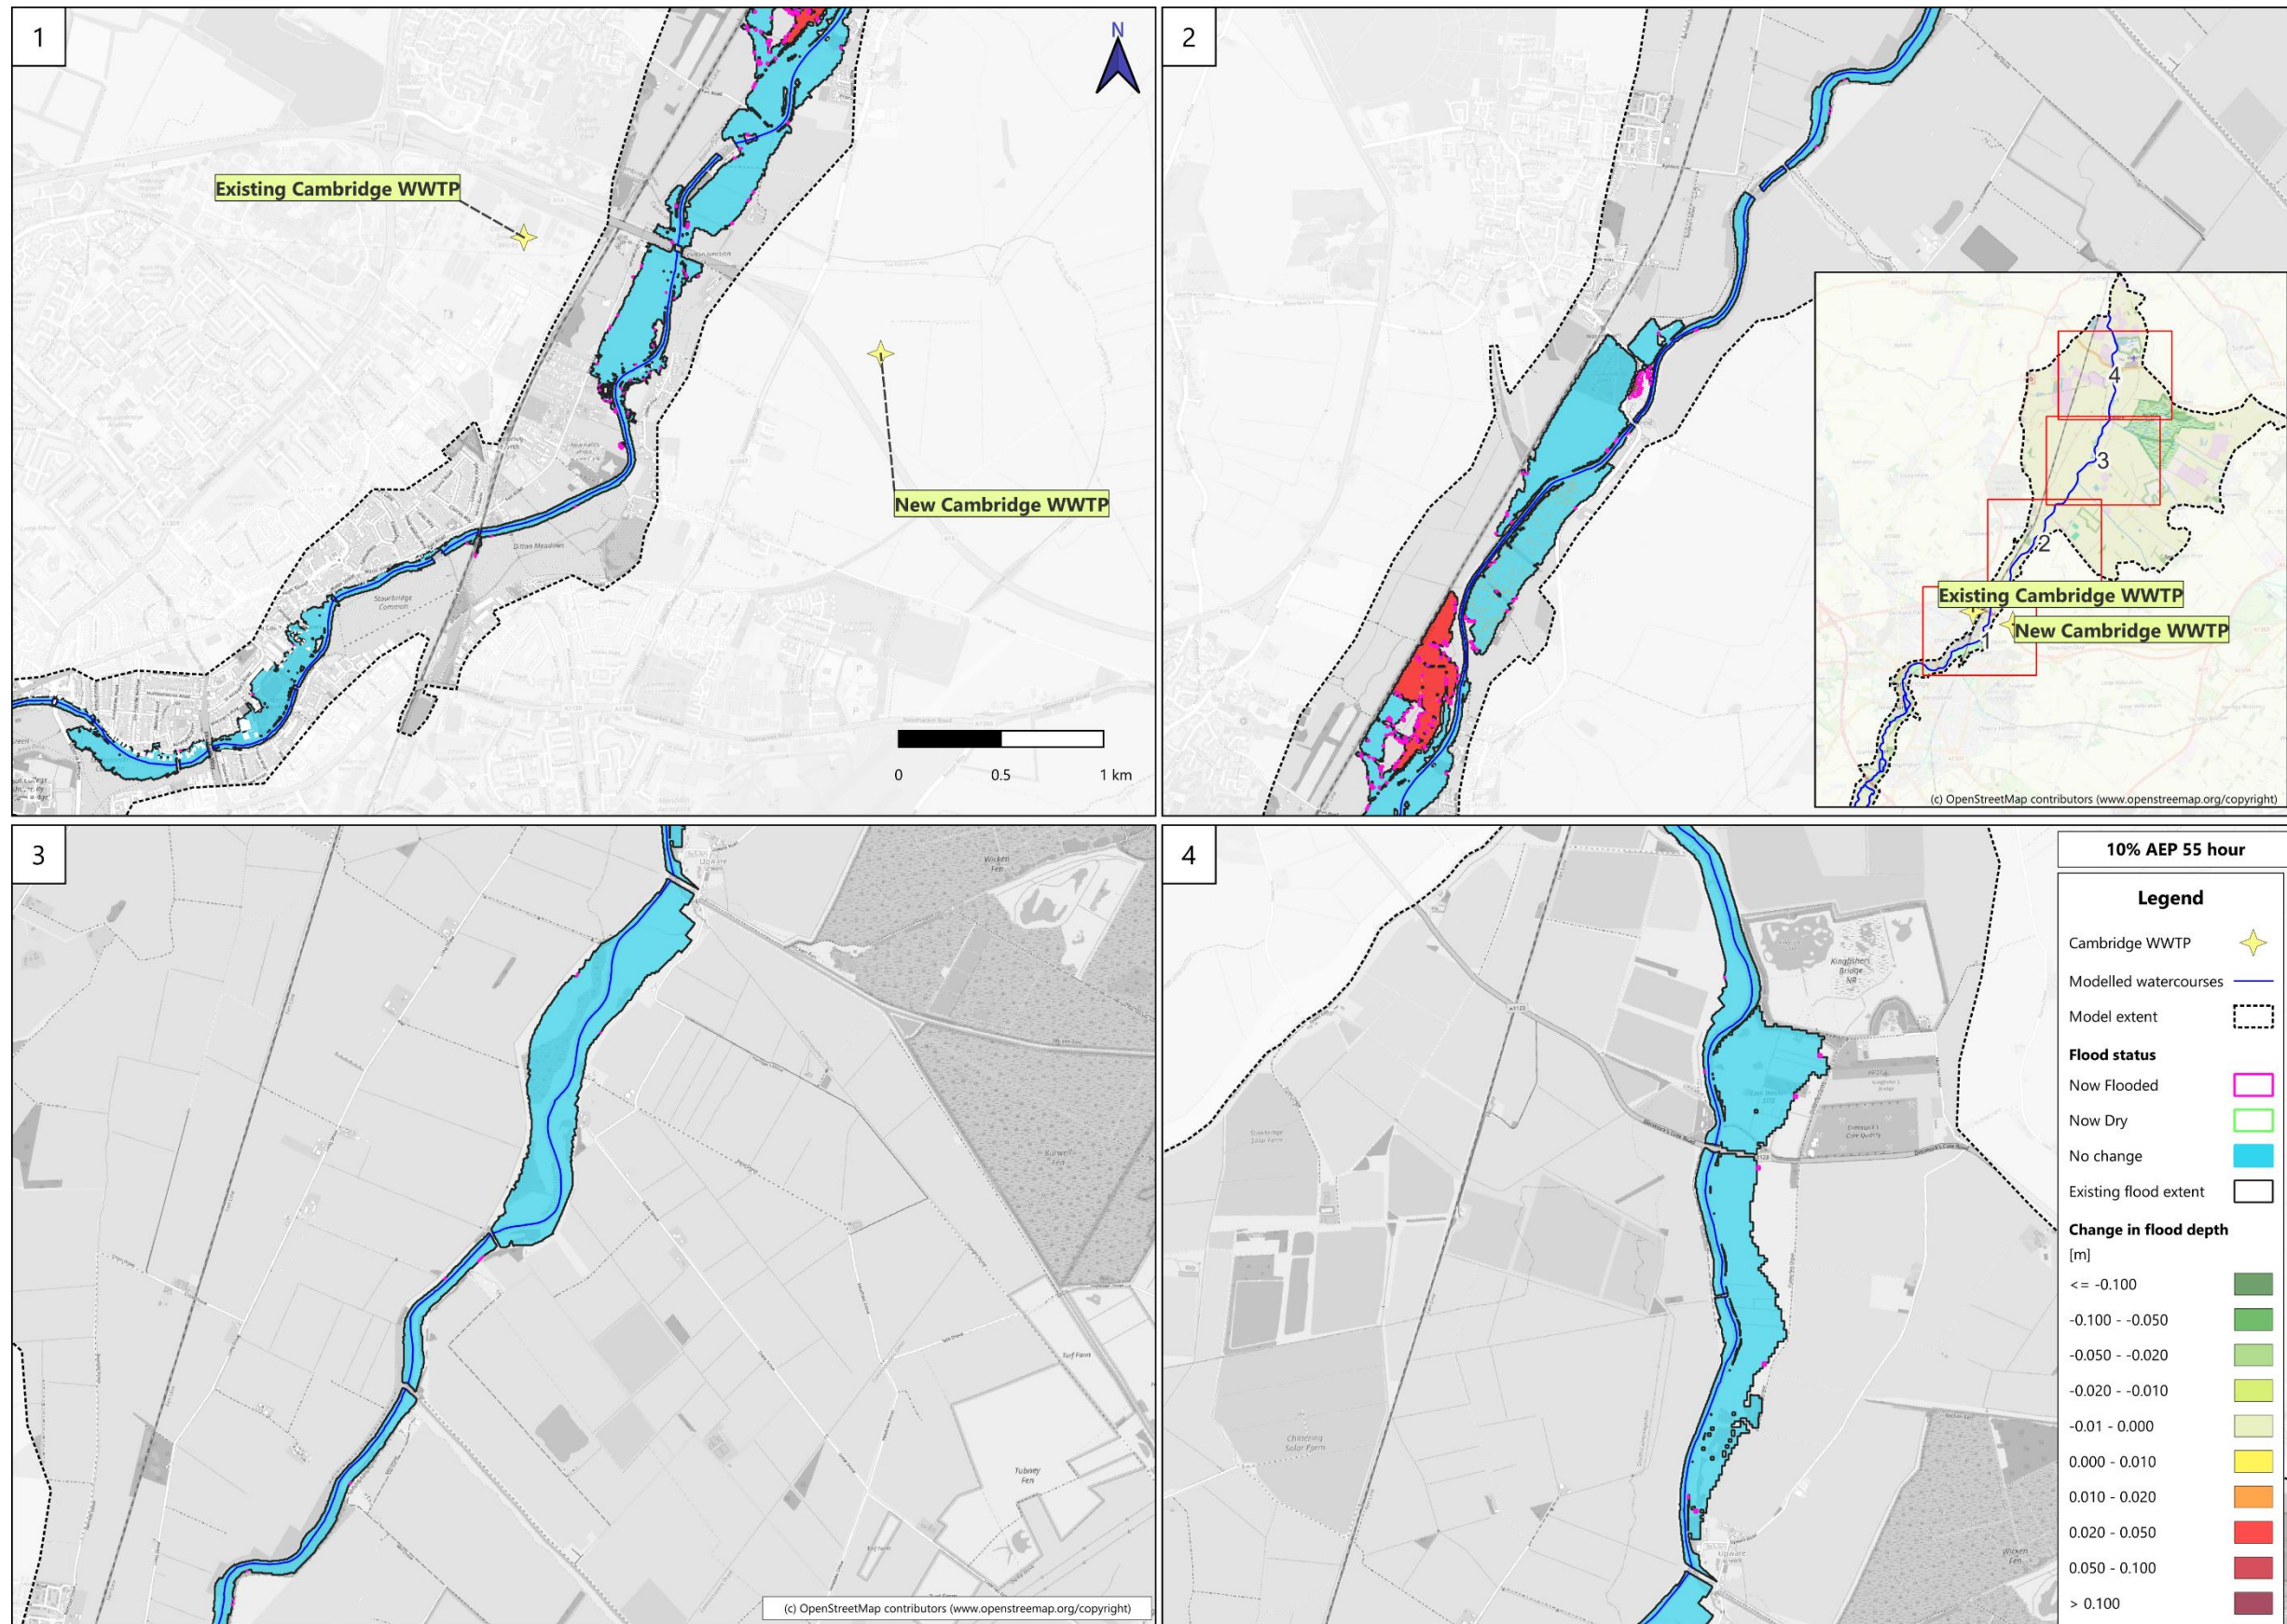

C.3 1 in 20 year flood

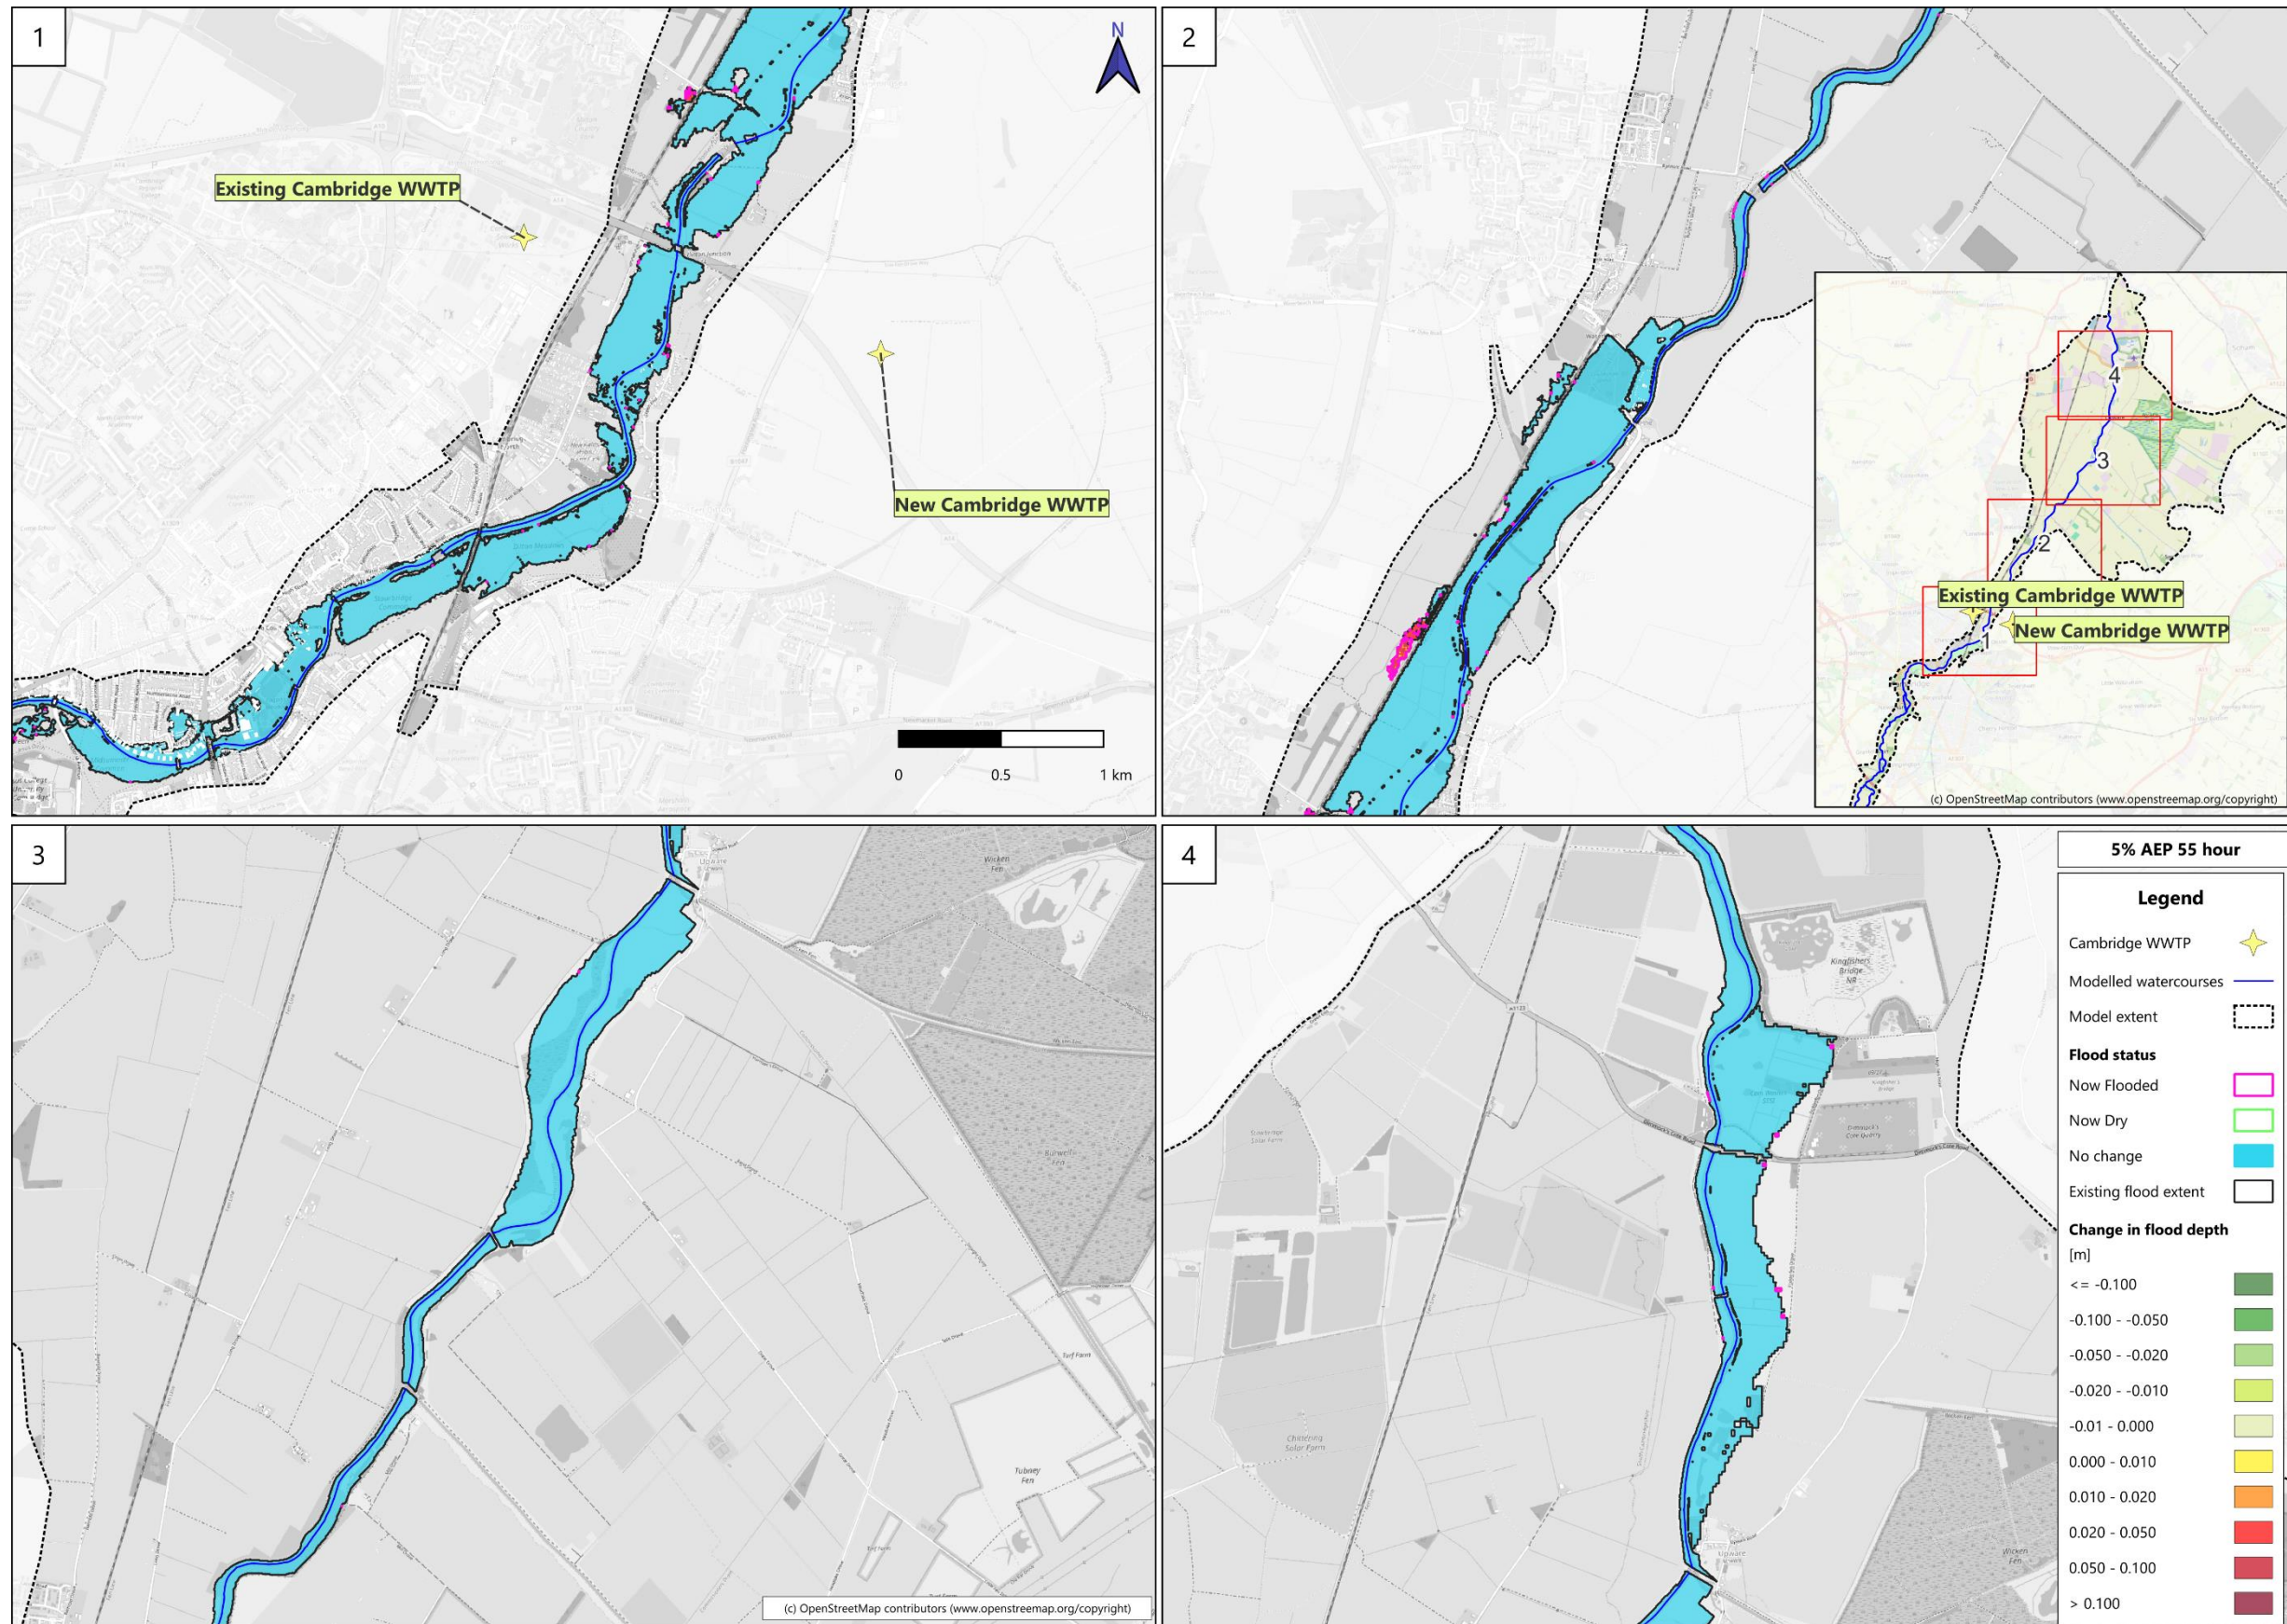


C.4 1 in 30 year flood

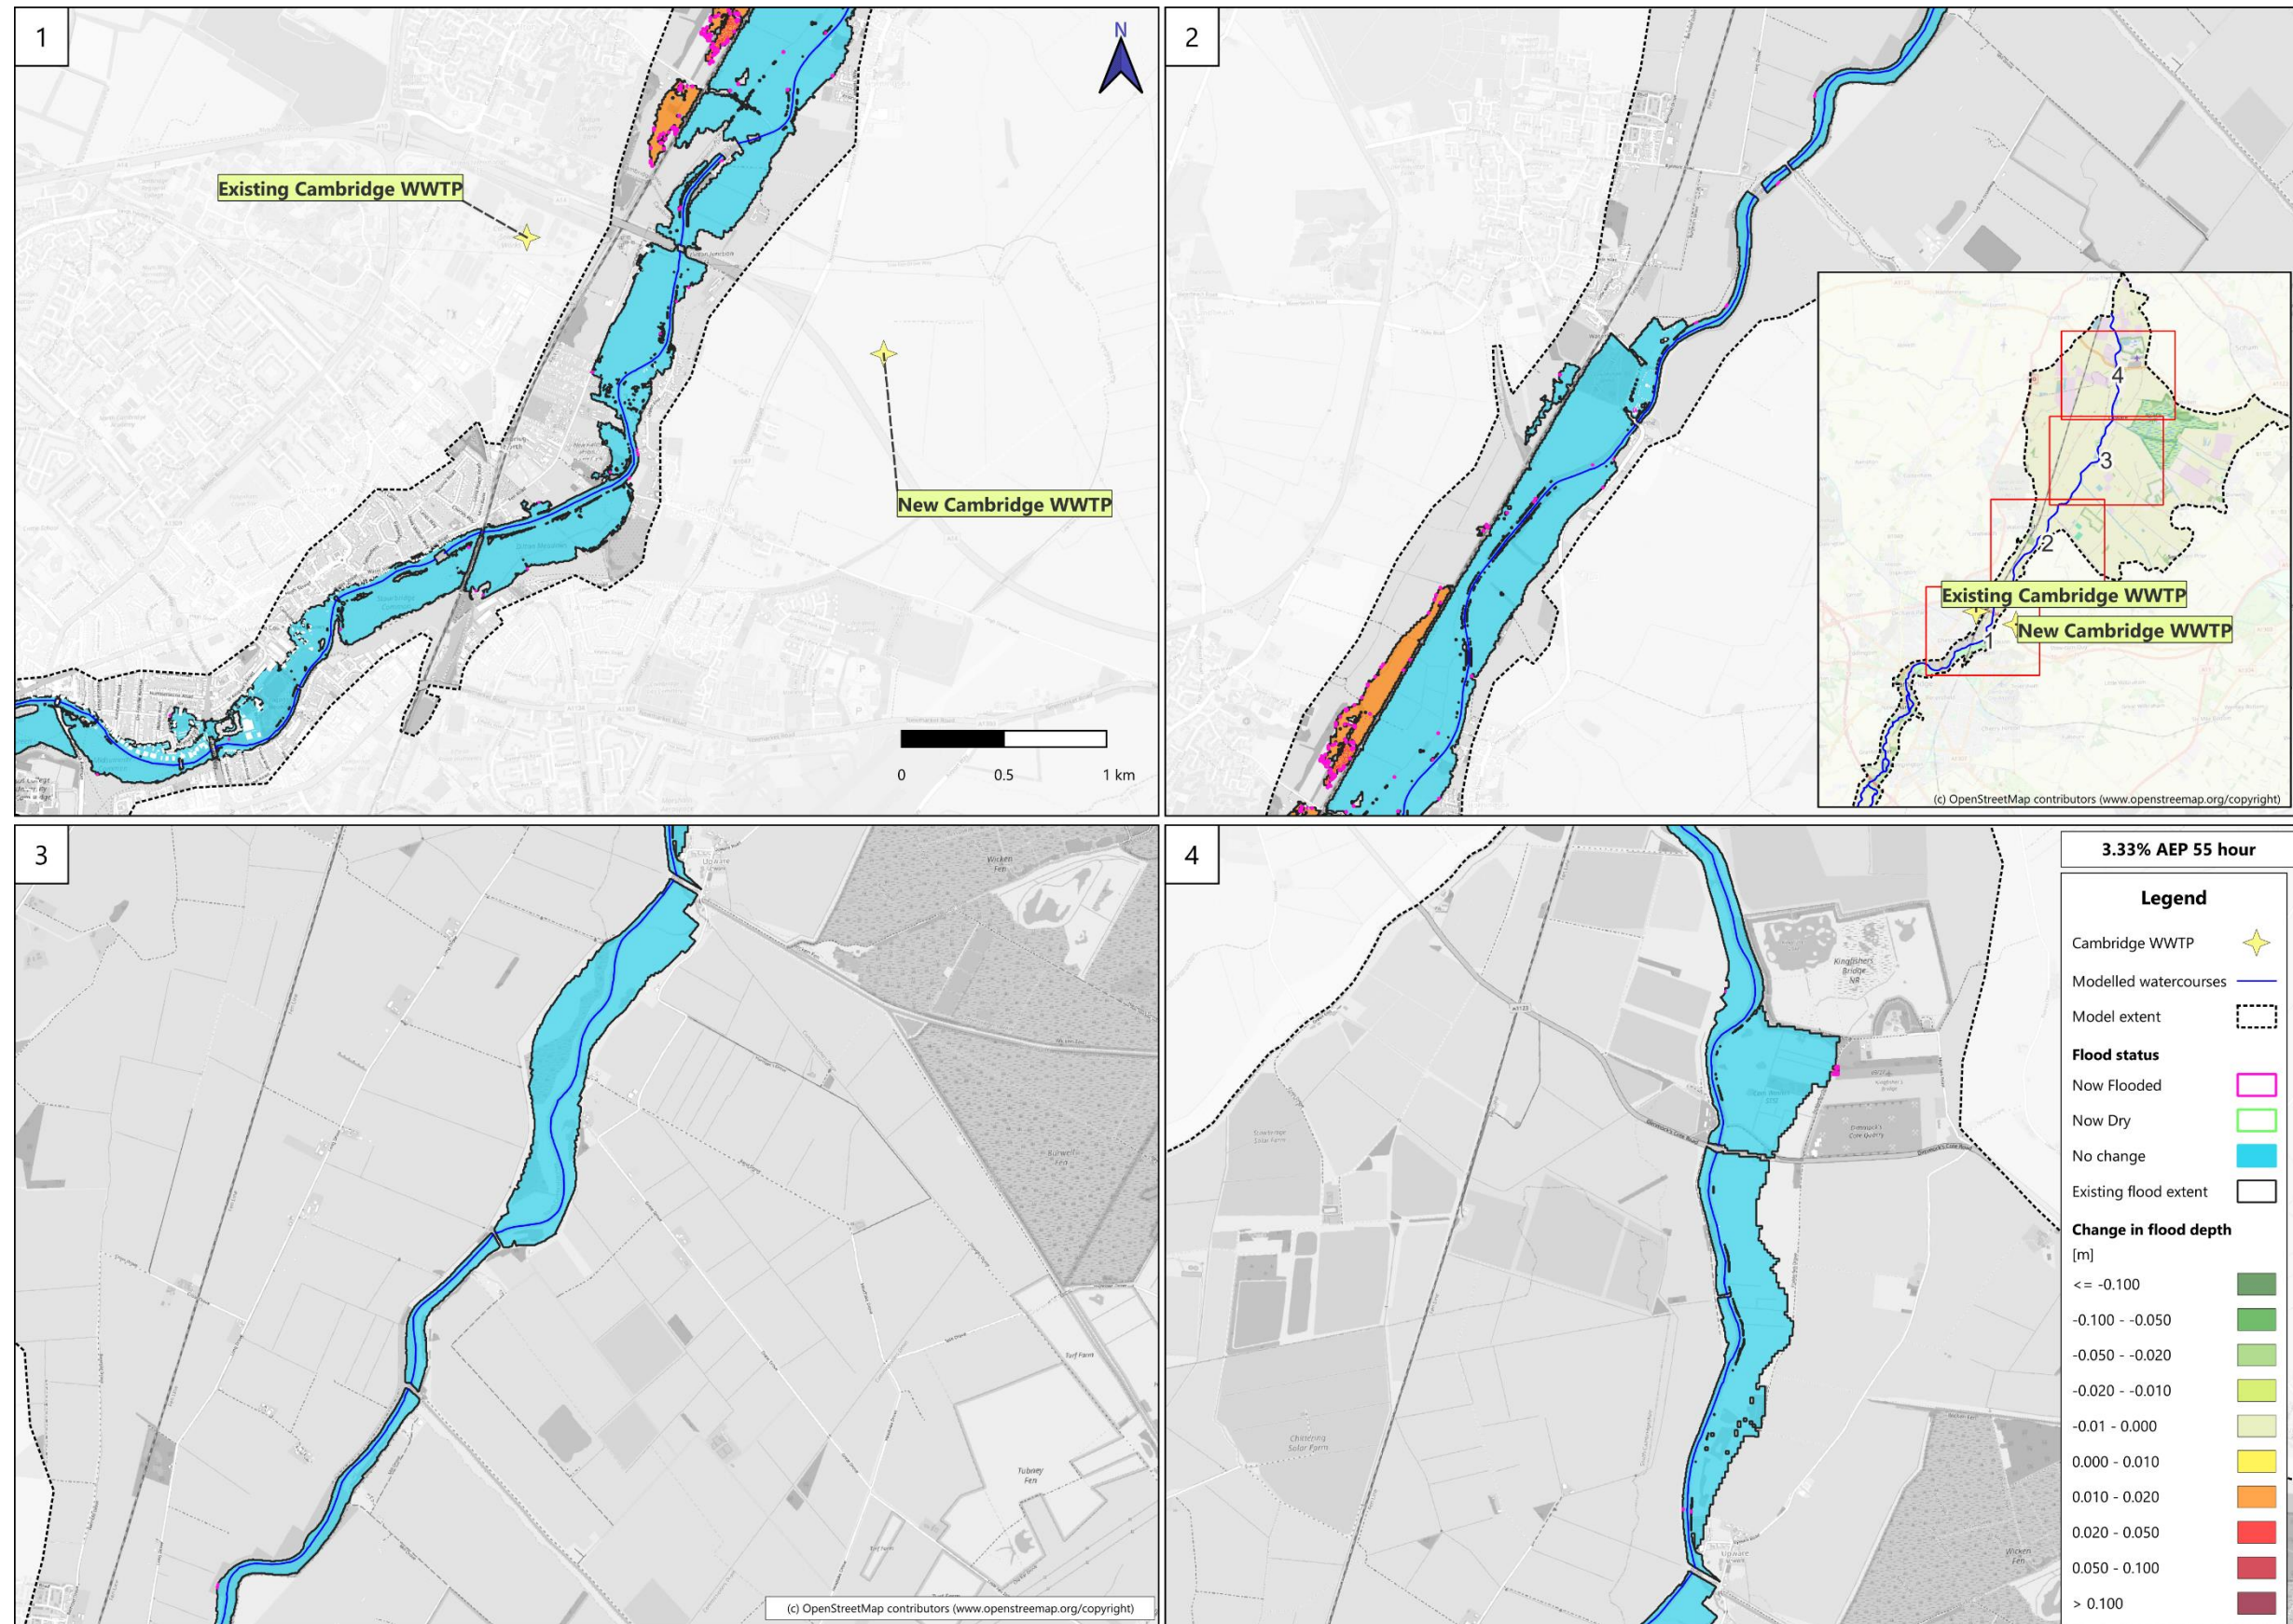





C.5 1 in 50 year flood

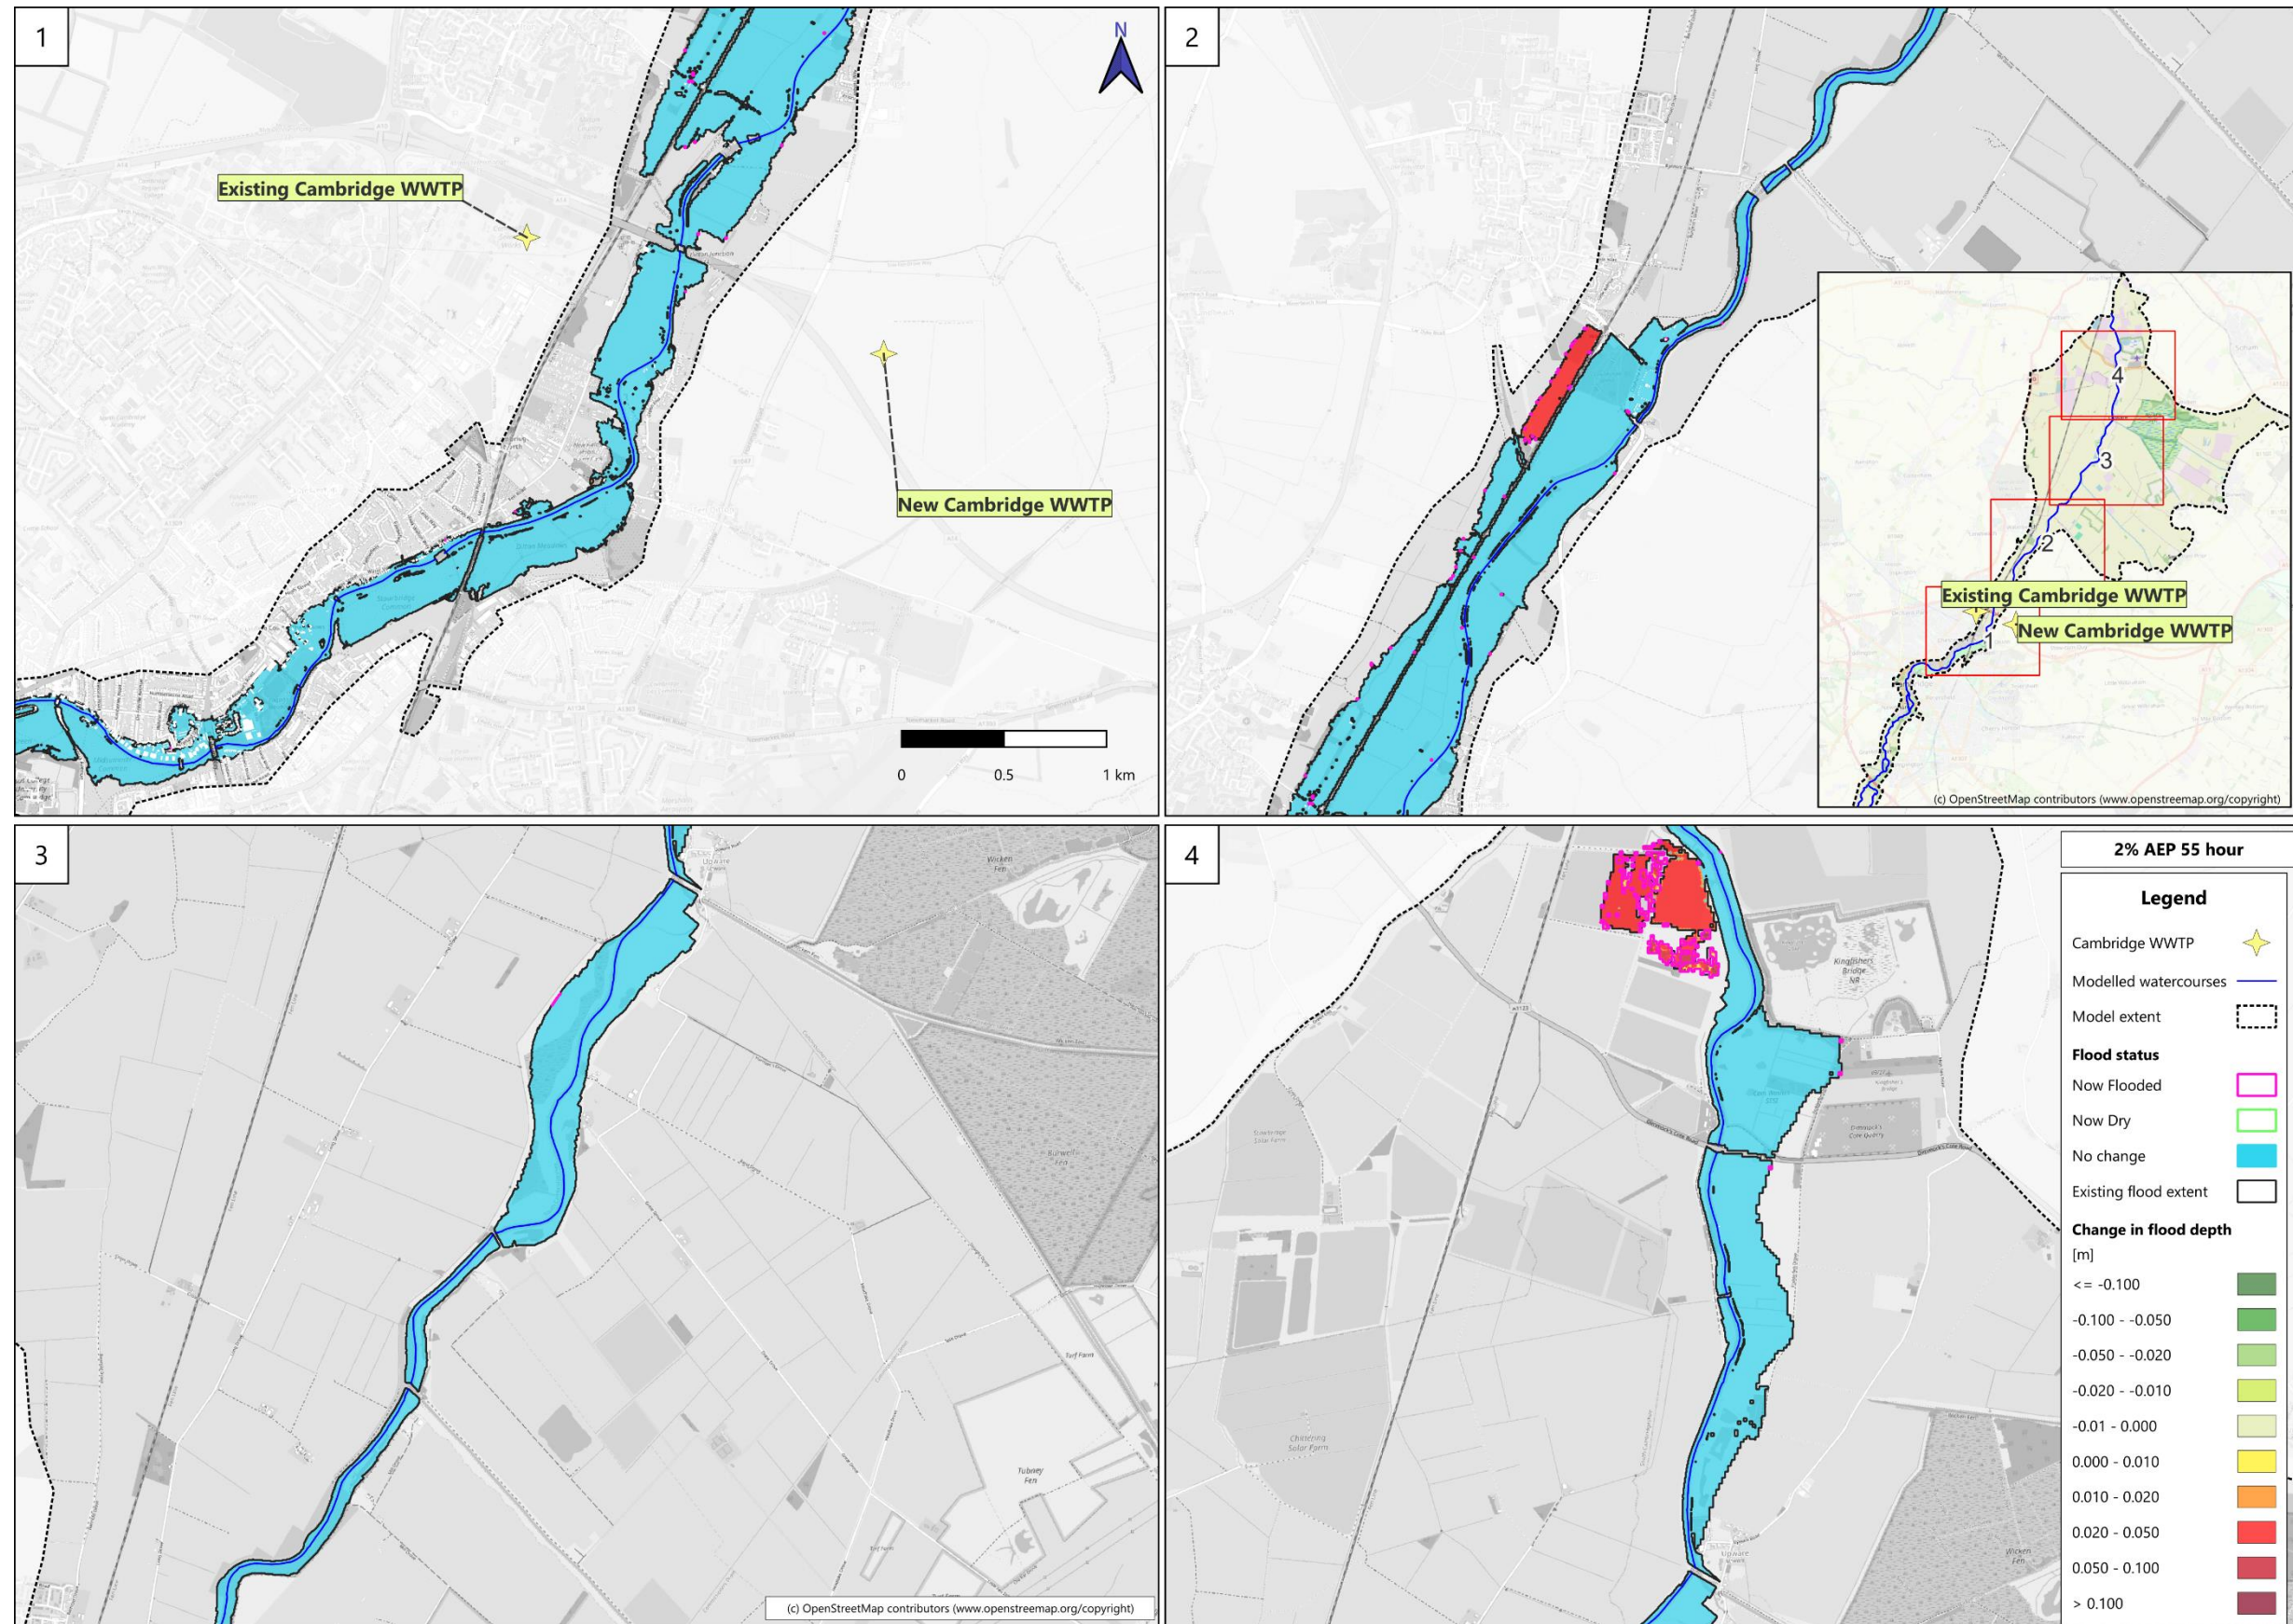


C.6 1 in 75 year flood

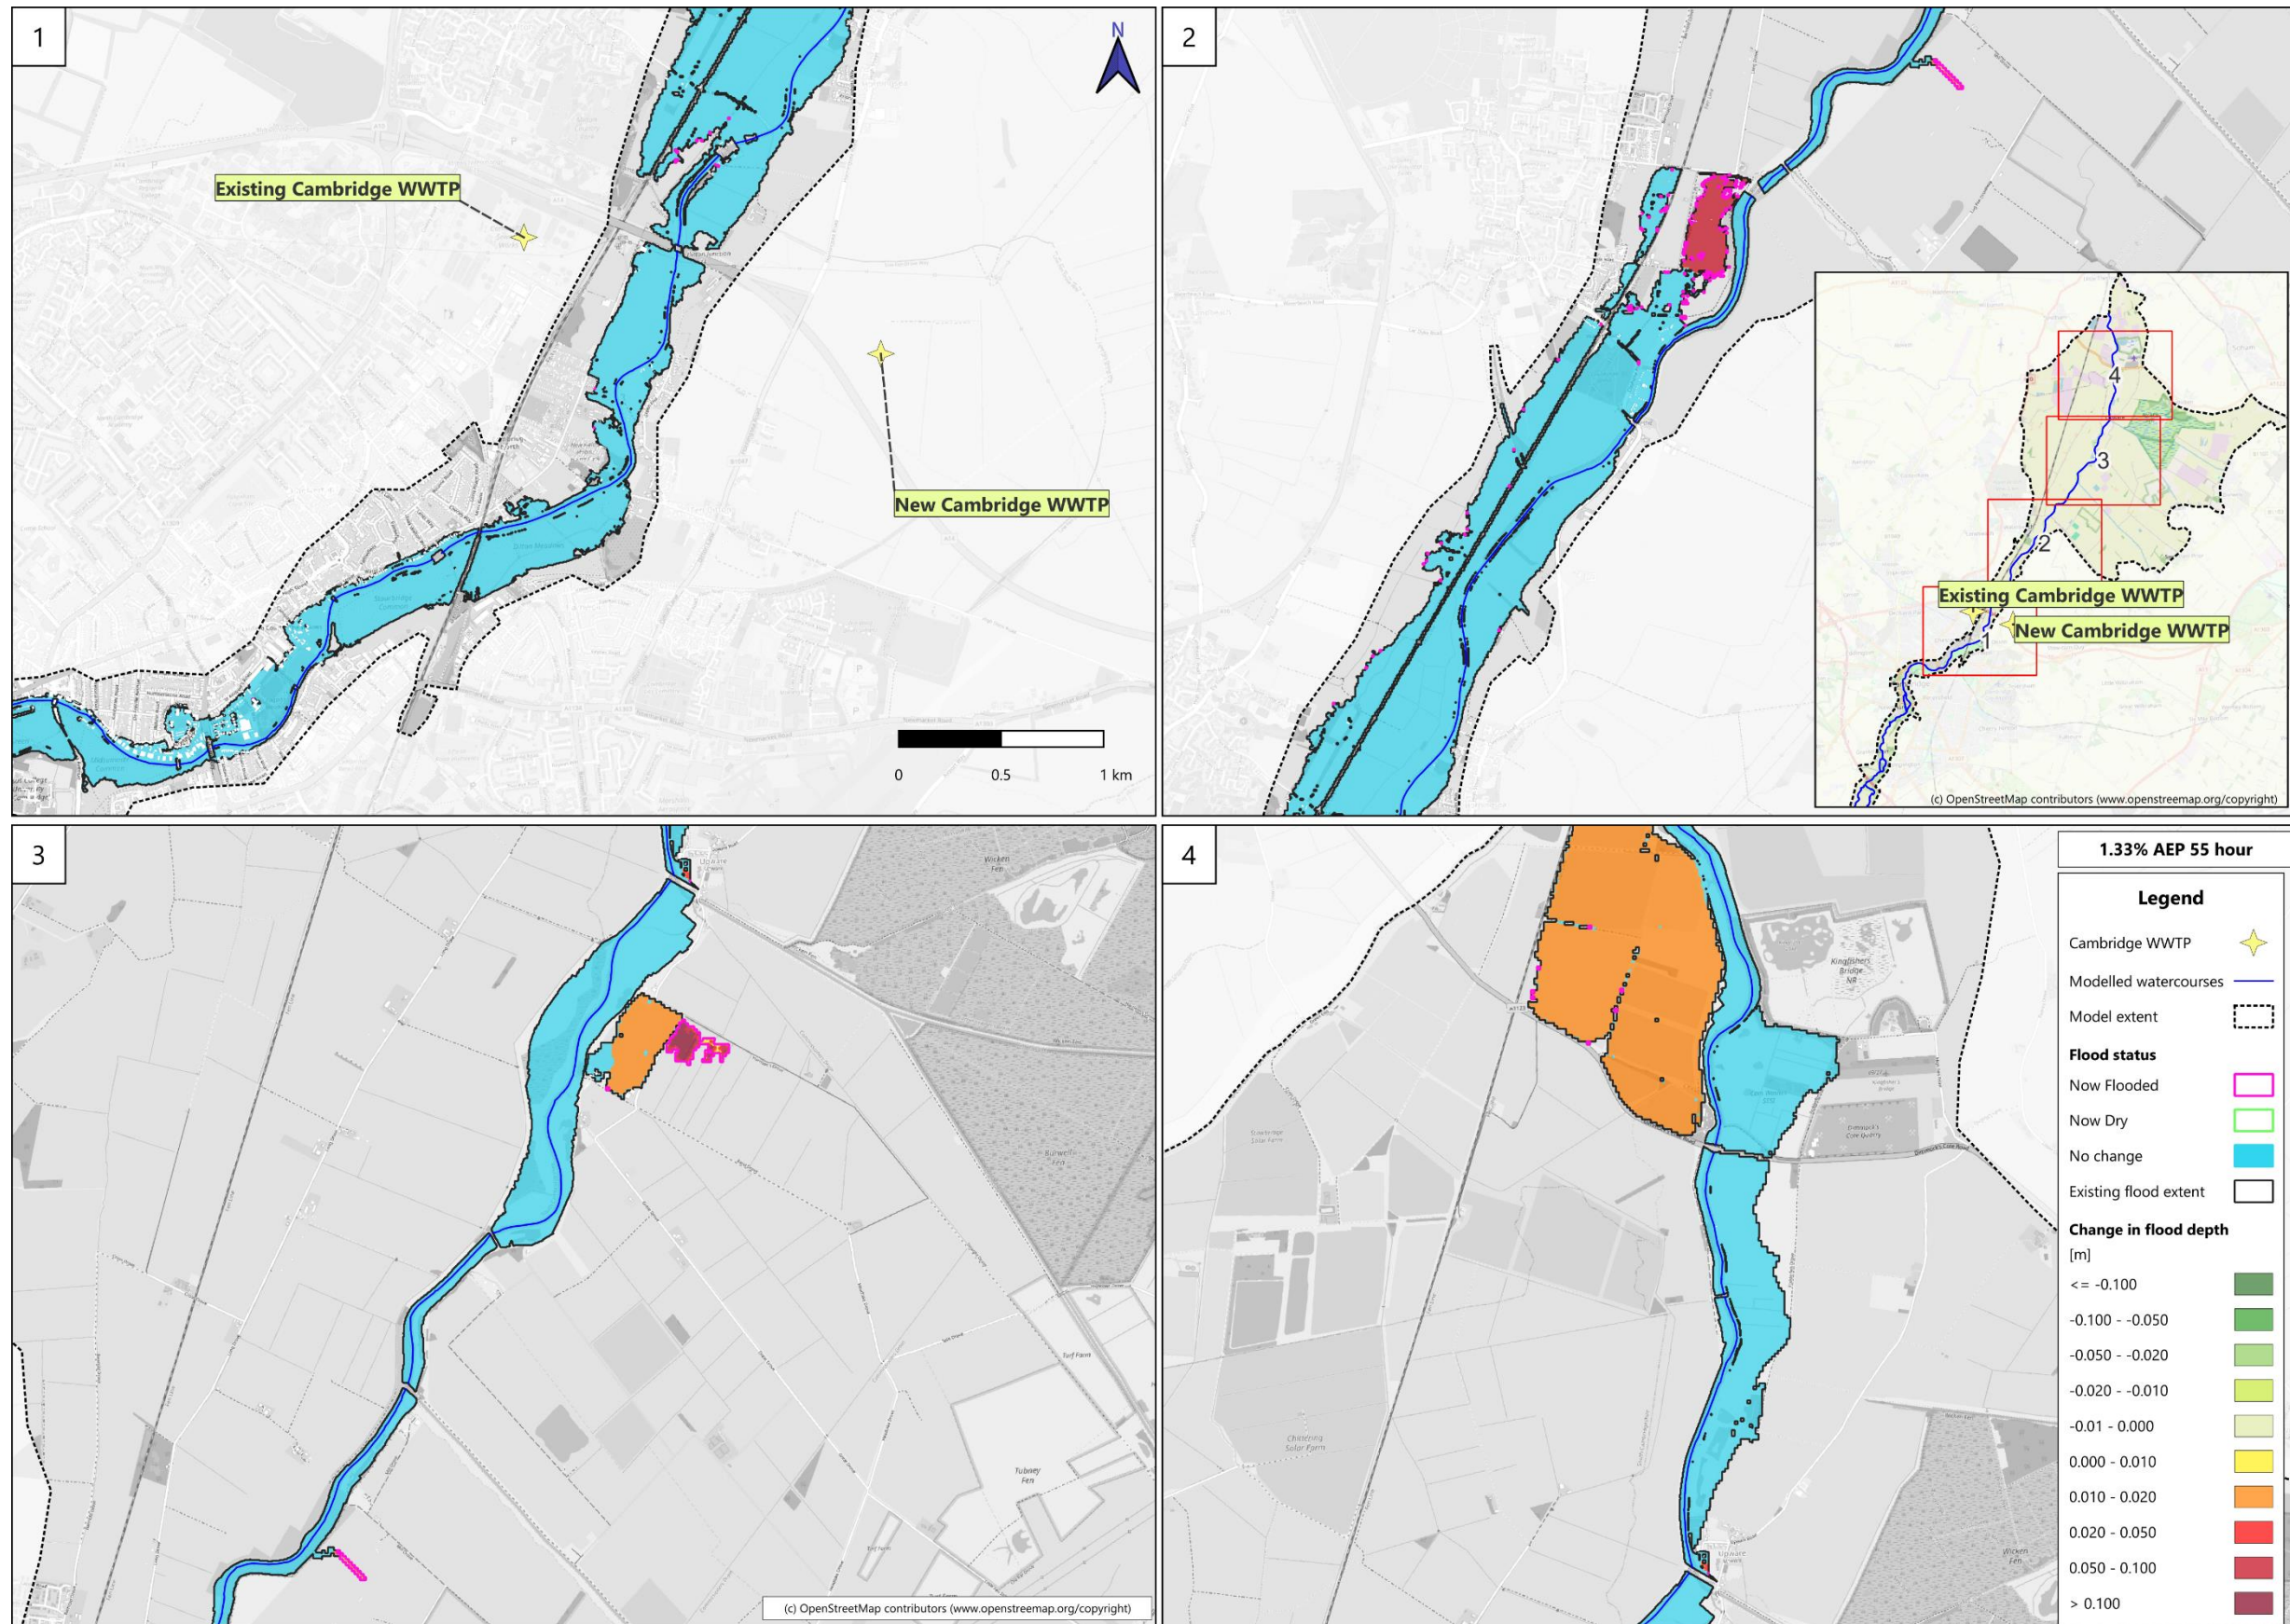


C.7 1 in 200 year flood

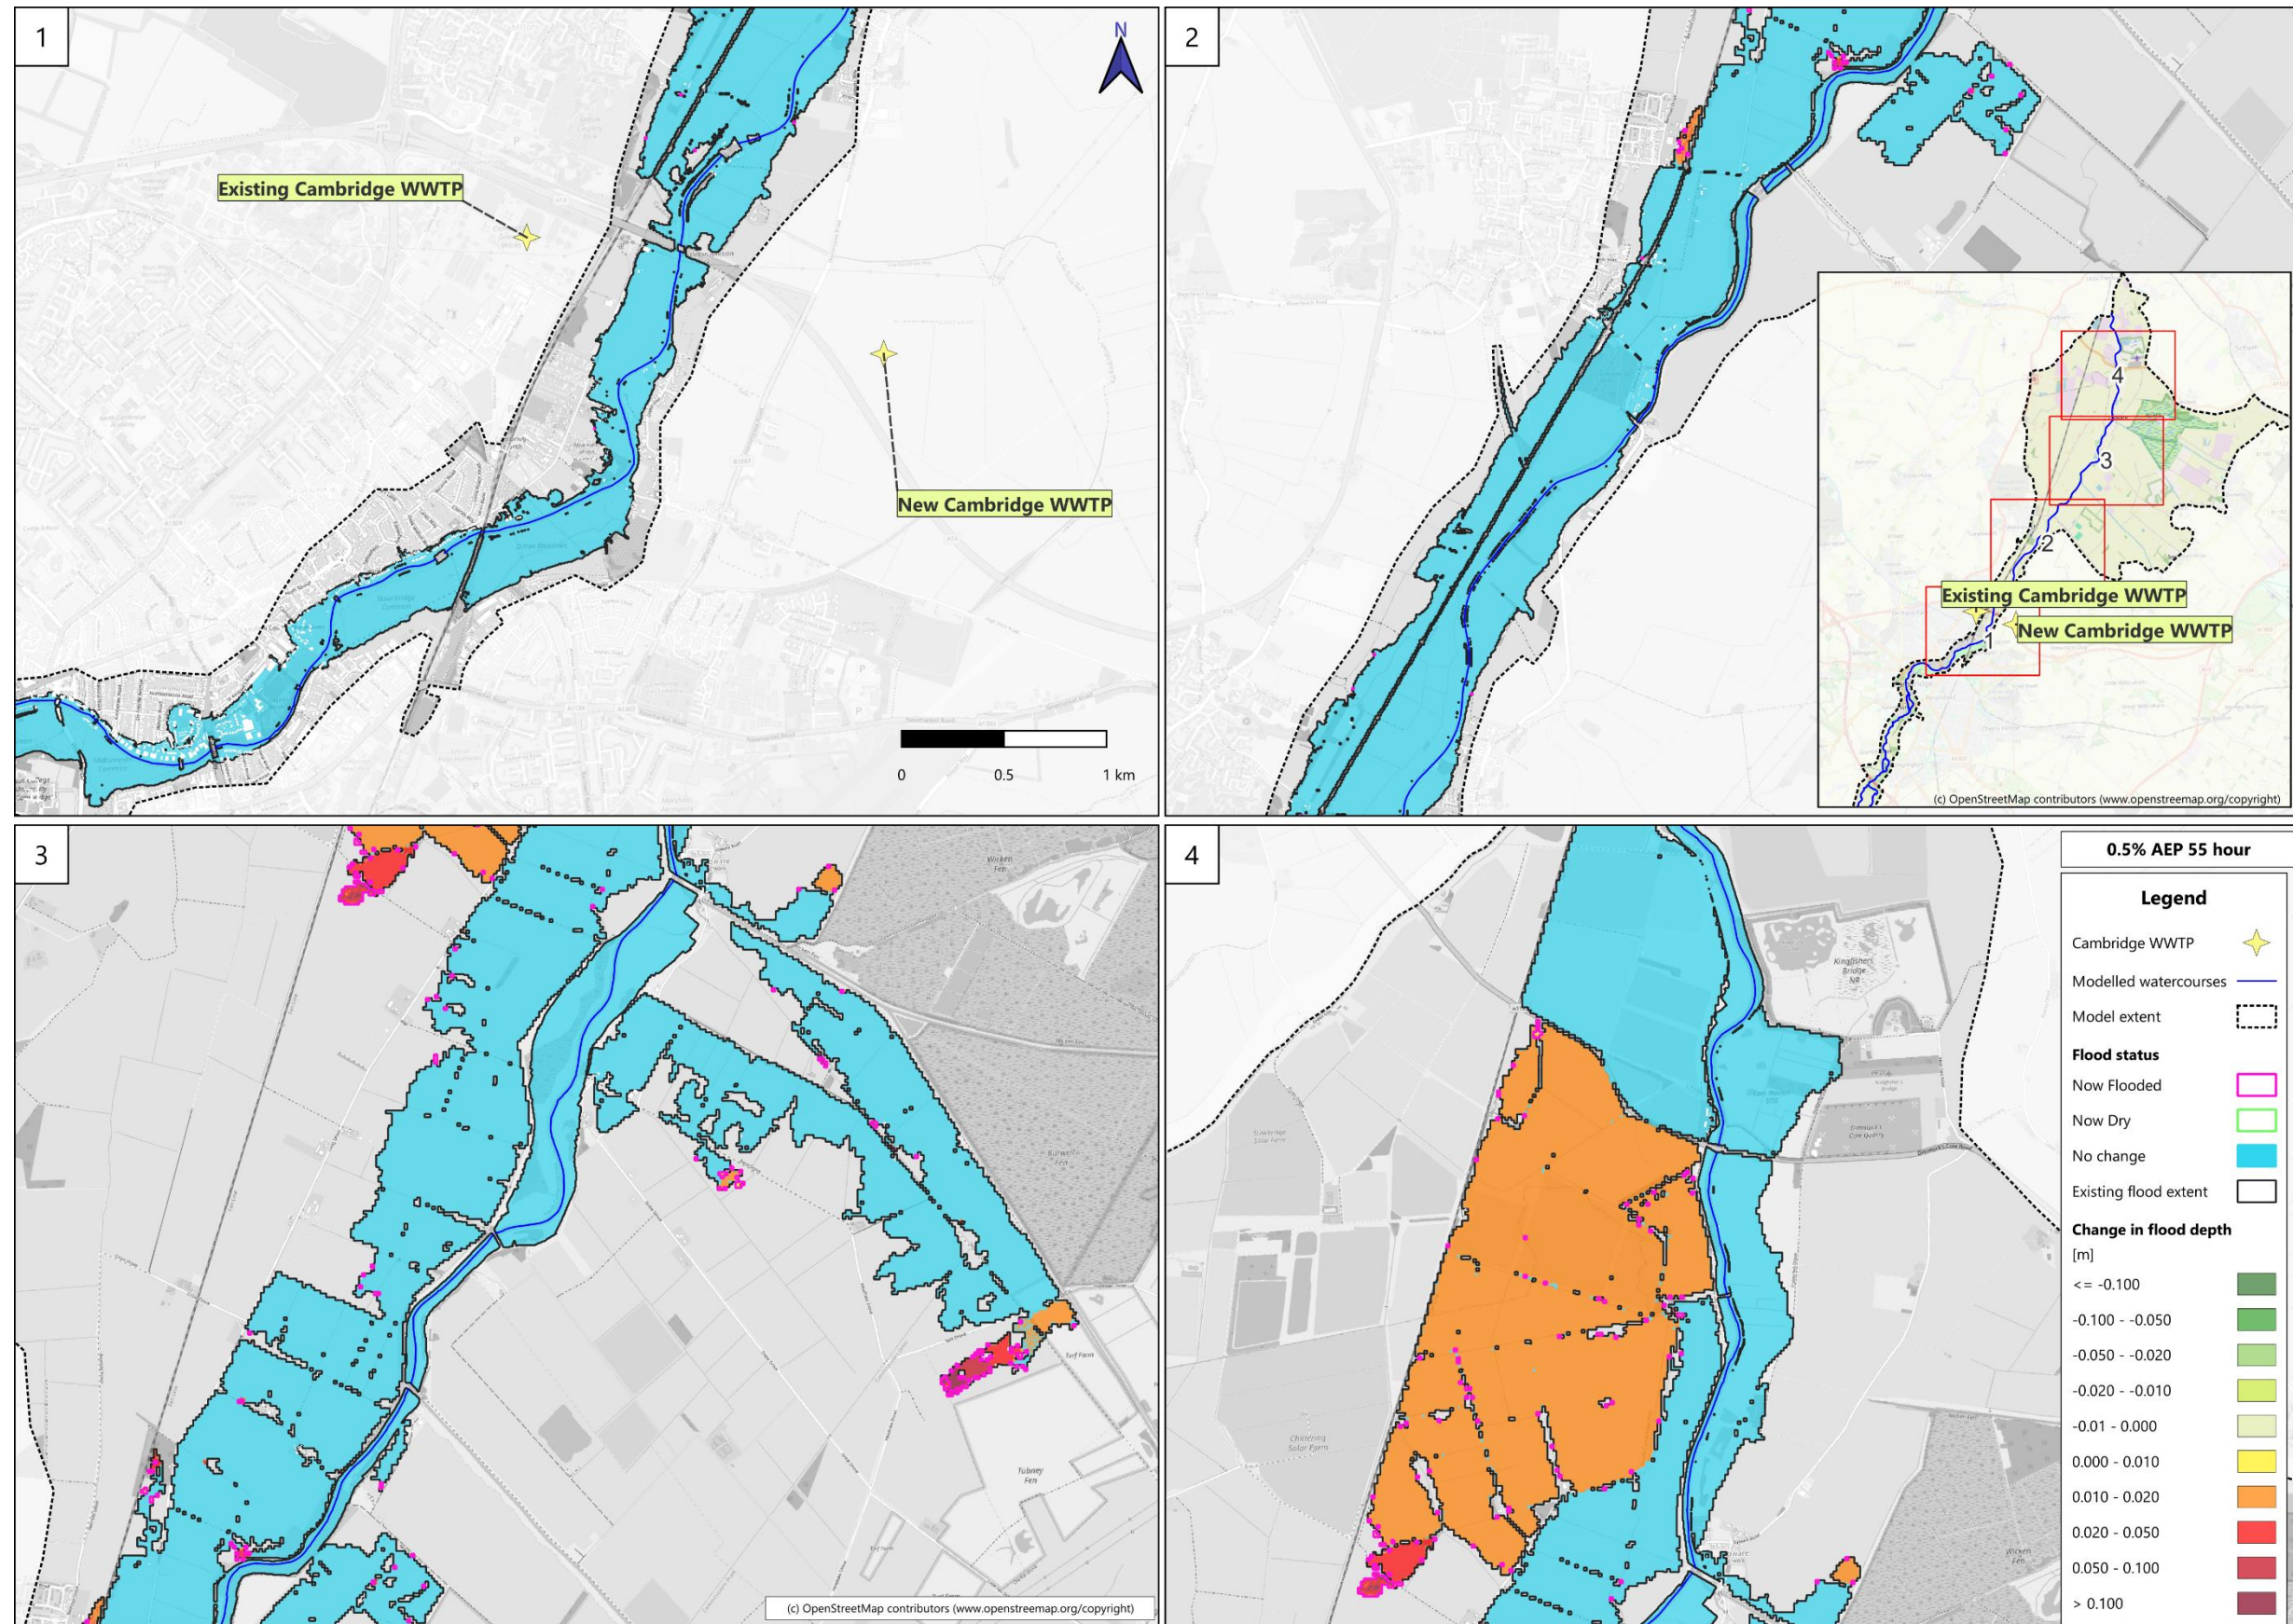


C.8 1 in 1000 year flood

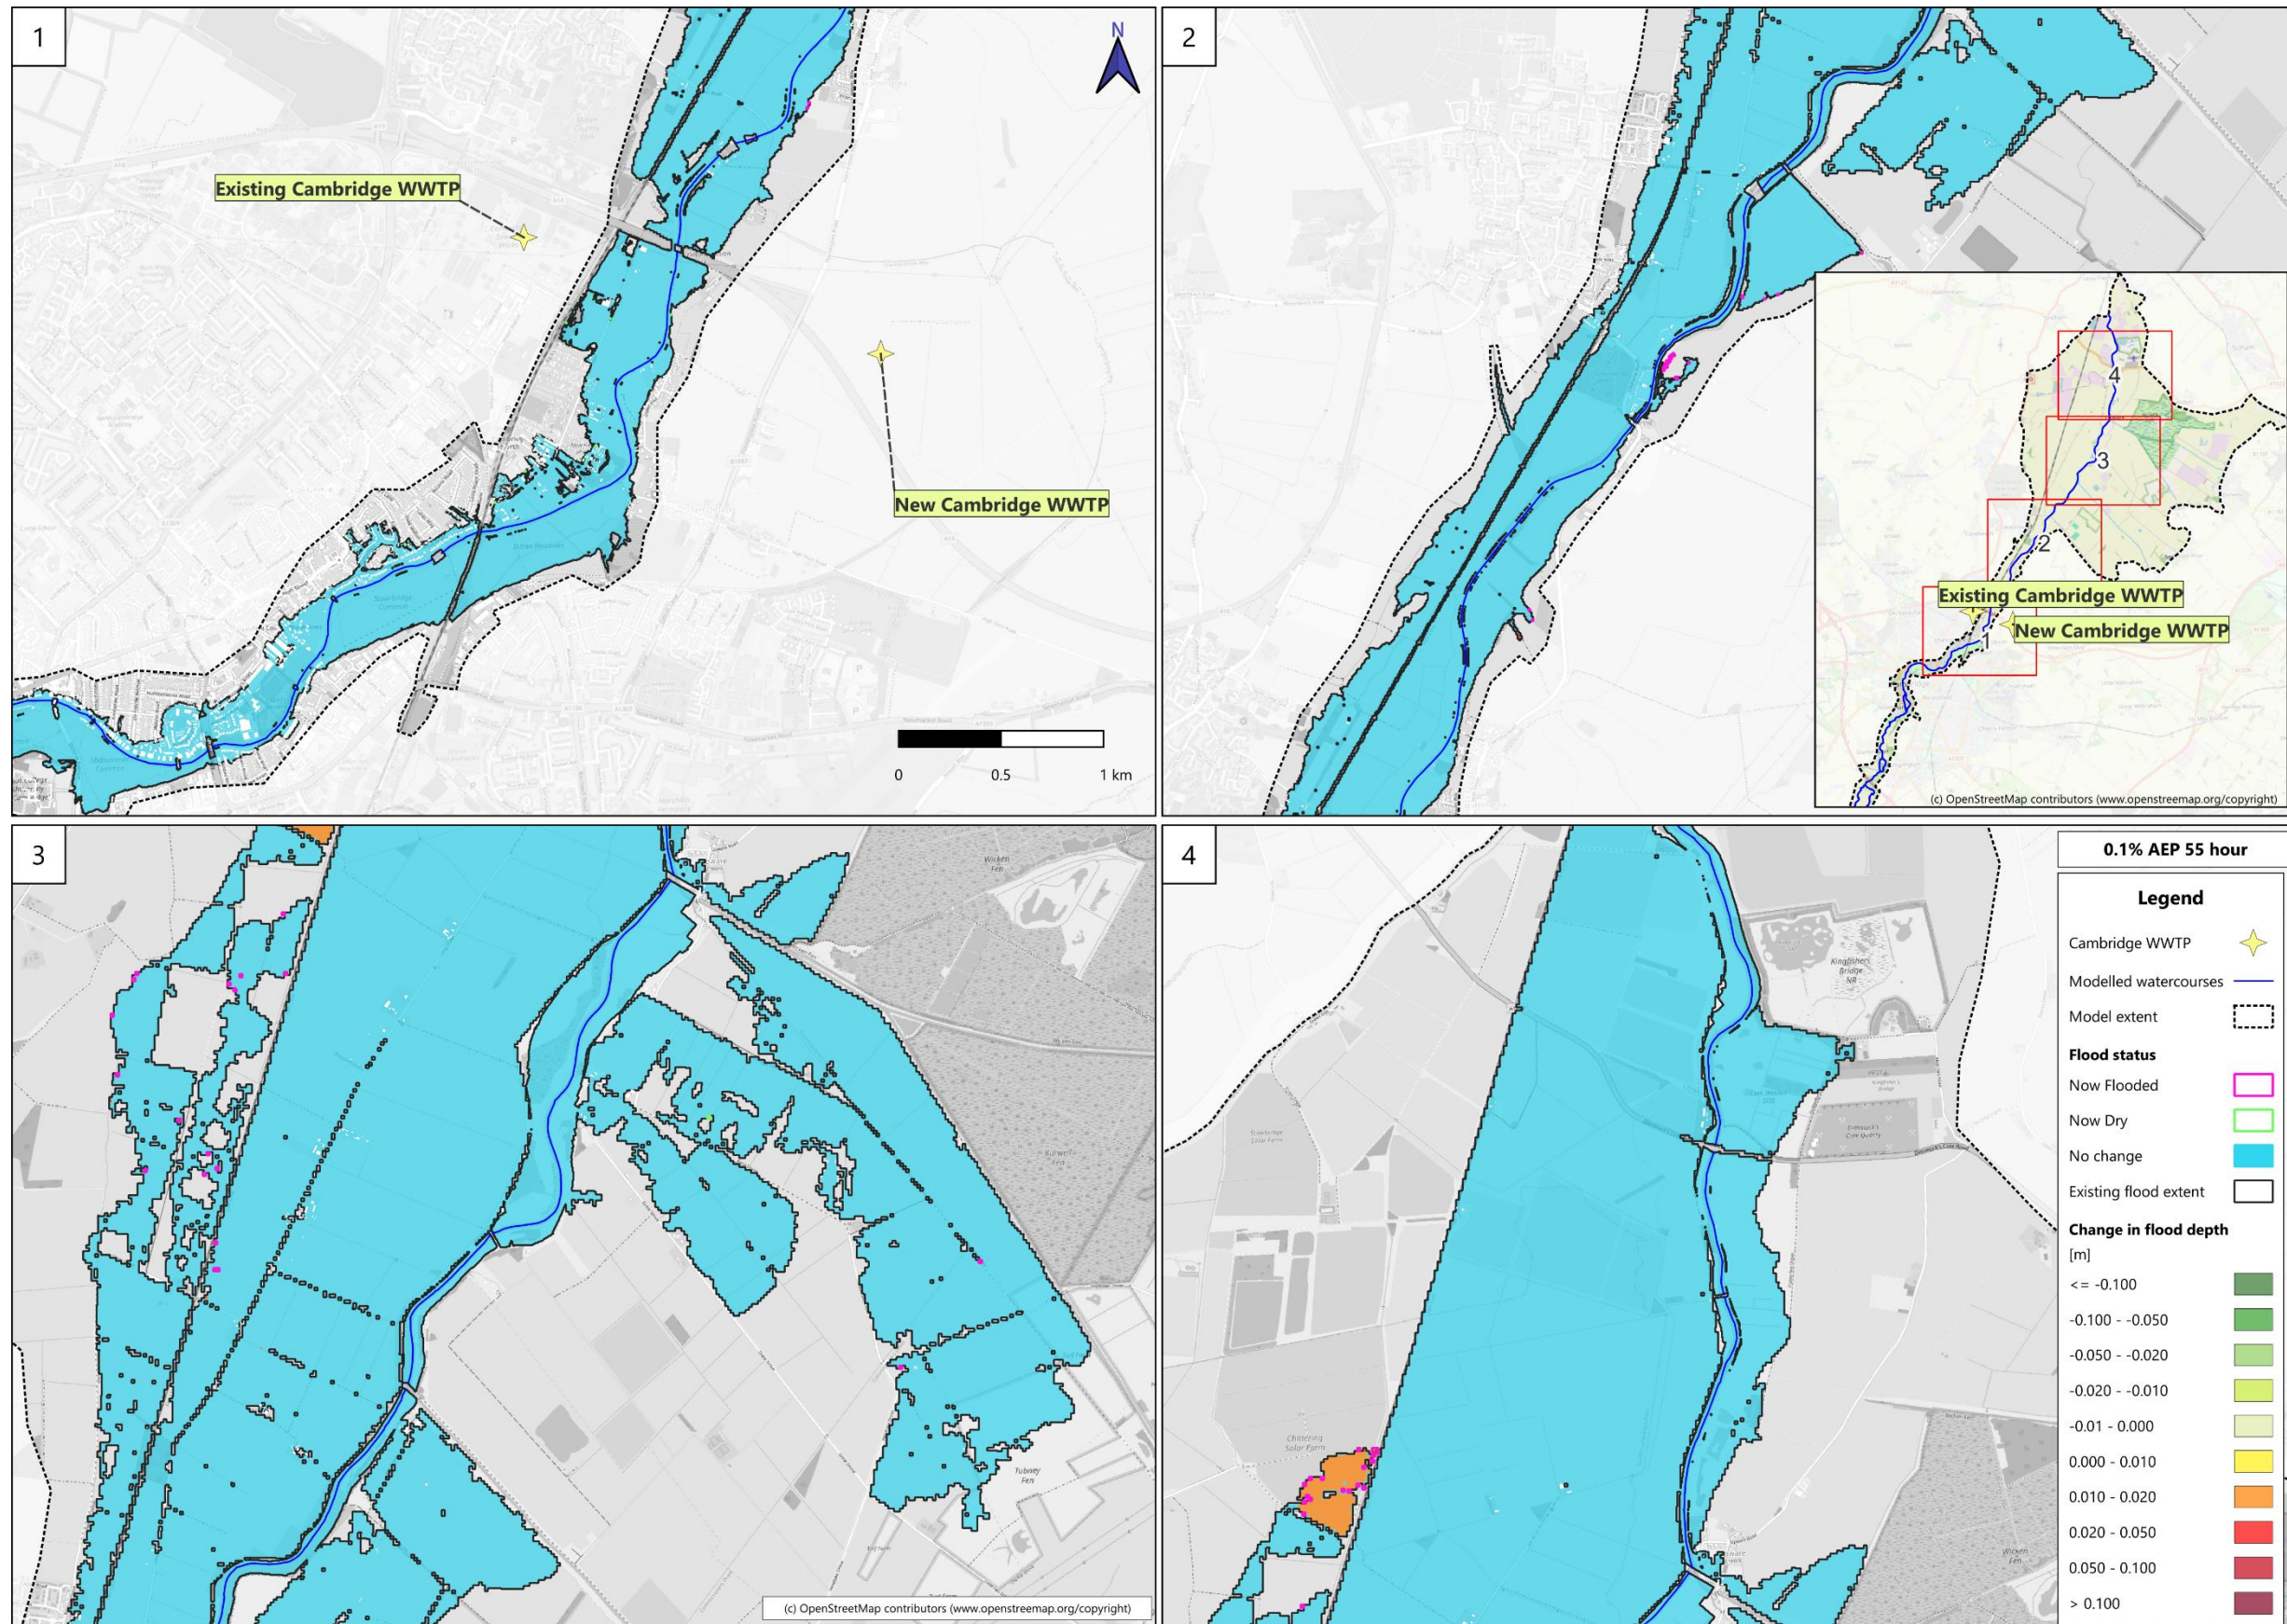

C.9 1 in 100 year flood + 19% climate change

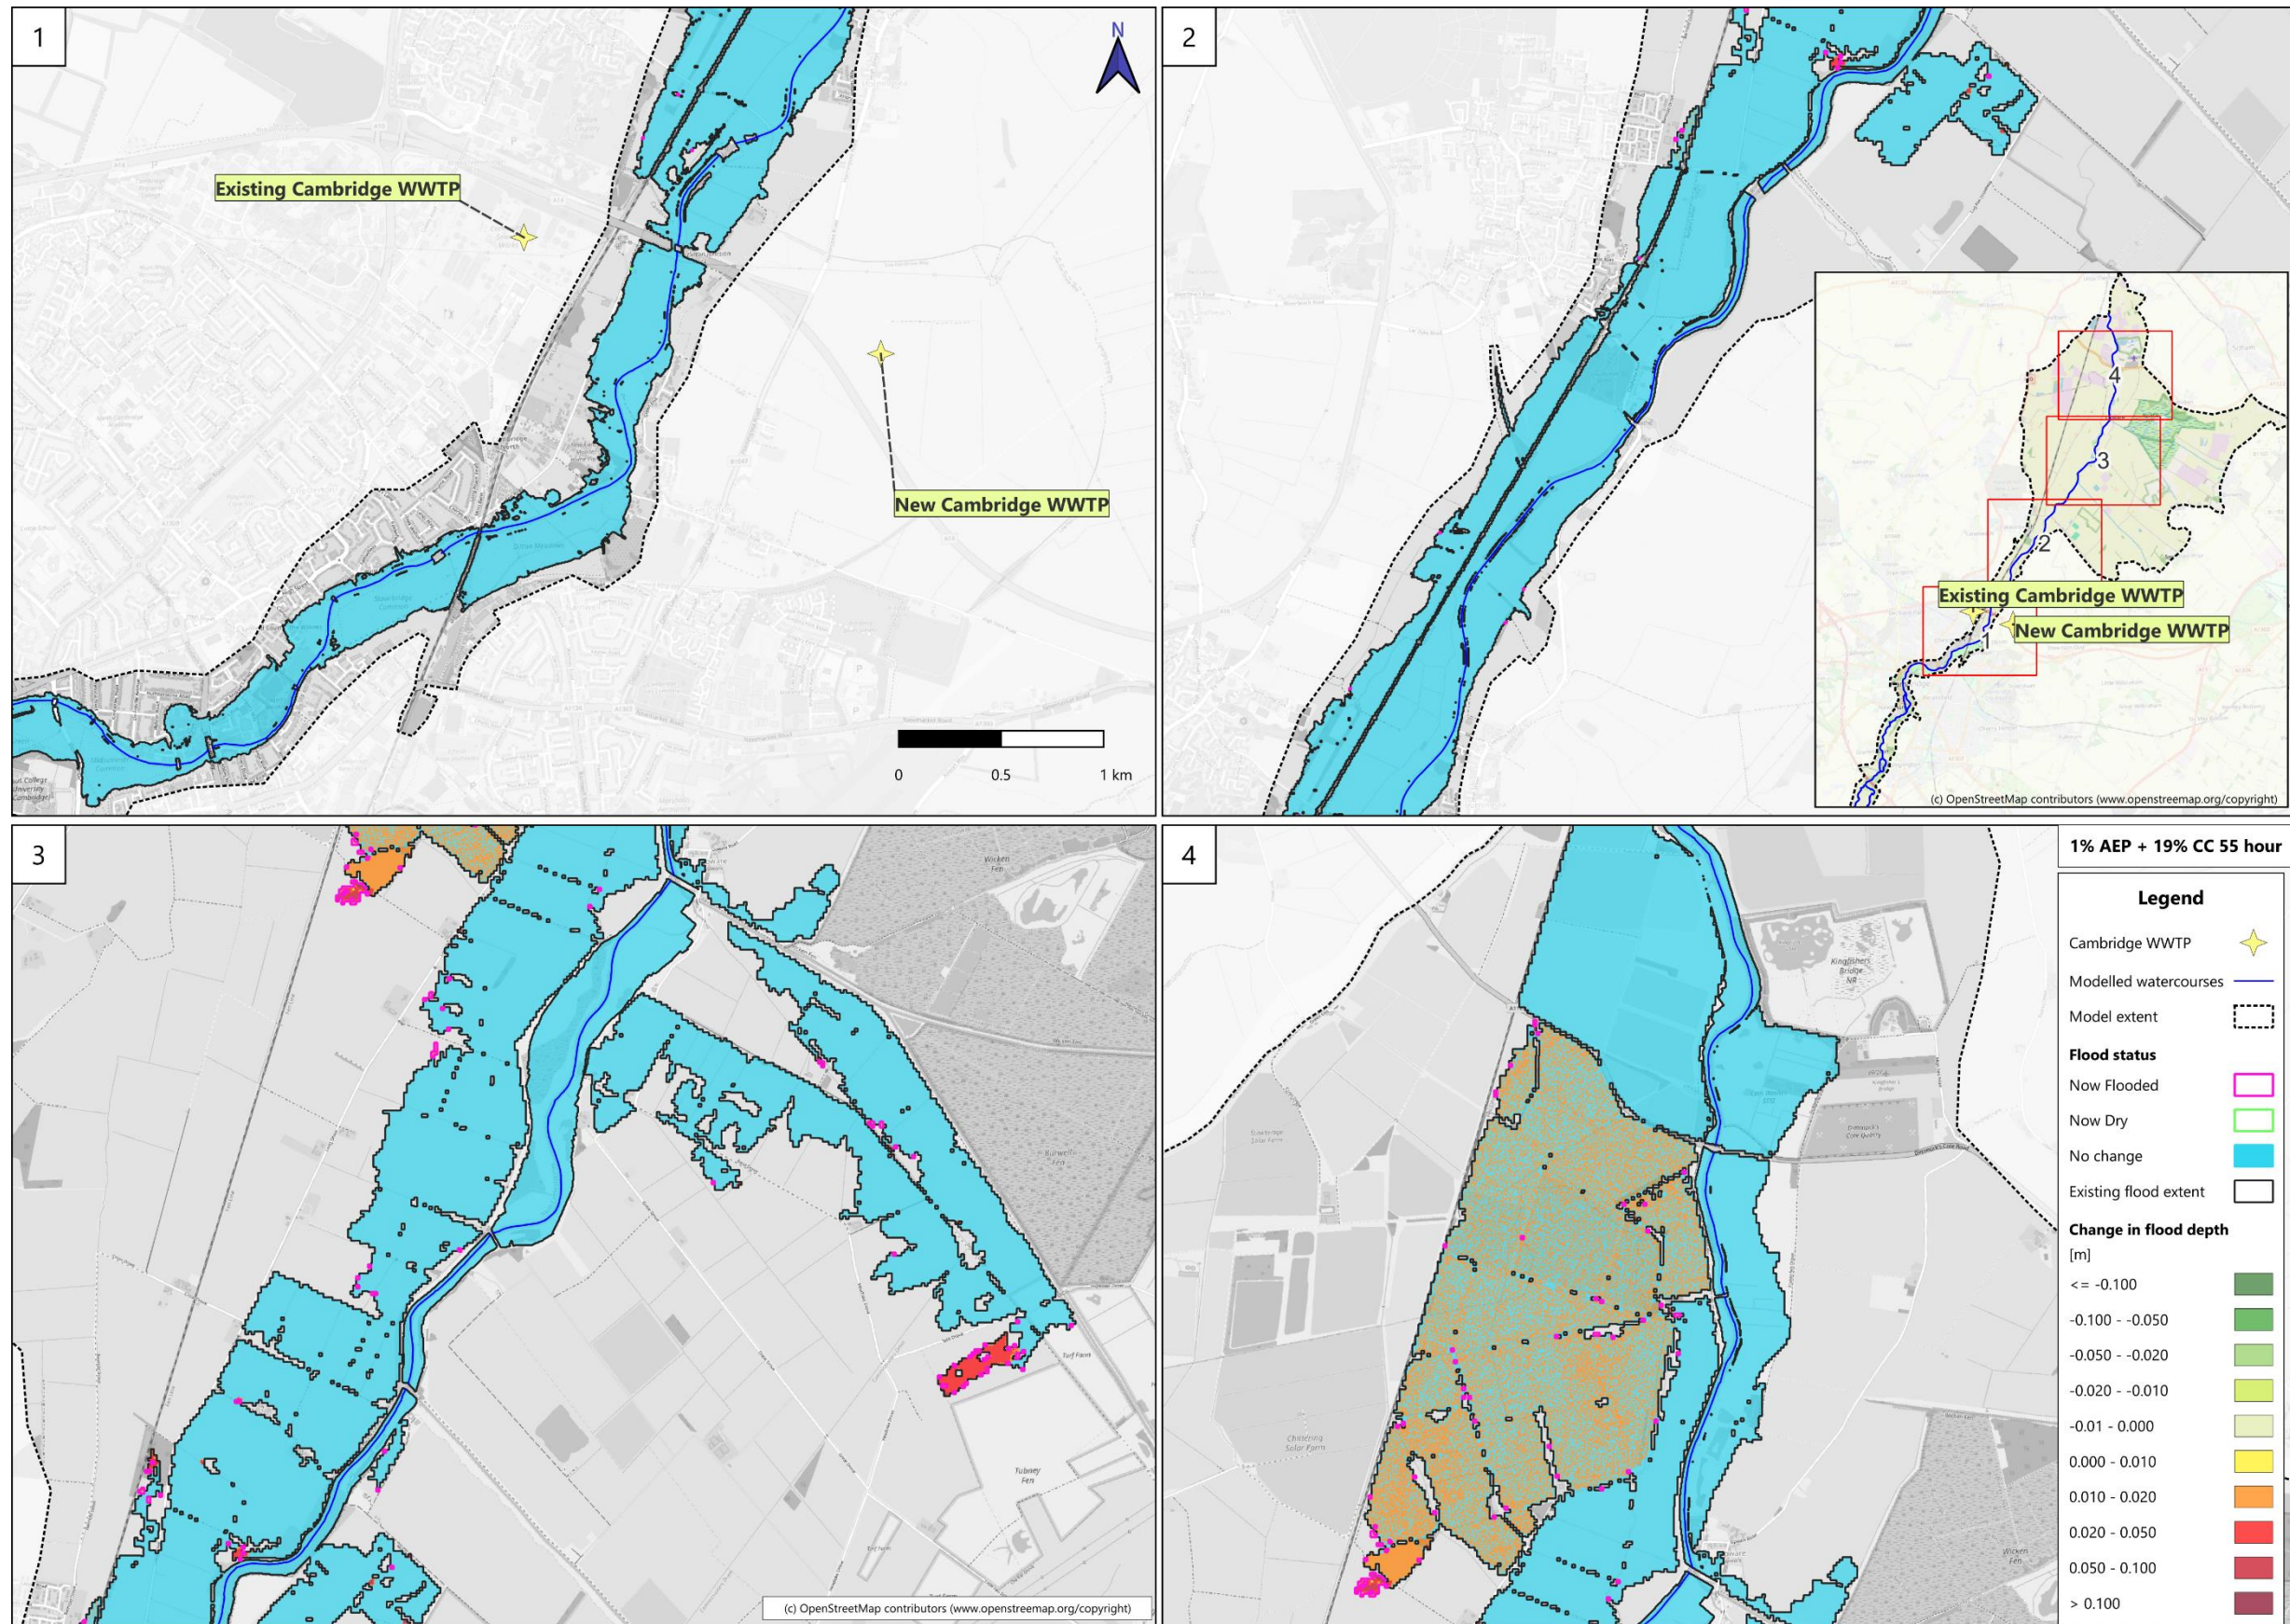


C.10 1 in 100 year flood + 45% climate change

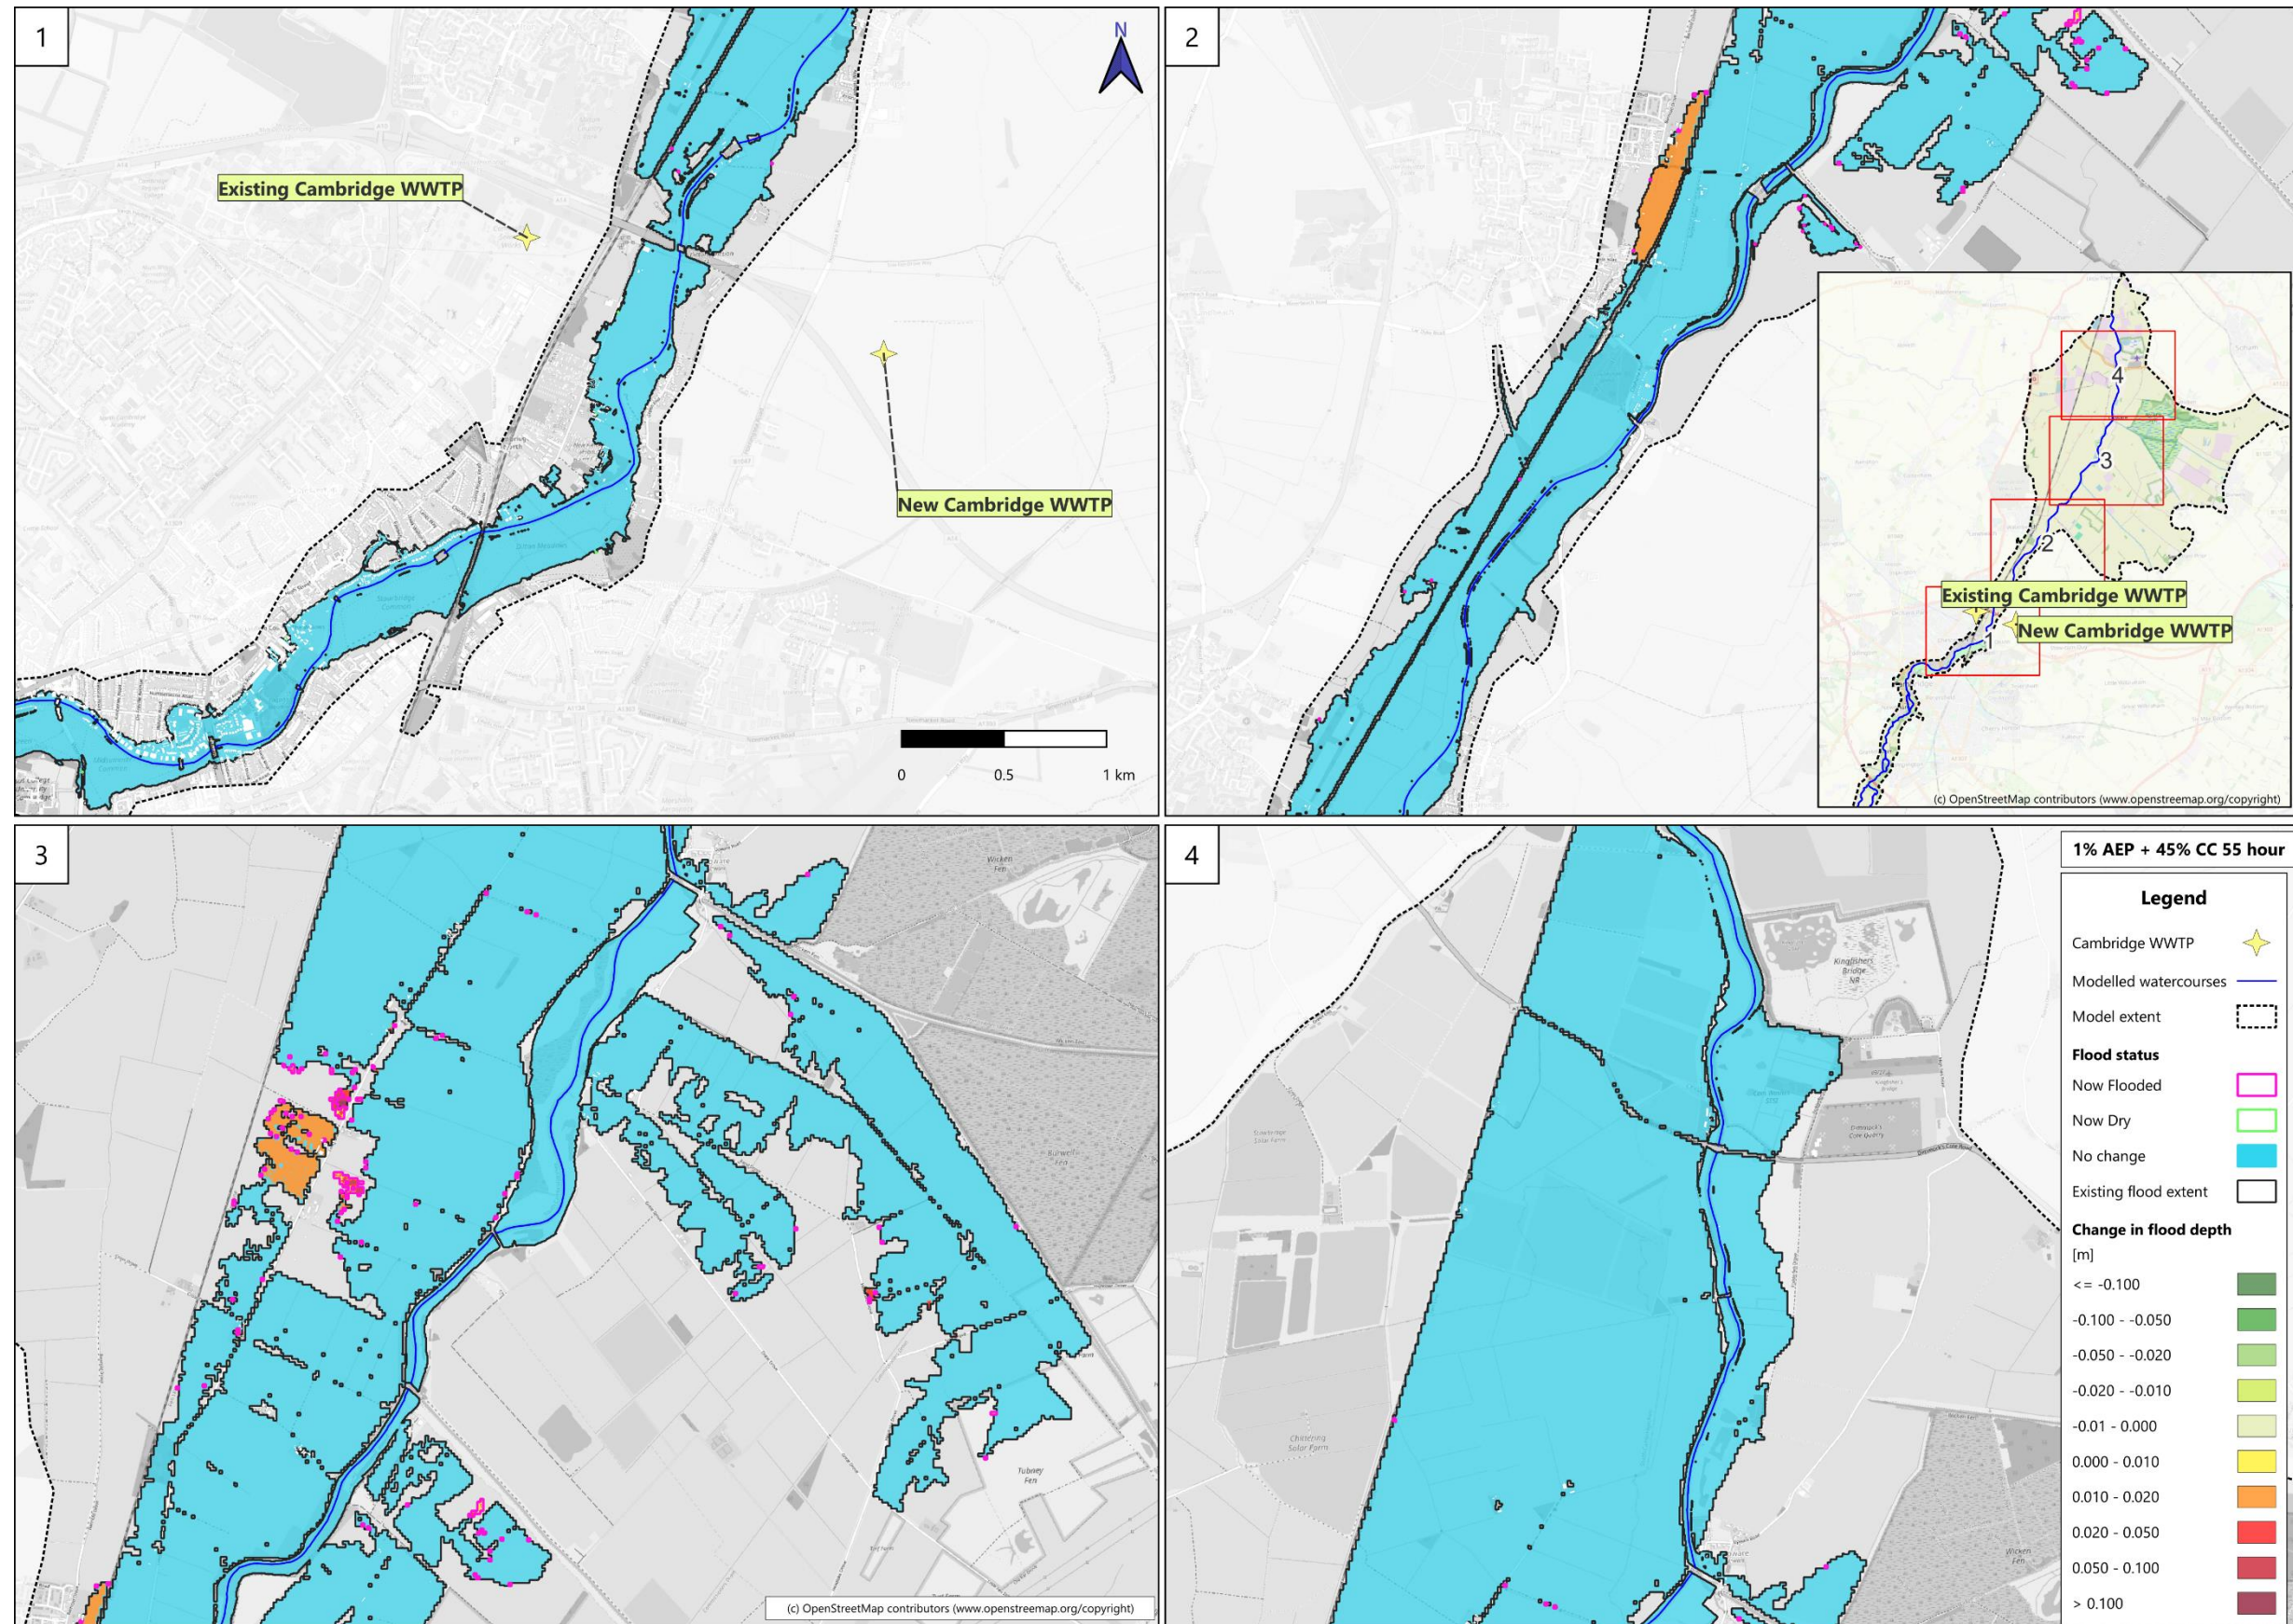


## **Appendix D: Flood difference for 4-hour storm – comparing Existing (no growth) to New Outfall (with growth)**

D.1 1 in 100 year flood

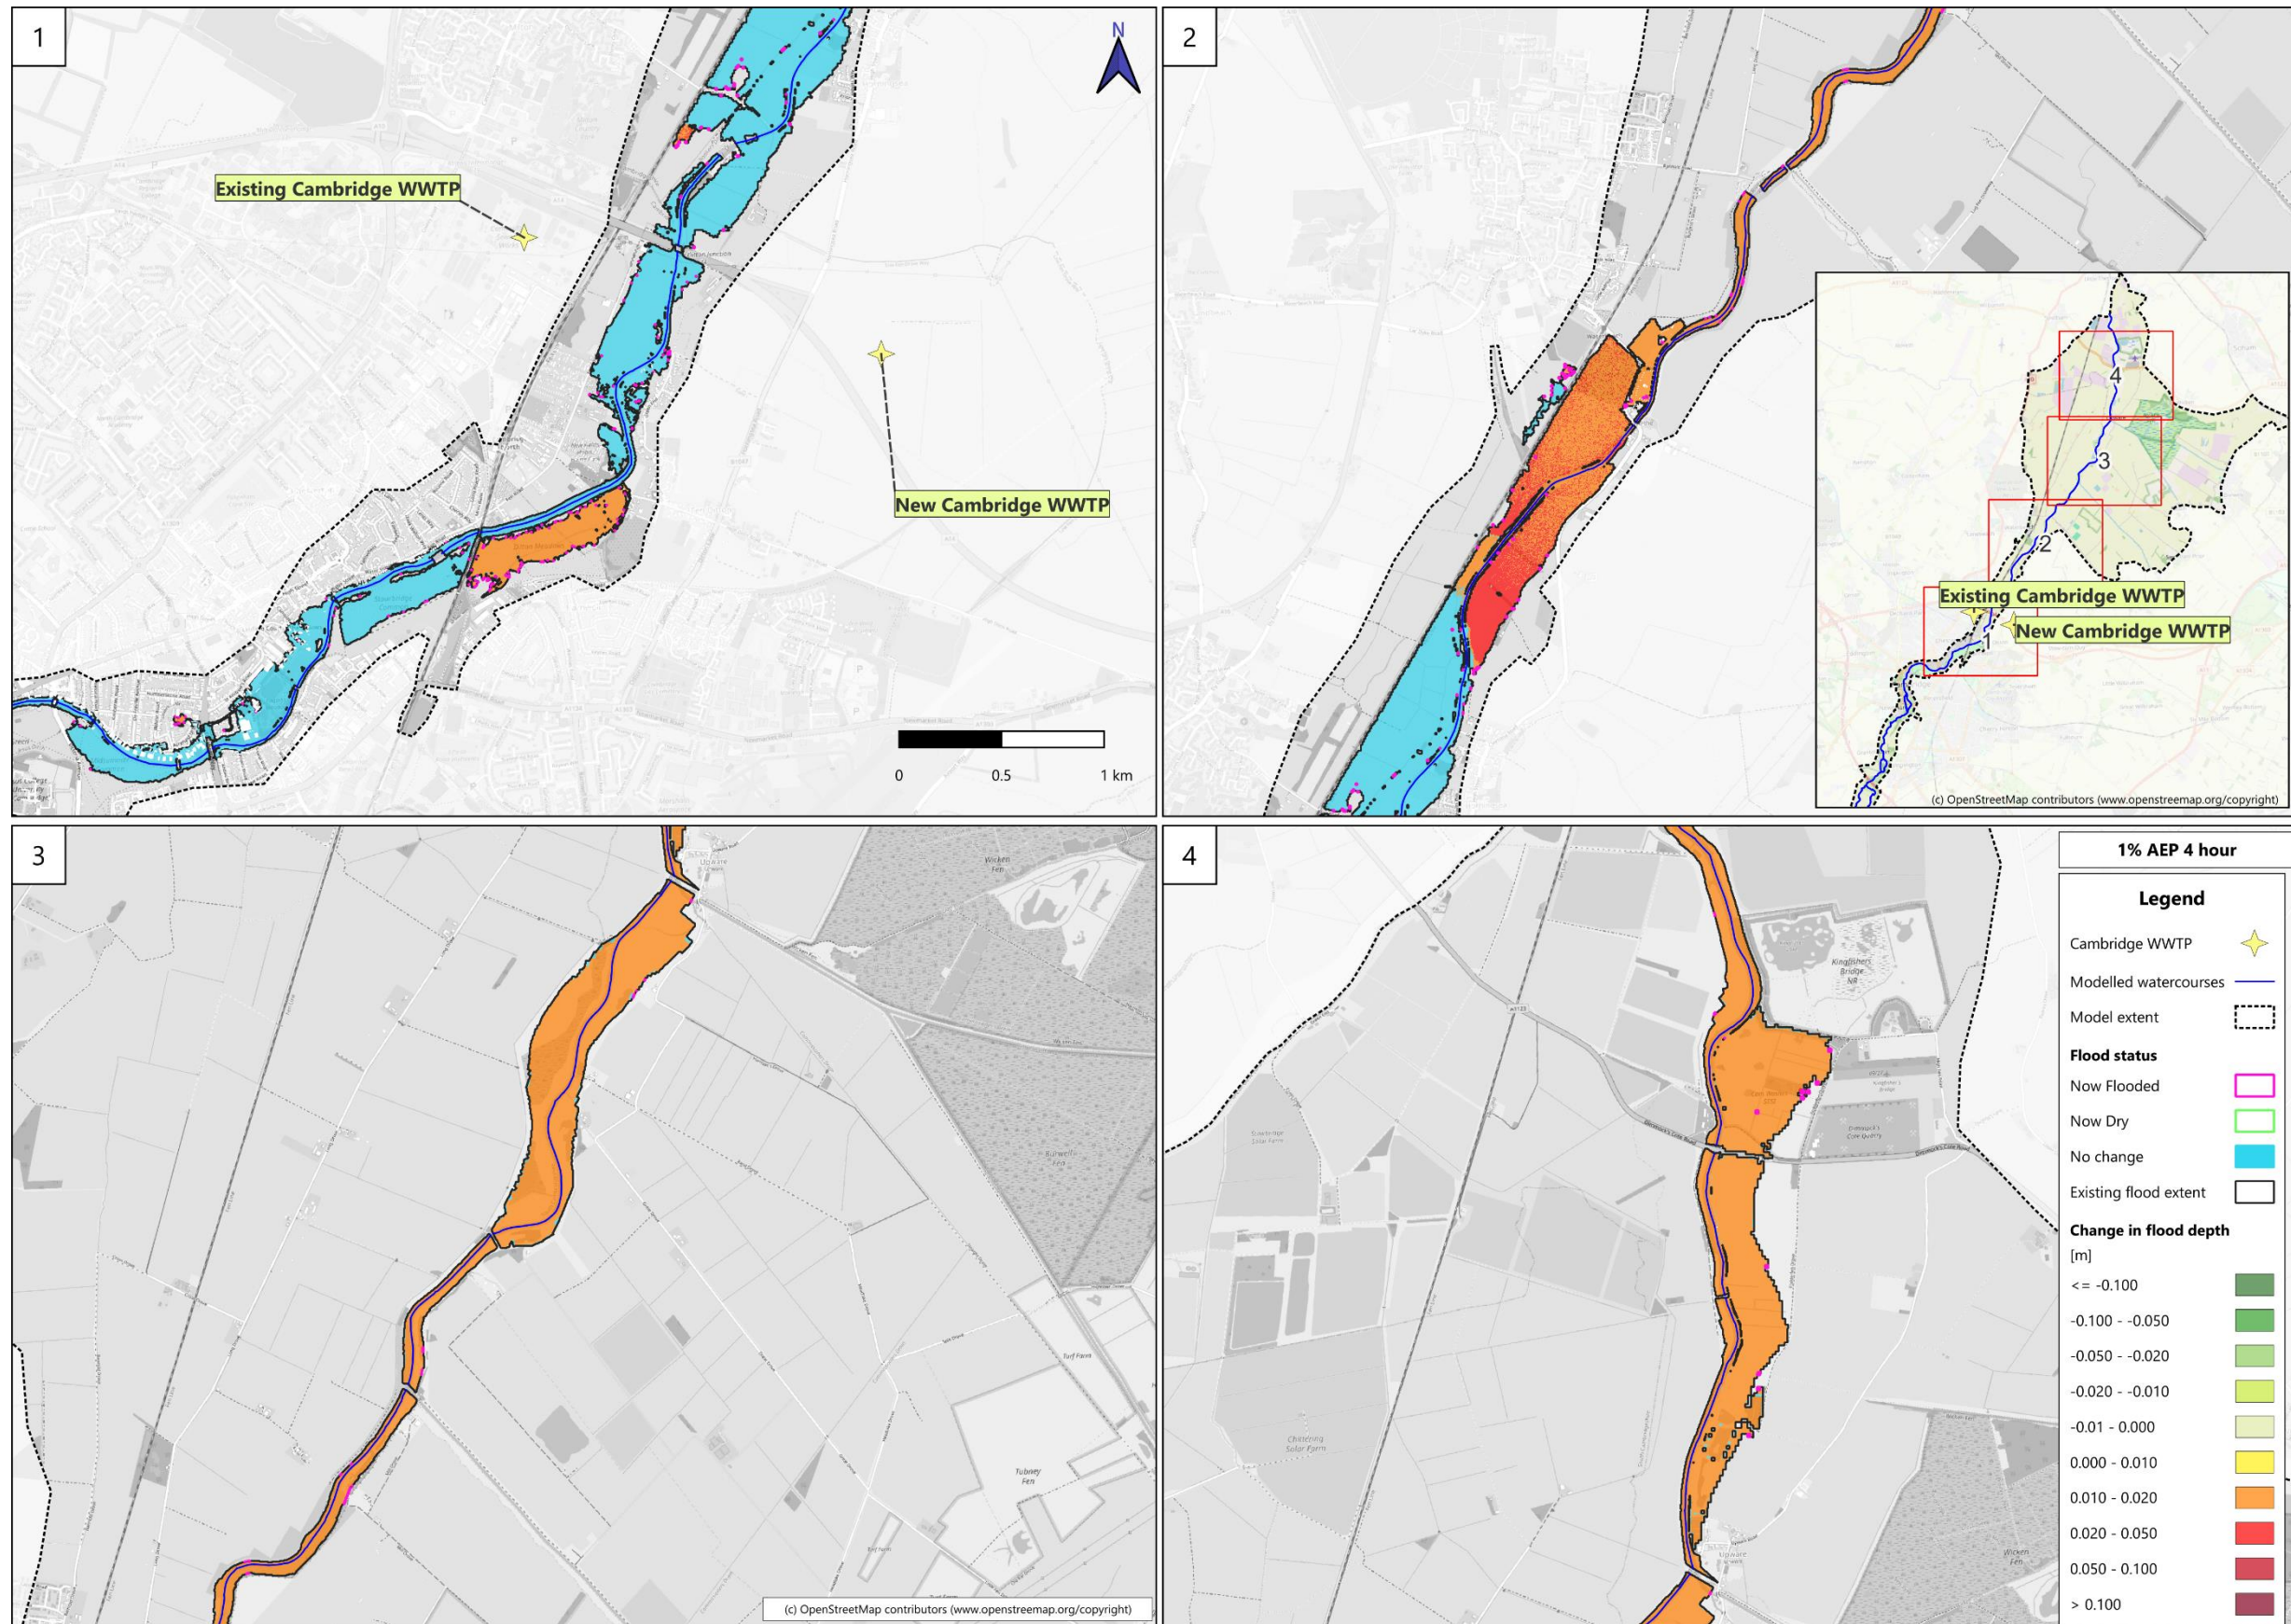





D.2 1 in 100 year flood + 9% climate change

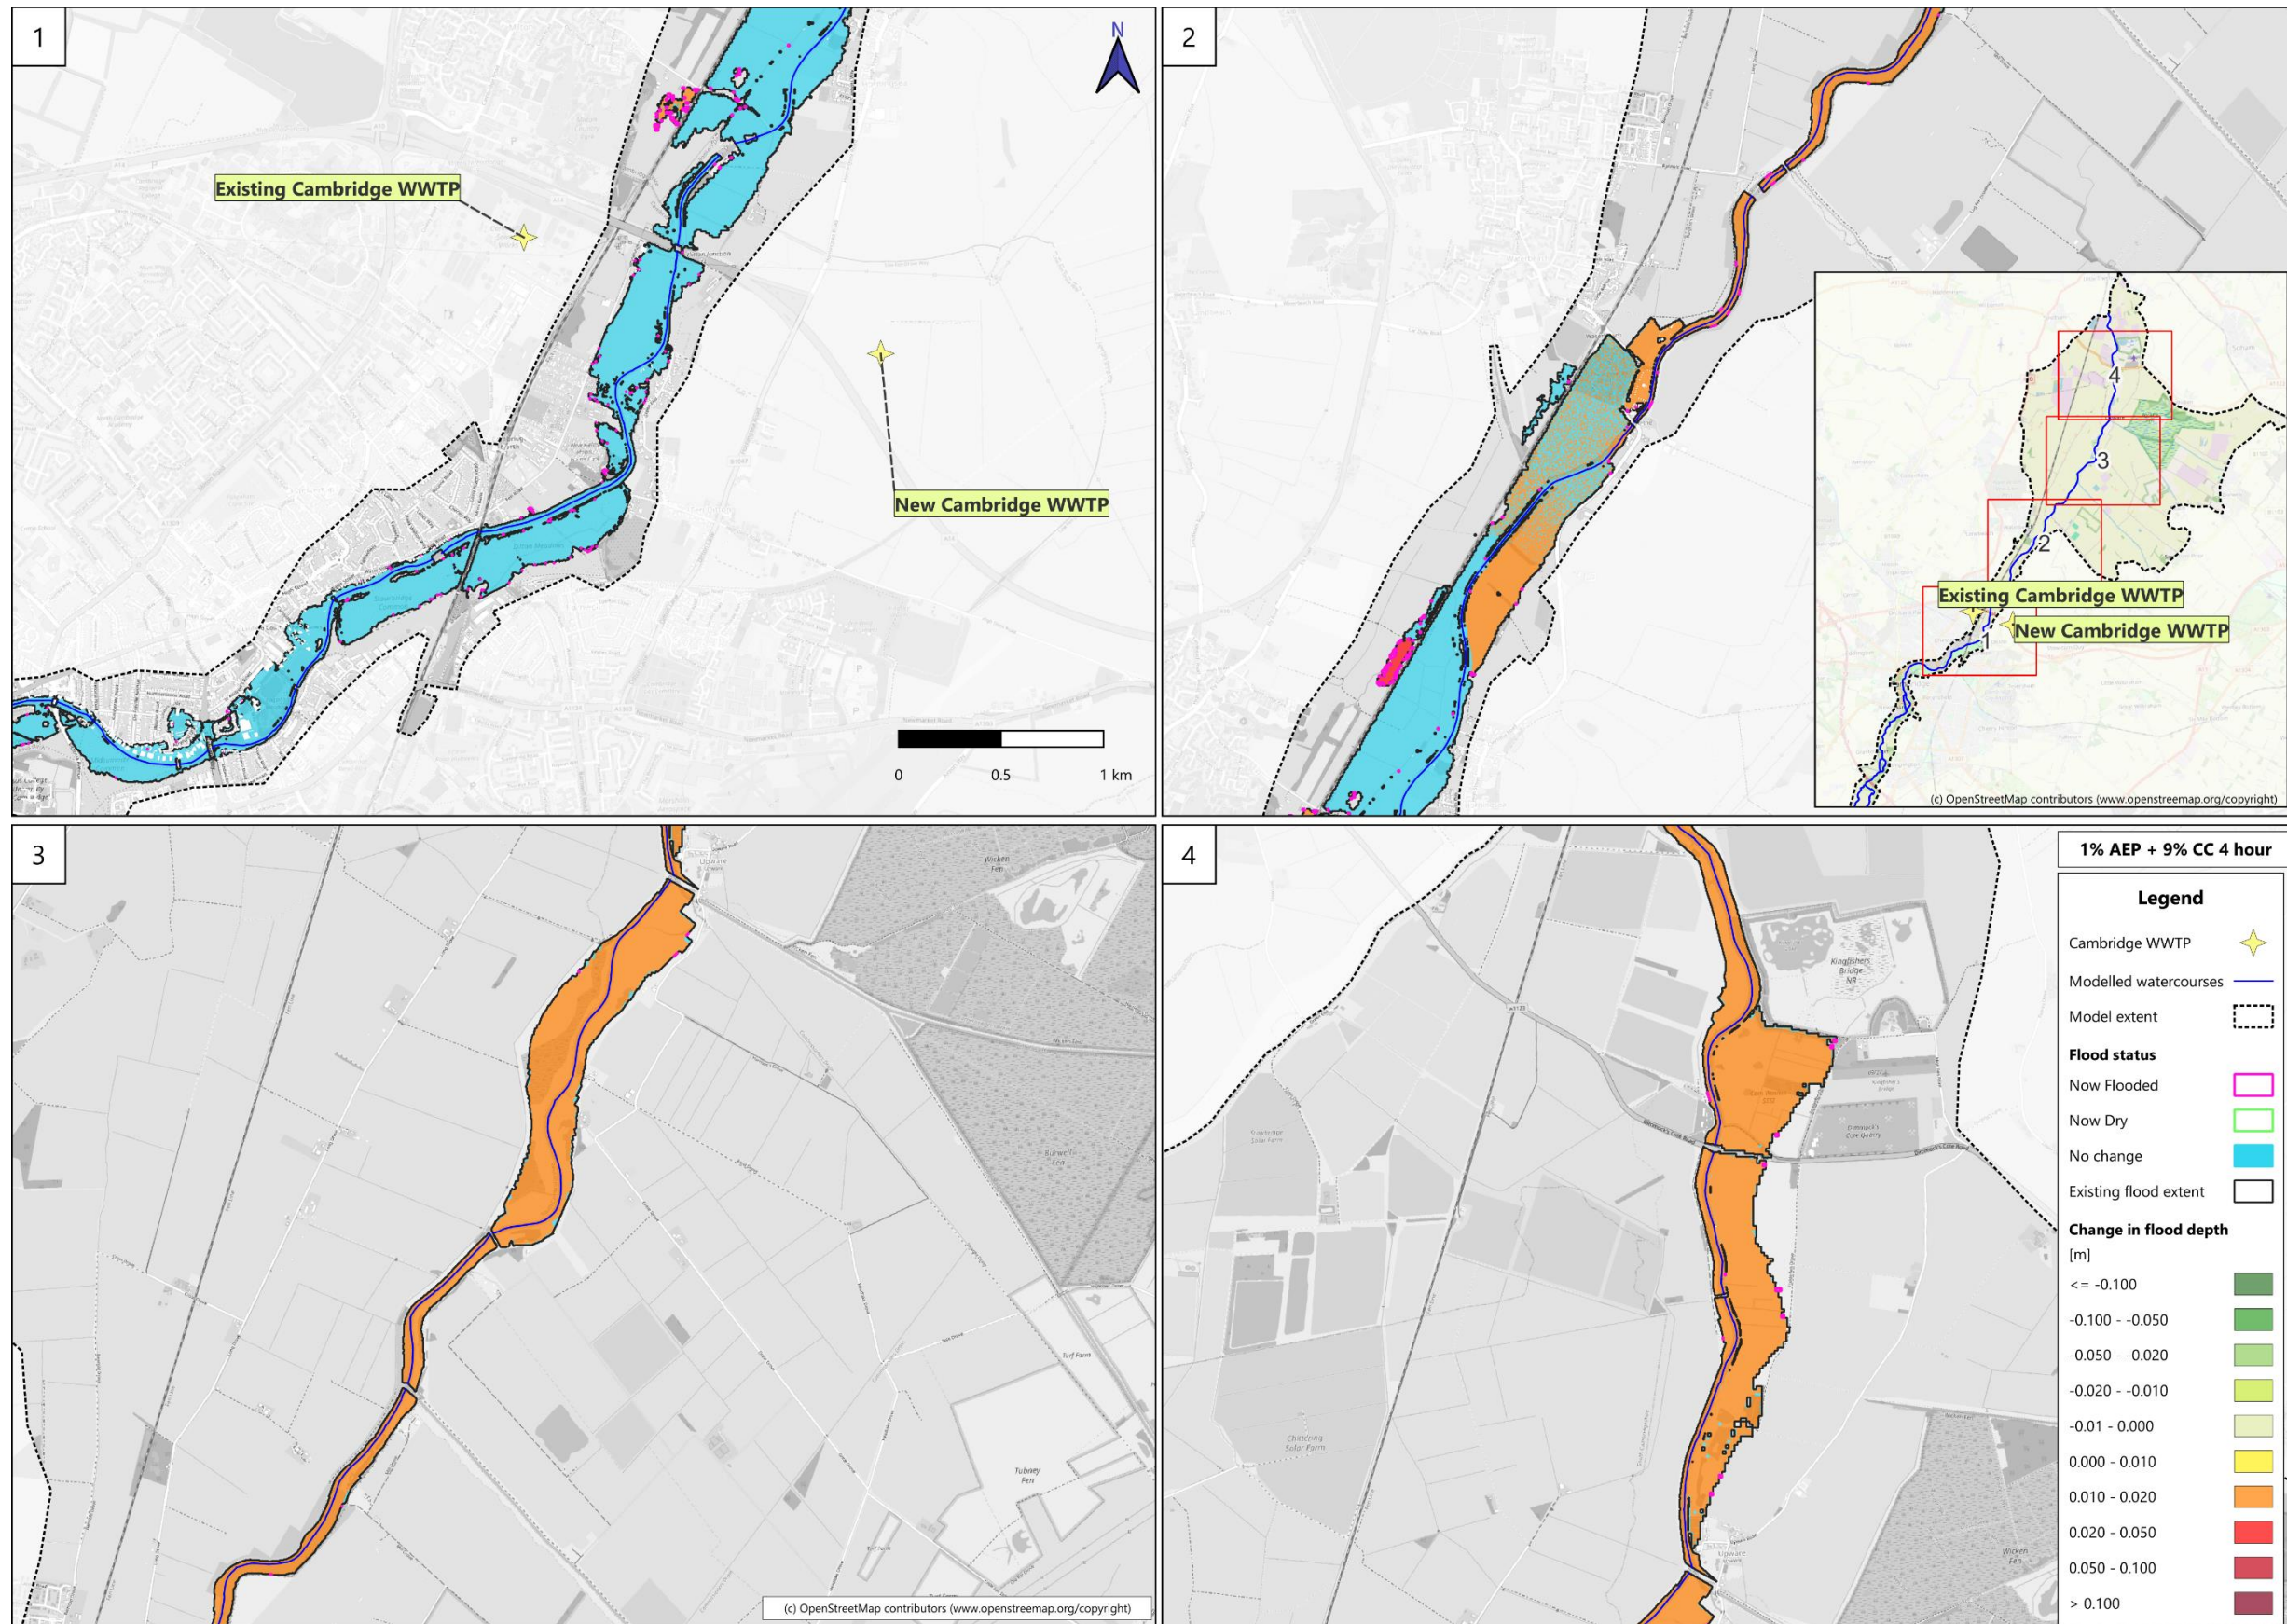

D.3 1 in 100 year flood + 19% climate change

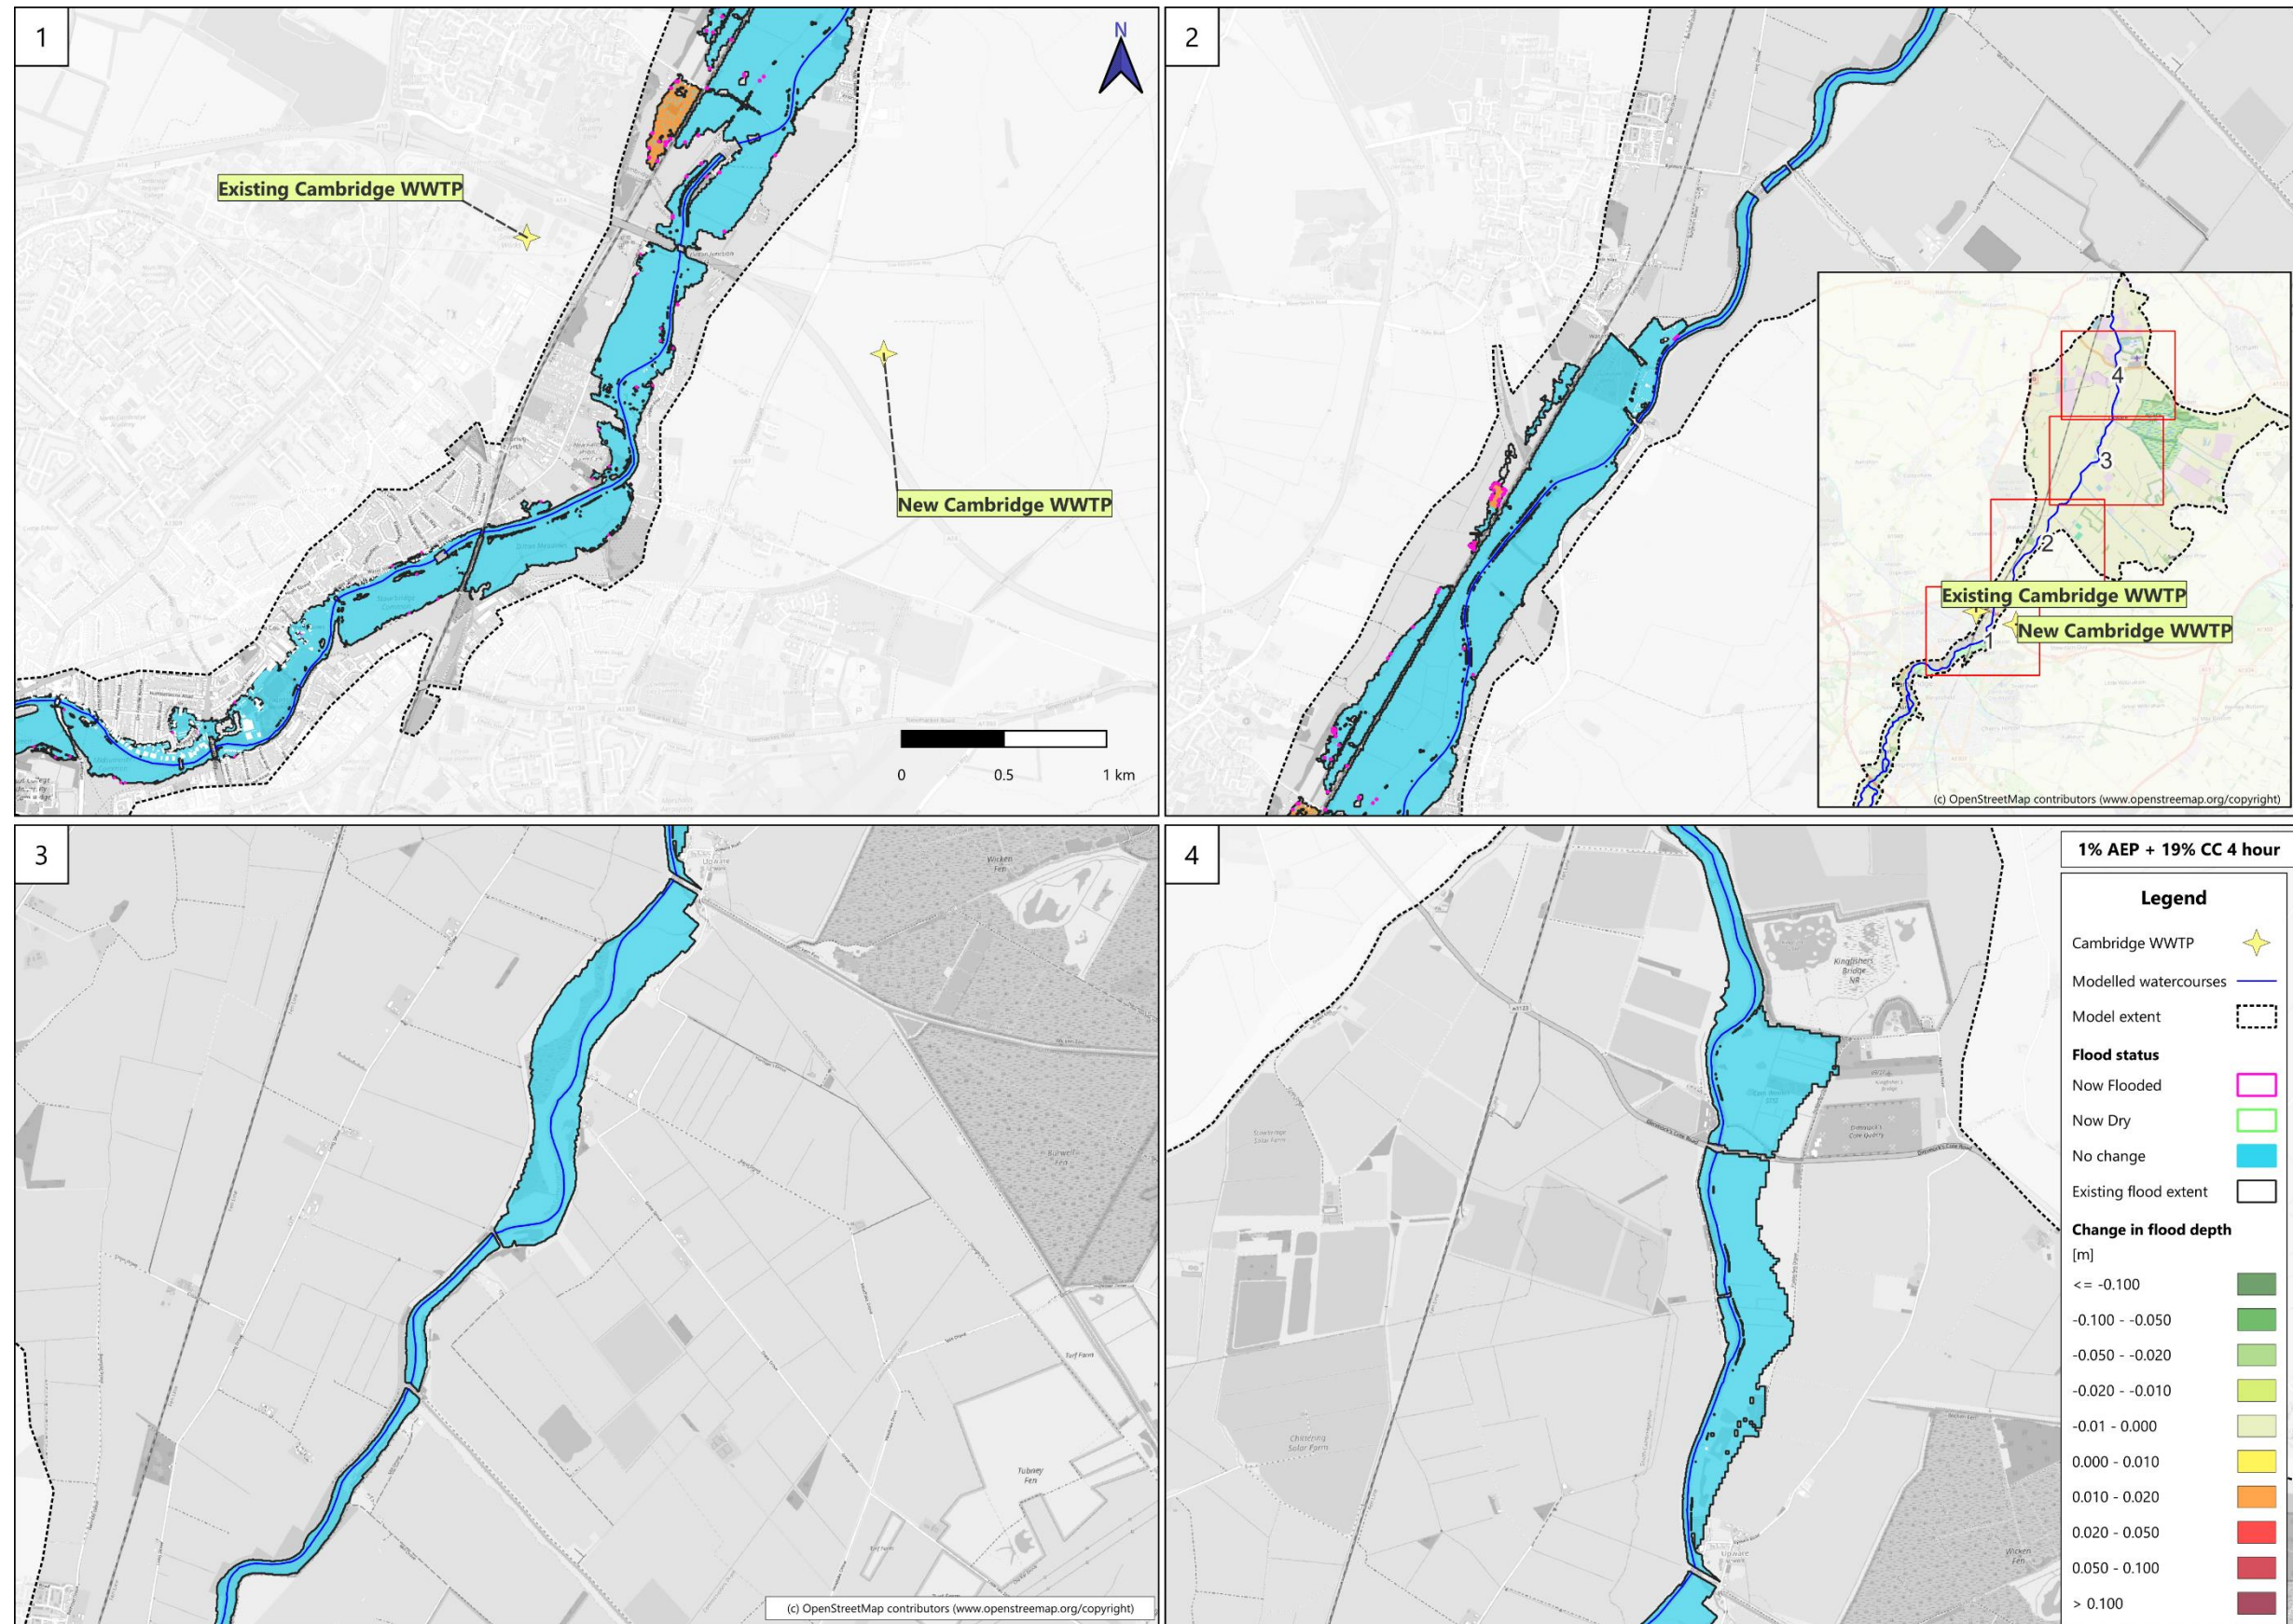

D.4 1 in 100 year flood + 45% climate change

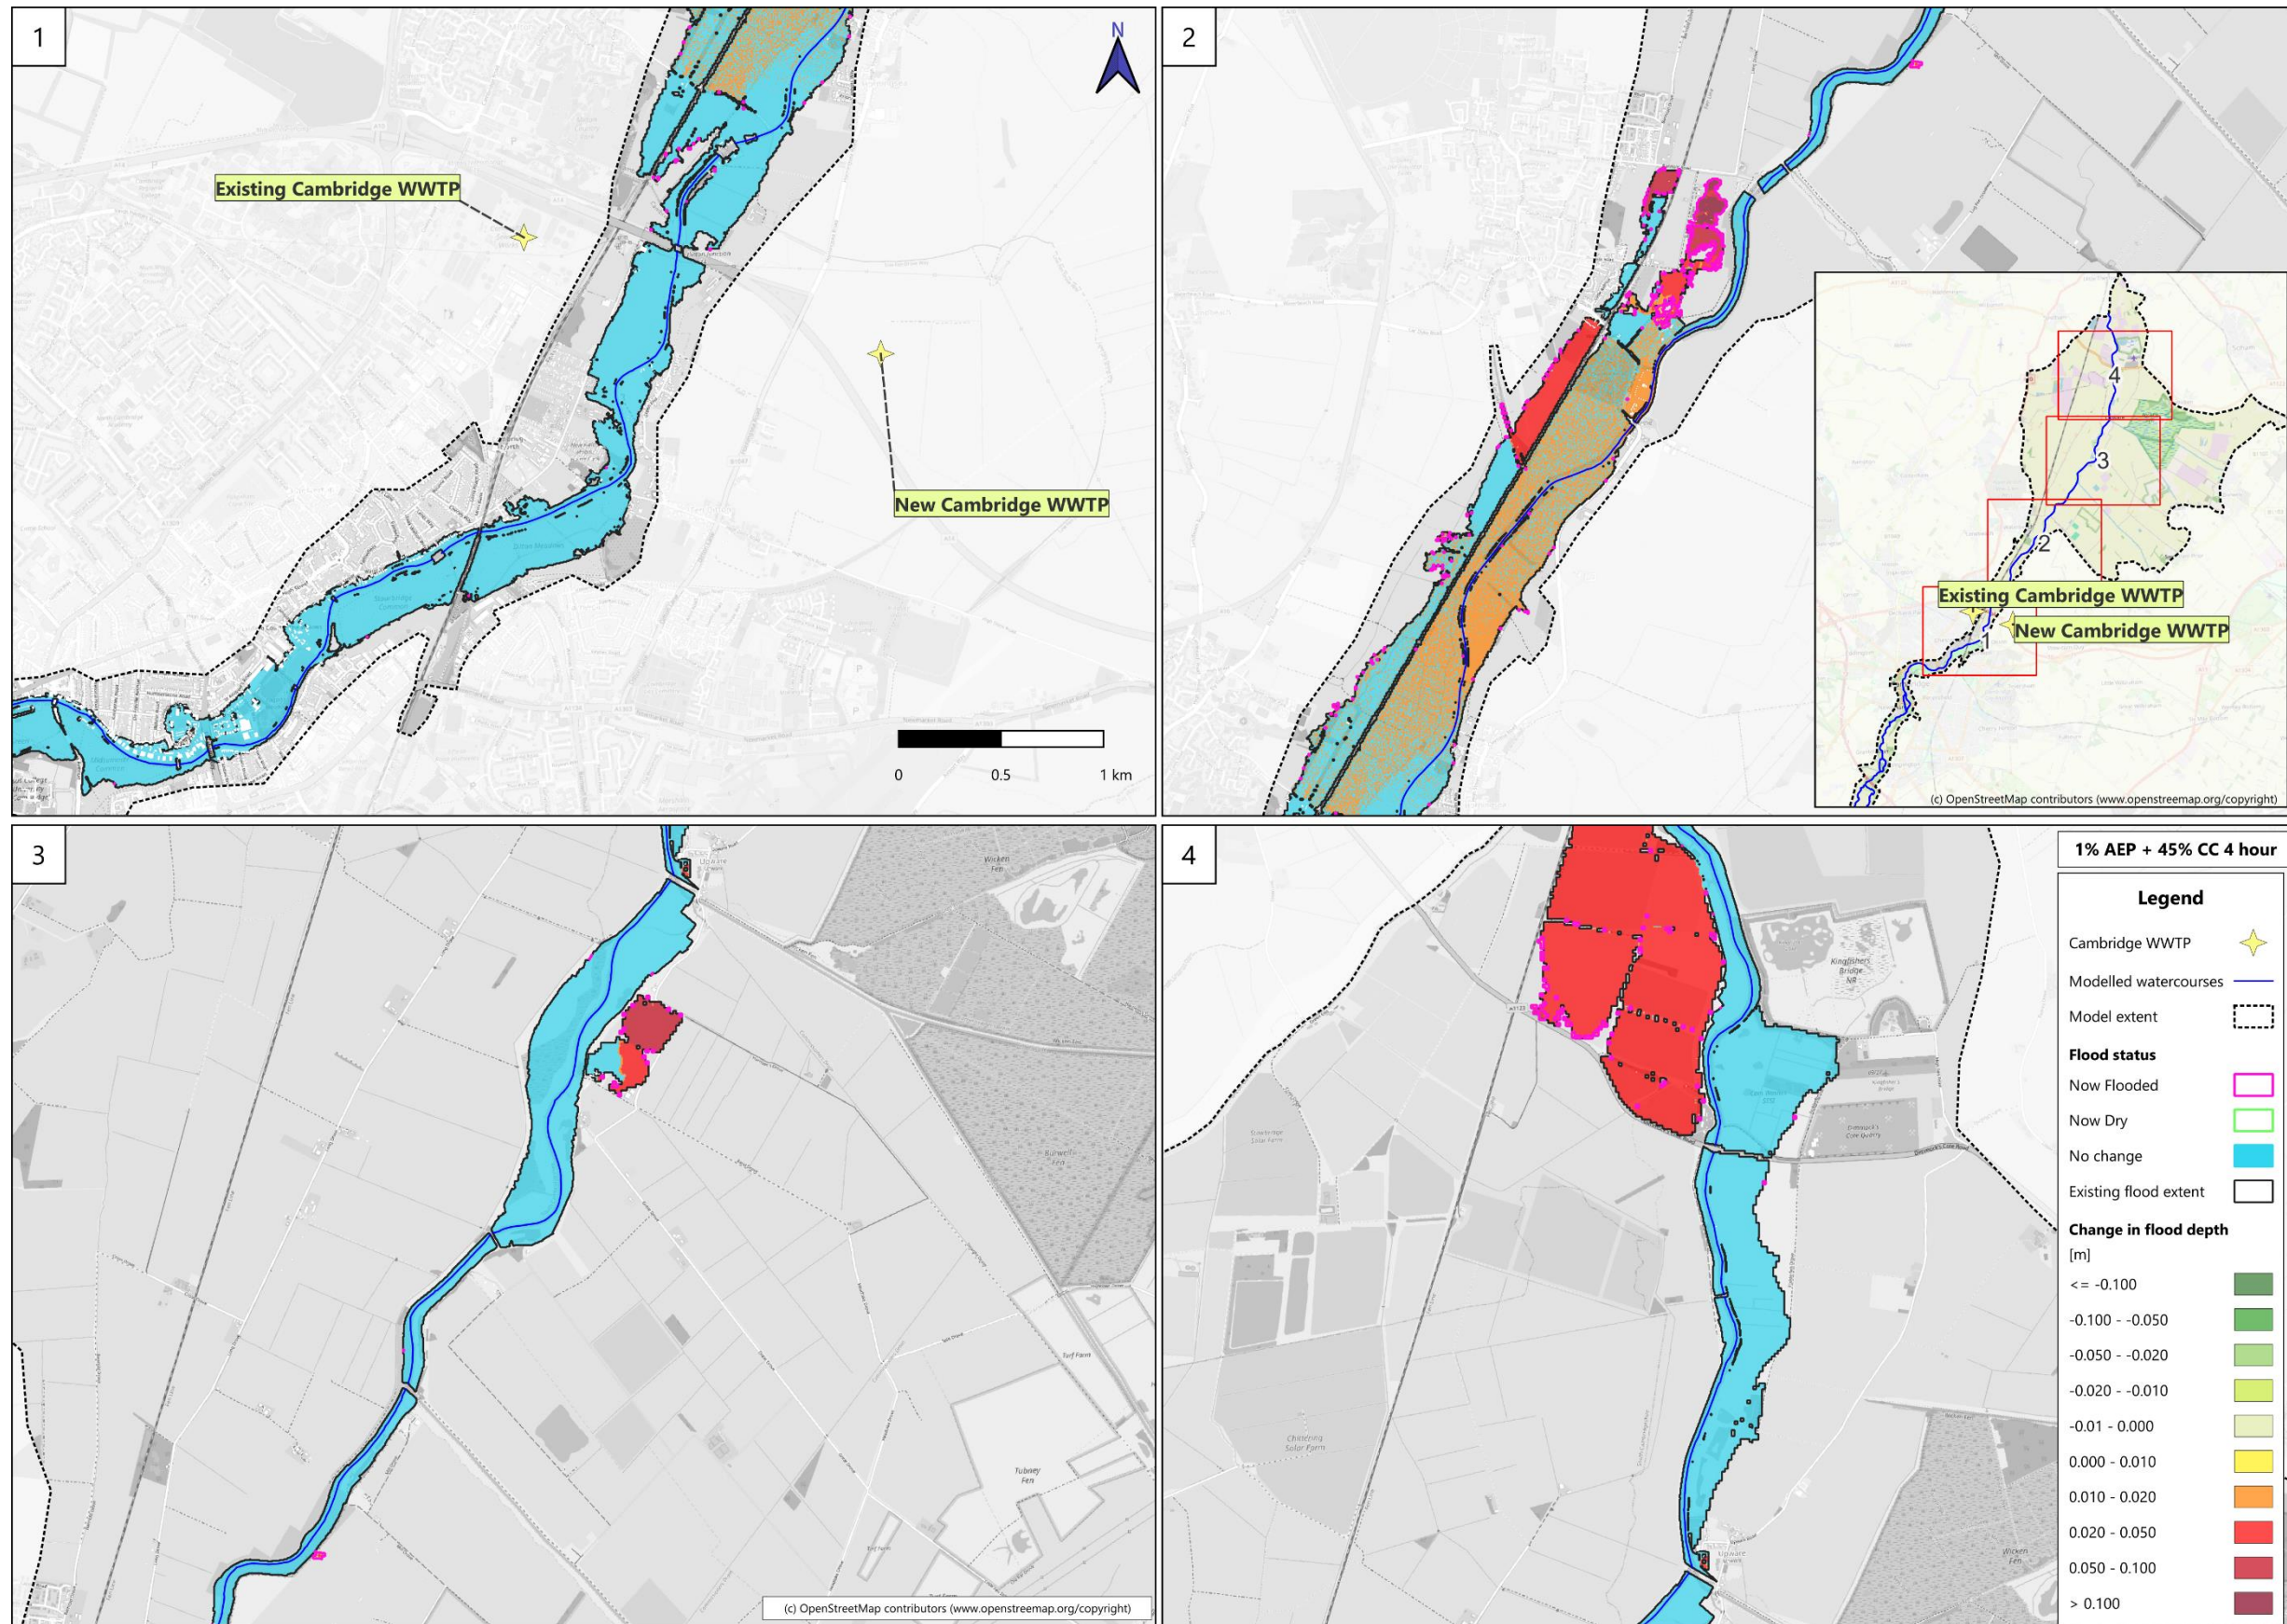

## **Appendix E: Results tables for Existing Future vs New Outfall – comparing Existing Future (with growth) to New Outfall (with growth)**

## E.1 1 in 2 year flood

Location	Node	Existing outfall (with growth)	New outfall (with growth)	Increase
		Peak water level (mAOD)		Level (m)
M11	CAM01_4253	8.719	8.719	0.000
A1134 Fen Causeway	CAM02_7723d	7.145	7.145	0.000
Silver Street	CAM02_7160	5.814	5.814	0.000
Trinity Bridge	CAM02_6603	5.595	5.595	0.000
Bridge Street	CAM02_6177	5.406	5.406	0.000
Victoria Avenue	CAM02_5371	4.743	4.742	-0.001
A1134 Elizabeth Way	CAM02_4494	4.619	4.618	-0.001
Railway	CAM02_2638	4.356	4.353	-0.003
A14	CAM02_0636	4.028	4.023	-0.005
Baits Bite Lock US	CAM02_0200	3.923	3.918	-0.005
Baits Bite Lock DS	CAM02_0000	3.508	3.503	-0.005
Horningsea	CA14400	3.301	3.297	-0.004
Waterbeach	CA12080J	2.839	2.838	-0.001
Bottisham Lock US	CA10600J	2.726	2.725	-0.001
Bottisham Lock DS	CA10560	2.561	2.560	-0.001
Shrubbs Marina	Cam8794	2.477	2.475	-0.002
Upware	Cam5007	2.375	2.373	-0.002
A1123	Cam2651u	2.289	2.287	-0.002
Great Ouse confluence	Cam0000	2.195	2.193	-0.002
		Peak flow (m <sup>3</sup> /s)		Flow (m <sup>3</sup> /s)
M11	CAM01_4253	20.3	20.3	0.0
A1134 Fen Causeway	CAM02_7723d	22.3	22.3	0.0
Silver Street	CAM02_7160	25.2	25.2	0.0
Trinity Bridge	CAM02_6603	25.2	25.2	0.0
Bridge Street	CAM02_6177	26.5	26.5	0.0
Victoria Avenue	CAM02_5371	26.5	26.6	0.0
A1134 Elizabeth Way	CAM02_4494	26.5	26.5	0.0
Railway	CAM02_2638	26.6	26.6	0.0
A14	CAM02_0636	26.9	26.7	-0.1
Baits Bite Lock US	CAM02_0200	27.7	27.5	-0.2
Baits Bite Lock DS	CAM02_0000	27.7	27.5	-0.2
Horningsea	CA14400	27.8	27.7	-0.2
Waterbeach	CA12080J	27.9	27.8	-0.1
Bottisham Lock US	CA10600J	28.1	28.0	-0.1
Bottisham Lock DS	CA10560	28.1	28.0	-0.1
Shrubbs Marina	Cam8794	30.4	30.2	-0.1
Upware	Cam5007	31.0	30.9	-0.1
A1123	Cam2651u	33.3	33.3	0.0
Great Ouse confluence	Cam0000	33.3	33.3	0.0

## E.2 1 in 10 year flood

Location	Node	Existing outfall (with growth)	New outfall (with growth)	Increase
		Peak water level (mAOD)		Level (m)
M11	CAM01_4253	9.131	9.131	0.000
A1134 Fen Causeway	CAM02_7723d	7.241	7.241	0.000
Silver Street	CAM02_7160	6.394	6.394	0.000
Trinity Bridge	CAM02_6603	6.105	6.104	-0.001
Bridge Street	CAM02_6177	5.810	5.810	0.000
Victoria Avenue	CAM02_5371	5.246	5.246	0.000
A1134 Elizabeth Way	CAM02_4494	5.080	5.080	0.000
Railway	CAM02_2638	4.781	4.781	0.000
A14	CAM02_0636	4.384	4.383	-0.001
Baits Bite Lock US	CAM02_0200	4.236	4.236	0.000
Baits Bite Lock DS	CAM02_0000	3.977	3.977	0.000
Horningsea	CA14400	3.776	3.777	0.001
Waterbeach	CA12080J	3.268	3.268	0.000
Bottisham Lock US	CA10600J	3.153	3.153	0.000
Bottisham Lock DS	CA10560	3.043	3.042	-0.001
Shrubbs Marina	Cam8794	2.957	2.956	-0.001
Upware	Cam5007	2.872	2.871	-0.001
A1123	Cam2651u	2.810	2.809	-0.001
Great Ouse confluence	Cam0000	2.740	2.739	-0.001
		Peak flow (m <sup>3</sup> /s)		Flow (m <sup>3</sup> /s)
M11	CAM01_4253	32.8	32.8	0.0
A1134 Fen Causeway	CAM02_7723d	27.6	27.6	0.0
Silver Street	CAM02_7160	40.6	40.6	0.0
Trinity Bridge	CAM02_6603	40.6	40.6	0.0
Bridge Street	CAM02_6177	41.6	41.6	0.0
Victoria Avenue	CAM02_5371	41.3	41.3	0.0
A1134 Elizabeth Way	CAM02_4494	41.6	41.6	0.0
Railway	CAM02_2638	41.8	41.8	0.0
A14	CAM02_0636	41.8	41.7	0.0
Baits Bite Lock US	CAM02_0200	40.9	40.9	0.0
Baits Bite Lock DS	CAM02_0000	40.9	40.9	0.0
Horningsea	CA14400	37.9	37.9	0.0
Waterbeach	CA12080J	38.6	38.7	0.0
Bottisham Lock US	CA10600J	38.0	38.1	0.0
Bottisham Lock DS	CA10560	38.0	38.1	0.0
Shrubbs Marina	Cam8794	40.5	40.5	-0.1
Upware	Cam5007	41.4	41.4	0.0
A1123	Cam2651u	45.2	45.1	-0.1
Great Ouse confluence	Cam0000	44.4	44.4	0.0

### E.3 1 in 20 year flood

Location	Node	Existing outfall (with growth)	New outfall (with growth)	Increase
		Peak water level (mAOD)		Level (m)
M11	CAM01_4253	9.240	9.240	0.000
A1134 Fen Causeway	CAM02_7723d	7.290	7.290	0.000
Silver Street	CAM02_7160	6.768	6.766	-0.002
Trinity Bridge	CAM02_6603	6.432	6.432	0.000
Bridge Street	CAM02_6177	6.062	6.062	0.000
Victoria Avenue	CAM02_5371	5.484	5.484	0.000
A1134 Elizabeth Way	CAM02_4494	5.284	5.284	0.000
Railway	CAM02_2638	4.940	4.940	0.000
A14	CAM02_0636	4.489	4.489	0.000
Baits Bite Lock US	CAM02_0200	4.339	4.339	0.000
Baits Bite Lock DS	CAM02_0000	4.075	4.075	0.000
Horningsea	CA14400	3.917	3.917	0.000
Waterbeach	CA12080J	3.588	3.588	0.000
Bottisham Lock US	CA10600J	3.478	3.477	-0.001
Bottisham Lock DS	CA10560	3.378	3.378	0.000
Shrubbs Marina	Cam8794	3.295	3.295	0.000
Upware	Cam5007	3.219	3.218	-0.001
A1123	Cam2651u	3.166	3.166	0.000
Great Ouse confluence	Cam0000	3.114	3.113	-0.001
		Peak flow (m <sup>3</sup> /s)		Flow (m <sup>3</sup> /s)
M11	CAM01_4253	41.3	41.3	0.0
A1134 Fen Causeway	CAM02_7723d	29.1	29.1	0.0
Silver Street	CAM02_7160	53.1	52.3	-0.8
Trinity Bridge	CAM02_6603	52.0	52.0	0.0
Bridge Street	CAM02_6177	53.3	53.3	0.0
Victoria Avenue	CAM02_5371	52.4	52.4	0.0
A1134 Elizabeth Way	CAM02_4494	53.2	53.2	0.0
Railway	CAM02_2638	53.3	53.3	0.0
A14	CAM02_0636	51.5	51.4	-0.1
Baits Bite Lock US	CAM02_0200	45.8	45.8	0.0
Baits Bite Lock DS	CAM02_0000	45.8	45.8	0.0
Horningsea	CA14400	38.4	38.4	0.0
Waterbeach	CA12080J	50.3	50.3	0.0
Bottisham Lock US	CA10600J	50.7	50.7	0.0
Bottisham Lock DS	CA10560	50.7	50.7	0.0
Shrubbs Marina	Cam8794	52.8	52.7	0.0
Upware	Cam5007	51.2	51.2	0.0
A1123	Cam2651u	53.7	53.7	0.0
Great Ouse confluence	Cam0000	53.1	53.1	0.0

### E.4 1 in 30 year flood

Location	Node	Existing outfall (with growth)	New outfall (with growth)	Increase
		<b>Peak water level (mAOD)</b>		<b>Level (m)</b>
M11	CAM01_4253	9.286	9.286	0.000
A1134 Fen Causeway	CAM02_7723d	7.316	7.316	0.000
Silver Street	CAM02_7160	6.891	6.891	0.000
Trinity Bridge	CAM02_6603	6.539	6.539	0.000
Bridge Street	CAM02_6177	6.141	6.141	0.000
Victoria Avenue	CAM02_5371	5.550	5.550	0.000
A1134 Elizabeth Way	CAM02_4494	5.345	5.345	0.000
Railway	CAM02_2638	4.996	4.996	0.000
A14	CAM02_0636	4.526	4.525	-0.001
Baits Bite Lock US	CAM02_0200	4.375	4.375	0.000
Baits Bite Lock DS	CAM02_0000	4.107	4.106	-0.001
Horningsea	CA14400	3.955	3.955	0.000
Waterbeach	CA12080J	3.728	3.728	0.000
Bottisham Lock US	CA10600J	3.621	3.620	-0.001
Bottisham Lock DS	CA10560	3.530	3.529	-0.001
Shrubbs Marina	Cam8794	3.449	3.448	-0.001
Upware	Cam5007	3.376	3.376	0.000
A1123	Cam2651u	3.327	3.326	-0.001
Great Ouse confluence	Cam0000	3.278	3.278	0.000
		<b>Peak flow (m<sup>3</sup>/s)</b>		<b>Flow (m<sup>3</sup>/s)</b>
M11	CAM01_4253	44.8	44.8	0.0
A1134 Fen Causeway	CAM02_7723d	29.1	29.1	0.0
Silver Street	CAM02_7160	56.2	56.2	0.0
Trinity Bridge	CAM02_6603	56.2	56.2	0.0
Bridge Street	CAM02_6177	57.4	57.4	0.0
Victoria Avenue	CAM02_5371	55.5	55.6	0.0
A1134 Elizabeth Way	CAM02_4494	56.5	56.5	0.0
Railway	CAM02_2638	56.8	56.8	0.0
A14	CAM02_0636	56.3	56.2	-0.1
Baits Bite Lock US	CAM02_0200	47.9	47.8	-0.1
Baits Bite Lock DS	CAM02_0000	47.9	47.8	-0.1
Horningsea	CA14400	38.8	39.0	0.1
Waterbeach	CA12080J	52.6	52.5	0.0
Bottisham Lock US	CA10600J	55.2	55.2	0.0
Bottisham Lock DS	CA10560	55.2	55.2	0.0
Shrubbs Marina	Cam8794	57.2	57.1	-0.1
Upware	Cam5007	55.0	55.0	0.0
A1123	Cam2651u	57.8	57.8	0.0
Great Ouse confluence	Cam0000	57.2	57.2	0.0



### E.5 1 in 50 year flood

Location	Node	Existing outfall (with growth)	New outfall (with growth)	Increase
		Peak water level (mAOD)	Level (m)	
M11	CAM01_4253	9.352	9.352	0.000
A1134 Fen Causeway	CAM02_7723d	7.365	7.365	0.000
Silver Street	CAM02_7160	7.087	7.087	0.000
Trinity Bridge	CAM02_6603	6.715	6.715	0.000
Bridge Street	CAM02_6177	6.274	6.274	0.000
Victoria Avenue	CAM02_5371	5.662	5.662	0.000
A1134 Elizabeth Way	CAM02_4494	5.440	5.440	0.000
Railway	CAM02_2638	5.072	5.072	0.000
A14	CAM02_0636	4.573	4.572	-0.001
Baits Bite Lock US	CAM02_0200	4.426	4.426	0.000
Baits Bite Lock DS	CAM02_0000	4.166	4.166	0.000
Horningsea	CA14400	4.037	4.037	0.000
Waterbeach	CA12080J	3.903	3.903	0.000
Bottisham Lock US	CA10600J	3.790	3.790	0.000
Bottisham Lock DS	CA10560	3.711	3.711	0.000
Shrubbs Marina	Cam8794	3.632	3.632	0.000
Upware	Cam5007	3.562	3.562	0.000
A1123	Cam2651u	3.515	3.514	-0.001
Great Ouse confluence	Cam0000	3.469	3.469	0.000
		Peak flow (m <sup>3</sup> /s)	Flow (m <sup>3</sup> /s)	
M11	CAM01_4253	50.2	50.2	0.0
A1134 Fen Causeway	CAM02_7723d	29.1	29.1	0.0
Silver Street	CAM02_7160	60.7	60.7	0.0
Trinity Bridge	CAM02_6603	62.9	62.9	0.0
Bridge Street	CAM02_6177	64.3	64.3	0.0
Victoria Avenue	CAM02_5371	62.7	62.7	0.0
A1134 Elizabeth Way	CAM02_4494	63.7	63.7	0.0
Railway	CAM02_2638	64.5	64.5	0.0
A14	CAM02_0636	63.6	63.6	0.0
Baits Bite Lock US	CAM02_0200	50.4	50.4	0.0
Baits Bite Lock DS	CAM02_0000	50.4	50.4	0.0
Horningsea	CA14400	39.4	39.5	0.1
Waterbeach	CA12080J	53.7	53.7	0.0
Bottisham Lock US	CA10600J	61.5	61.5	-0.1
Bottisham Lock DS	CA10560	61.5	61.5	-0.1
Shrubbs Marina	Cam8794	63.2	63.1	-0.1
Upware	Cam5007	60.2	60.1	0.0
A1123	Cam2651u	63.1	63.0	0.0
Great Ouse confluence	Cam0000	62.2	62.2	0.0

## E.6 1 in 75 year flood

Location	Node	Existing outfall (with growth)	New outfall (with growth)	Increase
		Peak water level (mAOD)		Level (m)
M11	CAM01_4253	9.420	9.420	0.000
A1134 Fen Causeway	CAM02_7723d	7.436	7.436	0.000
Silver Street	CAM02_7160	7.281	7.281	0.000
Trinity Bridge	CAM02_6603	6.904	6.904	0.000
Bridge Street	CAM02_6177	6.419	6.419	0.000
Victoria Avenue	CAM02_5371	5.772	5.772	0.000
A1134 Elizabeth Way	CAM02_4494	5.534	5.534	0.000
Railway	CAM02_2638	5.154	5.154	0.000
A14	CAM02_0636	4.618	4.617	-0.001
Baits Bite Lock US	CAM02_0200	4.479	4.479	0.000
Baits Bite Lock DS	CAM02_0000	4.250	4.250	0.000
Horningsea	CA14400	4.151	4.152	0.001
Waterbeach	CA12080J	4.055	4.055	0.000
Bottisham Lock US	CA10600J	3.923	3.923	0.000
Bottisham Lock DS	CA10560	3.842	3.842	0.000
Shrubbs Marina	Cam8794	3.748	3.747	-0.001
Upware	Cam5007	3.663	3.663	0.000
A1123	Cam2651u	3.607	3.607	0.000
Great Ouse confluence	Cam0000	3.559	3.559	0.000
		Peak flow (m <sup>3</sup> /s)		Flow (m <sup>3</sup> /s)
M11	CAM01_4253	56.6	56.6	0.0
A1134 Fen Causeway	CAM02_7723d	33.9	34.0	0.0
Silver Street	CAM02_7160	63.9	63.9	0.0
Trinity Bridge	CAM02_6603	71.1	71.1	0.0
Bridge Street	CAM02_6177	72.8	72.8	0.0
Victoria Avenue	CAM02_5371	70.5	70.5	0.0
A1134 Elizabeth Way	CAM02_4494	71.6	71.6	0.0
Railway	CAM02_2638	73.1	73.1	0.0
A14	CAM02_0636	71.9	71.9	0.0
Baits Bite Lock US	CAM02_0200	52.7	52.7	0.0
Baits Bite Lock DS	CAM02_0000	52.7	52.7	0.0
Horningsea	CA14400	39.8	39.8	0.0
Waterbeach	CA12080J	54.6	54.6	0.0
Bottisham Lock US	CA10600J	67.5	67.4	0.0
Bottisham Lock DS	CA10560	67.5	67.4	0.0
Shrubbs Marina	Cam8794	69.0	68.9	-0.1
Upware	Cam5007	68.0	67.9	0.0
A1123	Cam2651u	72.6	72.5	0.0
Great Ouse confluence	Cam0000	64.5	64.5	0.0

## E.7 1 in 200 year flood

Location	Node	Existing outfall (with growth)	New outfall (with growth)	Increase
		Peak water level (mAOD)		Level (m)
M11	CAM01_4253	9.562	9.562	0.000
A1134 Fen Causeway	CAM02_7723d	7.755	7.755	0.000
Silver Street	CAM02_7160	7.728	7.728	0.000
Trinity Bridge	CAM02_6603	7.315	7.315	0.000
Bridge Street	CAM02_6177	6.705	6.705	0.000
Victoria Avenue	CAM02_5371	5.996	5.996	0.000
A1134 Elizabeth Way	CAM02_4494	5.736	5.736	0.000
Railway	CAM02_2638	5.332	5.332	0.000
A14	CAM02_0636	4.699	4.698	-0.001
Baits Bite Lock US	CAM02_0200	4.571	4.571	0.000
Baits Bite Lock DS	CAM02_0000	4.384	4.384	0.000
Horningsea	CA14400	4.295	4.295	0.000
Waterbeach	CA12080J	4.177	4.177	0.000
Bottisham Lock US	CA10600J	4.012	4.012	0.000
Bottisham Lock DS	CA10560	3.923	3.922	-0.001
Shrubbs Marina	Cam8794	3.809	3.809	0.000
Upware	Cam5007	3.708	3.708	0.000
A1123	Cam2651u	3.644	3.644	0.000
Great Ouse confluence	Cam0000	3.593	3.593	0.000
		Peak flow (m <sup>3</sup> /s)		Flow (m <sup>3</sup> /s)
M11	CAM01_4253	72.2	72.2	0.0
A1134 Fen Causeway	CAM02_7723d	40.4	40.4	0.0
Silver Street	CAM02_7160	71.4	71.4	0.0
Trinity Bridge	CAM02_6603	89.9	89.9	0.0
Bridge Street	CAM02_6177	92.6	92.6	0.0
Victoria Avenue	CAM02_5371	77.7	77.7	0.0
A1134 Elizabeth Way	CAM02_4494	90.1	90.1	0.0
Railway	CAM02_2638	93.3	93.3	0.0
A14	CAM02_0636	91.2	91.2	0.0
Baits Bite Lock US	CAM02_0200	55.7	55.7	0.0
Baits Bite Lock DS	CAM02_0000	55.7	55.7	0.0
Horningsea	CA14400	40.5	40.6	0.1
Waterbeach	CA12080J	56.3	56.3	0.0
Bottisham Lock US	CA10600J	76.1	76.1	0.0
Bottisham Lock DS	CA10560	76.1	76.1	0.0
Shrubbs Marina	Cam8794	77.2	77.1	-0.1
Upware	Cam5007	74.2	74.1	0.0
A1123	Cam2651u	80.1	80.1	0.0
Great Ouse confluence	Cam0000	65.5	65.5	0.0

### E.8 1 in 1000 year flood

Location	Node	Existing outfall (with growth)	New outfall (with growth)	Increase
		Peak water level (mAOD)		Level (m)
M11	CAM01_4253	9.942	9.942	0.000
A1134 Fen Causeway	CAM02_7723d	8.632	8.632	0.000
Silver Street	CAM02_7160	8.596	8.596	0.000
Trinity Bridge	CAM02_6603	8.199	8.199	0.000
Bridge Street	CAM02_6177	7.157	7.157	0.000
Victoria Avenue	CAM02_5371	6.500	6.500	0.000
A1134 Elizabeth Way	CAM02_4494	6.170	6.170	0.000
Railway	CAM02_2638	5.740	5.740	0.000
A14	CAM02_0636	4.878	4.876	-0.002
Baits Bite Lock US	CAM02_0200	4.725	4.725	0.000
Baits Bite Lock DS	CAM02_0000	4.573	4.573	0.000
Horningsea	CA14400	4.488	4.488	0.000
Waterbeach	CA12080J	4.298	4.298	0.000
Bottisham Lock US	CA10600J	4.086	4.086	0.000
Bottisham Lock DS	CA10560	3.986	3.985	-0.001
Shrubbs Marina	Cam8794	3.851	3.851	0.000
Upware	Cam5007	3.737	3.737	0.000
A1123	Cam2651u	3.667	3.667	0.000
Great Ouse confluence	Cam0000	3.613	3.613	0.000
		Peak flow (m <sup>3</sup> /s)		Flow (m <sup>3</sup> /s)
M11	CAM01_4253	113.0	113.0	0.0
A1134 Fen Causeway	CAM02_7723d	48.4	48.3	0.0
Silver Street	CAM02_7160	96.7	96.7	0.0
Trinity Bridge	CAM02_6603	92.6	92.6	0.0
Bridge Street	CAM02_6177	143.4	143.4	0.0
Victoria Avenue	CAM02_5371	81.0	81.0	0.0
A1134 Elizabeth Way	CAM02_4494	127.5	127.5	0.0
Railway	CAM02_2638	145.1	145.1	0.0
A14	CAM02_0636	138.9	139.0	0.0
Baits Bite Lock US	CAM02_0200	63.6	63.6	0.0
Baits Bite Lock DS	CAM02_0000	63.6	63.6	0.0
Horningsea	CA14400	41.1	41.1	0.0
Waterbeach	CA12080J	58.6	58.6	0.0
Bottisham Lock US	CA10600J	84.6	84.7	0.1
Bottisham Lock DS	CA10560	84.6	84.7	0.1
Shrubbs Marina	Cam8794	85.2	85.2	0.0
Upware	Cam5007	78.9	78.9	0.0
A1123	Cam2651u	86.4	86.4	0.0
Great Ouse confluence	Cam0000	66.0	66.0	0.0

### E.9 1 in 100 year flood + 19% climate change


Location	Node	Existing outfall (with growth)	New outfall (with growth)	Increase
		Peak water level (mAOD)		Level (m)
M11	CAM01_4253	9.609	9.609	0.000
A1134 Fen Causeway	CAM02_7723d	7.892	7.892	0.000
Silver Street	CAM02_7160	7.742	7.742	0.000
Trinity Bridge	CAM02_6603	7.314	7.314	0.000
Bridge Street	CAM02_6177	6.705	6.705	0.000
Victoria Avenue	CAM02_5371	5.996	5.996	0.000
A1134 Elizabeth Way	CAM02_4494	5.736	5.736	0.000
Railway	CAM02_2638	5.332	5.331	-0.001
A14	CAM02_0636	4.698	4.697	-0.001
Baits Bite Lock US	CAM02_0200	4.570	4.570	0.000
Baits Bite Lock DS	CAM02_0000	4.381	4.381	0.000
Horningsea	CA14400	4.292	4.292	0.000
Waterbeach	CA12080J	4.174	4.173	-0.001
Bottisham Lock US	CA10600J	4.011	4.011	0.000
Bottisham Lock DS	CA10560	3.922	3.922	0.000
Shrubbs Marina	Cam8794	3.809	3.809	0.000
Upware	Cam5007	3.709	3.708	-0.001
A1123	Cam2651u	3.644	3.644	0.000
Great Ouse confluence	Cam0000	3.593	3.593	0.000
		Peak flow (m <sup>3</sup> /s)		Flow (m <sup>3</sup> /s)
M11	CAM01_4253	71.5	71.5	0.0
A1134 Fen Causeway	CAM02_7723d	43.1	43.1	0.0
Silver Street	CAM02_7160	78.6	78.6	0.0
Trinity Bridge	CAM02_6603	89.8	89.8	0.0
Bridge Street	CAM02_6177	92.6	92.6	0.0
Victoria Avenue	CAM02_5371	77.8	77.8	0.0
A1134 Elizabeth Way	CAM02_4494	90.1	90.1	0.0
Railway	CAM02_2638	93.3	93.3	0.0
A14	CAM02_0636	91.1	91.1	0.0
Baits Bite Lock US	CAM02_0200	55.7	55.7	0.0
Baits Bite Lock DS	CAM02_0000	55.7	55.7	0.0
Horningsea	CA14400	40.5	40.5	0.0
Waterbeach	CA12080J	55.7	55.7	0.0
Bottisham Lock US	CA10600J	75.9	75.8	-0.1
Bottisham Lock DS	CA10560	75.9	75.8	-0.1
Shrubbs Marina	Cam8794	77.0	76.9	-0.1
Upware	Cam5007	74.1	74.1	0.0
A1123	Cam2651u	80.1	80.1	0.0
Great Ouse confluence	Cam0000	65.5	65.5	0.0

### E.10 1 in 100 year flood + 45% climate change

Location	Node	Existing outfall (with growth)	New outfall (with growth)	Increase
		<b>Peak water level (mAOD)</b>		<b>Level (m)</b>
M11	CAM01_4253	9.738	9.738	0.000
A1134 Fen Causeway	CAM02_7723d	8.206	8.206	0.000
Silver Street	CAM02_7160	8.128	8.128	0.000
Trinity Bridge	CAM02_6603	7.703	7.703	0.000
Bridge Street	CAM02_6177	6.900	6.900	0.000
Victoria Avenue	CAM02_5371	6.204	6.204	0.000
A1134 Elizabeth Way	CAM02_4494	5.911	5.911	0.000
Railway	CAM02_2638	5.504	5.504	0.000
A14	CAM02_0636	4.768	4.767	-0.001
Baits Bite Lock US	CAM02_0200	4.637	4.637	0.000
Baits Bite Lock DS	CAM02_0000	4.467	4.467	0.000
Horningsea	CA14400	4.379	4.379	0.000
Waterbeach	CA12080J	4.233	4.232	-0.001
Bottisham Lock US	CA10600J	4.050	4.050	0.000
Bottisham Lock DS	CA10560	3.956	3.956	0.000
Shrubbs Marina	Cam8794	3.833	3.833	0.000
Upware	Cam5007	3.726	3.725	-0.001
A1123	Cam2651u	3.658	3.658	0.000
Great Ouse confluence	Cam0000	3.606	3.606	0.000
		<b>Peak flow (m<sup>3</sup>/s)</b>		<b>Flow (m<sup>3</sup>/s)</b>
M11	CAM01_4253	86.2	86.2	0.0
A1134 Fen Causeway	CAM02_7723d	44.8	44.8	0.0
Silver Street	CAM02_7160	85.8	85.8	0.0
Trinity Bridge	CAM02_6603	92.0	92.0	0.0
Bridge Street	CAM02_6177	113.2	113.2	0.0
Victoria Avenue	CAM02_5371	79.5	79.5	0.0
A1134 Elizabeth Way	CAM02_4494	105.0	105.0	0.0
Railway	CAM02_2638	113.8	113.8	0.0
A14	CAM02_0636	110.4	110.5	0.0
Baits Bite Lock US	CAM02_0200	58.4	58.5	0.0
Baits Bite Lock DS	CAM02_0000	58.4	58.5	0.0
Horningsea	CA14400	40.7	40.8	0.1
Waterbeach	CA12080J	57.4	57.5	0.1
Bottisham Lock US	CA10600J	79.8	79.7	0.0
Bottisham Lock DS	CA10560	79.8	79.7	0.0
Shrubbs Marina	Cam8794	80.6	80.5	-0.1
Upware	Cam5007	76.3	76.3	0.0
A1123	Cam2651u	83.9	83.9	0.0
Great Ouse confluence	Cam0000	65.8	65.8	0.0


## **Appendix F: Flood difference Existing Future vs New Outfall 55 hour – comparing Existing Future (with growth) to New Outfall (with growth)**

F.1 1 in 2 year flood

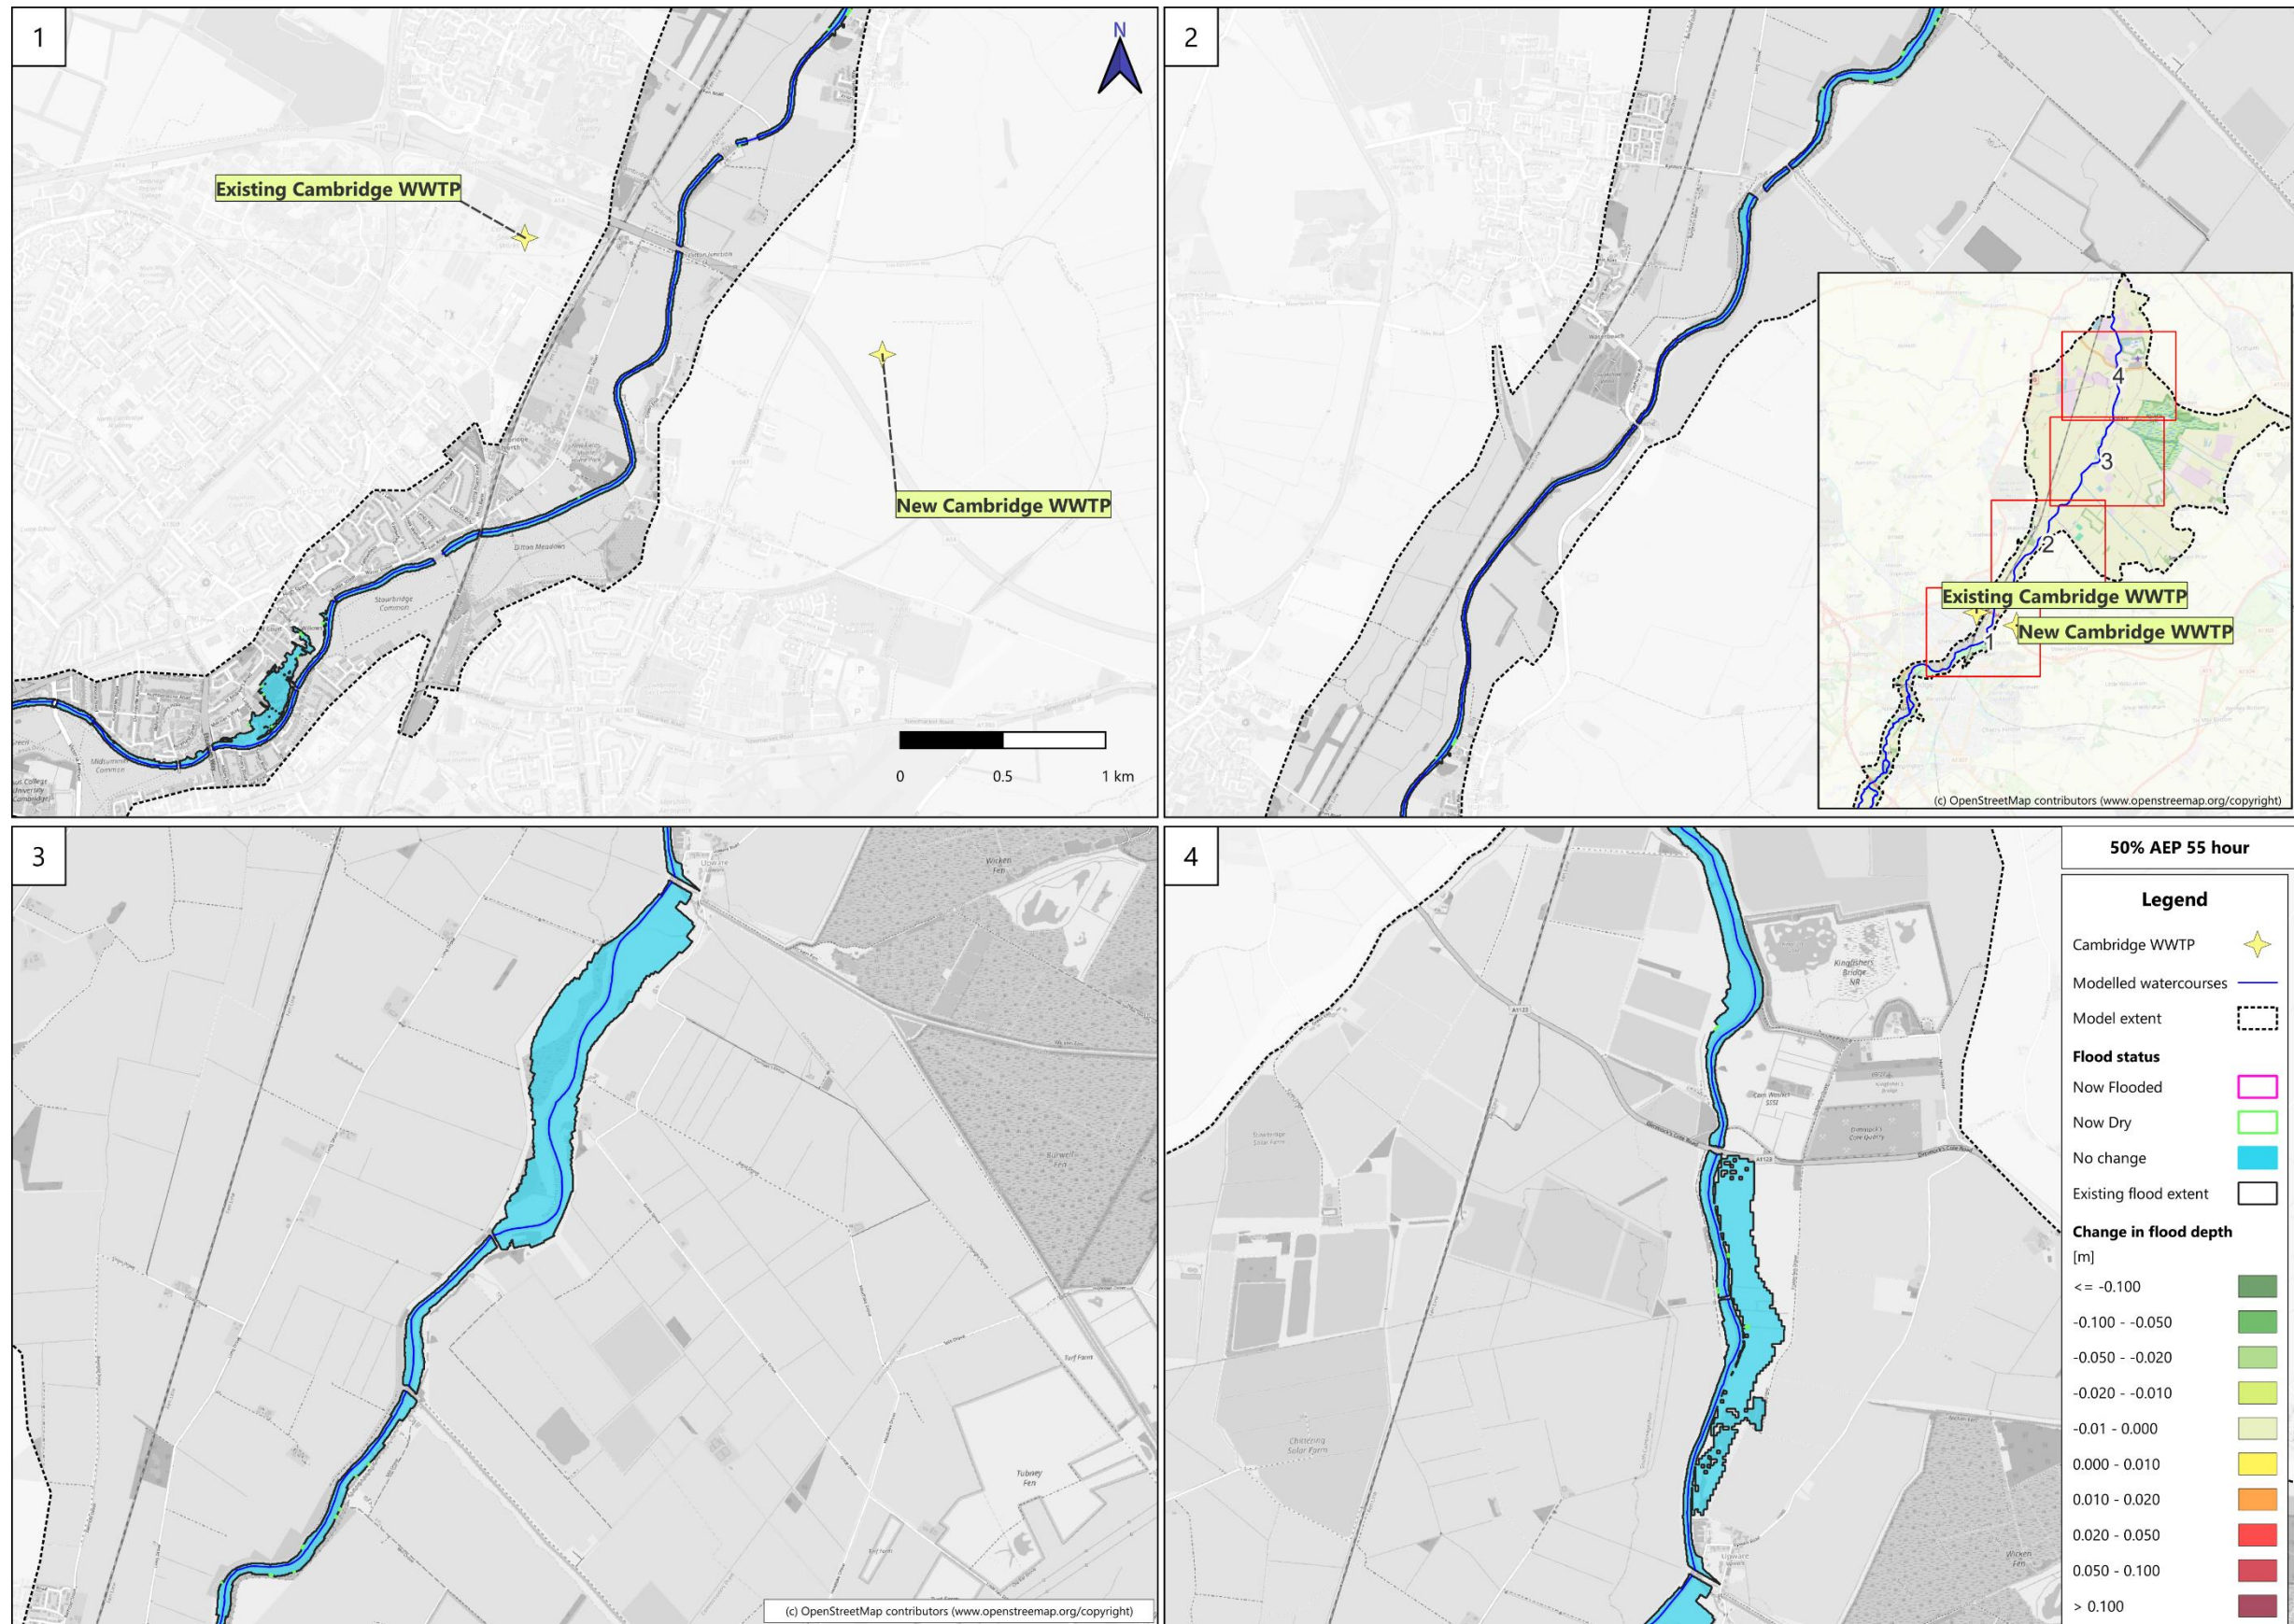





F.2 1 in 10 year flood

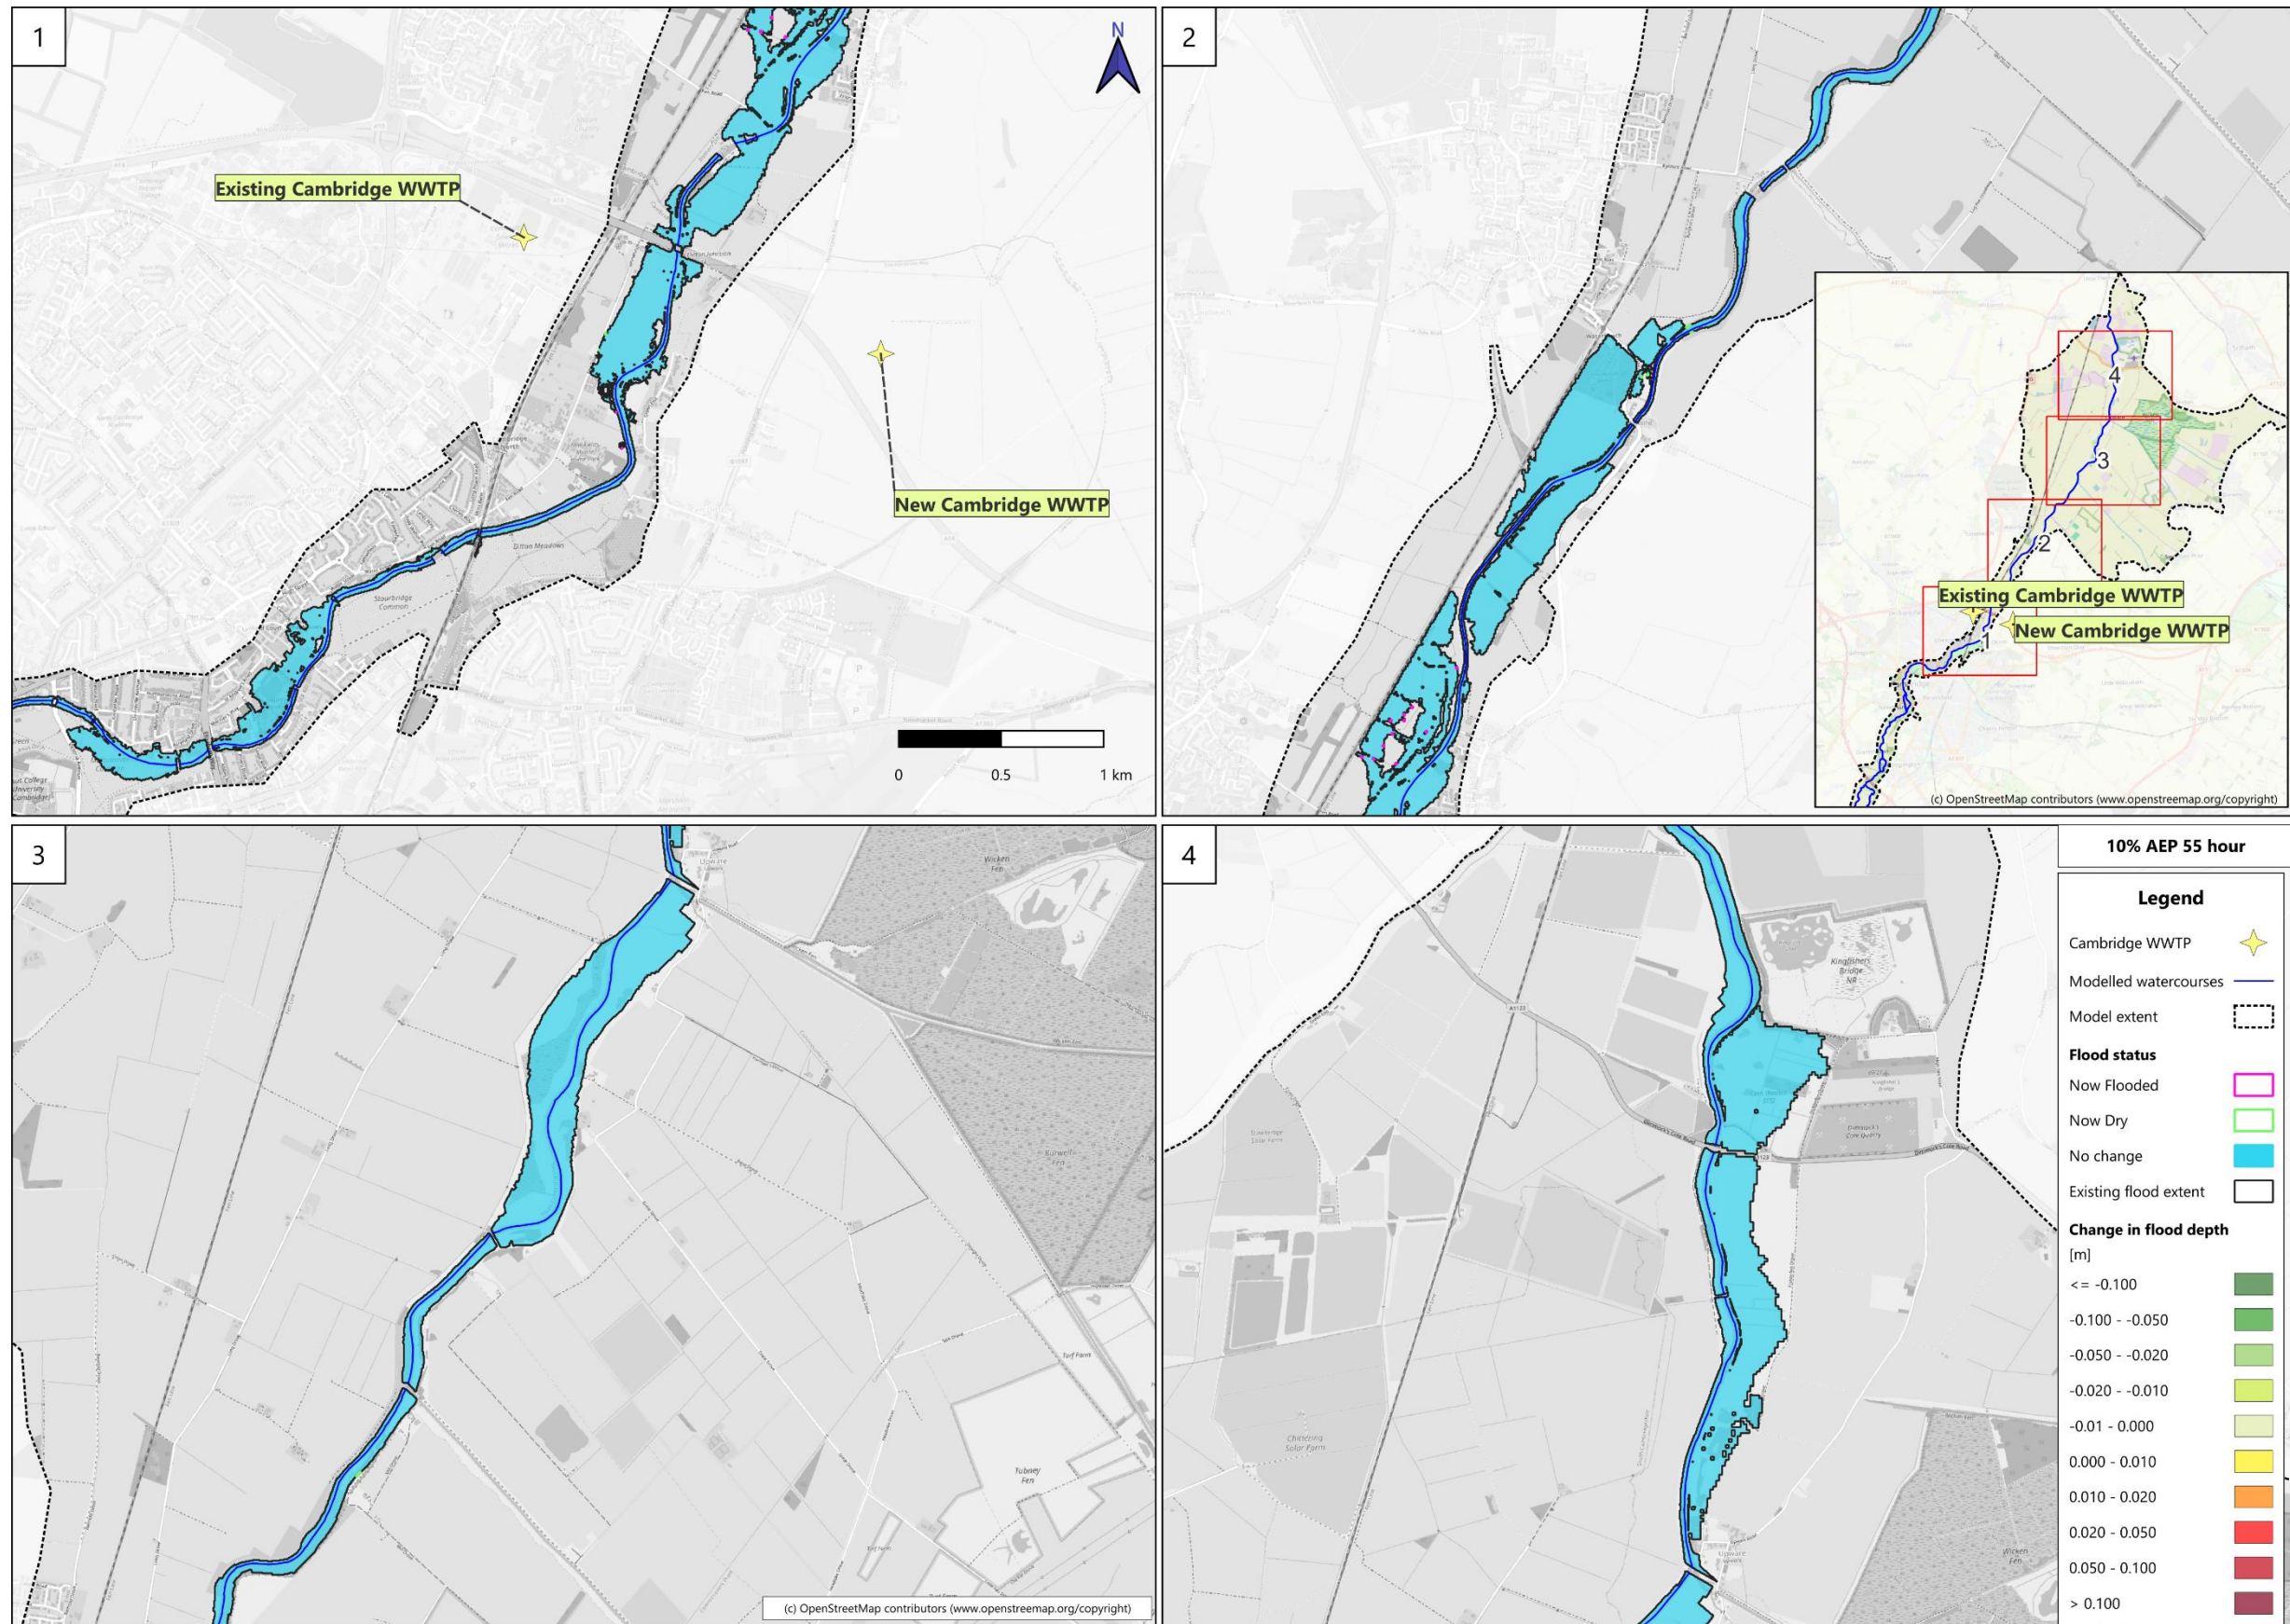


F.3 1 in 20 year flood

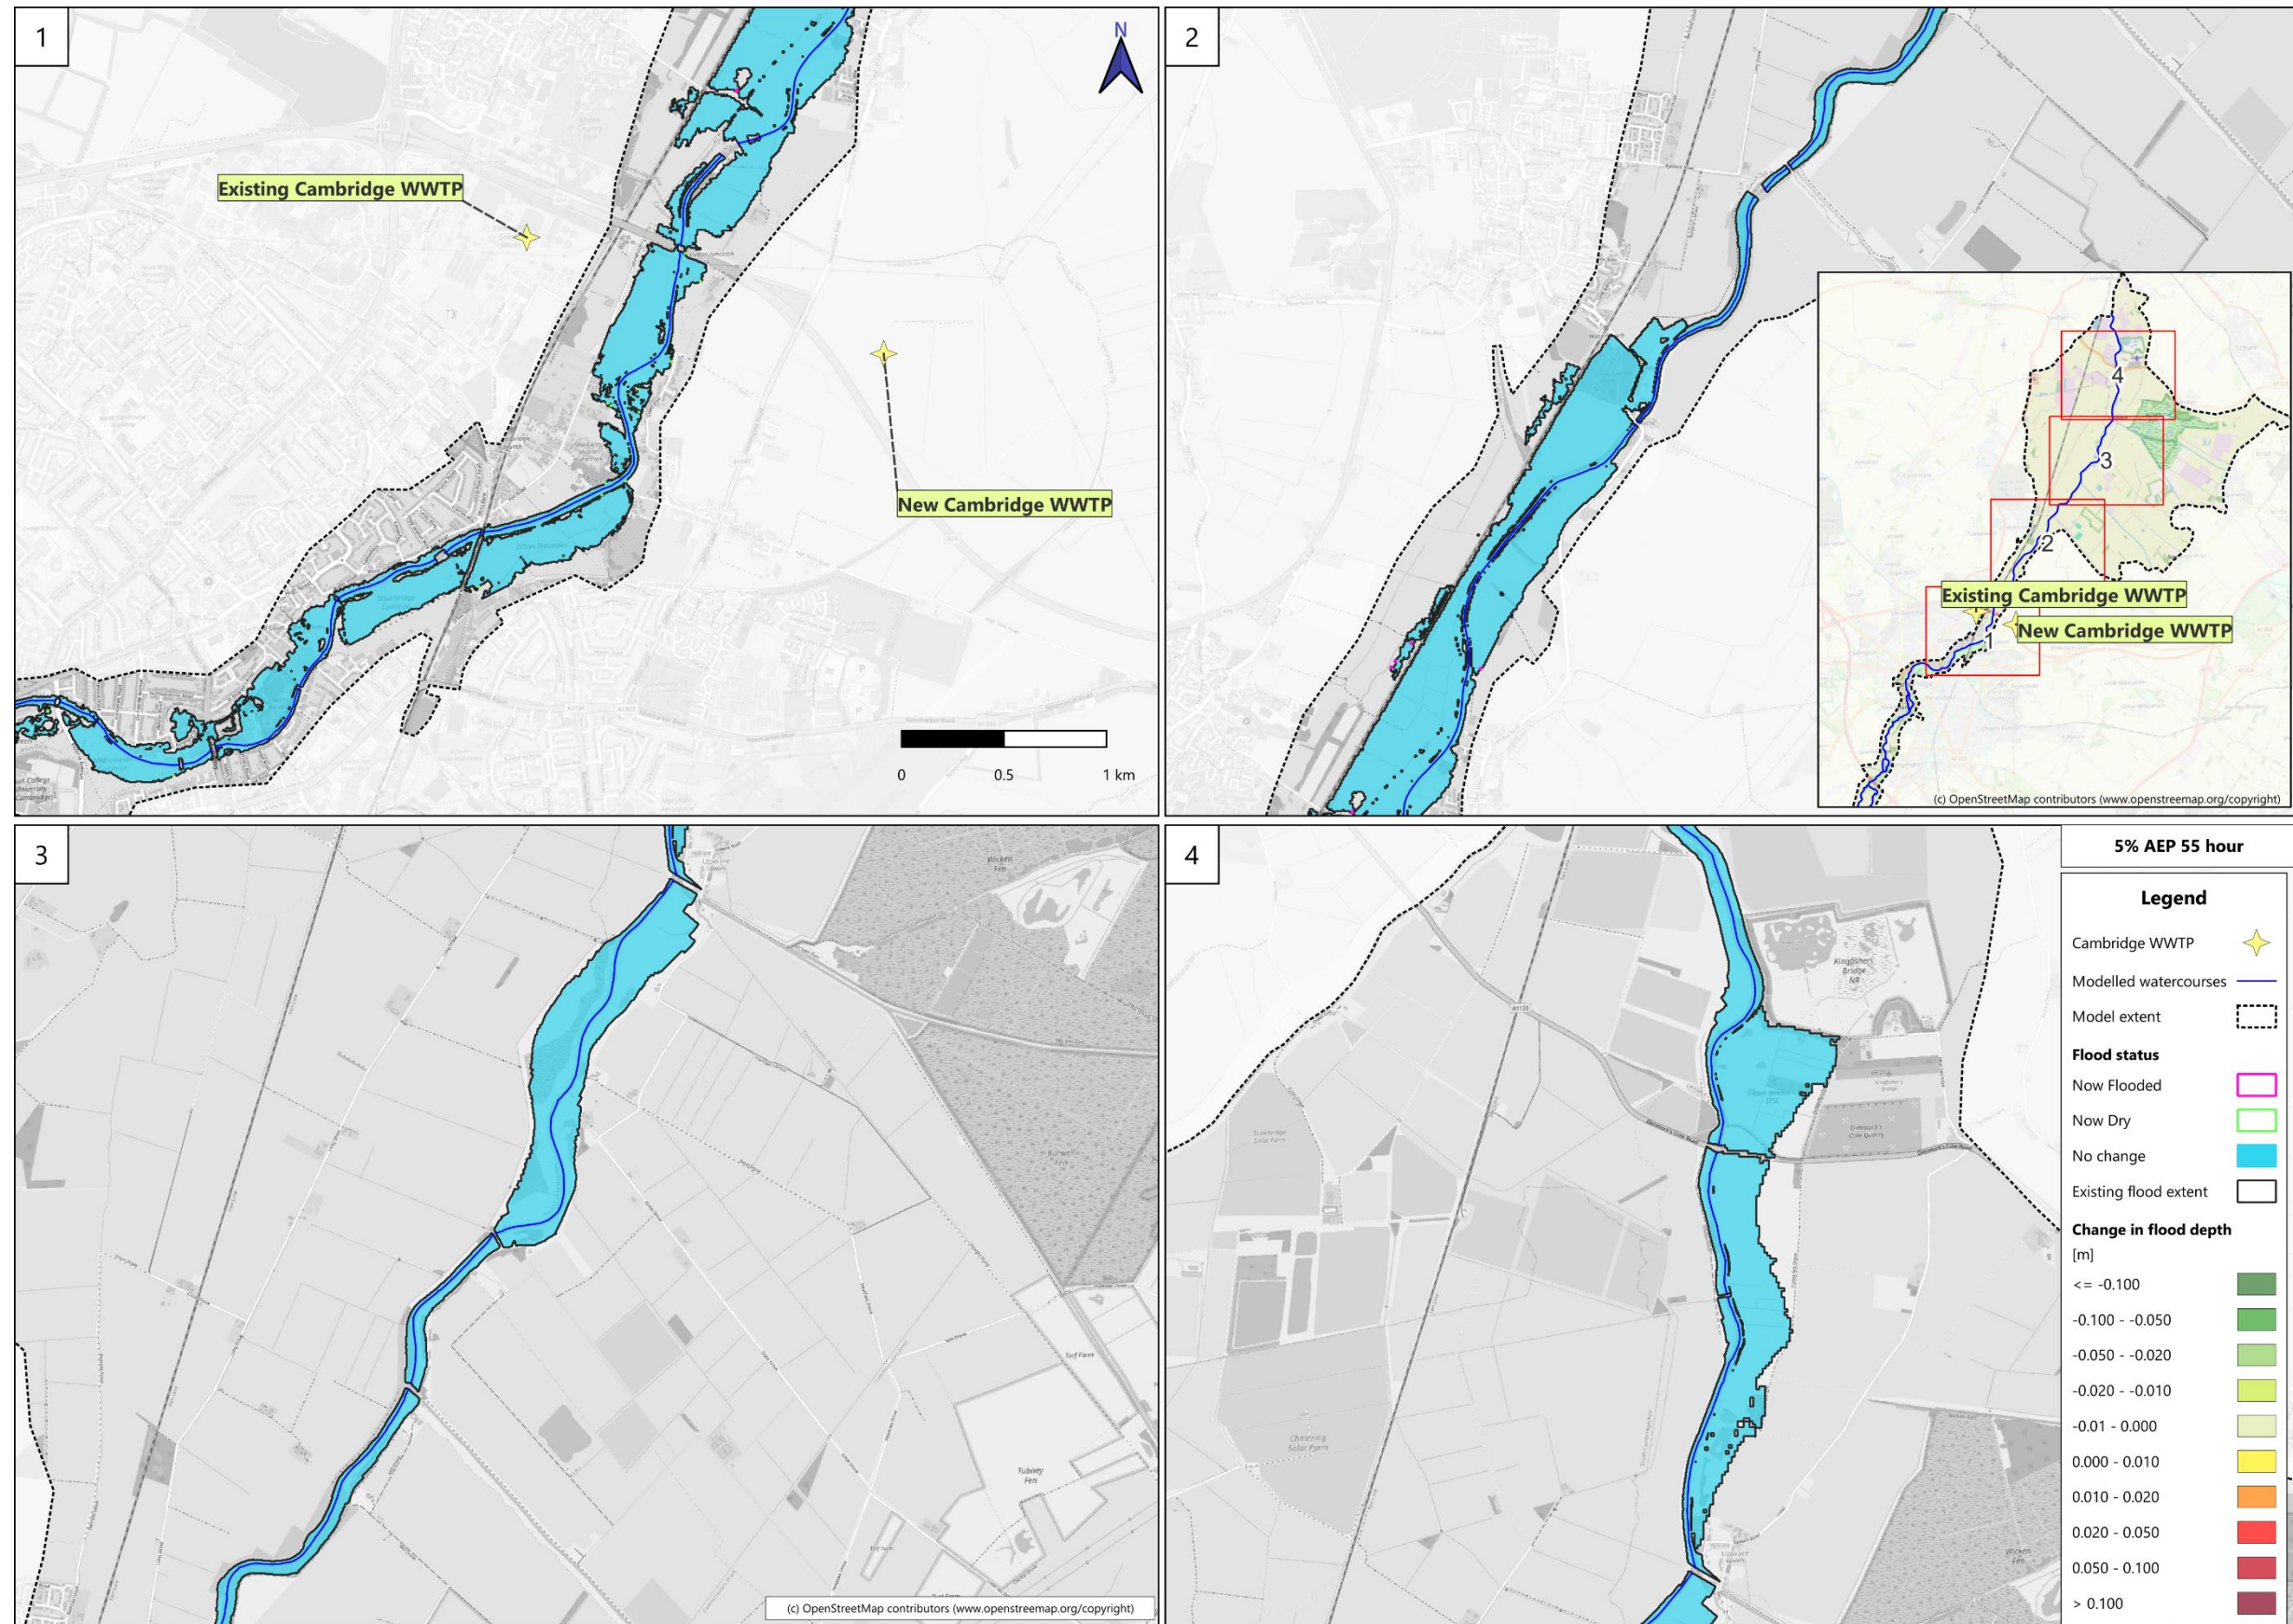


F.4 1 in 30 year flood

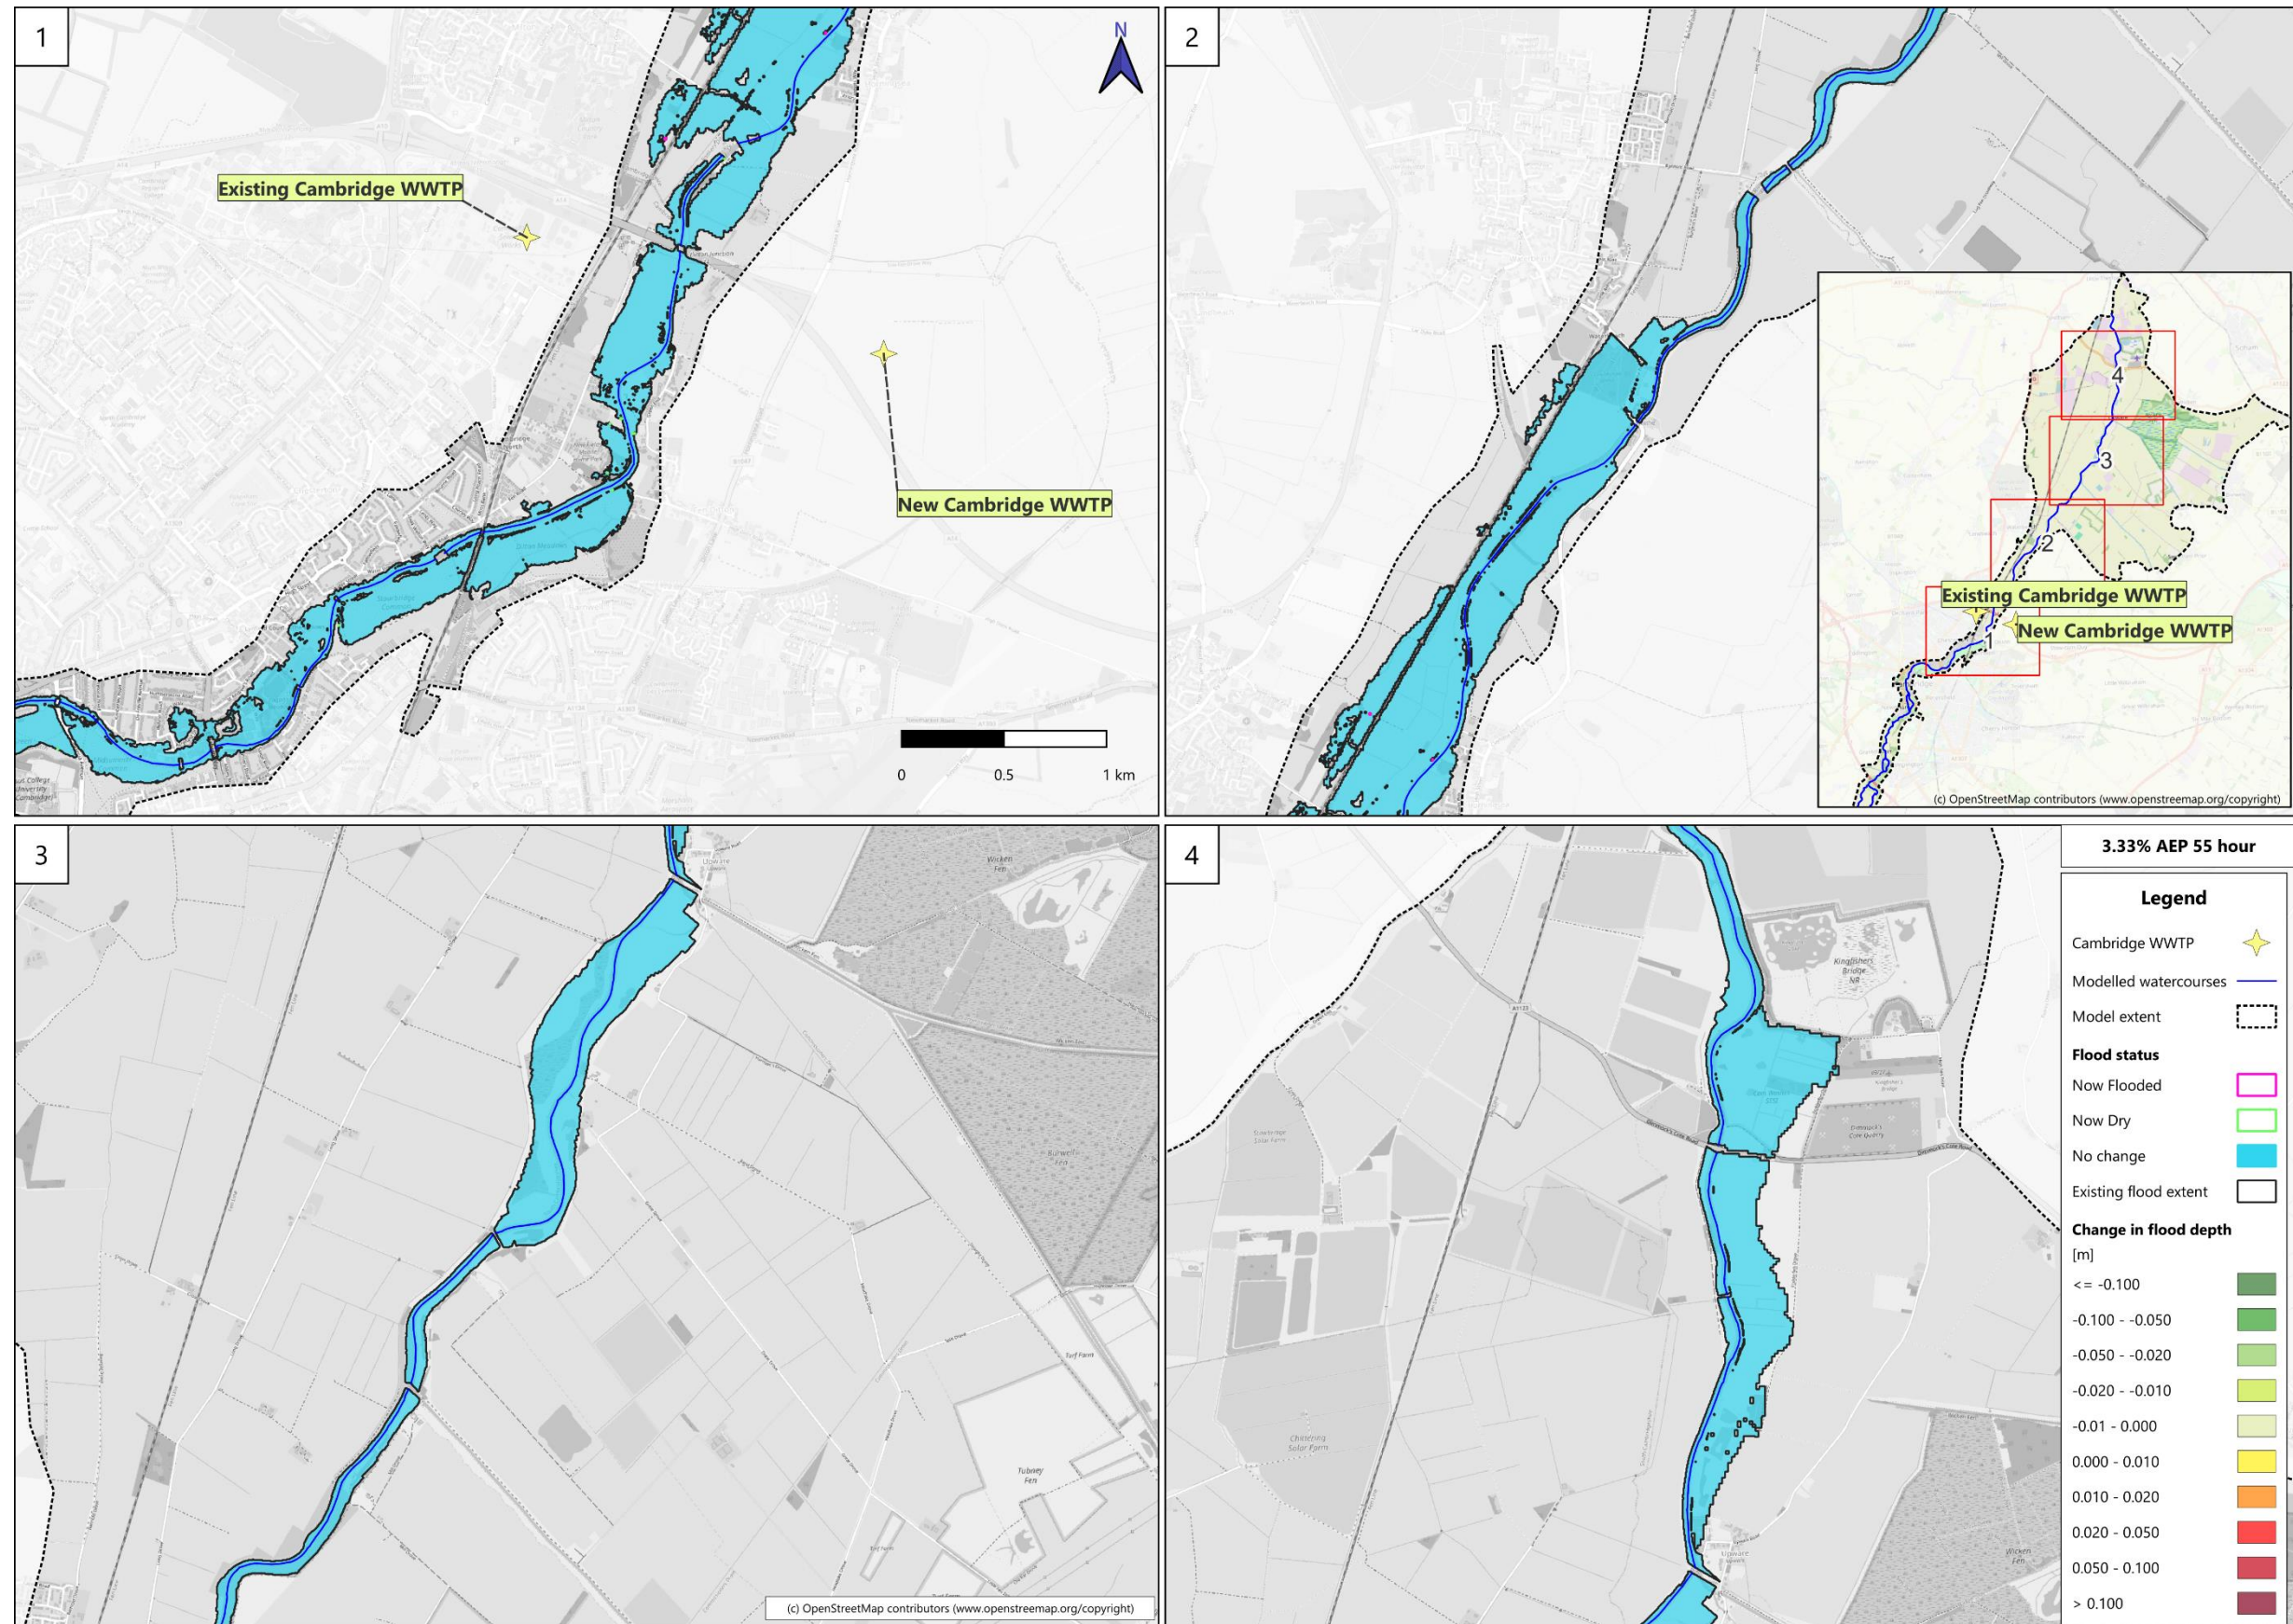


F.5 1 in 50 year flood

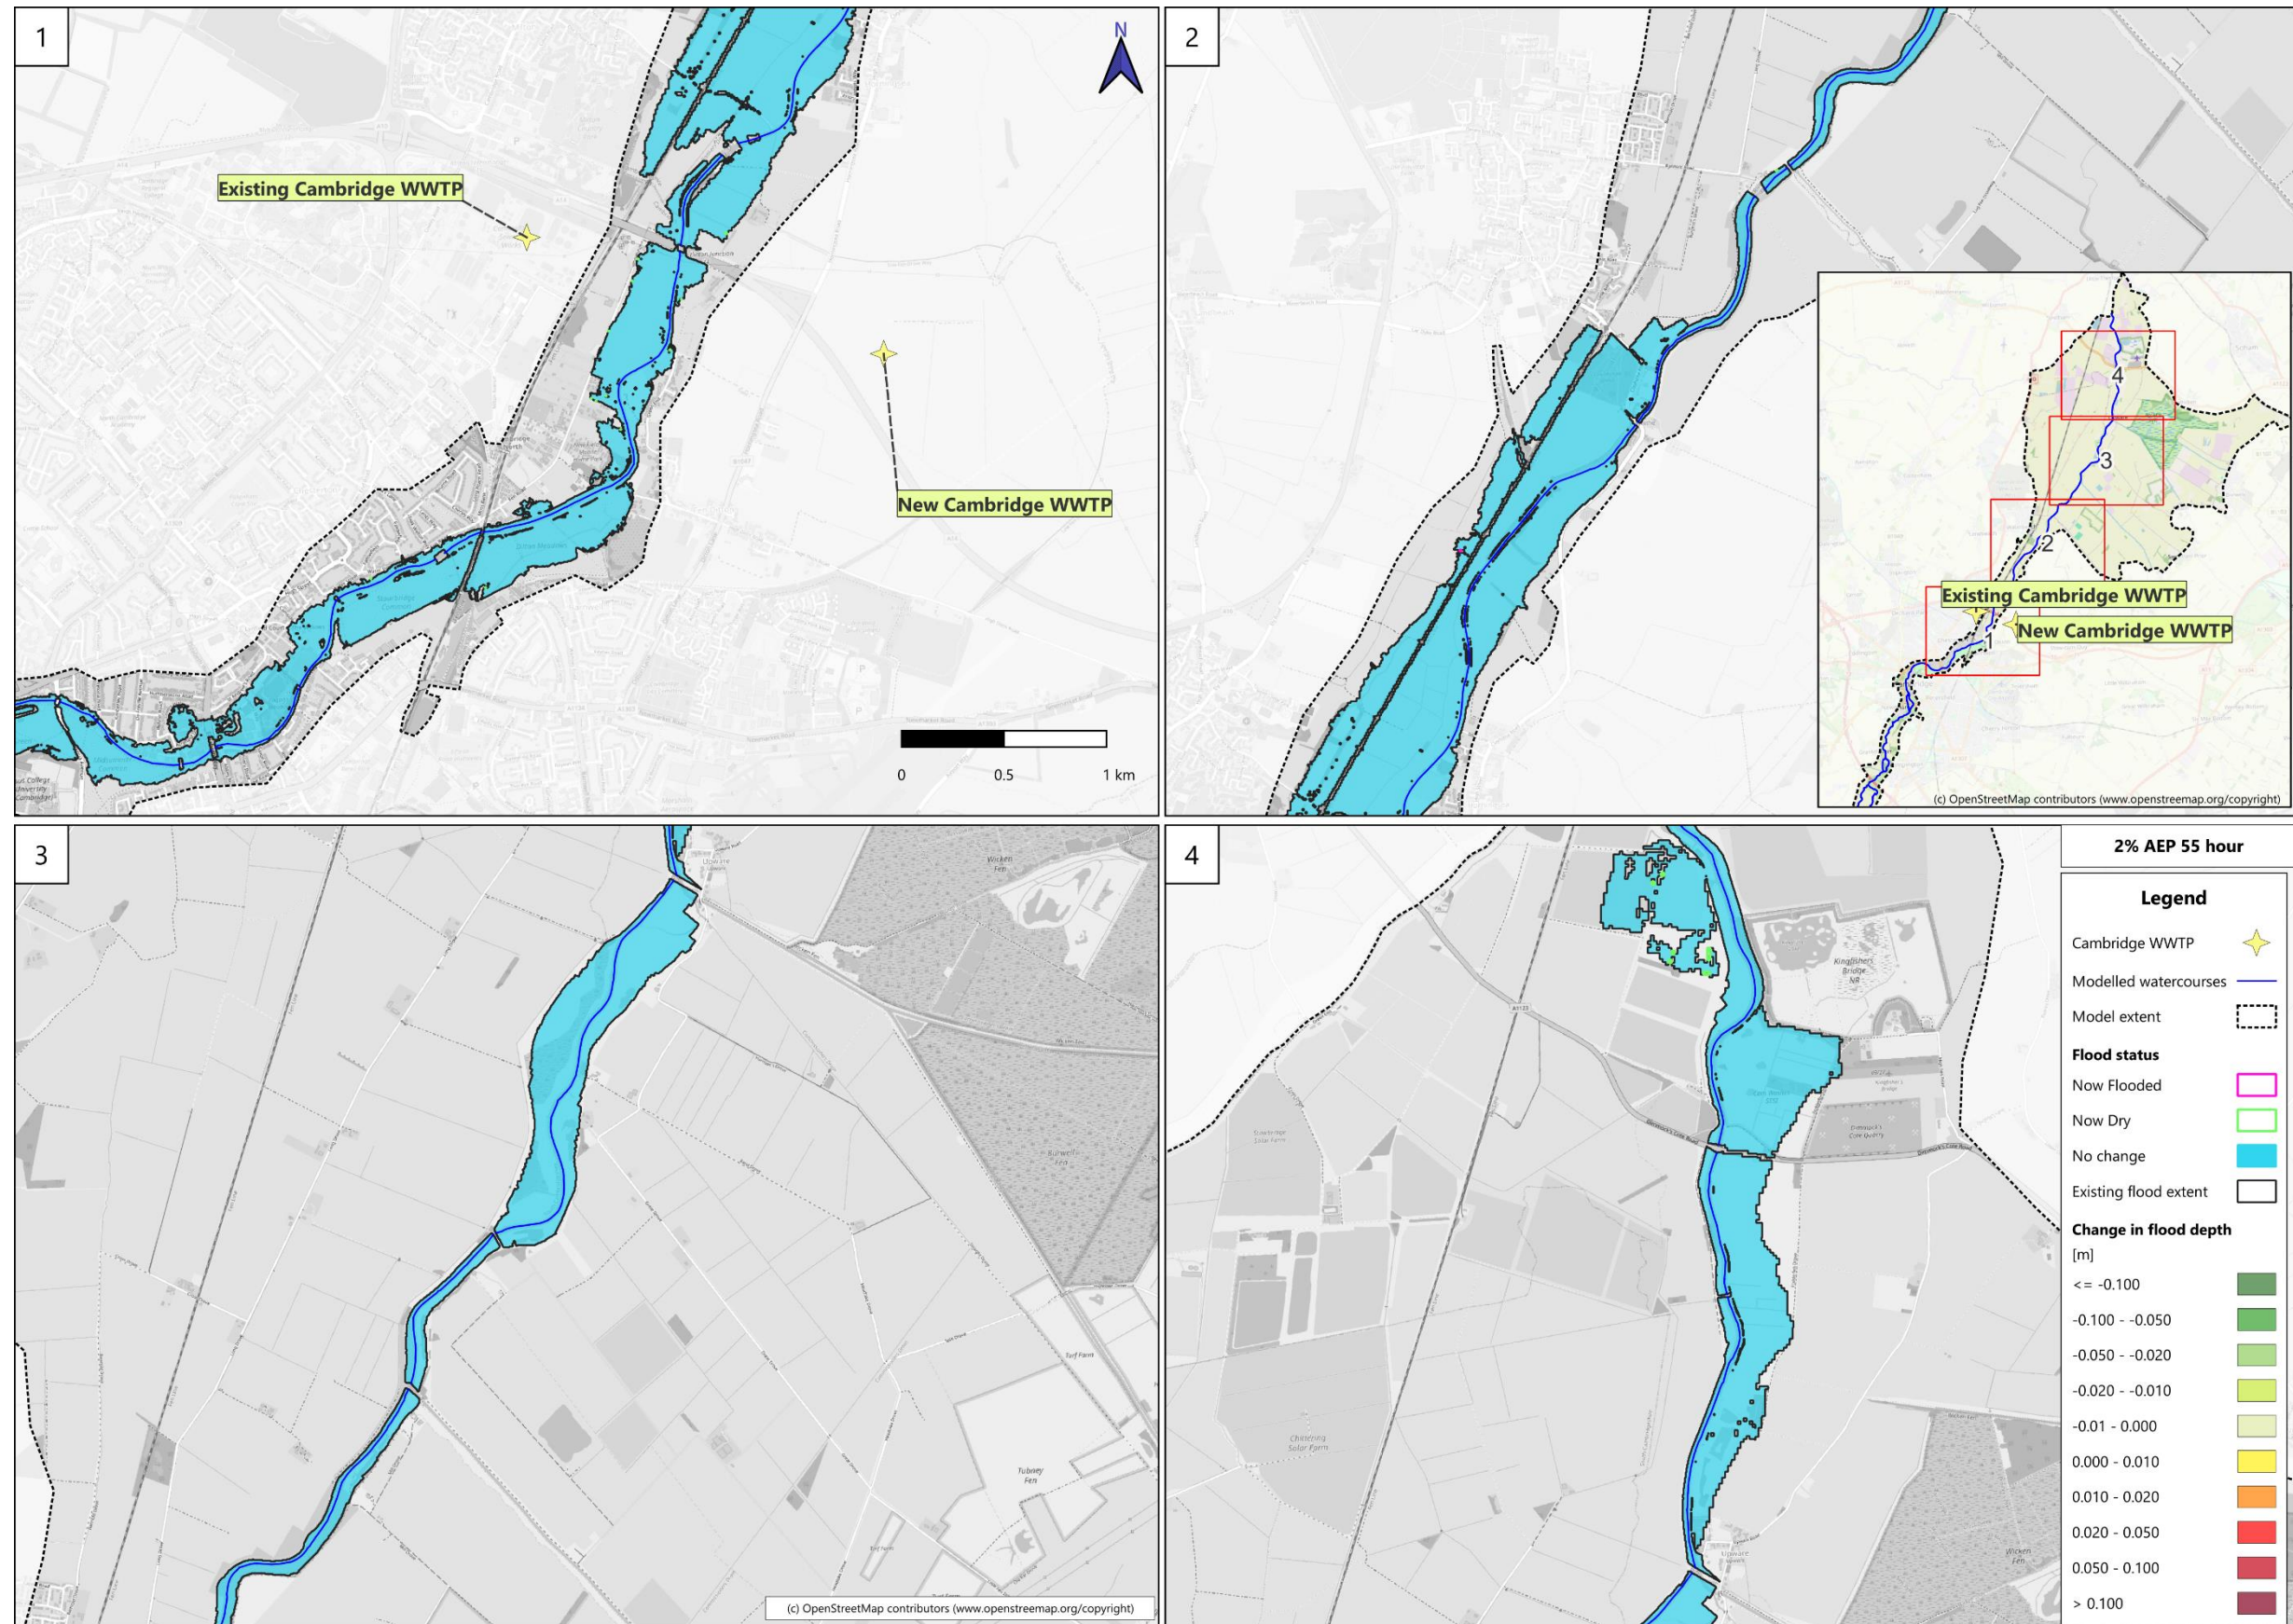


F.6 1 in 75 year flood

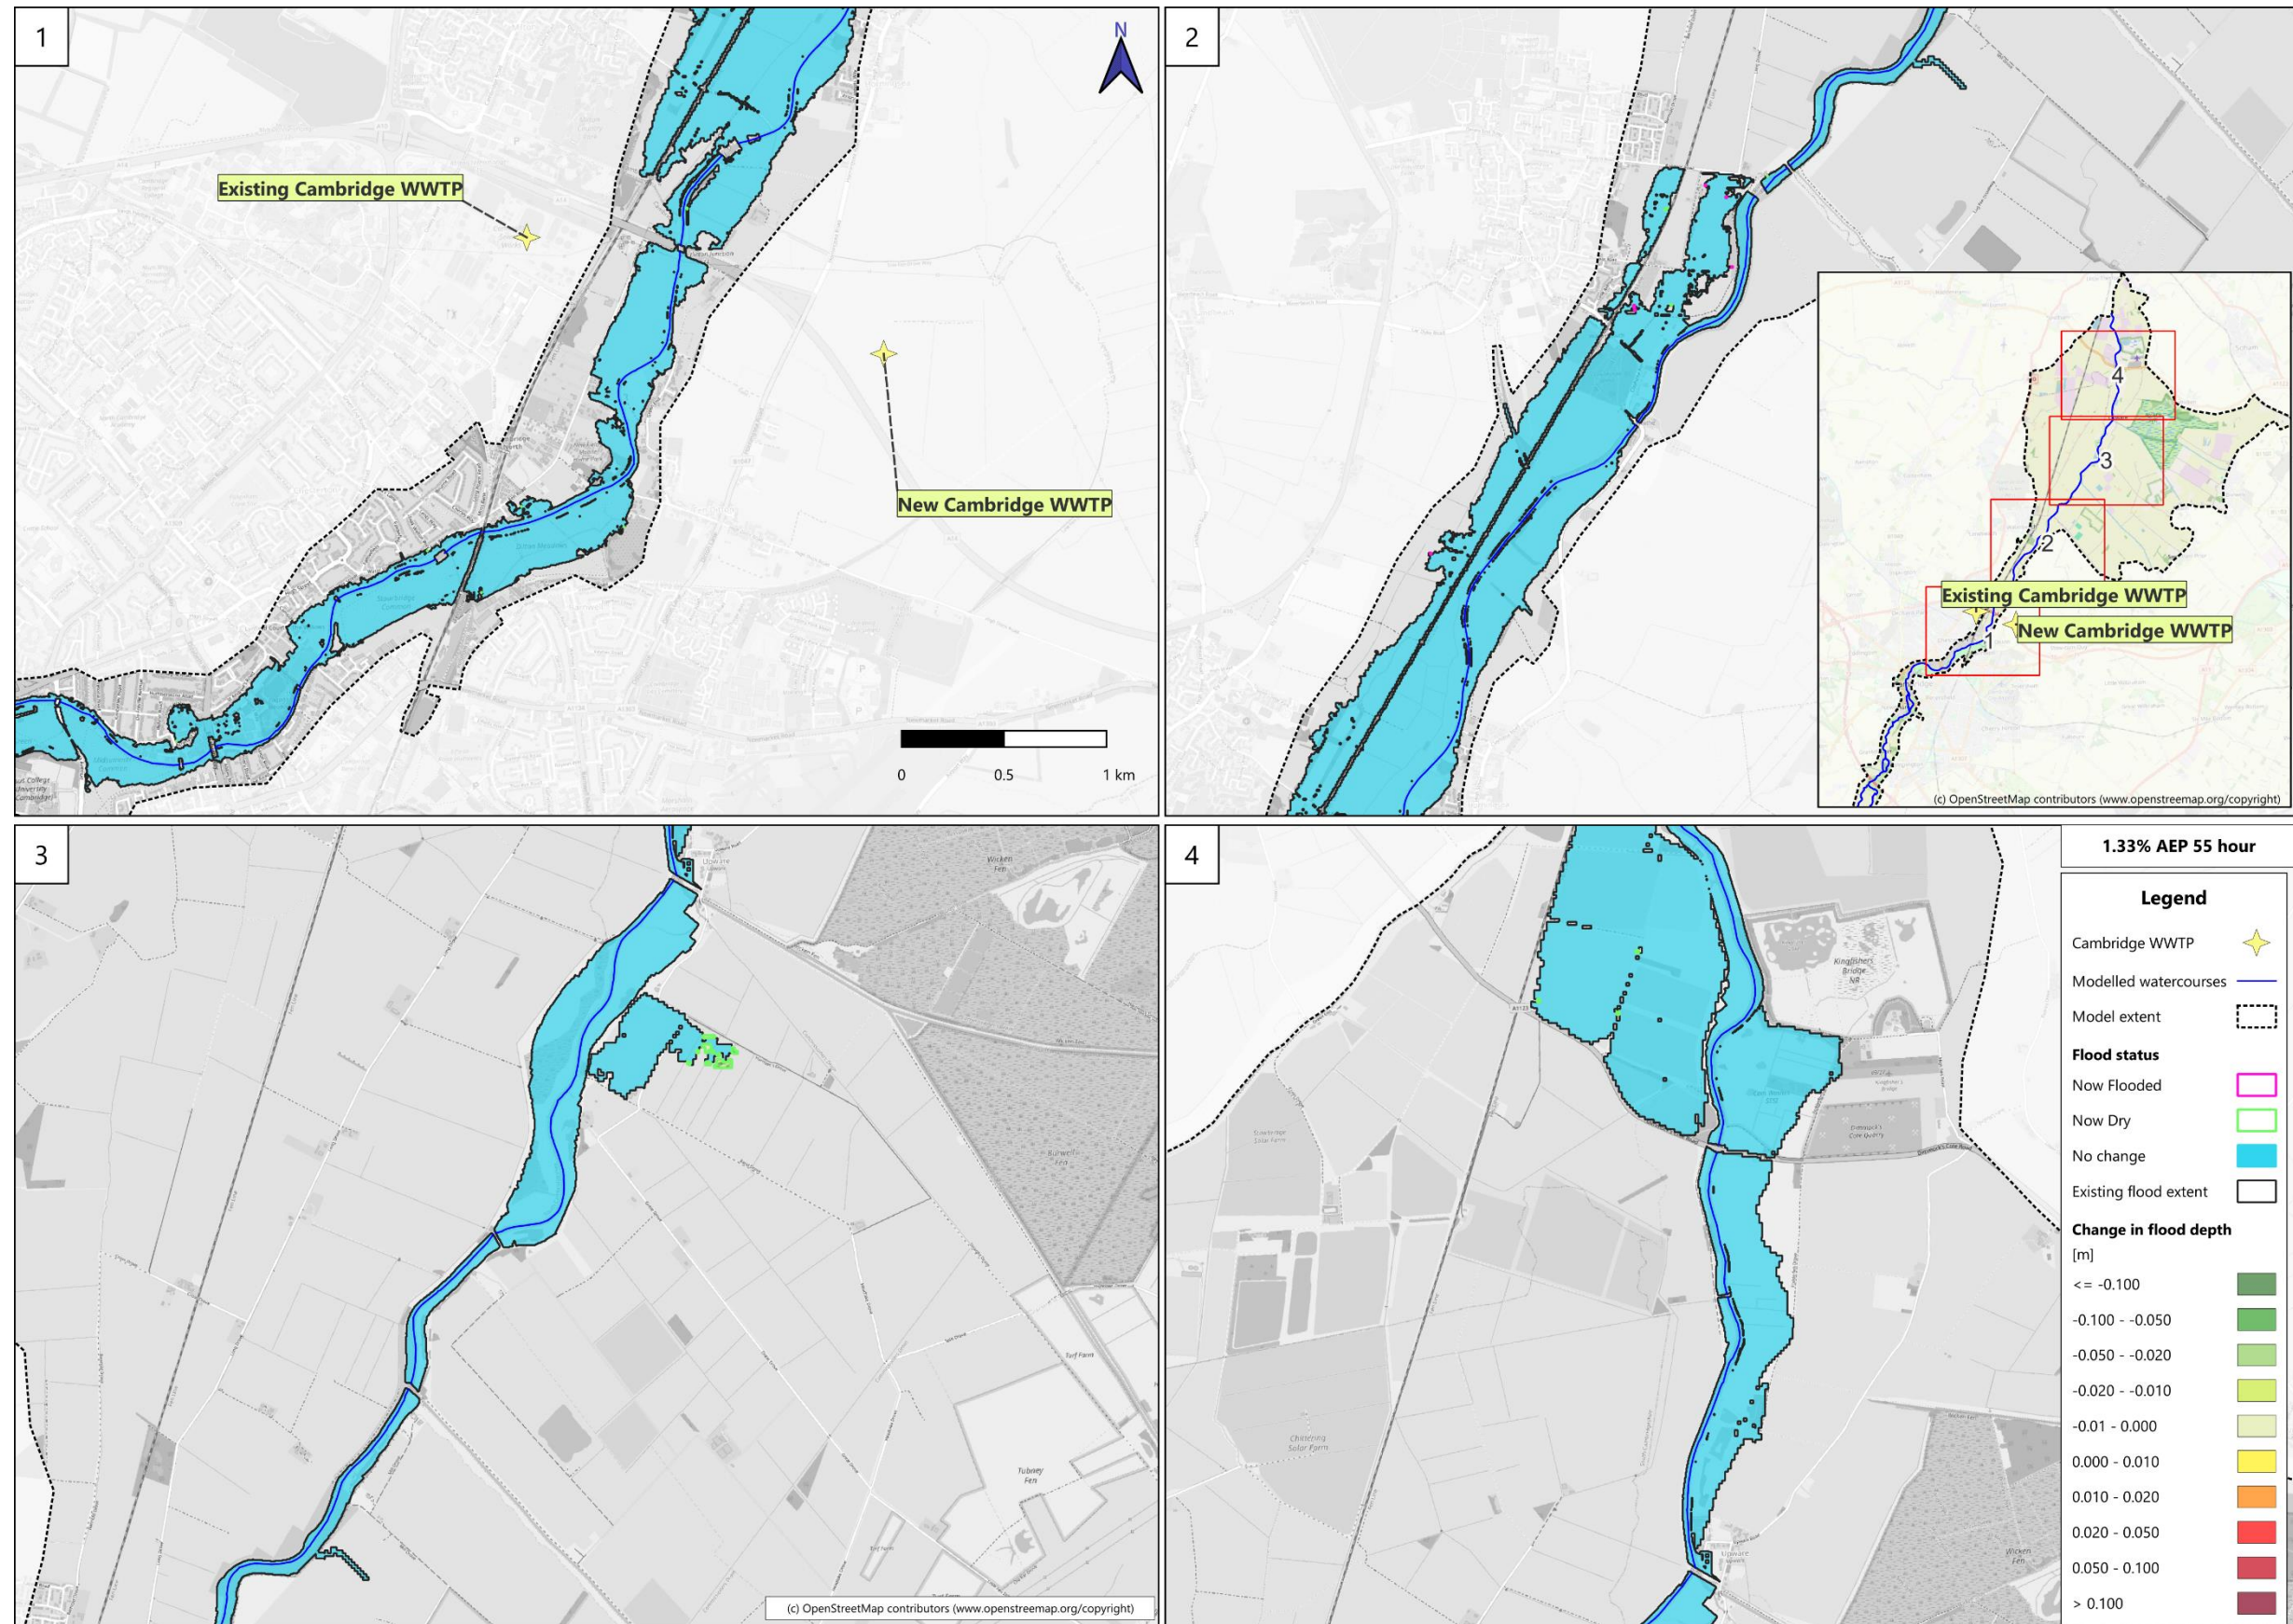


F.7 1 in 200 year flood

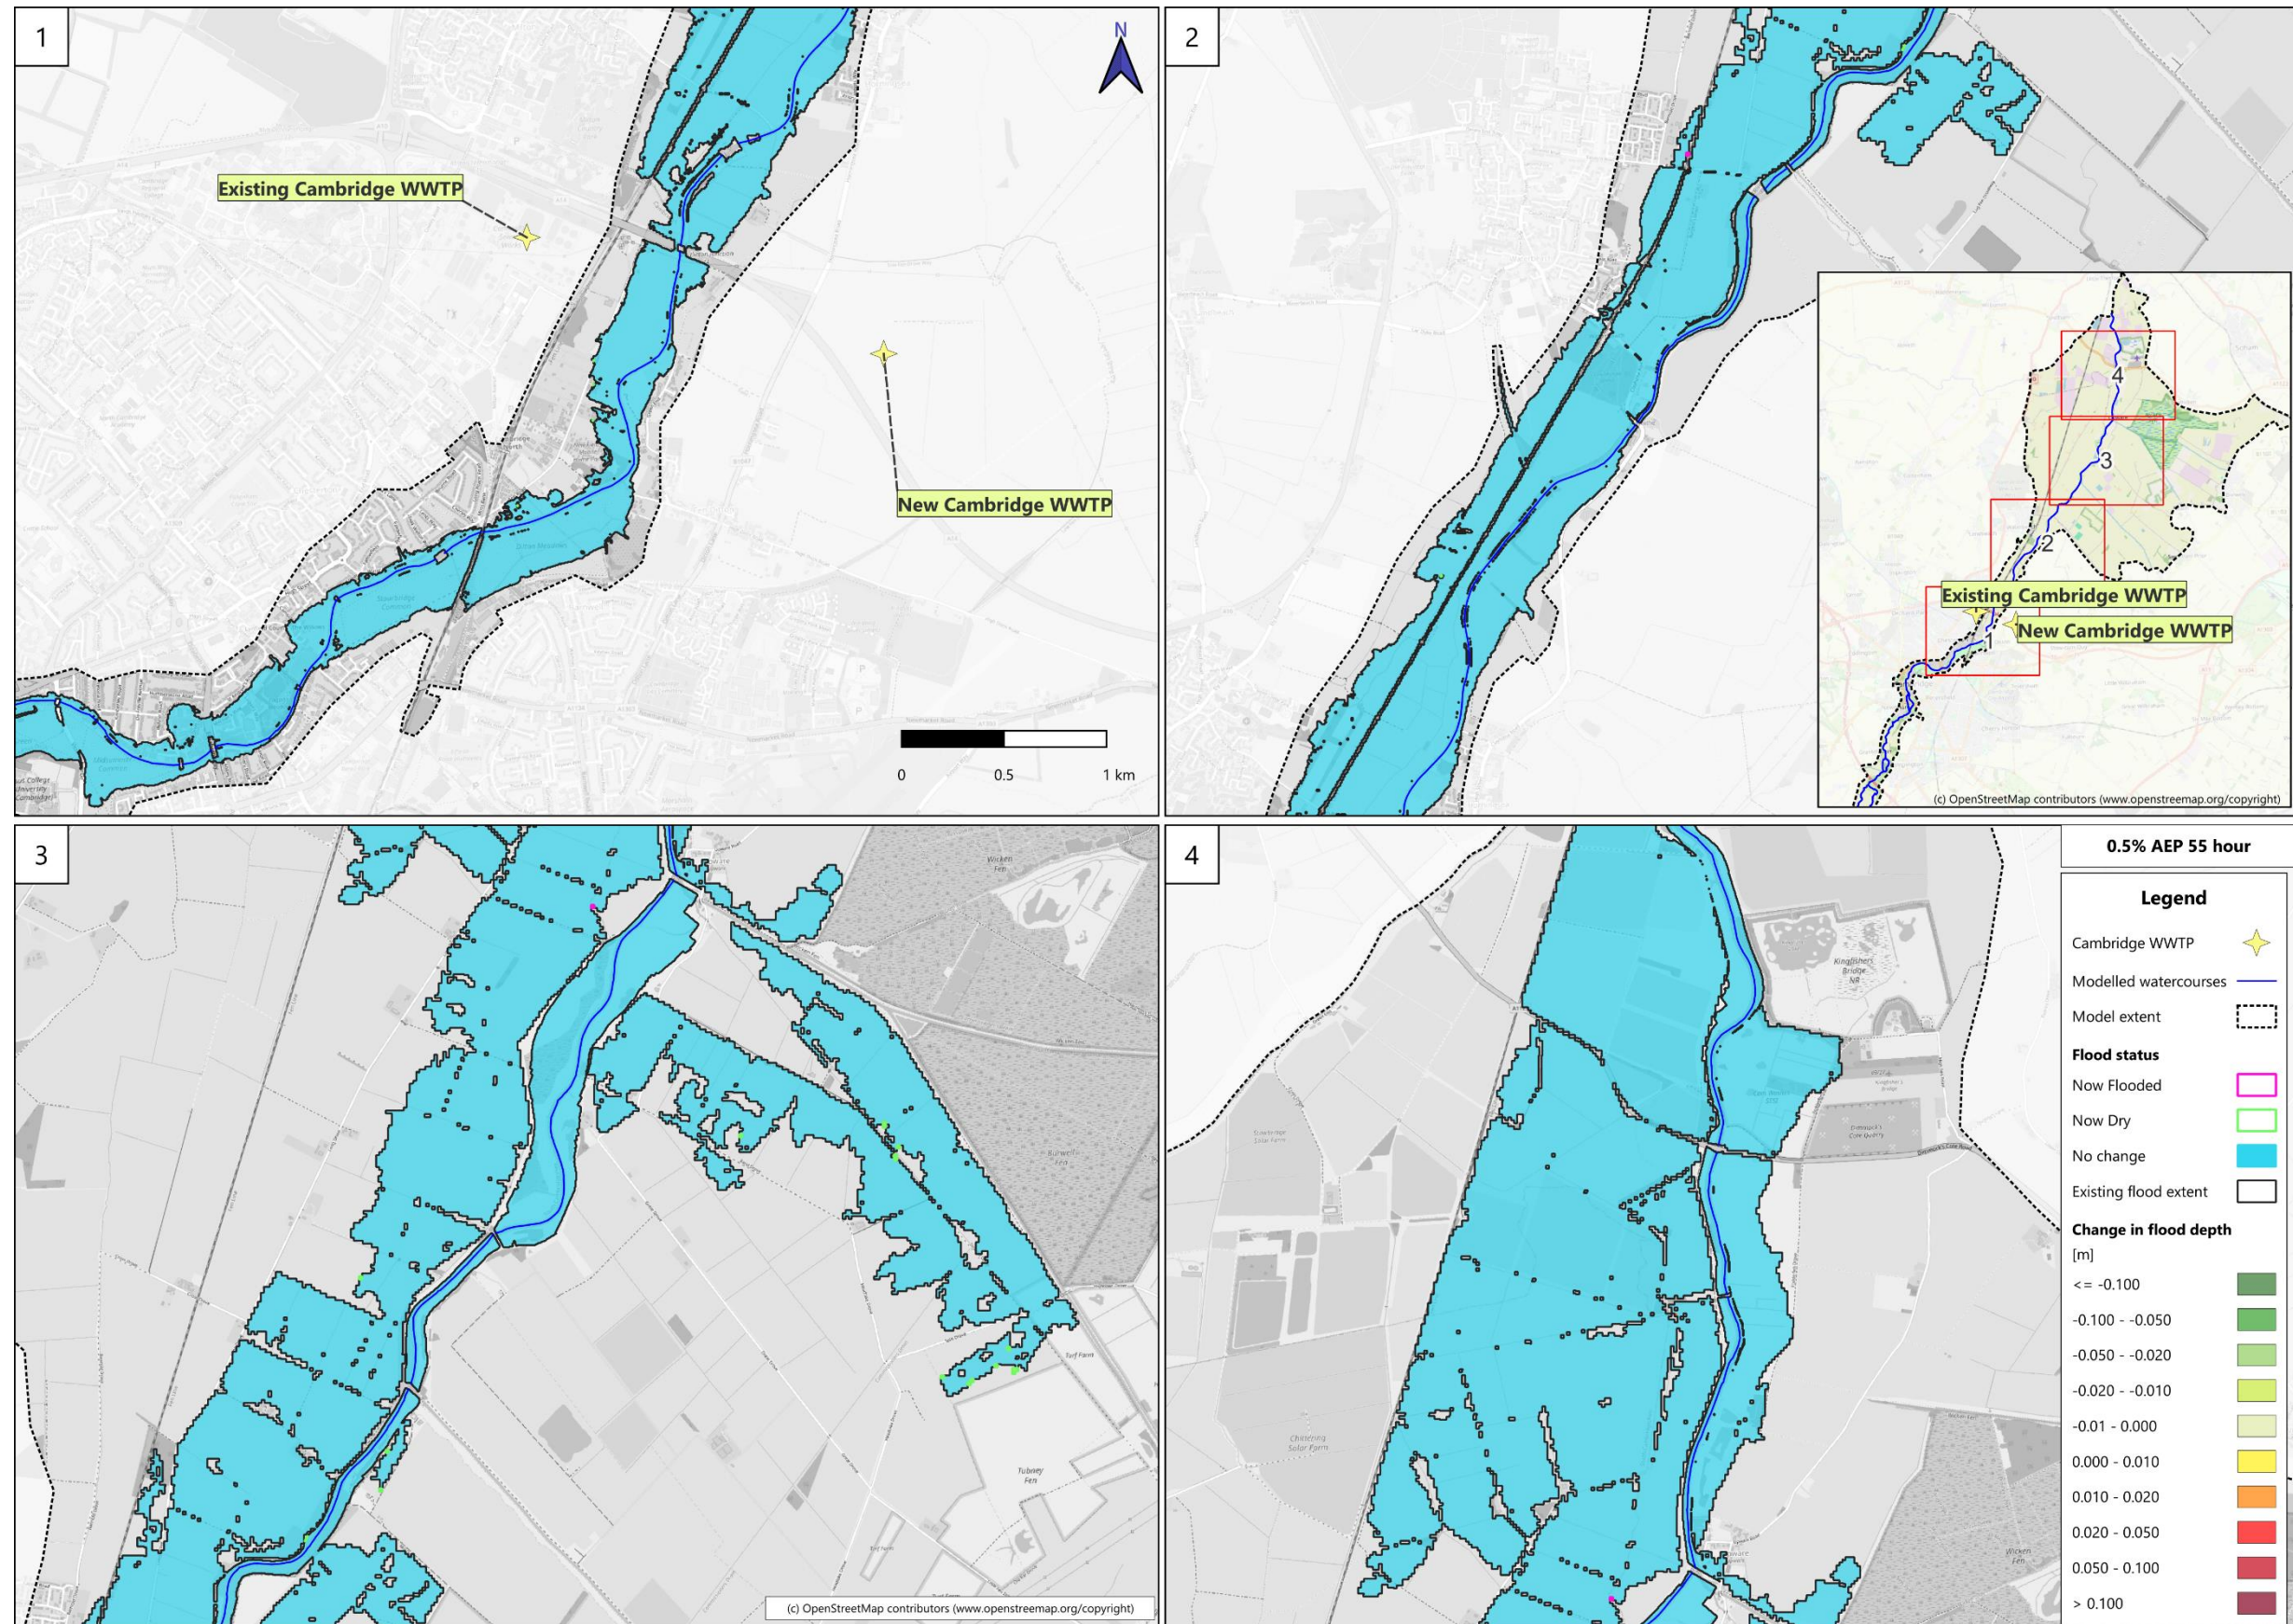

F.8 1 in 1000 year flood

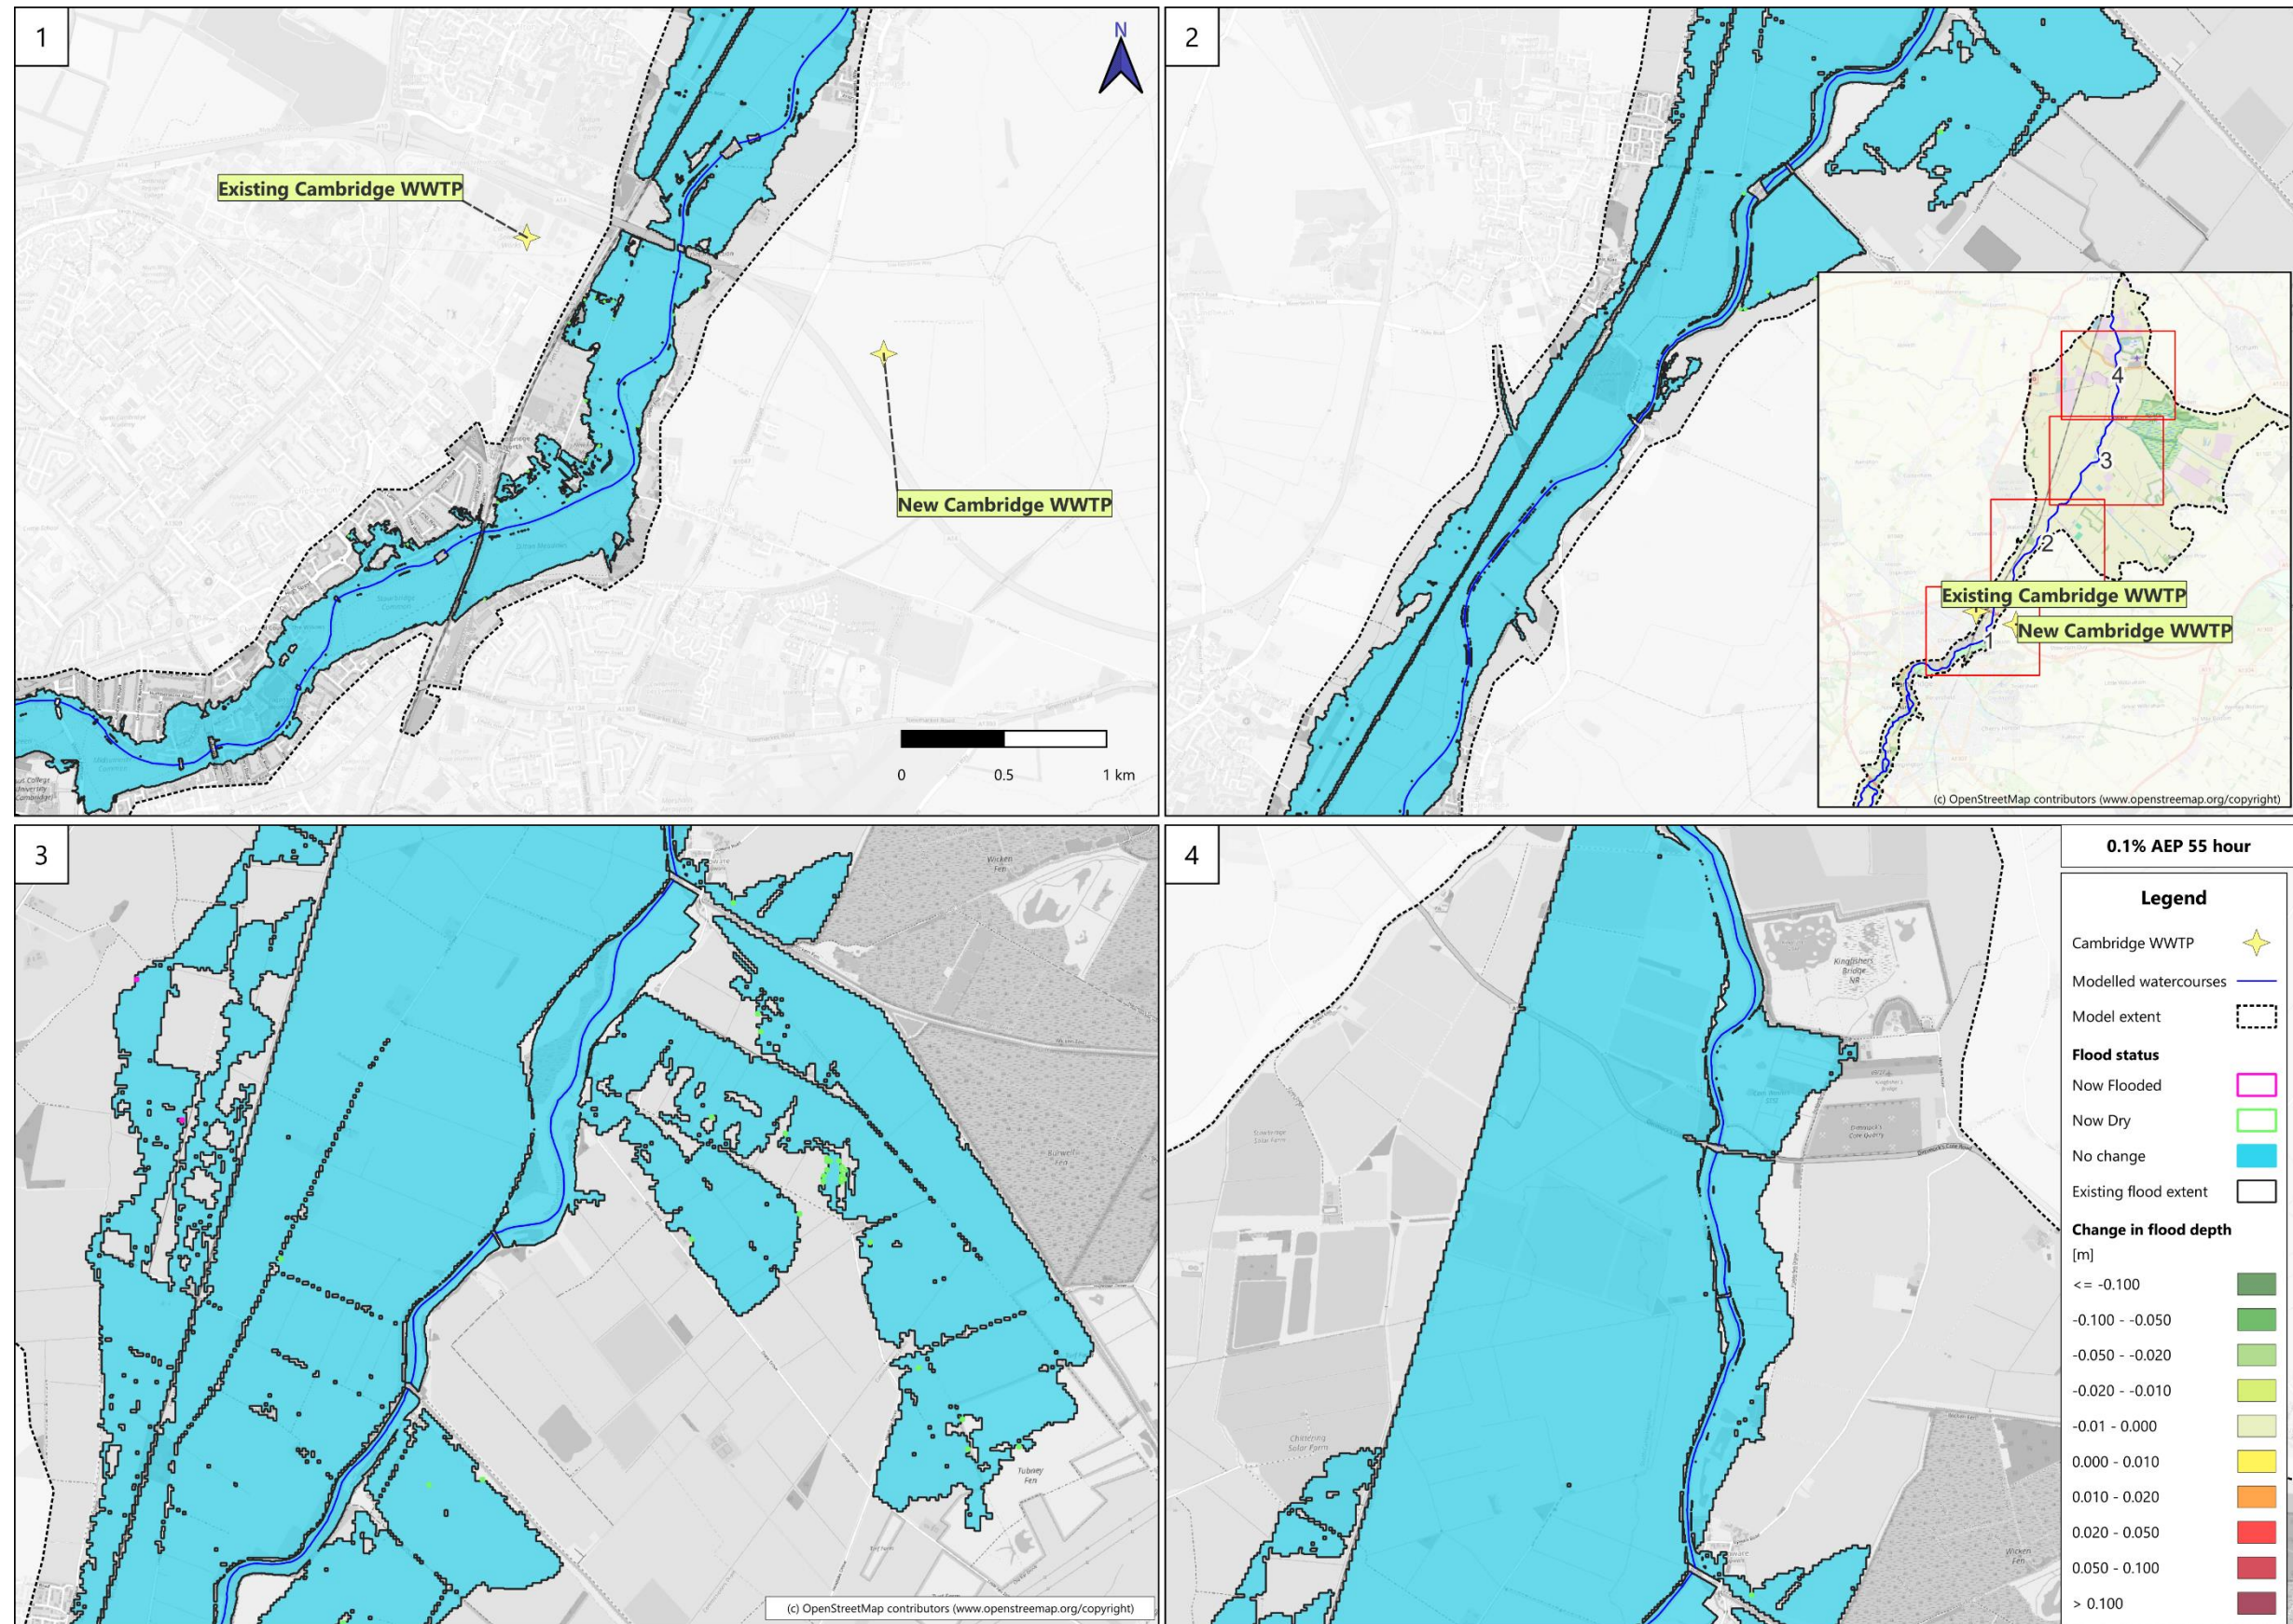


F.9 1 in 100 year flood + 19% climate change

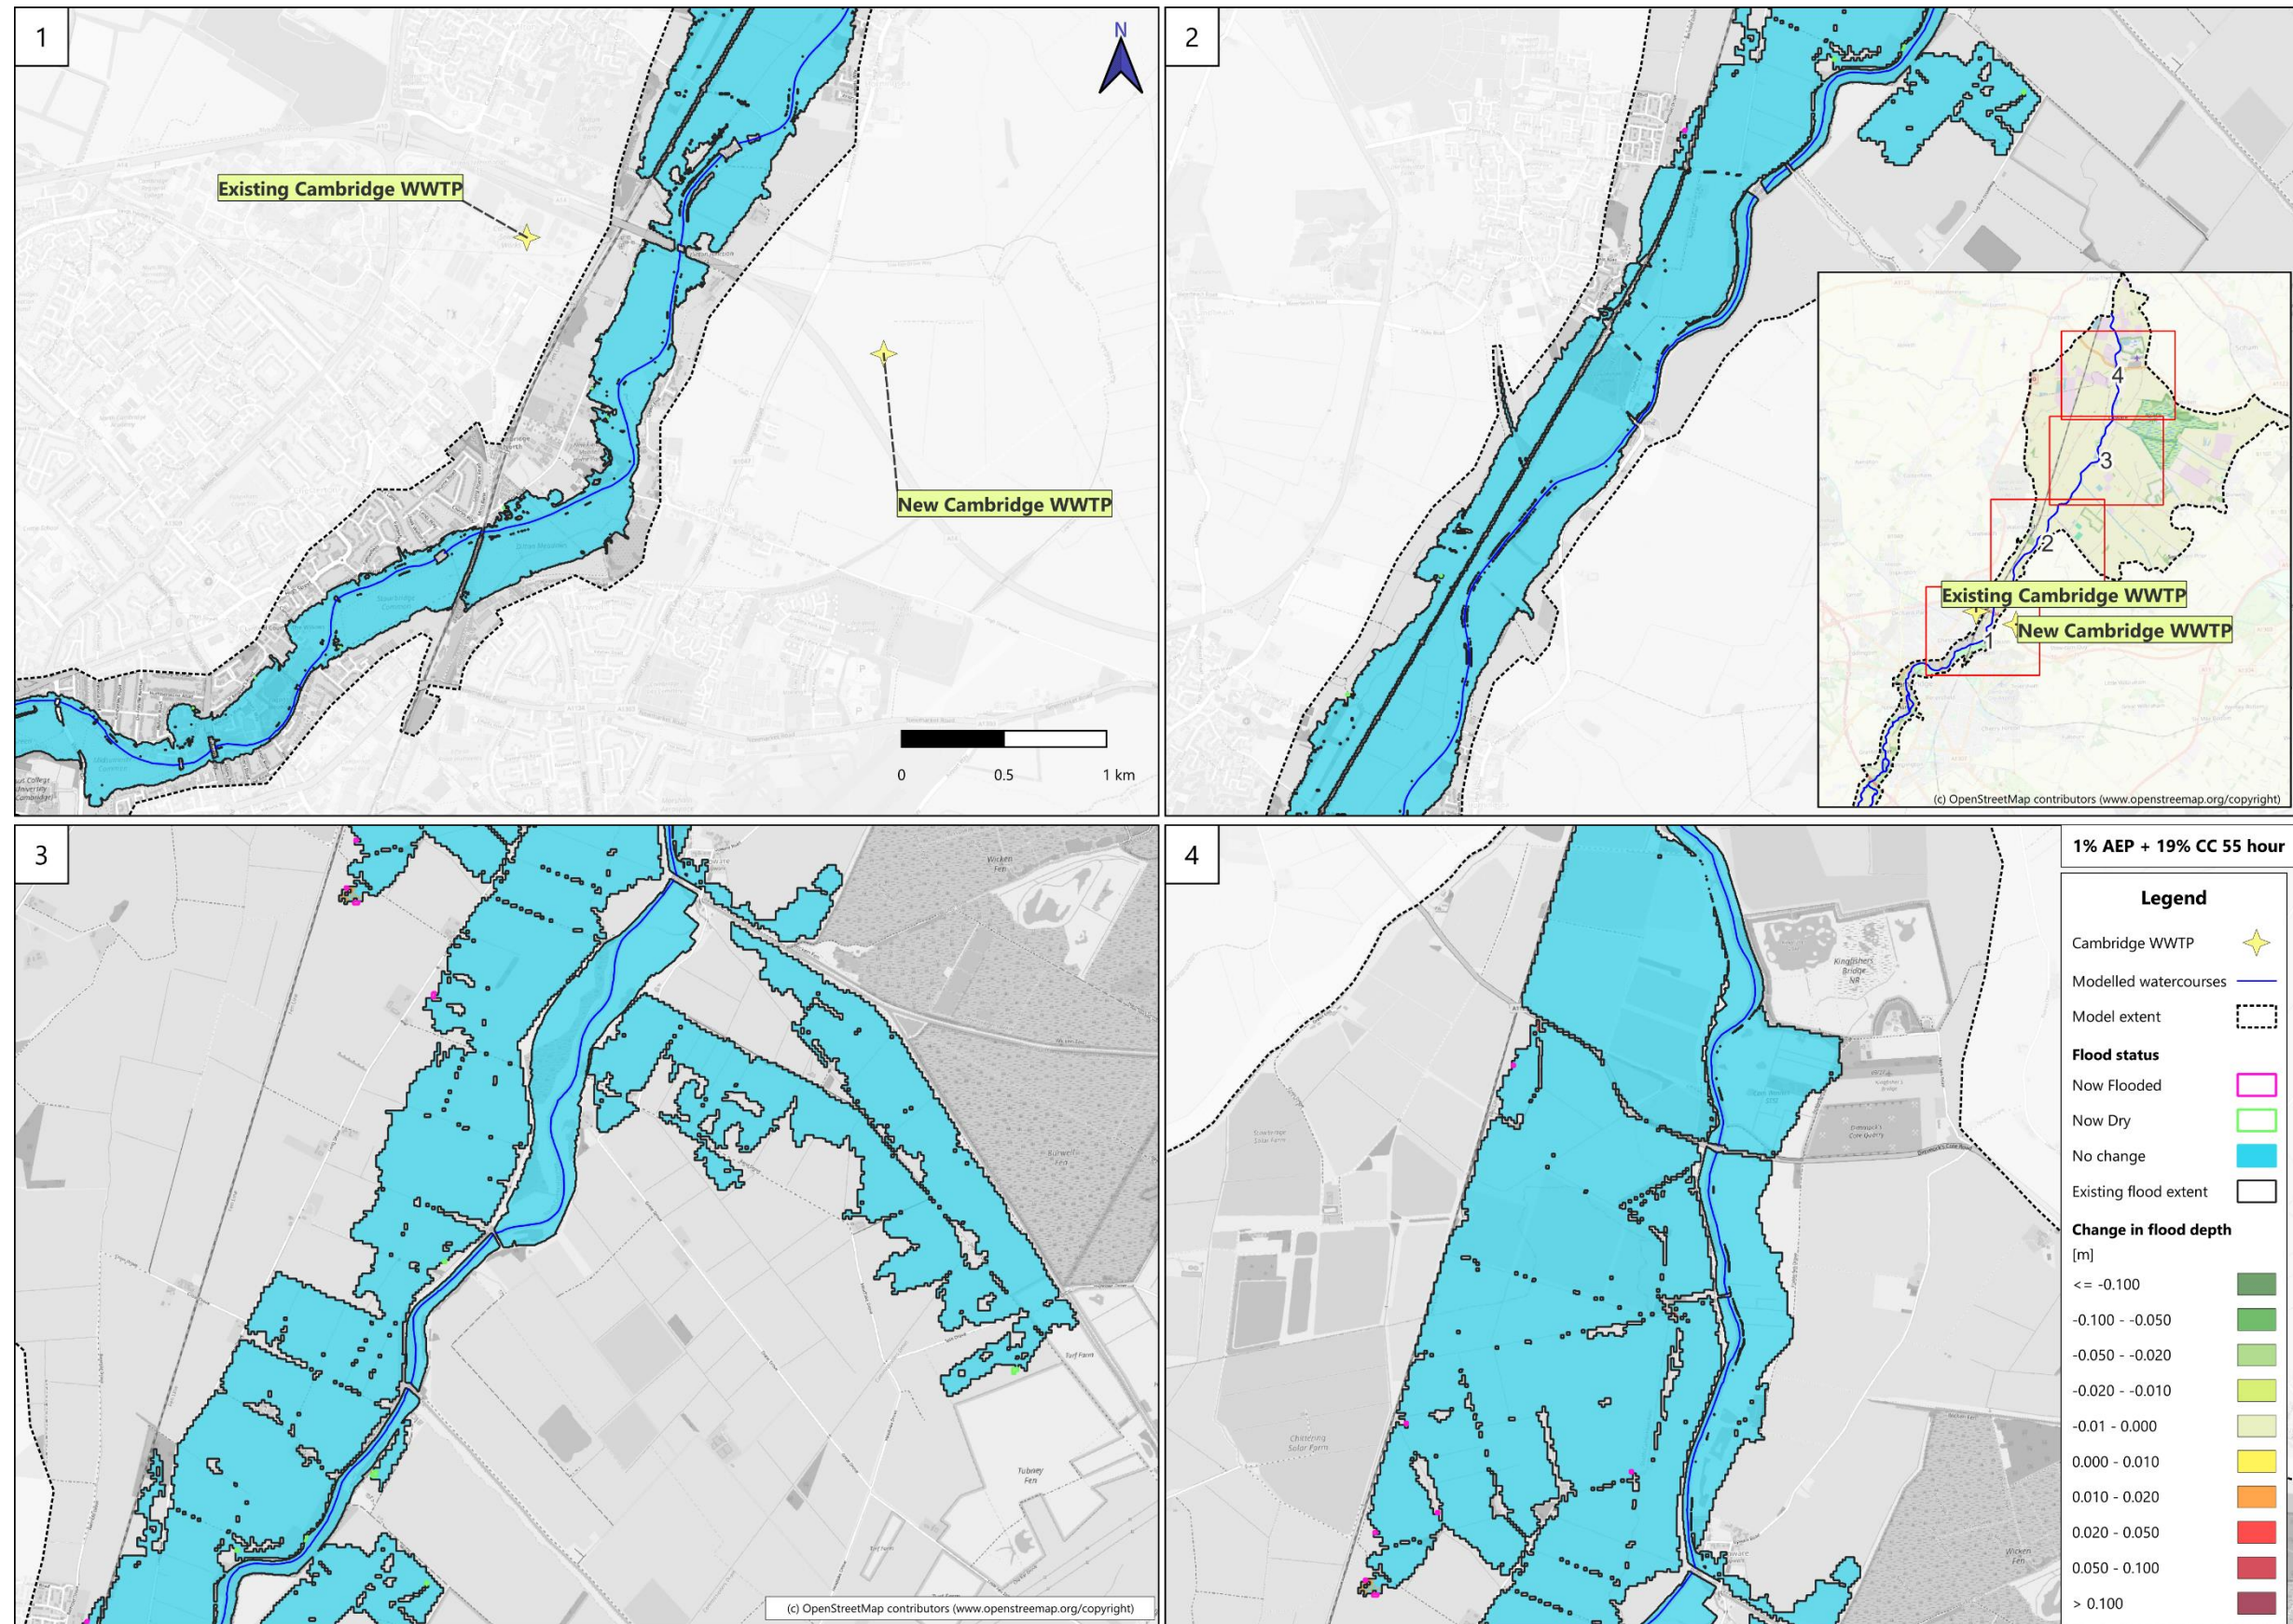




F.10 1 in 100 year flood + 45% climate change

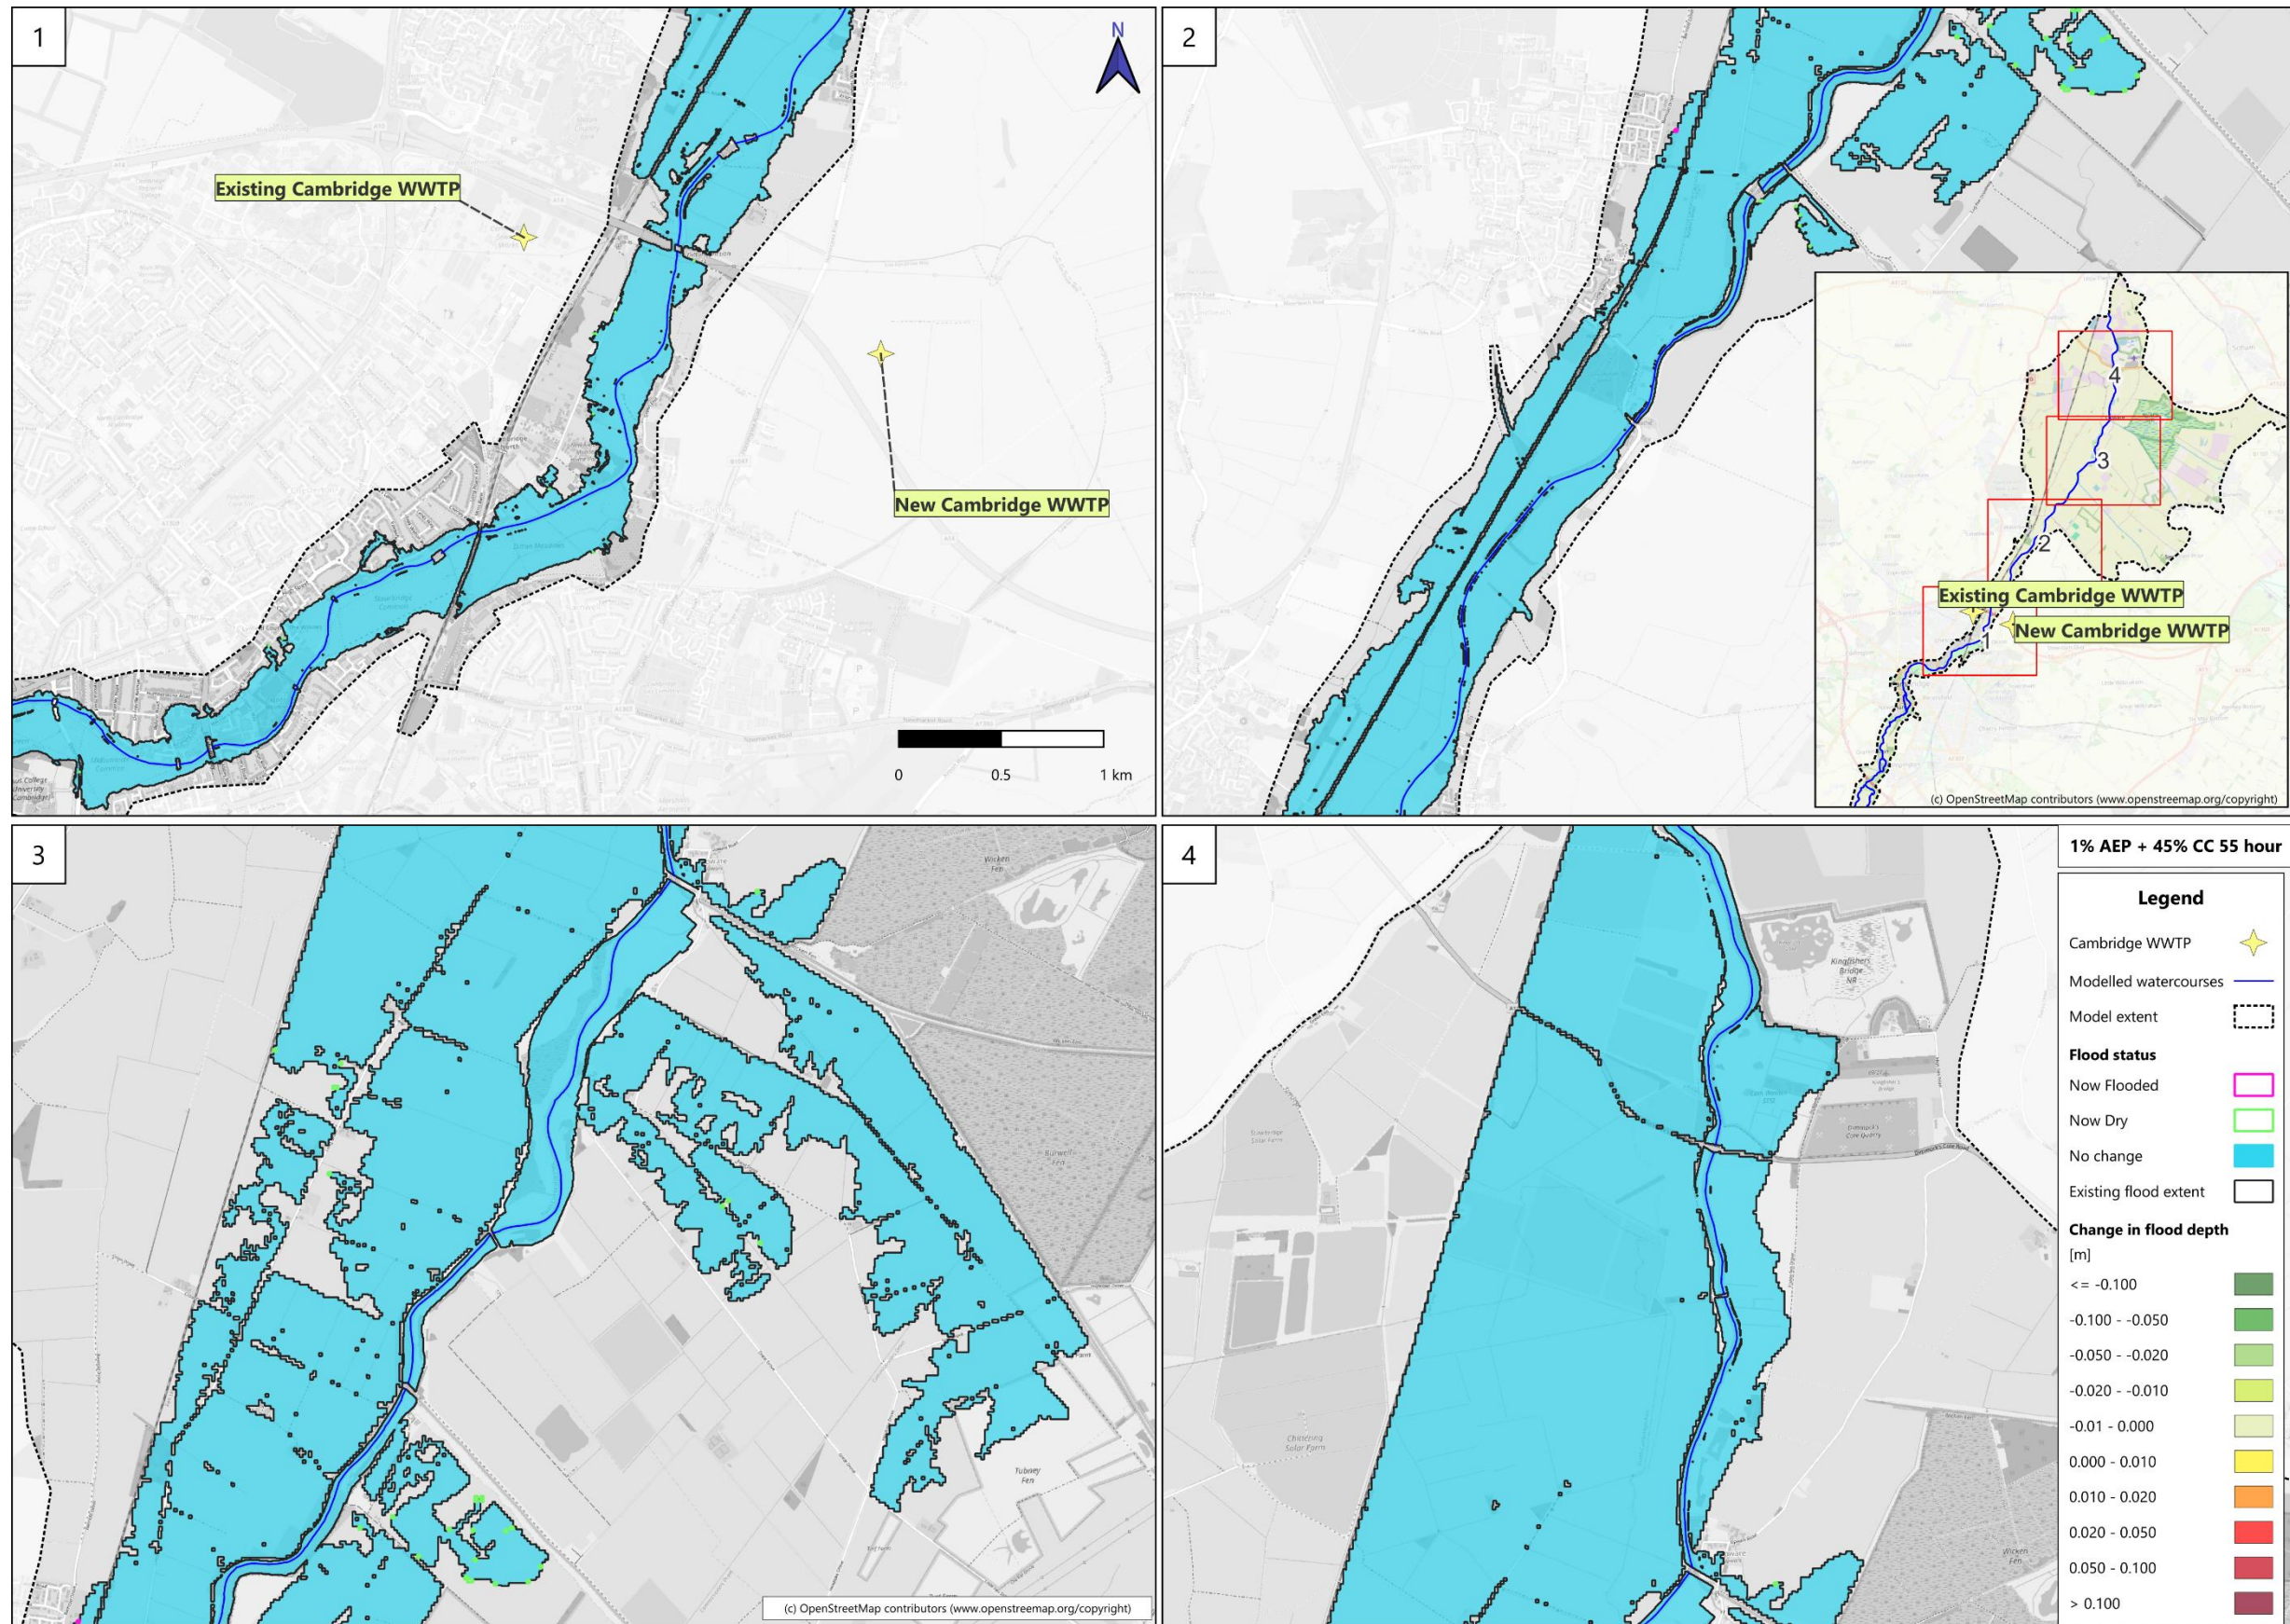


## **Appendix G: Flood difference Existing Future vs New Outfall 4 hour – comparing Existing Future (with growth) to New Outfall (with growth)**


G.1 1 in 100 year flood

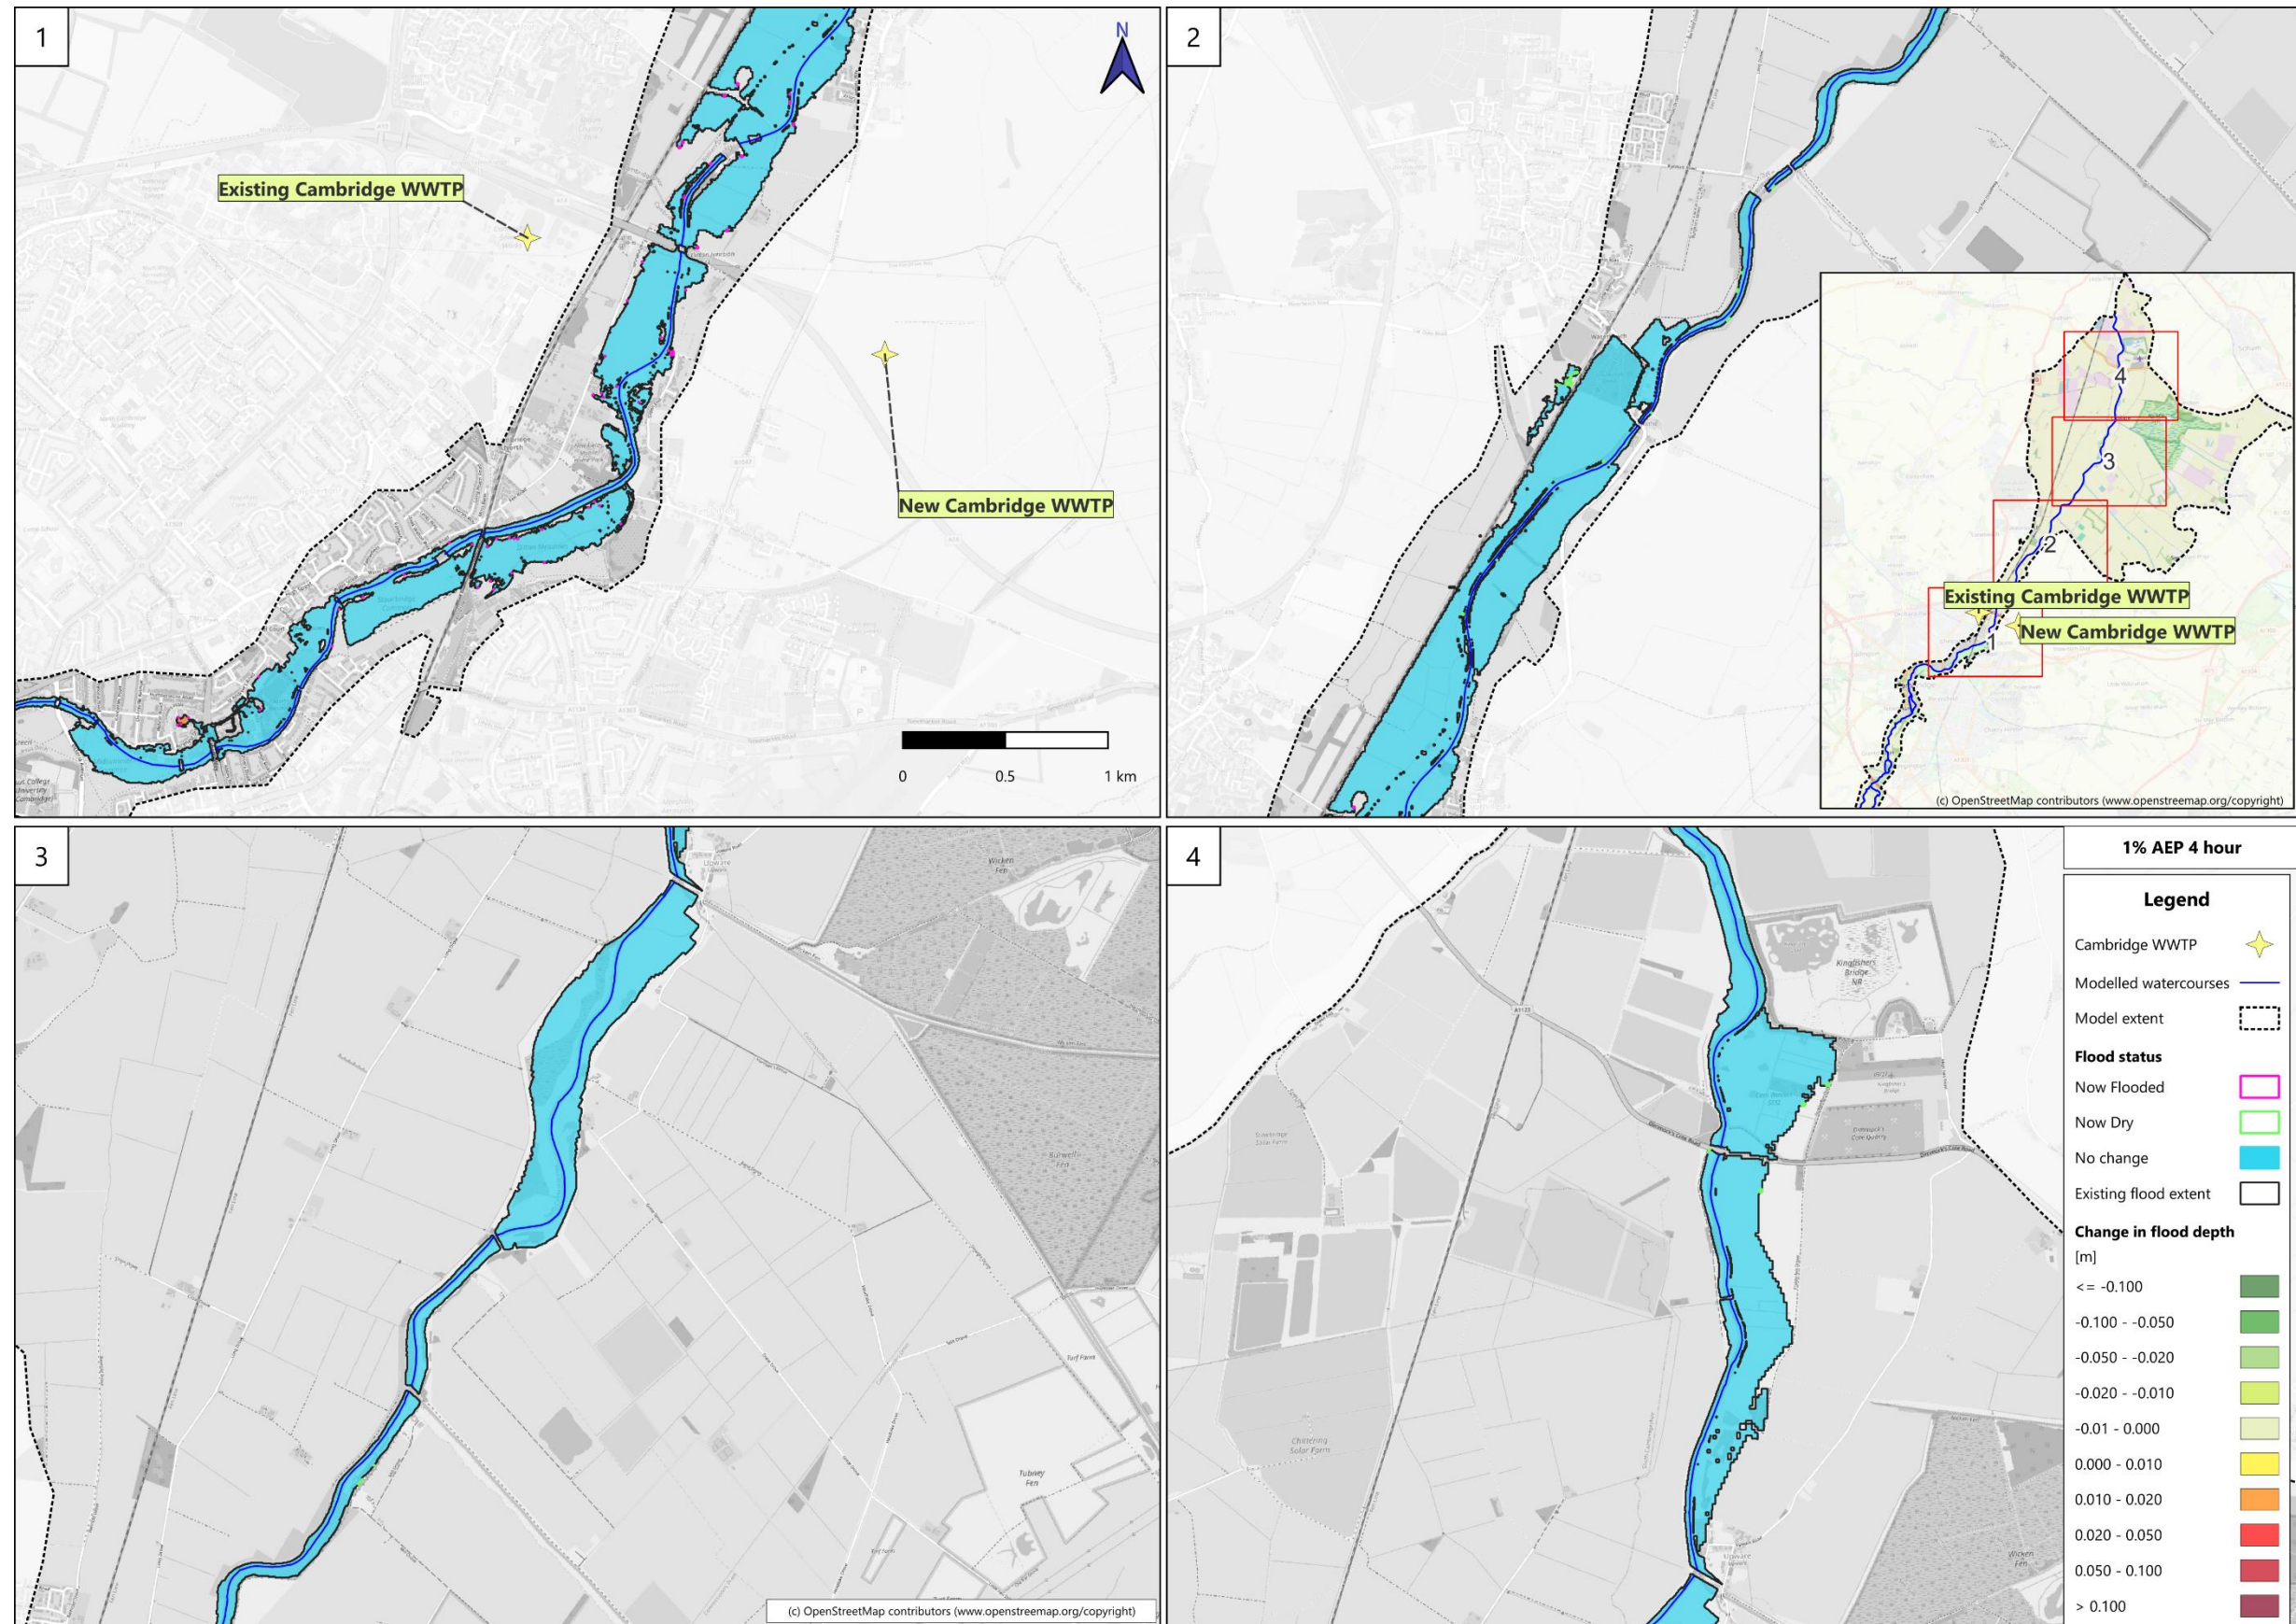


G.2 1 in 100 year flood + 9% climate change

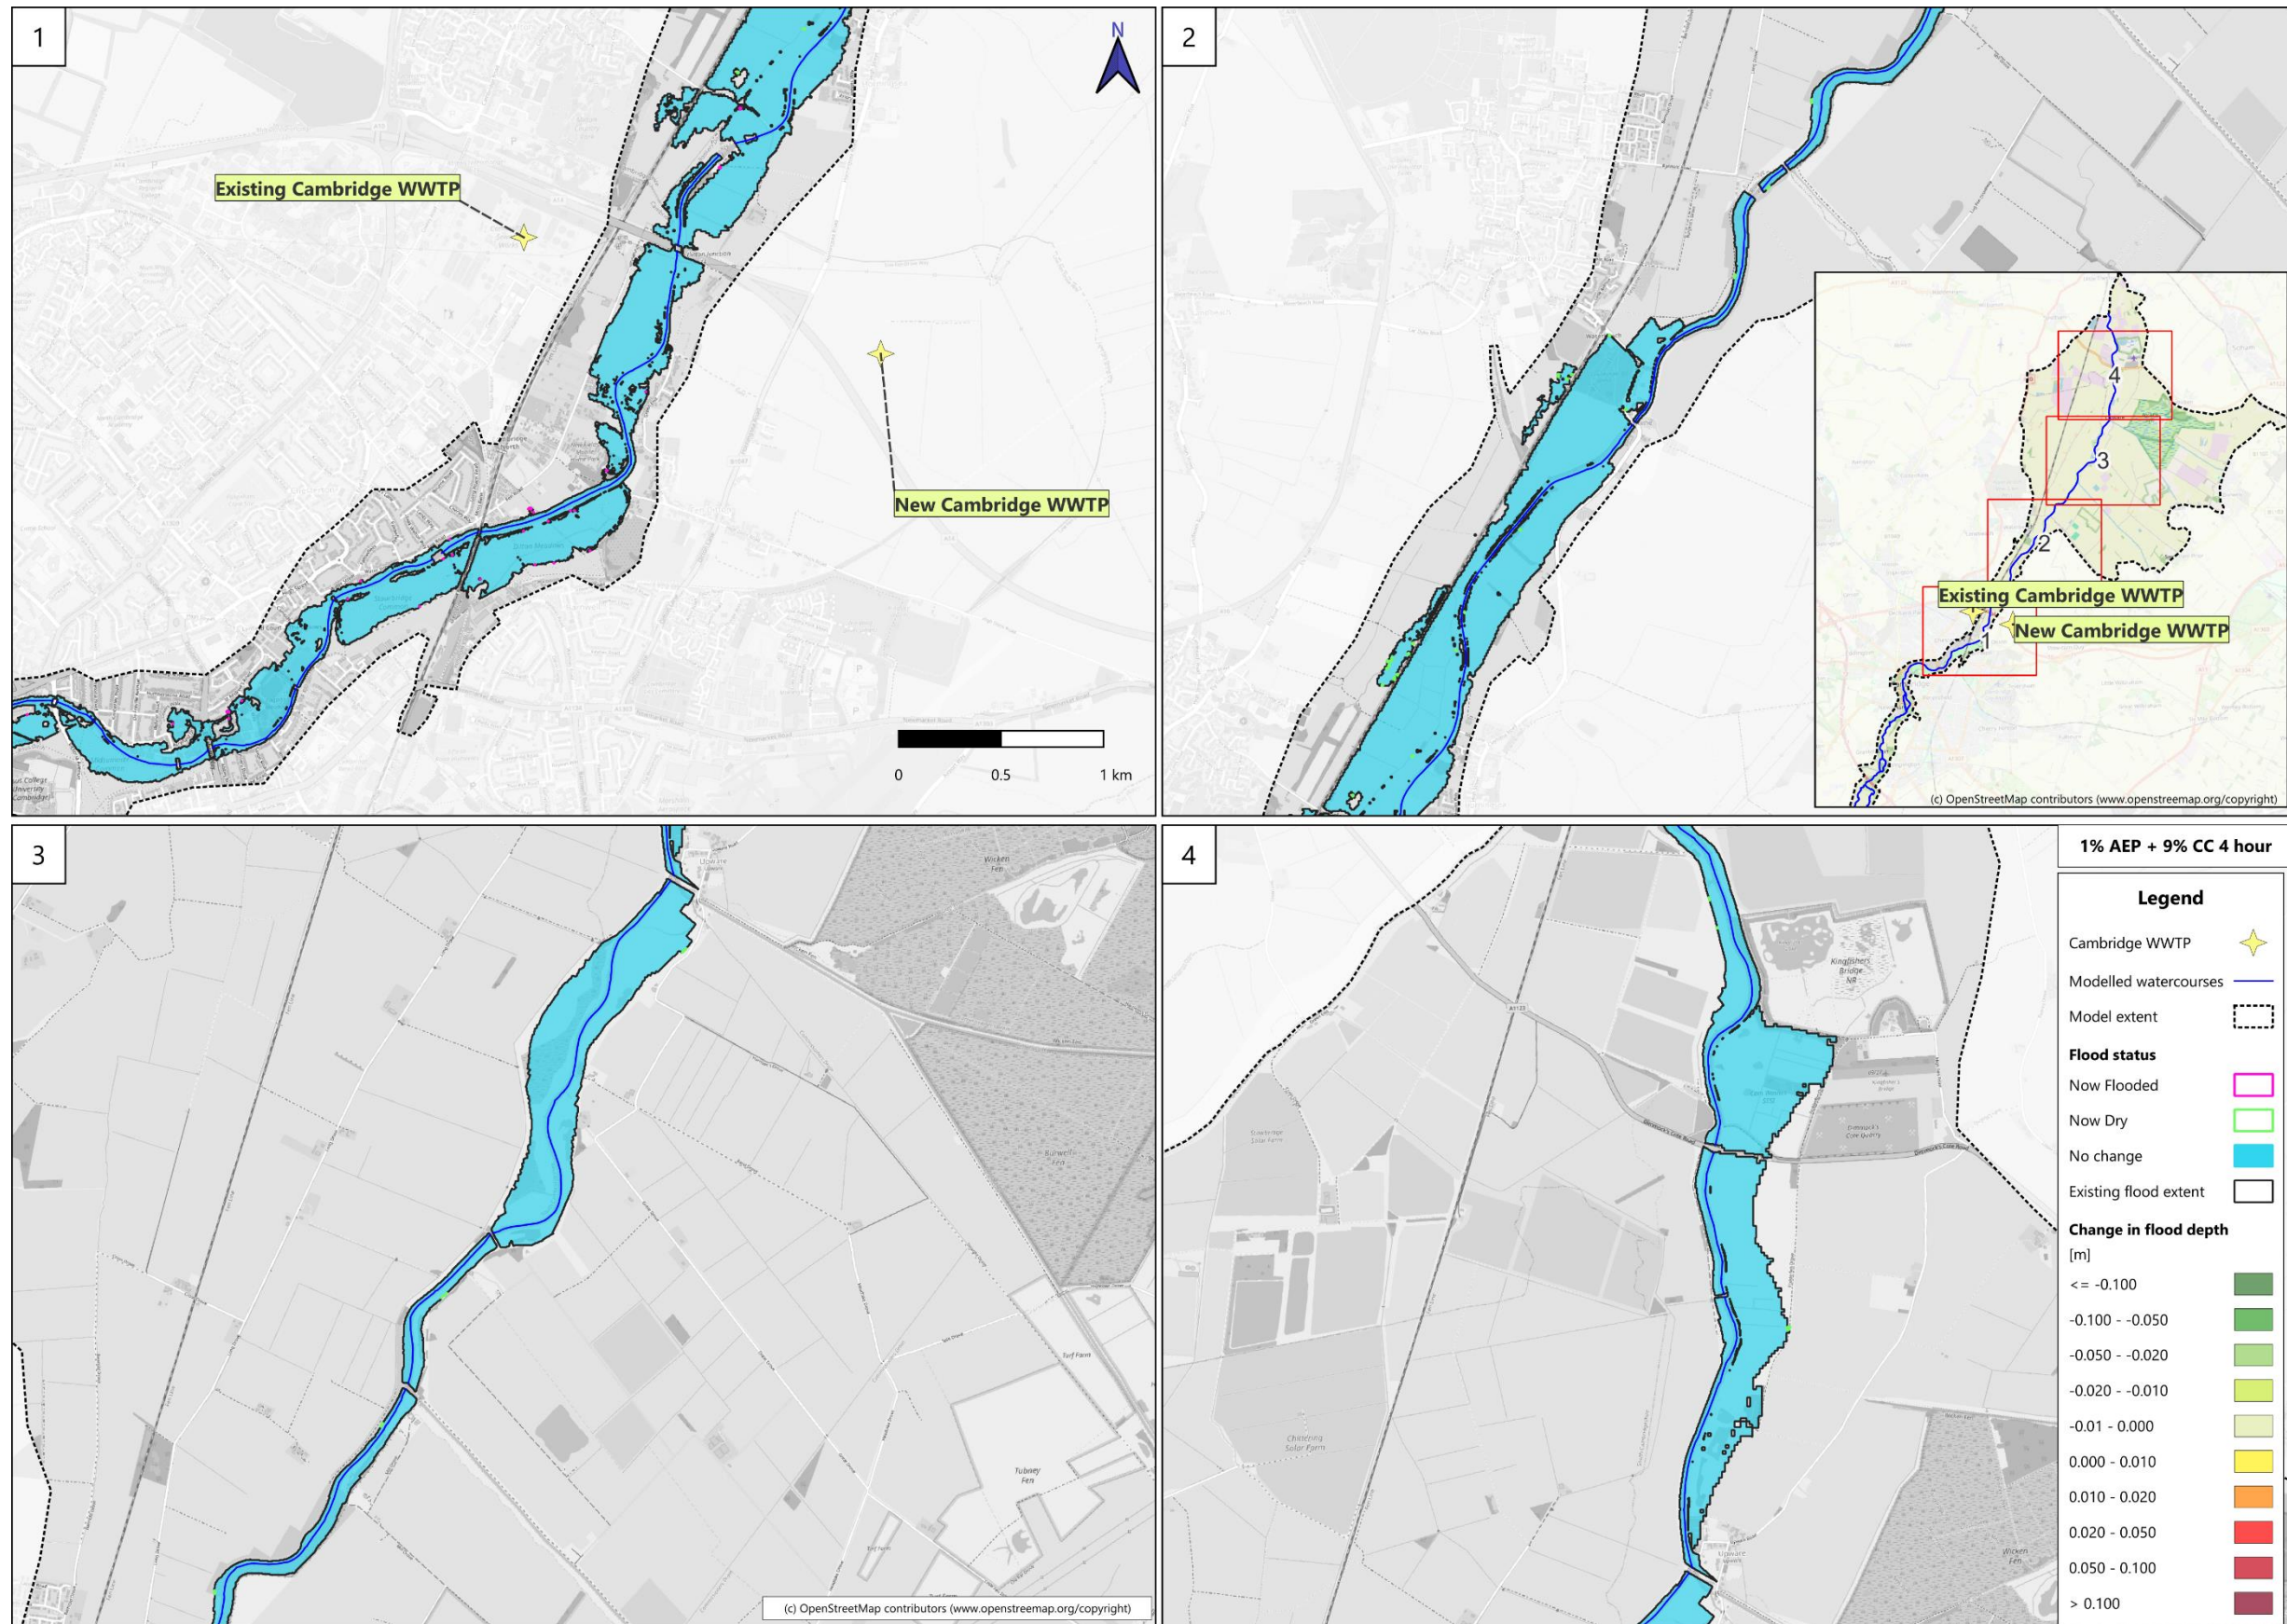

G.3 1 in 100 year flood + 19% climate change

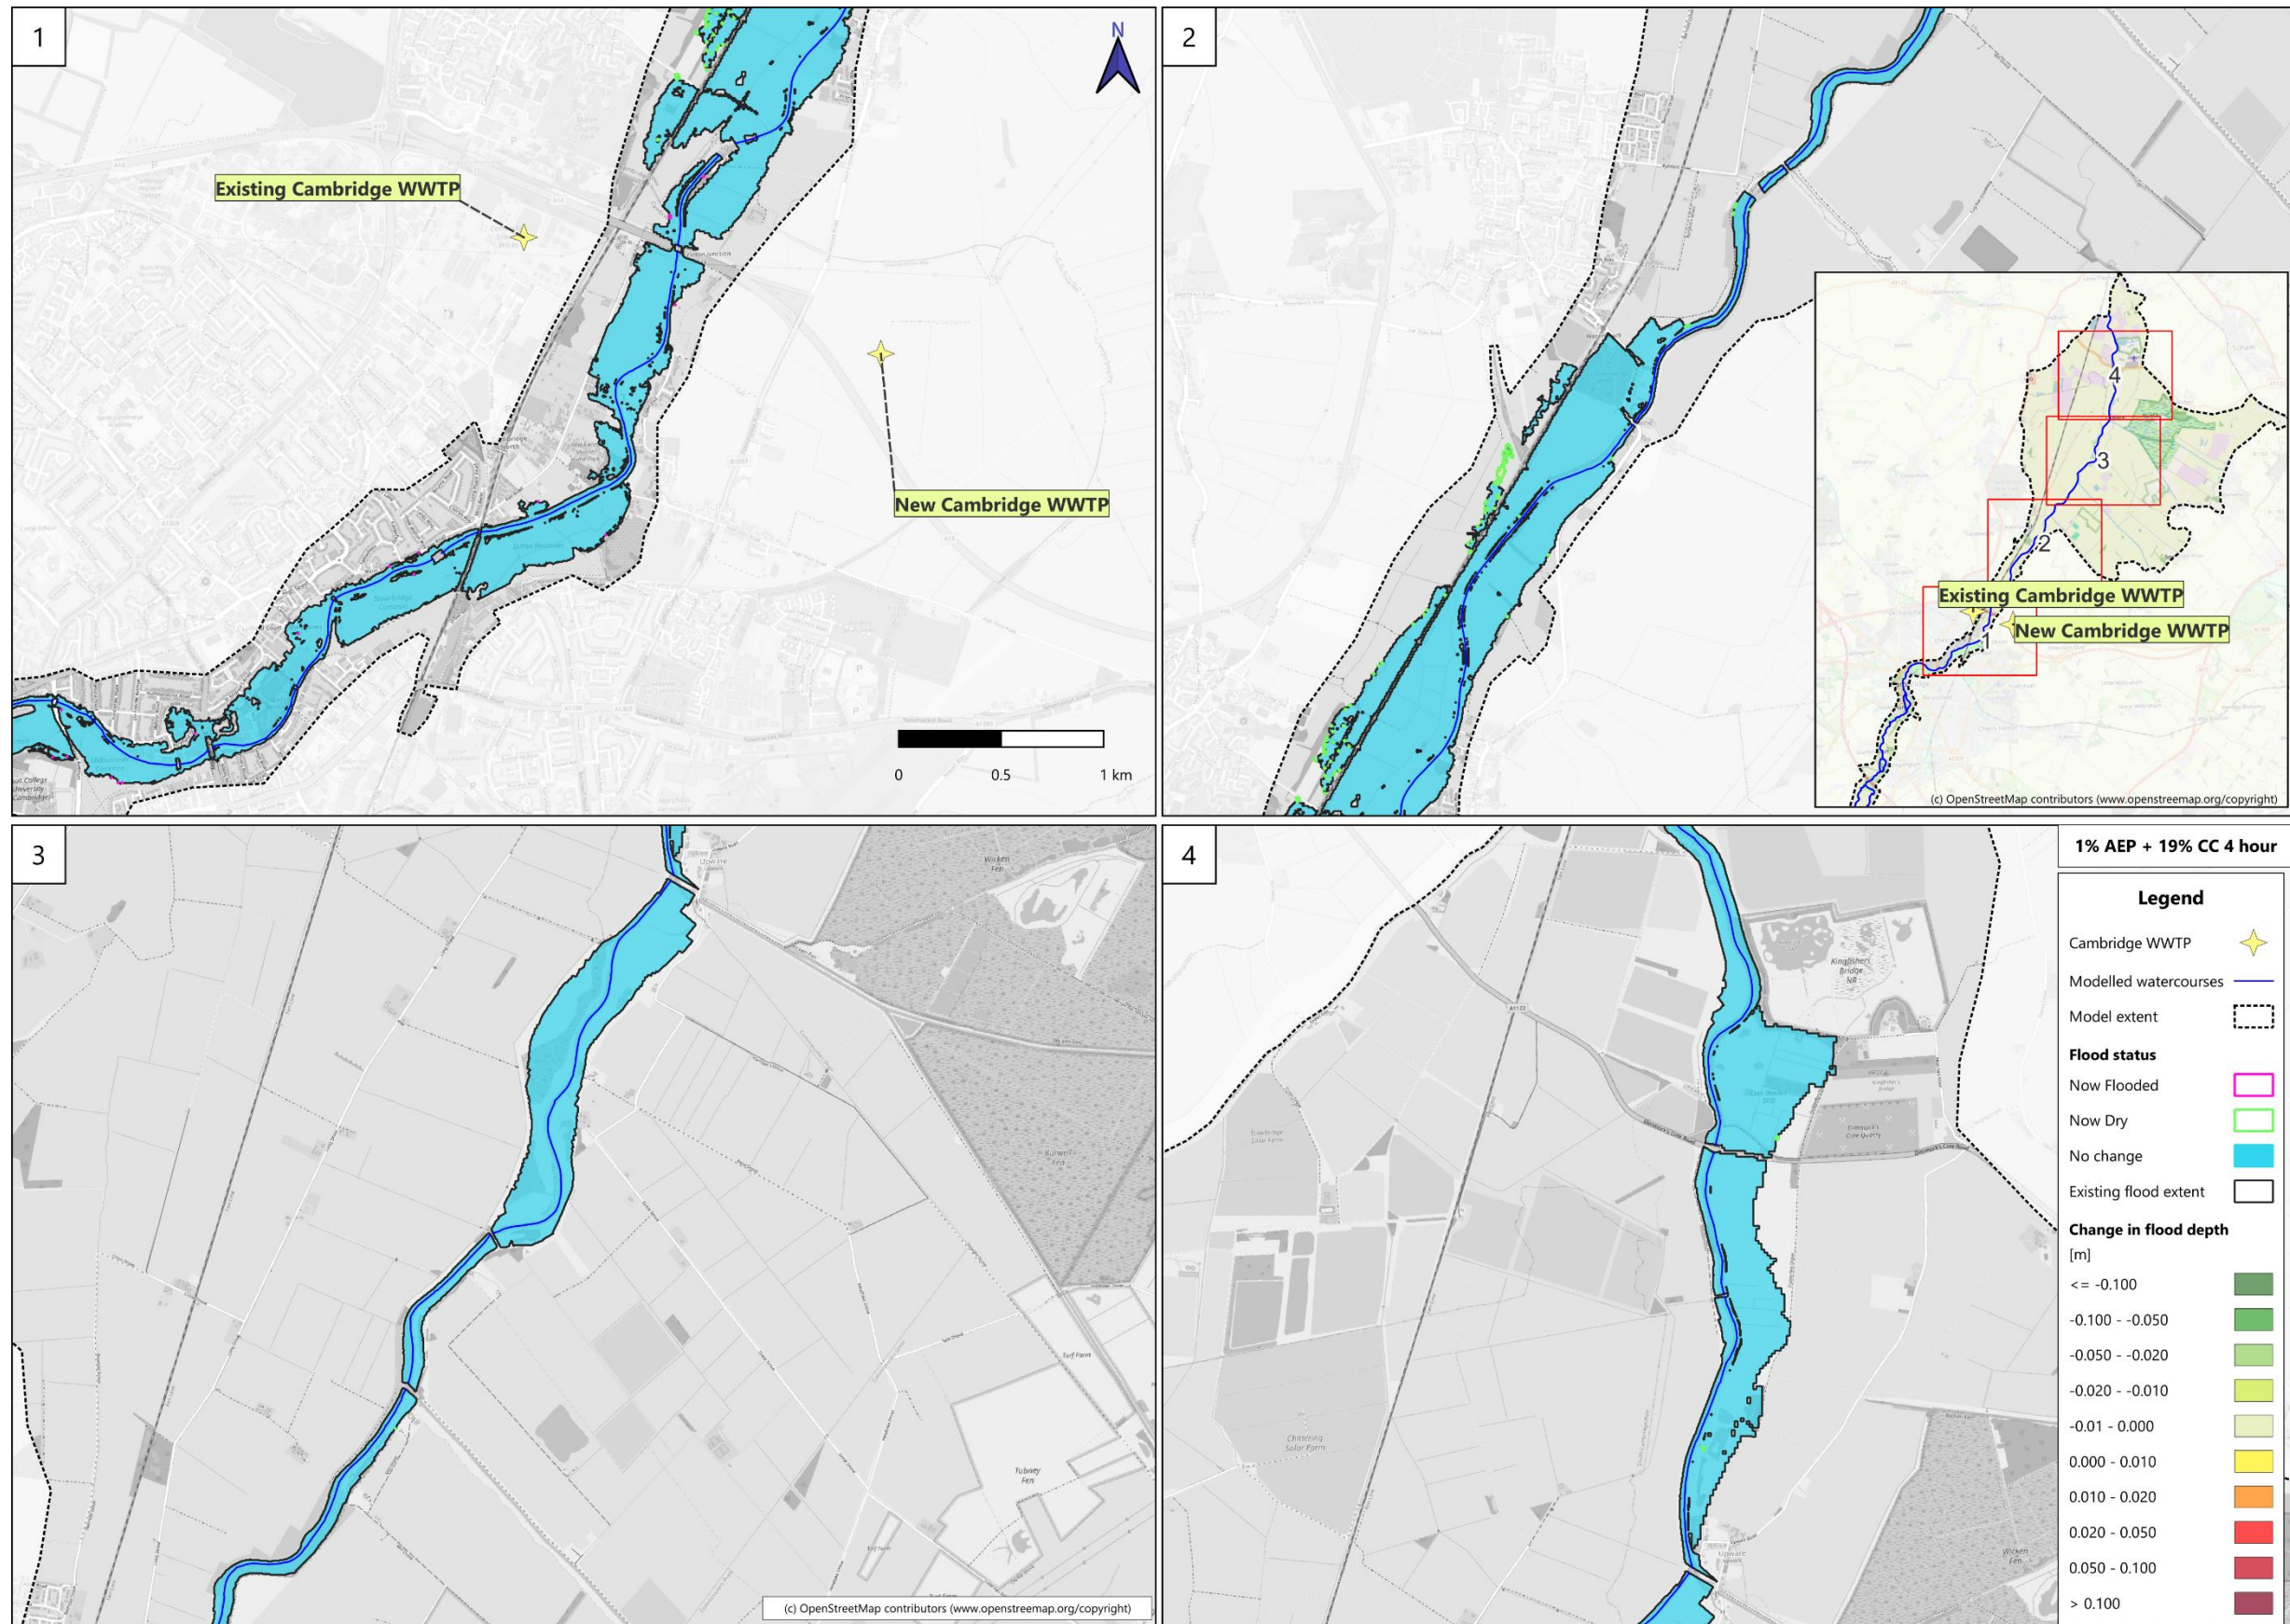

G.4 1 in 100 year flood + 45% climate change

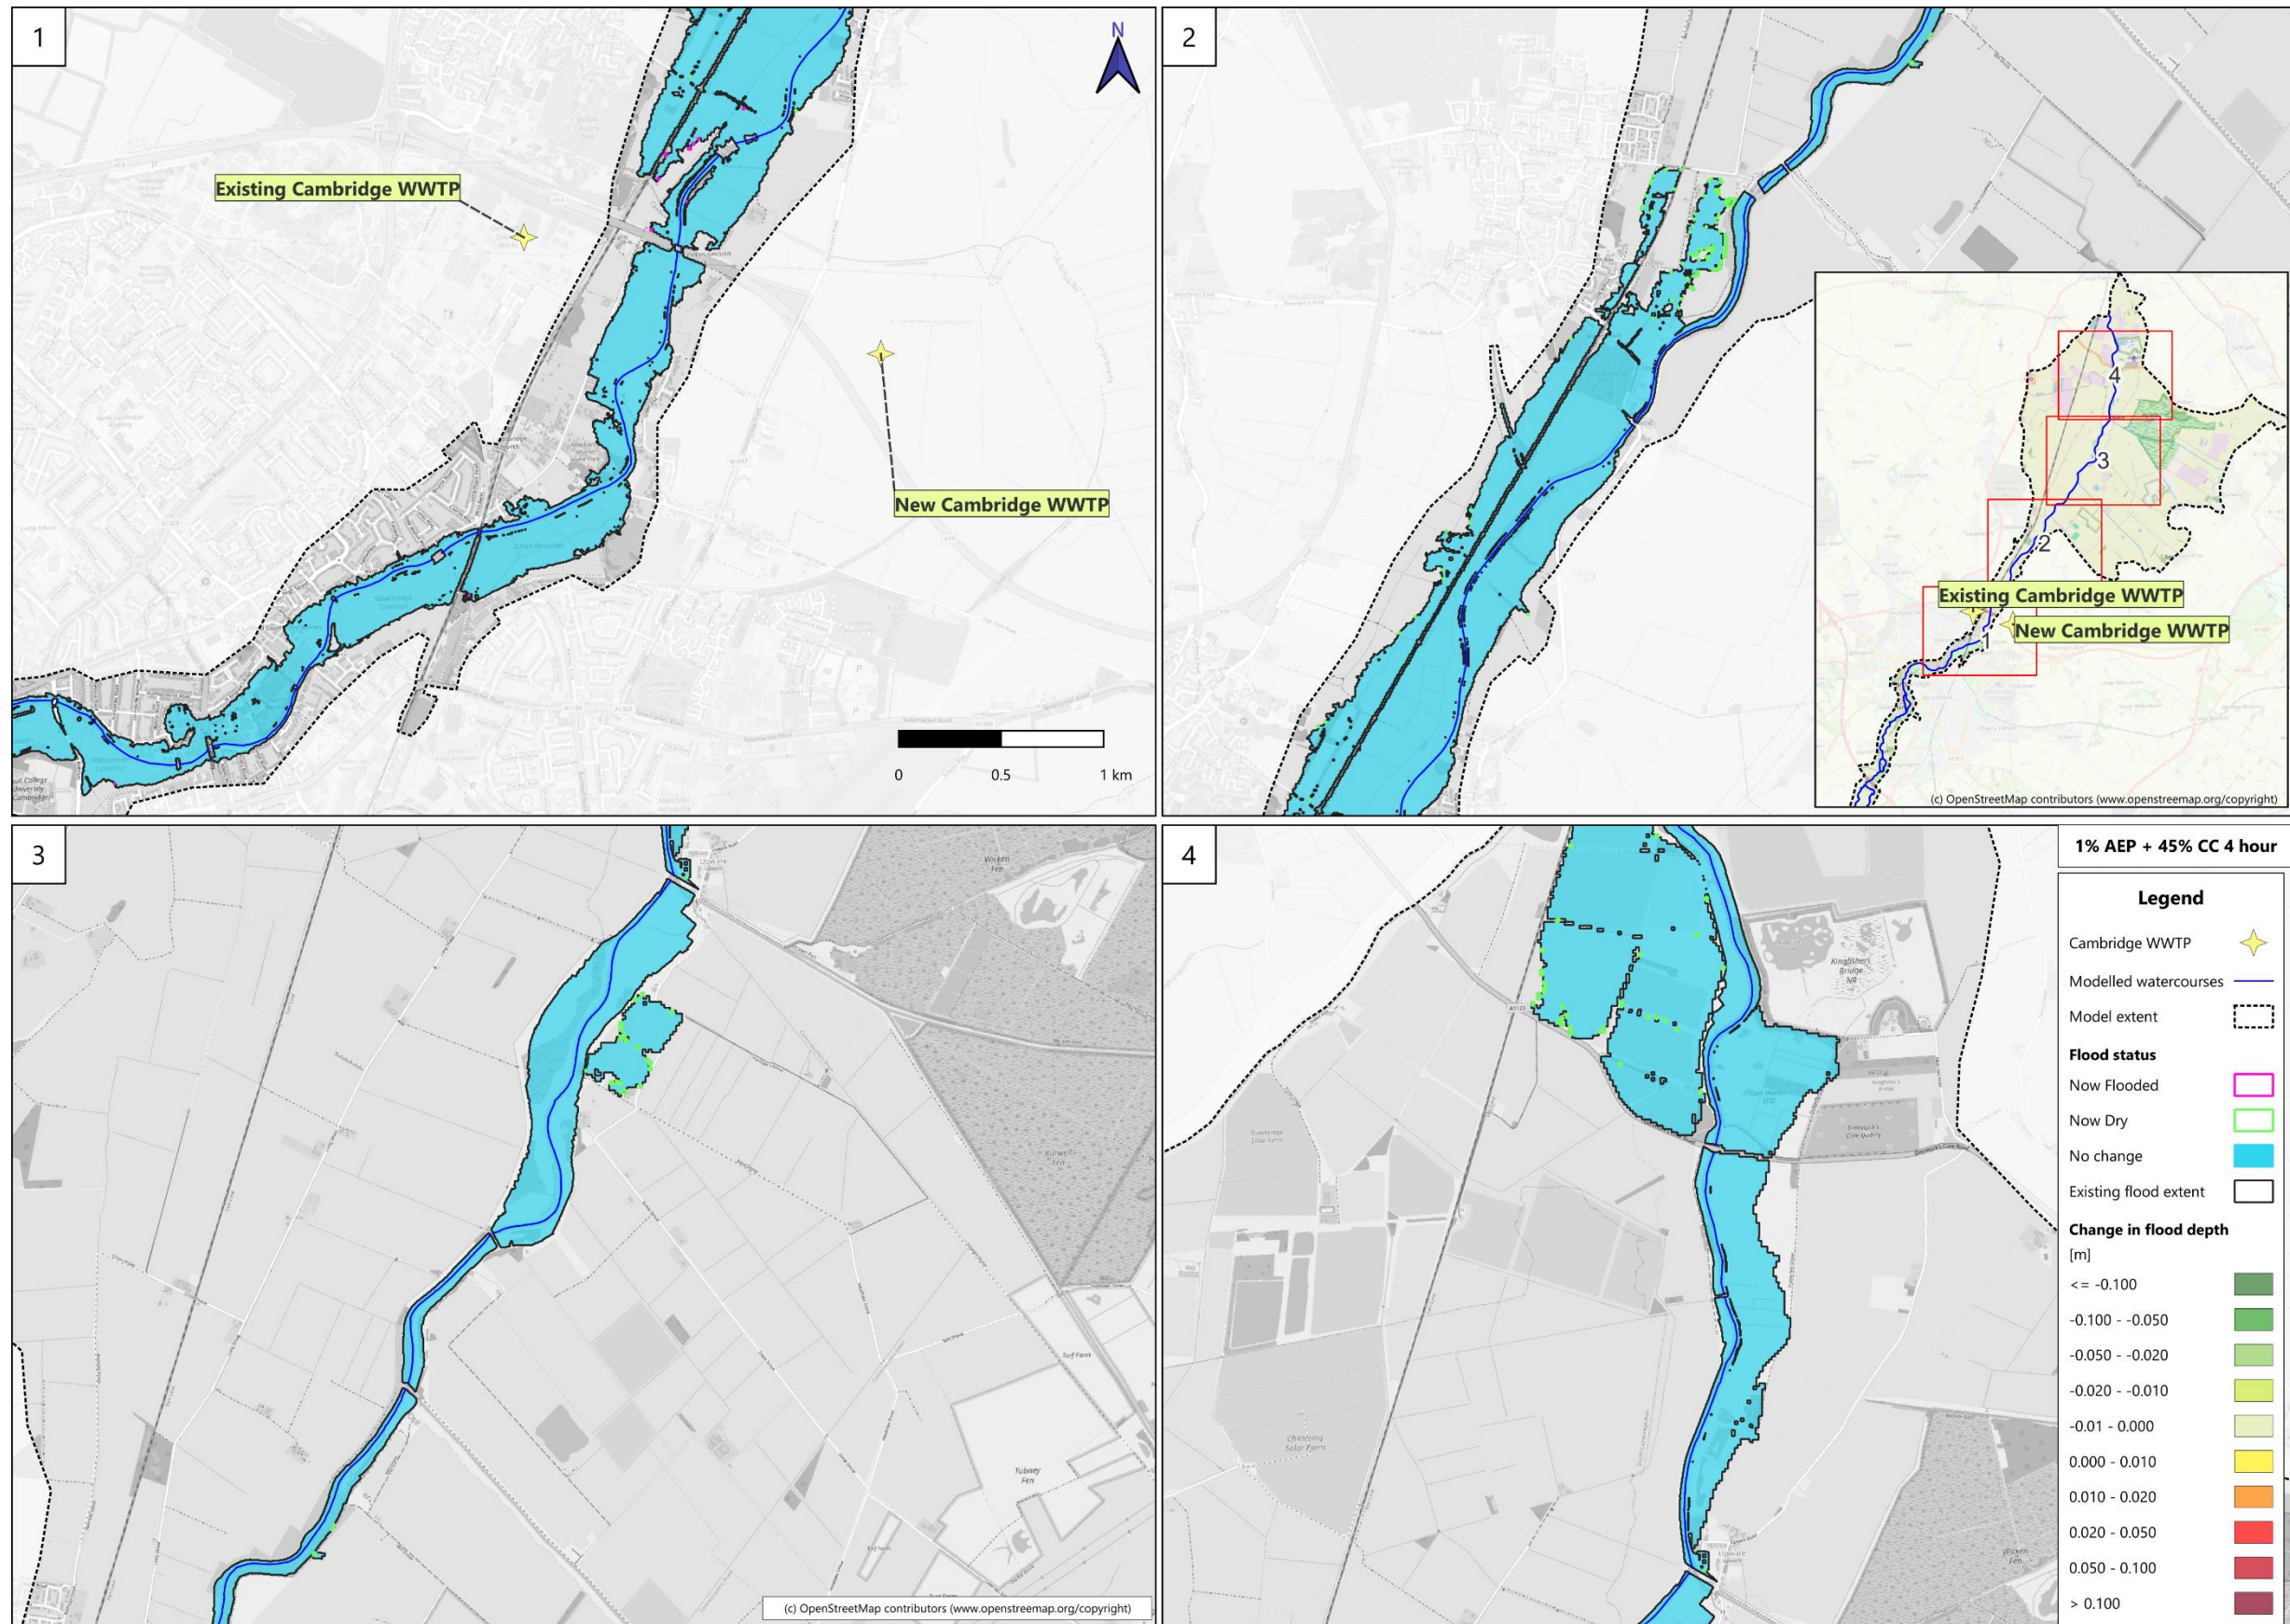

## Get in touch

You can contact us by:



Emailing at [info@cwwtpr.com](mailto:info@cwwtpr.com)



Calling our Freephone information line on **0808 196 1661**



Writing to us at **Freepost: CWWTPR**

You can view all our DCO application documents and updates on the application on The Planning Inspectorate website:

<https://infrastructure.planninginspectorate.gov.uk/projects/eastern/cambridge-waste-water-treatment-plant-relocation/>